


This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

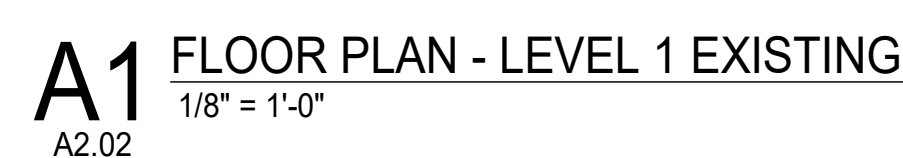


A. Window glazing is positive for all windows

1 Metallic silver roofing bull on exterior roof is positive. This includes exterior roofing, parapet wall, roof penetrations, and flashings.

WINDOW GLAZING

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES

[illegible]

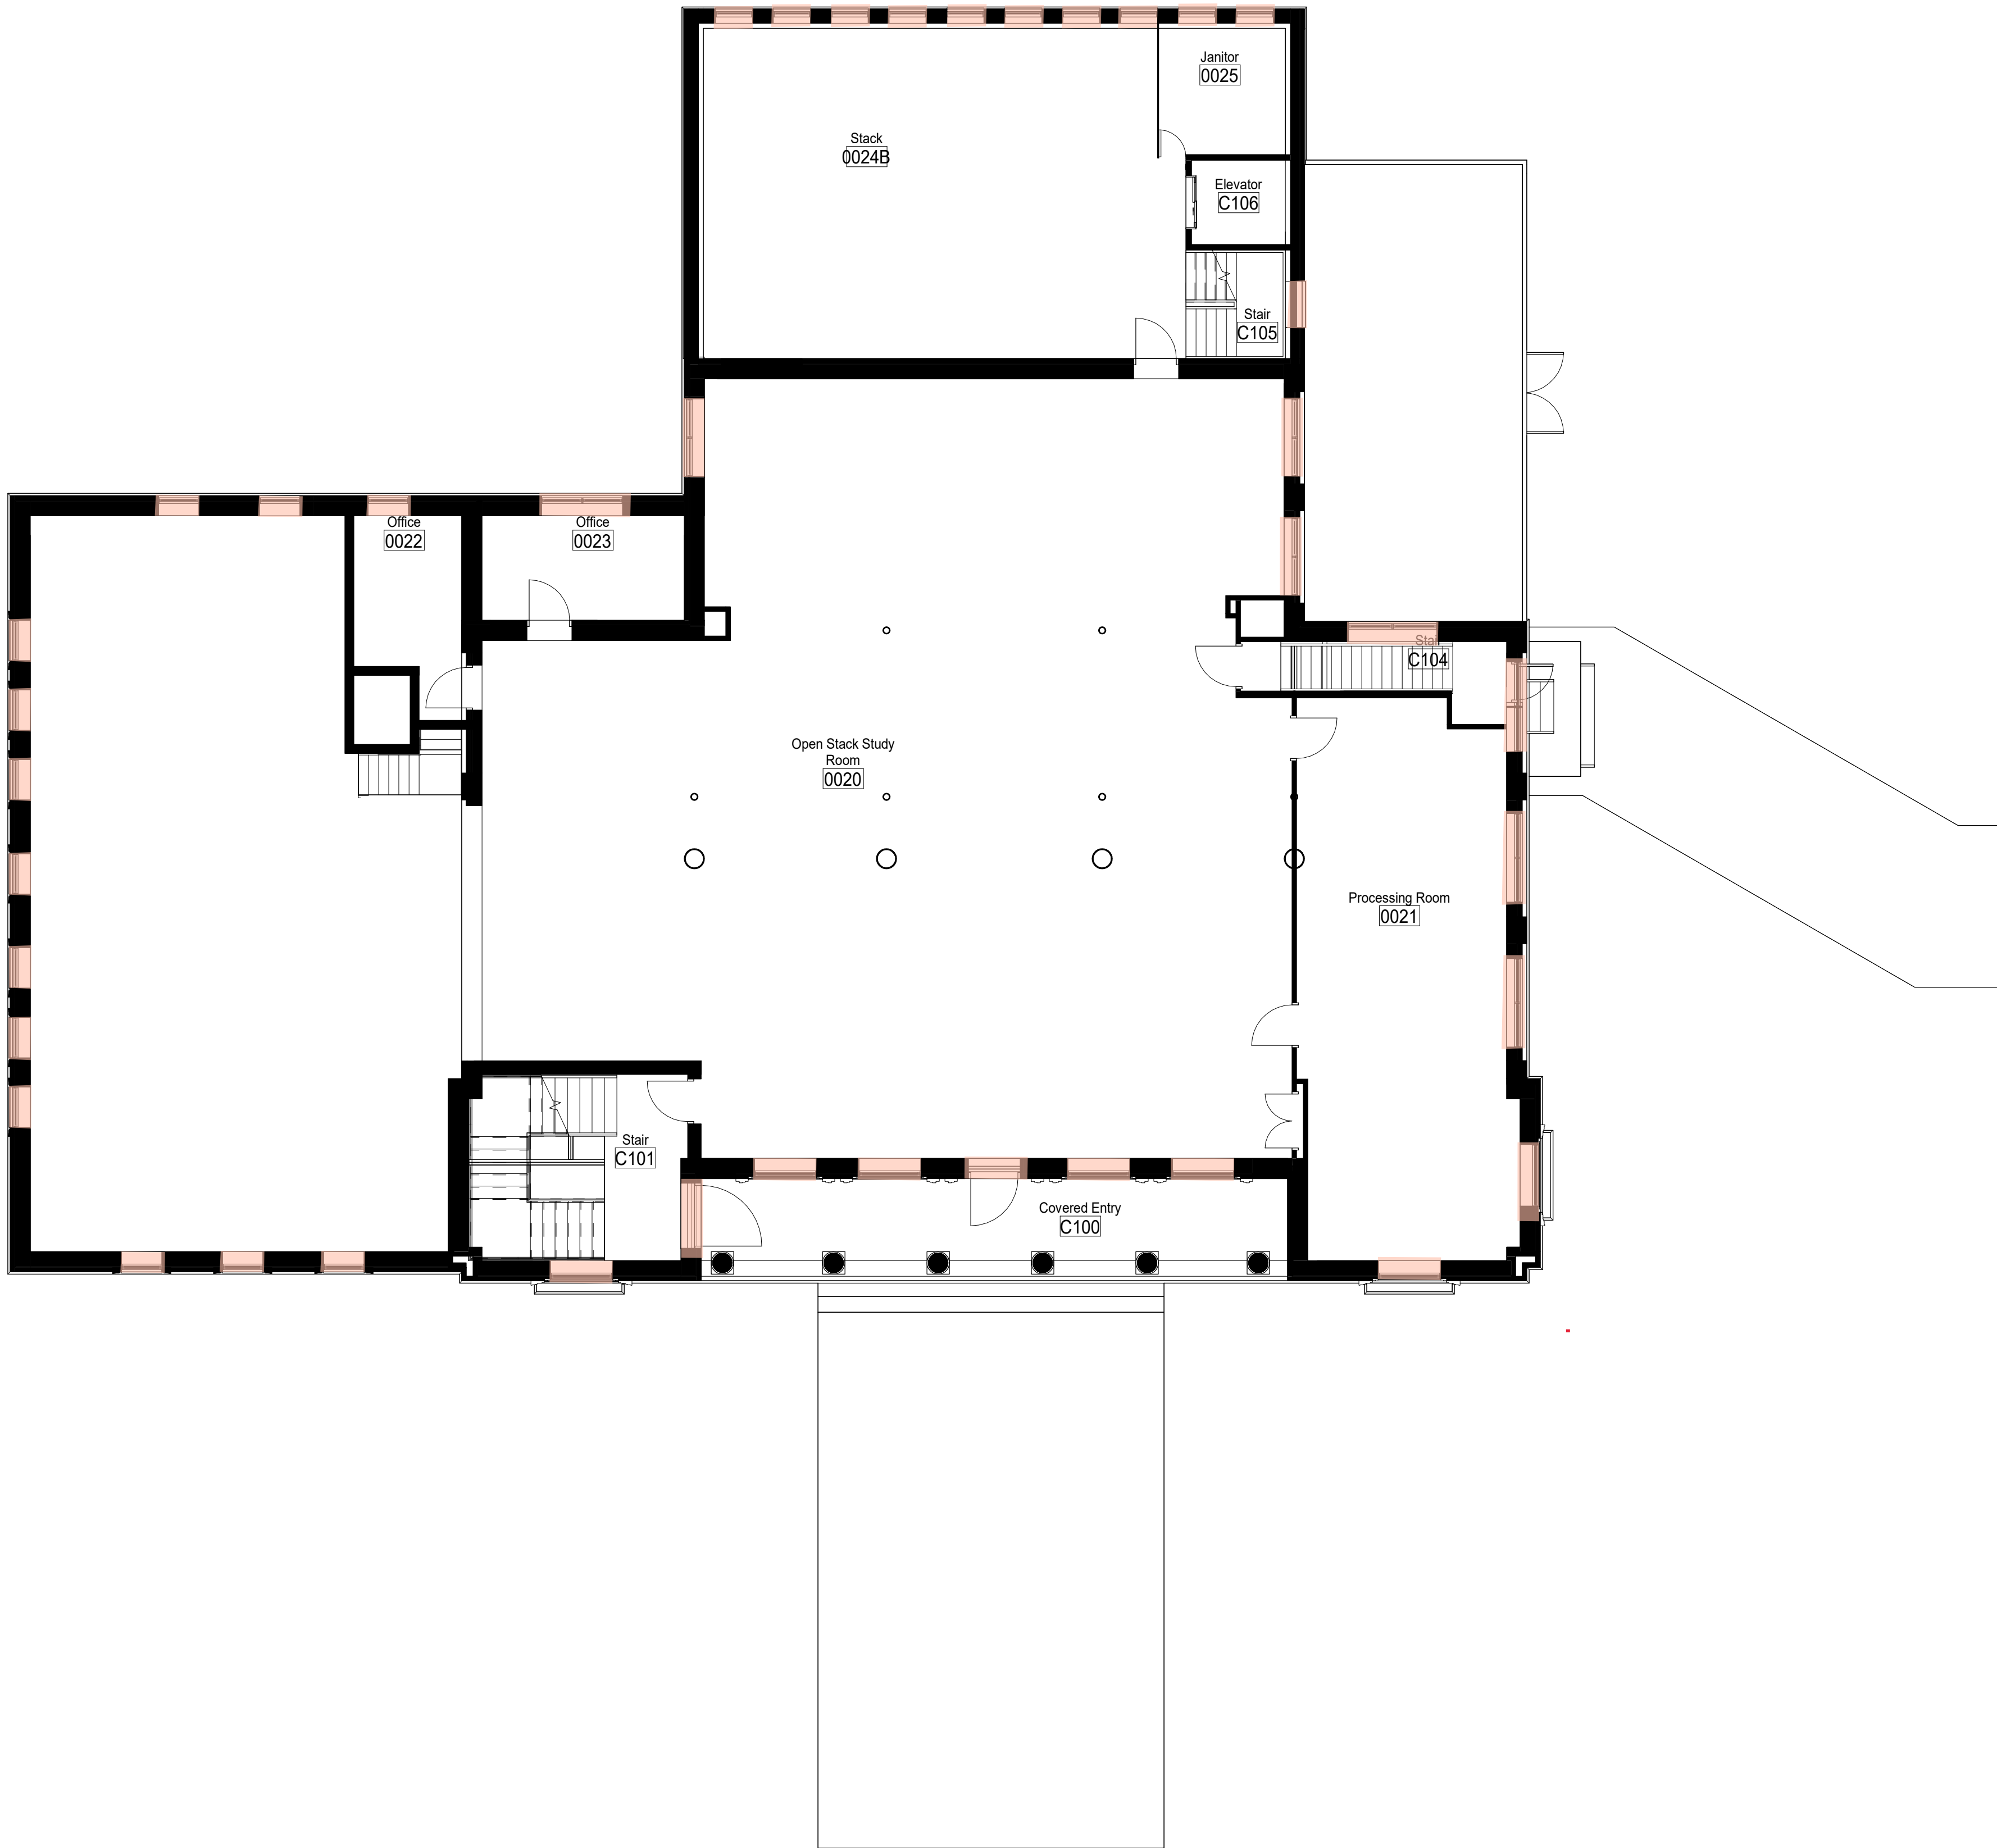

A2 FLOOR PLAN - LEVEL 2 EXISTING
A2.02 1/8" = 1'-0"

GENERAL NOTES:

A. Window glazing is positive for all windows.

KEY NOTES:


1 Metallic silver roofing bull on exterior roof is positive. This includes exterior roofing, parapet wall, roof penetrations, and flashings.

ABATEMENT LEGEND


WINDOW GLAZING

McLURE LIBRARY ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
FLOOR PLAN -		
LEVEL 2 EXISTING		
DRAWN BY: SWA		
CHECKED BY: RDW		
PROJECT NUMBER		
2360002-02		
DRAWING NO		
ACM.02		

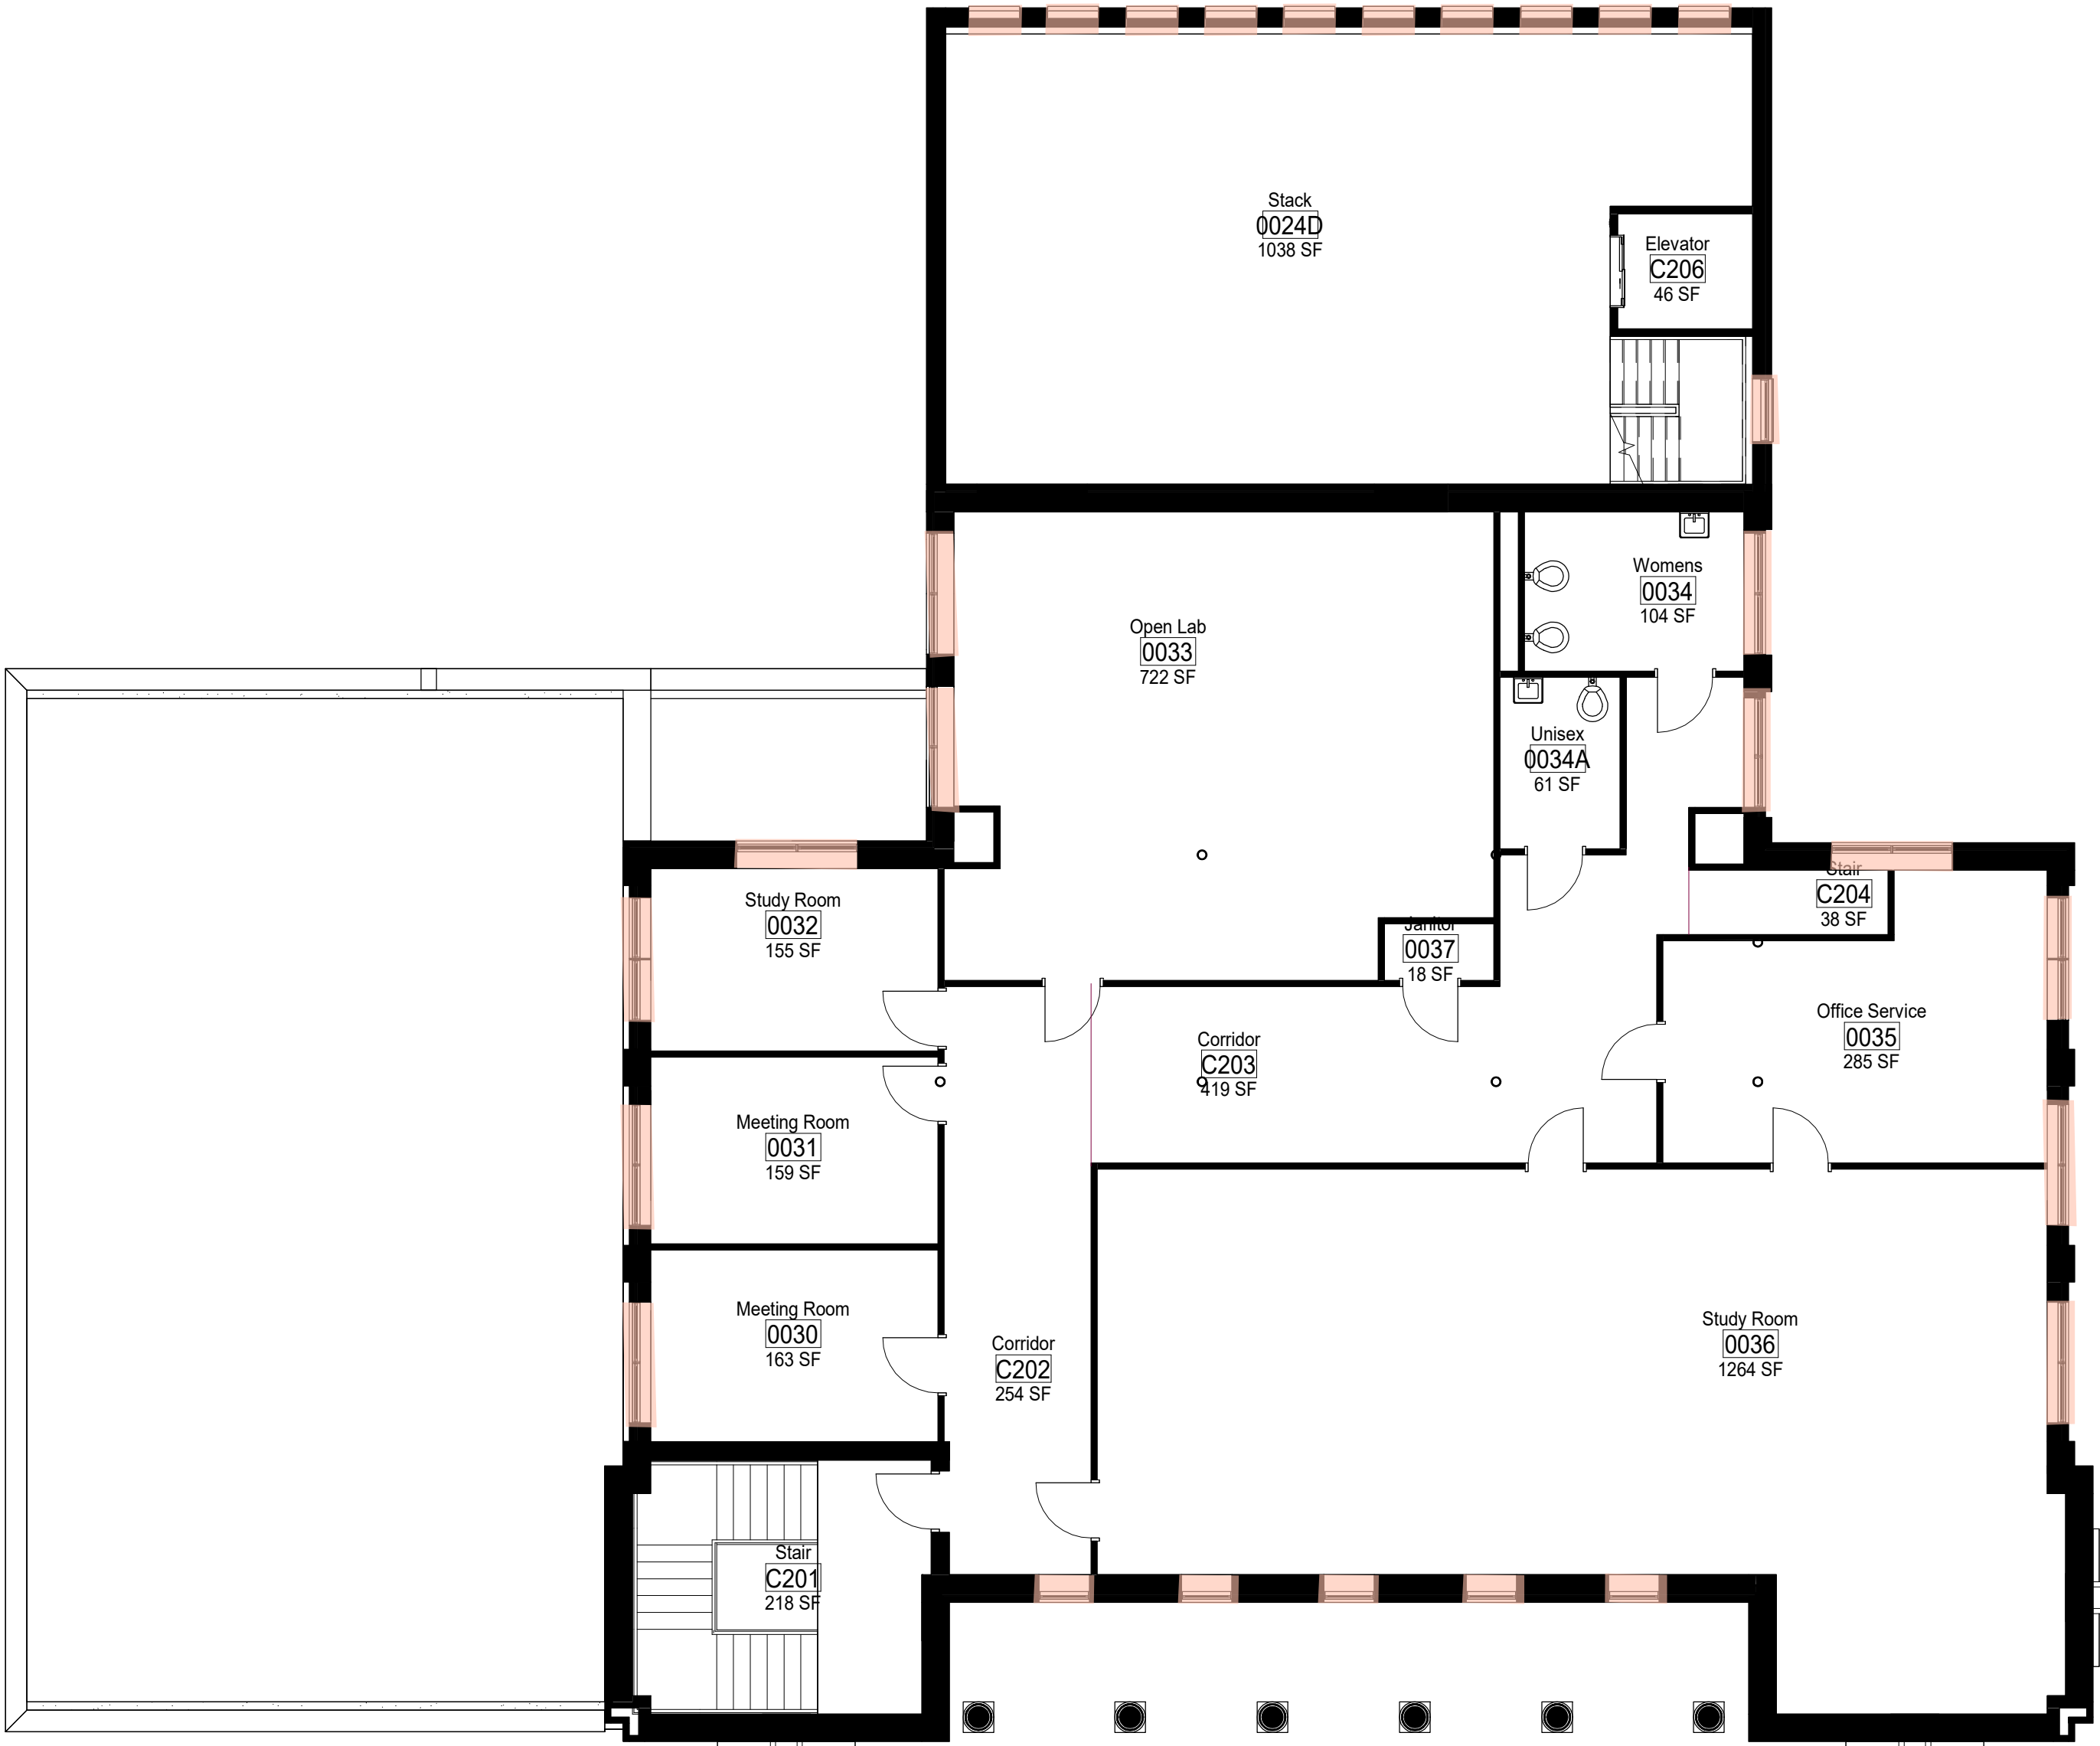

A1 FLOOR PLAN - LEVEL 3 EXISTING
A2.02 1/8" = 1'-0"

GENERAL NOTES:

A. Window glazing is positive for for all windows.

KEY NOTES:

1 Metallic silver roofing bull on exterior roof is positive. This includes exterior roofing, parapet wall, roof penetrations, and flashings.

ABATEMENT LEGEND

WINDOW GLAZING

K|P|S

G R O U P


BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

McLURE LIBRARY ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE

FLOOR PLAN -
LEVEL 3 EXISTING

DRAWN BY: SWA

CHECKED BY: RDW


PROJECT NUMBER

236002-02

DRAWING NO.

ACM.03

C:\Users\rpitts\Documents\236002-00 McLure Library - Arch_rpl\pittsFL217.rvt
4/18/2023 4:13:14 PM

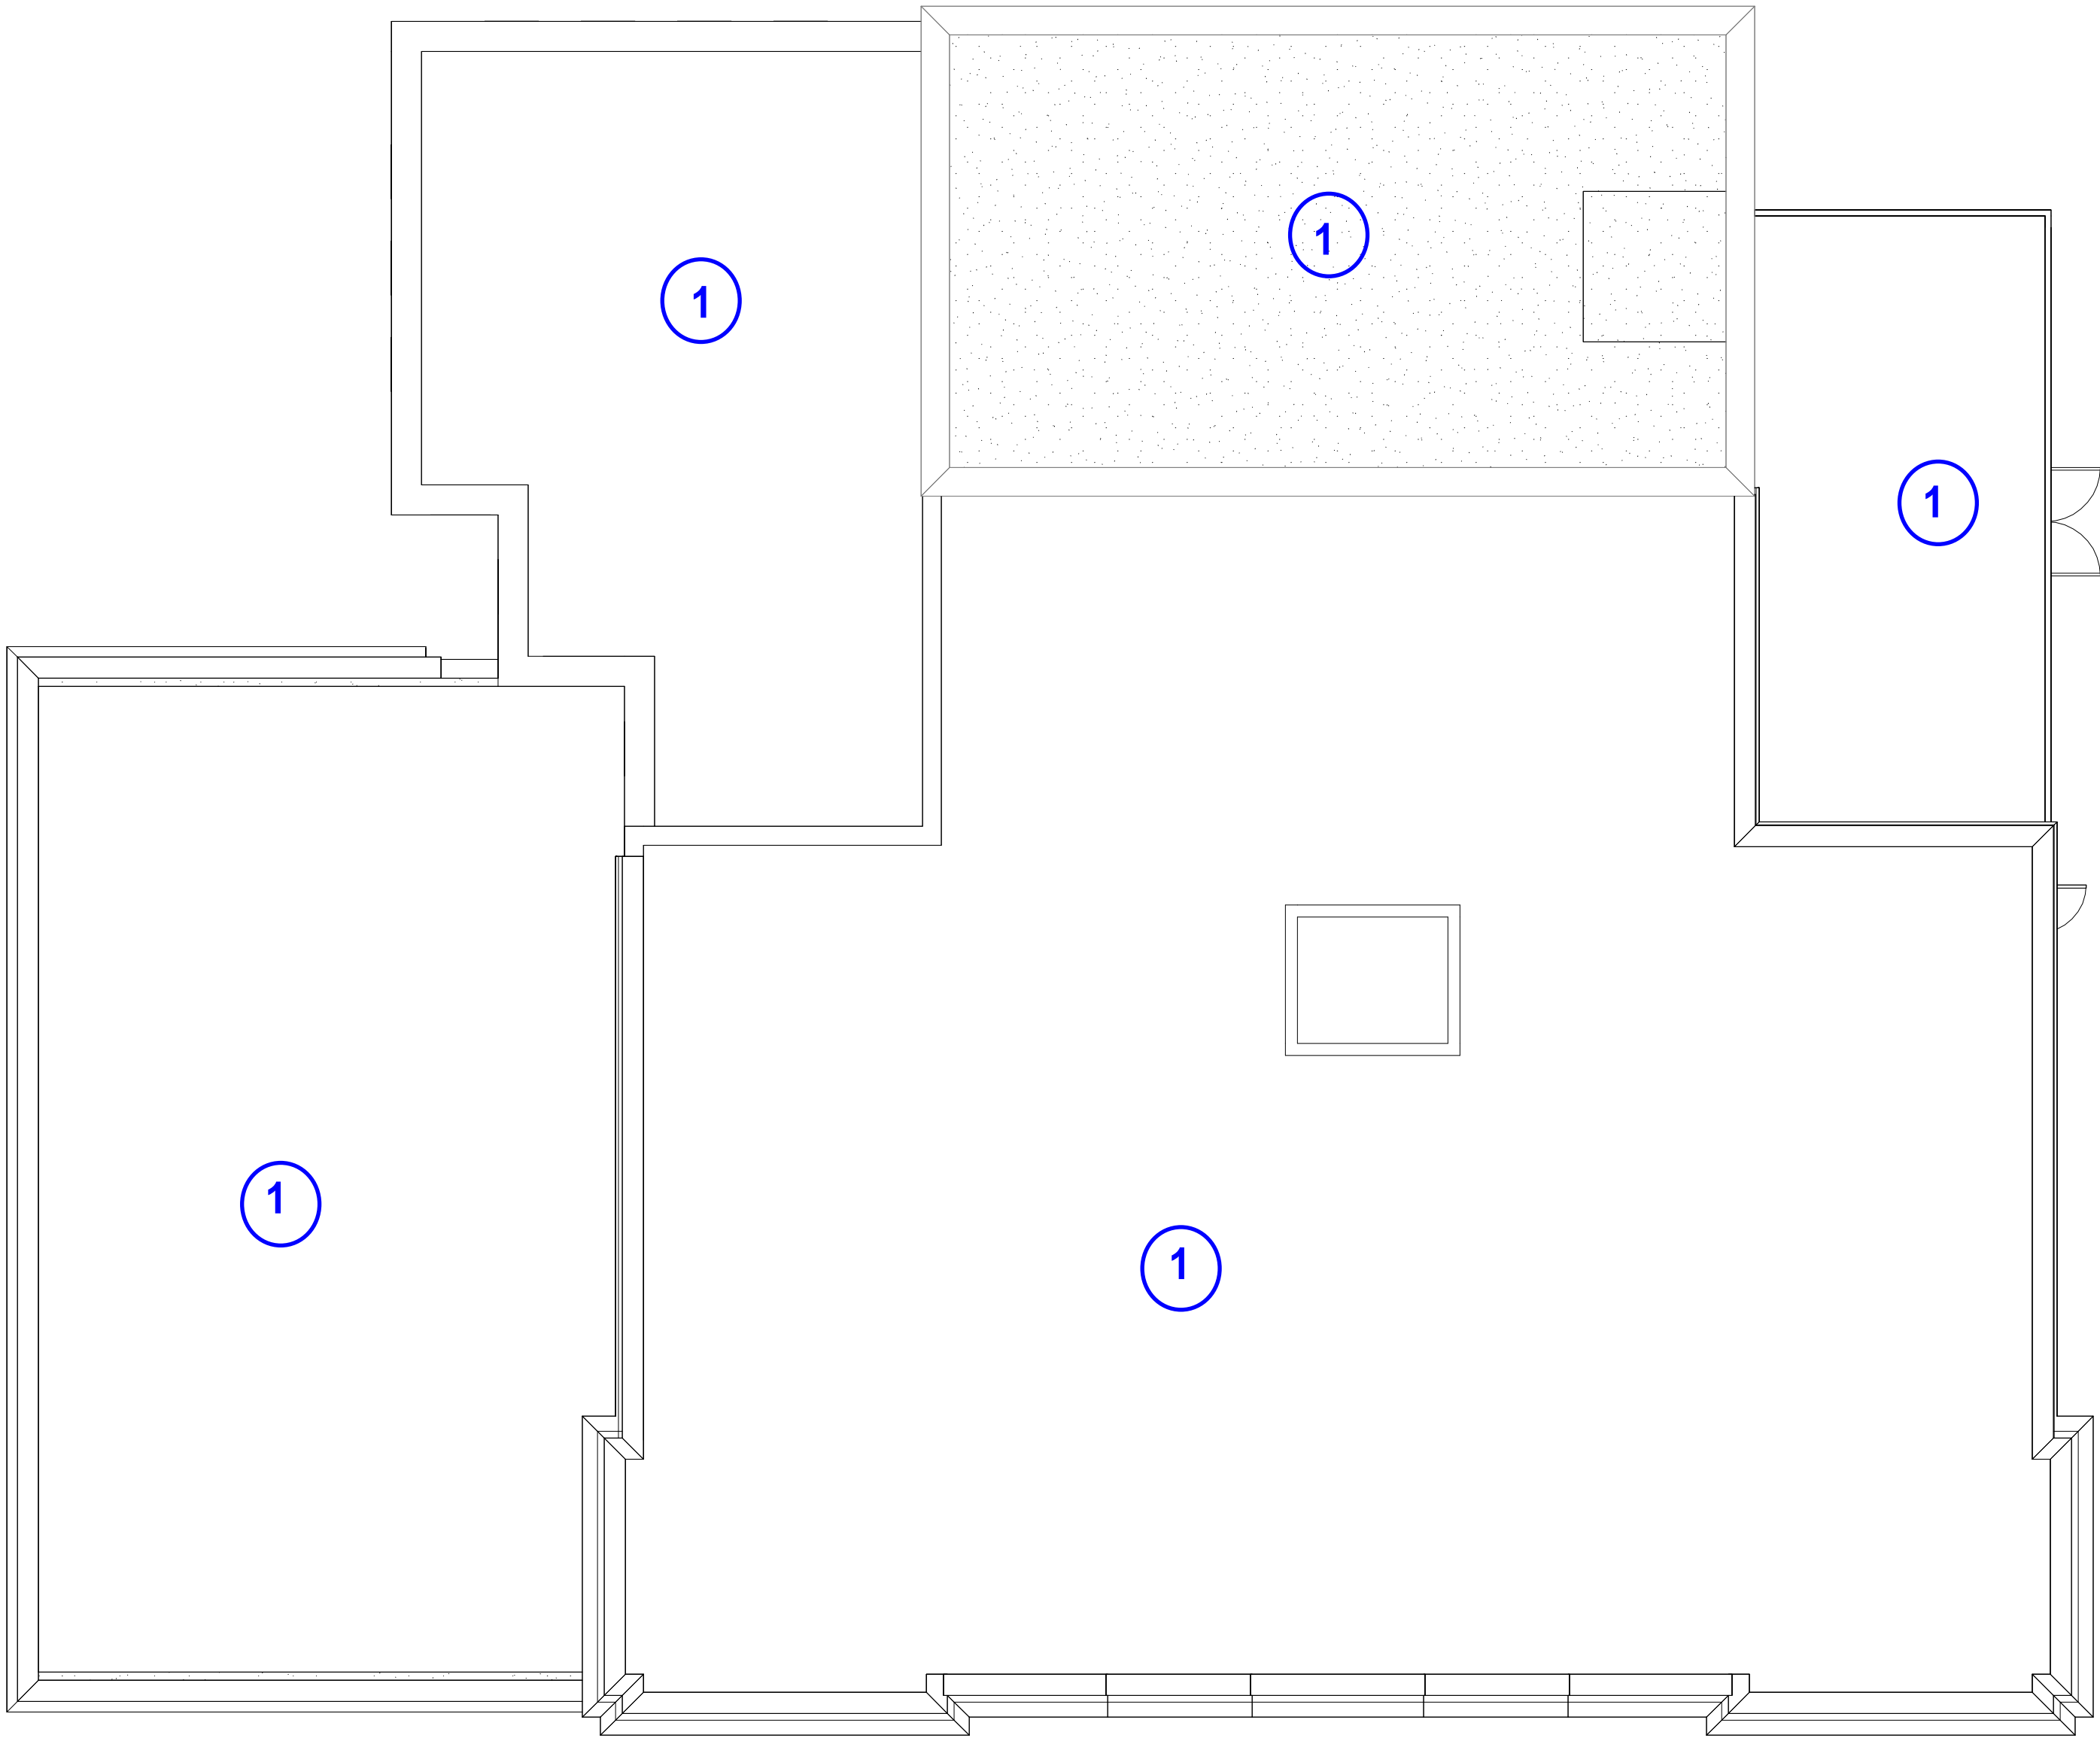

1 ROOF PLAN - EXISTING
1/8" = 1'-0"
A2.02

ROOF NOTES:

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE, REFER TO ARCHITECTURAL DRAFTING NOTES ON SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- IF ANY ITEM OF WORK CANNOT BE LOCATED, DO NOT PROCEED WITH THE WORK BEFORE CLARIFYING WITH ARCHITECT.

GENERAL NOTES:

A. Window glazing is positive for all windows.

KEY NOTES:

1 Metallic silver roofing bull on exterior roof is positive. This includes exterior roofing, parapet wall, roof penetrations, and flashings.

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

McLURE LIBRARY ADDITION AND RENOVATION


OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
ROOF PLAN		
EXISTING		
DRAWN BY:		SWA
CHECKED BY:		RDW
PROJECT NUMBER		
236002-02		
		DRAWING NO
ACM.04		

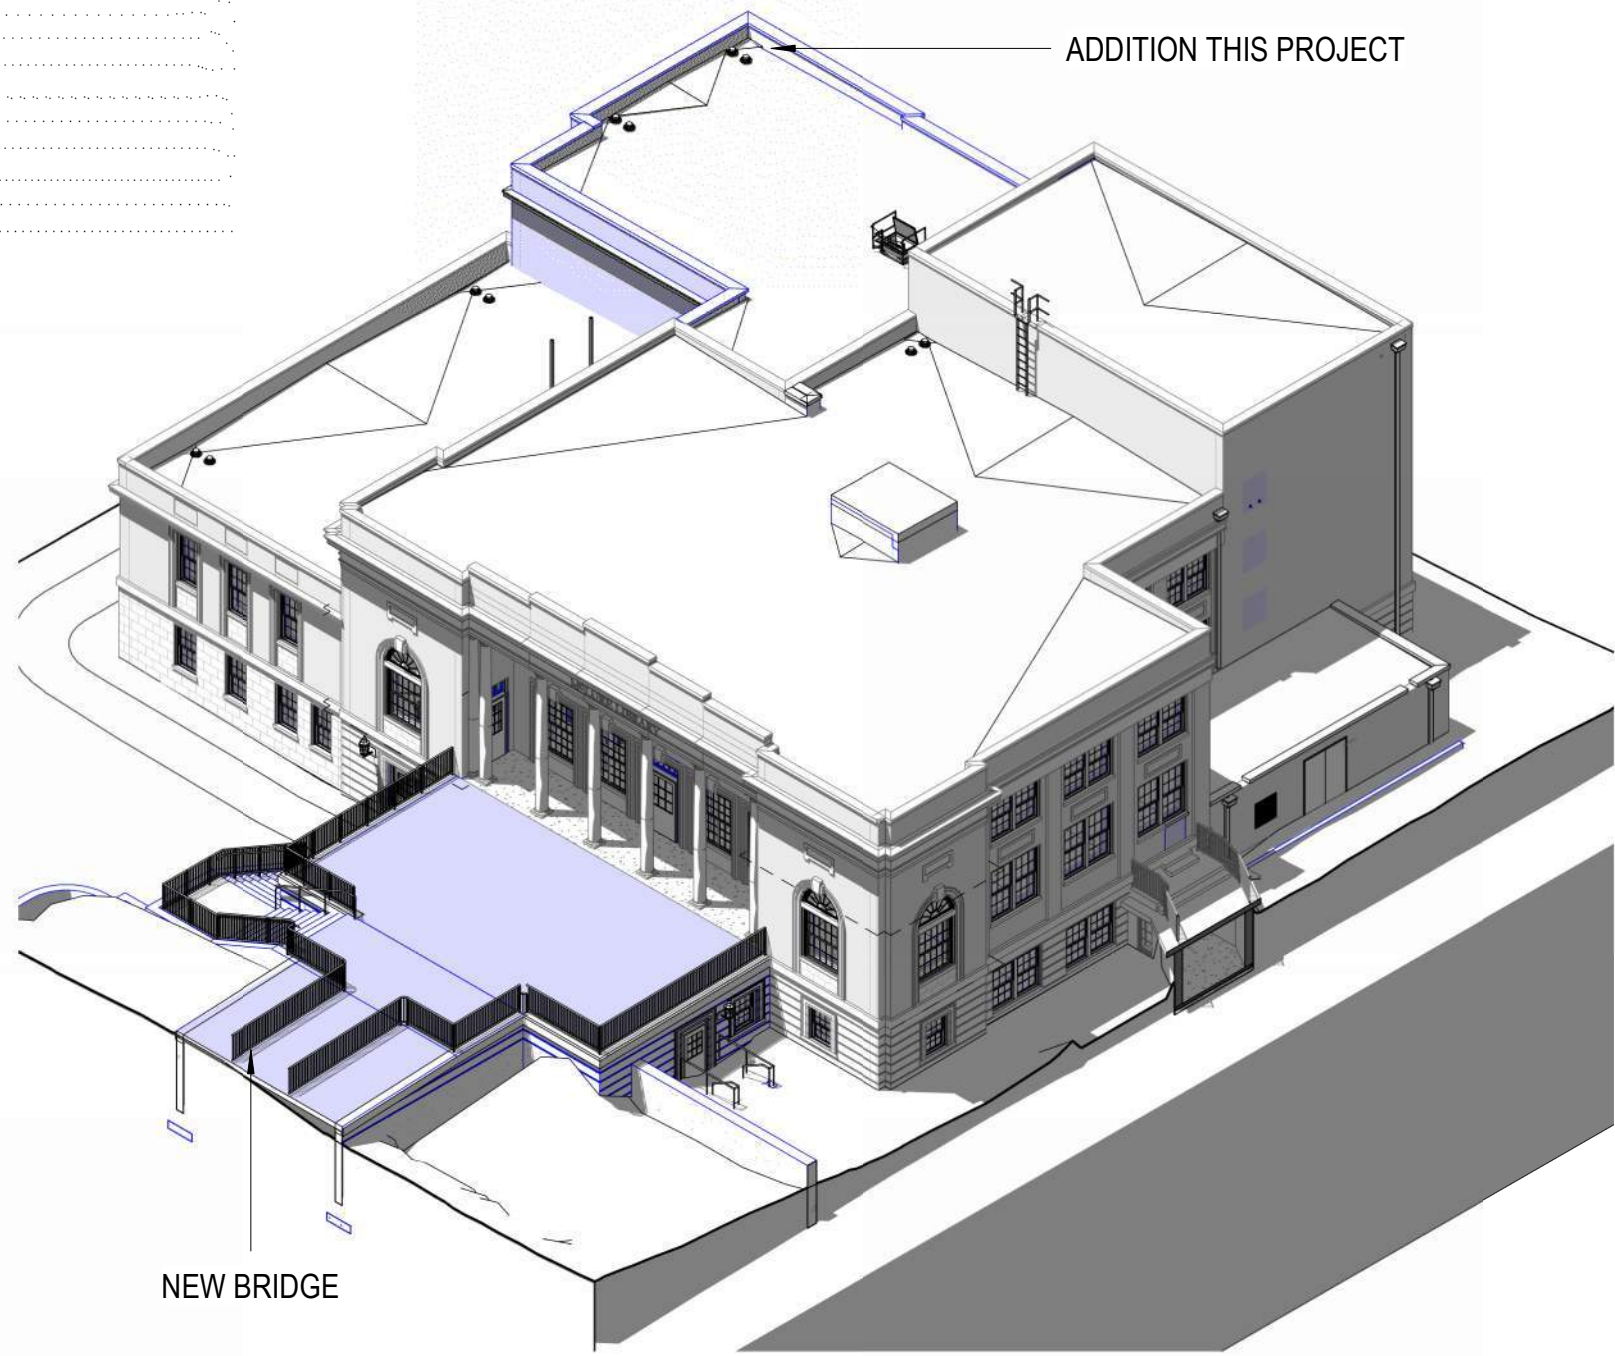


E5 AXON - SE

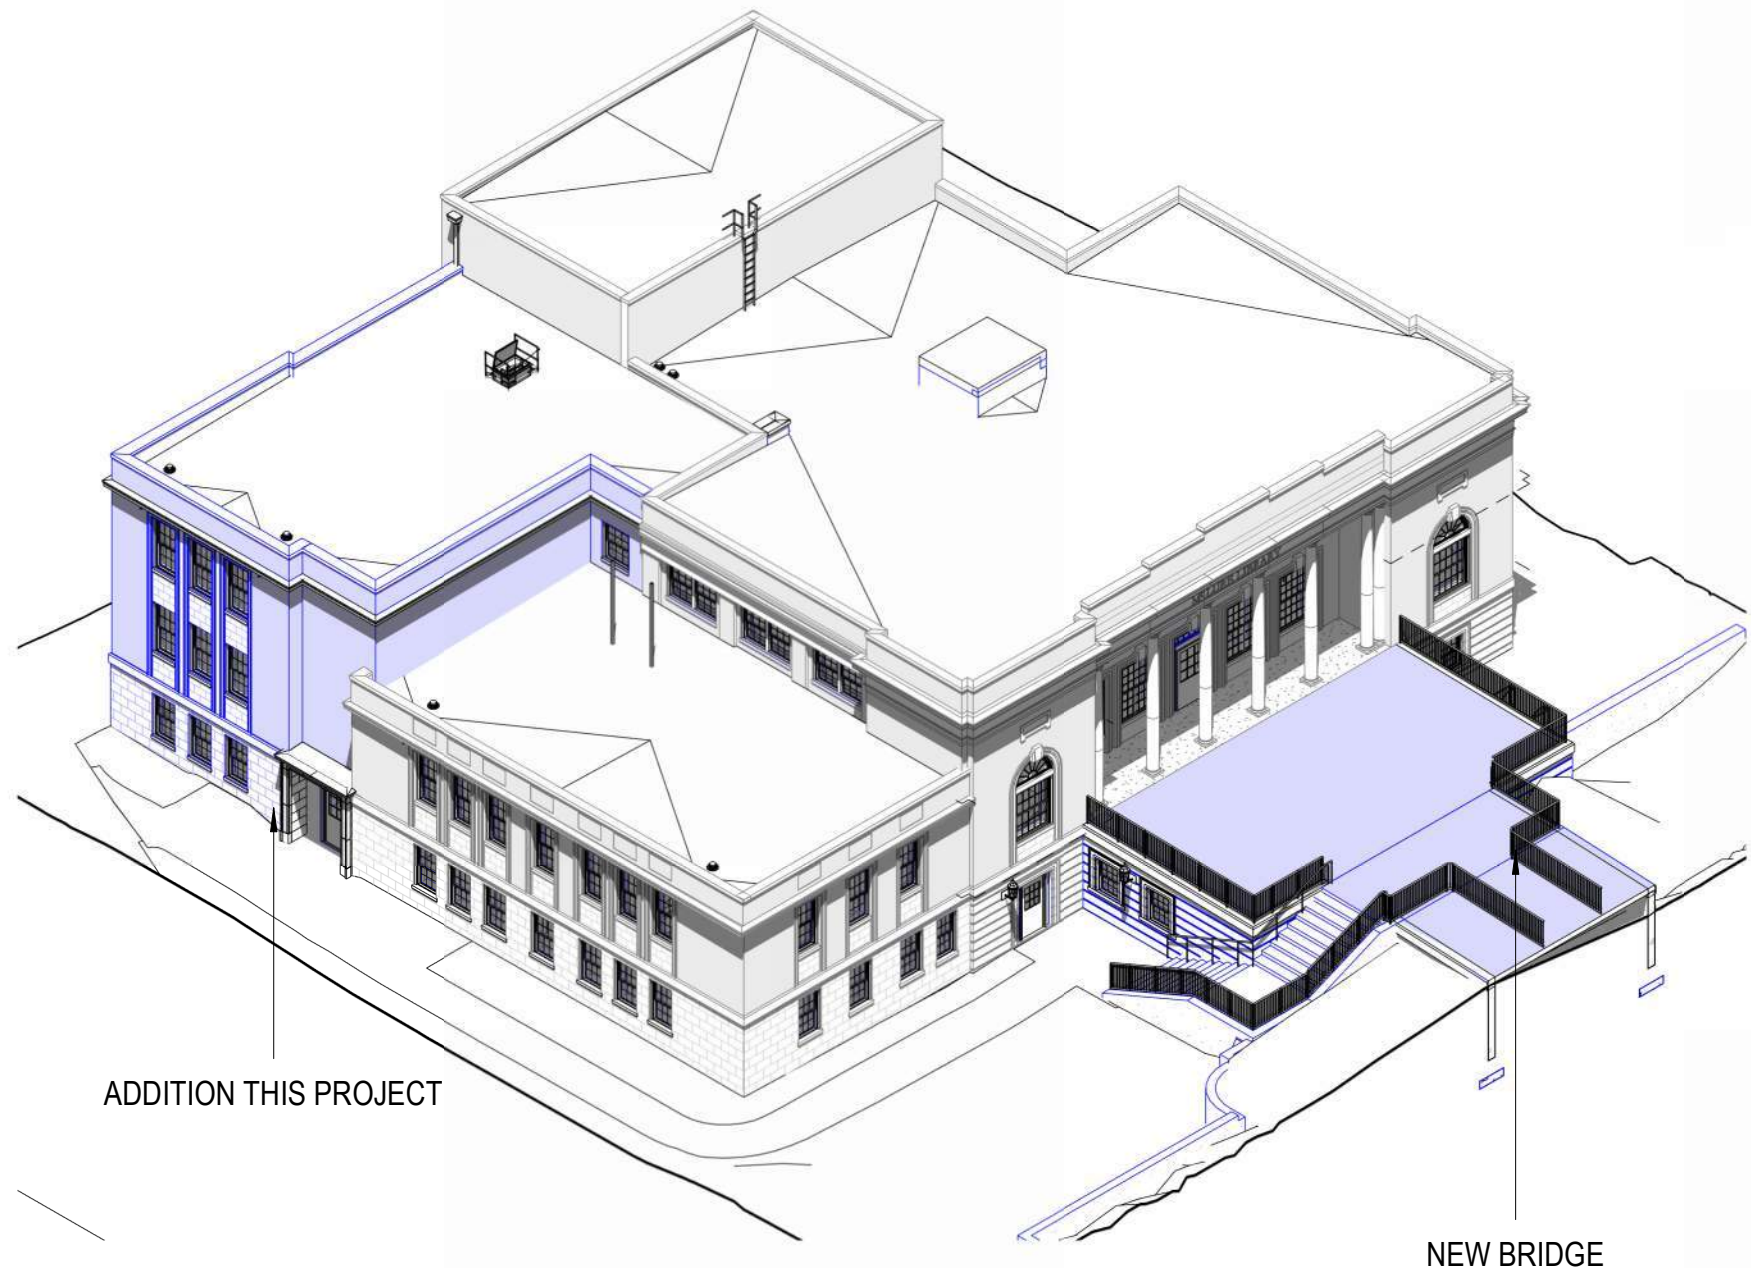

E4 AXON - SW

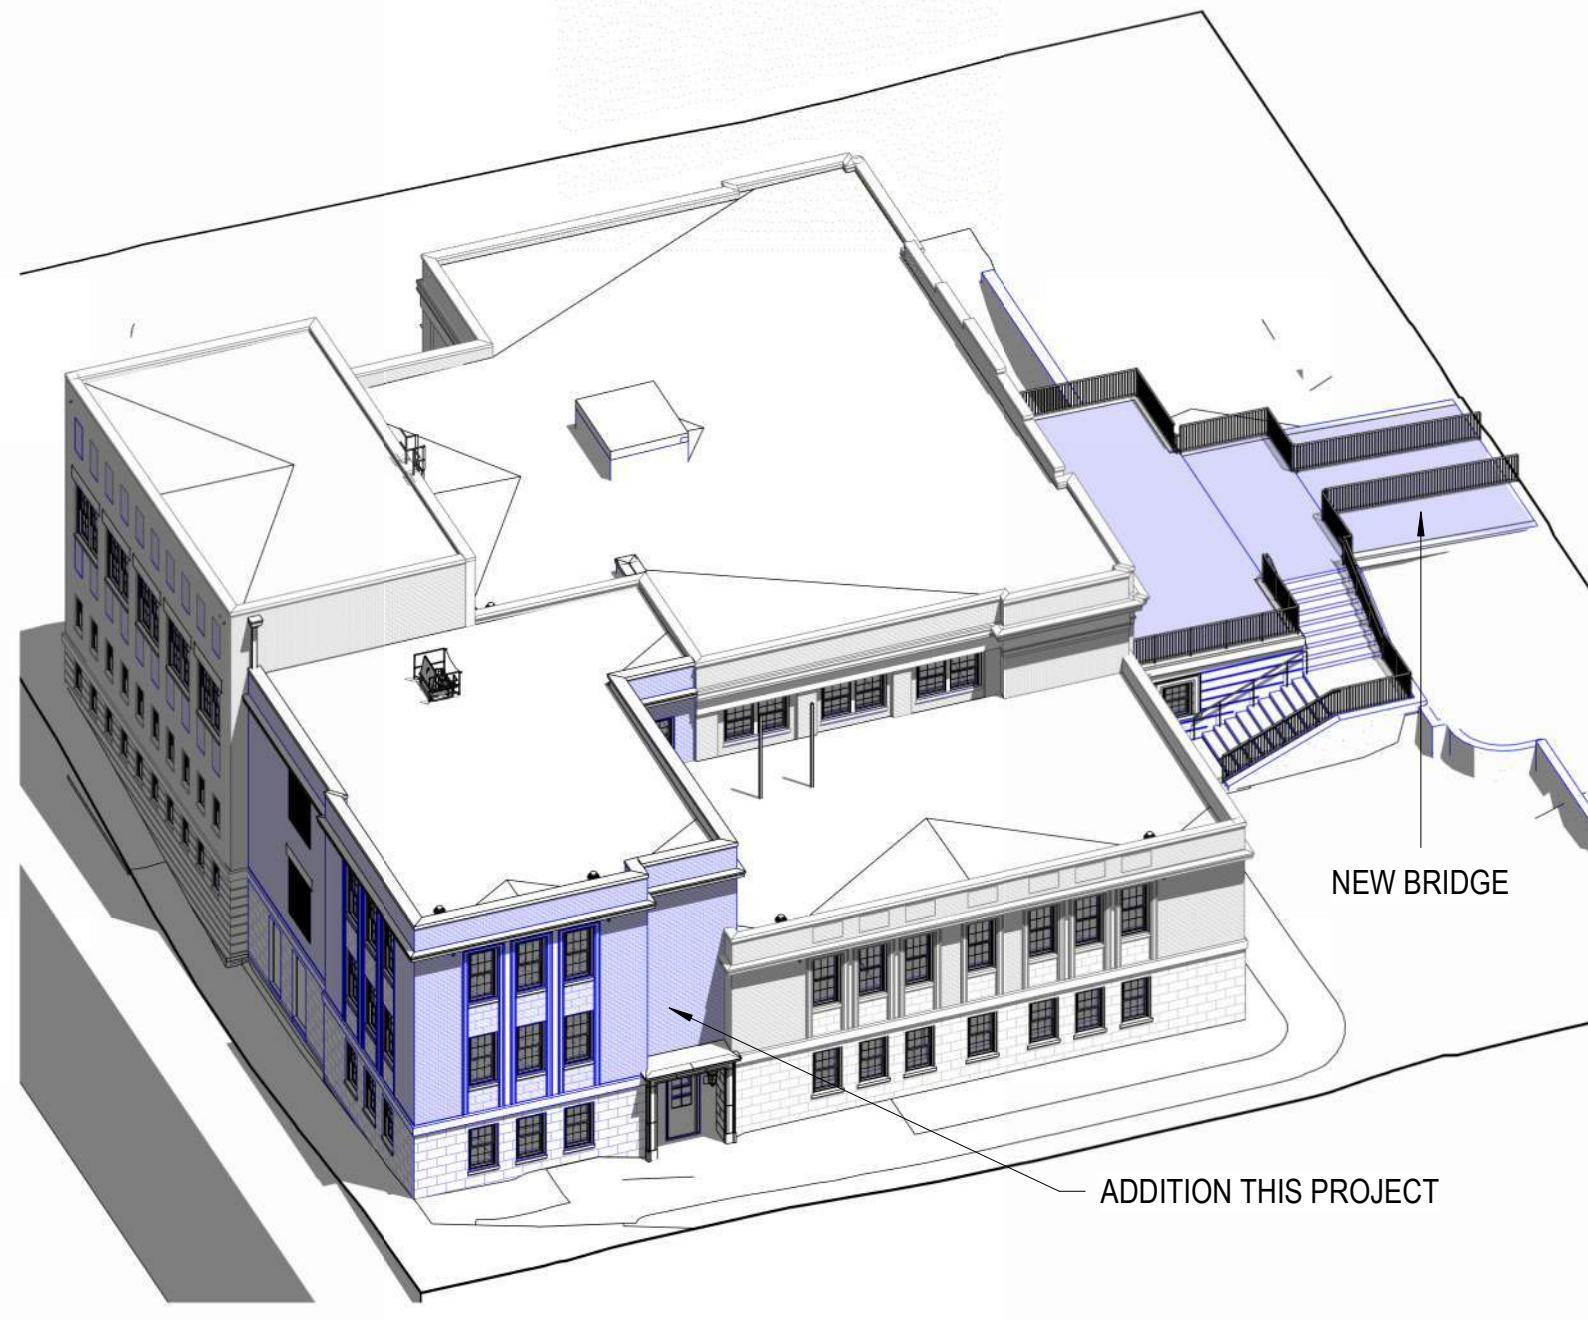

E2 AXON - NE

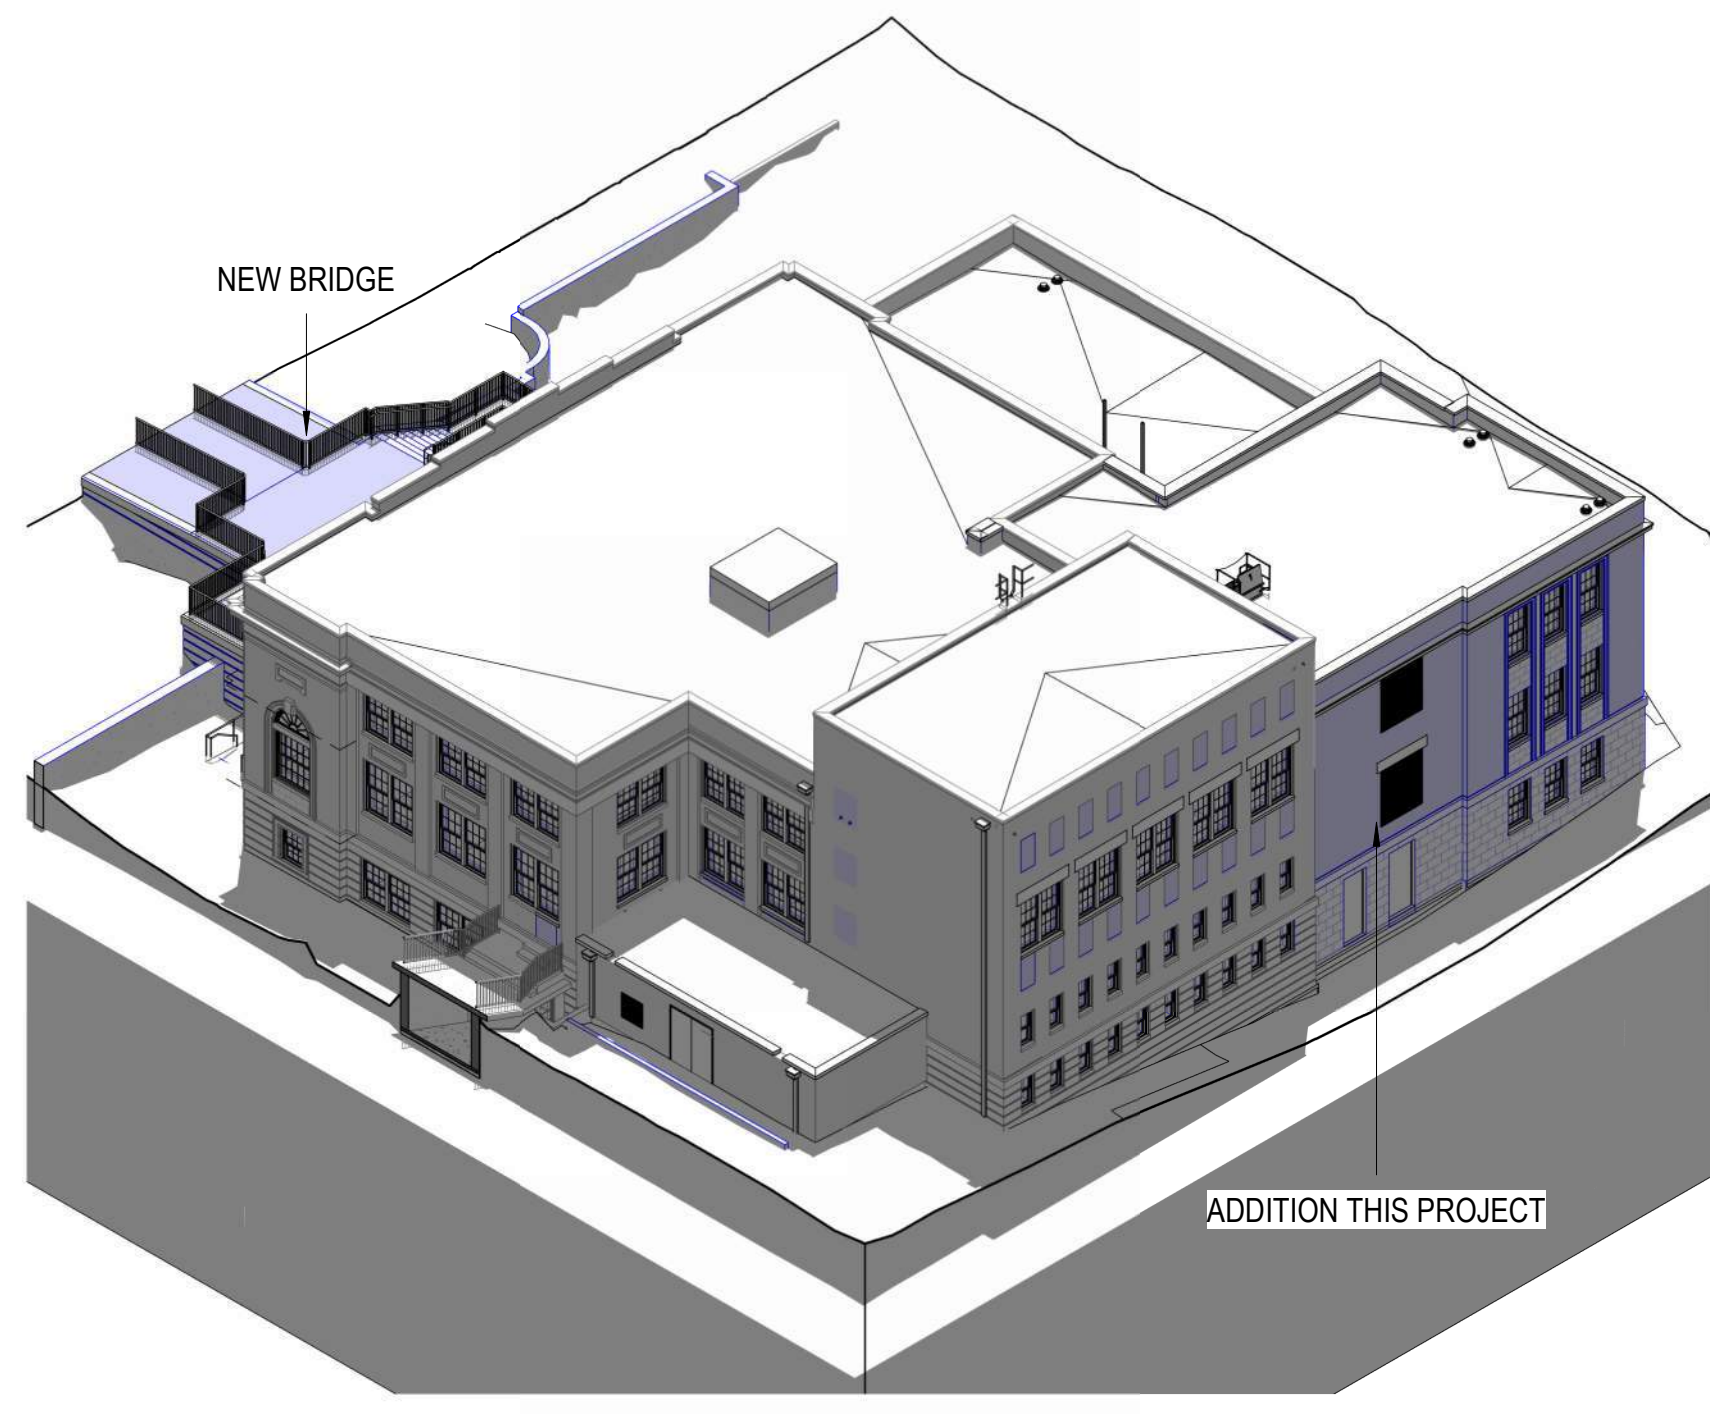

E1 AXON - NW



VIEW FROM NORTH



VIEW OF DUMPSTER



VIEW FROM SOUTH WEST



VIEW FROM WEST


KEYNOTES	
005	DEMOLISH EXISTING CONCRETE FLOOR AND STEEL BEAM. RE: STRUCTURAL DRAWINGS.
010	DEMOLISH STAIR IN ITS ENTIRETY
024	DEMOLISH EXISTING EXTERIOR DOOR.
030	DEMOLISH EXISTING FLOOR SLAB AS NEEDED THIS AREA TO EXCAVATE ELEVATOR PIT
031	DEMOLISH EXISTING LOAD-BEARING MASONRY WALLS. SHORE AS NEEDED UNTIL PERMANENT STRUCTURAL SUPPORT INSTALLED
036	COORDINATE DEMOLITION OF SELECTED AREAS OF MASONRY WALL WITH FINISHED OPENING SIZES. PROVIDE TEMPORARY SUPPORT AND SHORING AS NEEDED. RE: STRUCTURAL AND ARCHITECTURAL DRAWINGS.
039	DEMOLISH BRIDGE IN ITS ENTIRETY. KEEP EXISTING SANITARY SEWER APPROX 6' BELOW GRADE INTACT.
046	REMOVE PANEL AND WIRING; RE: ELECTRICAL DWGS
048	DOOR TO REMAIN
053	DEMOLISH EXISTING PIPING

DEMOLITION GENERAL NOTES

1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
2. IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
3. REFER TO ACM-SERIES DRAWINGS FOR ACM ABATEMENT.
4. REMOVE INTERIOR PARTITIONS PER PLAN.
5. REMOVE INTERIOR DOORS AND FRAMES PER PLAN.
6. DEMOLISH FLOORING, INCLUDING SUBFLOOR, TILE, CARPET, AND RAISED FLOOR TO CONCRETE FLOOR SLAB, TYPICAL, UNLESS NOTED OTHERWISE.
7. REMOVE PLUMBING FIXTURES PER PLAN. REMOVE PIPING AND ADDITIONAL FIRE PROTECTION AND PLUMBING PER PLUMBING DEMOLITION PLANS.
8. REMOVE HVAC DEVICES, DUCTS, AND PIPING PER MECHANICAL DEMOLITION PLANS.
9. REMOVE EXTERIOR DOORS AND WINDOWS, TYPICAL, UNLESS NOTED OTHERWISE. LEAVE EXISTING FRAME IN PLACE TO ANCHOR NEW WORK. RE: WINDOW DETAILS SEEING A7.1X SERIES.
10. REMOVE EXISTING CASEWORK, MILLWORK, SHELVLING.
11. REMOVE PLASTER FINISH FROM INSIDE FACE OF MASONRY WALLS DOWN TO BRICK, TYPICAL. RE: ACM DRAWINGS FOR REQUIRED ABATEMENT.

DEMOLITION PLAN LEGEND

- INDICATES EXISTING CONSTRUCTION TO BE DEMOLISHED TO LIMITS SHOWN ON DRAWINGS. PATCH, REPAIR, SMOOTH AND CLEAN ADJACENT FLOORS, WALLS AND CEILINGS AS REQUIRED TO PROVIDE SMOOTH SURFACE FOR NEW FINISHES
- WALLS TO REMAIN
- EXISTING DOOR, FRAME TO REMAIN. UPGRADE DOOR HARDWARE.
- EXISTING DOOR, FRAME AND HARDWARE IS TO BE REMOVED; WALLS TO BE CLEANED, REPAIRED AND RE-FINISHED. SAVE ALL ITEMS FOR RE-USE UNLESS OTHERWISE NOTED. RE-STRUCTURAL

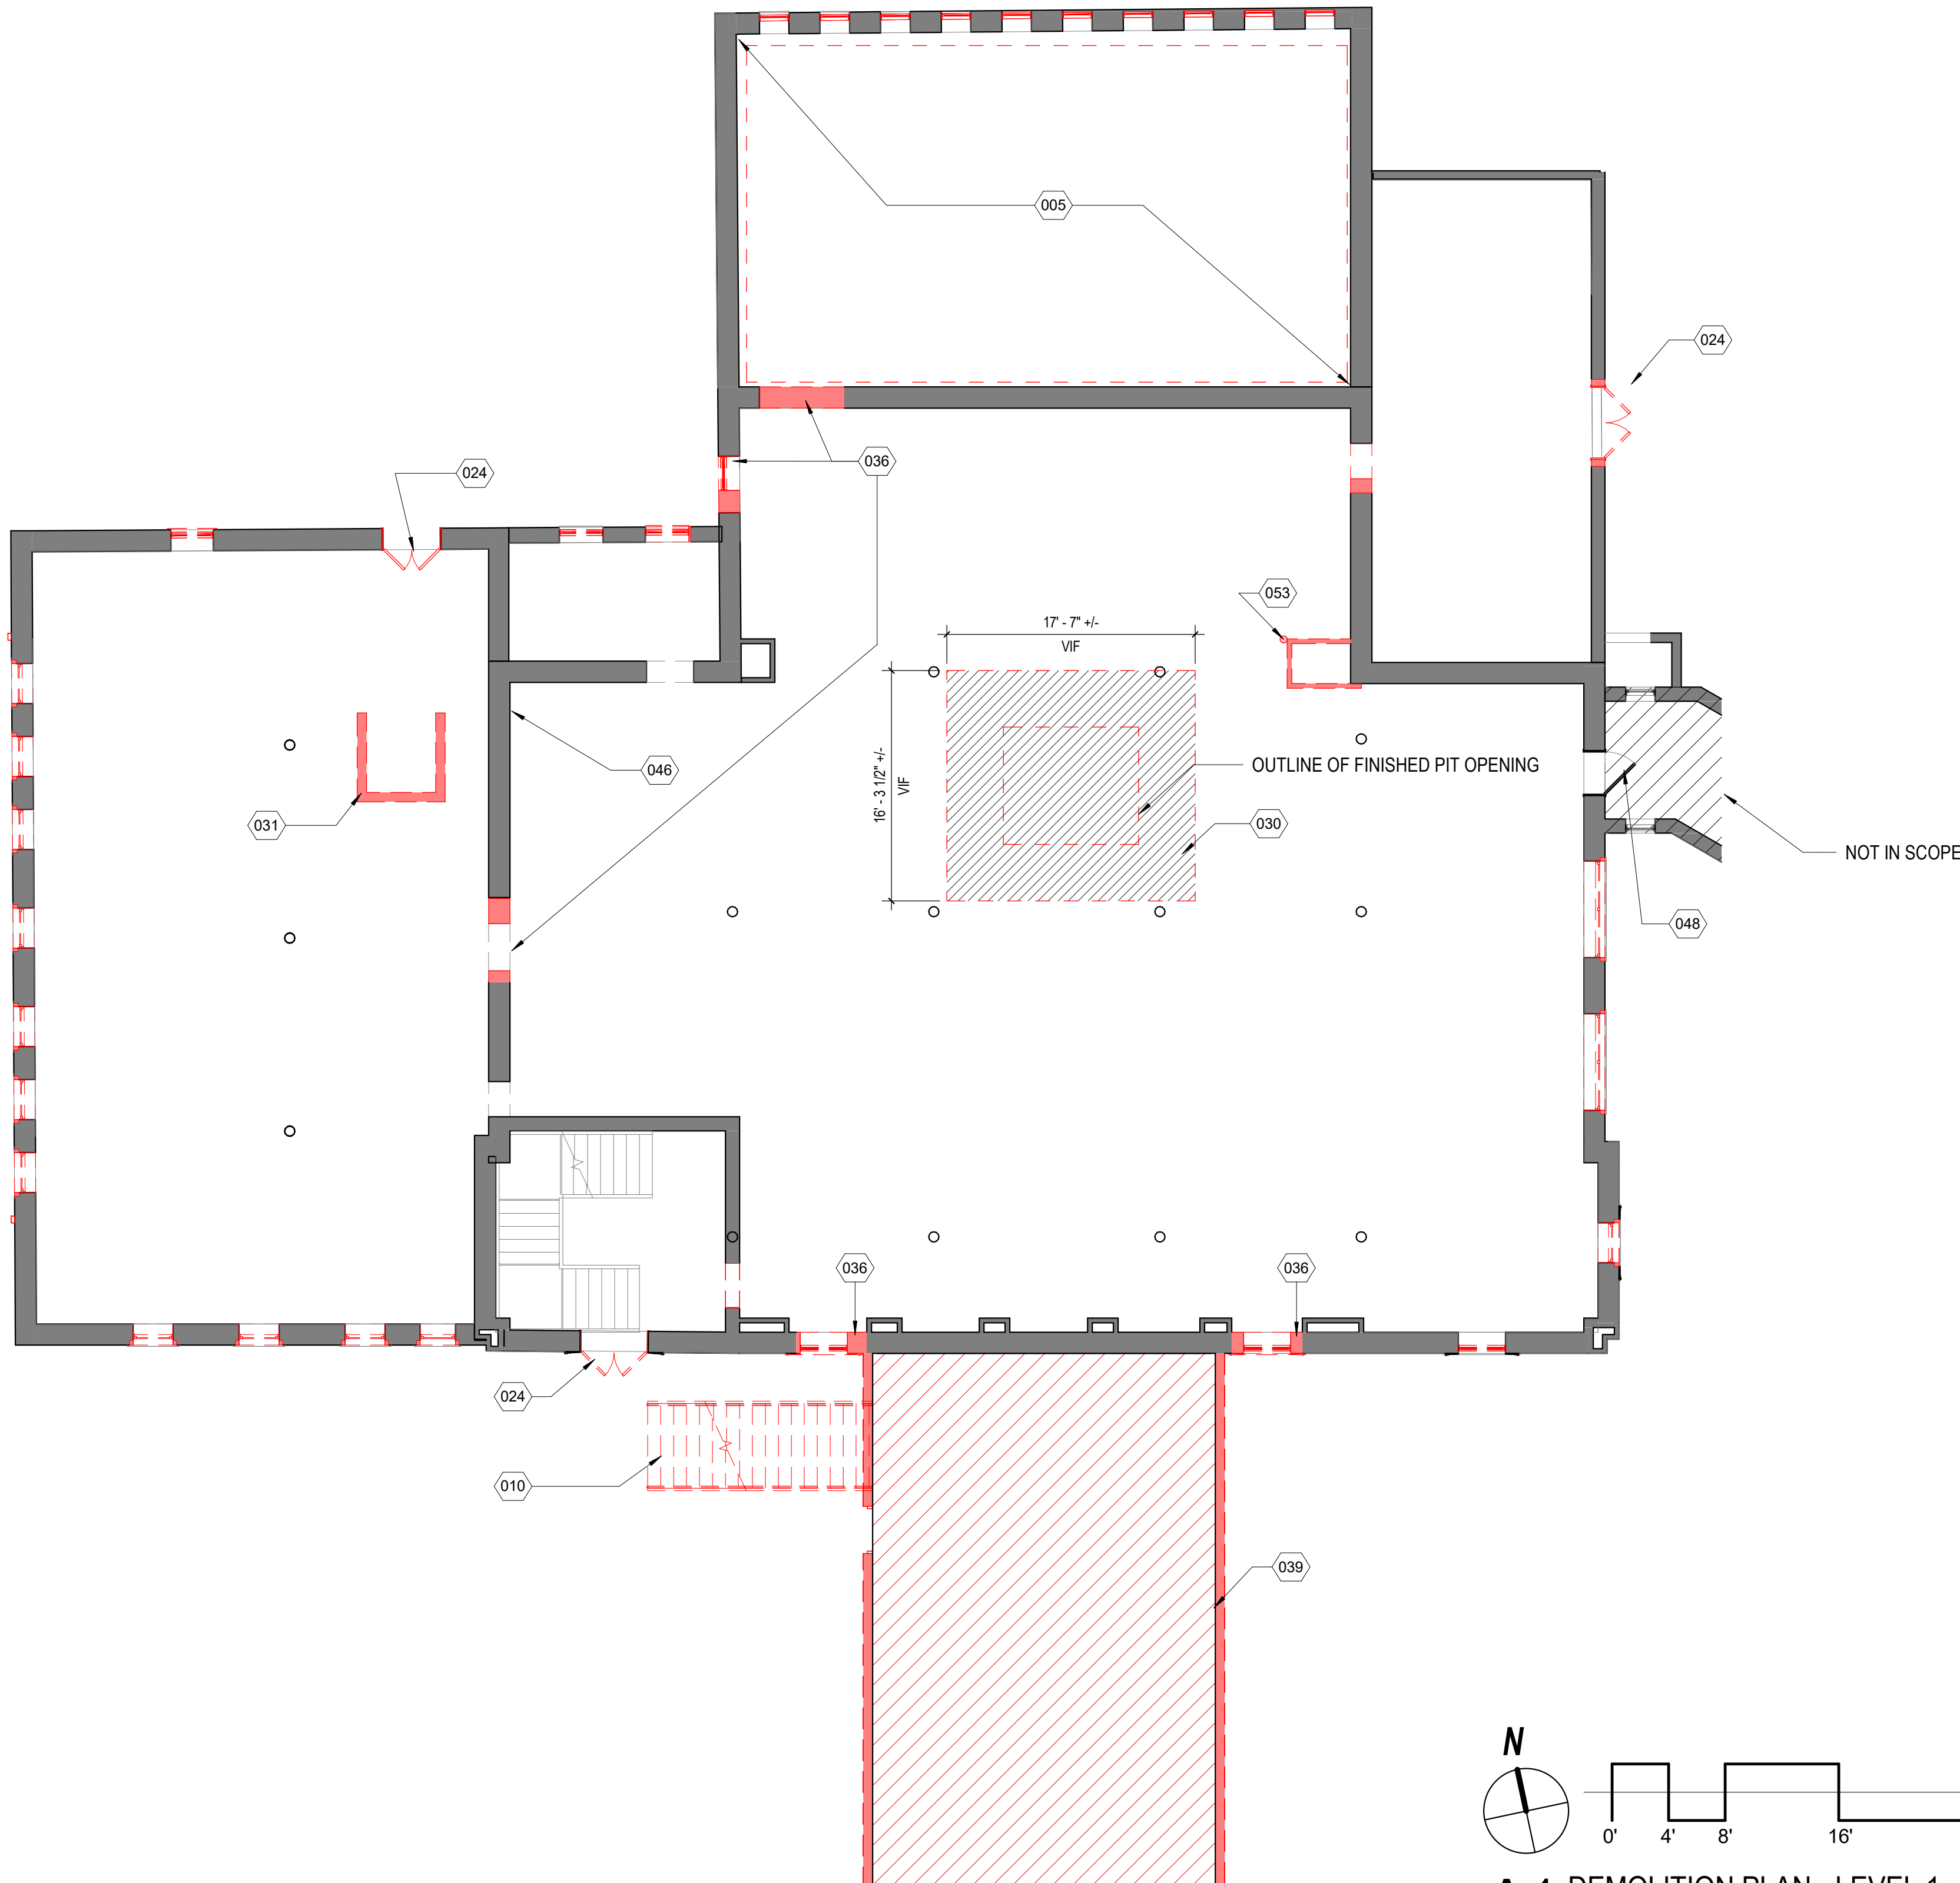

A1 DEMOLITION PLAN - LEVEL 1
1/8" = 1'-0"

DEMOLITION GENERAL NOTES (CONT'D)

- THE WORK OF THIS PROJECT INCLUDES ALTERATIONS OF THE EXISTING BUILDING TO ACHIEVE THE ARRANGEMENT INDICATED ON THE DRAWINGS. THE CONTRACTOR SHALL VISIT THE JOB SITE TO DETERMINE THE EXTENT OF DEMOLITION WORK REQUIRED BY THE CONSTRUCTION ACTIVITIES. THE ARCHITECTURAL DRAWINGS FOR THESE AREAS SHOW THE CHANGES TO BE MADE. THE CONTRACTOR SHALL REVISE, REARRANGE, REROUTE OR REMOVE EXISTING WIRING AND HVAC DISTRIBUTION AS REQUIRED TO ACCOMMODATE THE CHANGES AND ADDITIONS SHOWN AND TO PROVIDE CONTINUING ELECTRICAL AND HVAC SERVICES FOR THOSE EXISTING PORTIONS OF THE PROJECT WHICH ARE TO REMAIN IN OPERATION. INTENT OF THE DRAWING IS TO SHOW EXISTING BUILDING CONDITIONS WITH INFORMATION DEVELOPED FROM AVAILABLE DOCUMENTS. CONTRACTOR SHALL MAKE A DETAILED SURVEY OF EXISTING CONDITIONS PERTAINING TO THE WORK BEFORE COMMENCING DEMOLITION. THE CONTRACTOR SHALL REPORT DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL FIELD CONDITIONS TO THE ARCHITECT
16. DEMOLITION NOT DESCRIBED HERE BUT NECESSARY FOR THE COMPLETION OF THE WORK SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE DEMOLITION DRAWINGS ARE ISSUED FOR INFORMATION ONLY AND SHOW THE GENERAL EXTENT OF THE DEMOLITION REQUIRED. THESE DRAWINGS DO NOT REQUIRE THE CONTRACTOR TO SHOW EVERYTHING TO BE REMOVED IN ORDER TO PREPARE THE EXISTING BUILDING ELEMENTS FOR REMODELING OR NEW CONSTRUCTION. THE ARCHITECTURAL DRAWINGS SHOW THE EXISTING PARTITIONS WITH DOORS AND OTHER ITEMS TO REMAIN
17. FURNISH ALL LABOR AND MATERIAL REQUIRED TO COMPLETE DEMOLITION AND REMOVAL OF ALL ITEMS AS INDICATED IN ARCHITECT'S DRAWINGS OR AS OTHERWISE DIRECTED BY ARCHITECT.
18. FURNISH BUILDING MANAGEMENT AND ARCHITECT WITH A COMPLETE INVENTORY LIST OF ALL ITEMS THAT CAN BE REUSED AND/OR STORED IN BUILDING STOCK.
19. THE GENERAL CONTRACTOR SHALL EXECUTE ALL WORK WITH THE REGULATIONS OF THE BUILDING FOR DEMOLITION AND REMOVAL OF DEBRIS, INCLUDING OVERTIME WORK REQUIRED.
20. PROTECT THE PROPERTY OF THE BUILDING OWNER INCLUDING BUT NOT LIMITED TO, WINDOWS, FLOOR AND CEILING TILE, PUBLIC TOILETS, ELEVATORS, DOORS, BUCKS, ELECTRICAL AND AIR CONDITIONING EQUIPMENT, CONVECTOR ENCLOSURES, ETC. THE CONTRACTOR SHALL AT NO TIME DO ANY WORK OR PLACE ANY CONSTRUCTION THAT MAY AFFECT THE OPERATIONS OF THE OTHER TENANTS, INCLUDING ANY INTERRUPTIONS IN THE SUPPLY OF POWER OR OTHER UTILITIES WITHOUT FIRST NOTIFYING THE BUILDING OWNER AND OBTAINING PERMISSION TO PROCEED.
21. PROVIDE VISQUEEN SEAL FROM FLOOR TO CEILING AT ALL INTERFACES TO PROTECT ADJACENT BUILDING PROPERTY WHILE DEMOLITION AND CONSTRUCTION ARE IN PROGRESS. THIS SEAL IS TO BE KEPT CLOSED AT ALL TIMES.
22. IN AREAS WHERE THERE ARE NO ALTERATIONS INDICATED THE EXISTING FACILITIES SHALL BE RETAINED IN SERVICE. IN CASE OF DOUBT ASSUME THAT THE EXISTING ELECTRICAL WIRING IS TO REMAIN IN OPERATION THROUGHOUT THE CONSTRUCTION PERIOD AND THEREAFTER.
23. WHERE CONSTRUCTION TO BE REMOVED INTERSECTS CONSTRUCTION TO REMAIN, WORK SHALL INCLUDE ALL ATTACHMENT DEVICES (SHOT PINS, ANCHORS, LAG BOLTS, NAILS, NAILERS, SHIMS, ETC)
24. IN AREAS WHERE DEMOLITION REMOVAL OF TILE, CARPETING, PARTITIONS, ETC CAUSES AND UNEVENNESS IN SLAB, PATCH TO LEVEL. THE SLAB TO RECEIVE NEW FINISHED FLOORING, TYPICAL, UNLESS NOTED OTHERWISE.
25. REMOVE DEMOLISHED WORK FROM THE PREMISES EXCEPT ITEMS TO BE REUSED OR RETURNED TO TENANT OR AS OTHERWISE NOTED.
26. UPON THE REMOVAL OF THE EXISTING CEILING, THE EXISTING MECHANICAL SYSTEM WILL BE EVALUATED BY THE ENGINEER FOR POSSIBILITY FOR RE-USE. IF THE EXISTING MECHANICAL SYSTEMS ARE TO BE REUSED, EXISTING MAIN DUCT, VAV BOXES, PNEUMATIC CONTROL TUBING ETC SHALL REMAIN AND SHALL BE PROTECTED TO AVOID DAMAGE TO EXISTING HVAC EQUIPMENT DURING DEMOLITION
27. CAP AND FLUSH OFF BEHIND FINISH SURFACES ALL PROJECTING PLUMBING, FLOOR ELECTRICAL/TELEPHONE OUTLETS, AND ALL OTHER PROJECTING ITEMS WHICH ARE BEING ABANDONED.
28. THE GENERAL CONTRACTOR SHALL REMOVE FROM PREMISES CONDUITS LEFT AFTER WALL DEMOLITION, INCLUDING SWITCH BOXES, PLATES, BRIDGES OR ANY OTHER TELEPHONE OR ELECTRICAL WIRING AND EQUIPMENT.
29. REMOVED MATERIAL OTHER THAN ITEMS TO BE SALVAGED OR REUSED SHALL BECOME CONTRACTORS' PROPERTY UNLESS OTHERWISE NOTIFIED AND SHALL BE REMOVED FROM OWNERS PROPERTY. CLEAN UP AND DISPOSE OF DEBRIS PROMPTLY AND CONTINUOUSLY AS WORK PROGRESSES. SECURE AND PAY FOR REQUIRED HAULING PERMITS, DUMPING FEES AND CHARGES.
30. ELECTRICAL, MECHANICAL AND PLUMBING TO BE REMOVED TO THE FURTHEST TERMINATION POINT ON THE FLOOR. REMOVE ALL UNUSED AND DISCONNECTED HVAC, ELECTRICAL, PLUMBING AND PHONE EQUIPMENT ABOVE CEILING AND REMOVE TO THE FURTHEST TERMINATION POINT ON THE FLOOR. COORDINATE EXTENT OF REMOVAL WITH MECHANICAL/ELECTRICAL/PLUMBING DRAWINGS.

PATCHING AND CLEANING

THE GENERAL CONTRACTOR SHALL DO ALL CUTTING, FITTING, AND PATCHING WORK THAT MAY BE REQUIRED TO MAKE ALL PARTS COME TOGETHER PROPERLY AND FIT TO RECEIVE OR BE RECEIVED BY WORK OF OTHER CONTRACTOR SHOWN UPON OR REASONABLY IMPLIED BY THE DRAWINGS AND NOTES

PROVIDE FLOOR CUTOUTS AND PATCHING REQUIRED FOR THE INSTALLATION OF WORK, TYPICAL.


SURVEY ALL EXISTING FINISHED SURFACES TO INCLUDE CORNER BEADS, STOPS, ETC FOR CHIPS, CRACK Holes, DAMAGED SURFACES, MARBLE WAINSCOT AND PLASTER CEILING WHENEVER DOOR DUCKS HAVE BEEN REMOVED, AND ANY OTHER DEFECTS CAUSING AN APPEARANCE DIFFERENT FROM A NEW FIRST CLASS FINISHED REPAIRING, THEN GENERAL CONTRACTOR SHALL REMOVE ALL EXISTING AND INSTALL NEW SURFACES TO THE SATISFACTION OF ARCHITECT. ALL OTHER DAMAGED SURFACES (FINISHED FLOOR SLAB, CONVECTOR ENCLOSURES, ETC) SHALL BE REPAIRED TO THE SATISFACTION OF ARCHITECT

THE GENERAL CONTRACTOR SHALL INSPECT ALL EXISTING PLASTER SURFACES AND WHERE AS A RESULT OF DEMOLITION, FINISHED SURFACES DO NOT ALIGN, IF EXISTING PLASTER SHALL BE CHOPPED AWAY, NEW CORNER BEADS AND STOPS INSTALLED AND SURFACE RE-PLASTERED TO A SMOOTH, FLUSH, ALIGNED SURFACE

PROVIDE METAL LATH OVER NEW CONDUIT CHASES IN MASONRY PARTITIONS
TYPICAL, UNLESS NOTED OTHERWISE

DAMAGED EXISTING AREAS TO REMAIN AND EXISTING AREA AFFECTED BY DEMOLITION OR NEW CONSTRUCTION WORK SHOWN ON DRAWINGS SHALL BE PATCHED AS REQUIRED TO MATCH IMMEDIATE EXISTING ADJACENT AREAS IN MATERIALS, FIRE RATING, FINISH AND COLOR, TYPICAL, UNLESS NOTED OTHERWISE

FIRE PROOFING REMOVED FROM COLUMNS AND BEAMS DURING THE COURSE OF CONSTRUCTION SHALL BE REPLACED WITH THE SAME MATERIAL AND RATING AS THAT WHICH WAS REMOVED, TYPICAL, UNO

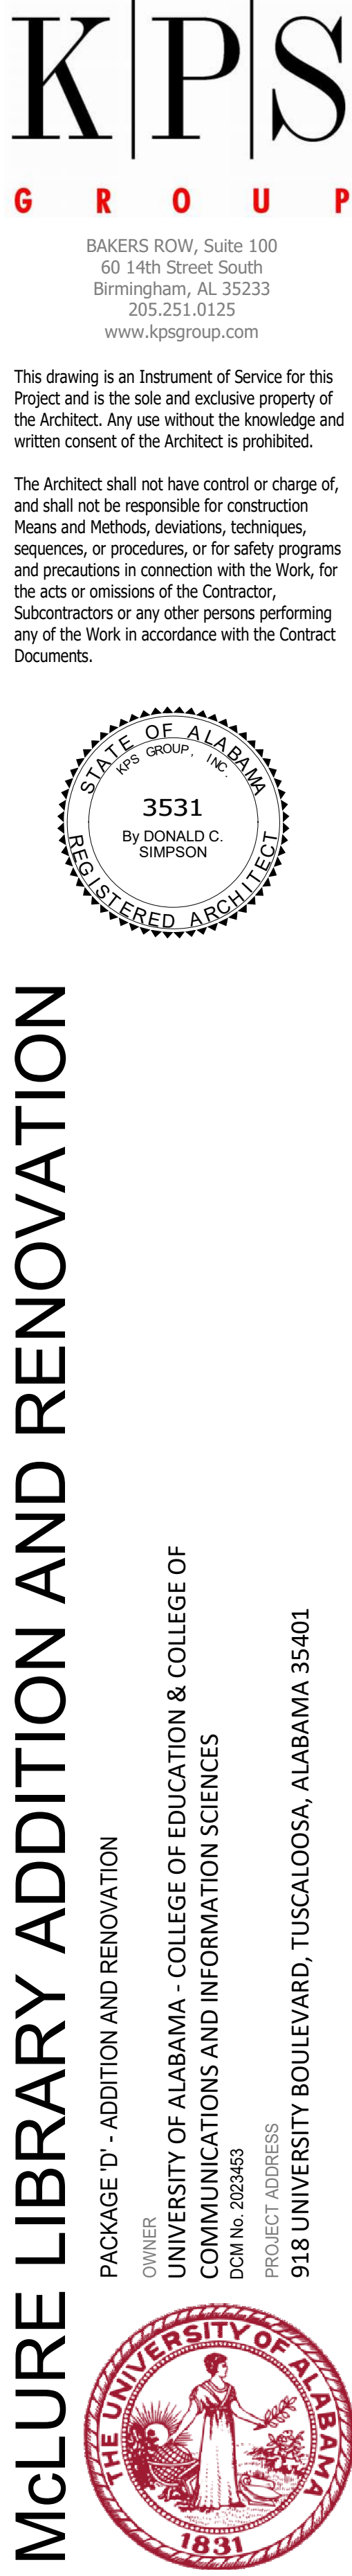

PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DEMOLITION PLAN		
- LEVEL 1		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A0.31		

KEYNOTES


- | | |
|-----|---|
| 001 | DEMOLISH EXISTING HANDRAILS AND GUARDRAILS. STAIR STRINGERS AND TREADS TO REMAIN |
| 012 | REMOVE EXISTING IRONWORK FROM FRONT OF WINDOW. PATCH VENEER. |
| 023 | DEMOLISH SECTION OF FLOOR FOR ELEVATOR SHAFT |
| 024 | DEMOLISH EXISTING EXTERIOR DOOR. |
| 026 | DEMOLISH EXISTING CHAIN LINK FENCE. |
| 032 | SALVAGE AND RE-USE EXISTING STONE SILL |
| 036 | COORDINATE DEMOLITION OF SELECTED AREAS OF MASONRY WALL WITH FINISHED OPENING SIZES. PROVIDE TEMPORARY SUPPORT AND SHORING AS NEEDED. RE. STRUCTURAL AND ARCHITECTURAL DRAWINGS. |
| 037 | INFILL OPENING IN FLOOR |
| 038 | RELOCATE EXISTING MONUMENT SIGN TO LOCATION PROVIDED BY OWNER |
| 039 | DEMOLISH BRIDGE IN ITS ENTIRETY. KEEP EXISTING SANITARY SEWER APPROX 6' BELOW GRADE. INTACT. |
| 040 | DEMOLISH EXISTING METAL PARAPET COPING PRIOR TO INSTALLATION OF REPLACEMENT COPING. |
| 052 | REMOVE OLD PLYWOOD AND PHONE JACK. CLEAN AND PATCH WALL. |
| 053 | DEMOLISH EXISTING PIPING |
| 054 | DEMOLISH ALL EXISTING ELECTRICAL, MECHANICAL, AND PLUMBING EQUIPMENT ON ROOF, INCLUDING, BUT NOT LIMITED TO CONDUITS, VENTS, EXHAUSTS, AND ROOF DRAINS, TYPICAL, UNLESS NOTED OTHERWISE |
| 056 | SALVAGE EXISTING WOOD CASINGS ON WINDOW EXTERIOR FOR RE-USE. RE: WINDOW DETAILS A7.1X SERIES. |

DEMOLITION GENERAL NOTES

1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES ON SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
2. IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
3. REFER TO ACM-SERIES DRAWINGS FOR ACM ABATEMENT.
4. REMOVE INTERIOR PARTITIONS PER PLAN.
5. REMOVE INTERIOR DOORS AND FRAMES PER PLAN.
6. DEMOLISH FLOORING, INCLUDING SUBFLOOR, TILE, CARPET, AND RAISED FLOOR TO CONCRETE FLOOR SLAB, TYPICAL, UNLESS NOTED OTHERWISE.
7. REMOVE PLUMBING FIXTURES PER PLAN. REMOVE PIPING AND ADDITIONAL FIRE PROTECTION AND PLUMBING PER PLUMBING DEMOLITION PLANS.
8. REMOVE HVAC DEVICES, DUCTS, AND PIPING PER MECHANICAL DEMOLITION PLANS.
9. DEMOLISH EXTERIOR DOORS AND WINDOWS, TYPICAL, UNLESS NOTED OTHERWISE. LEAVE EXISTING FRAME IN PLACE TO ANCHOR NEW WORK. RE: WINDOW DETAILS SHEETS A7.1X SERIES.
10. REMOVE EXISTING CASEWORK, MILLWORK, SHELVING.
11. REMOVE PLASTER FINISH FROM INSIDE FACE OF MASONRY WALLS DOWN TO BRICK, TYPICAL. RE: ACM DRAWINGS FOR REQUIRED ABATEMENT.

DEMOLITION PLAN LEGEND

- INDICATES EXISTING CONSTRUCTION TO BE DEMOLISHED TO LIMITS SHOWN ON DRAWINGS. PATCH, REPAIR, SMOOTH AND CLEAN ADJACENT FLOORS, WALLS AND CEILINGS AS REQUIRED TO PROVIDE SMOOTH SURFACE FOR NEW FINISHES
- WALLS TO REMAIN
- EXISTING DOOR, FRAME TO REMAIN. UPGRADE DOOR HARDWARE.
- EXISTING DOOR, FRAME AND HARDWARE IS TO BE REMOVED. WALLS TO BE CLEANED, REPAIRED AND REFINISHED. SAVE ALL ITEMS FOR REUSE UNLESS OTHERWISE NOTED. RE. STRUCTURAL

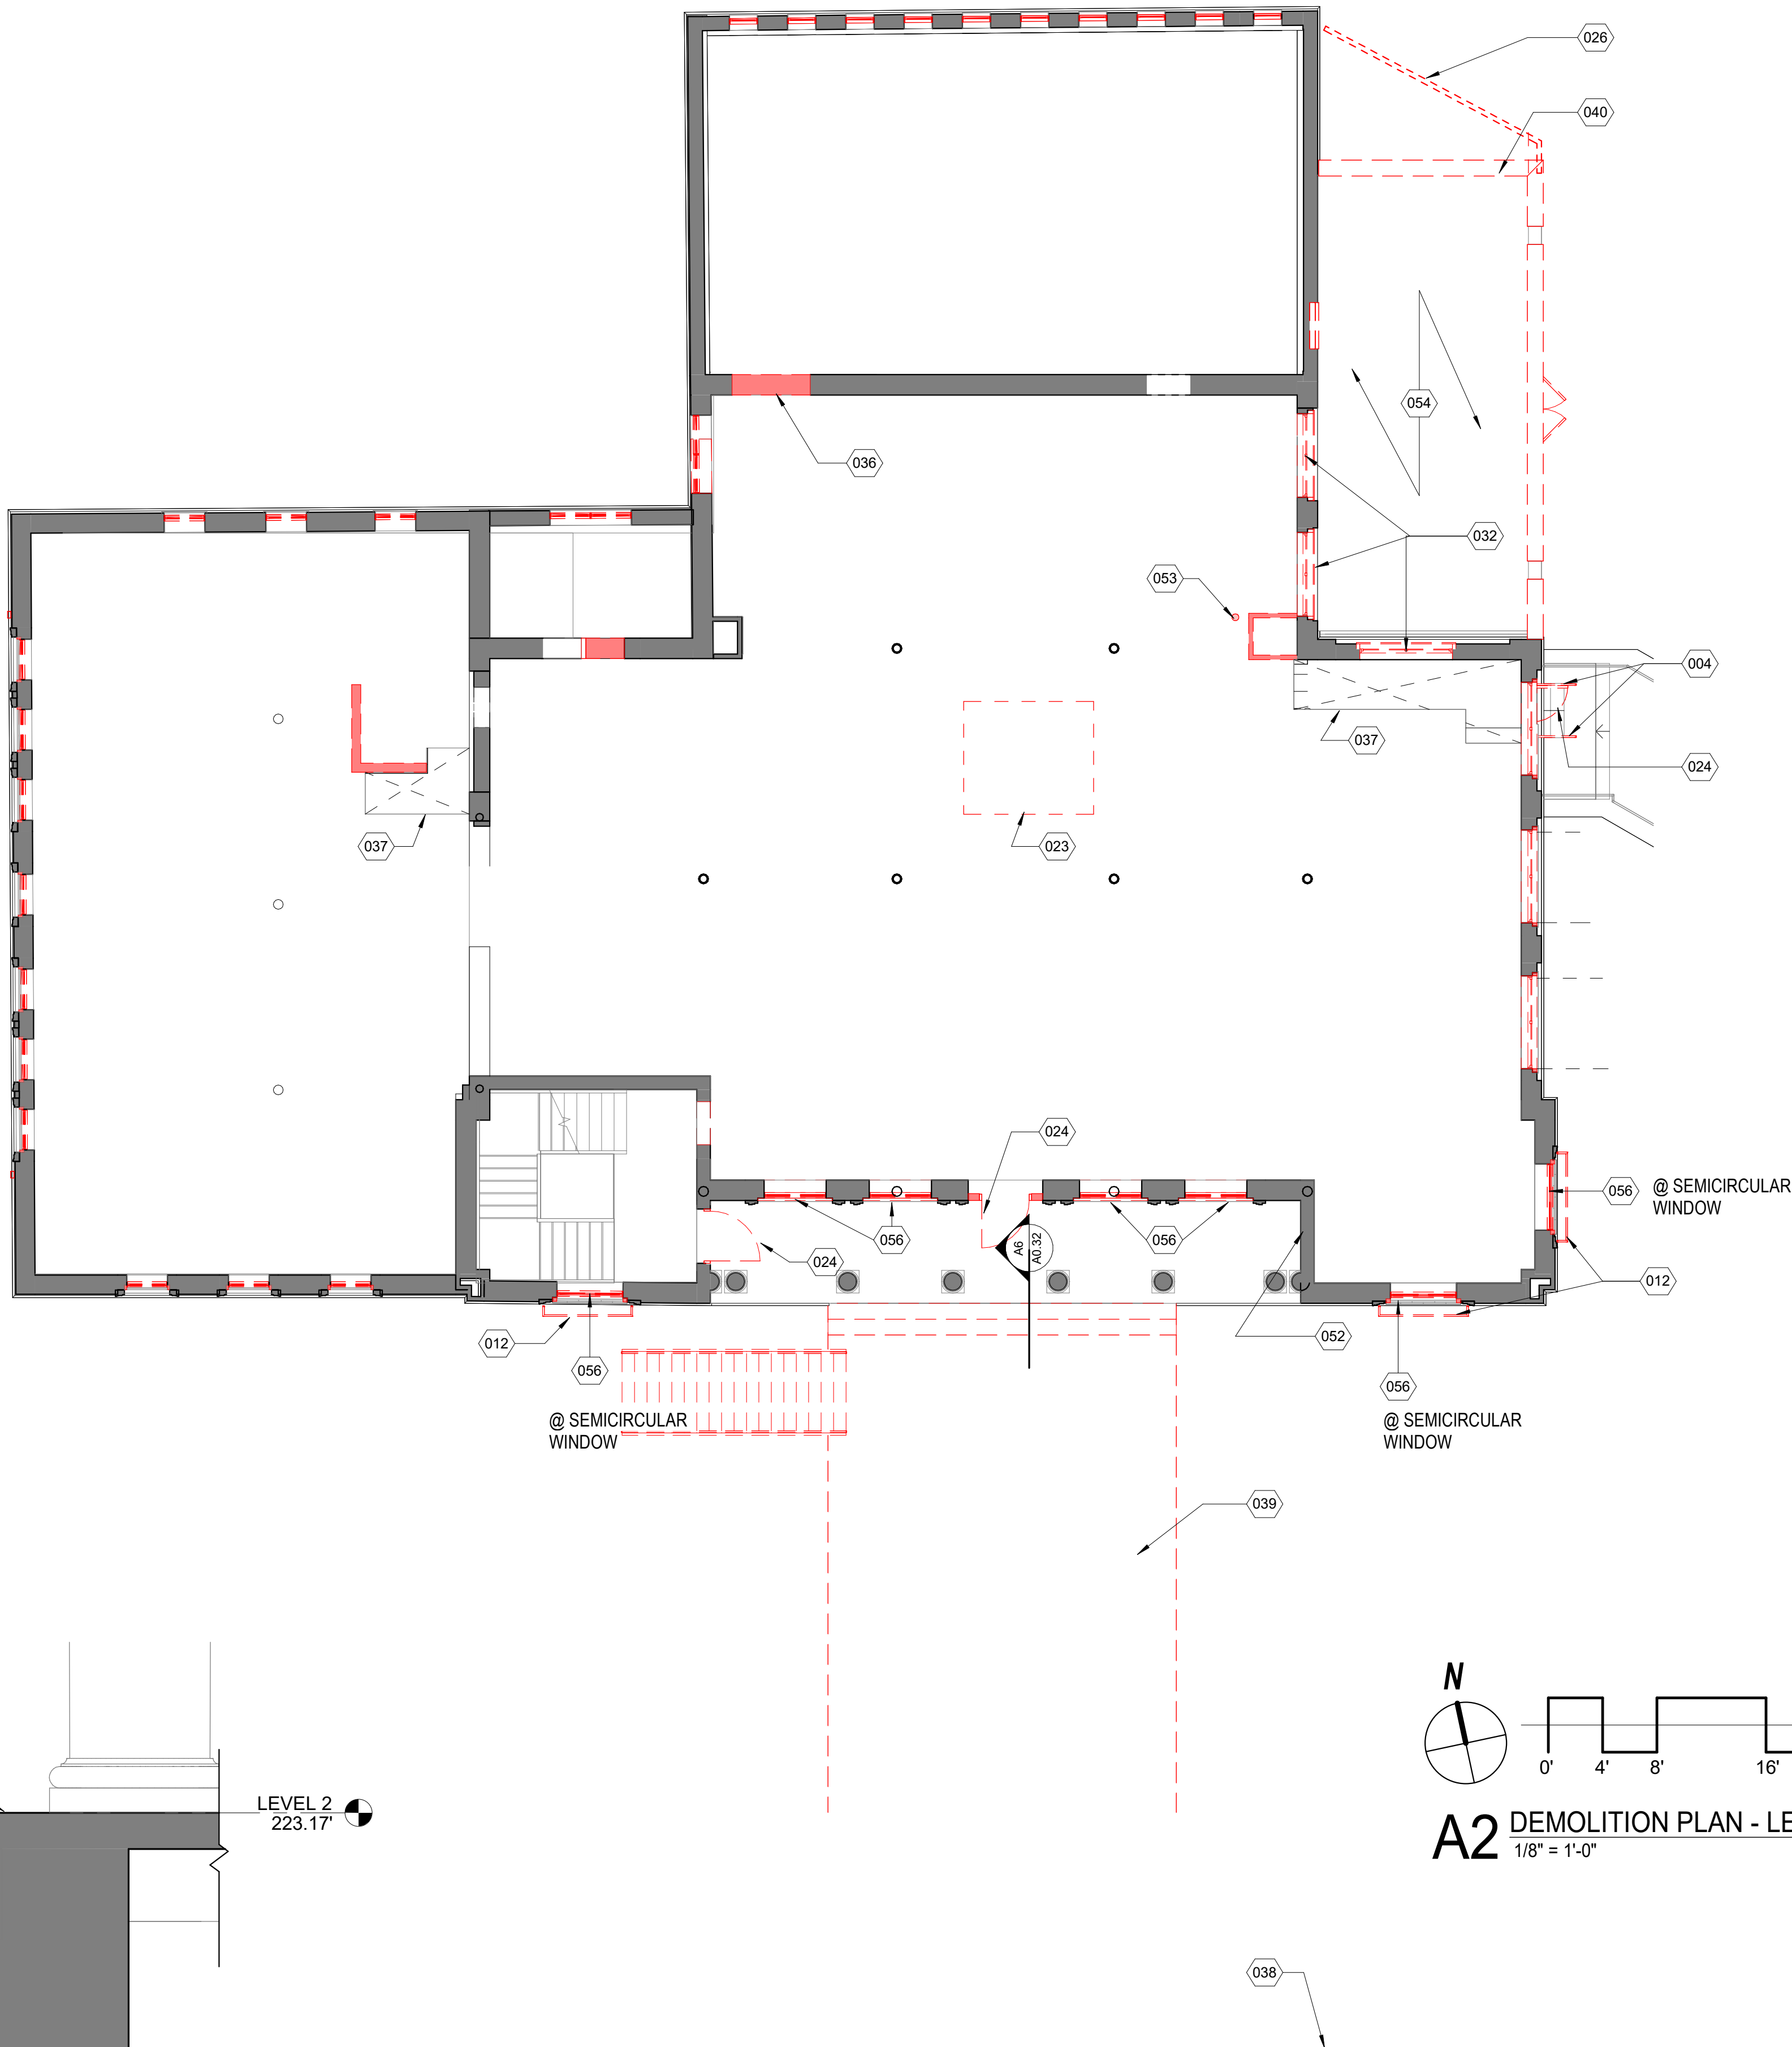

A6 DETAIL - BRIDGE TO PORTICO JOINT
1" = 1'-0"

DEMOLITION GENERAL NOTES (CONT'D)

- THE WORK OF THIS PROJECT INCLUDES ALTERATIONS OF THE EXISTING BUILDING TO ACHIEVE THE ARRANGEMENT INDICATED ON THE DRAWINGS. THE CONTRACTOR SHALL VISIT THE JOB SITE TO DETERMINE THE EXTENT OF DEMOLITION WORK REQUIRED BY THE CONSTRUCTION ACTIVITIES. THE ARCHITECTURAL DRAWINGS FOR THESE AREAS SHOW THE CHANGES TO BE MADE. THE CONTRACTOR SHALL REVISE, REARRANGE, REORDER OR REMOVE EXISTING WIRING AND HVAC DISTRIBUTION AS REQUIRED TO ACCOMMODATE THE CHANGES AND ADDITIONS SHOWN AND TO PROVIDE CONTINUING ELECTRICAL AND HVAC SERVICES FOR THOSE EXISTING PORTIONS OF THE PROJECT WHICH ARE TO REMAIN IN OPERATION. INTENT OF THE DRAWING IS TO SHOW EXISTING BUILDING CONDITIONS WITH INFORMATION DEVELOPED FROM AVAILABLE DOCUMENTS. CONTRACTOR SHALL MAKE A DETAILED SURVEY OF EXISTING CONDITIONS PERTAINING TO THE WORK BEFORE COMMENCING DEMOLITION. THE CONTRACTOR SHALL REPORT DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL FIELD CONDITIONS TO THE ARCHITECT.
16. DEMOLITION NOT DESCRIBED HERE BUT NECESSARY FOR THE COMPLETION OF THE WORK SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE DEMOLITION DRAWINGS ARE ISSUED FOR INFORMATION ONLY AND SHOW THE GENERAL EXTENT OF THE DEMOLITION REQUIRED. THESE DRAWINGS DO NOT NECESSARILY SHOW EVERYTHING TO BE REMOVED IN ORDER TO PREPARE THE EXISTING BUILDING ELEMENTS FOR REMODELING OR NEW CONSTRUCTION. THE ARCHITECTURAL DRAWINGS SHOW THE EXISTING PARTITIONS WITH DOORS AND OTHER ITEMS TO REMAIN
17. FURNISH ALL LABOR AND MATERIAL REQUIRED TO COMPLETE DEMOLITION AND REMOVAL OF ALL ITEMS AS INDICATED IN ARCHITECT'S DRAWINGS OR AS OTHERWISE DIRECTED BY ARCHITECT.
18. FURNISH BUILDING MANAGEMENT AND ARCHITECT WITH A COMPLETE INVENTORY LIST OF ALL ITEMS THAT CAN BE REUSED AND/OR STORED IN BUILDING STOCK.
19. THE GENERAL CONTRACTOR SHALL EXECUTE ALL WORK WITH THE REGULATIONS OF THE BUILDING FOR DEMOLITION AND REMOVAL OF DEBRIS, INCLUDING OVERTIME WORK REQUIRED.
20. PROTECT THE PROPERTY OF THE BUILDING OWNER INCLUDING BUT NOT LIMITED TO, WINDOWS, FLOOR AND CEILING TILE, PUBLIC TOILETS, ELEVATORS, DOORS, BUCKS, ELECTRICAL AND AIR CONDITIONING EQUIPMENT, CONVECTOR ENCLOSURES, ETC. THE CONTRACTOR SHALL AT NO TIME DO ANY WORK OR PLACE ANY CONSTRUCTION THAT MAY AFFECT THE OPERATIONS OF THE OTHER TENANTS, INCLUDING ANY INTERRUPTIONS IN THE SUPPLY OF POWER OR OTHER UTILITIES WITHOUT FIRST NOTIFYING THE BUILDING OWNER AND OBTAINING PERMISSION TO PROCEED.
21. PROVIDE ADJACENT SEAL FROM FLOOR TO CEILING AT ALL INTERFACES TO PROTECT VIOLENT BUILDING PROPERTY WHILE DEMOLITION AND CONSTRUCTION ARE IN PROGRESS. THIS SEAL IS TO BE KEPT CLOSED AT ALL TIMES.
22. IN AREAS WHERE THERE ARE NO ALTERATIONS INDICATED THE EXISTING FACILITIES SHALL BE RETAINED IN SERVICE. IN CASE OF DOUBT ASSUME THAT THE EXISTING ELECTRICAL WIRING IS TO REMAIN IN OPERATION THROUGHOUT THE CONSTRUCTION PERIOD AND THEREAFTER.
23. WHERE CONSTRUCTION TO BE REMOVED INTERSECTS CONSTRUCTION TO REMAIN, WORK SHALL INCLUDE ALL ATTACHMENT DEVICES (SHOT PINS, ANCHORS, LAG BOLTS, NAILS, NAILERS, SHIMS, ETC)
24. IN AREAS WHERE DEMOLITION (REMOVAL OF TILE, CARPETING, PARTITIONS, ETC) CAUSES AND UNEVENNESS IN SLAB, PATCH TO LEVEL THE SLAB TO RECEIVE NEW FINISHED FLOORING, TYPICAL, UNLESS NOTED OTHERWISE.
25. REMOVE DEMOLISHED WORK FROM THE PREMISES EXCEPT ITEMS TO BE REUSED OR RETURNED TO TENANT OR AS OTHERWISE NOTED.
26. UPON THE REMOVAL OF THE EXISTING CEILING, THE EXISTING MECHANICAL SYSTEM WILL BE EVALUATED BY THE ENGINEER FOR POSSIBILITY FOR RE-USE. IF THE EXISTING MECHANICAL SYSTEMS ARE TO BE REUSED, EXISTING MAIN DUCT, VAV BOXES, PNEUMATIC CONTROL TUBING ETC SHALL REMAIN AND SHALL BE PROTECTED TO AVOID DAMAGE TO EXISTING HVAC EQUIPMENT DURING DEMOLITION
27. CAP AND FLUSH OFF BEHIND FINISH SURFACES ALL PROJECTING PLUMBING, FLOOR ELECTRICAL/PLUMBING OUTLETS, AND ALL OTHER PROJECTING ITEMS WHICH ARE BEING ABANDONED.
28. THE GENERAL CONTRACTOR SHALL REMOVE FROM PREMISES CONDUITS LEFT AFTER WALL DEMOLITION, INCLUDING SWITCH BOXES, PLATES, BRIDGES OR ANY OTHER TELEPHONE OR ELECTRICAL WIRING EQUIPMENT.
29. REMOVE MATERIAL OTHER THAN ITEMS TO BE SALVAGED OR REUSED SHALL BECOME CONTRACTORS' PROPERTY UNLESS OTHERWISE NOTIFIED AND SHALL BE REMOVED FROM OWNERS PROPERTY. CLEAN UP AND DISPOSE OF DEBRIS PROMPTLY AND CONTINUOUSLY AS WORK PROGRESSES. SECURE AND PAY FOR REQUIRED HAULING PERMITS, DUMPING FEES AND CHARGES.
30. ELECTRICAL, MECHANICAL AND PLUMBING TO BE REMOVED TO THE FURTHEST TERMINATION POINT ON THE FLOOR. REMOVE ALL UNUSED AND DISCONNECTED HVAC, ELECTRICAL, PLUMBING AND PHONE EQUIPMENT ABOVE CEILING AND REMOVE TO THE FURTHEST TERMINATION POINT ON THE FLOOR. COORDINATE EXTENT OF REMOVAL WITH MECHANICAL/ELECTRICAL/PLUMBING DRAWINGS.
31. FURNISH A SYSTEM OF TEMPORARY LIGHTS THROUGHOUT THE SPACE UNDER CONSTRUCTION AS REQUIRED.
32. MAINTAIN FULLY CHARGED FIRE EXTINGUISHER READILY AVAILABLE DURING ALL DEMOLITION OPERATIONS.
33. UPON COMPLETION OF DEMOLITION WORK, PROVIDE THAT ALL AREAS BE LEFT CLEAN IN A BROOM- SWEEP CONDITION

PATCHING AND CLEANING

THE GENERAL CONTRACTOR SHALL DO ALL CUTTING, FITTING, AND PATCHING WORK THAT MAY BE REQUIRED TO MAKE ALL PARTS COME TOGETHER PROPERLY AND FIT TO RECEIVE OR BE RECEIVED BY WORK OF OTHER CONTRACTOR SHOWN UPON OR REASONABLY IMPLIED BY THE DRAWINGS AND NOTES

PROVIDE FLOOR CUTOUTS AND PATCHING REQUIRED FOR THE INSTALLATION OF WORK, TYPICAL.


SURVEY ALL EXISTING FINISHED SURFACES TO INCLUDE CORNER BEADS, STOPS, ETC. FOR CHIPS, CRACK HOLES, DAMAGED SURFACES, MARBLE WAINSCOT AND PLASTER CEILING WHENEVER DOOR DUCKS HAVE BEEN REMOVED, AND ANY OTHER DEFECTS CAUSING AN APPEARANCE DIFFERENT FROM A NEW FIRST CLASS FINISHED REPAIRING. THEN GENERAL CONTRACTOR SHALL REMOVE ALL EXISTING AND INSTALL NEW SURFACES TO THE SATISFACTION OF ARCHITECT. ALL OTHER DAMAGED SURFACES (FINISHED FLOOR SLAB, CONNECTOR ENCLOSURES, ETC) SHALL BE REPAIRED TO THE SATISFACTION OF ARCHITECT

THE GENERAL CONTRACTOR SHALL INSPECT ALL EXISTING PLASTER SURFACES AND WHERE AS A RESULT OF DEMOLITION, FINISHED SURFACES DO NOT ALIGN, IF EXISTING PLASTER SHALL BE CHOPPED AWAY, NEW CORNER BEADS AND STOPS INSTALLED AND SURFACE RE-PLASTERED TO A SMOOTH, FLUSH, ALIGNED SURFACE

PROVIDE METAL LATH OVER NEW CONDUIT CHASES IN MASONRY PARTITIONS
TYPICAL, UNLESS NOTED OTHERWISE

DAMAGED EXISTING AREAS TO REMAIN AND EXISTING AREA AFFECTED BY DEMOLITION OR NEW CONSTRUCTION WORK SHOWN ON DRAWINGS SHALL BE PATCHED AS REQUIRED TO MATCH IMMEDIATE EXISTING ADJACENT AREAS IN MATERIALS, FIRE RATING, FINISH AND COLOR, TYPICAL, UNLESS NOTED OTHERWISE

FIRE PROOFING REMOVED FROM COLUMNS AND BEAMS DURING THE COURSE OF CONSTRUCTION SHALL BE REPLACED WITH THE SAME MATERIAL AND RATING AS THAT WHICH WAS REMOVED, TYPICAL, UNO

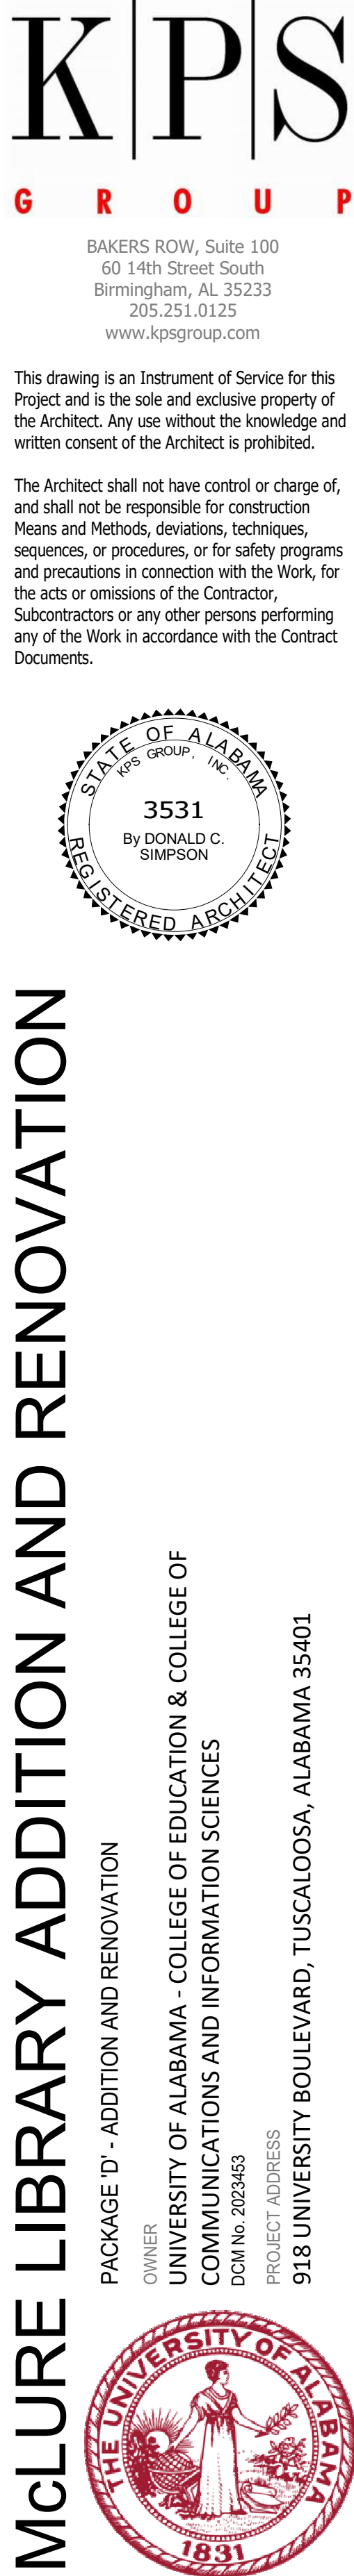

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DEMOLITION PLAN - LEVEL 2		
DRAWN BY:	Author	
CHECKED BY:	Checker	
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A0.32		

KEYNOTES

023	DEMOLISH SECTION OF FLOOR FOR ELEVATOR SHAFT
029	DEMOLISH EXISTING WOOD CEILING IN ITS ENTIRETY THIS AREA.
036	COORDINATE DEMOLITION OF SELECTED AREAS OF MASONRY WALL WITH FINISHED OPENING SIZES. PROVIDE TEMPORARY SUPPORT AND SHORING AS NEEDED. RE: STRUCTURAL AND ARCHITECTURAL DRAWINGS.
054	DEMOLISH ALL EXISTING ELECTRICAL, MECHANICAL, AND PLUMBING EQUIPMENT ON ROOF, INCLUDING, BUT NOT LIMITED TO CONDUITS, VENTS, EXHAUSTS, AND ROOF DRAINS, TYPICAL, UNLESS NOTED OTHERWISE.
055	REMOVE EXISTING CONDUITS

DEMOLITION GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL, UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
- REFER TO ACM-SERIES DRAWINGS FOR ACM ABATEMENT.
- REMOVE INTERIOR PARTITIONS PER PLAN.
- REMOVE INTERIOR DOORS AND FRAMES PER PLAN.
- DEMOLISH FLOORING, INCLUDING SUBFLOOR, TILE, CARPET, AND RAISED FLOOR TO CONCRETE FLOOR SLAB, TYPICAL, UNLESS NOTED OTHERWISE.
- REMOVE PLUMBING FIXTURES PER PLAN. REMOVE PIPING AND ADDITIONAL FIRE PROTECTION AND PLUMBING PER PLUMBING DEMOLITION PLANS.
- REMOVE HVAC DEVICES, DUCTS, AND PIPING PER MECHANICAL DEMOLITION PLANS.
- DEMOLISH EXTERIOR DOORS AND WINDOWS, TYPICAL, UNLESS NOTED OTHERWISE. LEAVE EXISTING FRAME IN PLACE TO ANCHOR NEW WORK. RE: WINDOW DETAILS SHEETS A7.1X SERIES.
- REMOVE EXISTING CASEWORK, MILLWORK, SHELVEING.
- REMOVE PLASTER FINISH FROM INSIDE FACE OF MASONRY WALLS DOWN TO BRICK, TYPICAL. RE: ACM DRAWINGS FOR REQUIRED ABATEMENT.

DEMOLITION PLAN LEGEND

- INDICATES EXISTING CONSTRUCTION TO BE DEMOLISHED TO LIMITS SHOWN ON DRAWINGS. PATCH, REPAIR, SMOOTH AND CLEAN ADJACENT FLOORS, WALLS AND CEILINGS AS REQUIRED TO PROVIDE SMOOTH SURFACE FOR NEW FINISHES
- WALLS TO REMAIN
- EXISTING DOOR, FRAME TO REMAIN. UPGRADE DOOR HARDWARE.
- EXISTING DOOR, FRAME AND HARDWARE IS TO BE REMOVED. WALLS TO BE CLEANED, REPAIRED AND RE-FINISHED. SAVE ALL ITEMS FOR RE-USE UNLESS OTHERWISE NOTED. RE: STRUCTURAL

DEMOLITION GENERAL NOTES (CONT'D)

- THE WORK OF THIS PROJECT INCLUDES ALTERATIONS OF THE EXISTING BUILDING TO ACHIEVE THE ARRANGEMENT INDICATED ON THE DRAWINGS. THE CONTRACTOR SHALL VISIT THE JOB SITE TO DETERMINE THE EXTENT OF DEMOLITION WORK REQUIRED BY THE CONSTRUCTION ACTIVITIES. THE ARCHITECTURAL DRAWINGS FOR THESE AREAS SHOW THE CHANGES TO BE MADE. THE CONTRACTOR SHALL REVISE, REARRANGE, REROUTE OR REMOVE EXISTING WIRING AND HVAC DISTRIBUTION AS REQUIRED TO ACCOMMODATE THE CHANGES AND ADDITIONS SHOWN AND TO PROVIDE CONTINUING ELECTRICAL AND HVAC SERVICES FOR THOSE EXISTING PORTIONS OF THE PROJECT WHICH ARE TO REMAIN IN OPERATION. INTENT OF THE DRAWING IS TO SHOW EXISTING BUILDING CONDITIONS WITH INFORMATION DEVELOPED FROM AVAILABLE DOCUMENTS. CONTRACTOR SHALL MAKE A DETAILED SURVEY OF EXISTING CONDITIONS PERTAINING TO THE WORK BEFORE COMMENCING DEMOLITION. THE CONTRACTOR SHALL REPORT DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL FIELD CONDITIONS TO THE ARCHITECT.
- DEMOLITION NOT DESCRIBED HERE BUT NECESSARY FOR THE COMPLETION OF THE WORK SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE DEMOLITION DRAWINGS ARE ISSUED FOR INFORMATION ONLY AND SHOW THE GENERAL EXTENT OF THE DEMOLITION REQUIRED. THESE DRAWINGS DO NOT NECESSARILY SHOW EVERYTHING TO BE REMOVED IN ORDER TO PREPARE THE EXISTING BUILDING ELEMENTS FOR REMODELING OR NEW CONSTRUCTION. THE ARCHITECTURAL DRAWINGS SHOW THE EXISTING PARTITIONS WITH DOORS AND OTHER ITEMS TO REMAIN
- FURNISH ALL LABOR AND MATERIAL REQUIRED TO COMPLETE DEMOLITION AND REMOVAL OF ALL ITEMS AS INDICATED IN ARCHITECT'S DRAWINGS OR AS OTHERWISE DIRECTED BY ARCHITECT.
- FURNISH BUILDING MANAGEMENT AND ARCHITECT WITH A COMPLETE INVENTORY LIST OF ALL ITEMS THAT CAN BE REUSED AND/OR STORED IN BUILDING STOCK.
- THE GENERAL CONTRACTOR SHALL EXECUTE ALL WORK WITH THE REGULATIONS OF THE BUILDING FOR DEMOLITION AND REMOVAL OF DEBRIS, INCLUDING OVERTIME WORK REQUIRED.
- PROTECT THE PROPERTY OF THE BUILDING OWNER INCLUDING BUT NOT LIMITED TO, WINDOWS, FLOOR AND CEILING TILE, PUBLIC TOILETS, ELEVATORS, DOORS, BUCKS, ELECTRICAL AND AIR CONDITIONING EQUIPMENT, CONVECTOR ENCLOSURES, ETC. THE CONTRACTOR SHALL AT NO TIME DO ANY WORK OR PLACE ANY CONSTRUCTION THAT MAY AFFECT THE OPERATIONS OF THE OTHER TENANTS, INCLUDING ANY INTERRUPTIONS IN THE SUPPLY OF POWER OR OTHER UTILITIES WITHOUT FIRST NOTIFYING THE BUILDING OWNER AND OBTAINING PERMISSION TO PROCEED.
- PROVIDE VISQUEEN SEAL FROM FLOOR TO CEILING AT ALL INTERFACES TO PROTECT ADJACENT BUILDING PROPERTY WHILE DEMOLITION AND CONSTRUCTION ARE IN PROGRESS, THIS SEAL IS TO BE KEPT CLOSED AT ALL TIMES.
- IN AREAS WHERE THERE ARE NO ALTERATIONS INDICATED THE EXISTING FACILITIES SHALL BE RETAINED IN SERVICE. IN CASE OF DOUBT ASSUME THAT THE EXISTING ELECTRICAL WIRING IS TO REMAIN IN OPERATION THROUGHOUT THE CONSTRUCTION PERIOD AND THEREAFTER.
- WHERE CONSTRUCTION TO BE REMOVED INTERSECTS CONSTRUCTION TO REMAIN, WORK SHALL INCLUDE ALL ATTACHMENT DEVICES (SHOT PINS, ANCHORS, LAG BOLTS, NAILS, NAILERS, SHIMS, (ETC)
- IN AREAS WHERE DEMOLITION (REMOVAL OF TILE, CARPETING, PARTITIONS, (ETC) CAUSES AND UNEVENNESS IN SLAB, PATCH TO LEVEL THE SLAB TO RECEIVE NEW FINISHED FLOORING, TYPICAL, UNLESS NOTED OTHERWISE.
- REMOVE DEMOLISHED WORK FROM THE PREMISES EXCEPT ITEMS TO BE REUSED OR RETURNED TO TENANT OR AS OTHERWISE NOTED.
- UPON THE REMOVAL OF THE EXISTING CEILING, THE EXISTING MECHANICAL SYSTEM WILL BE EVALUATED BY THE ENGINEER FOR POSSIBILITY FOR RE-USE, IF THE EXISTING MECHANICAL SYSTEMS ARE TO BE REUSED, EXISTING MAIN DUCT, VAV BOXES, PNEUMATIC CONTROL TUBING ETC SHALL REMAIN AND SHALL BE PROTECTED TO AVOID DAMAGE TO EXISTING HVAC EQUIPMENT DURING DEMOLITION
- CAP AND FLUSH OFF BEHIND FINISH SURFACES ALL PROJECTING PLUMBING, FLOOR ELECTRICAL/TELEPHONE OUTLETS, AND ALL OTHER PROJECTING ITEMS WHICH ARE BEING ABANDONED.
- THE GENERAL CONTRACTOR SHALL REMOVE FROM PREMISES CONDUITS LEFT AFTER WALL DEMOLITION, INCLUDING SWITCH BOXES, PLATES, BRIDGES OR ANY OTHER TELEPHONE OR ELECTRICAL WIRING AND EQUIPMENT.
- REMOVED MATERIAL OTHER THAN ITEMS TO BE SALVAGED OR REUSED SHALL BECOME CONTRACTORS' PROPERTY UNLESS OTHERWISE NOTIFIED AND SHALL BE REMOVED FROM OWNERS PROPERTY. CLEAN UP AND DISPOSE OF DEBRIS PROMPTLY AND CONTINUOUSLY AS WORK PROGRESSES. SECURE AND PAY FOR REQUIRED HAULING PERMITS, DUMPING FEES AND CHARGES.
- ELECTRICAL, MECHANICAL AND PLUMBING TO BE REMOVED TO THE FURTHEST TERMINATION POINT ON THE FLOOR. REMOVE ALL UNUSED AND DISCONNECTED HVAC, ELECTRICAL, PLUMBING AND PHONE EQUIPMENT ABOVE CEILING AND REMOVE TO THE FURTHEST TERMINATION POINT ON THE FLOOR. COORDINATE EXTENT OF REMOVAL WITH MECHANICAL/ ELECTRICAL/PLUMBING DRAWINGS.
- FURNISH A SYSTEM OF TEMPORARY LIGHTS THROUGHOUT THE SPACE UNDER CONSTRUCTION AS REQUIRED.
- MAINTAIN FULLY CHARGED FIRE EXTINGUISHER READILY AVAILABLE DURING ALL DEMOLITION OPERATIONS.
- UPON COMPLETION OF DEMOLITION WORK, PROVIDE THAT ALL AREAS BE LEFT CLEAN IN A BROOM -SWEEP CONDITION

PATCHING AND CLEANING

THE GENERAL CONTRACTOR SHALL DO ALL CUTTING, FITTING, AND PATCHING WORK THAT MAY BE REQUIRED TO MAKE ALL PARTS COME TOGETHER PROPERLY AND FIT TO RECEIVE OR BE RECEIVED BY WORK OF OTHER CONTRACTOR SHOWN UPON OR REASONABLY IMPLIED BY THE DRAWINGS AND NOTES

PROVIDE FLOOR CUTOUTS AND PATCHING REQUIRED FOR THE INSTALLATION OF WORK, TYPICAL.


SURVEY ALL EXISTING FINISHED SURFACES TO INCLUDE CORNER BEADS, STOPS, ETC FOR CHIPS, CRACK HOLES, DAMAGED SURFACES, MARBLE WAINSCOT AND PLASTER CEILING WHENEVER DOOR DUCKS HAVE BEEN REMOVED, AND ANY OTHER DEFECTS CAUSING AN APPEARANCE DIFFERENT FROM A NEW FIRST CLASS FINISHED REPAIRING, THEN GENERAL CONTRACTOR SHALL REMOVE ALL EXISTING AND INSTALL NEW SURFACES TO THE SATISFACTION OF ARCHITECT. ALL OTHER DAMAGED SURFACES (FINISHED FLOOR SLAB, CONVECTOR ENCLOSURES, ETC) SHALL BE REPAIRED TO THE SATISFACTION OF ARCHITECT

THE GENERAL CONTRACTOR SHALL INSPECT ALL EXISTING PLASTER SURFACES AND WHERE AS A RESULT OF DEMOLITION, FINISHED SURFACES DO NOT ALIGN, IF EXISTING PLASTER SHALL BE CHOPPED AWAY, NEW CORNER BEADS AND STOPS INSTALLED AND SURFACE RE-PLASTERED TO A SMOOTH, FLUSH, ALIGNED SURFACE

PROVIDE METAL LATH OVER NEW CONDUIT CHASES IN MASONRY PARTITIONS, TYPICAL, UNLESS NOTED OTHERWISE

DAMAGED EXISTING AREAS TO REMAIN AND EXISTING AREA AFFECTED BY DEMOLITION OR NEW CONSTRUCTION WORK SHOWN ON DRAWINGS SHALL BE PATCHED AS REQUIRED TO MATCH IMMEDIATE EXISTING ADJACENT AREAS IN MATERIALS, FIRE RATING, FINISH AND COLOR, TYPICAL, UNLESS NOTED OTHERWISE

FIRE PROOFING REMOVED FROM COLUMNS AND BEAMS DURING THE COURSE OF CONSTRUCTION SHALL BE REPLACED WITH THE SAME MATERIAL AND RATING AS THAT WHICH WAS REMOVED, TYPICAL, UNO

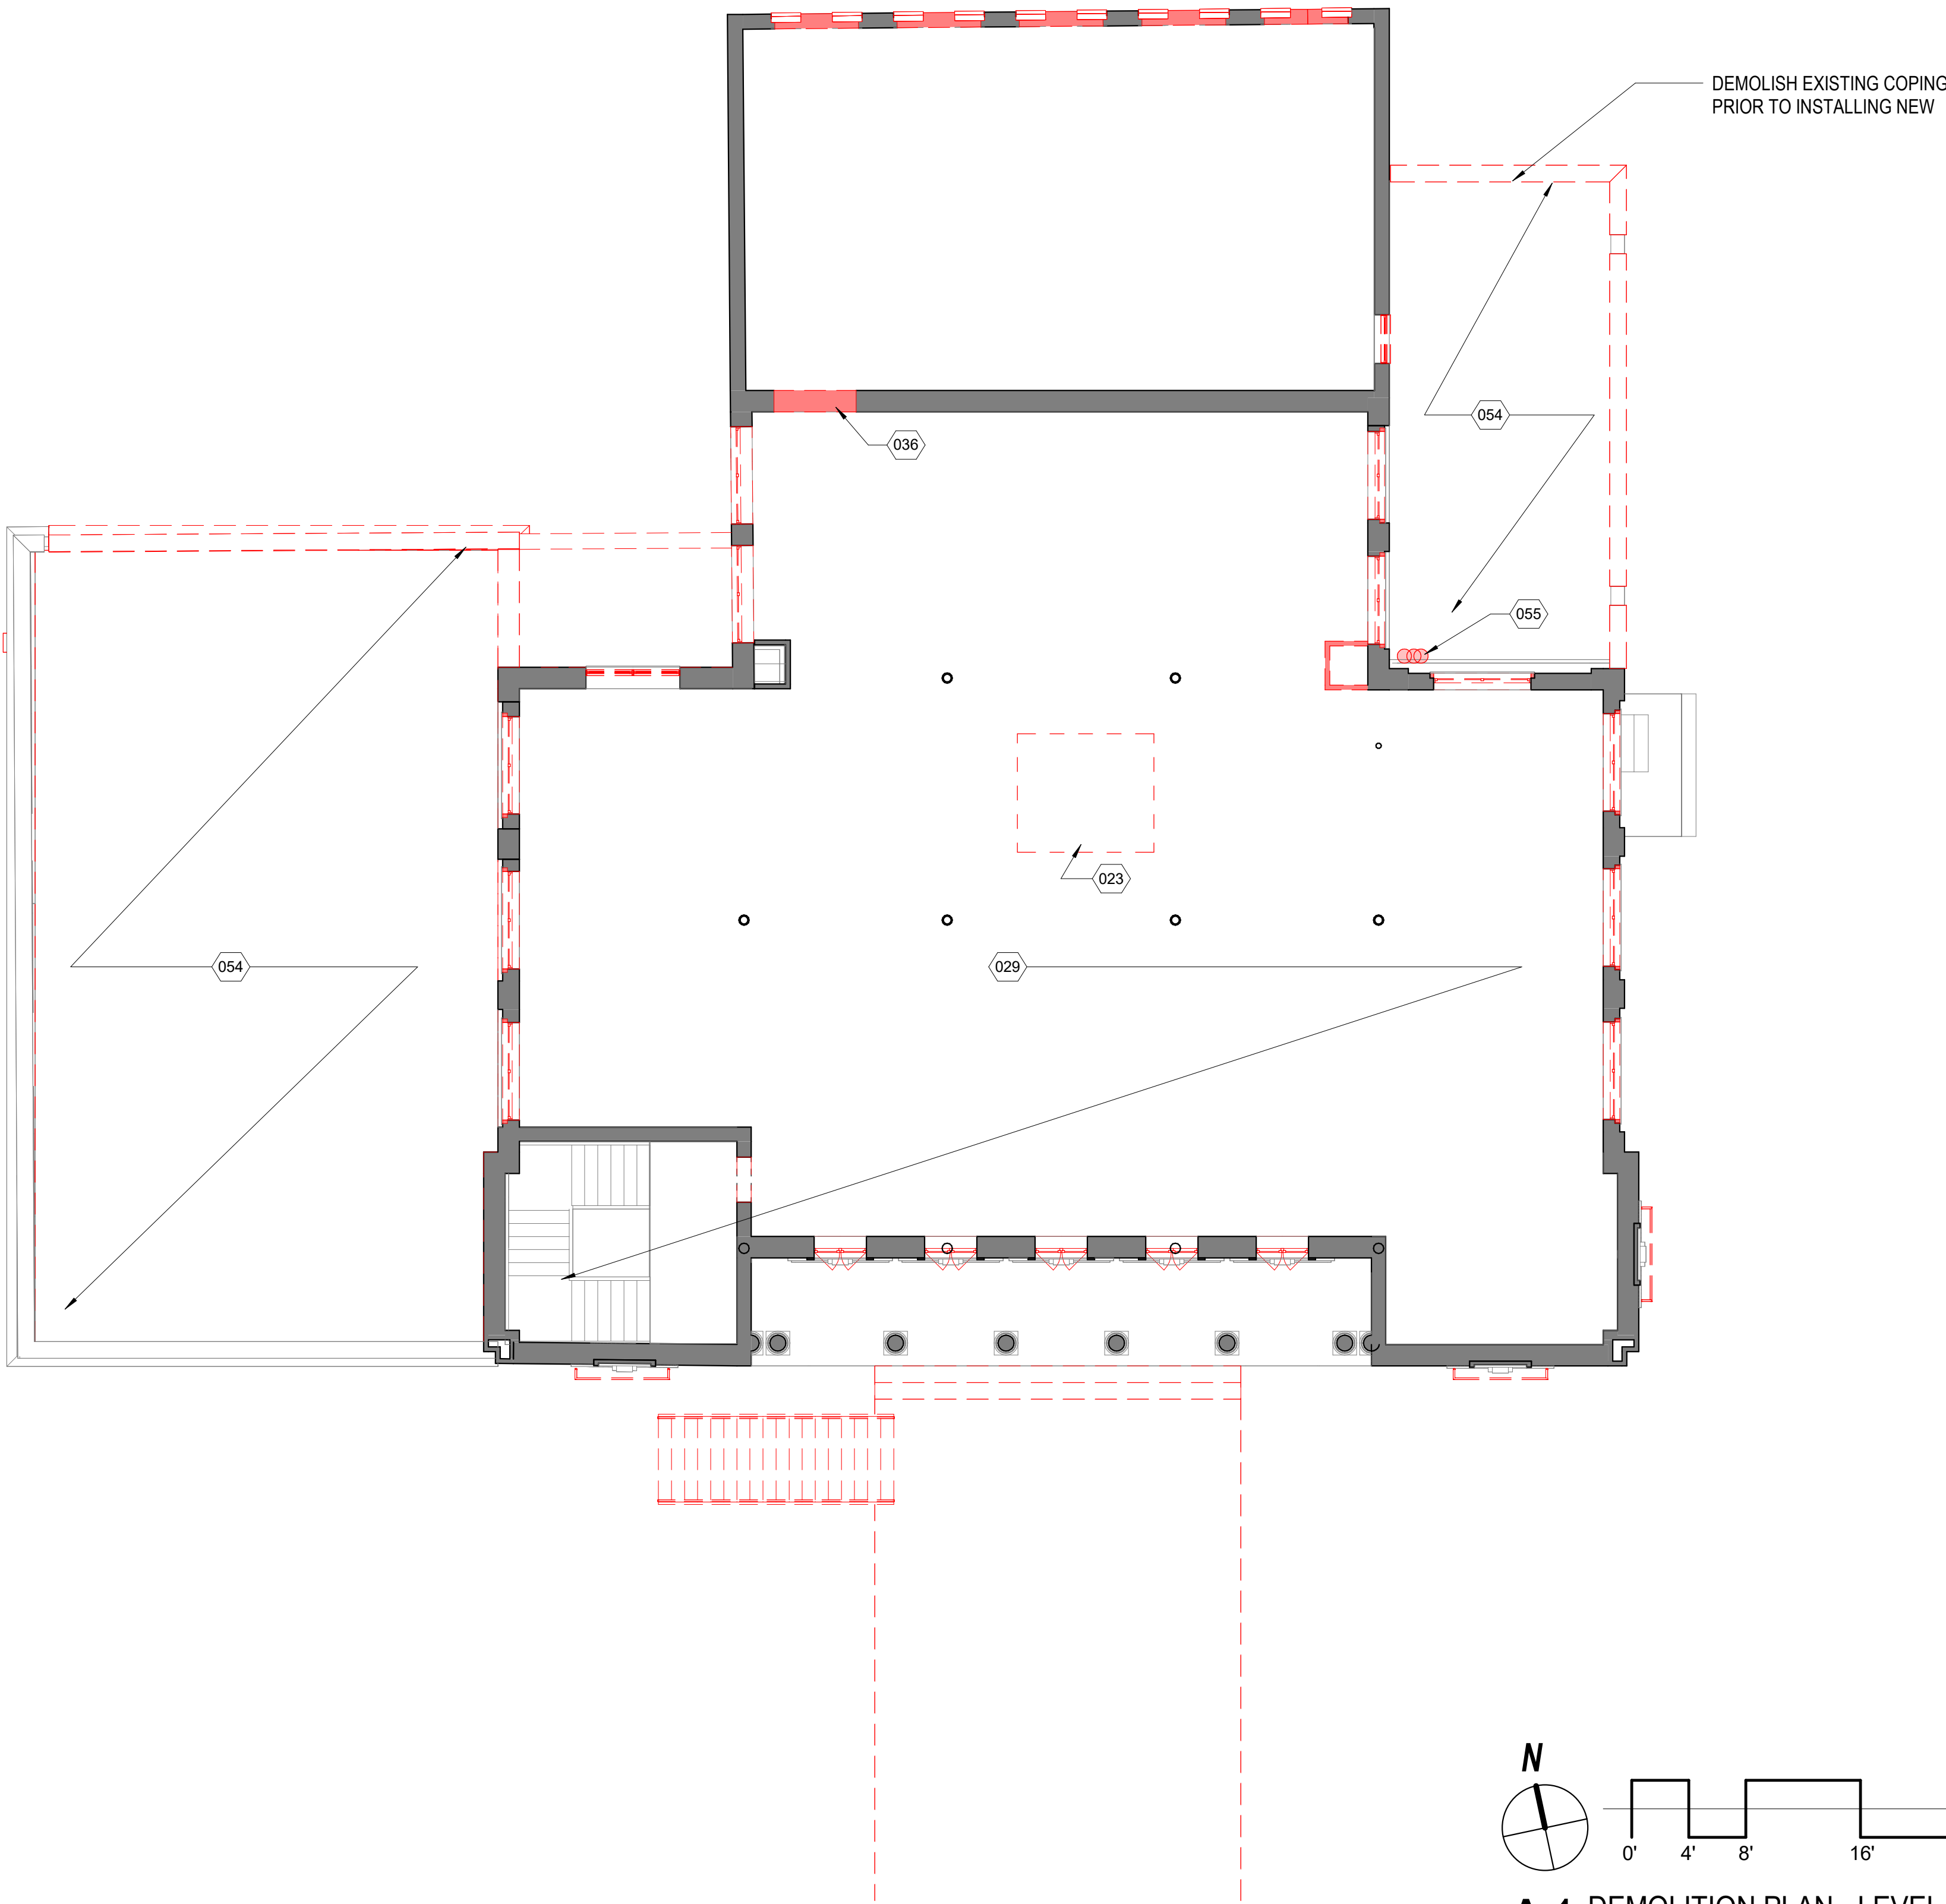


A1 DEMOLITION PLAN - LEVEL 3
1/8" = 1'-0"

K|P|S
G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

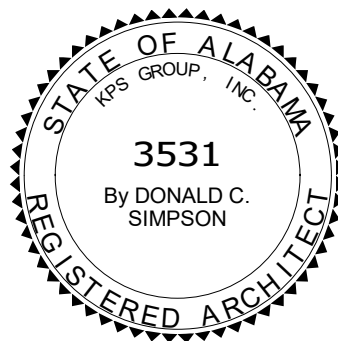

McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION

OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS:
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE

**DEMOLITION PLAN
- LEVEL 3**



DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.

A0.33

KEYNOTES	
041	DEMOLISH EXISTING SKYLIGHT; INFILL OPENING
042	DEMOLISH EXISTING ELEVATOR PENTHOUSE
043	DEMOLISH EXISTING CONCRETE PAD
044	DEMOLISH EXISTING PARAPET AND CORNICE AS NEEDED TO ACCOMMODATE NEW CONSTRUCTION
050	DEMOLISH SECTION OF ROOF FOR ELEVATOR SHAFT
051	DEMOLISH EXISTING ROOF LADDER
054	DEMOLISH ALL EXISTING ELECTRICAL, MECHANICAL, AND PLUMBING EQUIPMENT ON ROOF, INCLUDING, BUT NOT LIMITED TO CONDUITS, VENTS, EXHAUSTS, AND ROOF DRAINS, TYPICAL, UNLESS NOTED OTHERWISE.

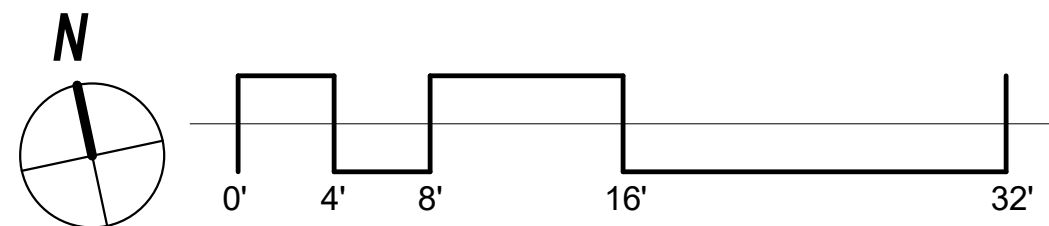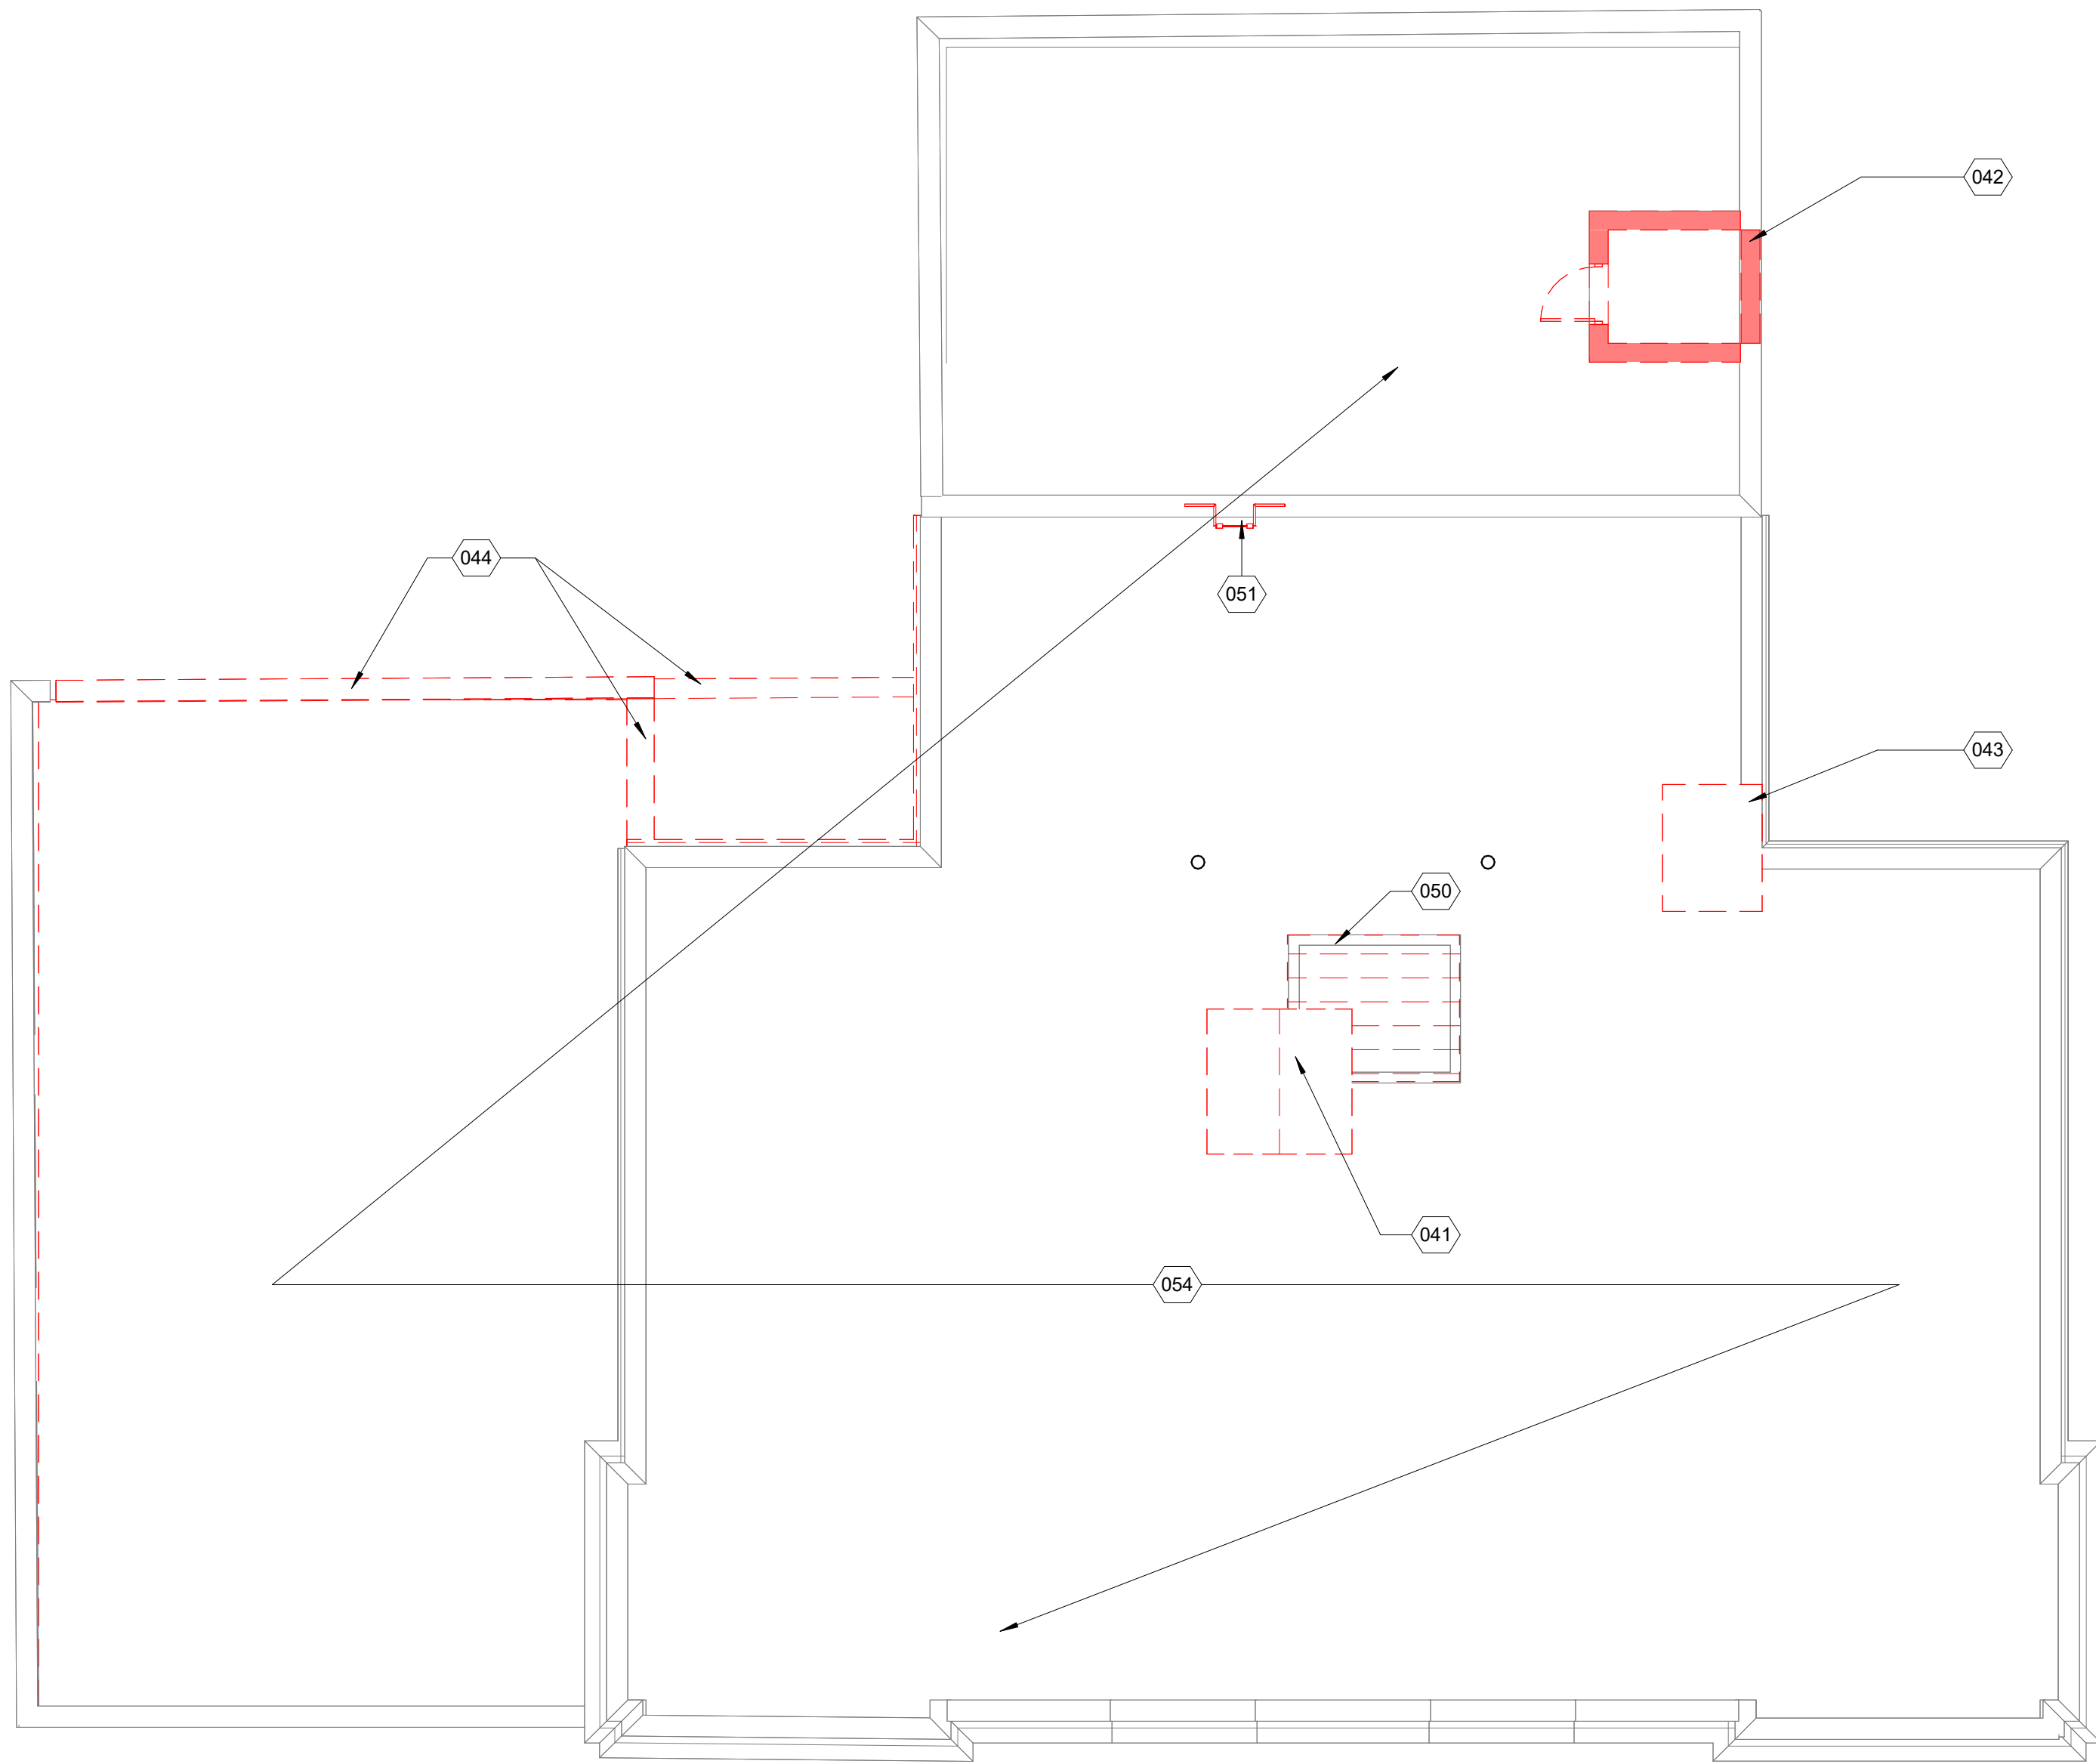

A1 DEMOLITION PLAN - ROOF
1/8" = 1'-0"

ROOF DEMOLITION GENERAL NOTES

1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AND SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
2. IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
3. REFER TO SPECIFICATIONS FOR PHASING AND ADD ALTERNATES DESCRIPTION.
4. REFER TO ACM-SERIES DRAWINGS AND SPECIFICATIONS FOR REMOVAL OF ASBESTOS CONTAINING MATERIALS.
5. REMOVE EXISTING ROOF TO STRUCTURAL DECK, TYPICAL, UNLESS NOTED OTHERWISE.
6. REMOVE EXISTING METAL ROOF COPINGS, TYPICAL, UNLESS NOTED OTHERWISE/
7. REMOVE EXISTING HVAC DEVICES, DUCTWORK, EQUIPMENT, TYPICAL, UNLESS NOTED OTHERWISE. RE: MECHANICAL PLANS.
8. REMOVE EXISTING ELECTRICAL WIRING, CONDUIT, DEVICES, AND CABLING, TYPICAL, UNLESS NOTED OTHERWISE. RE: ELECTRICAL DEMOLITION PLANS.

DEMOLITION PLAN LEGEND

- INDICATES EXISTING CONSTRUCTION TO BE DEMOLISHED
TO LIMITS SHOWN ON DRAWINGS. PATCH, REPAIR, SMOOTH
AND CLEAN ADJACENT FLOORS, WALLS AND CEILINGS AS
REQUIRED TO PROVIDE SMOOTH SURFACE FOR NEW
FINISHES
- WALLS TO REMAIN
- EXISTING DOOR, FRAME TO REMAIN. UPGRADE DOOR
HARDWARE.
- EXISTING DOOR, FRAME AND HARDWARE IS TO BE
REMOVED. WALLS TO BE CLEANED, REPAIRED AND RE-
FINISHED. SAVE ALL ITEMS FOR RE-USE UNLESS
OTHERWISE NOTED. RE: STRUCTURAL

A - GENERAL NOTES - DEMOLITION ROOF
1/4" = 1'-0"

DEMOLITION GENERAL NOTES (CONT'D)

- THE WORK OF THIS PROJECT INCLUDES ALTERATIONS OF THE EXISTING BUILDING TO ACHIEVE THE ARRANGEMENT INDICATED ON THE DRAWINGS. THE CONTRACTOR SHALL VISIT THE JOB SITE TO DETERMINE THE EXTENT OF DEMOLITION WORK REQUIRED BY THE CONSTRUCTION ACTIVITIES. THE ARCHITECTURAL DRAWINGS FOR THESE AREAS SHOW THE CHANGES TO BE MADE. THE CONTRACTOR SHALL REUSE, REARRANGE, REROUTE OR REMOVE EXISTING WIRING AND HVAC DISTRIBUTION AS REQUIRED TO ACCOMMODATE THE CHANGES AND ADDITIONS SHOWN AND TO PROVIDE CONTINUING ELECTRICAL AND HVAC SERVICES FOR THOSE EXISTING PORTIONS OF THE PROJECT WHICH ARE TO REMAIN IN OPERATION. INTENT OF THE DRAWING IS TO SHOW EXISTING BUILDING CONDITIONS WITH INFORMATION DEVELOPED FROM AVAILABLE DOCUMENTS. CONTRACTOR SHALL MAKE A DETAILED SURVEY OF EXISTING CONDITIONS PERTAINING TO THE WORK BEFORE COMMENCING DEMOLITION. THE CONTRACTOR SHALL REPORT DISCREPANCIES BETWEEN DRAWINGS AND ACTUAL FIELD CONDITIONS TO THE ARCHITECT.
16. DEMOLITION NOT DESCRIBED HERE BUT NECESSARY FOR THE COMPLETION OF THE WORK SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR. THE DEMOLITION DRAWINGS ARE ISSUED FOR INFORMATION ONLY AND SHOW THE GENERAL EXTENT OF THE DEMOLITION REQUIRED. THESE DRAWINGS DO NOT NECESSARILY SHOW EVERYTHING TO BE REMOVED IN ORDER TO PREPARE THE EXISTING BUILDING ELEMENTS FOR REMODELING OR NEW CONSTRUCTION. THE ARCHITECTURAL DRAWINGS SHOW THE EXISTING PARTITIONS WITH DOORS AND OTHER ITEMS TO REMAIN
17. FURNISH ALL LABOR AND MATERIAL REQUIRED TO COMPLETE DEMOLITION AND REMOVAL OF ALL ITEMS AS INDICATED IN ARCHITECT'S DRAWINGS OR AS OTHERWISE DIRECTED BY ARCHITECT.
18. FURNISH BUILDING MANAGEMENT AND ARCHITECT WITH A COMPLETE INVENTORY LIST OF ALL ITEMS THAT CAN BE REUSED AND/OR STORED IN BUILDING STOCK.
19. THE GENERAL CONTRACTOR SHALL EXECUTE ALL WORK WITH THE REGULATIONS OF THE BUILDING FOR DEMOLITION AND REMOVAL OF DEBRIS, INCLUDING OVERTIME WORK REQUIRED.
20. PROTECT THE PROPERTY OF THE BUILDING OWNER INCLUDING BUT NOT LIMITED TO, WINDOWS, FLOOR AND CEILING TILE, PUBLIC TOILETS, ELEVATORS, DOORS, BUCKS, ELECTRICAL AND AIR CONDITIONING EQUIPMENT, CONVECTOR ENCLOSURES, ETC. THE CONTRACTOR SHALL AT NO TIME DO ANY WORK OR PLACE ANY CONSTRUCTION THAT MAY AFFECT THE OPERATIONS OF THE OTHER TENANTS, INCLUDING ANY INTERRUPTIONS IN THE SUPPLY OF POWER OR OTHER UTILITIES WITHOUT FIRST NOTIFYING THE BUILDING OWNER AND OBTAINING PERMISSION TO PROCEED.
21. PROVIDE VISOQUEEN SEAL FROM FLOOR TO CEILING AT ALL INTERFACES TO PROTECT ADJACENT BUILDING PROPERTY WHILE DEMOLITION AND CONSTRUCTION ARE IN PROGRESS. THIS SEAL IS TO BE KEPT CLOSED AT ALL TIMES.
22. IN AREAS WHERE THERE ARE NO ALTERATIONS INDICATED THE EXISTING FACILITIES SHALL BE RETAINED IN SERVICE. IN CASE OF DOUBT ASSUME THAT THE EXISTING ELECTRICAL WIRING IS TO REMAIN IN OPERATION THROUGHOUT THE CONSTRUCTION PERIOD AND THEREAFTER.
23. WHERE CONSTRUCTION TO BE REMOVED INTERSECTS CONSTRUCTION TO REMAIN, WORK SHALL INCLUDE ALL ATTACHMENT DEVICES (SHOT PINS, ANCHORS, LAG BOLTS, NAILS, NAILERS, ETC)
24. IN AREAS WHERE DEMOLITION REMOVAL OF TILE, CARPETING, PARTITIONS, (ETC) CAUSES AND UNEVENNESS IN SLAB PATCH TO LEVEL THE SLAB TO RECEIVE NEW FINISHED FLOORING, TYPICAL, UNLESS NOTED OTHERWISE.
25. REMOVE DEMOLISHED WORK FROM THE PREMISES EXCEPT ITEMS TO BE REUSED OR RETURNED TO TENANT OR AS OTHERWISE NOTED.
26. UPON THE REMOVAL OF THE EXISTING CEILING, THE EXISTING MECHANICAL SYSTEM WILL BE EVALUATED BY THE ENGINEER FOR POSSIBILITY FOR RE-USE. IF THE EXISTING MECHANICAL SYSTEMS ARE TO BE REUSED, EXISTING MAIN DUCT, VAV BOXES, PNEUMATIC CONTROL TUBING ETC SHALL REMAIN AND SHALL BE PROTECTED TO AVOID DAMAGE TO EXISTING HVAC EQUIPMENT DURING DEMOLITION
27. CAP AND FLUSH OFF BEHIND FINISH SURFACES ALL PROJECTING PLUMBING, FLOOR ELECTRICAL/TELEPHONE OUTLETS, AND ALL OTHER PROJECTING ITEMS WHICH ARE BEING ABANDONED.
28. THE GENERAL CONTRACTOR SHALL REMOVE FROM PREMISES CONDUITS LEFT AFTER WALL DEMOLITION, INCLUDING SWITCH BOXES, PLATES, BRIDGES OR ANY OTHER TELEPHONE OR ELECTRICAL WIRING AND EQUIPMENT.
29. REMOVE MATERIAL OTHER THAN ITEMS TO BE SALVAGED OR REUSED SHALL BECOME CONTRACTORS' PROPERTY UNLESS OTHERWISE NOTIFIED AND SHALL BE REMOVED FROM OWNERS PROPERTY. CLEAN UP AND DISPOSE OF DEBRIS PROMPTLY AND CONTINUOUSLY AS WORK PROGRESSES. SECURE AND PAY FOR REQUIRED HAULING PERMITS, DUMPING FEES AND CHARGES.
30. ELECTRICAL, MECHANICAL AND PLUMBING TO BE REMOVED TO THE FURTHEST TERMINATION POINT ON THE FLOOR. REMOVE ALL UNUSED AND DISCONNECTED HVAC, ELECTRICAL, PLUMBING AND PHONE EQUIPMENT ABOVE CEILING AND REMOVE TO THE FURTHEST TERMINATION POINT ON THE FLOOR. COORDINATE EXTENT OF REMOVAL WITH MECHANICAL/ELECTRICAL/PLUMBING DRAWINGS.
31. FURNISH A SYSTEM OF TEMPORARY LIGHTS THROUGHOUT THE SPACE UNDER CONSTRUCTION AS REQUIRED.
32. MAINTAIN FULLY CHARGED FIRE EXTINGUISHER READILY AVAILABLE DURING ALL DEMOLITION OPERATIONS.
33. UPON COMPLETION OF DEMOLITION WORK, PROVIDE THAT ALL AREAS BE LEFT CLEAN IN A BROOM - SWEEP CONDITION

PATCHING AND CLEANING

THE GENERAL CONTRACTOR SHALL DO ALL CUTTING, FITTING, AND PATCHING WORK THAT MAY BE REQUIRED TO MAKE ALL PARTS COME TOGETHER PROPERLY AND FIT TO RECEIVE OR BE RECEIVED BY WORK OF OTHER CONTRACTOR SHOWN UPON OR REASONABLY IMPLIED BY THE DRAWINGS AND NOTES

PROVIDE FLOOR CUTOUTS AND PATCHING REQUIRED FOR THE INSTALLATION OF WORK, TYPICAL



SURVEY ALL EXISTING FINISHED SURFACES TO INCLUDE CORNER BEADS, STOPS, ETC. FOR CHIPS, CRACK HOLES, DAMAGED SURFACES, MARBLE WAINSCOT AND PLASTER CEILING WHENEVER DOOR DUCKS HAVE BEEN REMOVED, AND ANY OTHER DEFECTS CAUSING AN APPEARANCE DIFFERENT FROM A NEW FIRST CLASS FINISHED REPAIRING, THEN GENERAL CONTRACTOR SHALL REMOVE ALL EXISTING AND INSTALL NEW SURFACES TO THE SATISFACTION OF ARCHITECT. ALL OTHER DAMAGED SURFACES (FINISHED FLOOR SLAB, CONVECTOR ENCLOSURES, ETC) SHALL BE REPAIRED TO THE SATISFACTION OF ARCHITECT

THE GENERAL CONTRACTOR SHALL INSPECT ALL EXISTING PLASTER SURFACES AND WHERE AS A RESULT OF DEMOLITION, FINISHED SURFACES DO NOT ALIGN, IF EXISTING PLASTER SHALL BE CHOPPED AWAY, NEW CORNER BEADS AND STOPS INSTALLED AND SURFACE RE-PLASTERED TO A SMOOTH, FLUSH, ALIGNED SURFACE

PROVIDE METAL LATH OVER NEW CONDUIT CHASES IN MASONRY PARTITIONS,
TYPICAL, UNLESS NOTED OTHERWISE

DAMAGED EXISTING AREAS TO REMAIN AND EXISTING AREA AFFECTED BY DEMOLITION OR NEW CONSTRUCTION WORK SHOWN ON DRAWINGS SHALL BE PATCHED AS REQUIRED TO MATCH IMMEDIATE EXISTING ADJACENT AREAS IN MATERIALS, FIRE RATING, FINISH AND COLOR, TYPICAL, UNLESS NOTED OTHERWISE

FIRE PROOFING REMOVED FROM COLUMNS AND BEAMS DURING THE COURSE OF CONSTRUCTION SHALL BE REPLACED WITH THE SAME MATERIAL AND RATING AS THAT WHICH WAS REMOVED, TYPICAL, UNO

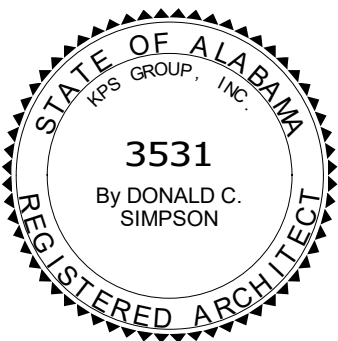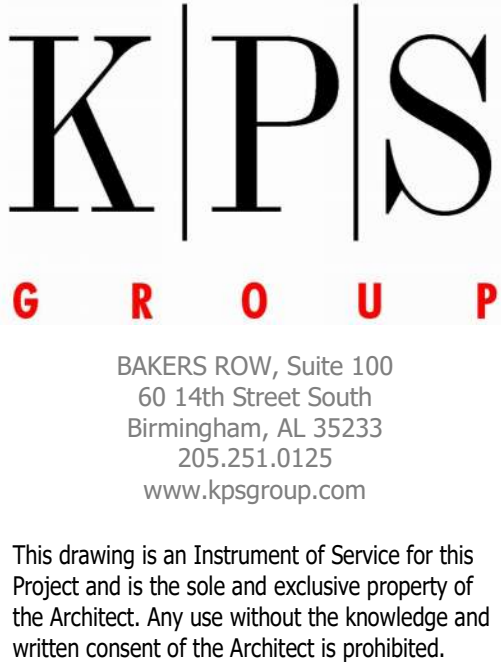


McCLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION
OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
DCM No. 2023453
PROJECT ADDRESS
1918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DEMOLITION PLAN		
- ROOF		
DRAWN BY:		
CHECKED BY:		
Author		
Checker		
PROJECT NUMBER		
2360002-02		
DRAWING NO.		
A0.34		

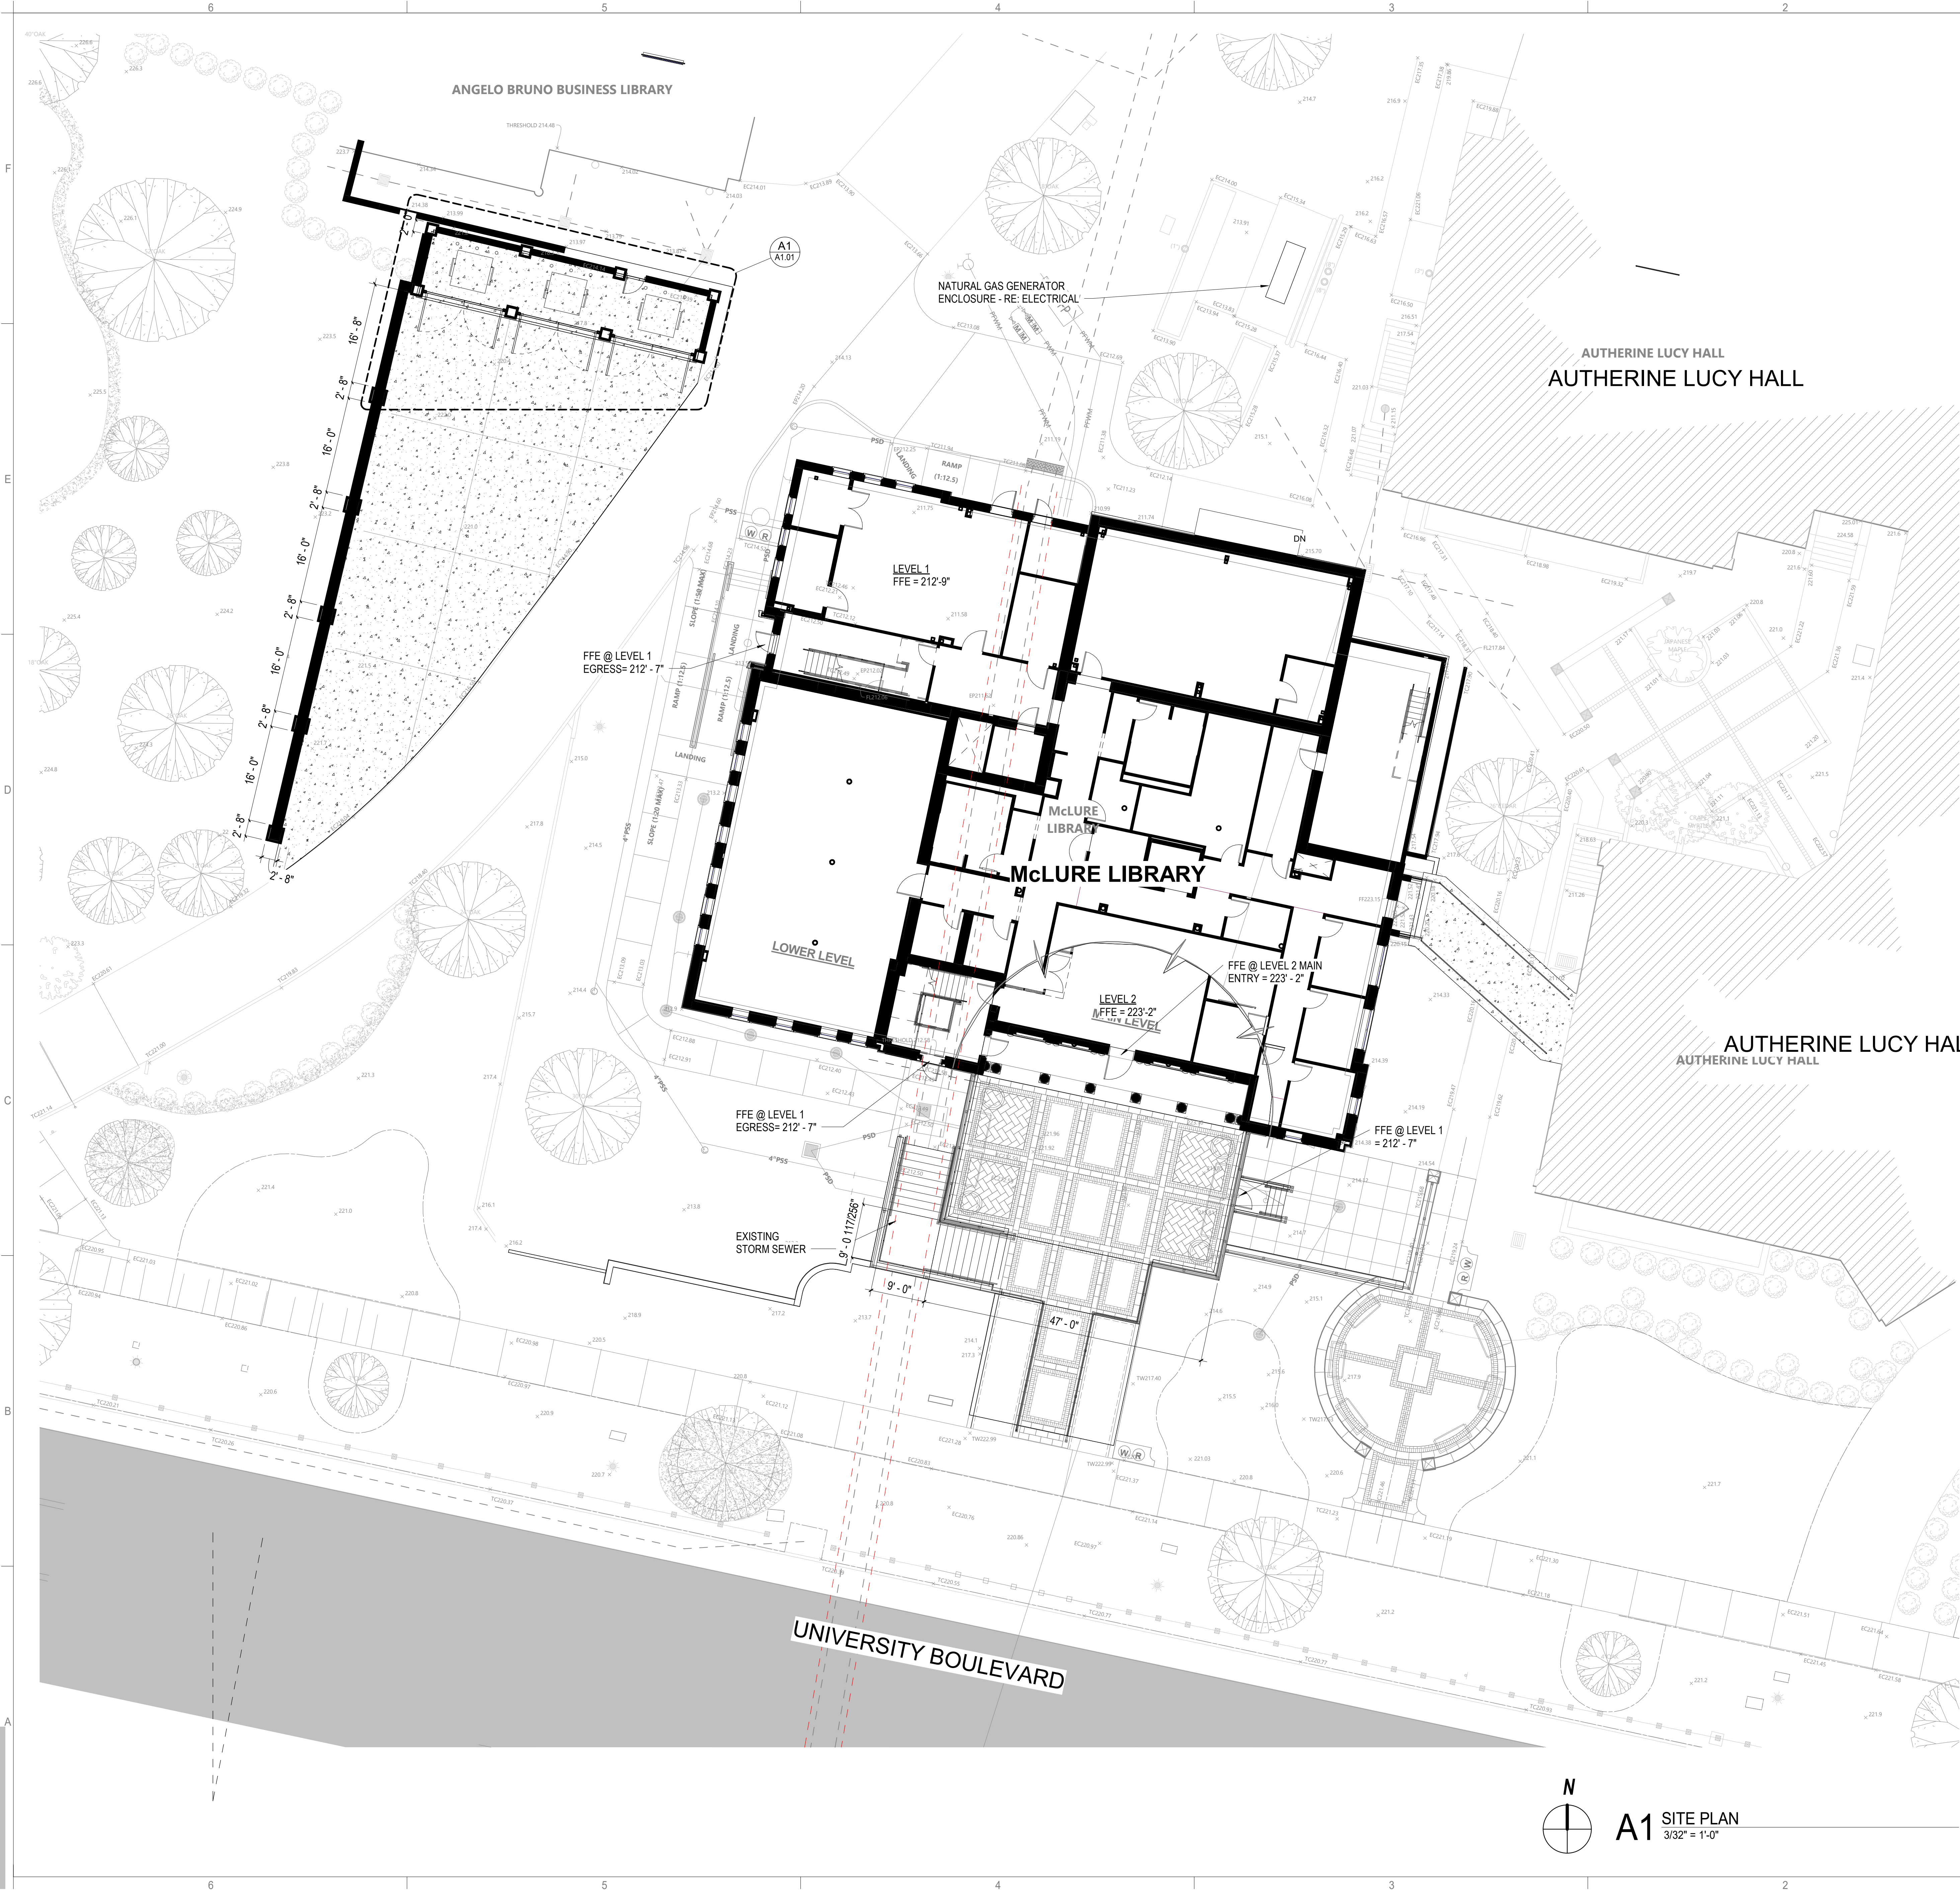

N
A1 SITE PLAN
3/32" = 1'-0"

SHEET NOTES:


- FOR INFORMATION ONLY. REFER TO CIVIL AND LANDSCAPE PLANS FOR FULL SCOPE OF WORK.

K|P|S
G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

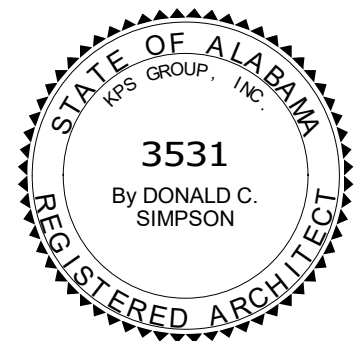

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES


PROJECT ADDRESS:
DOING 202403

918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
ARCHITECTURAL		
SITE PLAN		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A1.00		


D5 ELEVATION - DUMPSTER - EAST
3/8" = 1'-0"

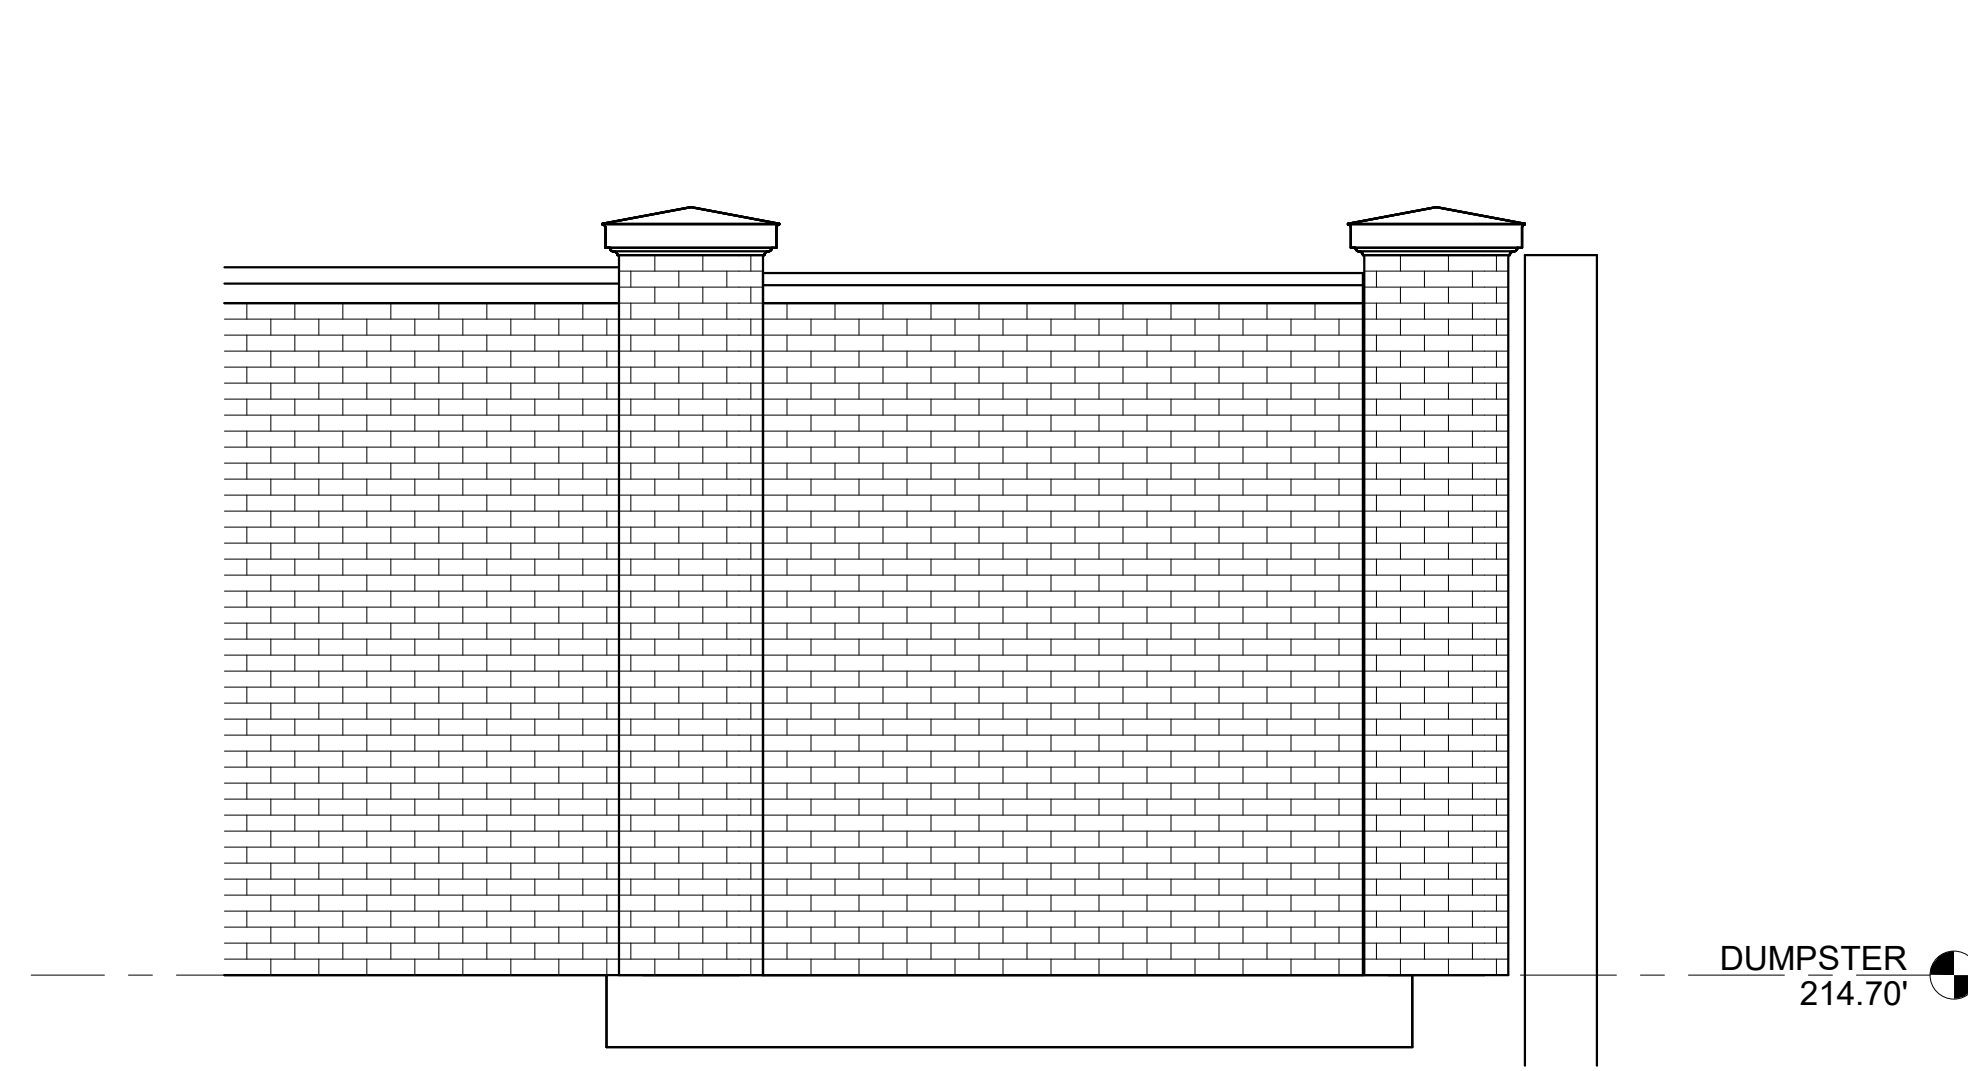


F4 GATE LOUVER DETAIL
1 1/2" = 1'-0"

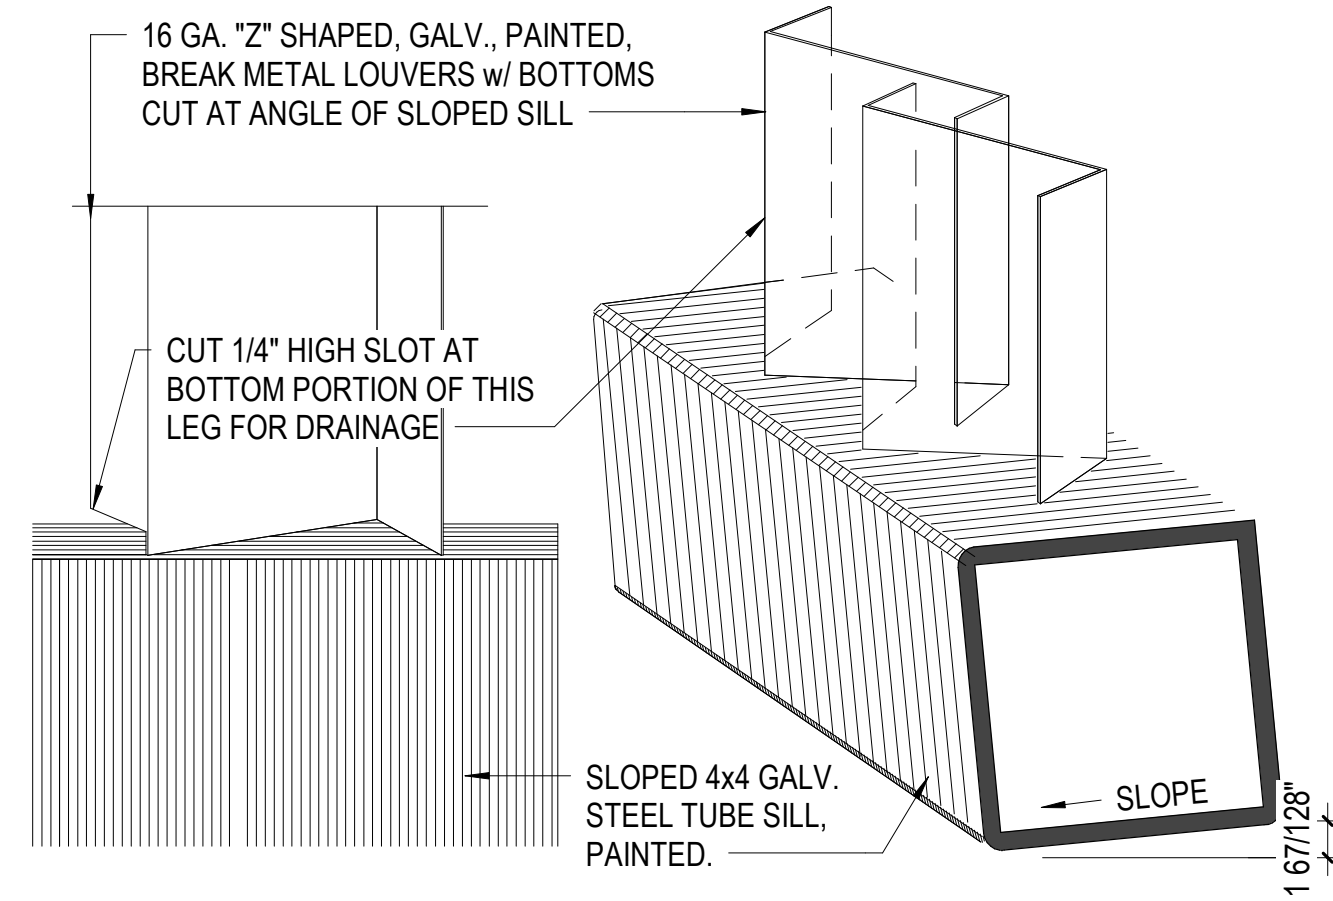



F3 GATE LATCH ELEVATION
3" = 1'-0"

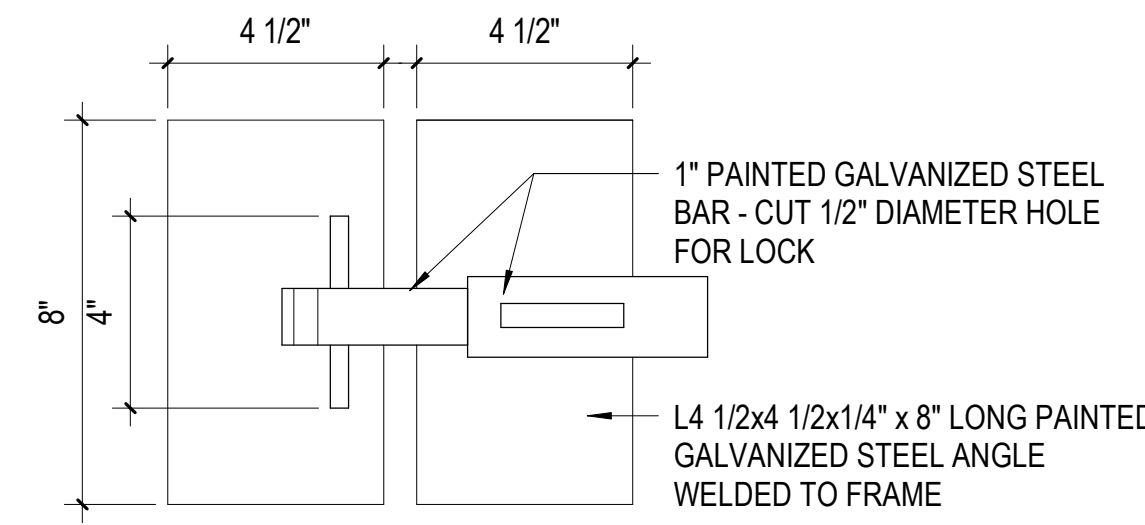

F1 DETAIL - GATE LATCH
3" = 1'-0"

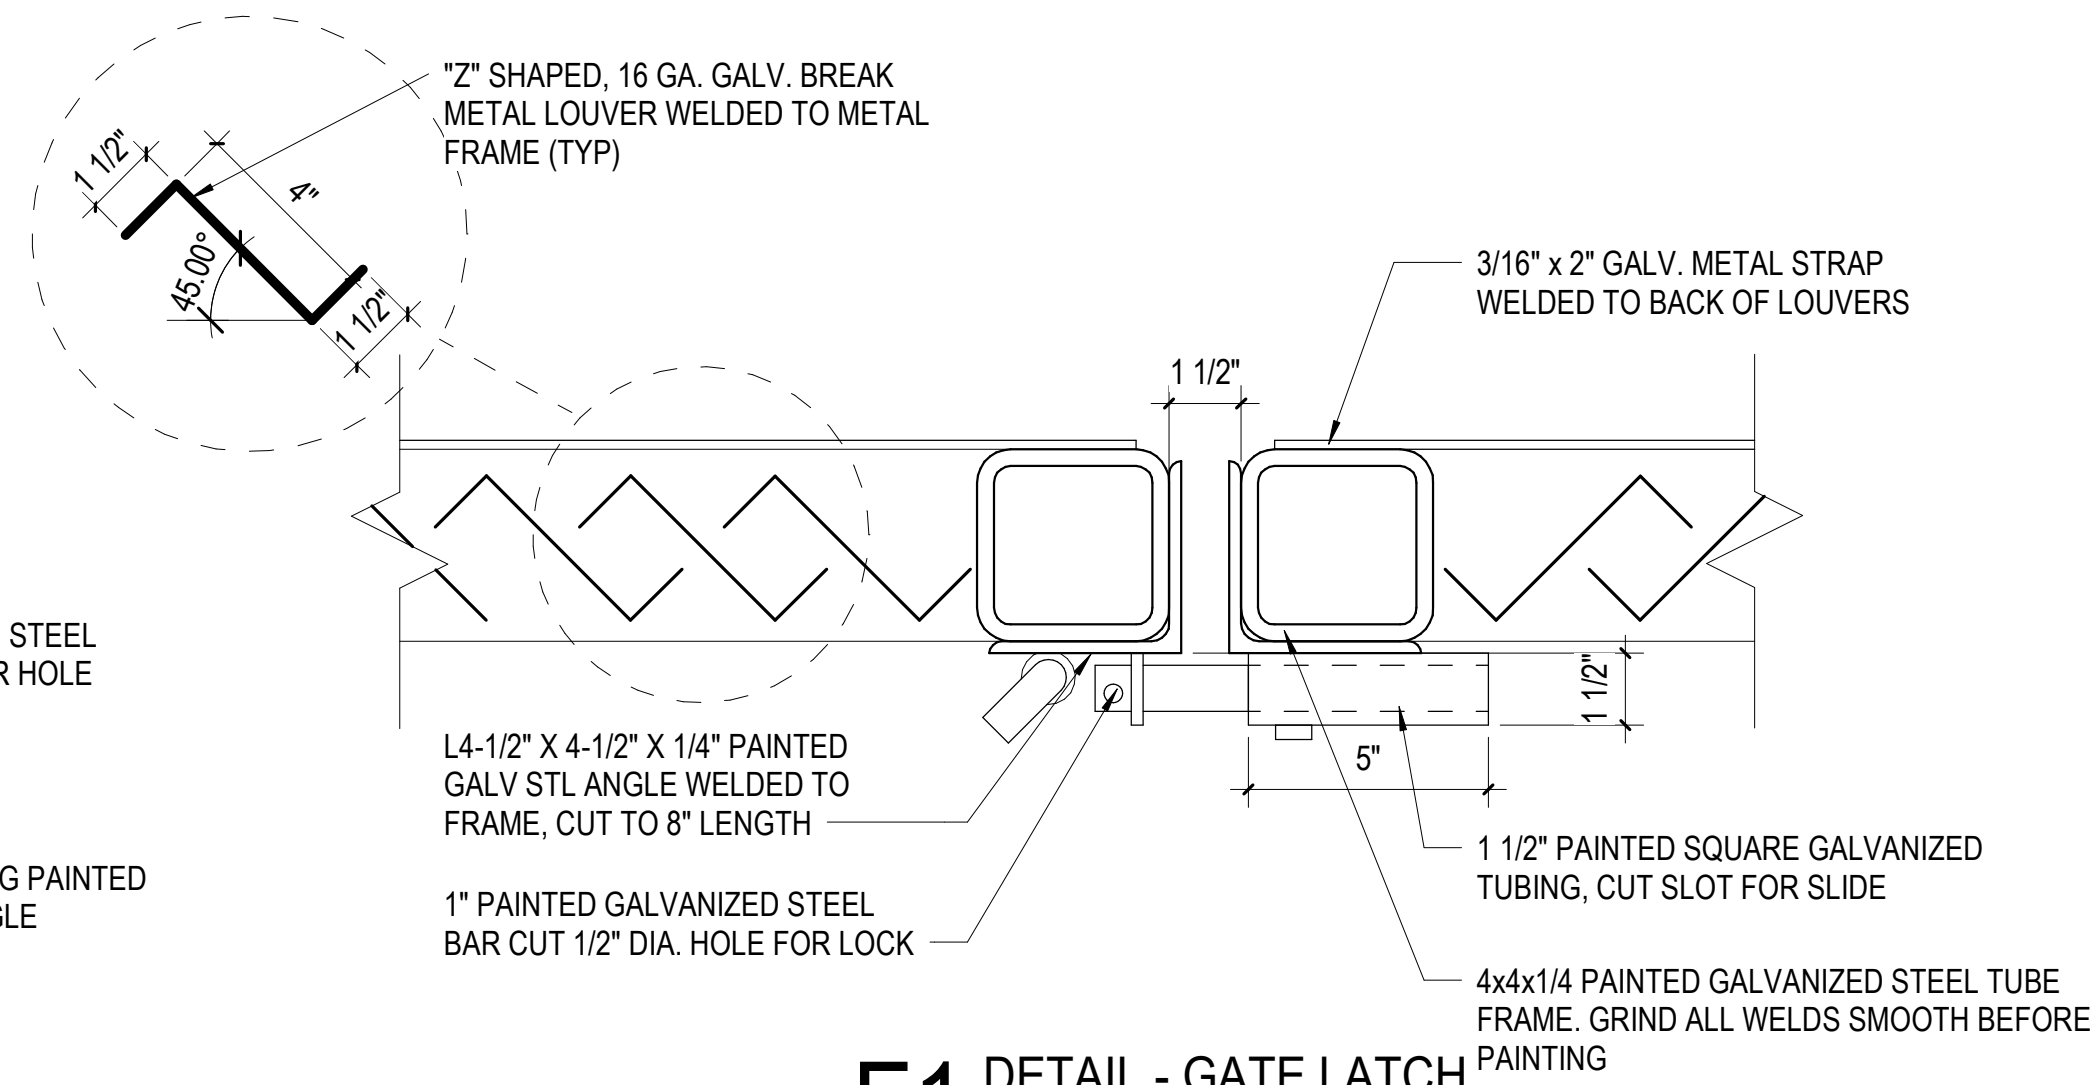

D1 ELEVATION - DUMPSTER SOUTH
3/8" = 1'-0"

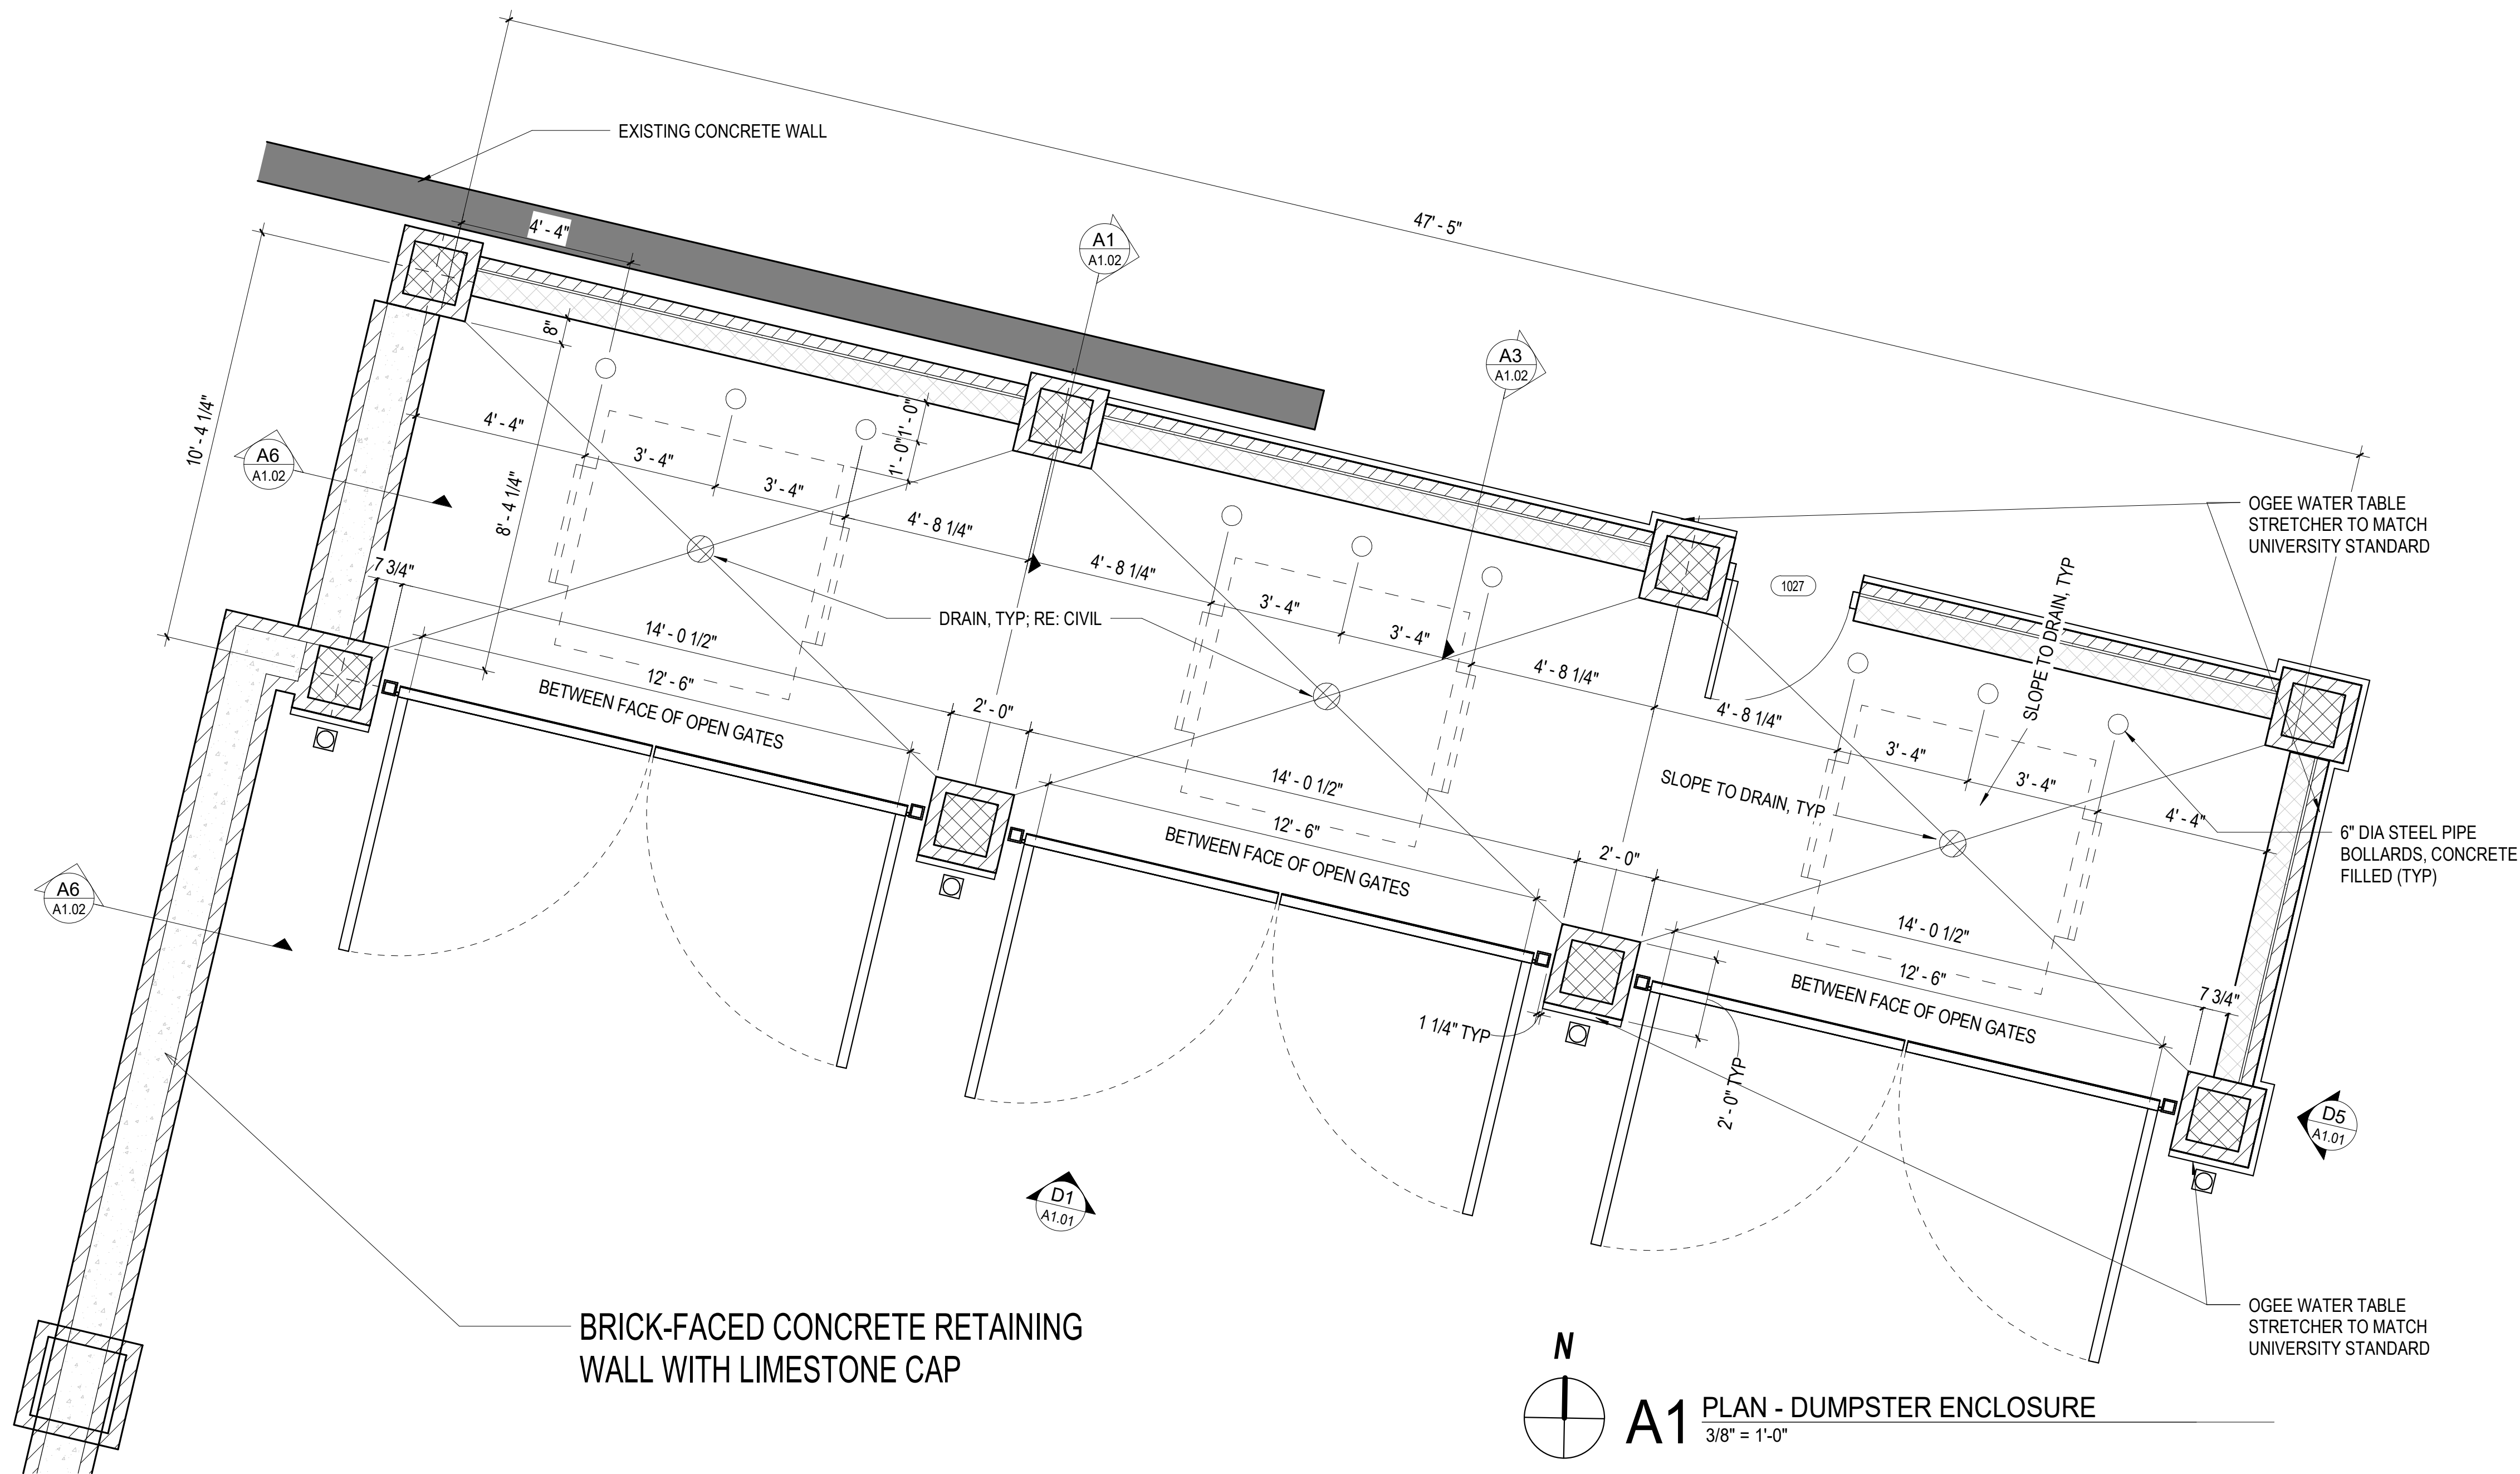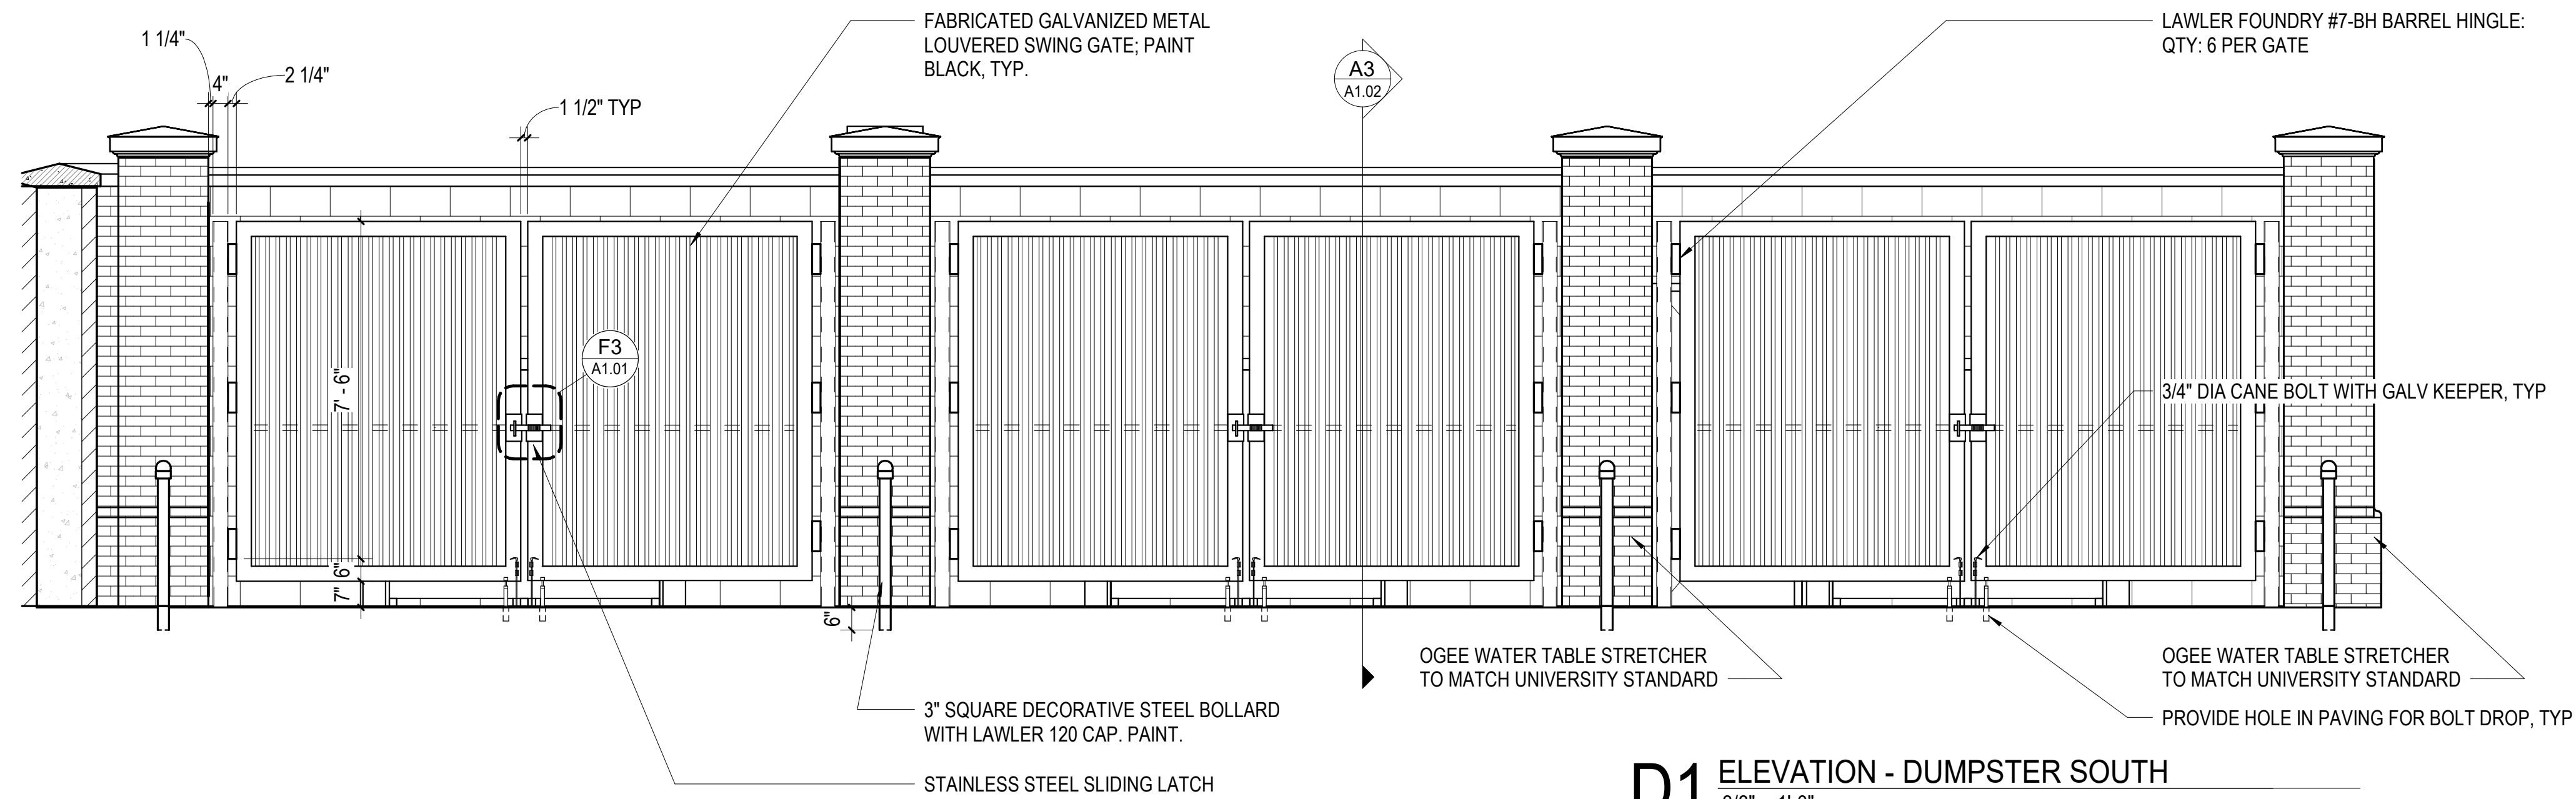

A1 PLAN - DUMPSTER ENCLOSURE
3/8" = 1'-0"

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	

REVISIONS		
No.	Description	Date

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

--	--	--



--	--	--

--	--	--

--	--	--

--	--	--

--	--	--

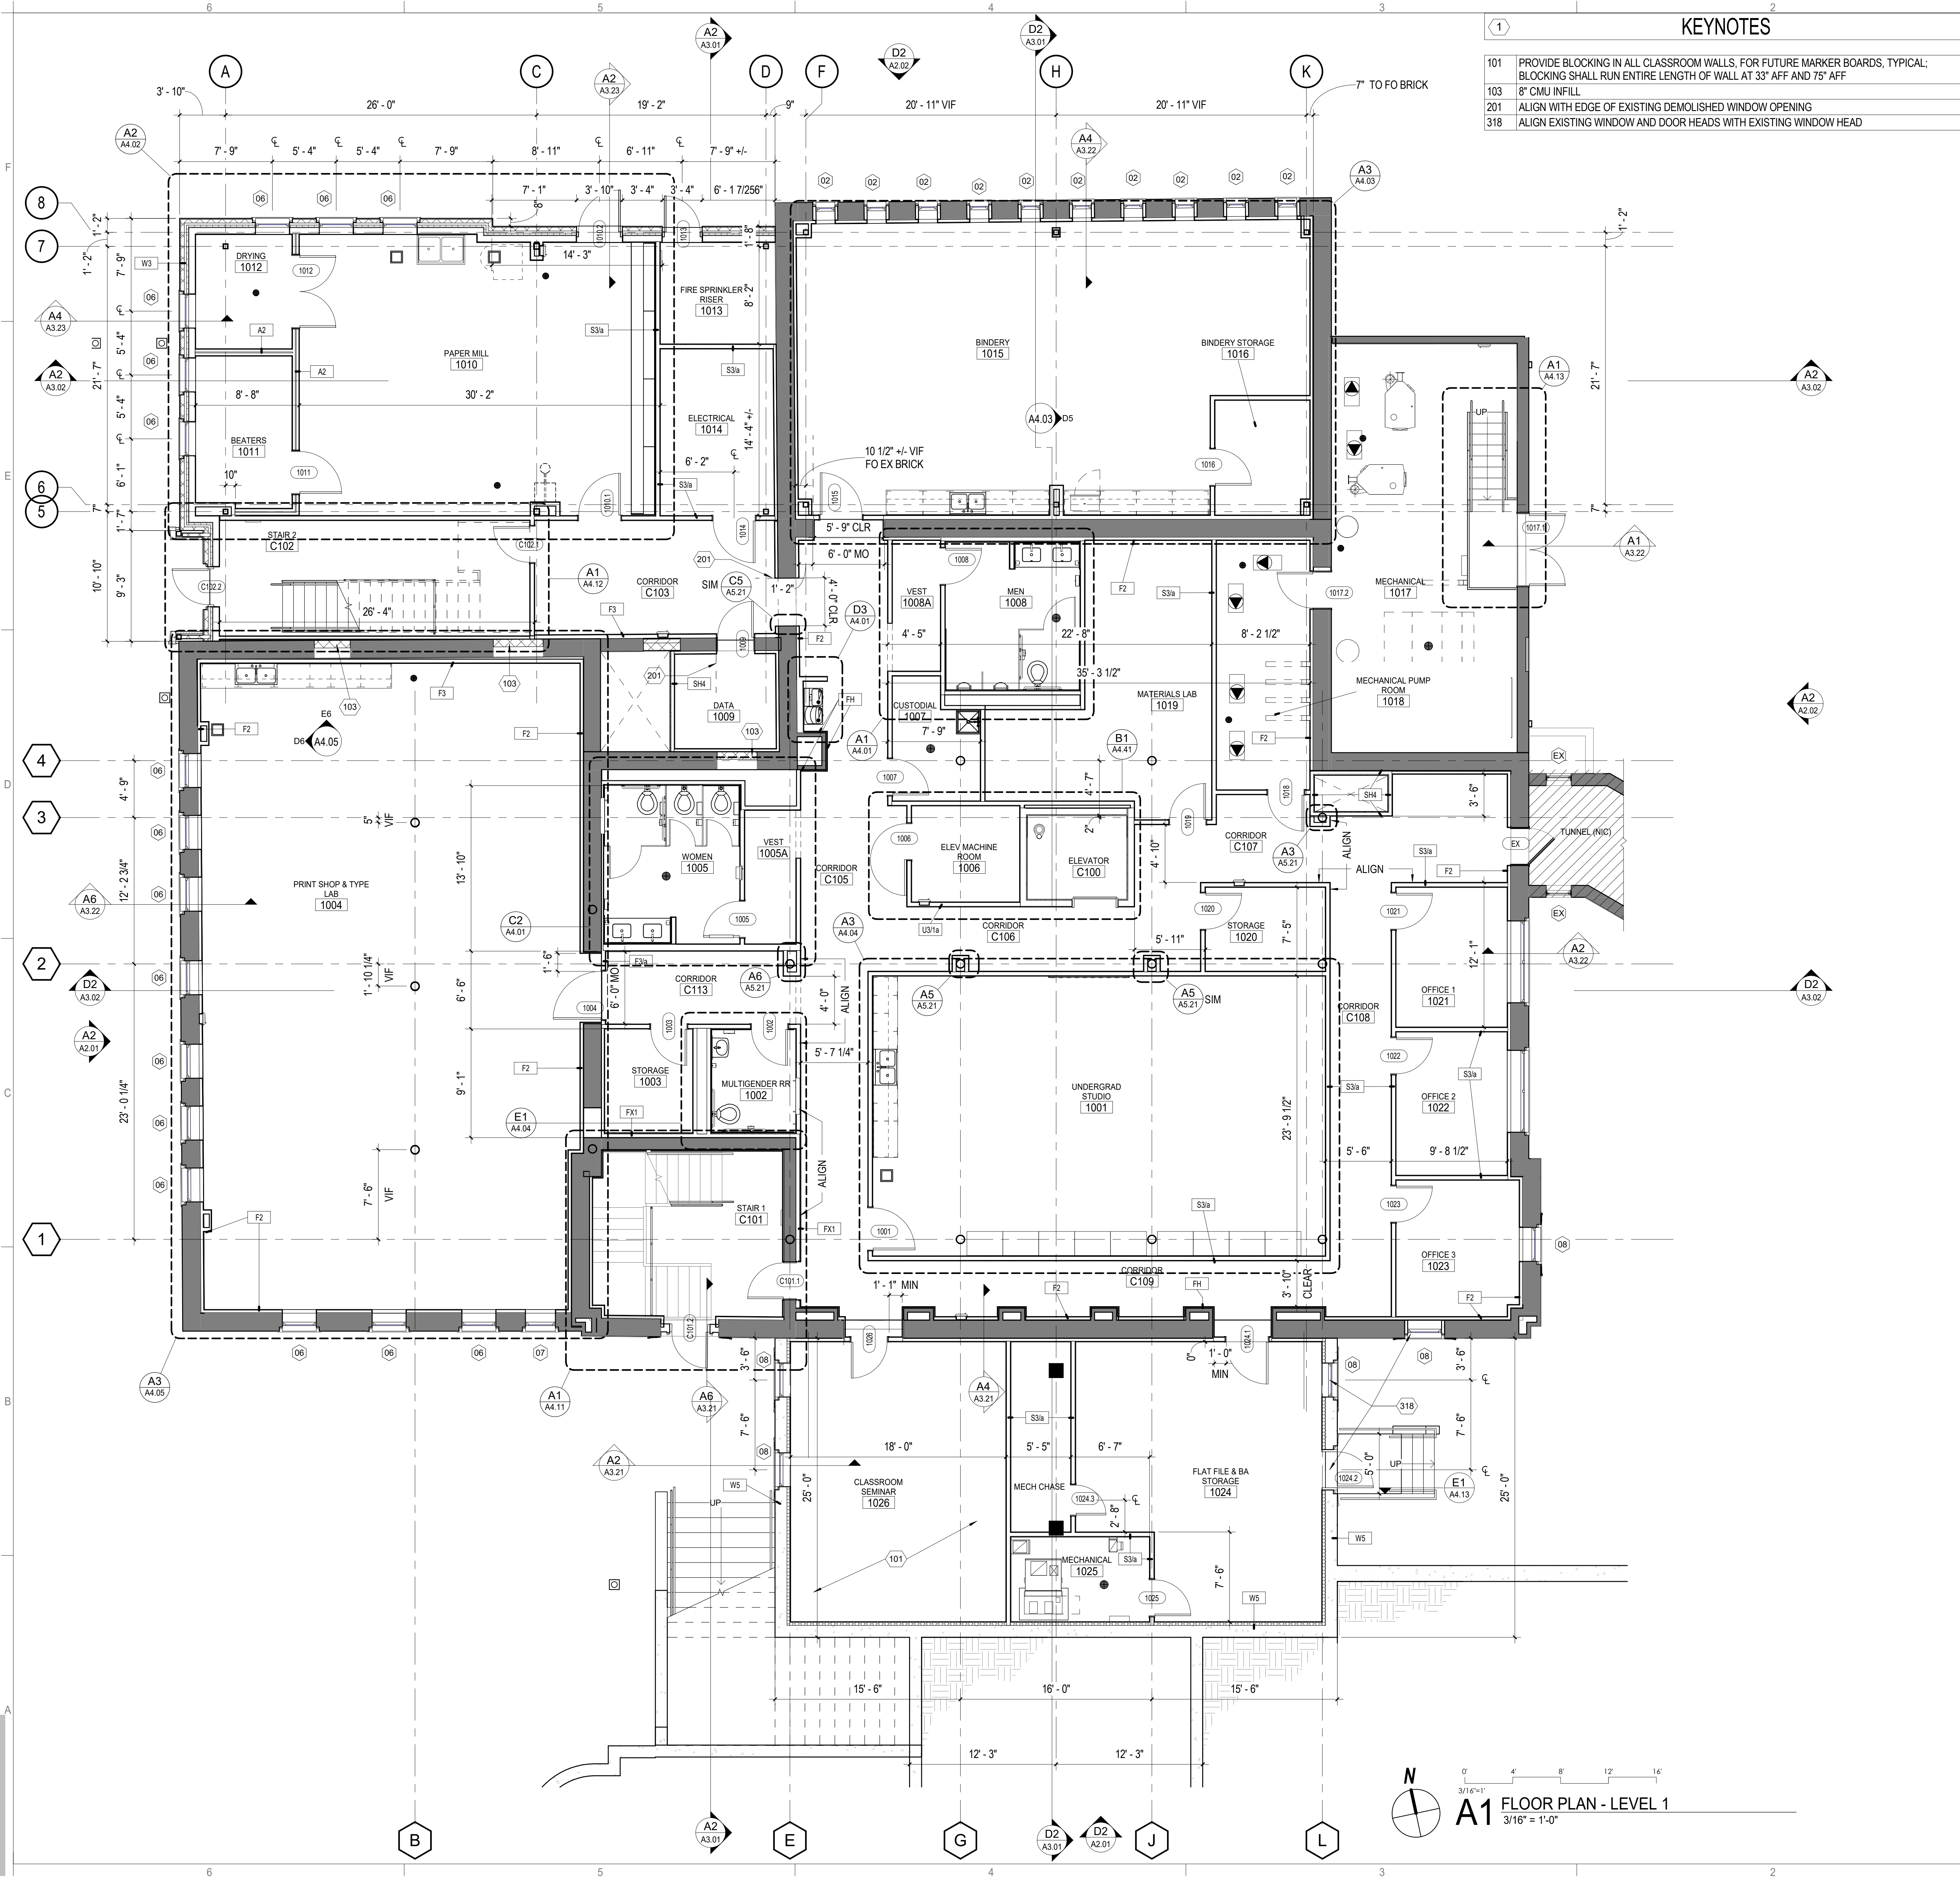

A1 FLOOR PLAN - LEVEL 1
3/16" = 1'-0"

KEYNOTES

- | | |
|-----|---|
| 101 | PROVIDE BLOCKING IN ALL CLASSROOM WALLS, FOR FUTURE MARKER BOARDS, TYPICAL: BLOCKING SHALL RUN ENTIRE LENGTH OF WALL AT 33" AFF AND 75" AFF |
| 103 | 8" CMU INFILL |
| 201 | ALIGN WITH EDGE OF EXISTING DEMOLISHED WINDOW OPENING |
| 318 | ALIGN EXISTING WINDOW AND DOOR HEADS WITH EXISTING WINDOW HEAD |

FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- PARTITIONS TYPICALLY TYPE S3a UNLESS OTHERWISE NOTED.
- PARTITIONS DIMENSIONED TO EXISTING FACE OF FINISH.
- RE: G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- RE: FINISH PLANS FOR WALLS TO RECEIVE LEVEL 5 FINISH.
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 9'-12" WIDE MIN CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.


FLOOR PLAN LEGEND

- | | |
|--------------------------------|--------------------------------|
| COLUMN LINE (NEW) | 0 |
| COLUMN LINE (EXISTING) | 0 |
| VIEW TYPES | |
| BUILDING ELEVATION | ELEVATION #
DRAWING SHEET |
| BUILDING SECTION | DRAWING SHEET |
| WALL SECTION | SECTION CUT #
DRAWING SHEET |
| DETAIL / ENLARGED PLAN CALLOUT | CALLOUT #
DRAWING SHEET |
| INTERIOR ELEVATION VIEW | ELEVATION #
DRAWING SHEET |

TAG TYPES

- | | |
|---------------------------|------------------|
| ROOM NAME/NUMBER | ROOM NAME
101 |
| DOOR NUMBER | 101 |
| WINDOW TYPE | 1 |
| STOREFRONT / CURTAIN WALL | SF-22 |
| WALL TYPE TAG | S3 |
| DRAWING SHEET KEYNOTE | 1 |
| REVISION NUMBER | 1 |

NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

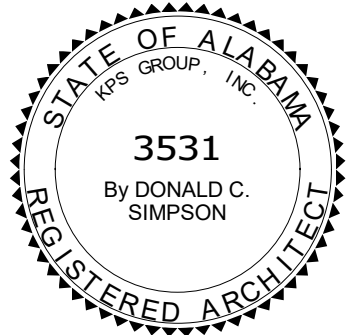

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION


OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
DOING 2024B3

918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
FLOOR PLAN - LEVEL 1		
DRAWN BY: Author		
CHECKED BY: Checker		
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A1.11		

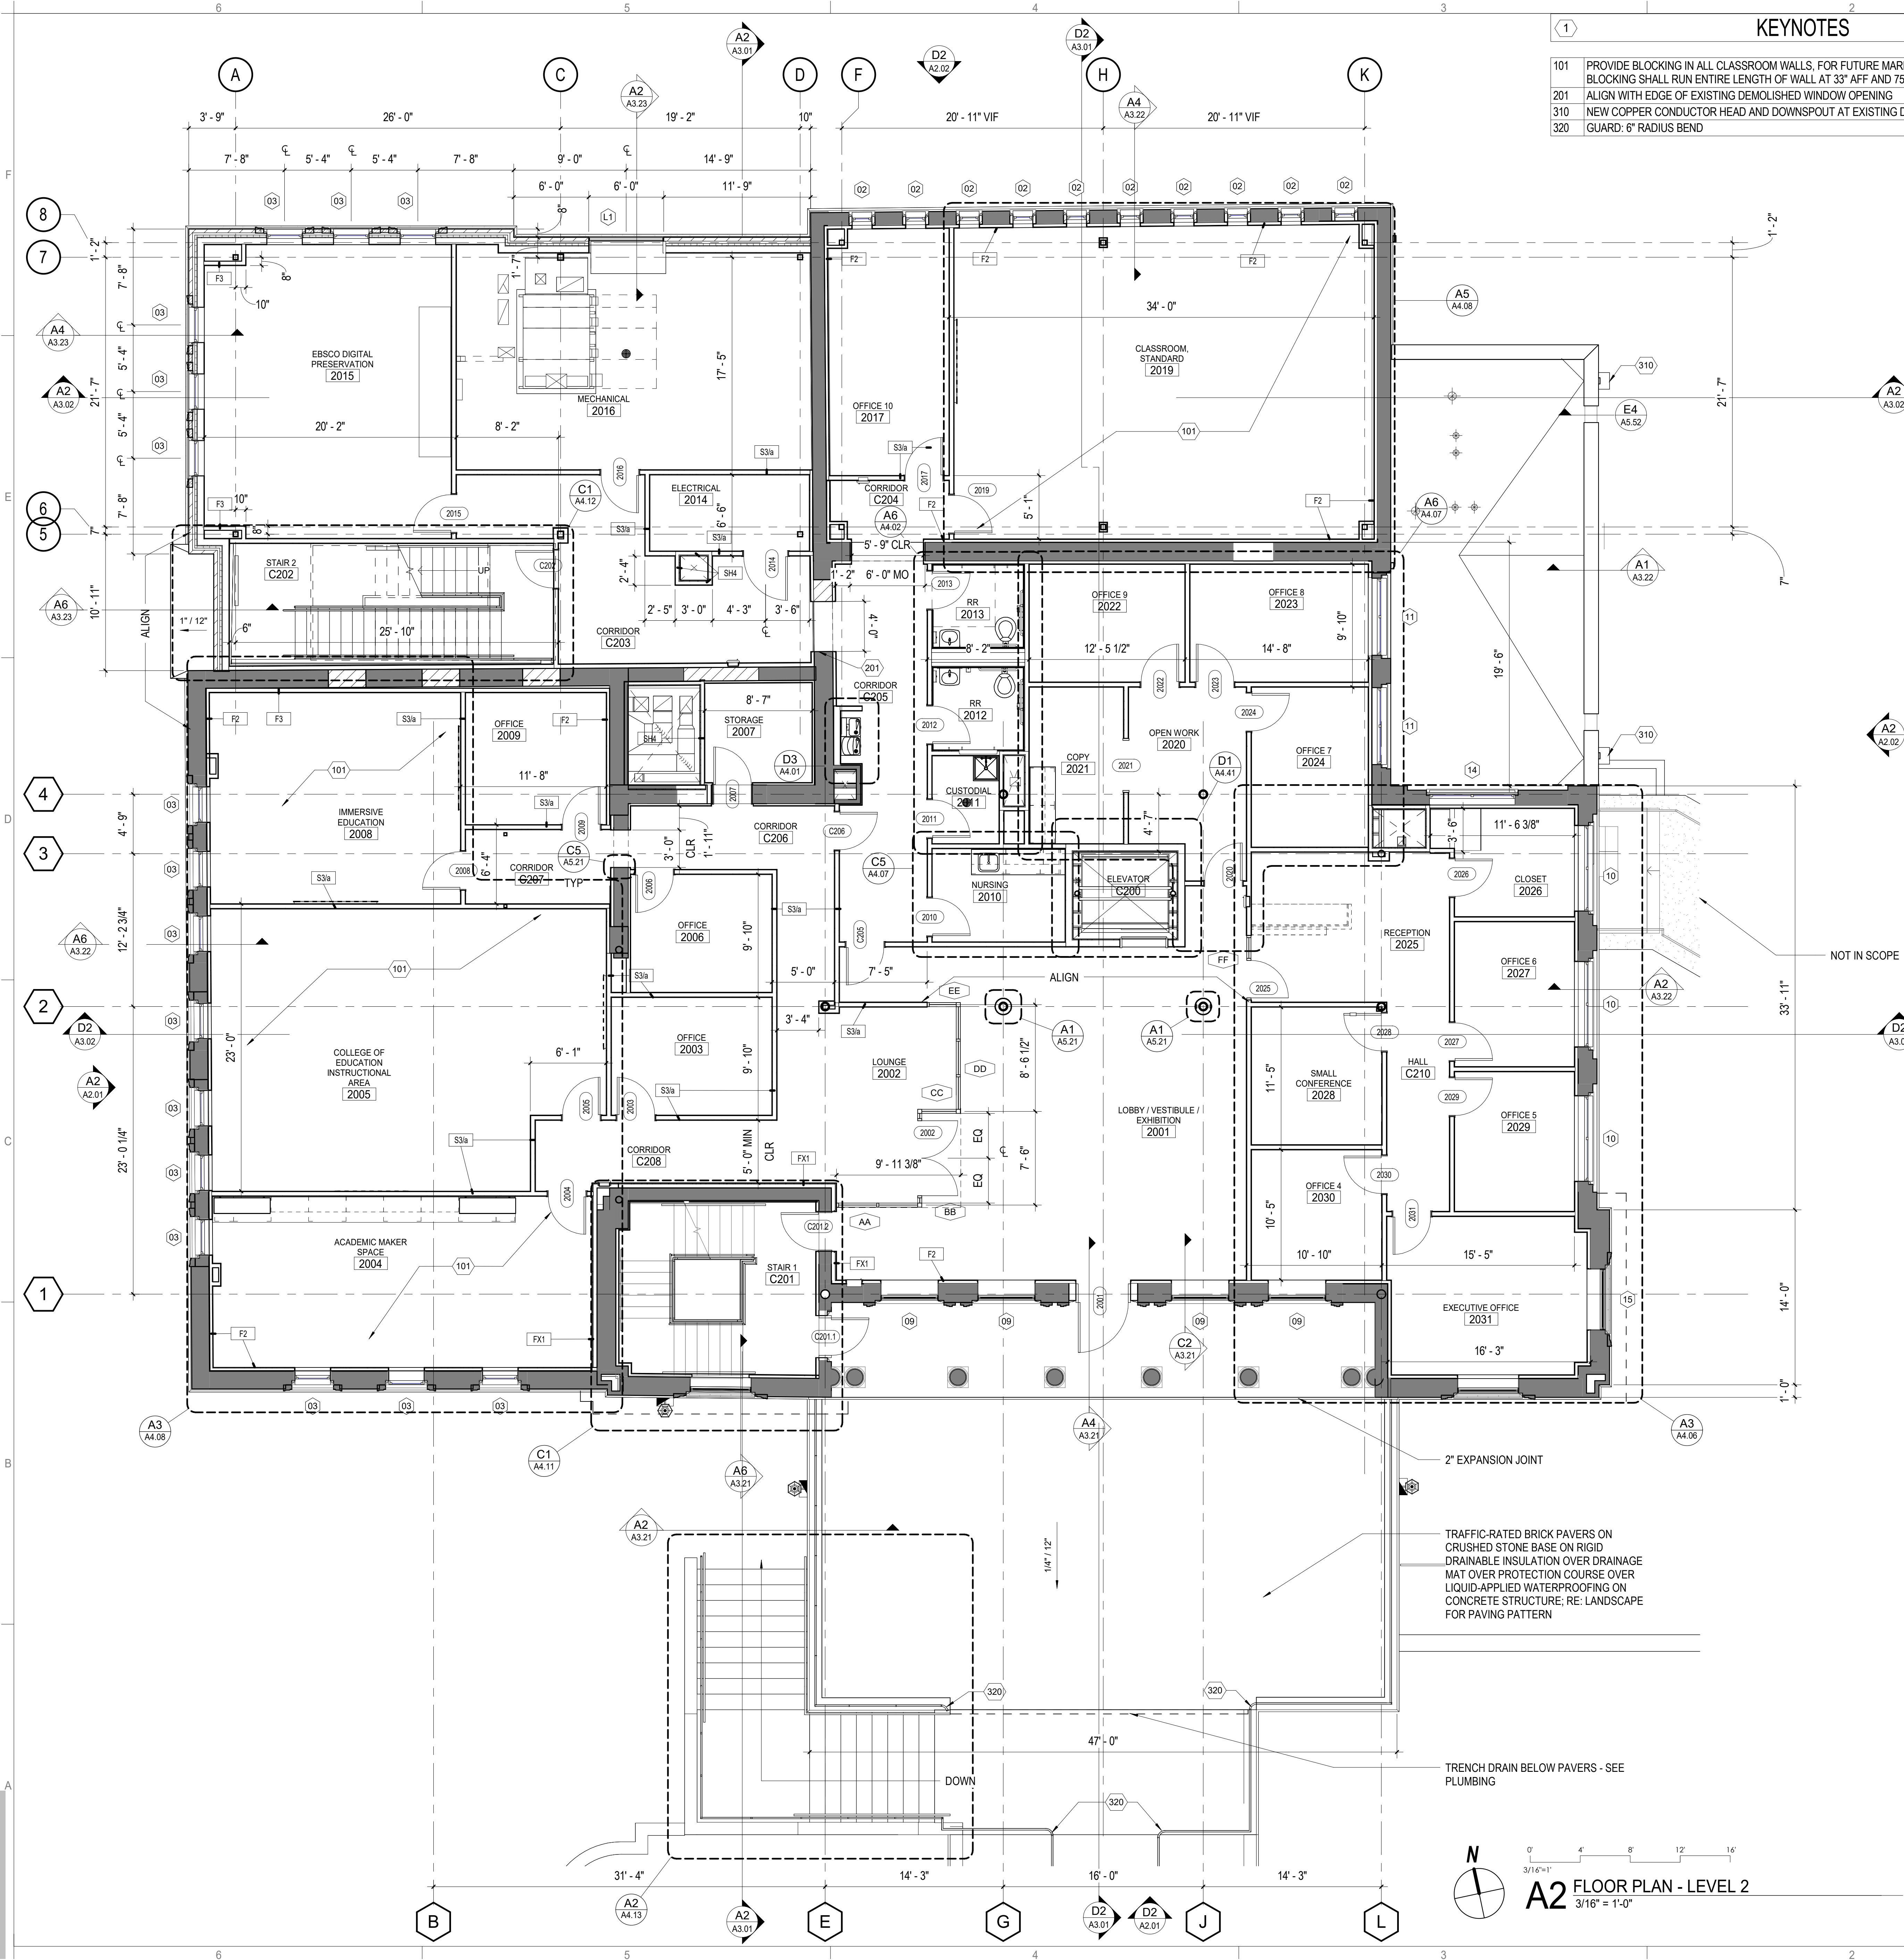

KEYNOTES

- | | |
|-----|---|
| 101 | PROVIDE BLOCKING IN ALL CLASSROOM WALLS. FOR FUTURE MARKER BOARDS, TYPICAL: BLOCKING SHALL RUN ENTIRE LENGTH OF WALL AT 33" AFF AND 75" AFF |
| 201 | ALIGN WITH EDGE OF EXISTING DEMOLISHED WINDOW OPENING |
| 310 | NEW COPPER CONDUCTOR HEAD AND DOWNSPOUT AT EXISTING DOWNSPOUT LOCATION |
| 320 | GUARD: 6" RADIUS BEND |

FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- PARTITIONS TYPICALLY TYPE S3a UNLESS OTHERWISE NOTED.
- PARTITIONS DIMENSIONED TO EXISTING FACE OF FINISH.
- RE: G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- RE: FINISH PLANS FOR WALLS TO RECEIVE LEVEL 5 FINISH.
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 9'-1/2" WIDE MIN CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES. UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD. MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.

FLOOR PLAN LEGEND

- | | |
|--------------------------------|--------------------------------|
| COLUMN LINE (NEW) | 0 |
| COLUMN LINE (EXISTING) | 0 |
| VIEW TYPES | |
| BUILDING ELEVATION | ELEVATION #
DRAWING SHEET |
| BUILDING SECTION | DRAWING SHEET |
| WALL SECTION | SECTION CUT #
DRAWING SHEET |
| DETAIL / ENLARGED PLAN CALLOUT | CALLOUT #
DRAWING SHEET |
| INTERIOR ELEVATION VIEW | ELEVATION #
DRAWING SHEET |

TAG TYPES

- | | |
|---------------------------|------------------|
| ROOM NAME/NUMBER | ROOM NAME
101 |
| DOOR NUMBER | 101 |
| WINDOW TYPE | 1 |
| STOREFRONT / CURTAIN WALL | SF-22 |
| WALL TYPE TAG | S3 |
| DRAWING SHEET KEYNOTE | 1 |
| REVISION NUMBER | 1 |

NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
3531
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 02 - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No. Description Date

DRAWING TITLE

FLOOR PLAN - LEVEL 2

DRAWN BY: Author


CHECKED BY: Checker

PROJECT NUMBER

236002-02

DRAWING NO.

A1.12

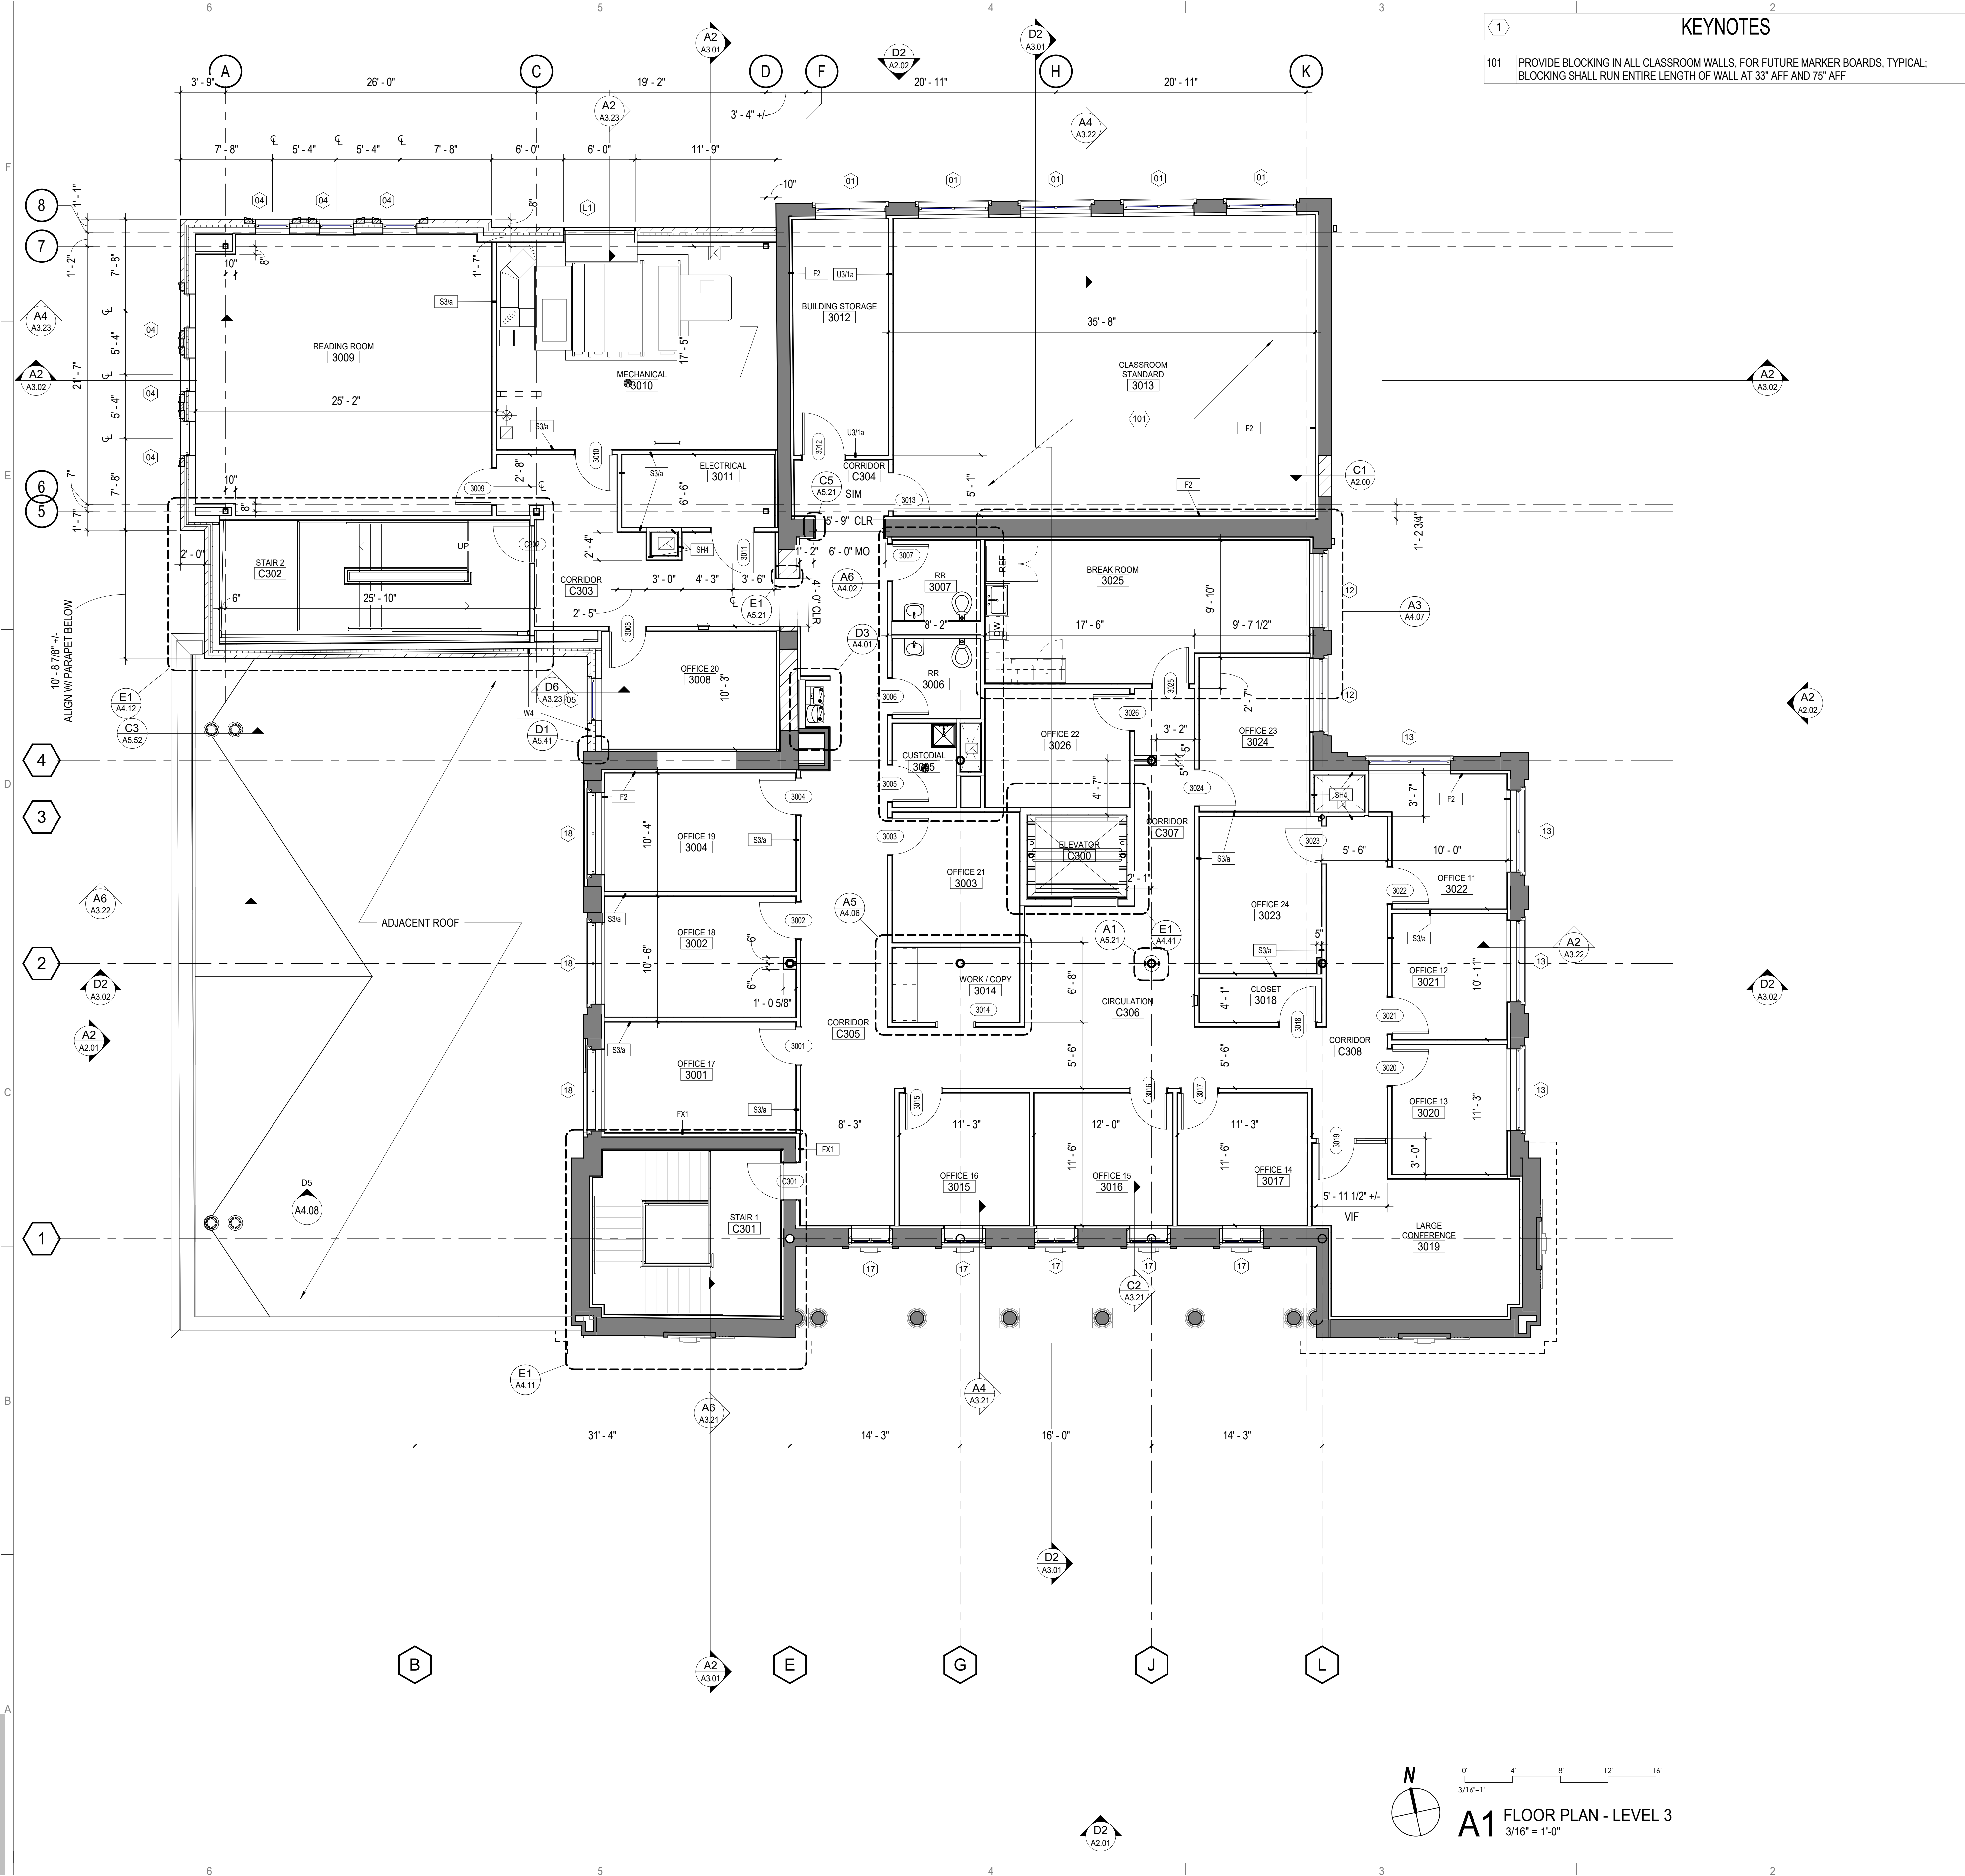

KEYNOTES

- 101 PROVIDE BLOCKING IN ALL CLASSROOM WALLS, FOR FUTURE MARKER BOARDS, TYPICAL: BLOCKING SHALL RUN ENTIRE LENGTH OF WALL AT 33" AFF AND 75" AFF

FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL, UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- IF AN ITEM OF WORK CANNOT BE LOCATED, CLARIFY WITH ARCHITECT BEFORE PROCEEDING.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- PARTITIONS TYPICALLY TYPE S3/a UNLESS OTHERWISE NOTED.
- PARTITIONS DIMENSIONED TO EXISTING FACE OF FINISH.
- RE: G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- RE: FINISH PLANS FOR WALLS TO RECEIVE LEVEL 5 FINISH.
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 9'-1/2" WIDE MIN CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.

FLOOR PLAN LEGEND


- COLUMN LINE (NEW) 0
- COLUMN LINE (EXISTING) 0
- VIEW TYPES
- BUILDING ELEVATION 1 A101 ELEVATION # DRAWING SHEET
- BUILDING SECTION 1 A101 ELEVATION # DRAWING SHEET
- WALL SECTION 1 A101 SECTION CUT # DRAWING SHEET
- DETAIL / ENLARGED PLAN CALLOUT 1 A101 CALLOUT # DRAWING SHEET
- INTERIOR ELEVATION VIEW A1 A101 ELEVATION # DRAWING SHEET

TAG TYPES

- ROOM NAME/NUMBER ROOM NAME 101
- DOOR NUMBER 101
- WINDOW TYPE 1
- STOREFRONT / CURTAIN WALL SF-22
- WALL TYPE TAG S3
- DRAWING SHEET KEYNOTE 1
- REVISION NUMBER 1

NOTE:

REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

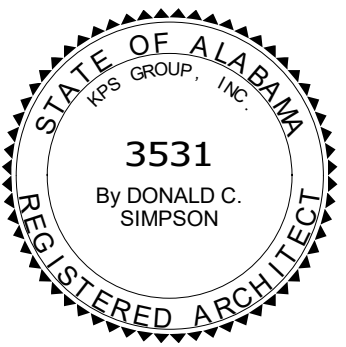

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE D - ADDITION AND RENOVATION


OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
DOMING 2024B3

918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
FLOOR PLAN - LEVEL 3		
DRAWN BY:		
CHECKED BY:		Author Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A1.13		

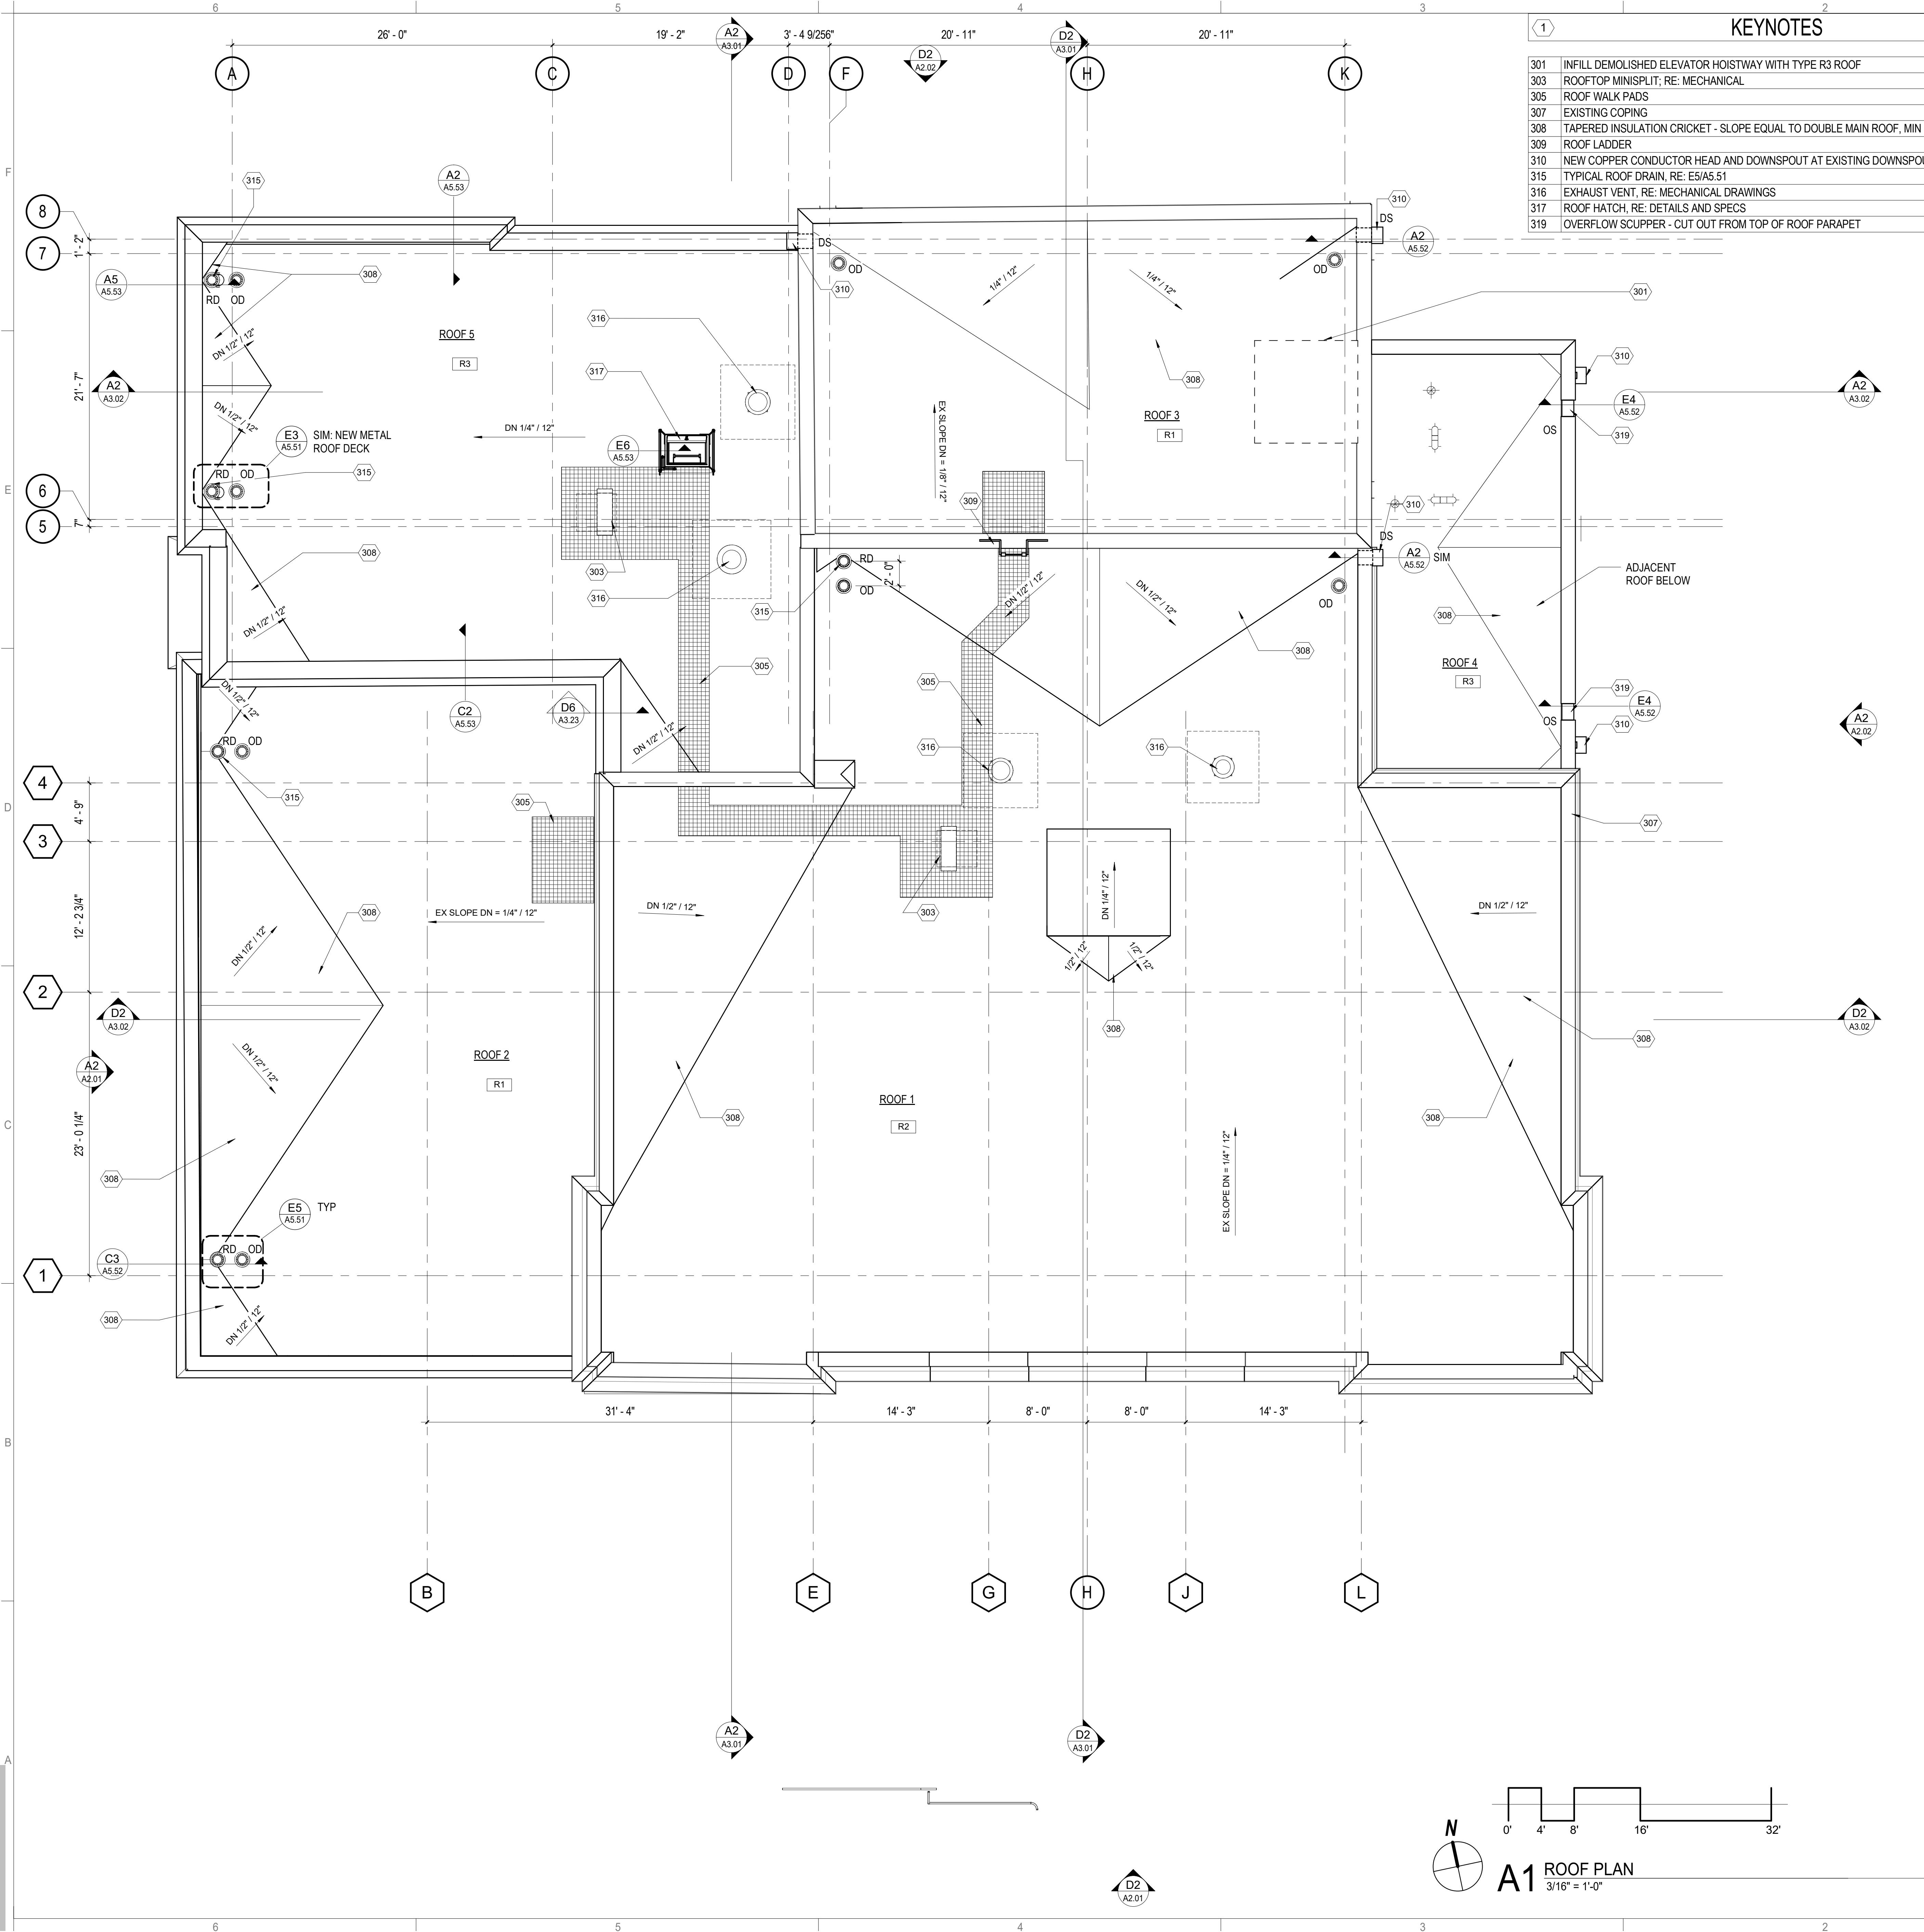

KEYNOTES	
301	INFILL DEMOLISHED ELEVATOR HOISTWAY WITH TYPE R3 ROOF
303	ROOFTOP MINISPLIT, RE: MECHANICAL
305	ROOF WALK PADS
307	EXISTING COPING
308	TAPERED INSULATION CRICKET - SLOPE EQUAL TO DOUBLE MAIN ROOF, MIN
309	ROOF LADDER
310	NEW COPPER CONDUCTOR HEAD AND DOWNSPOUT AT EXISTING DOWNSPOUT LOCATION
315	TYPICAL ROOF DRAIN, RE: E5/A5.51
316	EXHAUST VENT, RE: MECHANICAL DRAWINGS
317	ROOF HATCH, RE: DETAILS AND SPECS
319	OVERFLOW SCUPPER - CUT OUT FROM TOP OF ROOF PARAPET

ROOF PLAN NOTES & LEGEND	
COLUMN LINE (NEW)	0
COLUMN LINE (EXISTING)	0
TAG TYPES	
R1	ROOF TYPE 1 - EXISTING: SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ADHERED TO EXISTING CONCRETE ROOF DECK
R2	ROOF TYPE 2 - EXISTING: SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED THROUGH POLYISO ROOF INSULATION (R-25 MIN) TO EXISTING WOOD DECKING.
R3	ROOF TYPE 3 - NEW ADDITION: SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED THROUGH POLYISO ROOF INSULATION (R-25 MIN) TO METAL ROOF DECKING
DS	DOWNSPOUT
OS	OVERFLOW THRU-WALL SCUPPER
RD	ROOF DRAIN
OD	OVERFLOW ROOF DRAIN
DRAWING SHEET KEYNOTE	
REVISION NUMBER	
NOTE: REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS	

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
REGISTERED ARCHITECT
3531

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
BUILDING 2024B3
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE
ROOF PLAN

DRAWN BY: Author

CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A1.14



KEYNOTES

102 24" WIDE BY 8" HIGH OPENING FOR PIPES, AS HIGH ABOVE FINISH FLOOR AS POSSIBLE. RE: TYPICAL LINTEL DETAIL S0.04 FOR SUPPORT

REFLECTED CEILING PLAN GENERAL NOTES

- COMPARE THIS REFLECTED CEILING PLAN WITH ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN, AND EXHAUST PLANS. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- CEILING ELEVATION @ +9'-0" AFF, TYPICAL, UNLESS NOTED OTHERWISE.
- FOR FURTHER DIMENSIONS SEE LARGE SCALE PLANS, SECTIONS, ELEVATIONS, AND DETAILS.
- RE: ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, SPEAKERS, EXIT SIGNAGE, FIRE ALARM DEVICES, WALL MOUNTED EXIT LIGHTS, ETC.
- FIXTURES SHOWN FOR LOCATION ONLY, REFER TO ENGINEERING DWGS FOR COMPLETE SCOPE, TYPE, AND ANY ADDITIONAL SYSTEM REQUIREMENTS. NOTIFY ARCHITECT OF ANY DISCREPANCIES BETWEEN ENGINEERING DWGS AND THIS PLAN AND OBTAIN CLARIFICATION BEFORE PROCEEDING.
- COORDINATE WITH ARCHITECT THE EXACT LOCATION OF EQUIPMENT ACCESS PANELS IN GYPSUM WALL BOARD CEILING BEFORE INSTALLATION.
- VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE THE FIRE RATED TYPE EQUAL TO THE RATING OF THE CEILING IN WHICH THEY OCCUR.
- SPRINKLER HEAD LOCATIONS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. (BUILDING IS TO BE "FULLY SPRINKLERED") PER NFPA 13 AND OWNER'S INSURANCE COMPANY'S REQUIREMENTS. RE: FIRE PROTECTION PLANS FOR ADDITIONAL INFORMATION.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF EXTENDED SPRINKLER HEADS AND THE TOP OF FILES, SHELVING, LOCKERS, ETC., TYPICAL, UNLESS NOTED OTHERWISE.
- VERIFY WITH ARCHITECT LOCATION OF VISIBLE CEILING ELEMENTS NOT SHOWN ON ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION. COORDINATE WITH OTHER DRAWINGS FOR CEILING FIXTURES NOT SHOWN ON ARCHITECTURAL DRAWINGS, INCLUDING (BUT NOT LIMITED TO) ELECTRICAL AND MECHANICAL FIXTURES.
- IF LOCATION DIMENSIONS ARE NOT INDICATED, FINAL POSITION OF ANY/ALL EXPOSED ELEMENTS SHALL BE COORDINATED WITH ARCHITECT.
- LAY DIRECTIONAL PATTERN CEILING PANEL OR TILE ON WAY WITH PATTERN AS INDICATED BY ARCHITECT, TYPICAL U.N.O.
- INSTALL SIGHT BAFFLES AT RETURN AIR SLOTS. PAINT ANY NEW AREA OR ITEM ABOVE THE CEILING VISIBLE FROM THE ROOM SIDE, INCLUDING DUCTWORK, NON-SPECULAR BLACK, TYPICAL, U.N.O.
- CEILING SUPPORT SYSTEMS ARE NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, LIGHTS, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. SUPPORT THESE ITEMS INDEPENDENTLY FROM THE STRUCTURE ABOVE.
- DO NOT HANG (SUPPORT) ANY ITEMS FROM METAL ROOF DECK. SUSPEND CEILING HANGERS FROM BUILDING'S STRUCTURAL MEMBERS, PLUMB AND FREE FROM CONTACT WITH INSULATION OR OTHER OBJECTS WITHIN CEILING PLENUM. SPLAY HANGERS ONLY WHERE REQUIRED TO MISS OBSTRUCTIONS; OFFSET RESULTING HORIZONTAL FORCES BY BRACING, COUNTER-SPLAYING, OR OTHER EQUALLY EFFECTIVE MEANS. WHERE WIDTH OF DUCTS AND OTHER CONSTRUCTION WITHIN CEILING PLENUM PRODUCES HANGER SPACING THAT INTERFERE WITH LOCATION OF HANGERS, USE TRAPEZES OR EQUIVALENT DEVICES.
- EACH FIXTURE SHALL BE PROVIDED WITH SUPPORT WIRE, ATTACHED TO STRUCTURAL MEMBERS SO THAT THE FIXTURE IS SUPPORTED INDEPENDENTLY OF CEILING. INSTALL (1) SUPPORT @ EACH CORNER. FLEXIBLE CONDUIT, DUCT OR PIPING SHALL BE SUPPORTED SO THAT IT DOES NOT REST UPON CEILING OR TOUCH OTHER BUILDING SYSTEMS.
- REFER TO THE INTERIOR FINISH SCHEDULE FOR PRODUCT INFORMATION.
- AT EXPOSED CEILINGS, CONDUIT, DUCTWORK, AND PIPING TO BE PAINTED TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE.
- G1 CEILING TO BE PAINTED ____ U.N.O. CONFIRM DISCREPANCIES WITH ARCHITECT.
- REFER TO FLOOR PLANS FOR TV LOCATIONS.
- PENETRATIONS OF NON-FIRE RATED DRYWALL ABOVE CEILING AND PENETRATIONS OF GYPSUM BOARD CEILINGS TO BE ACOUSTICALLY SEALED, TYPICAL, UNLESS NOTED OTHERWISE.

REFLECTED CEILING PLAN LEGEND

	ELEVATION ABOVE FINISHED FLOOR
CEILING TYPE TA, 30'-0" AFF	CEILING TYPE
SUSPENDED ACOUSTICAL TILE CEILING. REFER TO CEILING TYPE SCHEDULE	
DIRECT-ATTACHED ACOUSTICAL CEILING. LOCATE BETWEEN BAR JOISTS.	
GYPSUM BOARD CEILING. REFER TO CEILING TYPE SCHEDULE	
EXP-1	
EXPOSED STRUCTURE. PAINT DECK, CONDUIT, DUCTWORK, AND PIPING TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE	
CEILING LIGHT FIXTURE, RECESSED 24" x 48", RE: ELECTRICAL FOR TYPE	
CEILING LIGHT FIXTURE, RECESSED, 24" x 24", RE: ELECTRICAL FOR TYPE	
CEILING LIGHT LINEAR PENDANT, RE: ELECTRICAL FOR TYPE	
CEILING LIGHT, RECESSED, ROUND, RE: ELECTRICAL FOR TYPE	
WALL-MOUNTED STRIP LIGHT FIXTURE, RE: ELECTRICAL FOR TYPE	
CEILING LINEAR SURFACE MOUNTED, RE: ELECTRICAL FOR TYPE	
CEILING SUPPLY AIR DIFFUSER, REFER TO HVAC DWGS FOR SIZE AND TYPE.	
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.	
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.	
CEILING CLOSED-CIRCUIT TV CAMERA, DOME-STYLE	CCTV

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 01 - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS


No.	Description	Date
-----	-------------	------

DRAWING TITLE
REFLECTED CEILING PLAN - LEVEL 1

DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO
A1.21

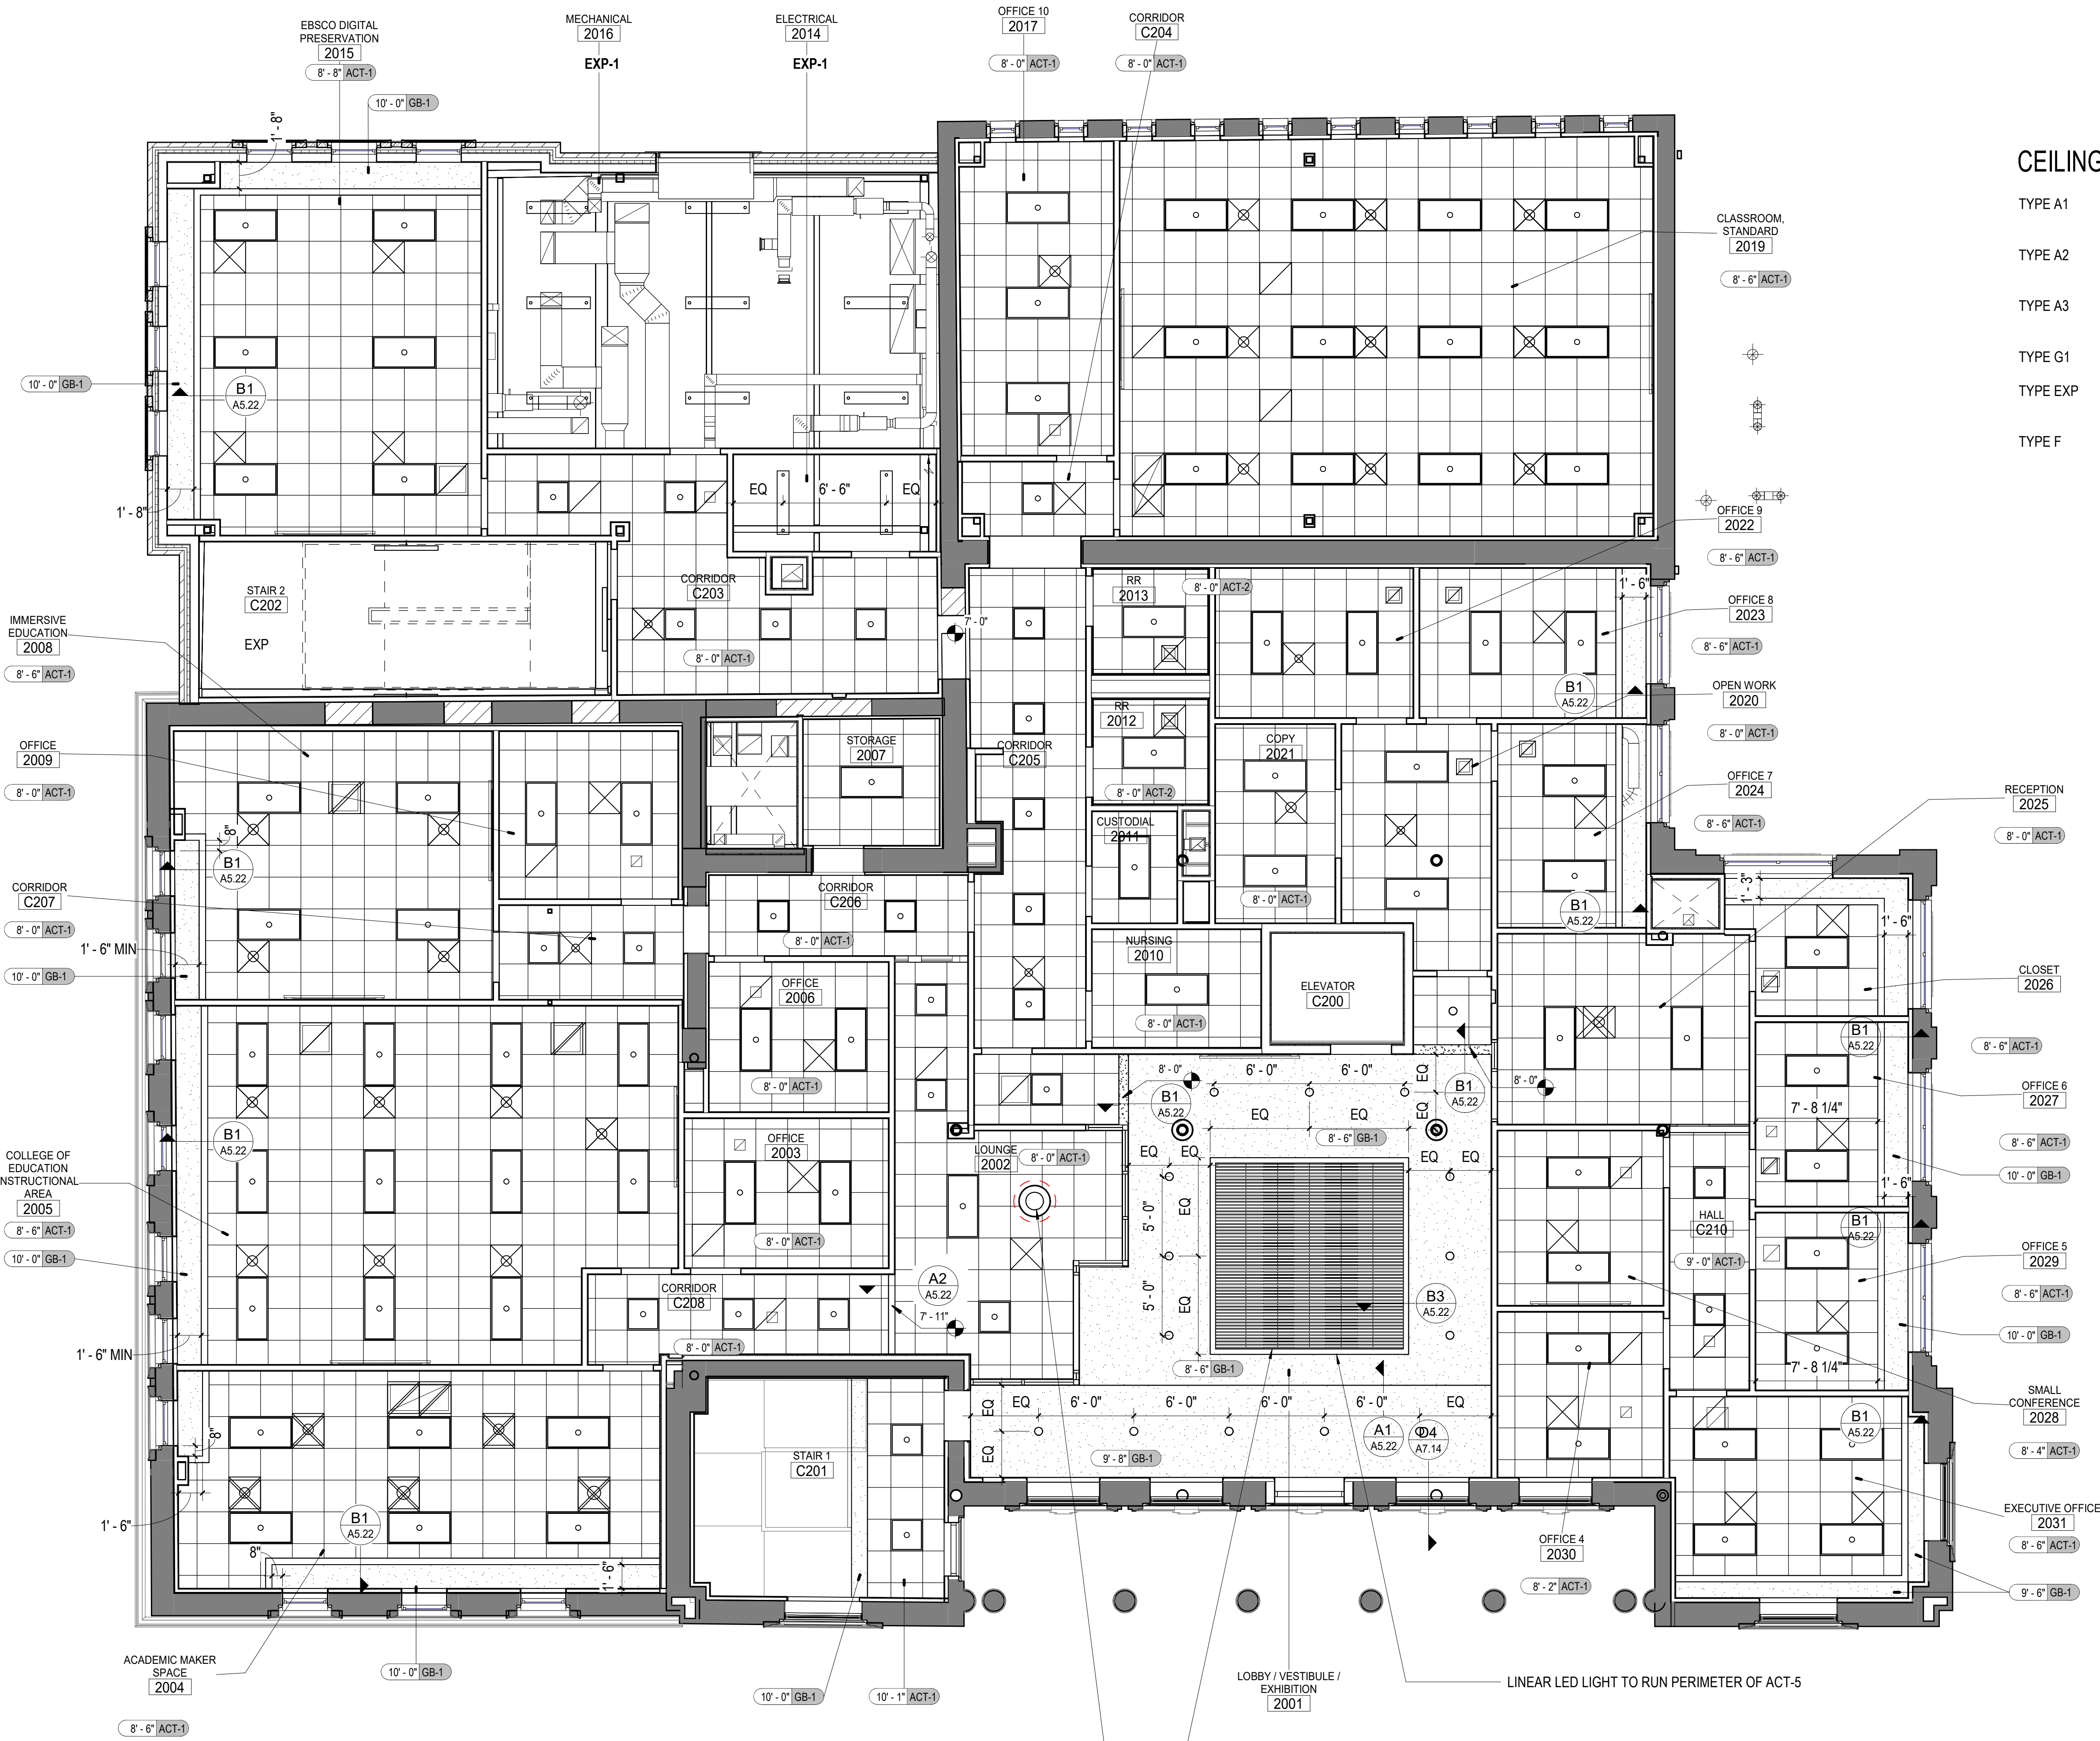

CEILING TYPES:

TYPE A1	2' X 2' ACOUSTICAL PANEL CEILING SYSTEM, CORTEGA 704 REGULAR EDGE IN WHITE BY ARMSTRONG
TYPE A2	2' X 2' ACOUSTICAL PANEL CEILING SYSTEM, CLEANROOM VL UNPERFORATED SQUARE LAY-IN 869 IN WHITE BY ARMSTRONG
TYPE A3	2' X 2' ACOUSTICAL PANEL CEILING SYSTEM, CLEANROOM VL PERFORATED SQUARE LAY-IN 869 IN WHITE BY ARMSTRONG
TYPE G1	GYPSUM WALL BOARD CEILING SYSTEM
TYPE EXP	NO CEILING (OPEN TO STRUCTURE ABOVE) UNDERSIDE OF STRUCTURE TO BE PAINTED P1FL AT OPEN CEILING
TYPE F	GYPSUM BOARD CEILING SYSTEM, UL #501 OR SIMILAR.

REFLECTED CEILING PLAN GENERAL NOTES

- COMPARE THIS REFLECTED CEILING PLAN WITH ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN, AND EXHAUST PLANS. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- CEILING ELEVATION @ +9'-0" AFF, TYPICAL, UNLESS NOTED OTHERWISE.
- FOR FURTHER DIMENSIONS SEE LARGE SCALE PLANS, SECTIONS, ELEVATIONS, AND DETAILS.
- RE: ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, SPEAKERS, EXIT SIGNAGE, FIRE ALARM DEVICES, WALL MOUNTED EXIT LIGHTS, ETC.
- FIXTURES SHOWN FOR LOCATION ONLY, REFER TO ENGINEERING DWGS FOR COMPLETE SCOPE, TYPE, AND ANY ADDITIONAL SYSTEM REQUIREMENTS. NOTIFY ARCHITECT OF ANY DISCREPANCIES BETWEEN ENGINEERING DWGS AND THIS PLAN AND OBTAIN CLARIFICATION BEFORE PROCEEDING.
- COORDINATE WITH ARCHITECT THE EXACT LOCATION OF EQUIPMENT ACCESS PANELS IN GYPSUM WALL BOARD CEILING BEFORE INSTALLATION.
- VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE THE FIRE RATED TYPE EQUAL TO THE RATING OF THE CEILING IN WHICH THEY OCCUR.
- SPRINKLER HEAD LOCATIONS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. (BUILDING IS TO BE "FULLY SPRINKLERED") PER NFPA 13 AND OWNER'S INSURANCE COMPANY'S REQUIREMENTS. RE: FIRE PROTECTION PLANS FOR ADDITIONAL INFORMATION.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF EXTENDED SPRINKLER HEADS AND THE TOP OF FILES, SHELVING, LOCKERS, ETC., TYPICAL, UNLESS NOTED OTHERWISE.
- VERIFY WITH ARCHITECT LOCATION OF VISIBLE CEILING ELEMENTS NOT SHOWN ON ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION. COORDINATE WITH OTHER DRAWINGS FOR CEILING FIXTURES NOT SHOWN ON ARCHITECTURAL DRAWINGS, INCLUDING (BUT NOT LIMITED TO) ELECTRICAL AND MECHANICAL FIXTURES.
- IF LOCATION DIMENSIONS ARE NOT INDICATED, FINAL POSITION OF ANY/ALL EXPOSED ELEMENTS SHALL BE COORDINATED WITH ARCHITECT.
- LAY DIRECTIONAL PATTERN CEILING PANEL OR TILE ON WAY WITH PATTERN AS INDICATED BY ARCHITECT, TYPICAL U.N.O.
- INSTALL SIGHT BAFFLES AT RETURN AIR SLOTS. PAINT ANY NEW AREA OR ITEM ABOVE THE CEILING VISIBLE FROM THE ROOM SIDE, INCLUDING DUCTWORK, NON-SPECULAR BLACK, TYPICAL, U.N.O.
- CEILING SUPPORT SYSTEMS ARE NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, LIGHTS, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. SUPPORT THESE ITEMS INDEPENDENTLY FROM THE STRUCTURE ABOVE.
- DO NOT HANG (SUPPORT) ANY ITEMS FROM METAL ROOF DECK. SUSPEND CEILING HANGERS FROM BUILDING'S STRUCTURAL MEMBERS, PLUMB AND FREE FROM CONTACT WITH INSULATION OR OTHER OBJECTS WITHIN CEILING PLENUM. SPLAY HANGERS ONLY WHERE REQUIRED TO MISS OBSTRUCTIONS; OFFSET RESULTING HORIZONTAL FORCES BY BRACING, COUNTER-SPLAYING, OR OTHER EQUALLY EFFECTIVE MEANS. WHERE WIDTH OF DUCTS AND OTHER CONSTRUCTION WITHIN CEILING PLENUM PRODUCES HANGER SPACING THAT INTERFERE WITH LOCATION OF HANGERS, USE TRAPEZES OR EQUIVALENT DEVICES.
- EACH FIXTURE SHALL BE PROVIDED WITH SUPPORT WIRE, ATTACHED TO STRUCTURAL MEMBERS SO THAT THE FIXTURE IS SUPPORTED INDEPENDENTLY OF CEILING. INSTALL (1) SUPPORT @ EACH CORNER. FLEXIBLE CONDUIT, DUCT OR PIPING SHALL BE SUPPORTED SO THAT IT DOES NOT REST UPON CEILING OR TOUCH OTHER BUILDING SYSTEMS.
- REFER TO THE INTERIOR FINISH SCHEDULE FOR PRODUCT INFORMATION.
- AT EXPOSED CEILINGS, CONDUIT, DUCTWORK, AND PIPING TO BE PAINTED TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE.
- G1 CEILING TO BE PAINTED _____. U.N.O. CONFIRM DISCREPANCIES WITH ARCHITECT.
- REFER TO FLOOR PLANS FOR TV LOCATIONS.
- PENETRATIONS OF NON-FIRE RATED DRYWALL ABOVE CEILING AND PENETRATIONS OF GYPSUM BOARD CEILINGS TO BE ACOUSTICALLY SEALED, TYPICAL, UNLESS NOTED OTHERWISE.

REFLECTED CEILING PLAN LEGEND

CEILING TYPE TA, 30'-0" A1	ELEVATION ABOVE FINISHED FLOOR	CEILING TYPE
SUSPENDED ACOUSTICAL TILE CEILING. REFER TO CEILING TYPE SCHEDULE		
DIRECT-ATTACHED ACOUSTICAL CEILING. LOCATE BETWEEN BAR JOISTS.		
GYPSUM BOARD CEILING. REFER TO CEILING TYPE SCHEDULE		
EXPOSED STRUCTURE. PAINT DECK, CONDUIT, DUCTWORK, AND PIPING TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE		
CEILING LIGHT FIXTURE, RECESSED 24" x 48", RE: ELECTRICAL FOR TYPE		EXP-1
CEILING LIGHT FIXTURE, RECESSED, 24" x 24", RE: ELECTRICAL FOR TYPE		
CEILING LIGHT LINEAR PENDANT, RE: ELECTRICAL FOR TYPE		
CEILING LIGHT, RECESSED, ROUND, RE: ELECTRICAL FOR TYPE		
WALL-MOUNTED STRIP LIGHT FIXTURE, RE: ELECTRICAL FOR TYPE		
CEILING LINEAR SURFACE MOUNTED, RE: ELECTRICAL FOR TYPE		
CEILING SUPPLY AIR DIFFUSER, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING CLOSED-CIRCUIT TV CAMERA, DOME-STYLE		CCTV

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE D - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
DOING 2024B3
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No. Description Date

DRAWING TITLE

REFLECTED CEILING PLAN - LEVEL 2

DRAWN BY: Author


CHECKED BY: Checker

PROJECT NUMBER

236002-02

DRAWING NO.

A1.22

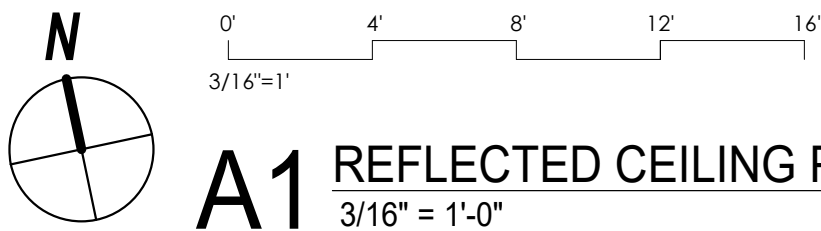

A1 REFLECTED CEILING PLAN - LEVEL 3
3/16" = 1'-0"

KEYNOTES

304 EXISTING STUCCO SOFFIT - PATCH AND CLEAN

REFLECTED CEILING PLAN GENERAL NOTES

- COMPARE THIS REFLECTED CEILING PLAN WITH ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN, AND EXHAUST PLANS. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- CEILING ELEVATION @ +9'-0" AFF, TYPICAL, UNLESS NOTED OTHERWISE.
- FOR FURTHER DIMENSIONS SEE LARGE SCALE PLANS, SECTIONS, ELEVATIONS, AND DETAILS.
- RE: ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, SPEAKERS, EXIT SIGNAGE, FIRE ALARM DEVICES, WALL MOUNTED EXIT LIGHTS, ETC.
- FIXTURES SHOWN FOR LOCATION ONLY, REFER TO ENGINEERING DWGS FOR COMPLETE SCOPE, TYPE, AND ANY ADDITIONAL SYSTEM REQUIREMENTS. NOTIFY ARCHITECT OF ANY DISCREPANCIES BETWEEN ENGINEERING DWGS AND THIS PLAN AND OBTAIN CLARIFICATION BEFORE PROCEEDING.
- COORDINATE WITH ARCHITECT THE EXACT LOCATION OF EQUIPMENT ACCESS PANELS IN GYPSUM WALL BOARD CEILING BEFORE INSTALLATION.
- VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE THE FIRE RATED TYPE EQUAL TO THE RATING OF THE CEILING IN WHICH THEY OCCUR.
- SPRINKLER HEAD LOCATIONS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS (BUILDING IS TO BE "FULLY SPRINKLERED") PER NFPA 13 AND OWNER'S INSURANCE COMPANY'S REQUIREMENTS. RE: FIRE PROTECTION PLANS FOR ADDITIONAL INFORMATION.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF EXTENDED SPRINKLER HEADS AND THE TOP OF FILES, SHELVING, LOCKERS, ETC., TYPICAL, UNLESS NOTED OTHERWISE.
- VERIFY WITH ARCHITECT LOCATION OF VISIBLE CEILING ELEMENTS NOT SHOWN ON ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION. COORDINATE WITH OTHER DRAWINGS FOR CEILING FIXTURES NOT SHOWN ON ARCHITECTURAL DRAWINGS, INCLUDING (BUT NOT LIMITED TO) ELECTRICAL AND MECHANICAL FIXTURES.
- IF LOCATION DIMENSIONS ARE NOT INDICATED, FINAL POSITION OF ANY/ALL EXPOSED ELEMENTS SHALL BE COORDINATED WITH ARCHITECT.
- LAY DIRECTIONAL PATTERN CEILING PANEL OR TILE ON WAY WITH PATTERN AS INDICATED BY ARCHITECT, TYPICAL U.N.O.
- INSTALL SIGHT BAFFLES AT RETURN AIR SLOTS. PAINT ANY NEW AREA OR ITEM ABOVE THE CEILING VISIBLE FROM THE ROOM SIDE, INCLUDING DUCTWORK, NON-SPECULAR BLACK, TYPICAL, U.N.O.
- CEILING SUPPORT SYSTEMS ARE NOT DESIGNED OR INTENDED TO SUPPORT THE WEIGHT OF ADDITIONAL EQUIPMENT, CABLE, CONDUIT, LIGHTS, MECHANICAL EQUIPMENT OR OTHER CONSTRUCTION. SUPPORT THESE ITEMS INDEPENDENTLY FROM THE STRUCTURE ABOVE.
- DO NOT HANG (SUPPORT) ANY ITEMS FROM METAL ROOF DECK. SUSPEND CEILING HANGERS FROM BUILDING'S STRUCTURAL MEMBERS, PLUMB AND FREE FROM CONTACT WITH INSULATION OR OTHER OBJECTS WITHIN CEILING PLENUM. SPLAY HANGERS ONLY WHERE REQUIRED TO MISS OBSTRUCTIONS; OFFSET RESULTING HORIZONTAL FORCES BY BRACING, COUNTER-SPLAYING, OR OTHER EQUALLY EFFECTIVE MEANS. WHERE WIDTH OF DUCTS AND OTHER CONSTRUCTION WITHIN CEILING PLENUM PRODUCES HANGER SPACING THAT INTERFERE WITH LOCATION OF HANGERS, USE TRAPEZES OR EQUIVALENT DEVICES.
- EACH FIXTURE SHALL BE PROVIDED WITH SUPPORT WIRE, ATTACHED TO STRUCTURAL MEMBERS SO THAT THE FIXTURE IS SUPPORTED INDEPENDENTLY OF CEILING. INSTALL (1) SUPPORT @ EACH CORNER. FLEXIBLE CONDUIT, DUCT OR PIPING SHALL BE SUPPORTED SO THAT IT DOES NOT REST UPON CEILING OR TOUCH OTHER BUILDING SYSTEMS.
- REFER TO THE INTERIOR FINISH SCHEDULE FOR PRODUCT INFORMATION.
- AT EXPOSED CEILINGS, CONDUIT, DUCTWORK, AND PIPING TO BE PAINTED TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE.
- G1 CEILING TO BE PAINTED ____ U.N.O. CONFIRM DISCREPANCIES WITH ARCHITECT.
- REFER TO FLOOR PLANS FOR TV LOCATIONS.
- PENETRATIONS OF NON-FIRE RATED DRYWALL ABOVE CEILING AND PENETRATIONS OF GYPSUM BOARD CEILINGS TO BE ACOUSTICALLY SEALED, TYPICAL, UNLESS NOTED OTHERWISE.

REFLECTED CEILING PLAN LEGEND

CEILING TYPE	ELEVATION ABOVE FINISHED FLOOR	CEILING TYPE
SUSPENDED ACOUSTICAL TILE CEILING. REFER TO CEILING TYPE SCHEDULE		
DIRECT-ATTACHED ACOUSTICAL CEILING. LOCATE BETWEEN BAR JOISTS.		
GYPSUM BOARD CEILING. REFER TO CEILING TYPE SCHEDULE		
EXPOSED STRUCTURE. PAINT DECK, CONDUIT, DUCTWORK, AND PIPING TO MATCH STRUCTURE, TYPICAL, UNLESS NOTED OTHERWISE		
CEILING LIGHT FIXTURE, RECESSED 24" x 48", RE: ELECTRICAL FOR TYPE		
CEILING LIGHT FIXTURE, RECESSED, 24" x 24", RE: ELECTRICAL FOR TYPE		
CEILING LIGHT LINEAR PENDANT, RE: ELECTRICAL FOR TYPE		
CEILING LIGHT, RECESSED, ROUND, RE: ELECTRICAL FOR TYPE		
WALL-MOUNTED STRIP LIGHT FIXTURE, RE: ELECTRICAL FOR TYPE		
CEILING LINEAR SURFACE MOUNTED, RE: ELECTRICAL FOR TYPE		
CEILING SUPPLY AIR DIFFUSER, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING RETURN AIR GRILLE, REFER TO HVAC DWGS FOR SIZE AND TYPE.		
CEILING CLOSED-CIRCUIT TV CAMERA, DOME-STYLE		

K|P|S
GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT


McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE D - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24
REVISIONS
No. Description Date
DRAWING TITLE
REFLECTED CEILING PLAN - LEVEL 3
DRAWN BY: Author
CHECKED BY: Checker
PROJECT NUMBER
236002-02
DRAWING NO.
A1.23


W7 WALL TYPE 7
1" = 1'-0"

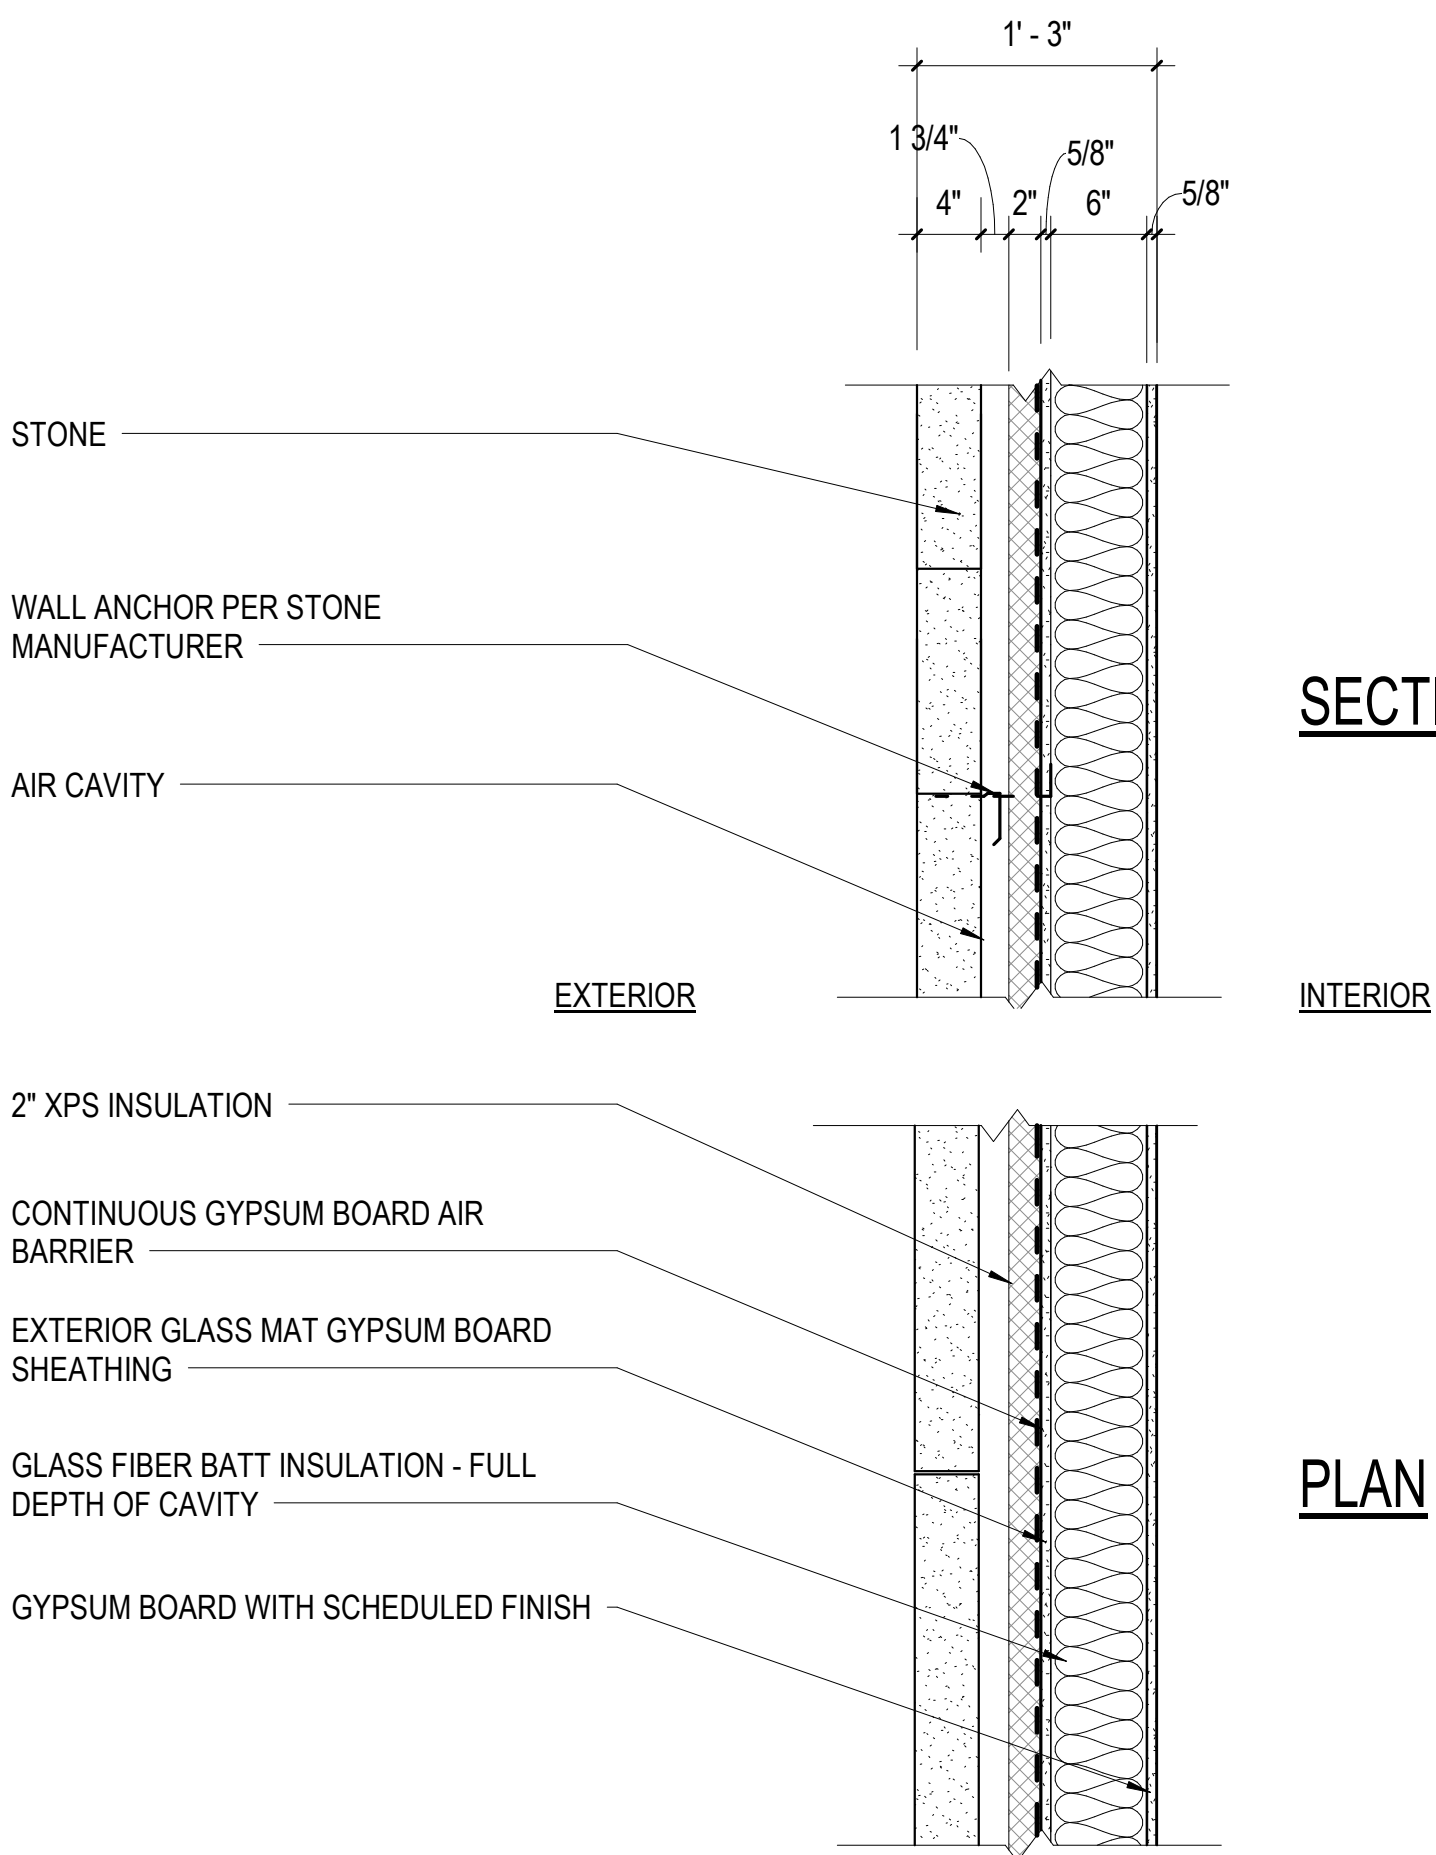


W5 WALL TYPE 5
1" = 1'-0"

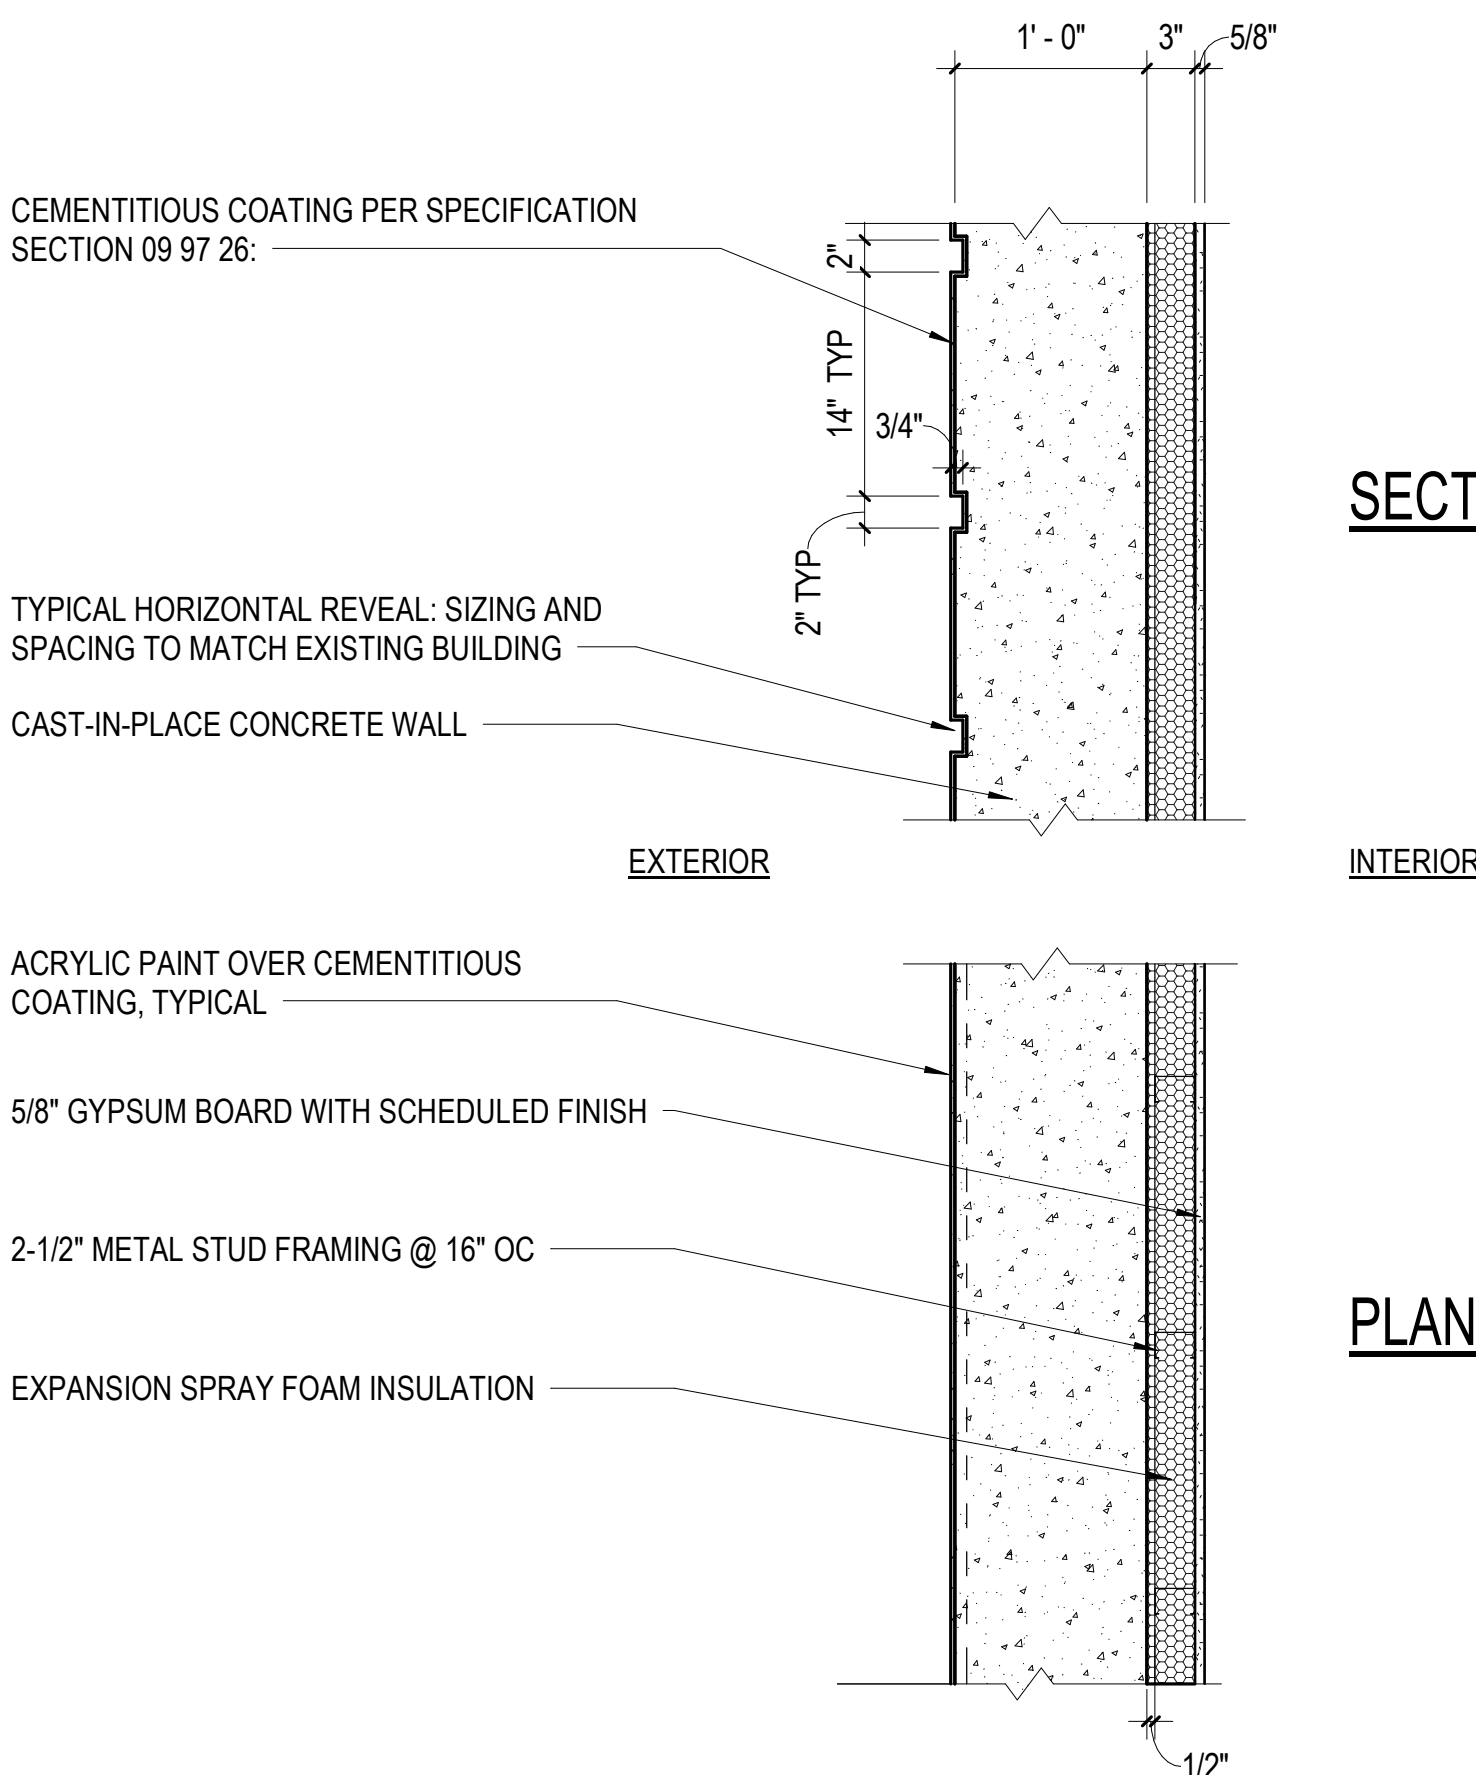


W3 WALL TYPE 3
1" = 1'-0"

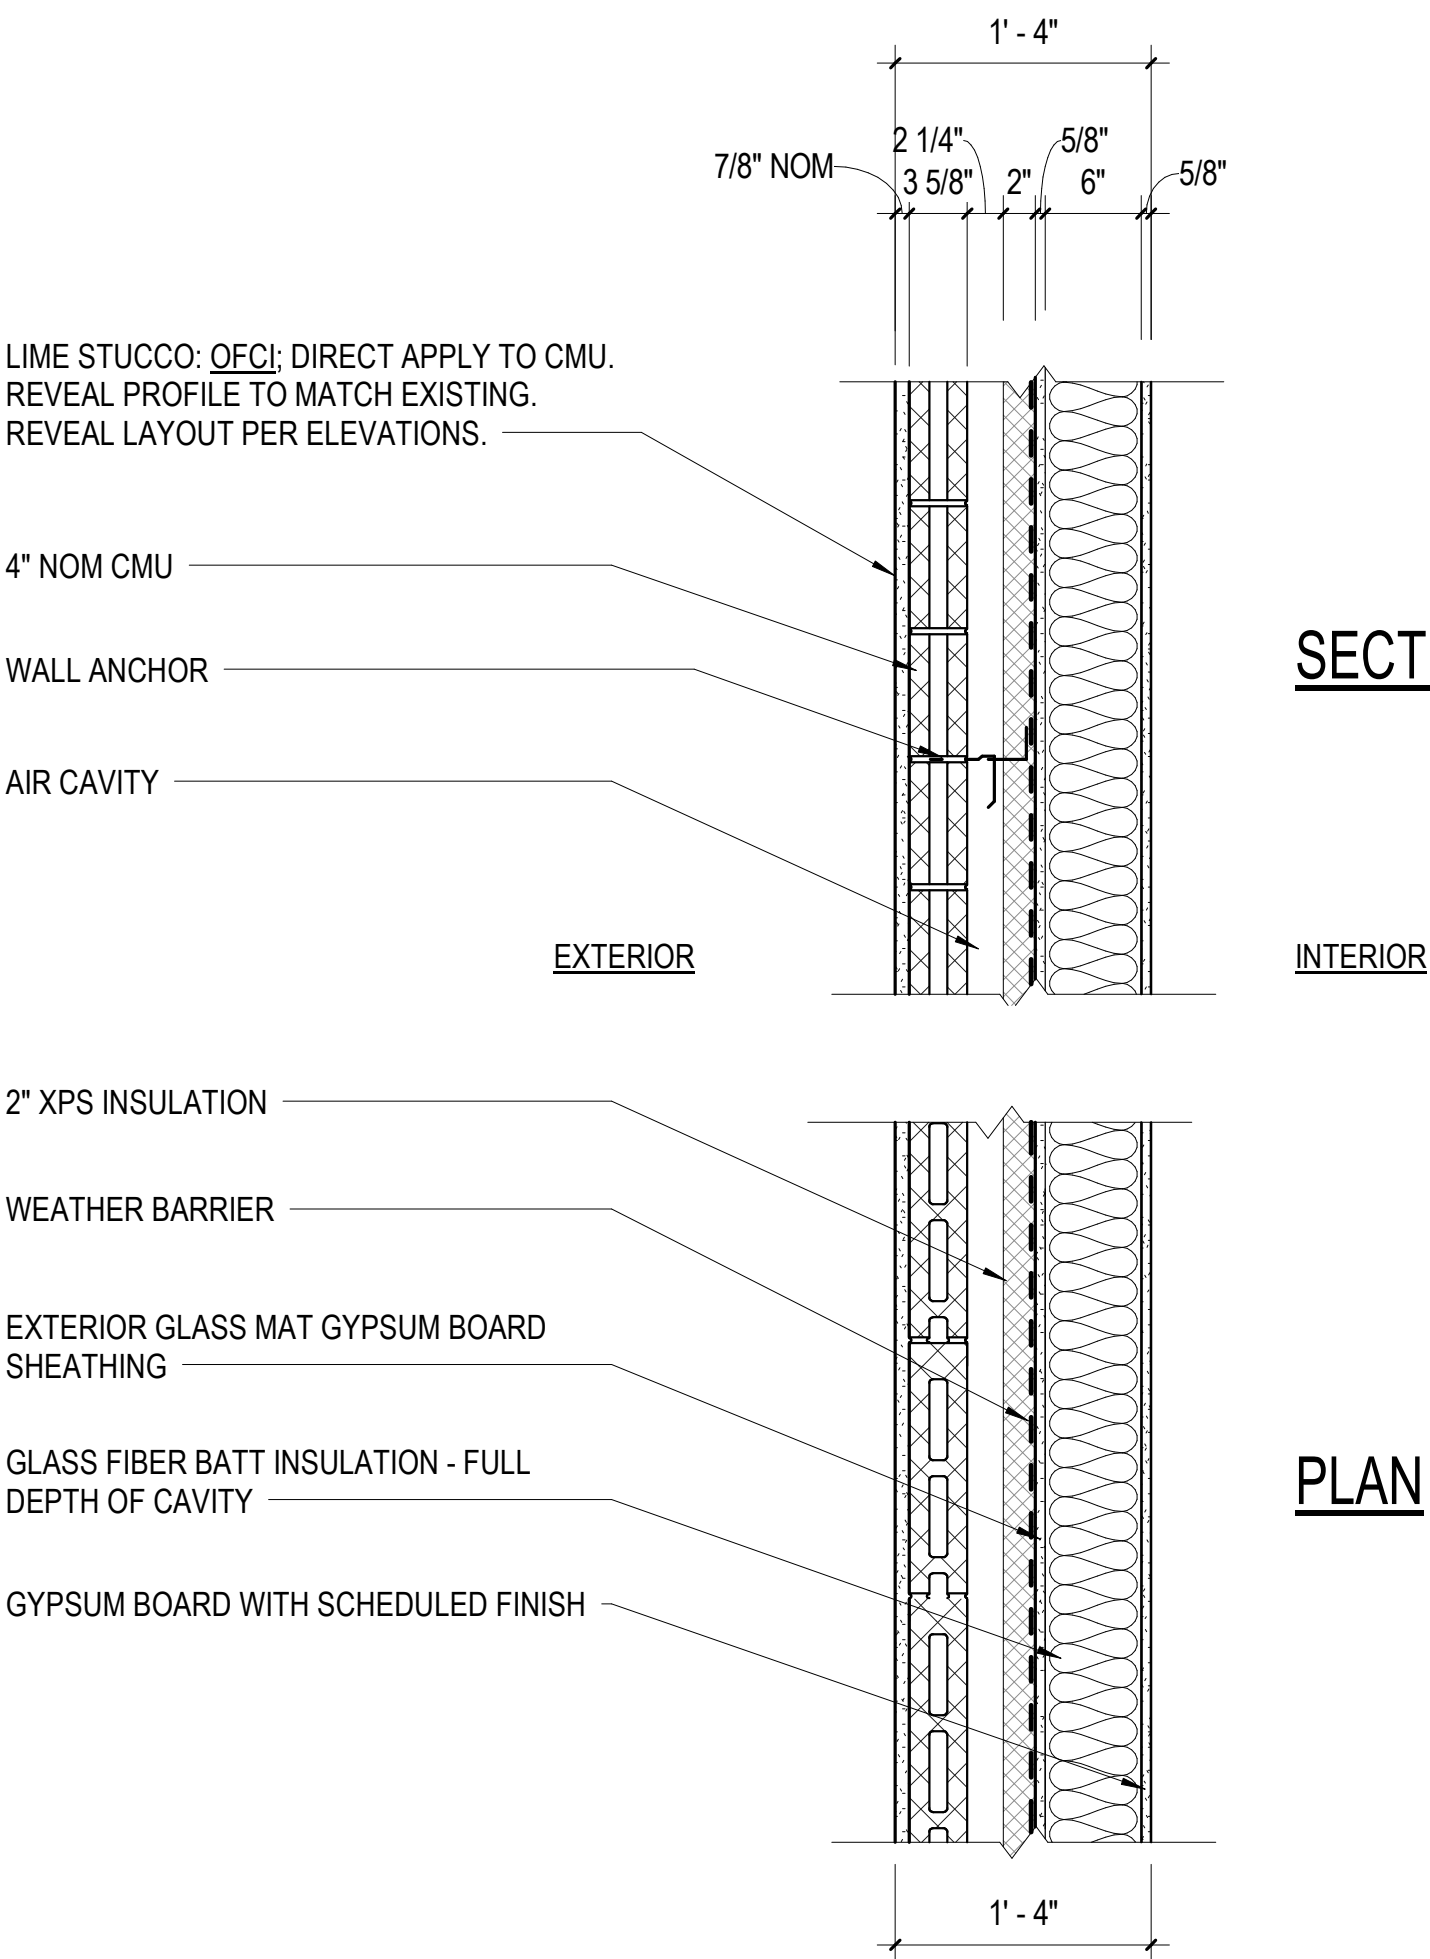


W1 WALL TYPE 1
1" = 1'-0"

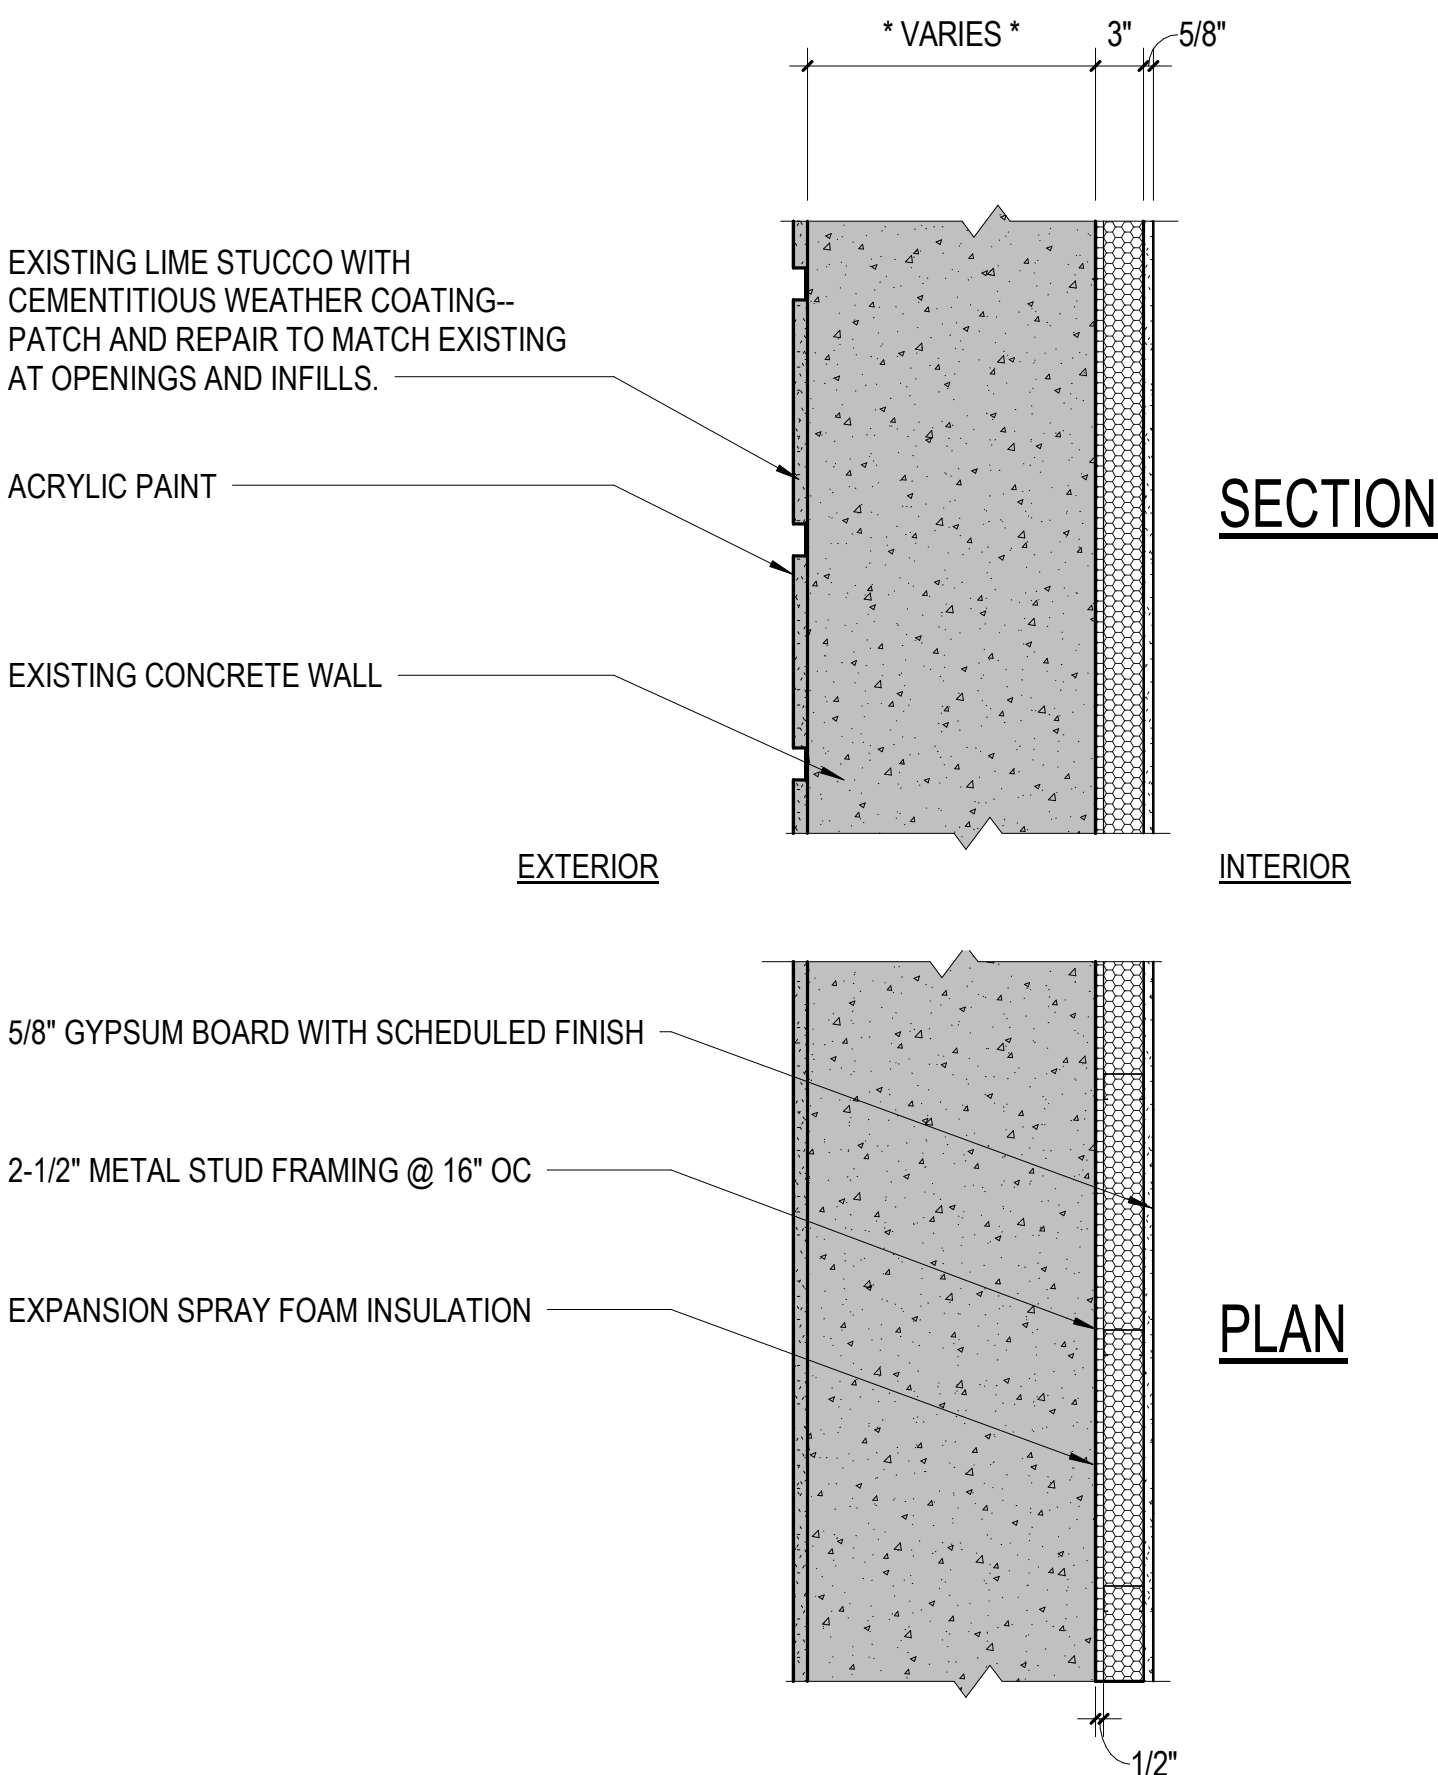


C1 TYP EXTERIOR MASONRY WALL OPENING INFILL
1" = 1'-0"

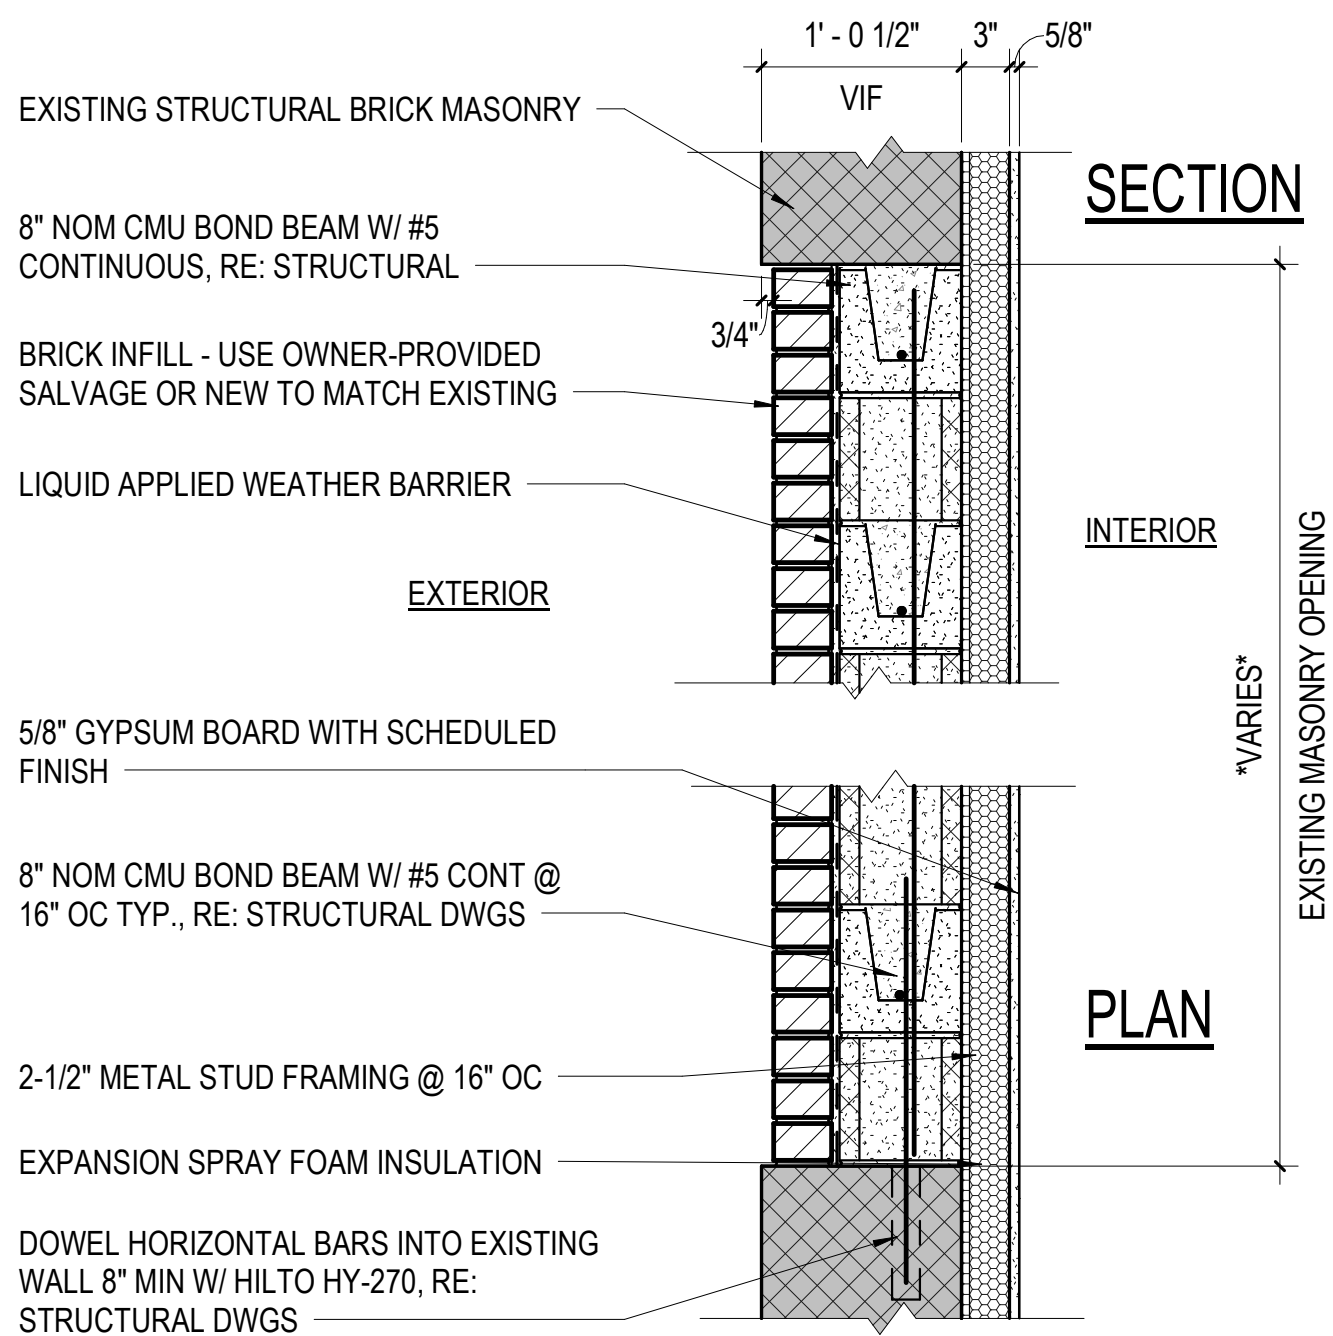


W6 WALL TYPE 6
1" = 1'-0"

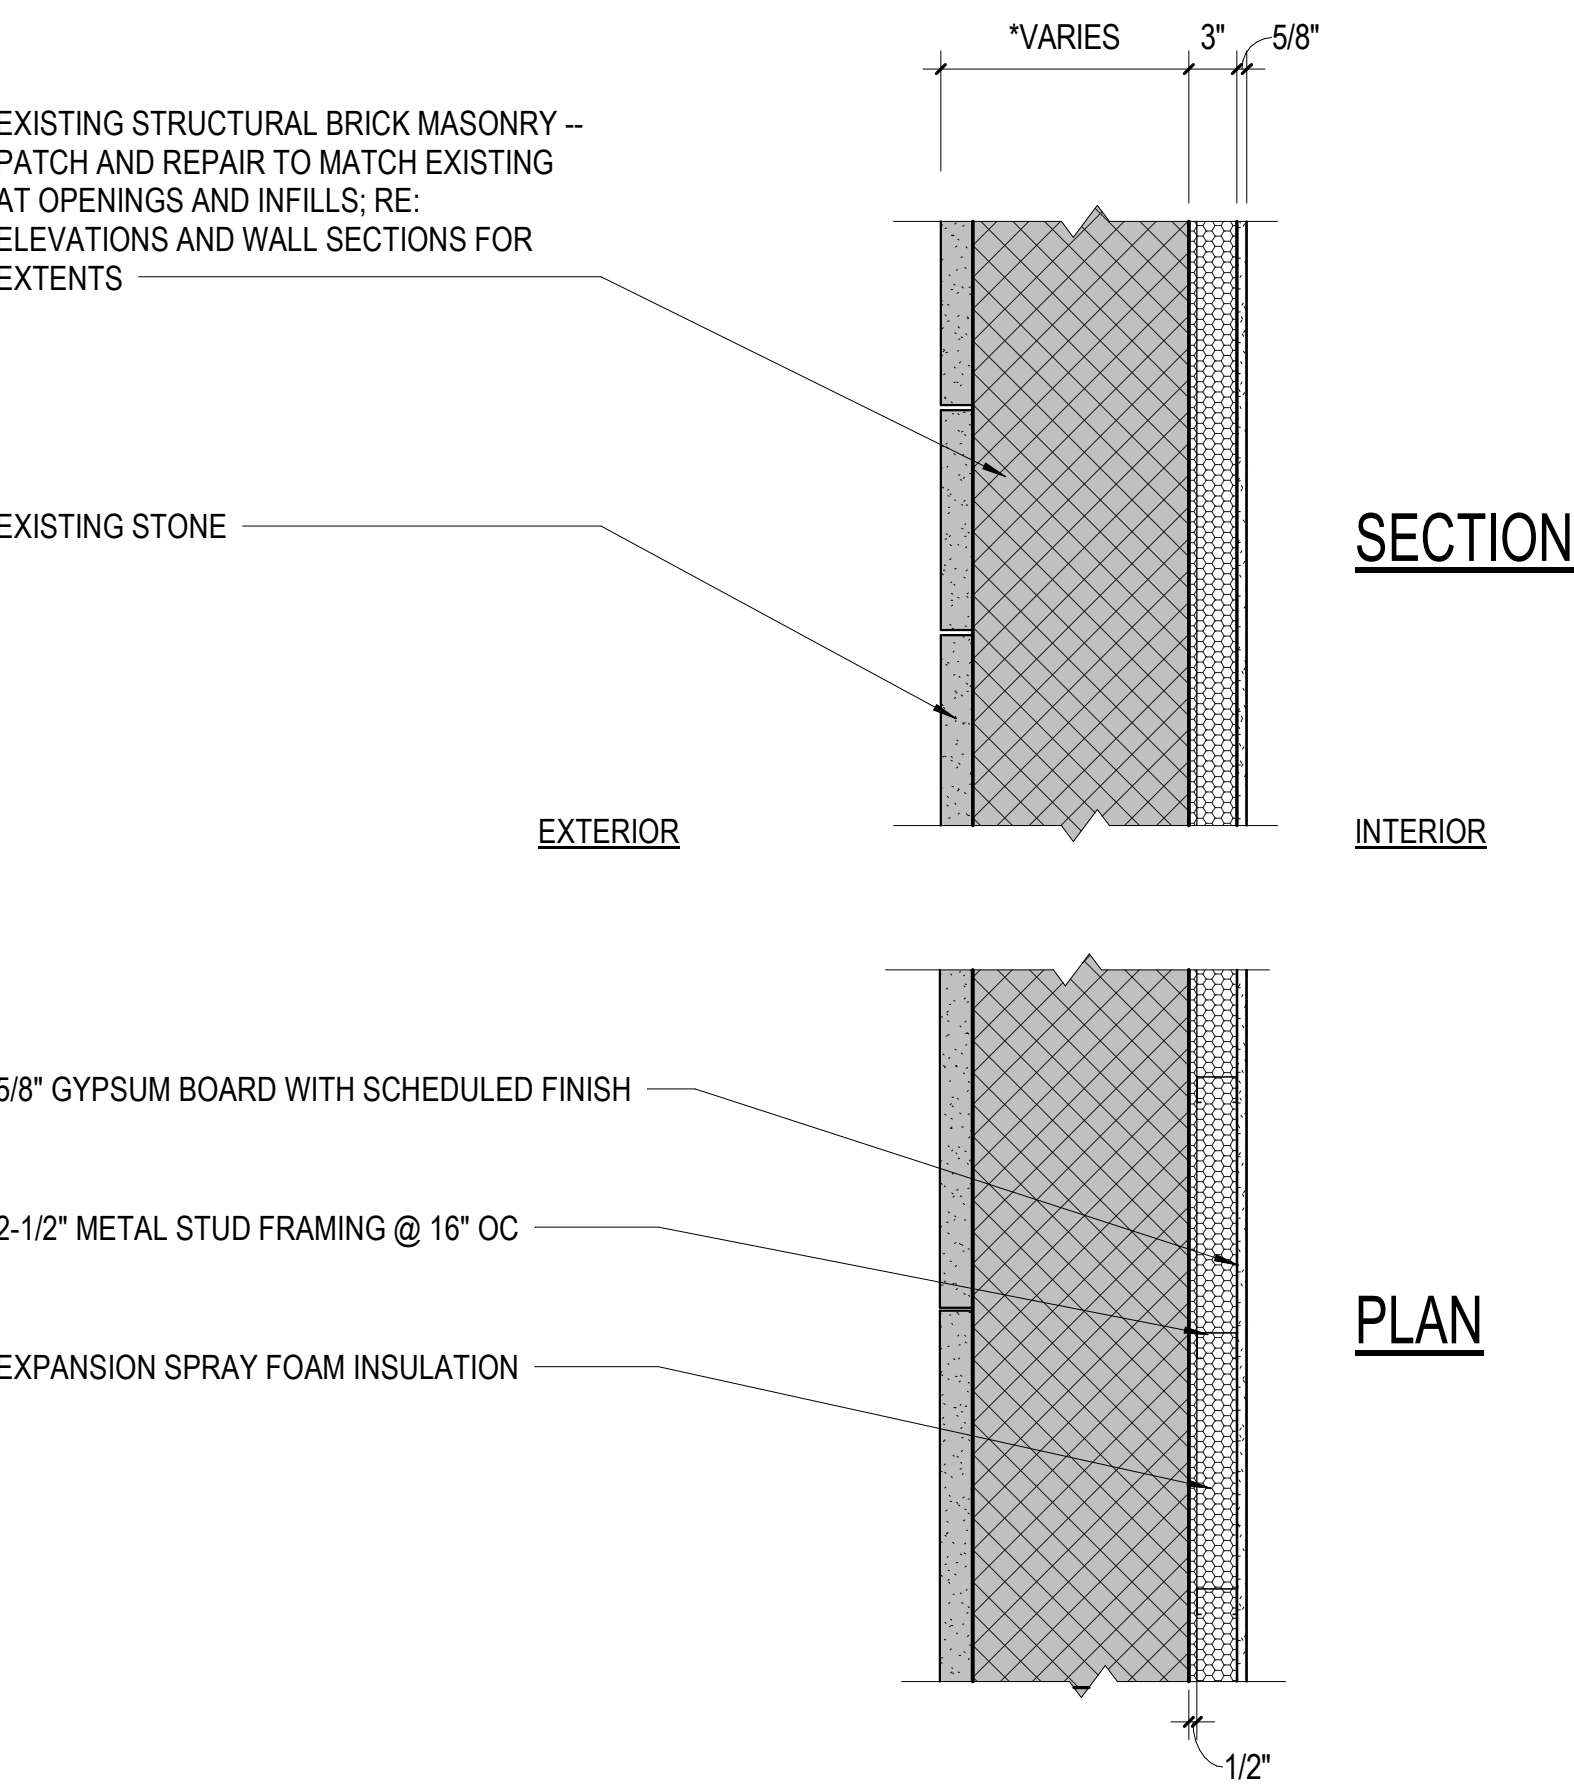


W4 WALL TYPE 4
1" = 1'-0"

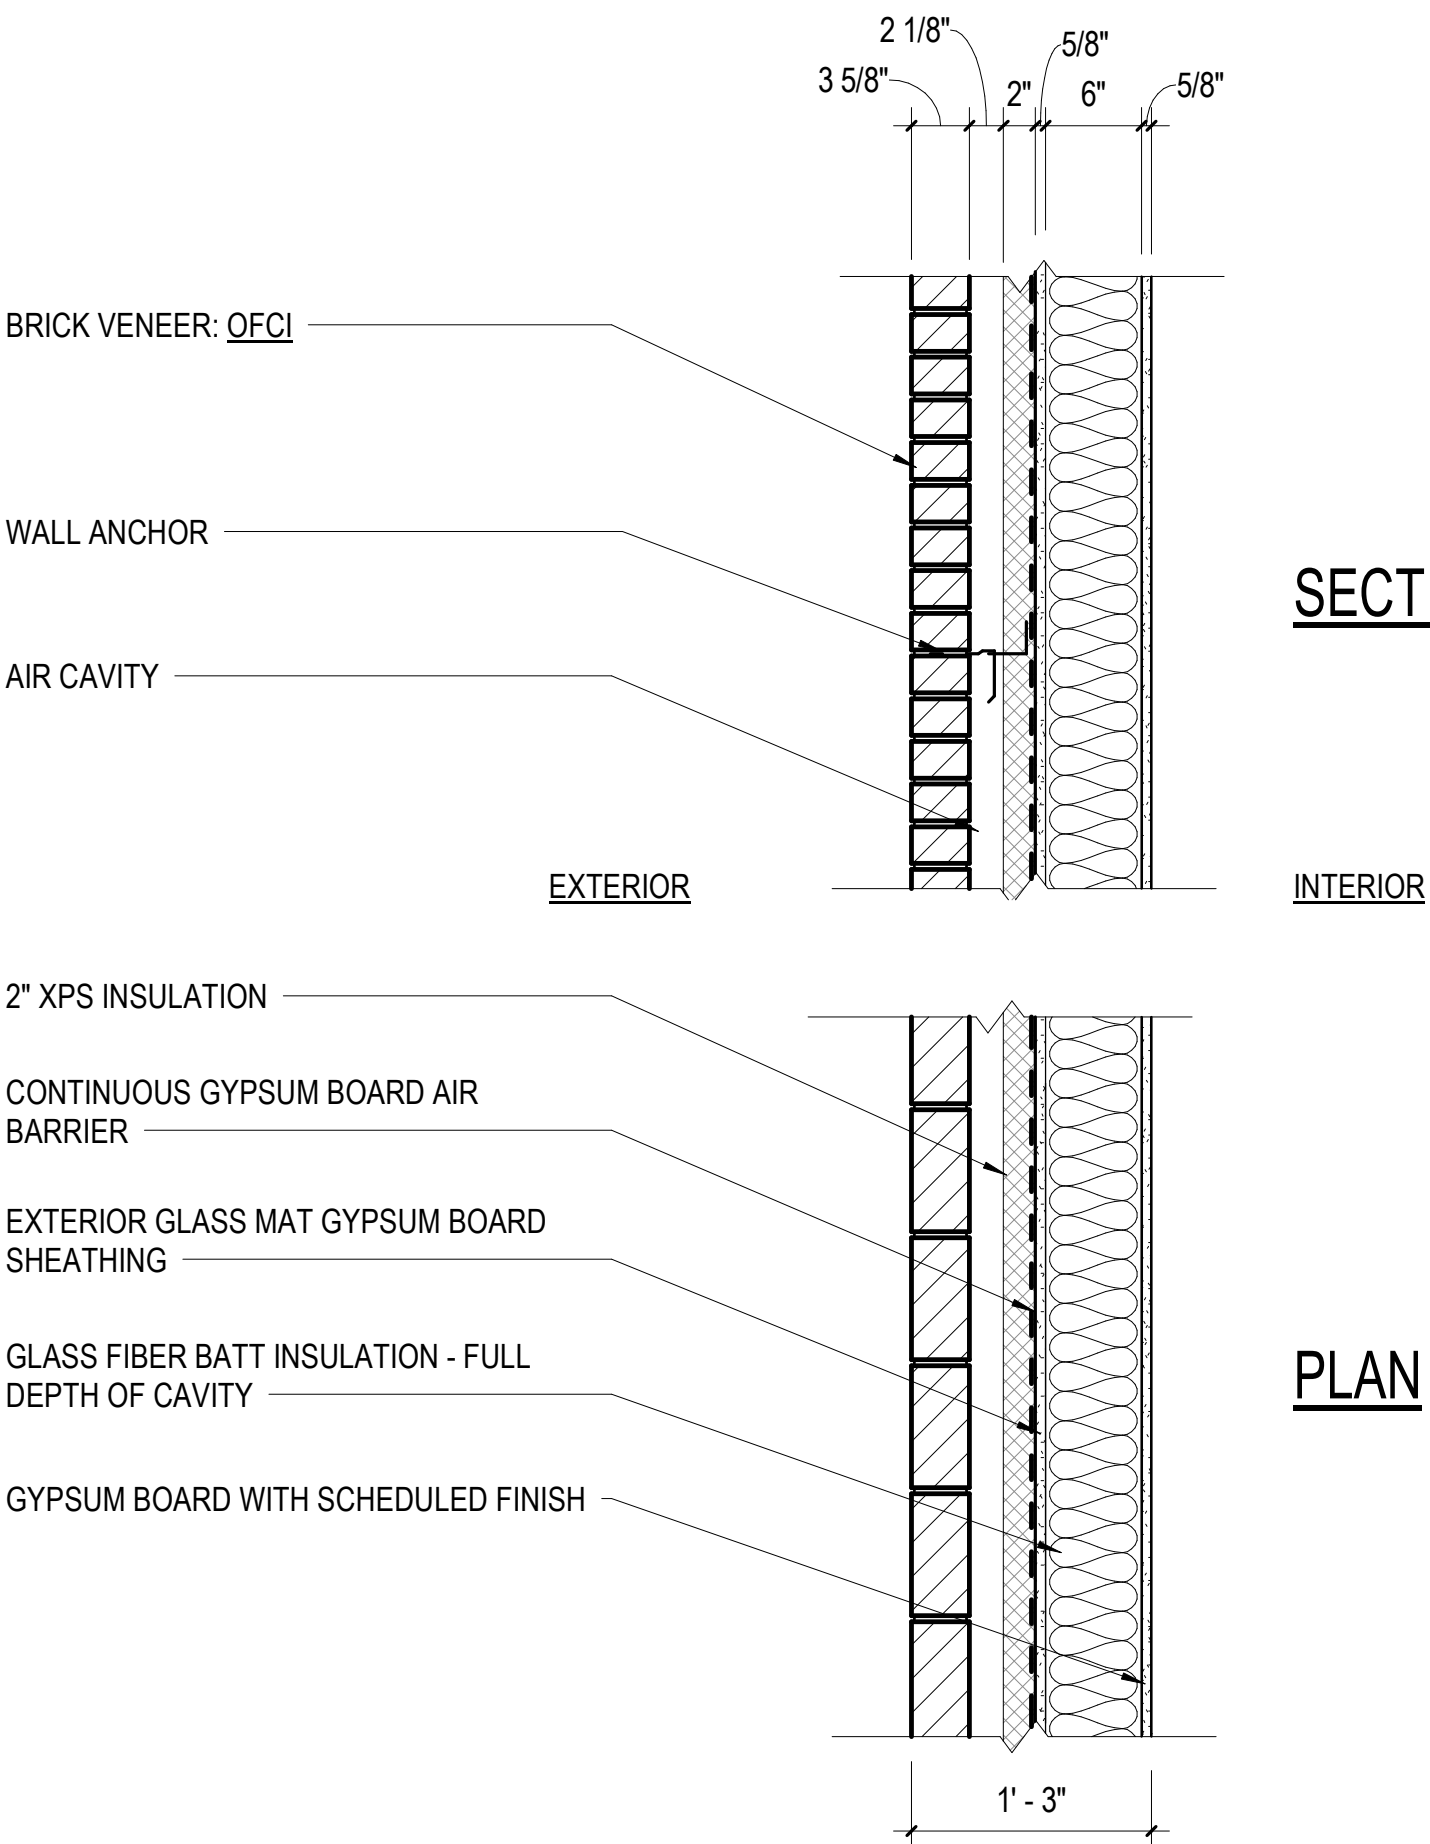


W2 WALL TYPE 2
1" = 1'-0"

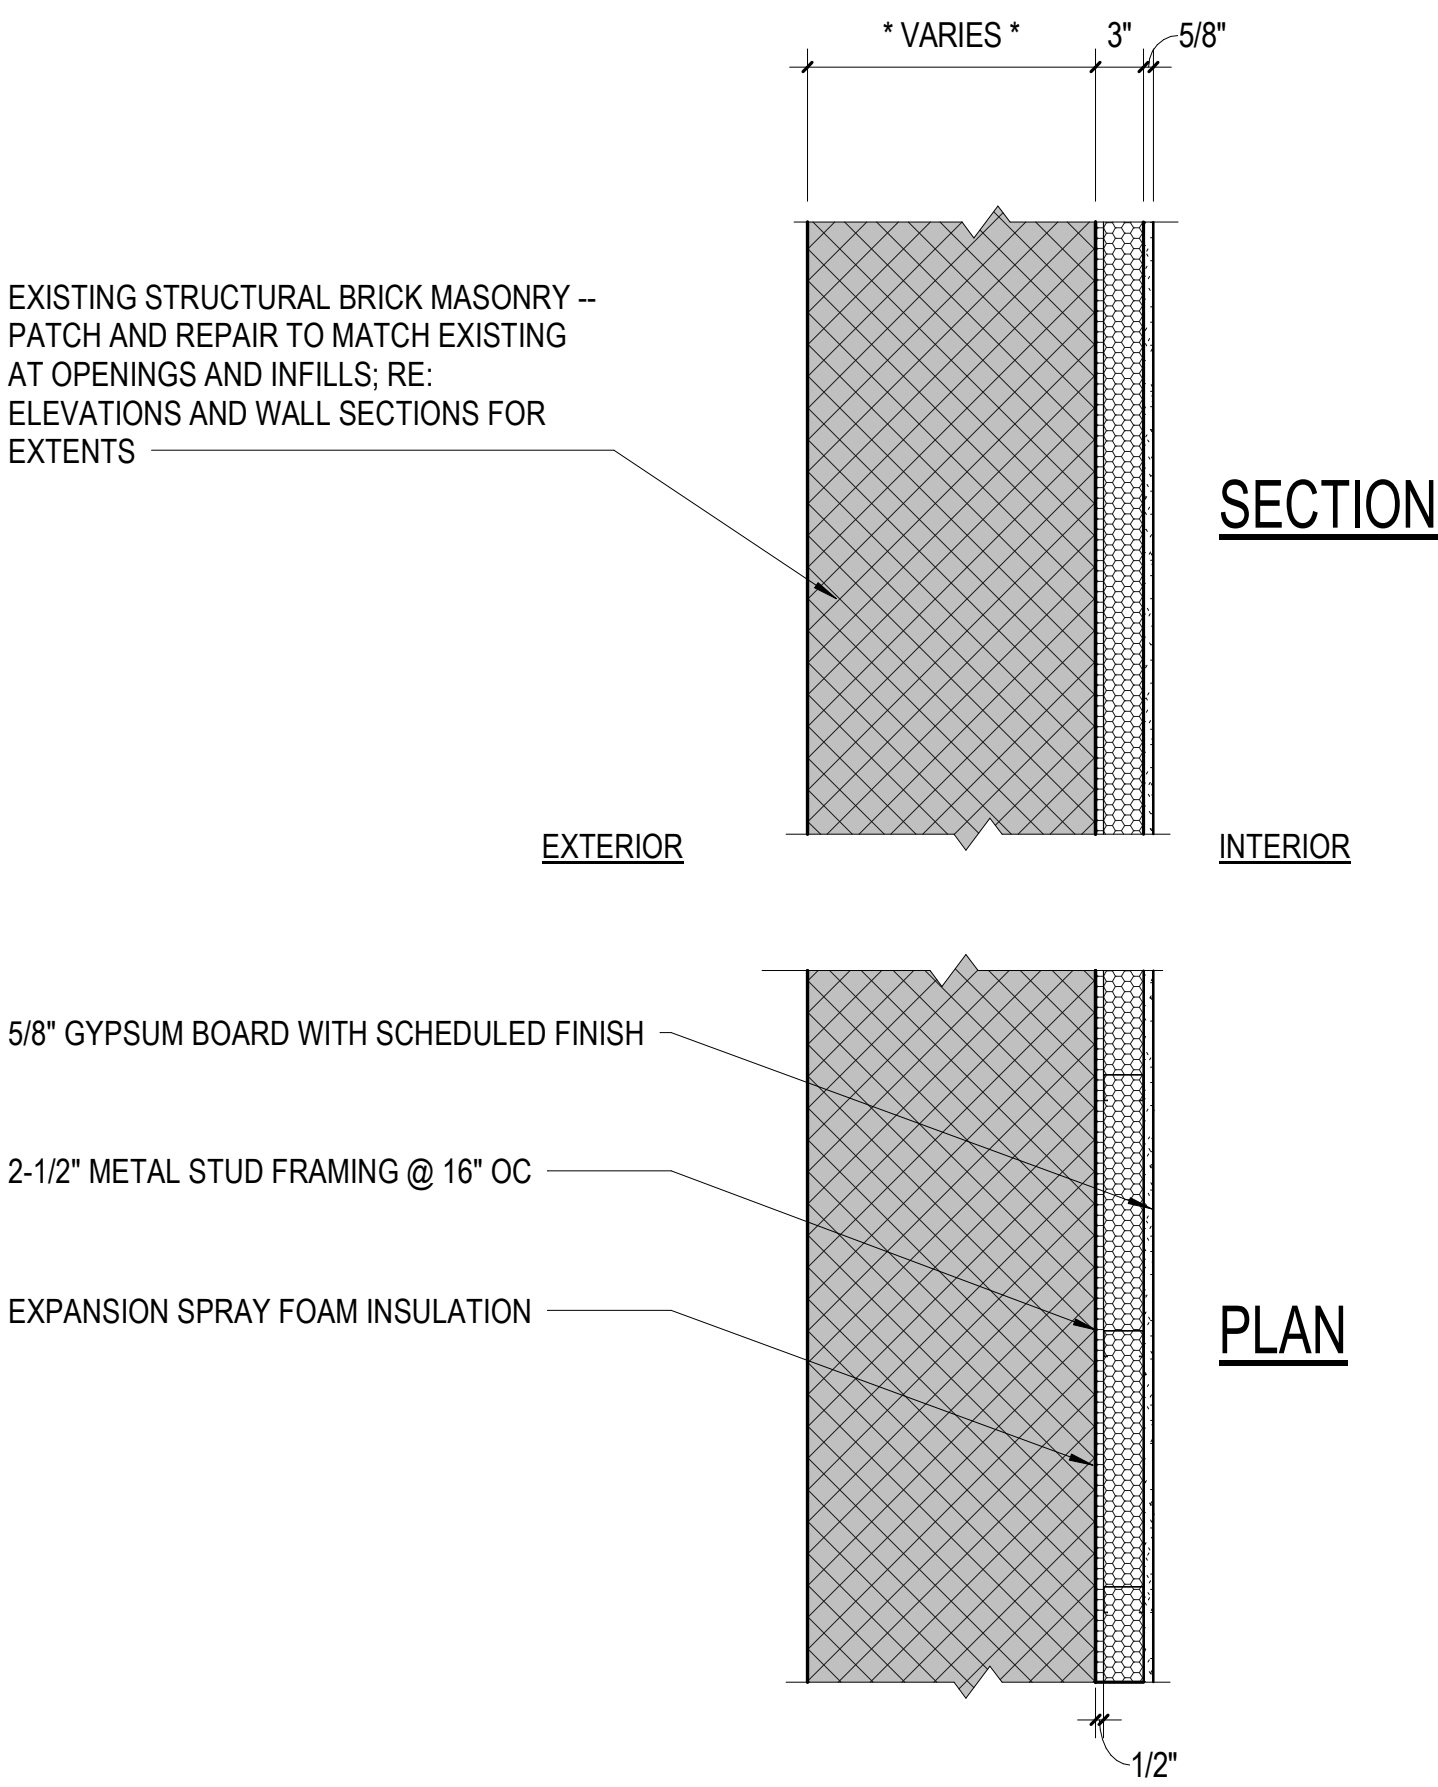


R3 ROOF TYPE 3
1" = 1'-0"

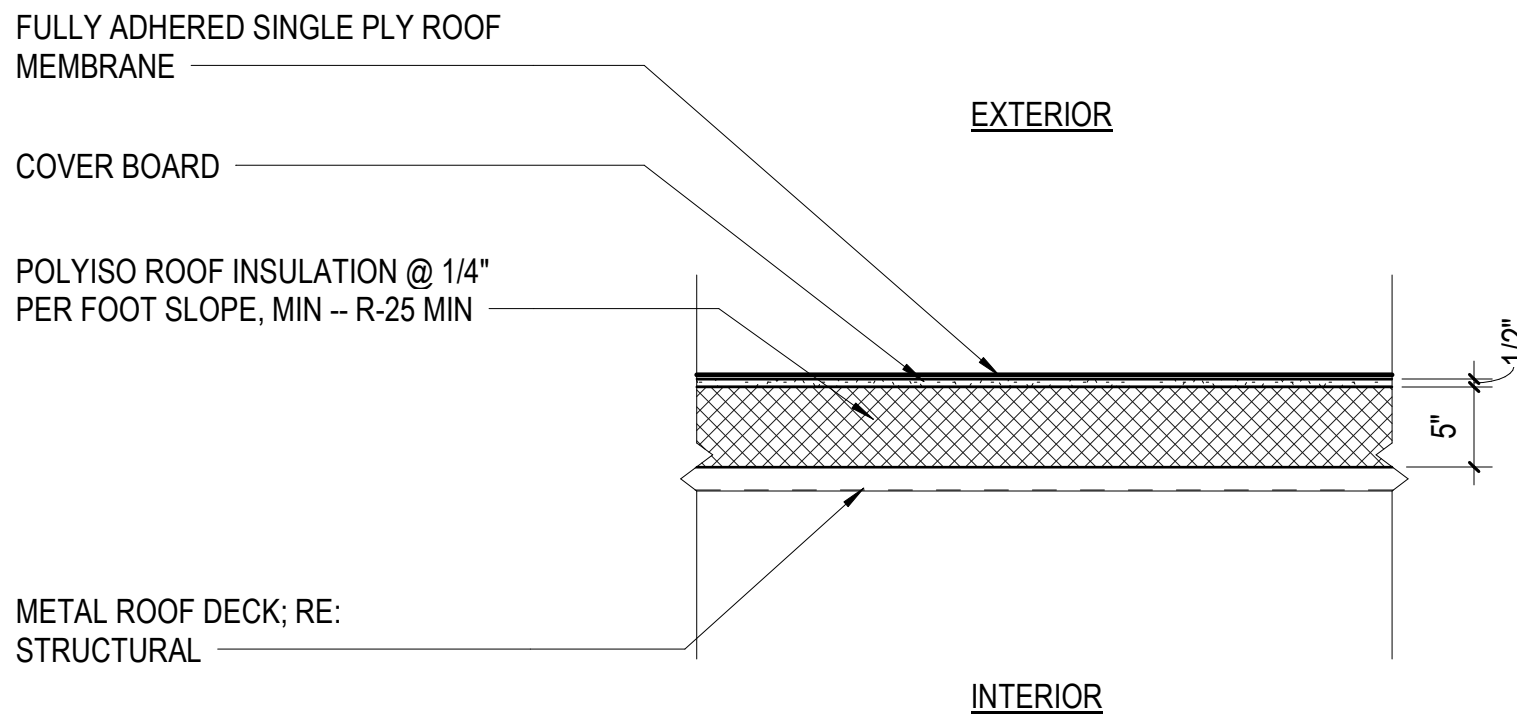

R2 ROOF TYPE 2
1" = 1'-0"

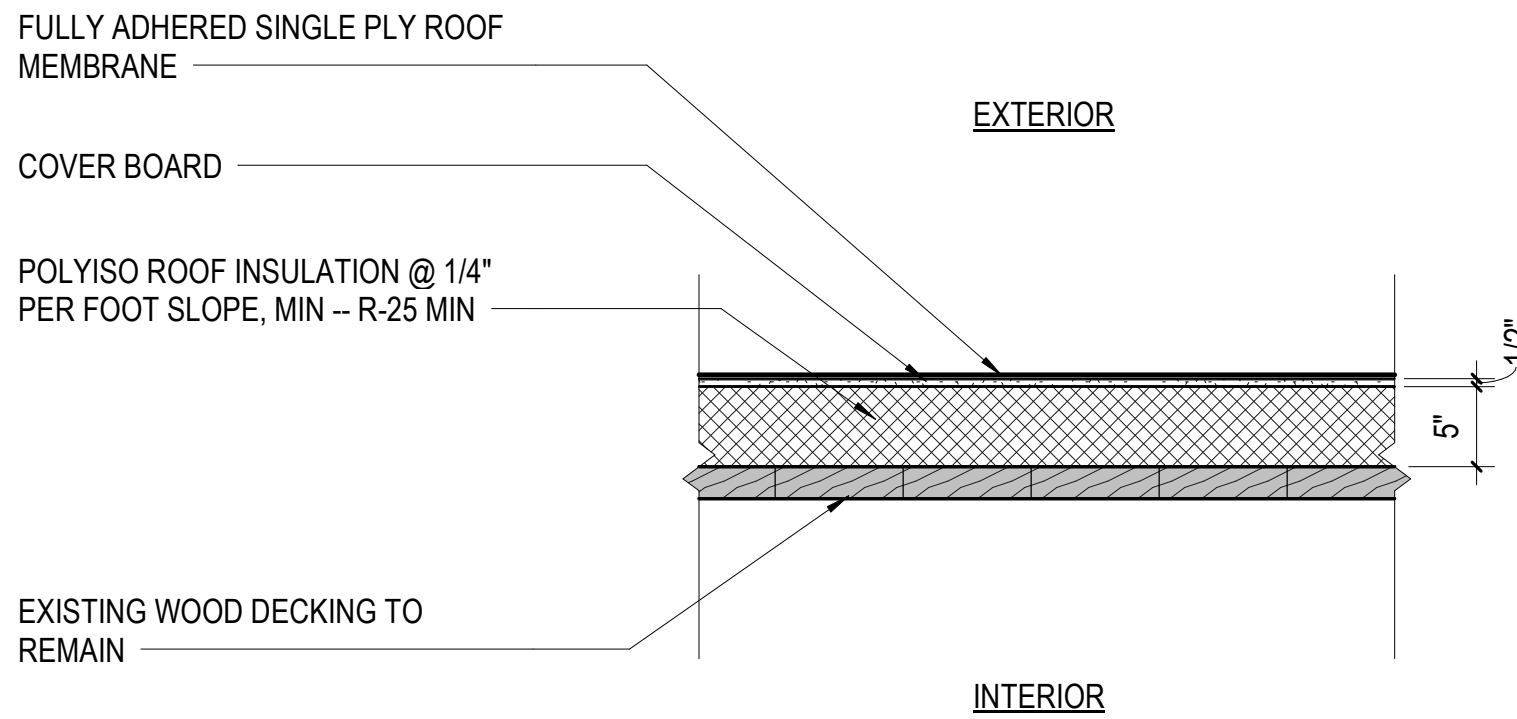

R1 ROOF TYPE 1
1" = 1'-0"

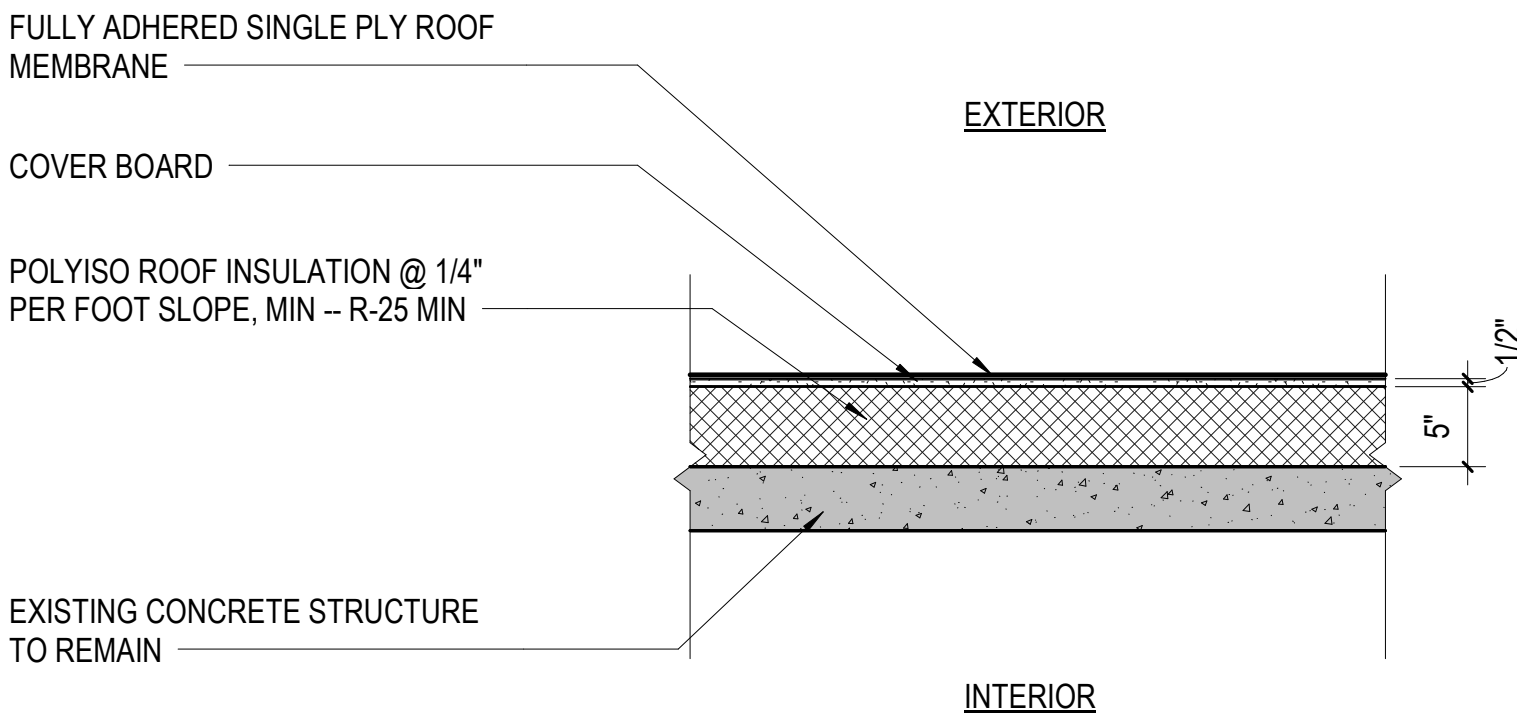

PROJECT STATUS

ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24

No.	Description	Date
-----	-------------	------

DRAWING TITLE

EXTERIOR BUILDING ASSEMBLIES

DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A2.00


McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE D - ADDITION AND RENOVATION

OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES


PROJECT ADDRESS:
DOING 202483
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

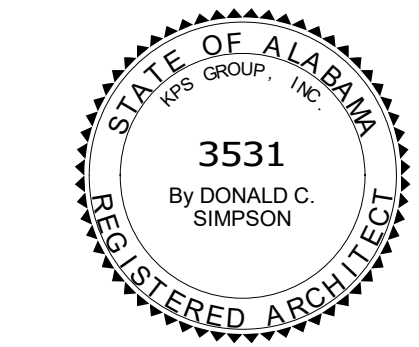


This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

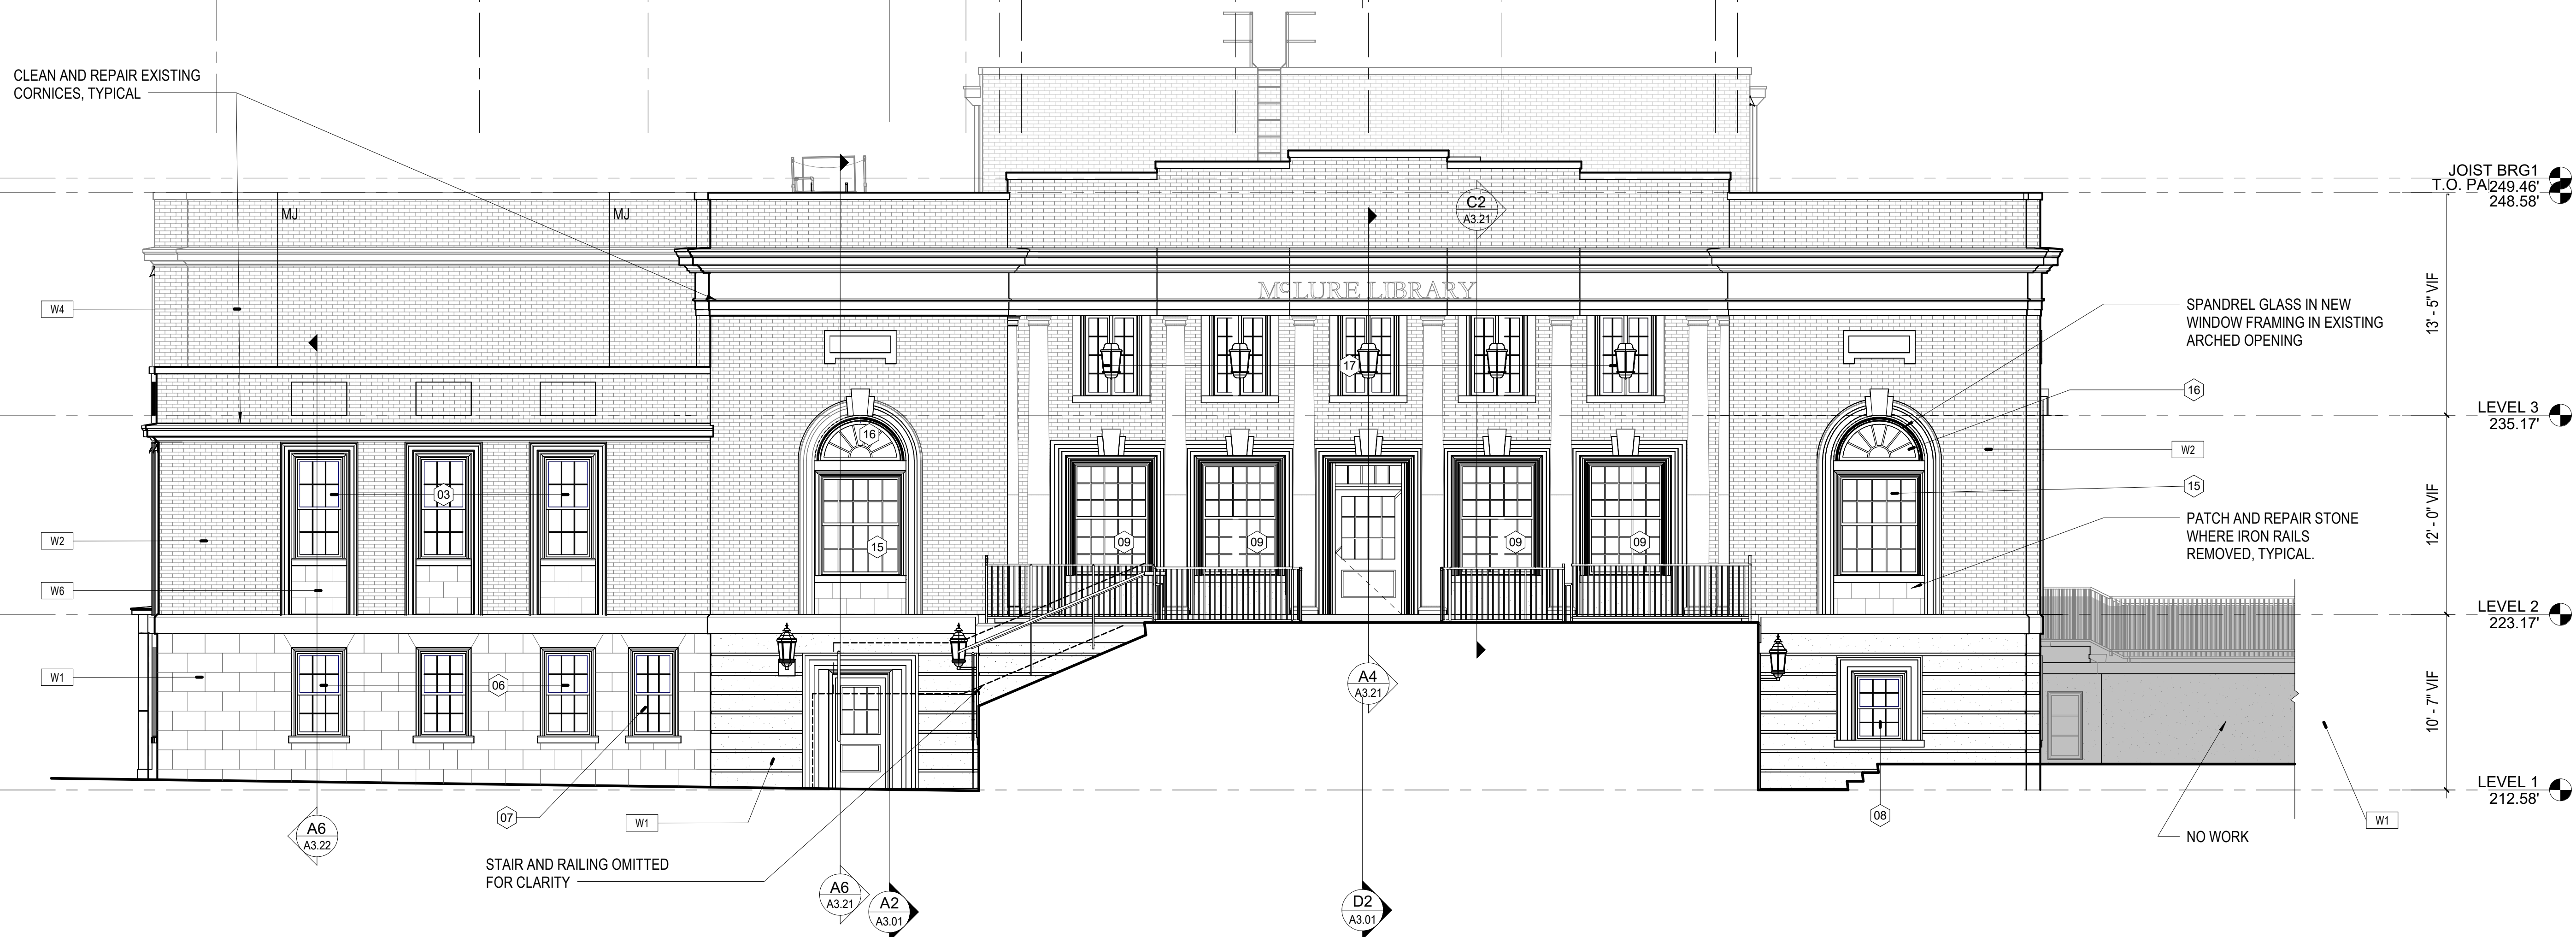

D2 BUILDING ELEVATION - SOUTH
3/16" = 1'-0"

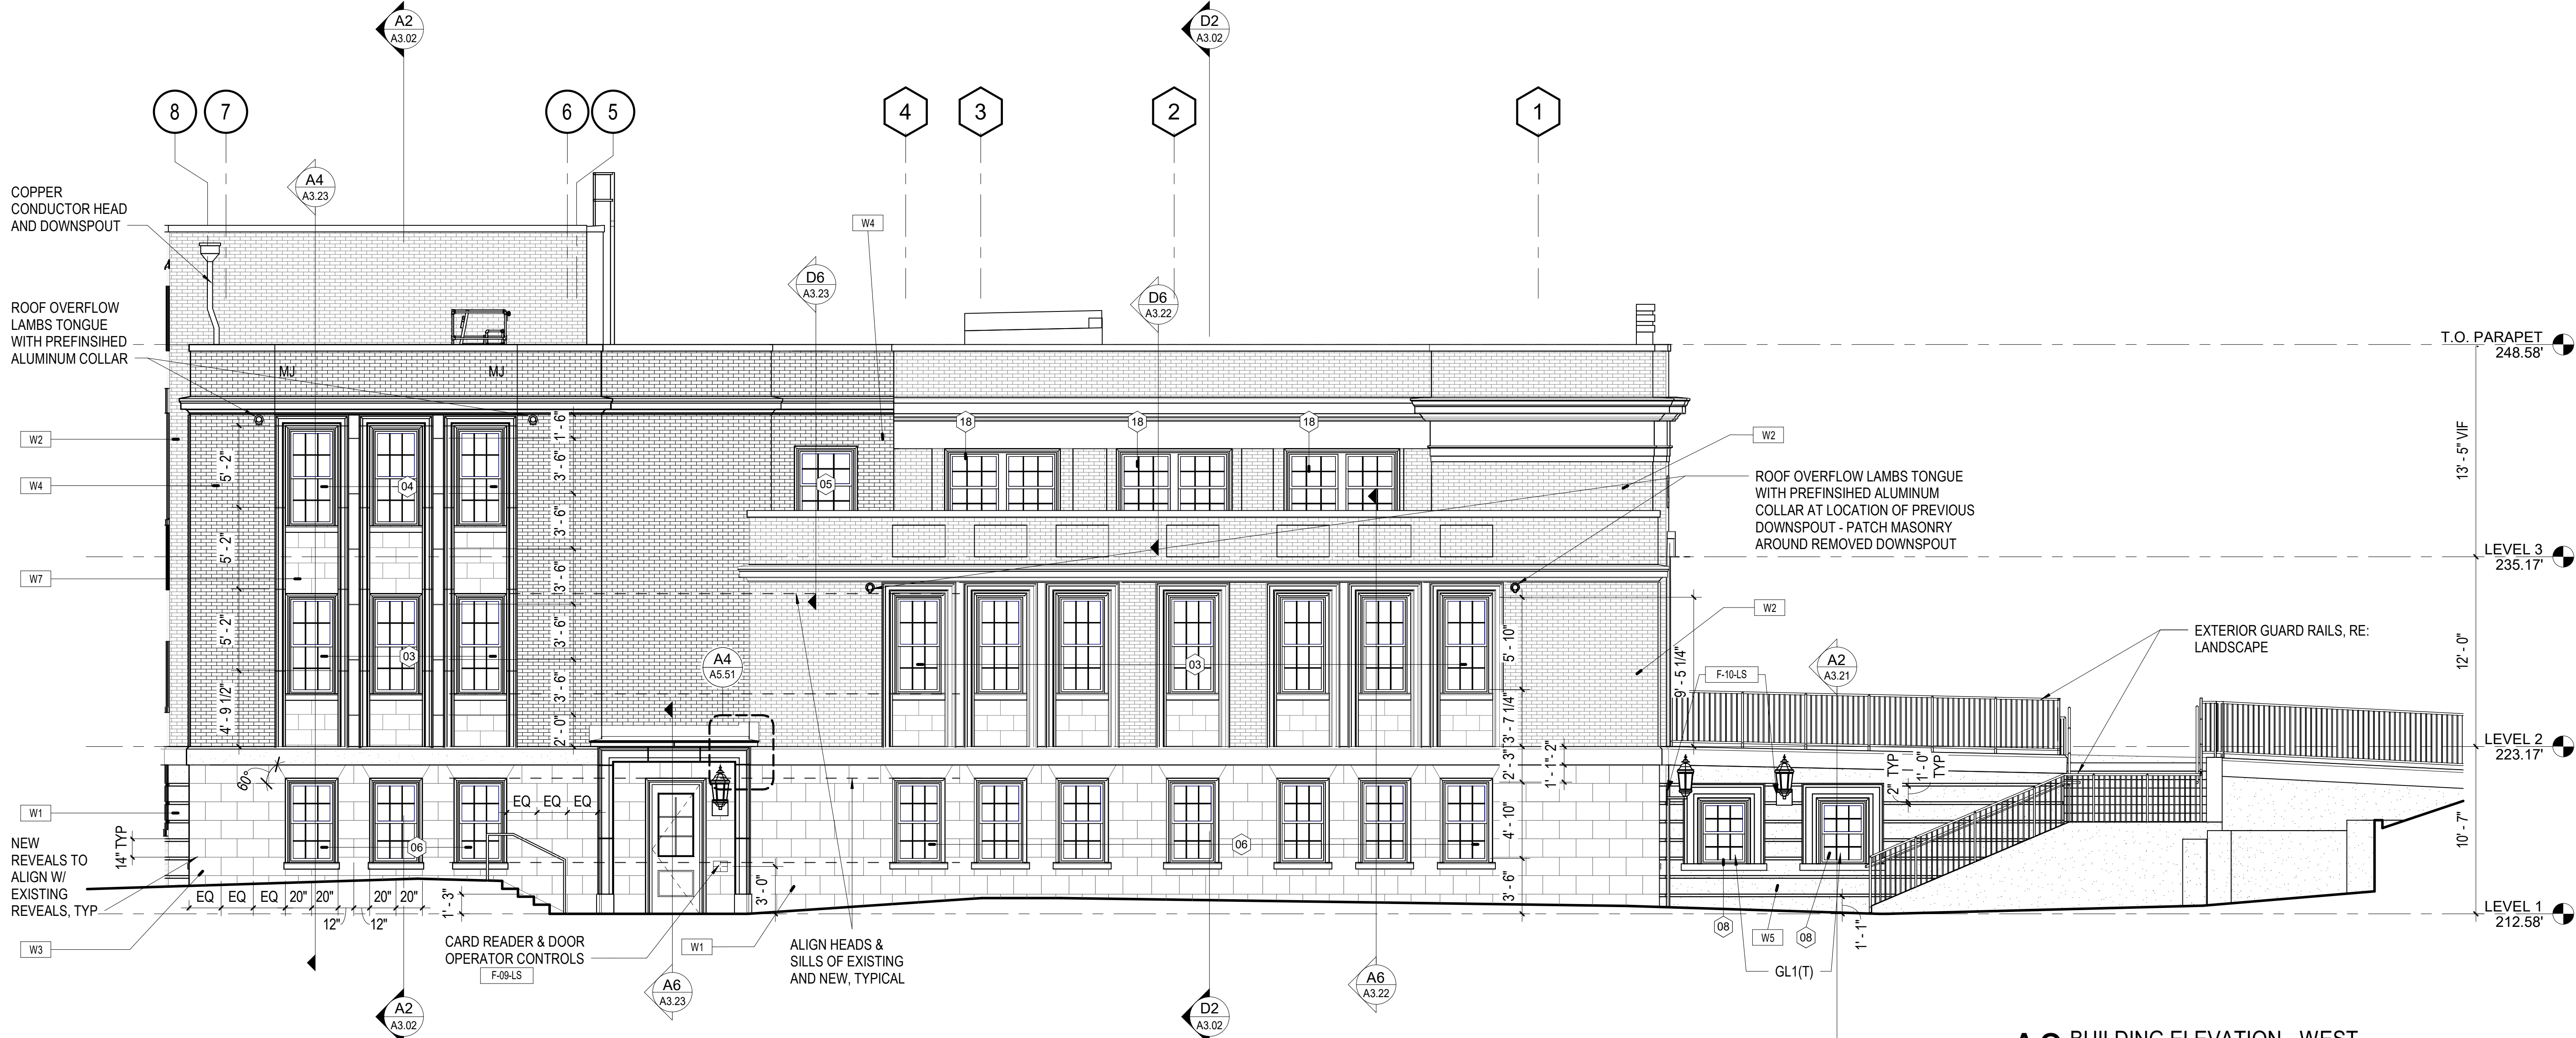

A2 BUILDING ELEVATION - WEST
3/16" = 1'-0"

EXTERIOR ELEVATION GENERAL NOTES

- MATERIAL SYMBOLS AND HATCHES ON ELEVATIONS ARE TO DISPLAY THE EXTENT OF THE MATERIAL ONLY. THEY ARE NOT TO SCALE.
- PROVIDE BRICK EXPANSION JOINTS PER THE AMERICAN BRICK INSTITUTE'S RECOMMENDATIONS.
- FLASHING, FASTENERS, MEMBRANE, TRANSITIONS & TERMINATION, ETC. SHALL COMPLY W/ APPROVED MANUFACTURER DETAILS, TYPICAL.
- EXISTING MASONRY WALLS TO RECEIVE CONTINUOUS SPRAY FOAM INSULATION ON INTERIOR FACE OF MASONRY TO ACHIEVE R-8, MINIMUM.
- THERMAL ENVELOPE INSULATION FOR NEW COMPONENTS (ASHRAE 90.1-2013 & IECC 2015):
 - ROOFS: INSULATION ENTIRELY ABOVE ROOF DECK: R-25CI MIN
 - WALLS ABOVE GRADE, METAL FRAMED: R-13 + R-7.6CI MIN
 - FIXED PENETRATION: MAX U-FACTOR = 0.46
 - ENTRANCE DOORS: MAX U-FACTOR = 0.77
- CLEAN EXISTING STUCCO WALLS AND RECAULK JOINTS, TYPICAL.
- CLEAN EXISTING BRICK, TYPICAL.
- CLEAN EXISTING LIMESTONE SILLS, TYPICAL.
- CLEAN AND REPAIR EXISTING CORNICES AND COPING, TYPICAL. REFER TO DETAILS.
- INFILL DEMOLISHED WINDOW OPENINGS. PATCH TO MATCH EXISTING MASONRY AND STUCCO.

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION.
RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
 - RE: SHEET A7.11 FOR WINDOW SCHEDULE
- W1 WALL TYPE 1:
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2 WALL TYPE 2:
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3 WALL TYPE 3:
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4 WALL TYPE 4:
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- W5 WALL TYPE 5:
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6 WALL TYPE 6:
EXISTING STONE PANEL (CLEAN AND RE-JOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7 WALL TYPE 7:
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT SHEATHING / 6" COLD FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL


- 1 EXTERIOR GLAZED OPENING TYPE -- RE: SHEET A7.11
- MJ MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR
- R1 ROOF TYPE 1:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2 ROOF TYPE 2:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3 ROOF TYPE 3:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

K|P|S

GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

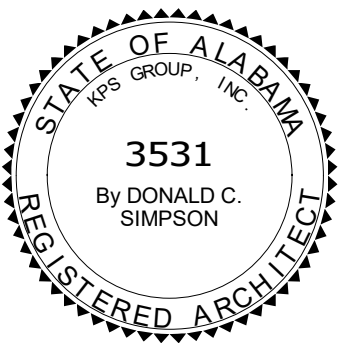

McLURE LIBRARY ADDITION AND RENOVATION


PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES


PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
BUILDING ELEVATIONS		
DRAWN BY: Author		
CHECKED BY: Checker		
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A2.01		

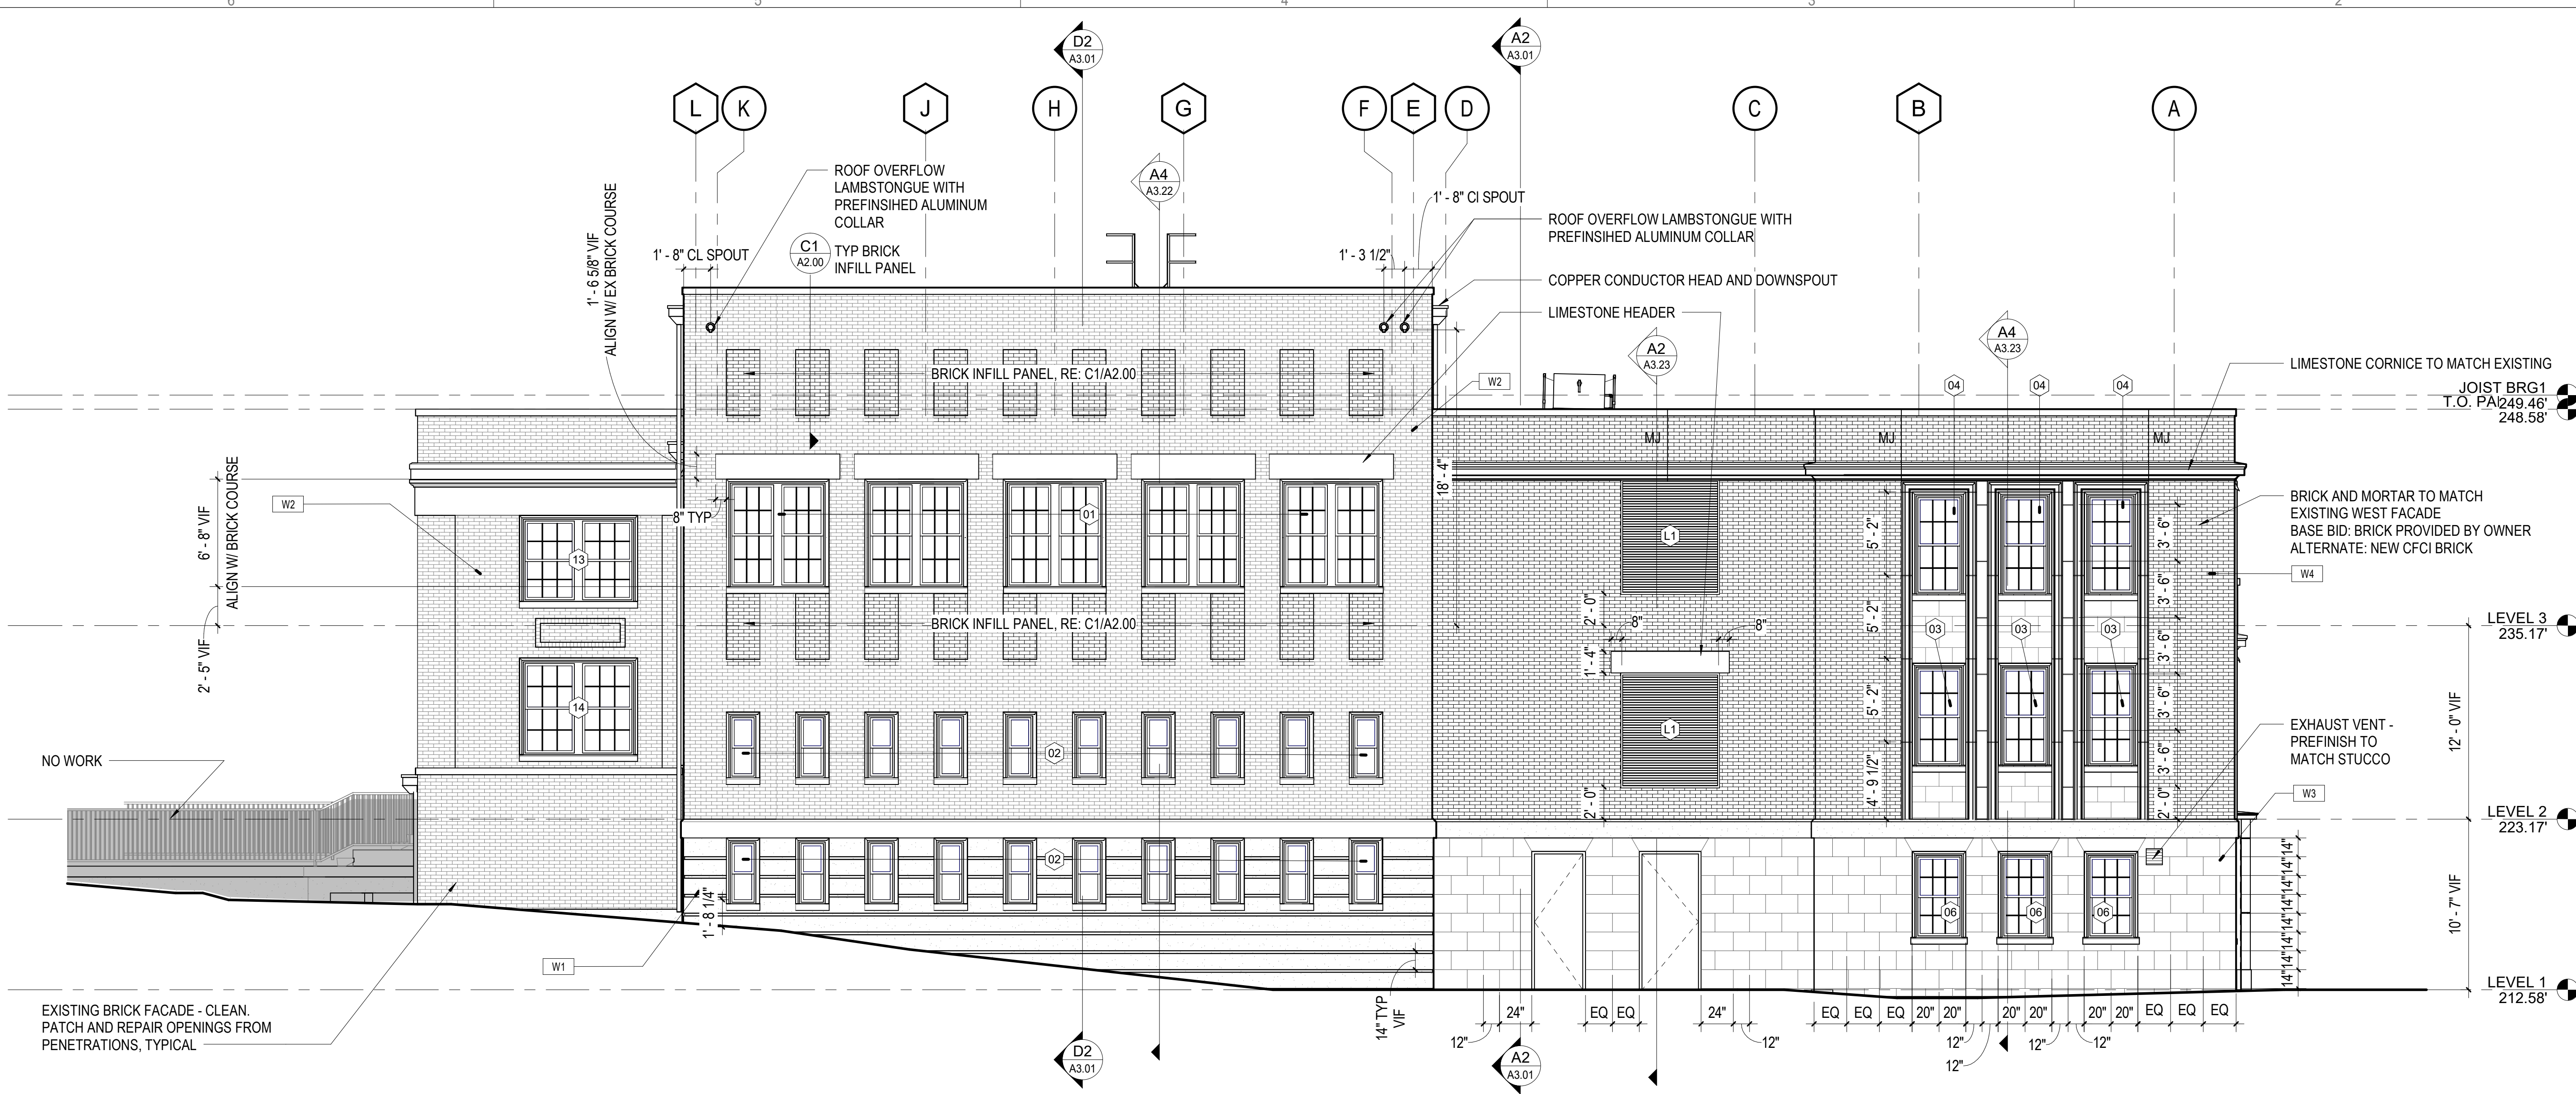

D2 BUILDING ELEVATION - NORTH
3/16" = 1'-0"

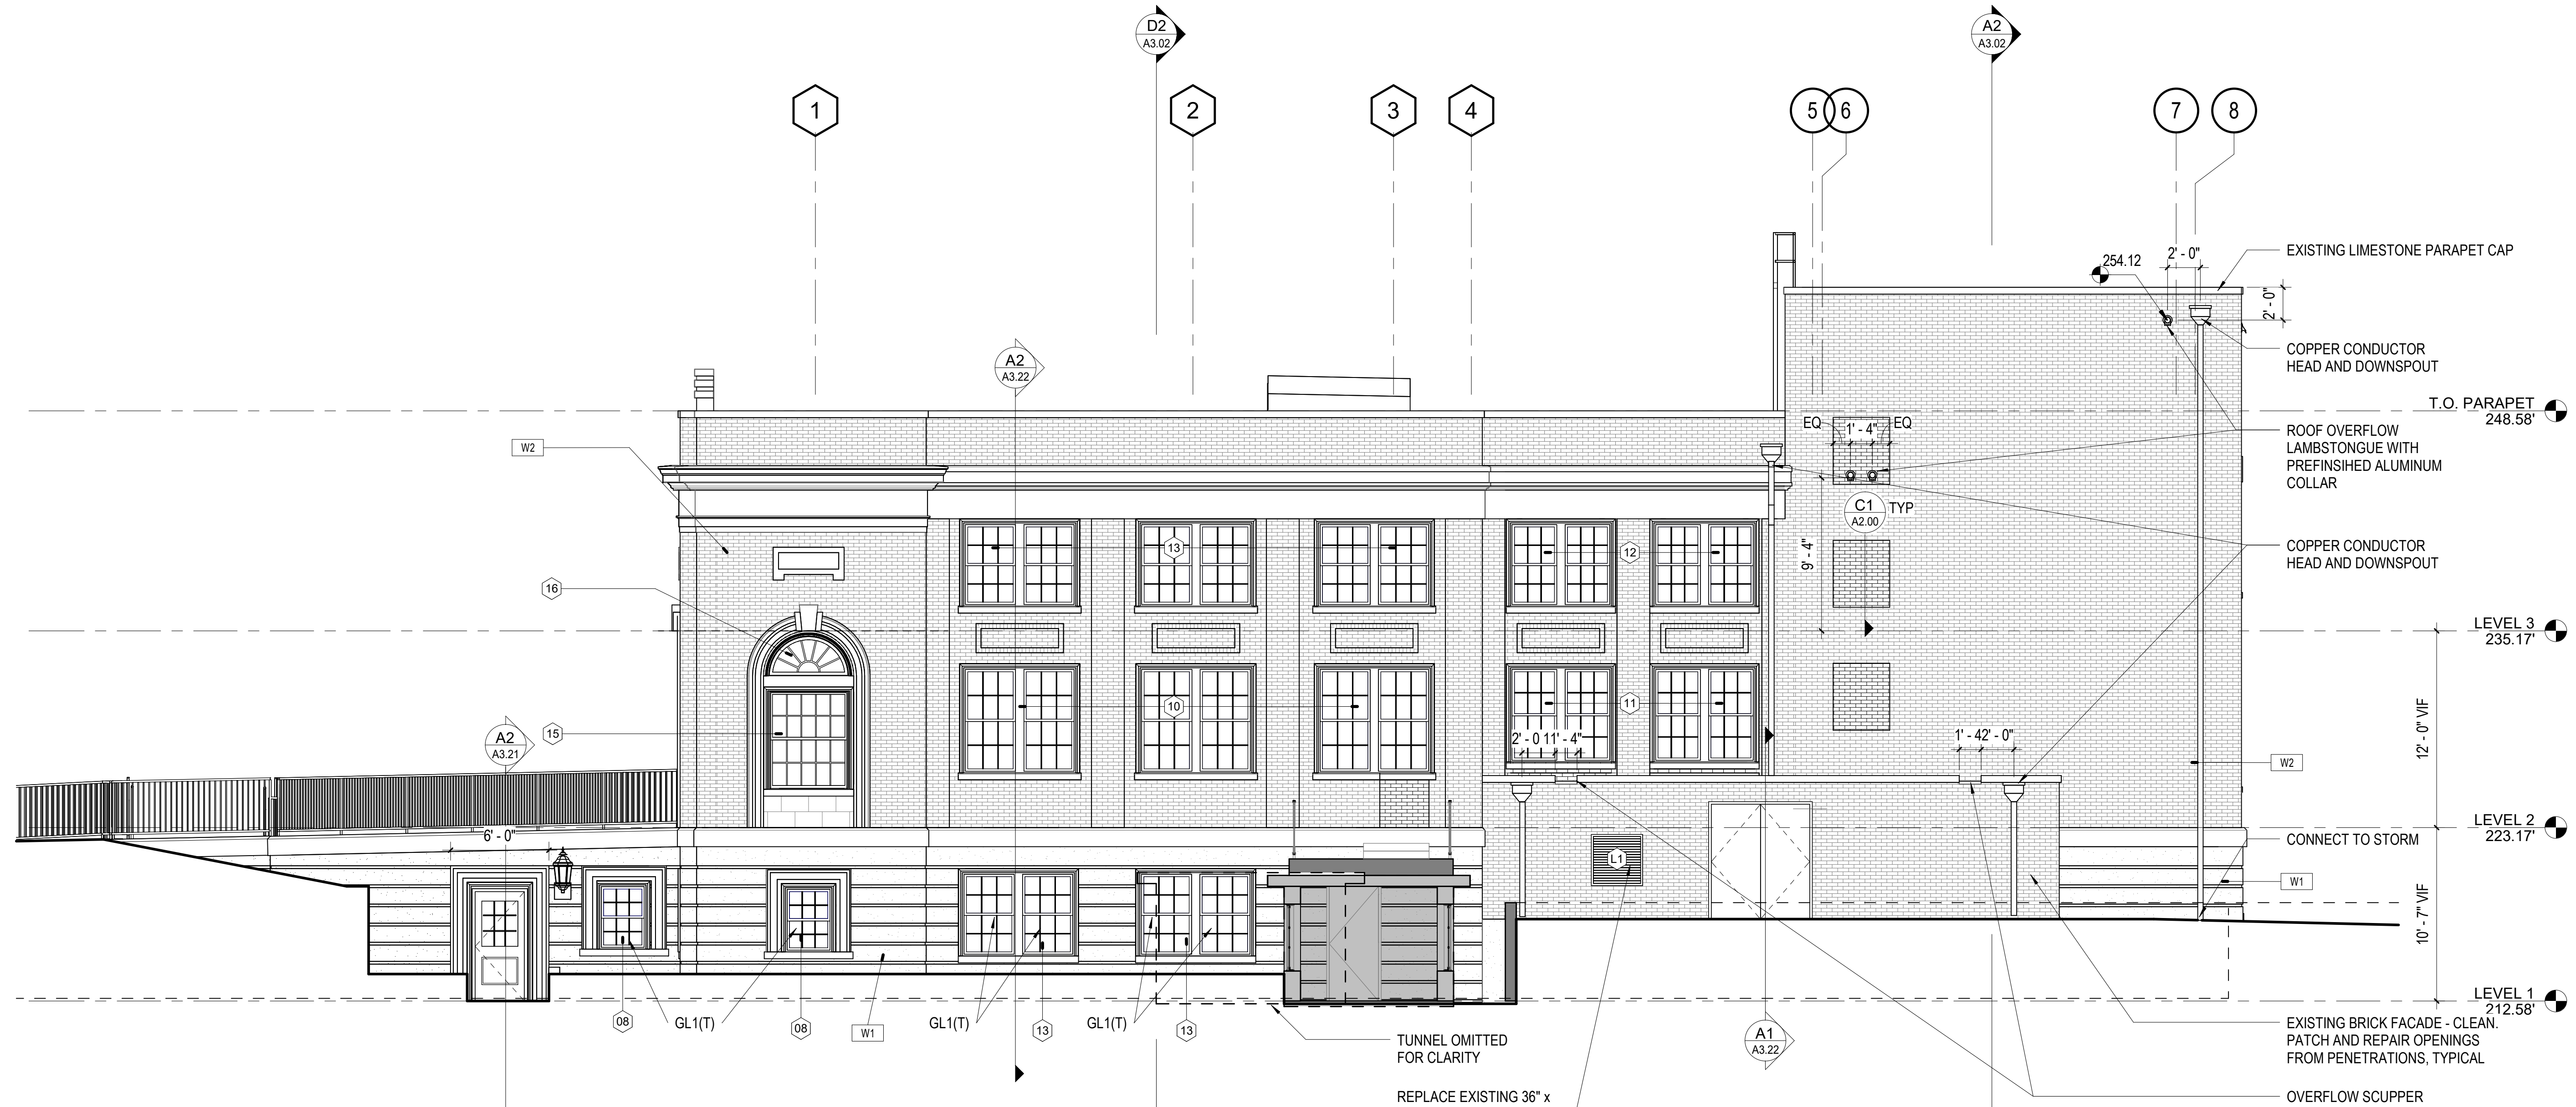

A2 BUILDING ELEVATION - EAST
3/16" = 1'-0"

EXTERIOR ELEVATION GENERAL NOTES


- MATERIAL SYMBOLS AND HATCHES ON ELEVATIONS ARE TO DISPLAY THE EXTENT OF THE MATERIAL ONLY. THEY ARE NOT TO SCALE.
- PROVIDE BRICK EXPANSION JOINTS PER THE AMERICAN BRICK INSTITUTE'S RECOMMENDATIONS.
- FLASHING, FASTENERS, MEMBRANE, TRANSITIONS & TERMINATION, ETC. SHALL COMPLY W/ APPROVED MANUFACTURER DETAILS. TYPICAL.
- EXISTING MASONRY WALLS TO RECEIVE CONTINUOUS SPRAY FOAM INSULATION ON INTERIOR FACE OF MASONRY TO ACHIEVE R-8, MINIMUM.
- THERMAL ENVELOPE INSULATION FOR NEW COMPONENTS (ASHRAE 90.1-2013 & IECC 2015):
 - ROOFS: INSULATION ENTIRELY ABOVE ROOF DECK: R-25CI MIN
 - WALLS ABOVE GRADE: METAL FRAMED: R-13 + R-7.6CI MIN
 - FIXED FENESTRATION: MAX U-FACTOR = 0.46
 - ENTRANCE DOORS: MAX U-FACTOR = 0.77
- CLEAN EXISTING STUCCO WALLS AND RECAULK JOINTS. TYPICAL.
- CLEAN EXISTING BRICK. TYPICAL.
- CLEAN EXISTING LIMESTONE SILLS. TYPICAL.
- CLEAN AND REPAIR EXISTING CORNICES AND COPING. TYPICAL. REFER TO DETAILS.
- INFILL DEMOLISHED WINDOW OPENINGS. PATCH TO MATCH EXISTING MASONRY AND STUCCO.

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION. RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
- RE: SHEET A7.11 FOR WINDOW SCHEDULE

- W1** WALL TYPE 1:
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2** WALL TYPE 2:
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3** WALL TYPE 3:
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS. TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4** WALL TYPE 4:
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS. TYPICAL
- W5** WALL TYPE 5:
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6** WALL TYPE 6:
EXISTING STONE PANEL (CLEAN AND RE-JOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7** WALL TYPE 7:
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT SHEATHING / 6" COLD FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS. TYPICAL

- 1** EXTERIOR GLAZED OPENING TYPE -- RE: SHEET A7.11
- MJ** MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR
- R1** ROOF TYPE 1:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2** ROOF TYPE 2:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3** ROOF TYPE 3:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

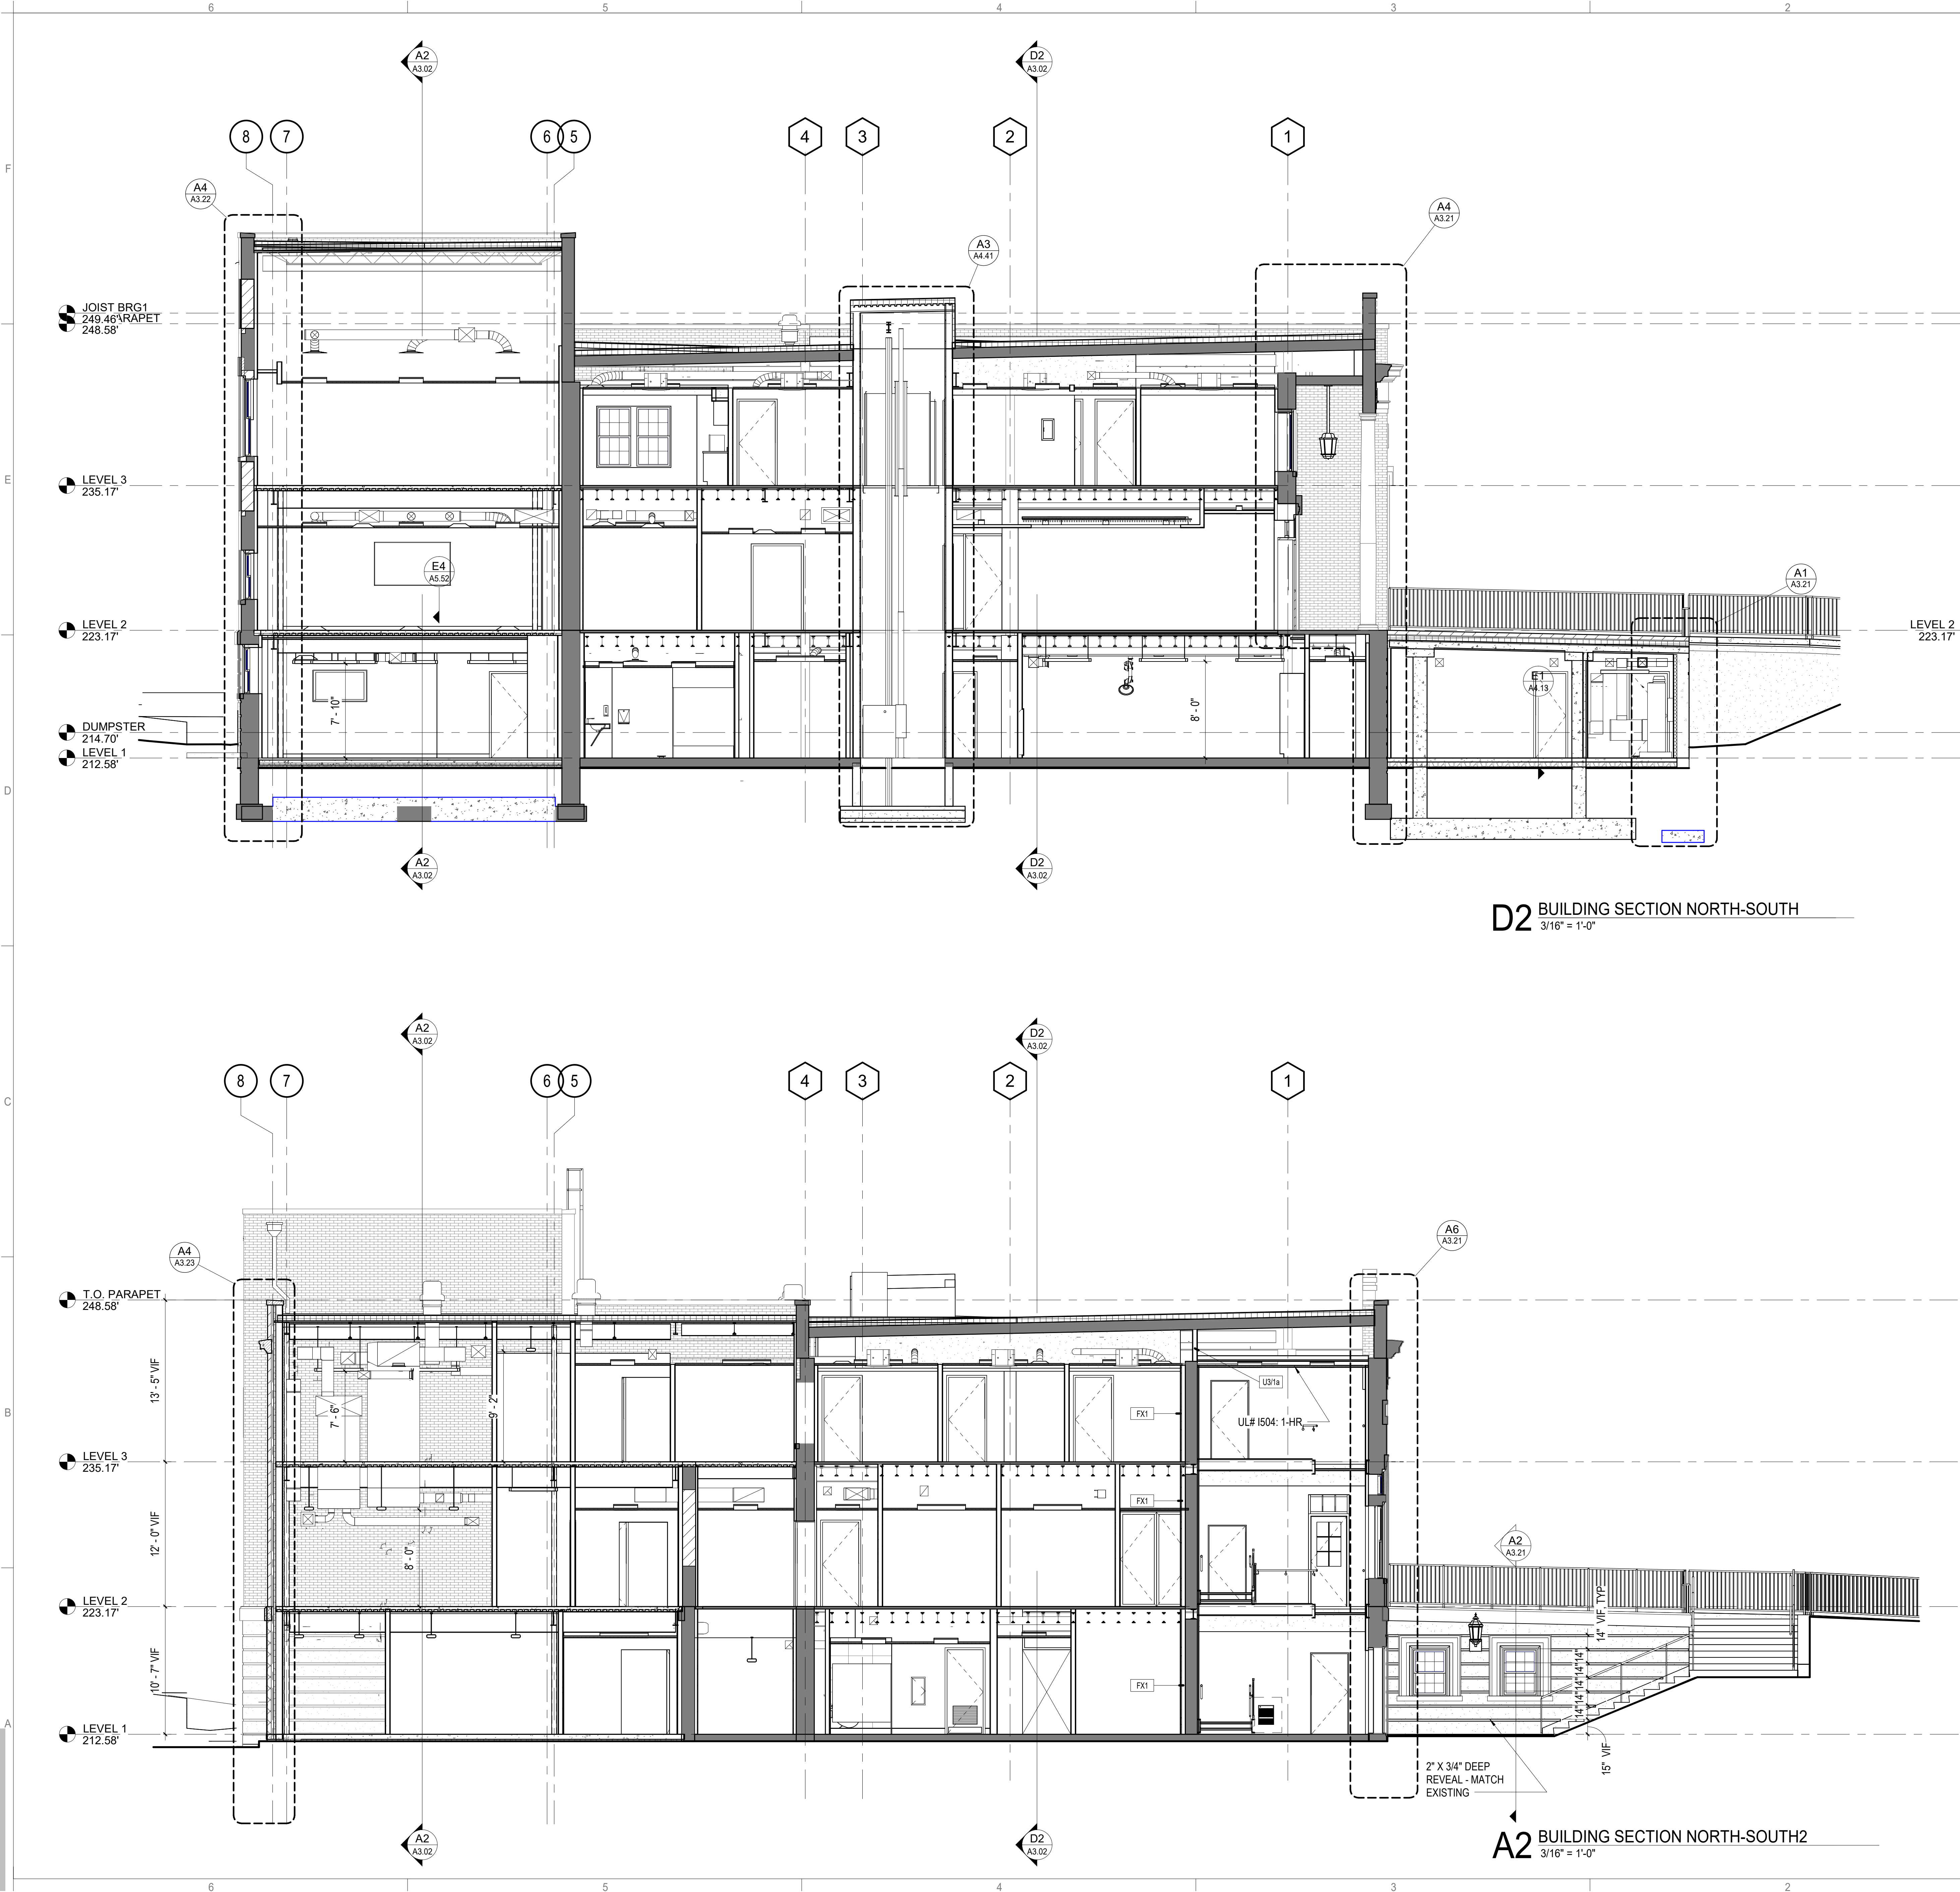

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION.
RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
 - RE: SHEET A7.11 FOR WINDOW SCHEDULE
- W1** WALL TYPE 1:
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2** WALL TYPE 2:
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3** WALL TYPE 3:
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4** WALL TYPE 4:
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- W5** WALL TYPE 5:
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6** WALL TYPE 6:
EXISTING STONE PANEL (CLEAN AND REJOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7** WALL TYPE 7:
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT SHEATHING / 6" COLD FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- 1** EXTERIOR GLAZED OPENING TYPE - RE: SHEET A7.11
- MJ** MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR
- R1** ROOF TYPE 1:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2** ROOF TYPE 2:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3** ROOF TYPE 3:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
3531
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOING 2024B3
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------


DRAWING TITLE
BUILDING SECTIONS

DRAWN BY: Author


CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A3.01

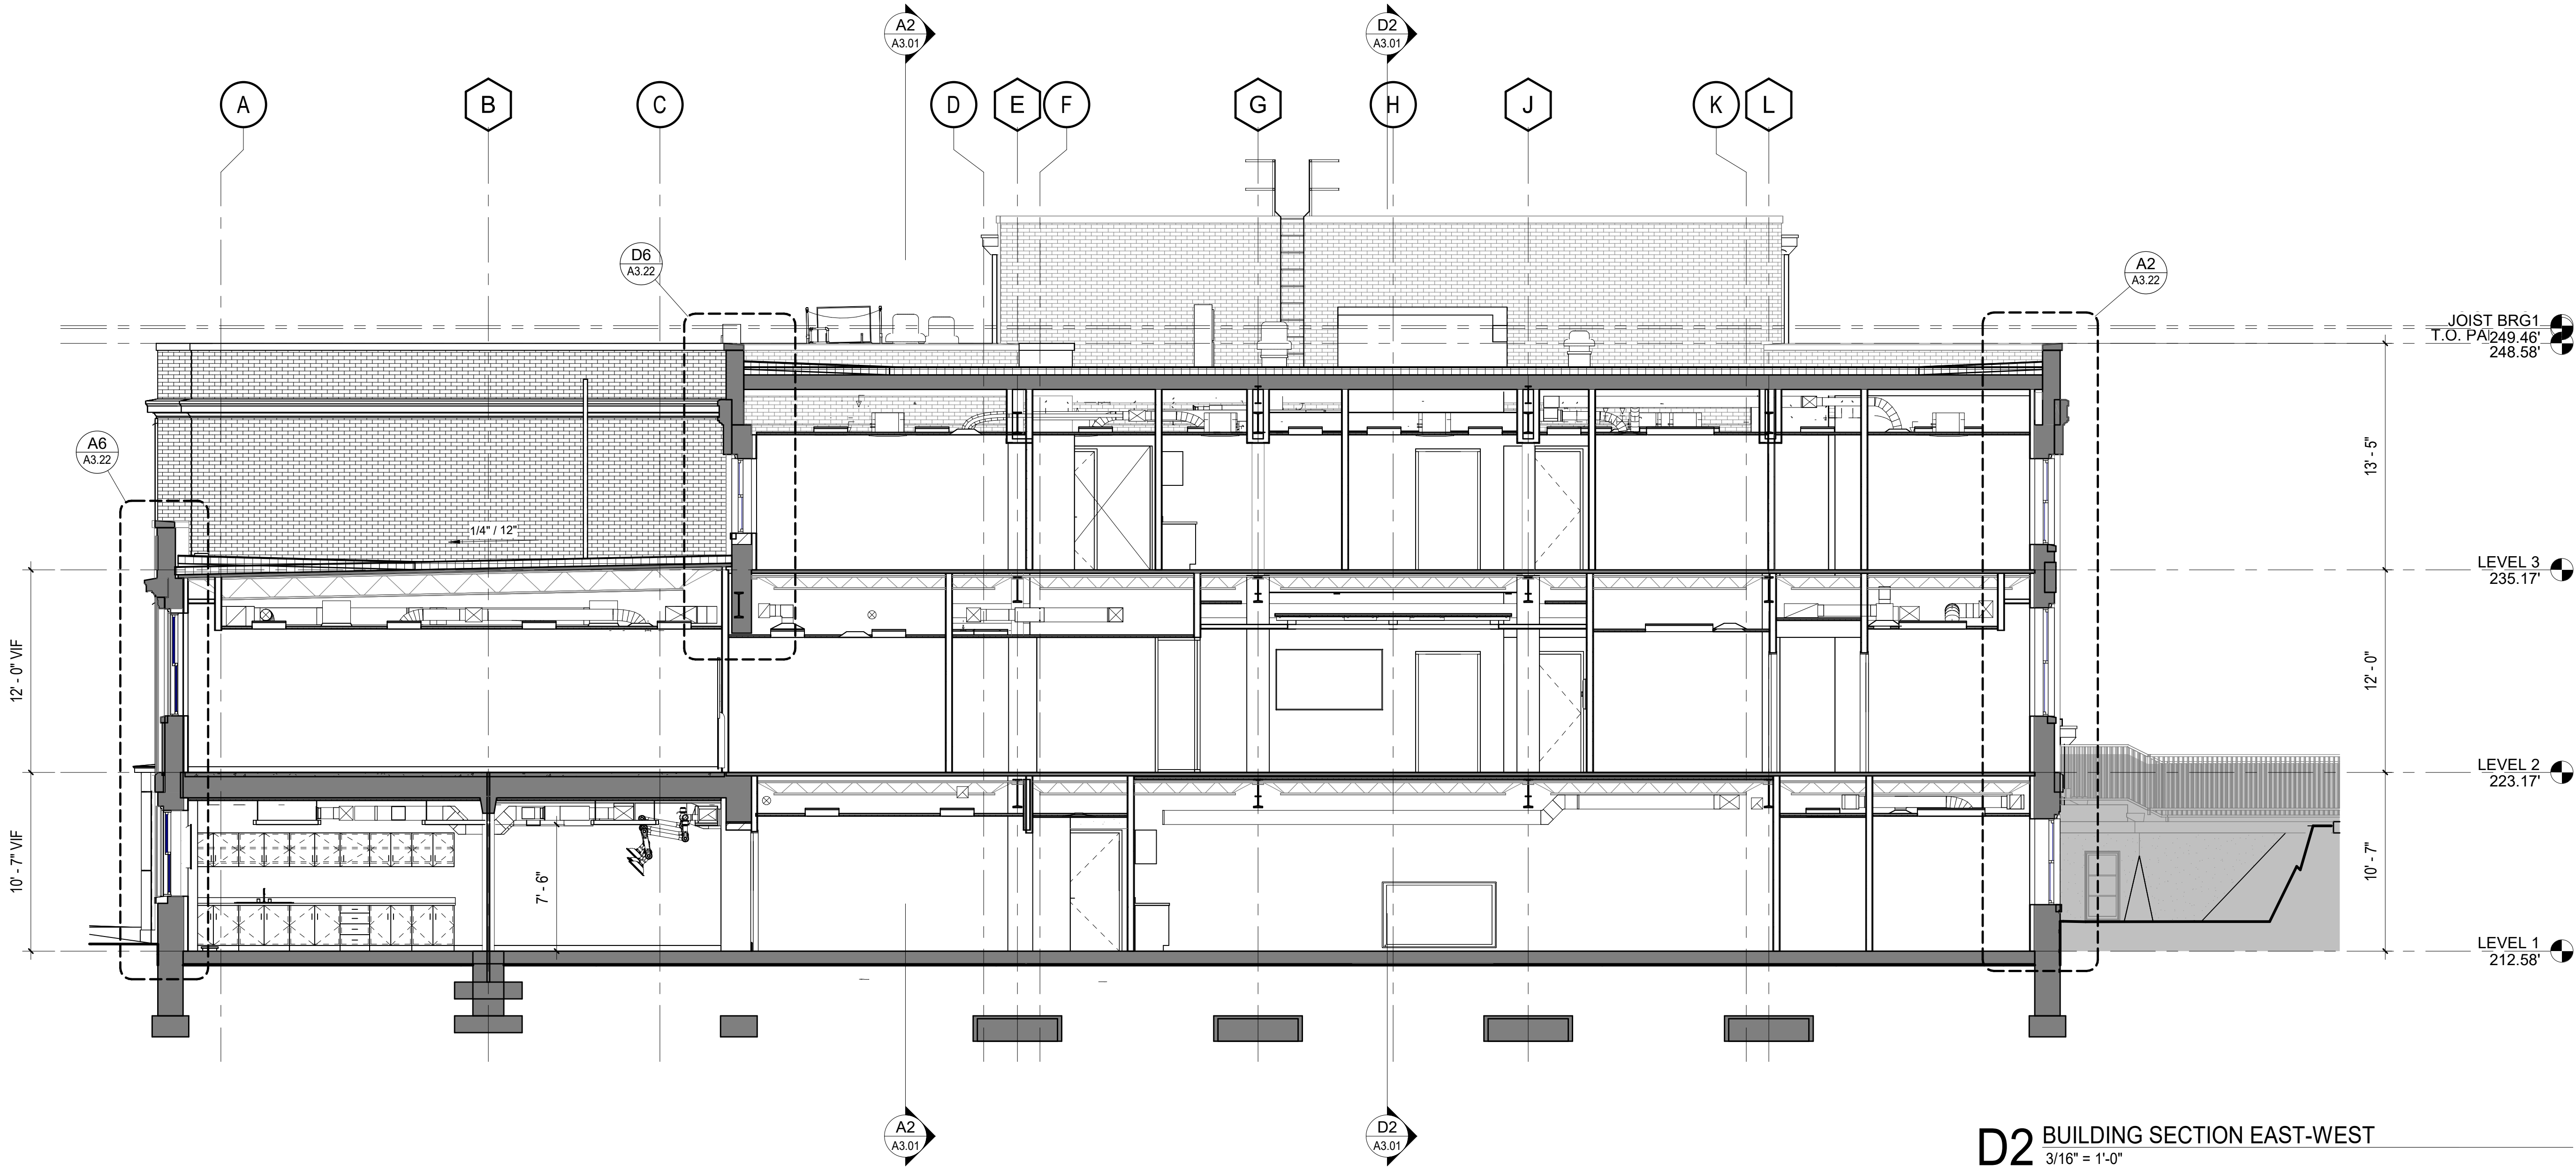

D2 BUILDING SECTION EAST-WEST
3/16" = 1'-0"

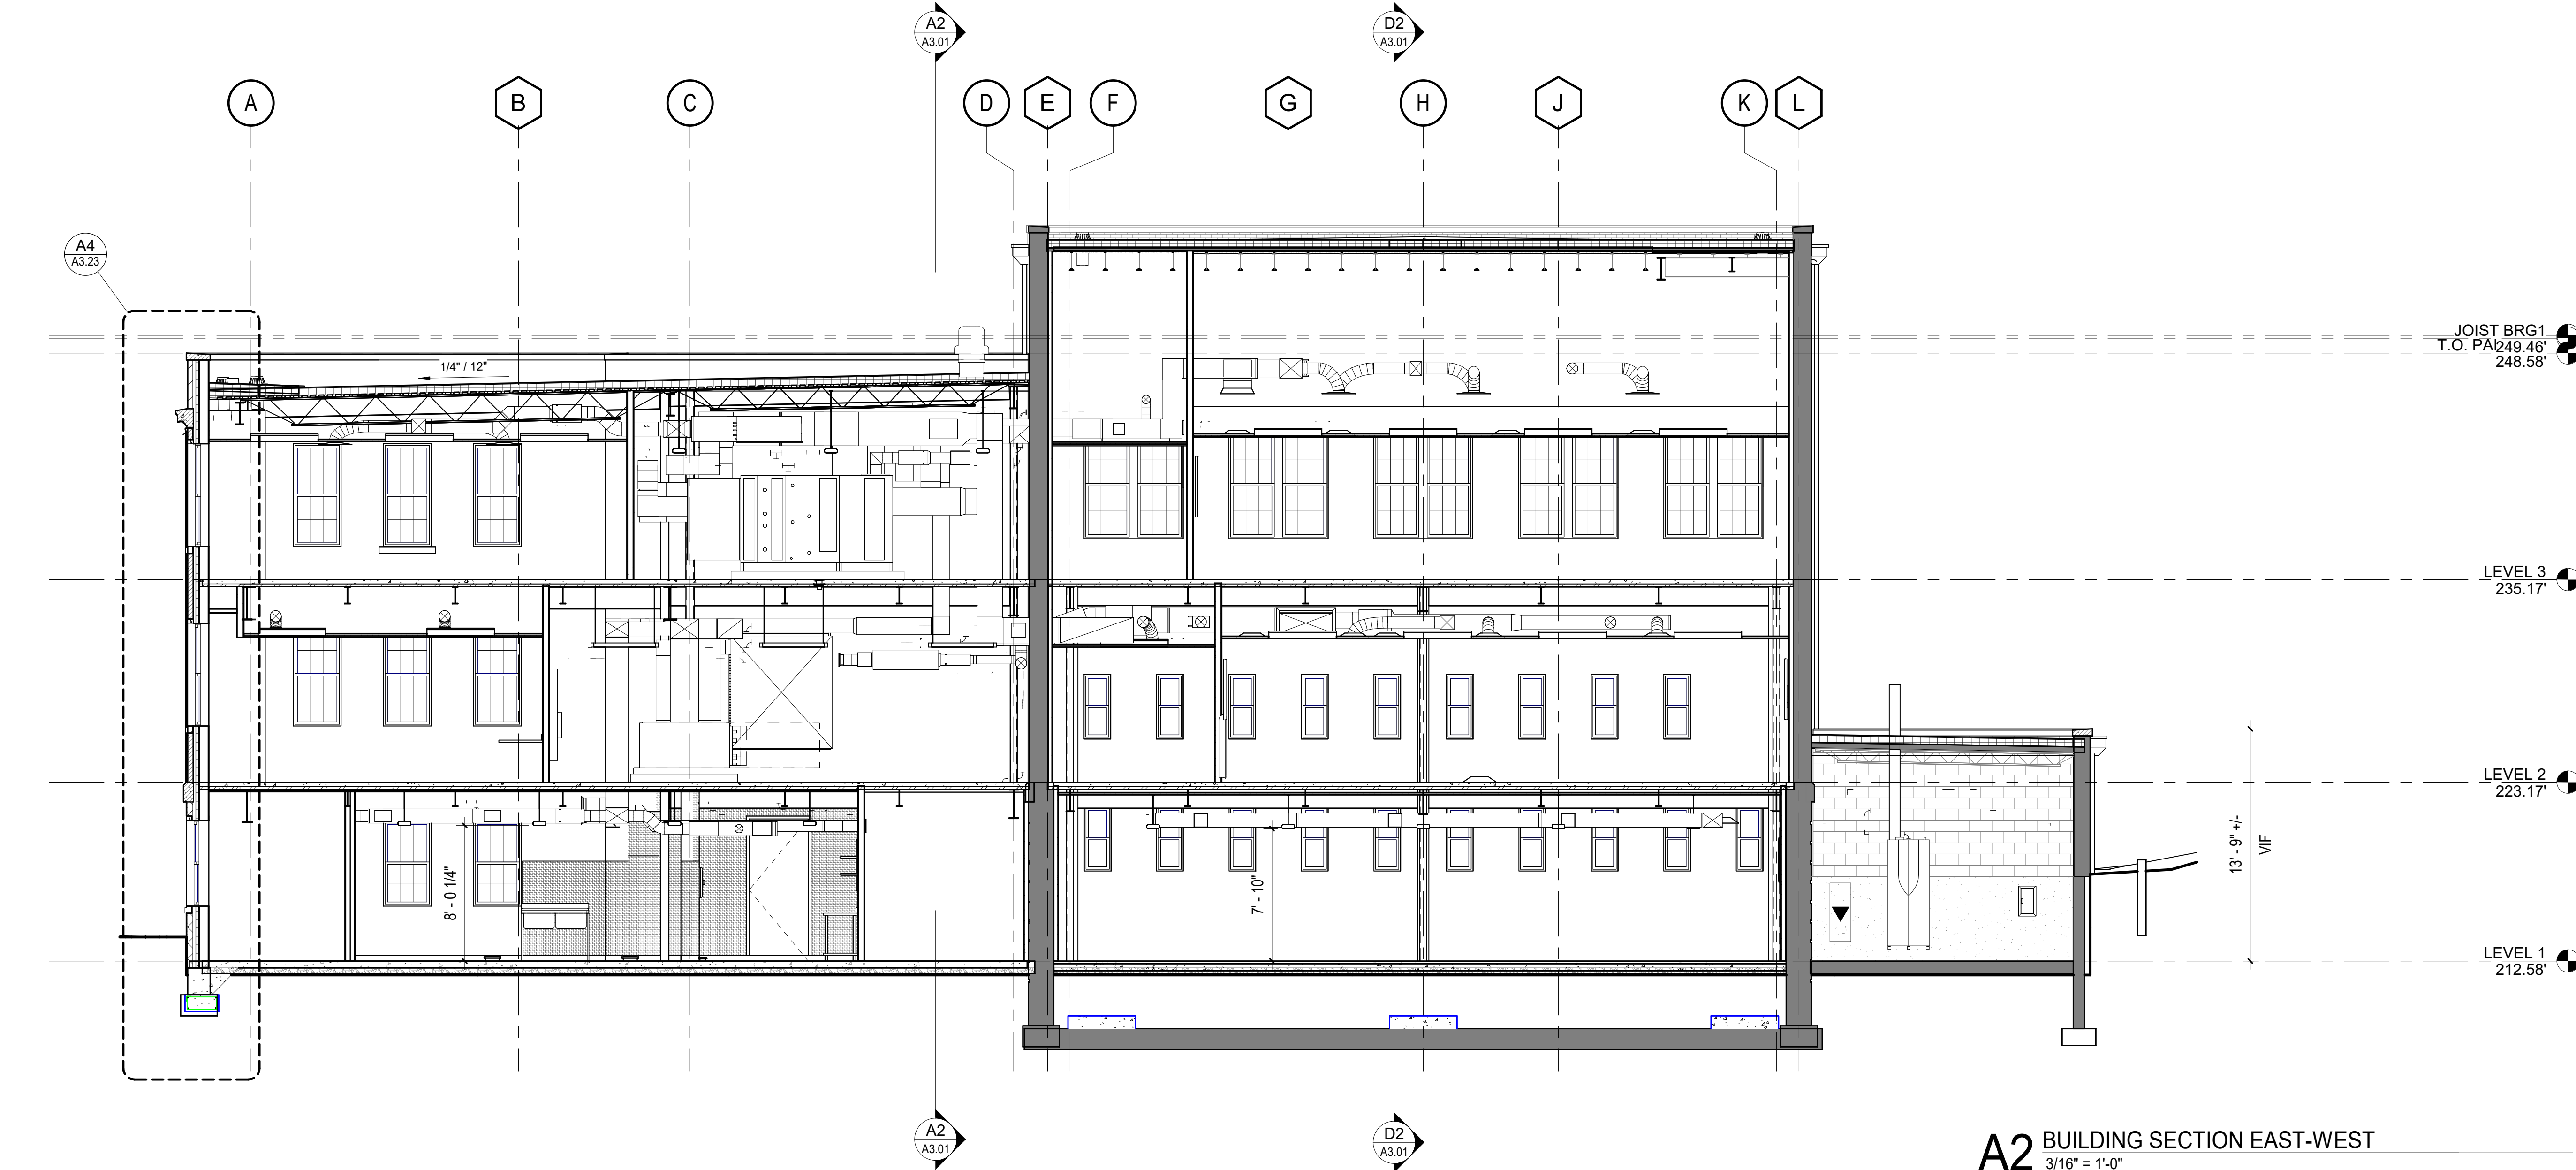

A2 BUILDING SECTION EAST-WEST
3/16" = 1'-0"

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION.
RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
 - RE: SHEET A7.11 FOR WINDOW SCHEDULE
- W1 WALL TYPE 1:
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2 WALL TYPE 2:
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3 WALL TYPE 3:
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4 WALL TYPE 4:
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- W5 WALL TYPE 5:
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6 WALL TYPE 6:
EXISTING STONE PANEL (CLEAN AND REJOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7 WALL TYPE 7:
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- 1 EXTERIOR GLAZED OPENING TYPE - RE: SHEET A7.11
- MJ MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR
- R1 ROOF TYPE 1:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2 ROOF TYPE 2:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3 ROOF TYPE 3:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

K|P|S
GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
3531
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: DOWNS 202483
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24

REVISIONS		
No.	Description	Date


DRAWING TITLE
BUILDING SECTIONS

DRAWN BY: Author
CHECKED BY: Checker


PROJECT NUMBER
236002-02

DRAWING NO.
A3.02


A6 WALL SECTION - NORTH FACADE
1/2" = 1'-0"

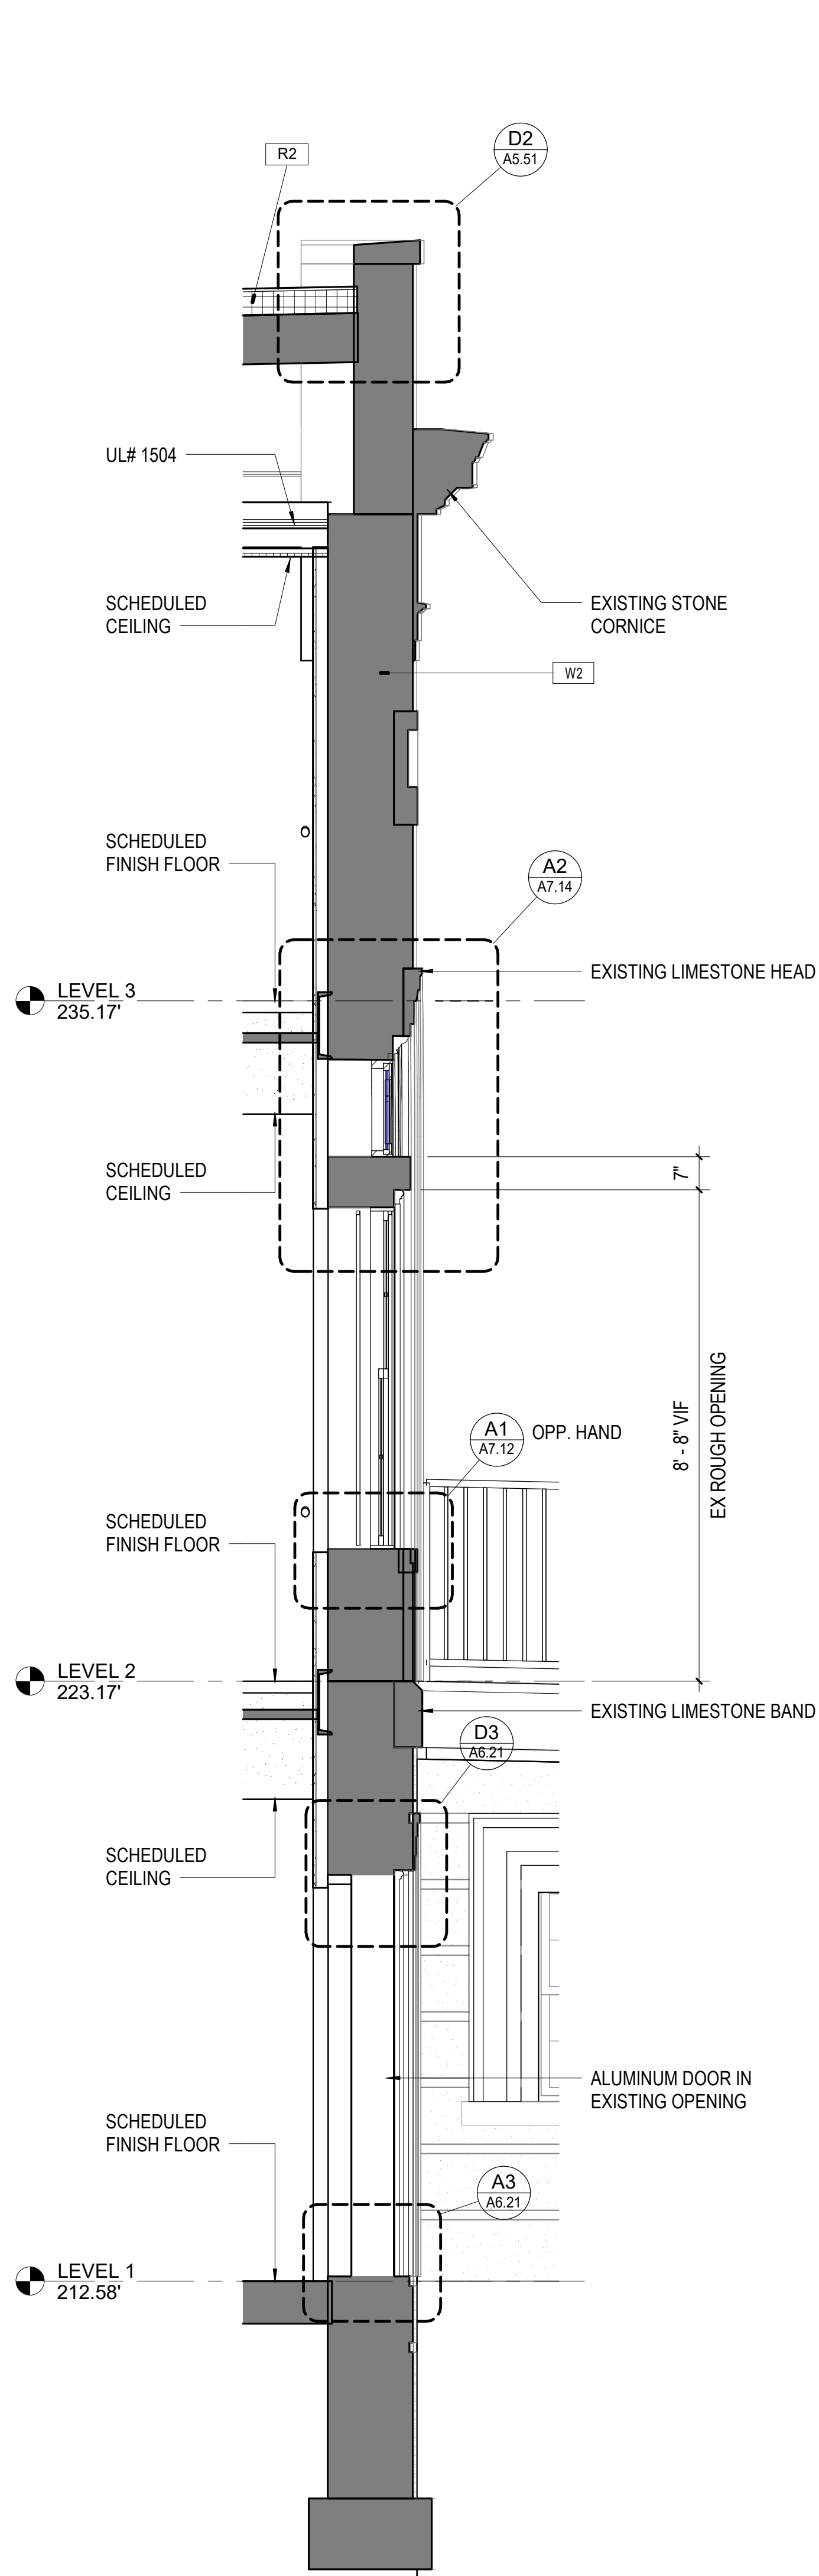


A4 WALL SECTION - MAIN ENTRY
1/2" = 1'-0"

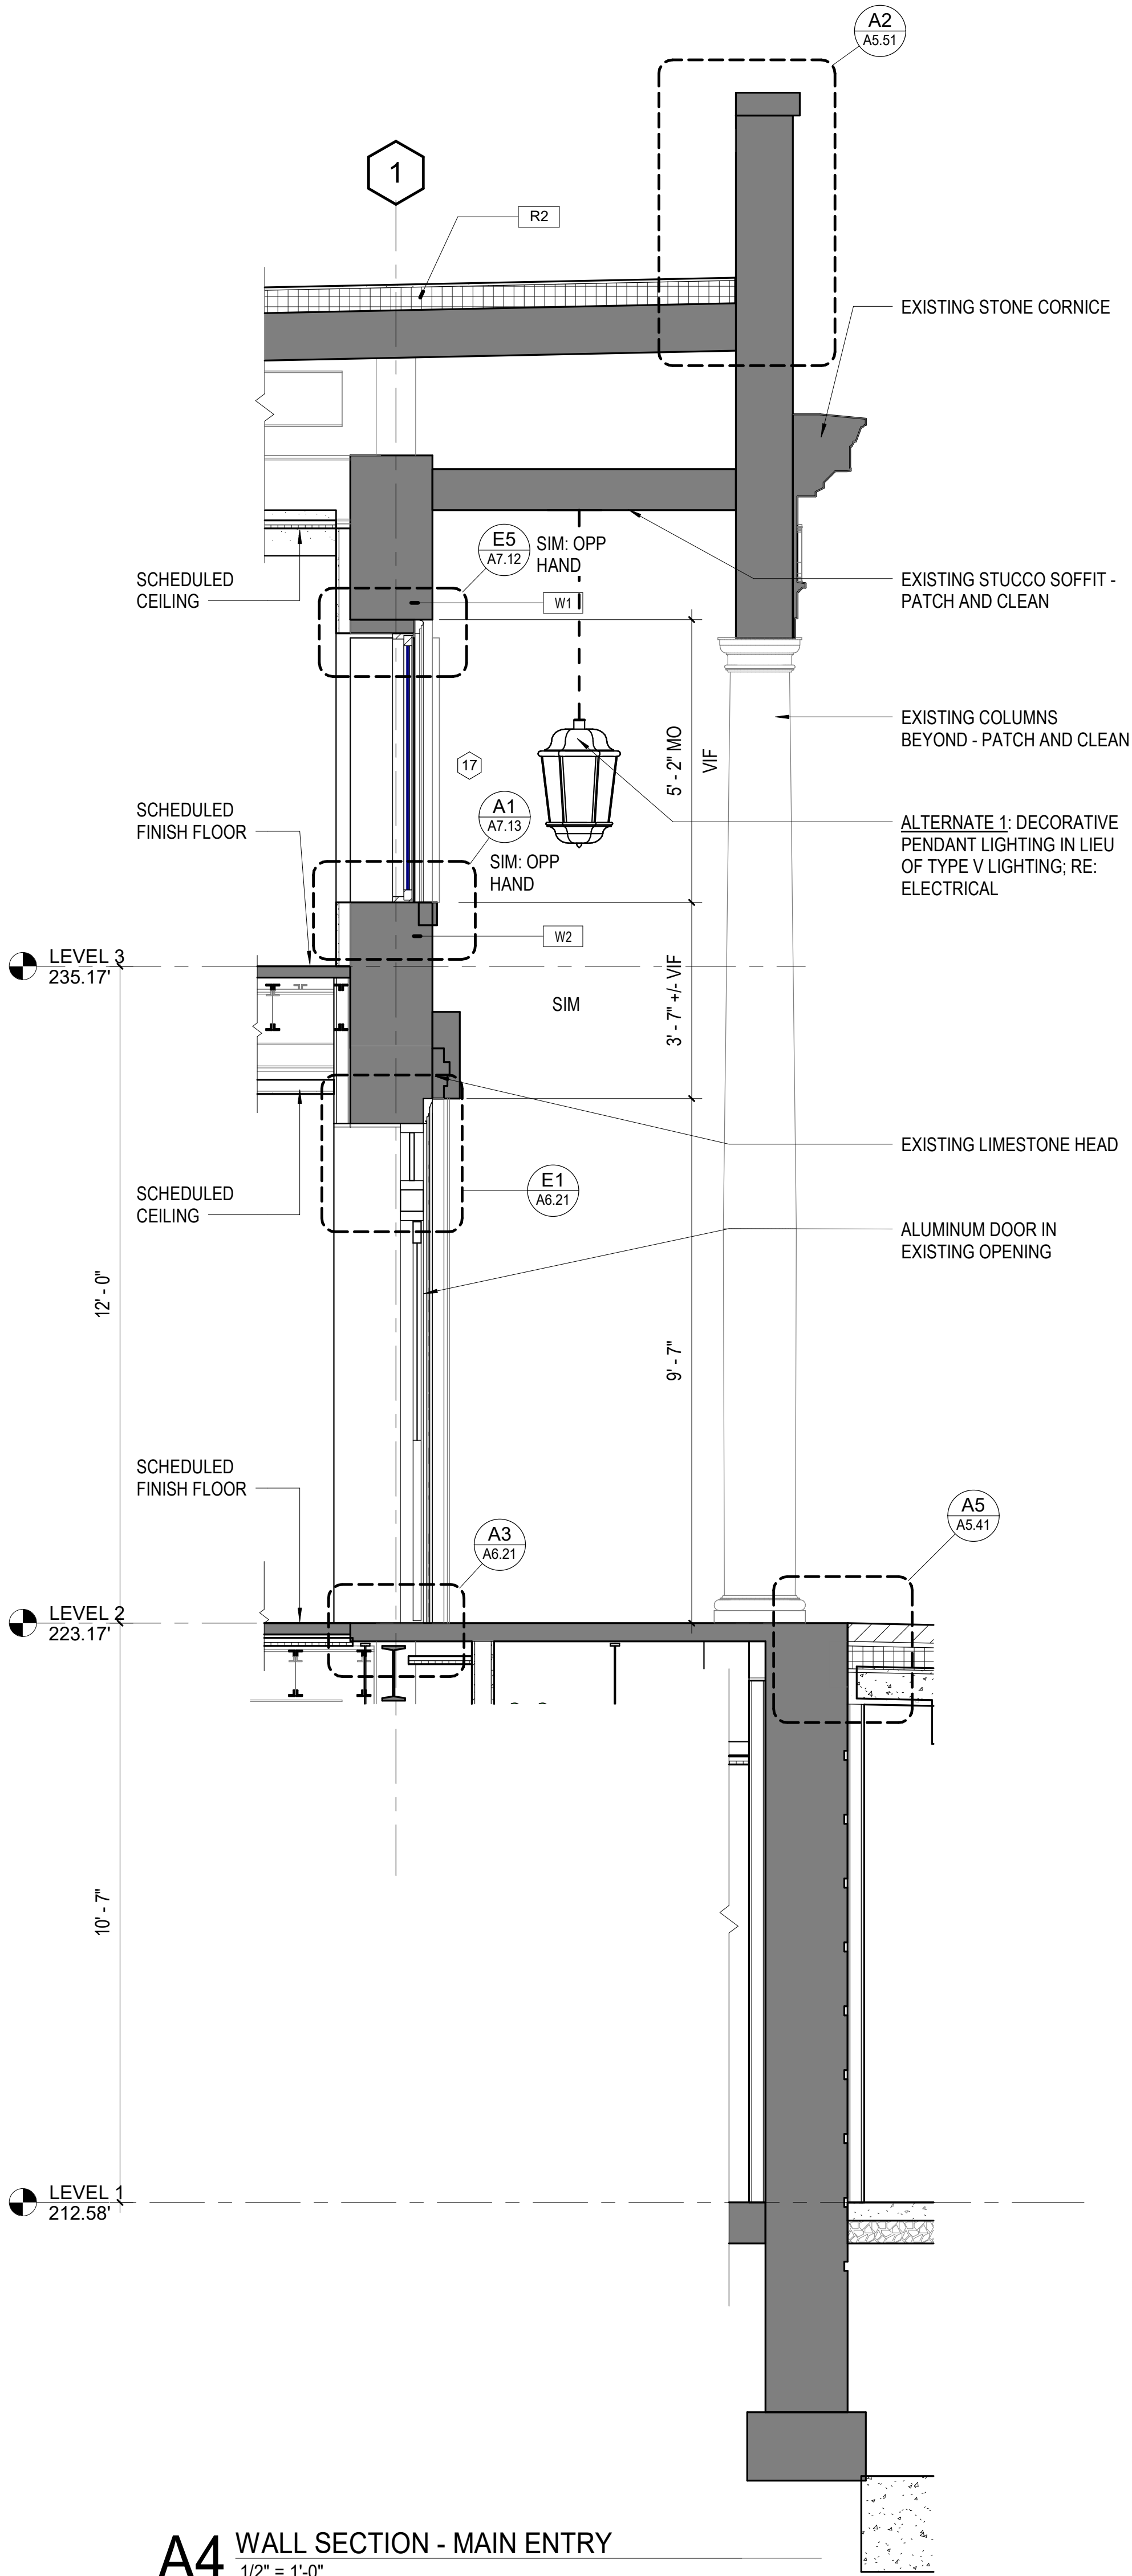


A2 WALL SECTION - BRIDGE 1
1/2" = 1'-0"

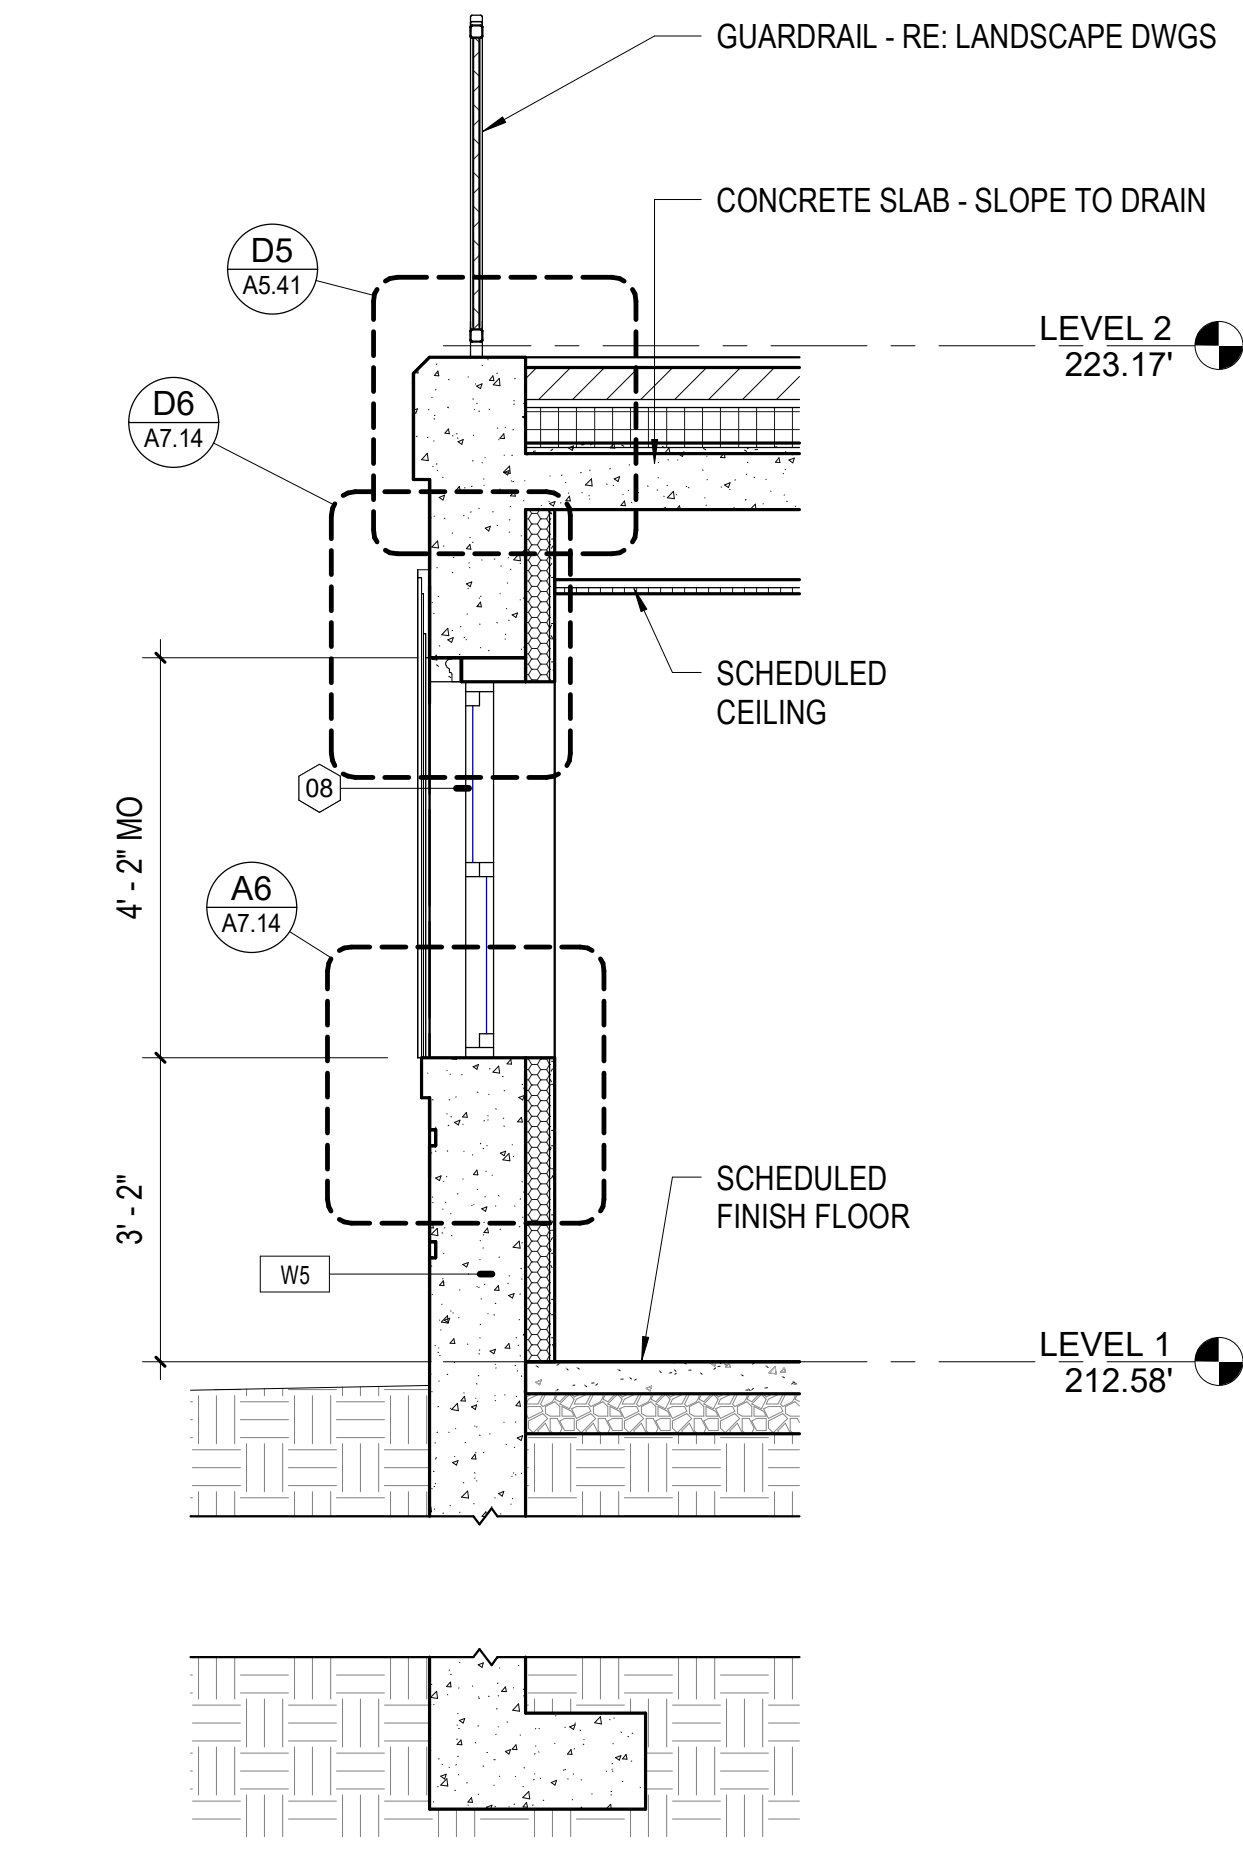


C2 WALL SECTION - WINDOWS AT PORTICO
1/2" = 1'-0"

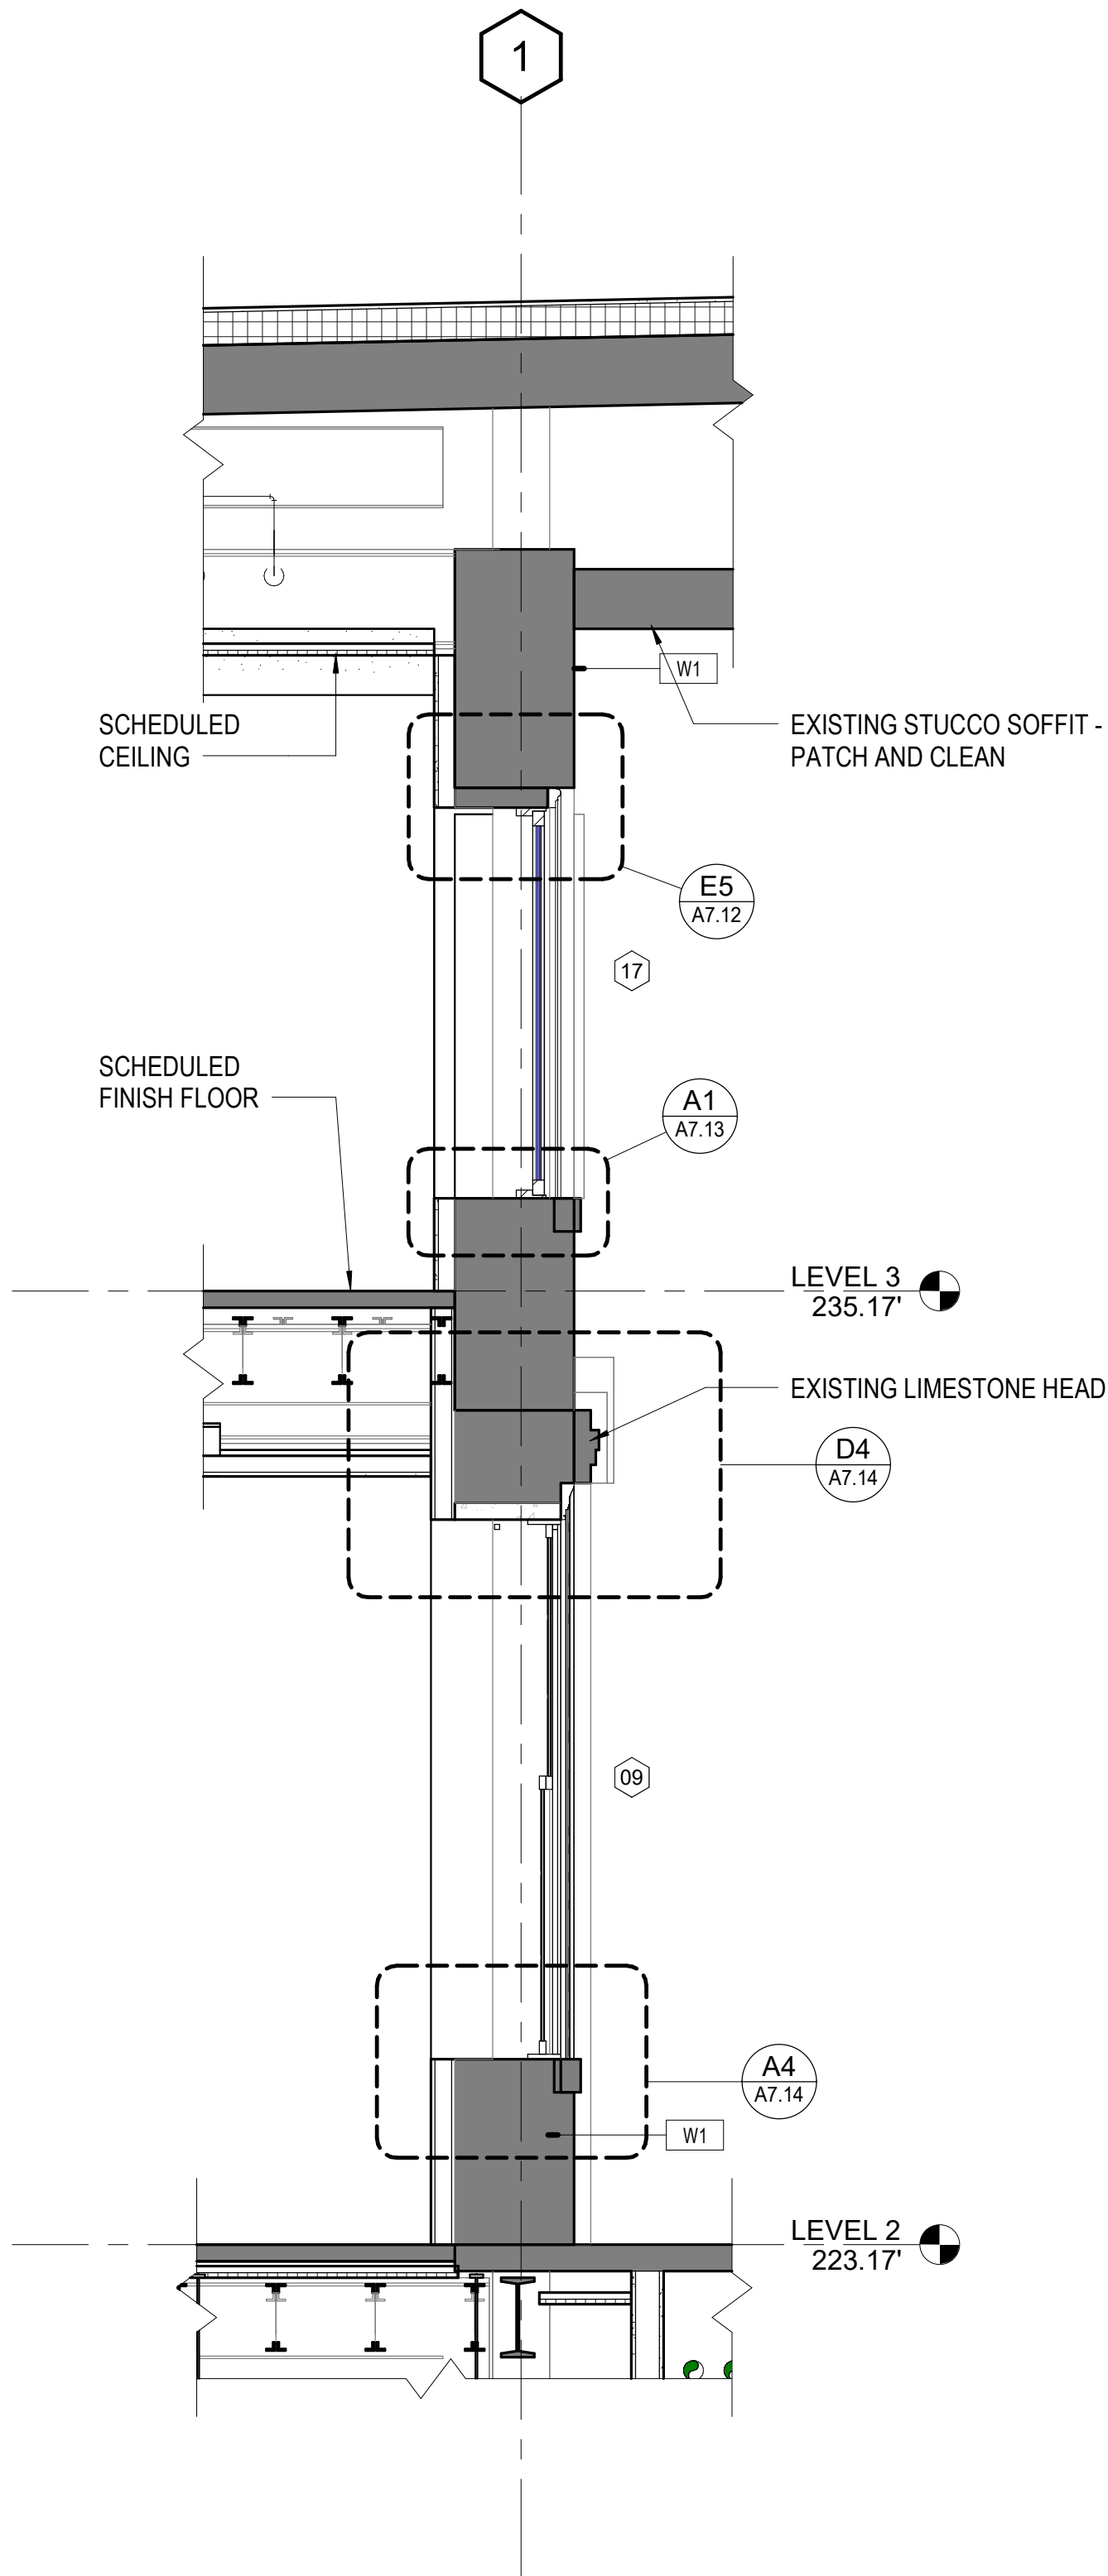

A1 WALL SECTION - BRIDGE
1/2" = 1'-0"

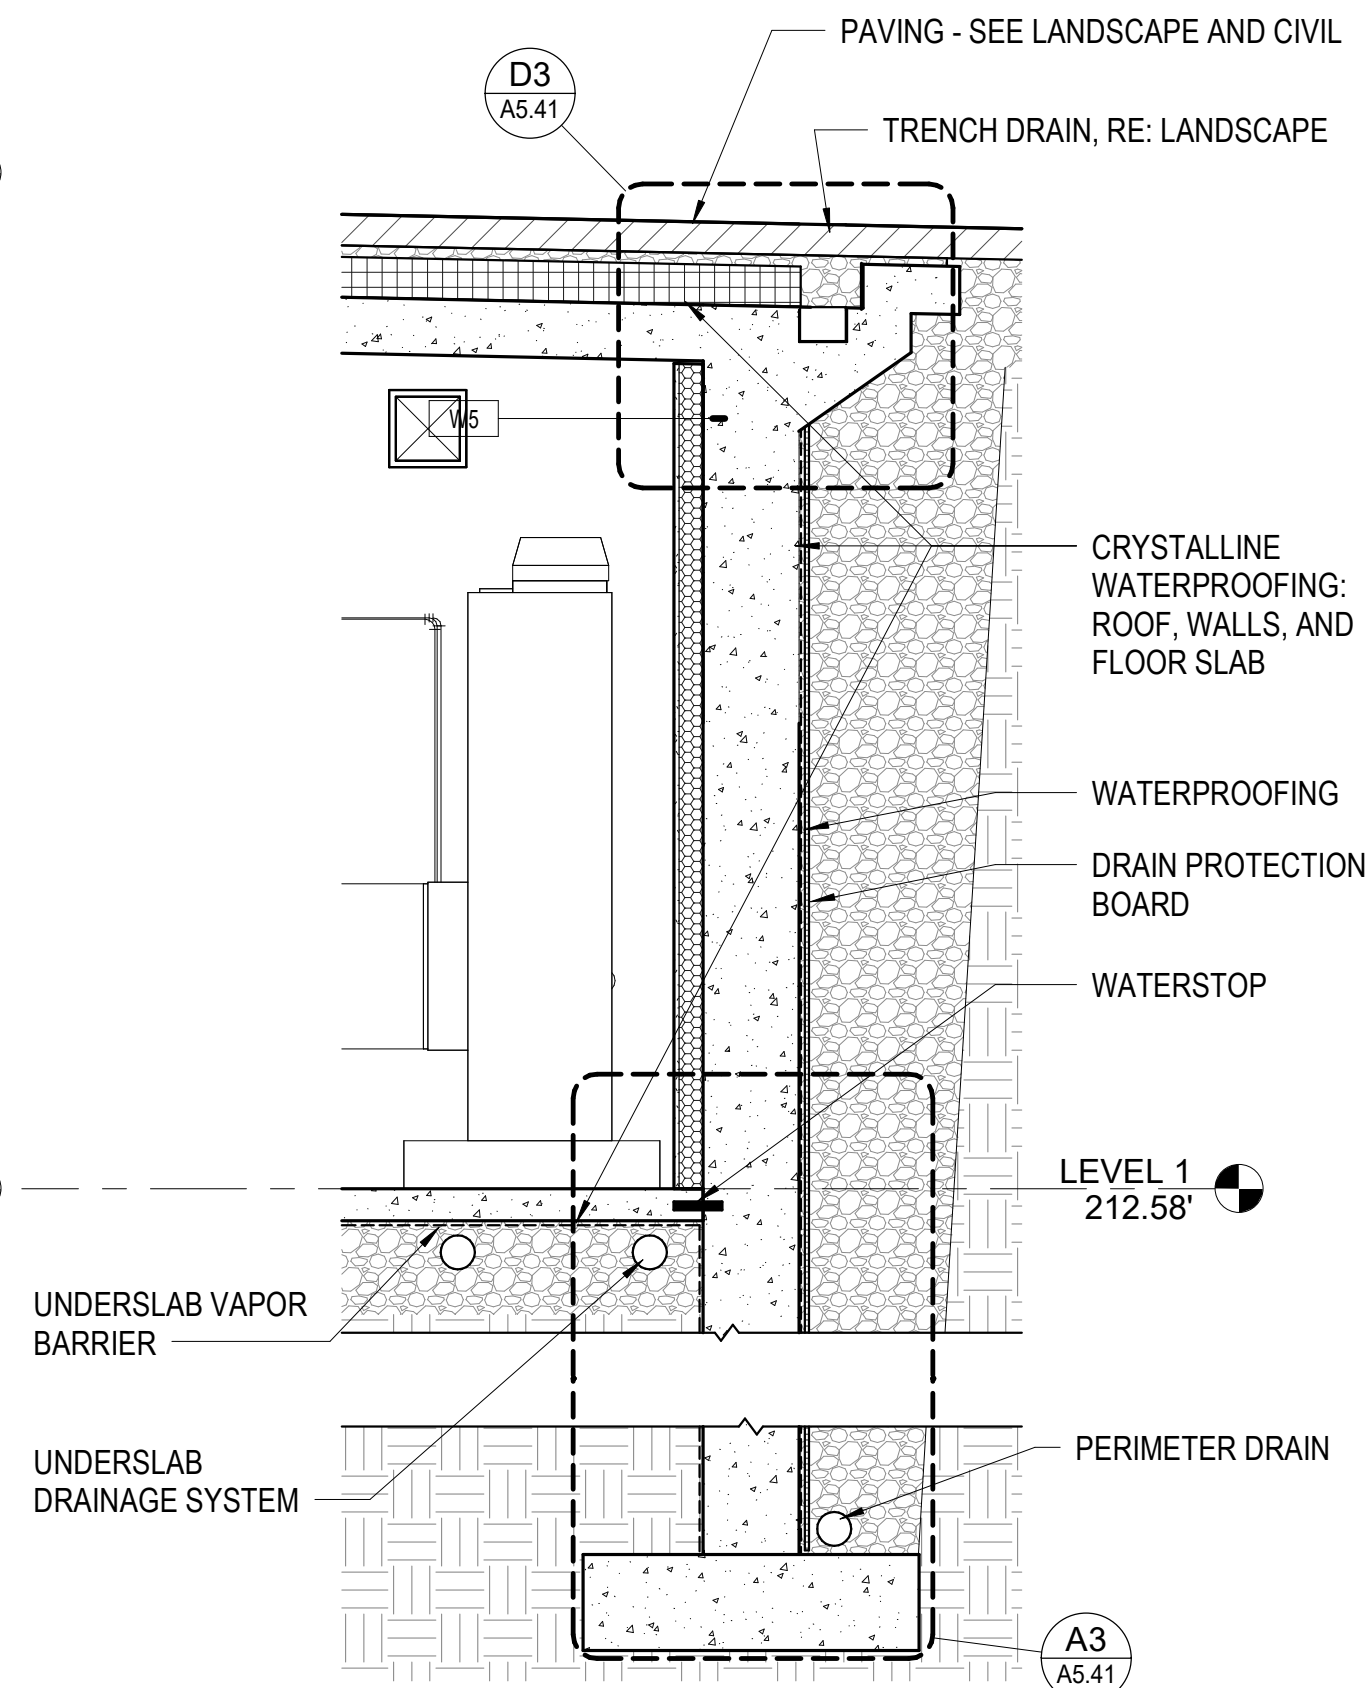

C2 WALL SECTION - WINDOWS AT PORTICO
1/2" = 1'-0"

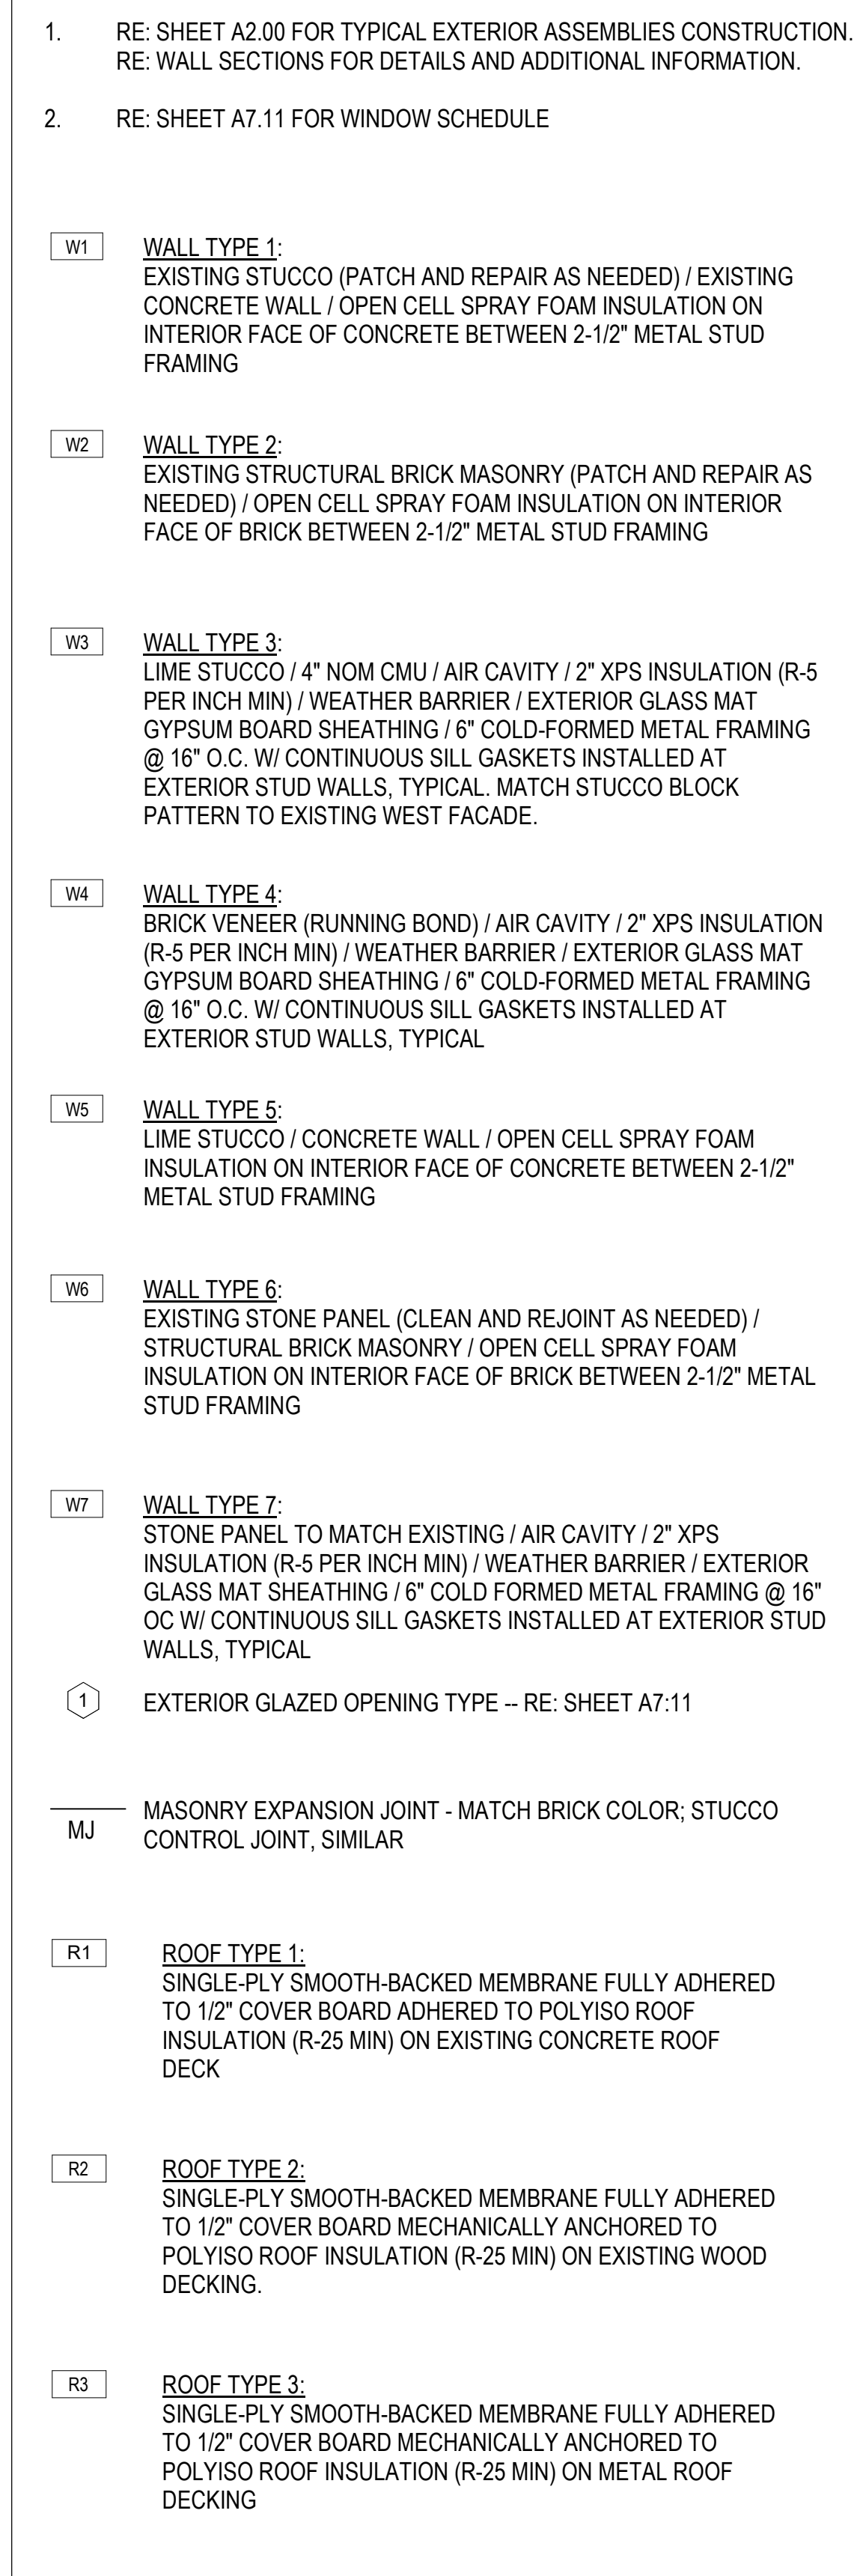

K|P|S
GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com


This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.


STATE OF ALABAMA
REGISTERED ARCHITECT
3531
By DONALD C. SIMPSON

McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: DOWNS 202483
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401


PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24
REVISIONS
No. Description Date
DRAWING TITLE
WALL SECTIONS
DRAWN BY: Author
CHECKED BY: Checker
PROJECT NUMBER
236002-02
DRAWING NO.
A3.21

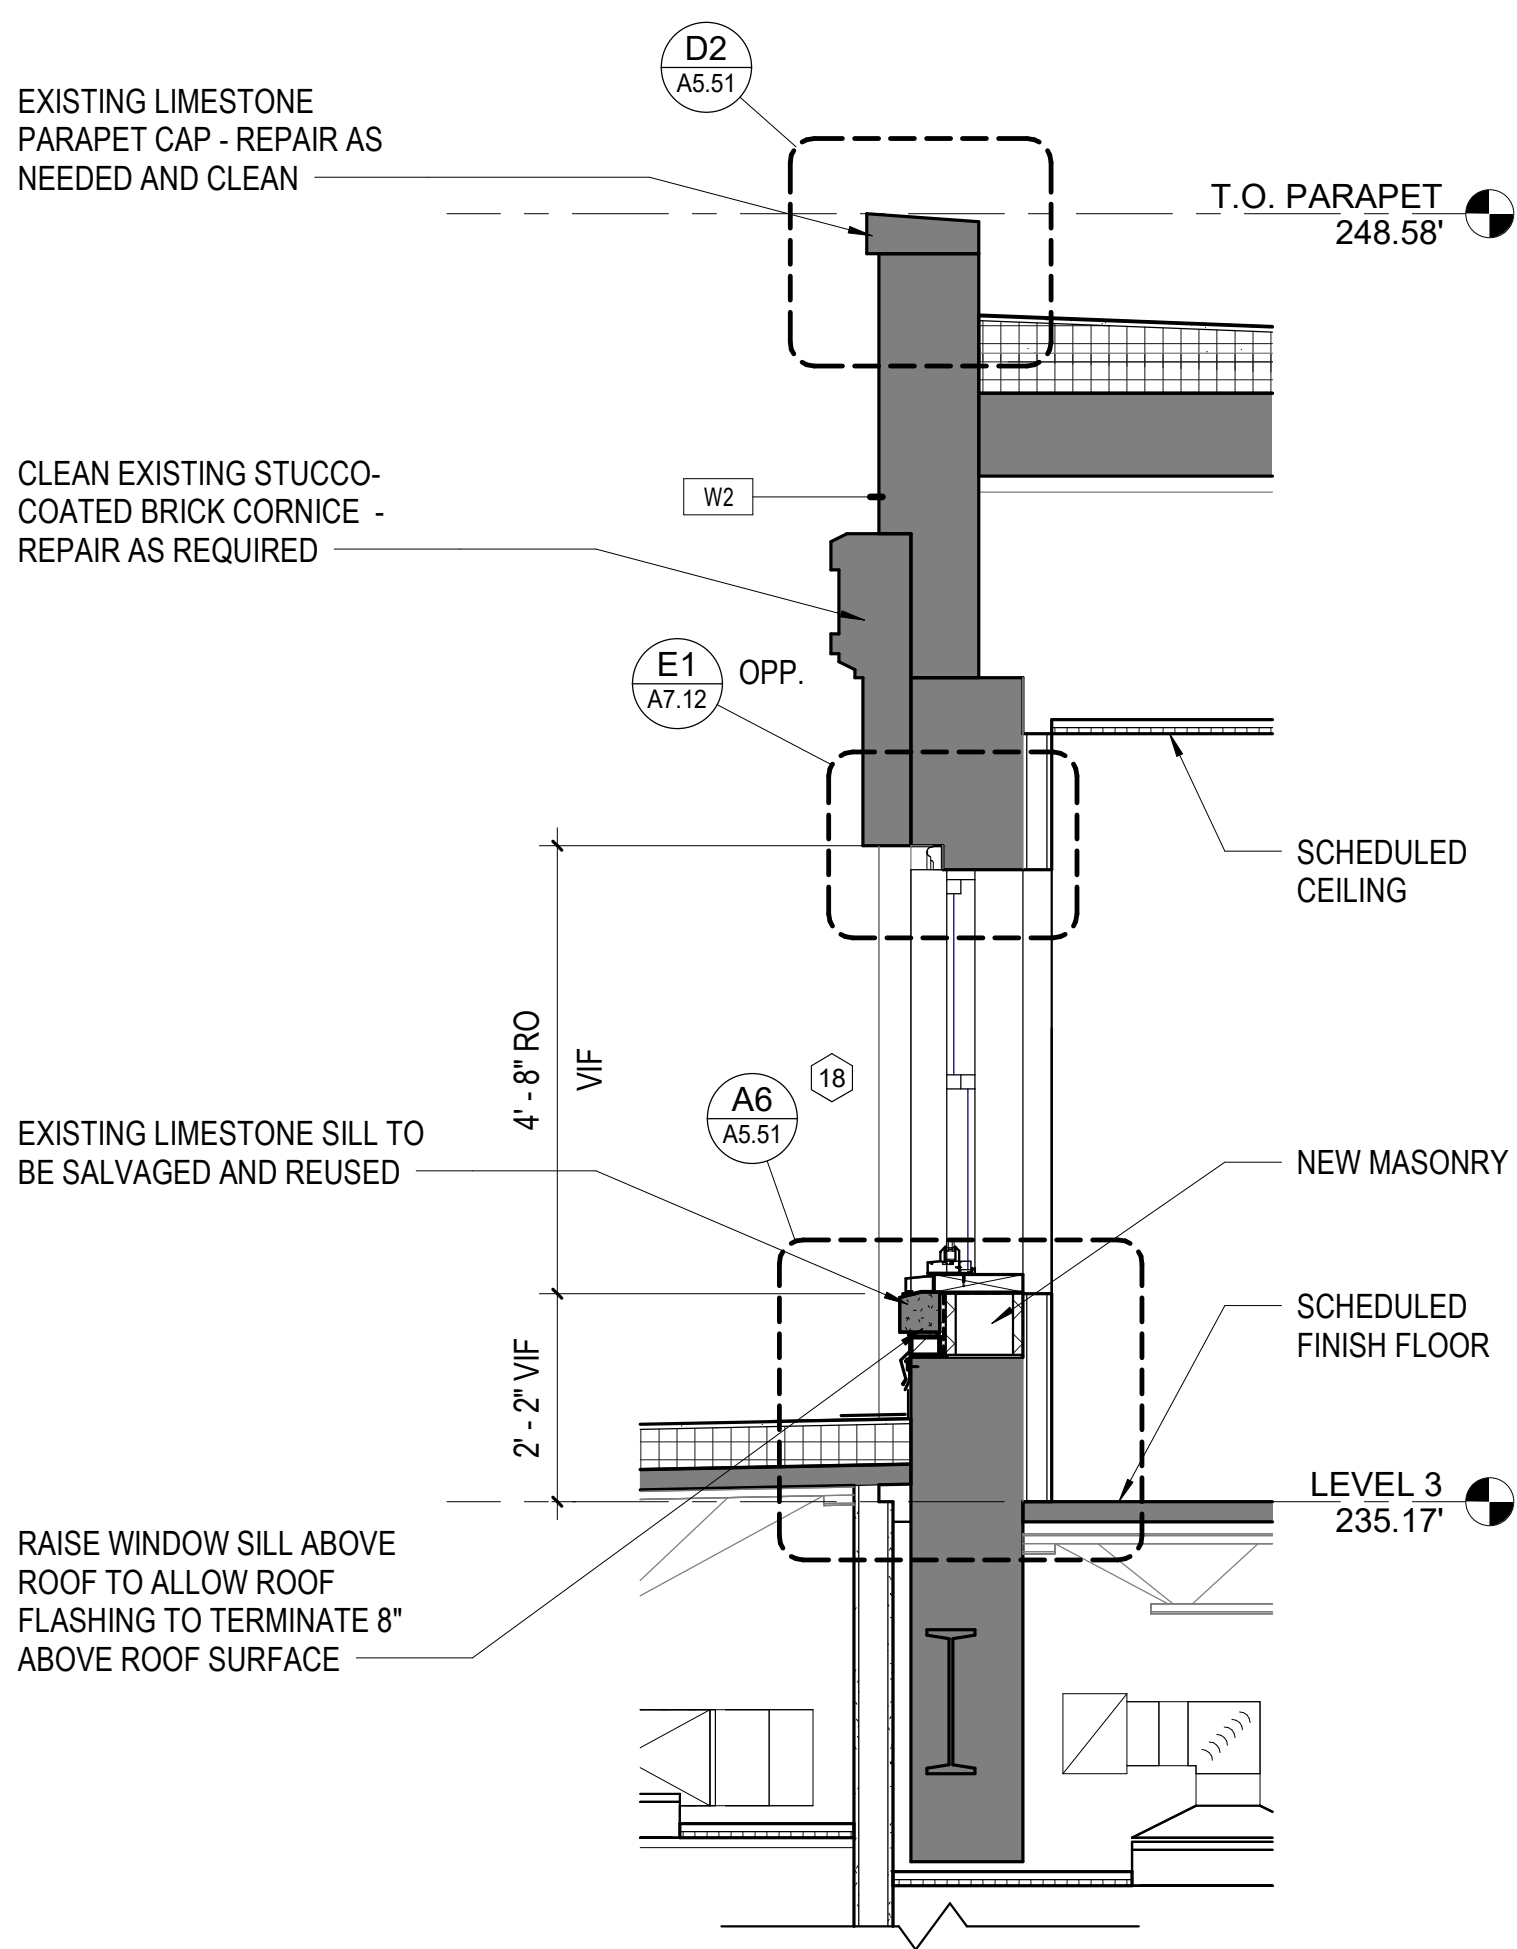


D6 WALL SECTION - WEST UPPER FACADE
1/2" = 1'-0"

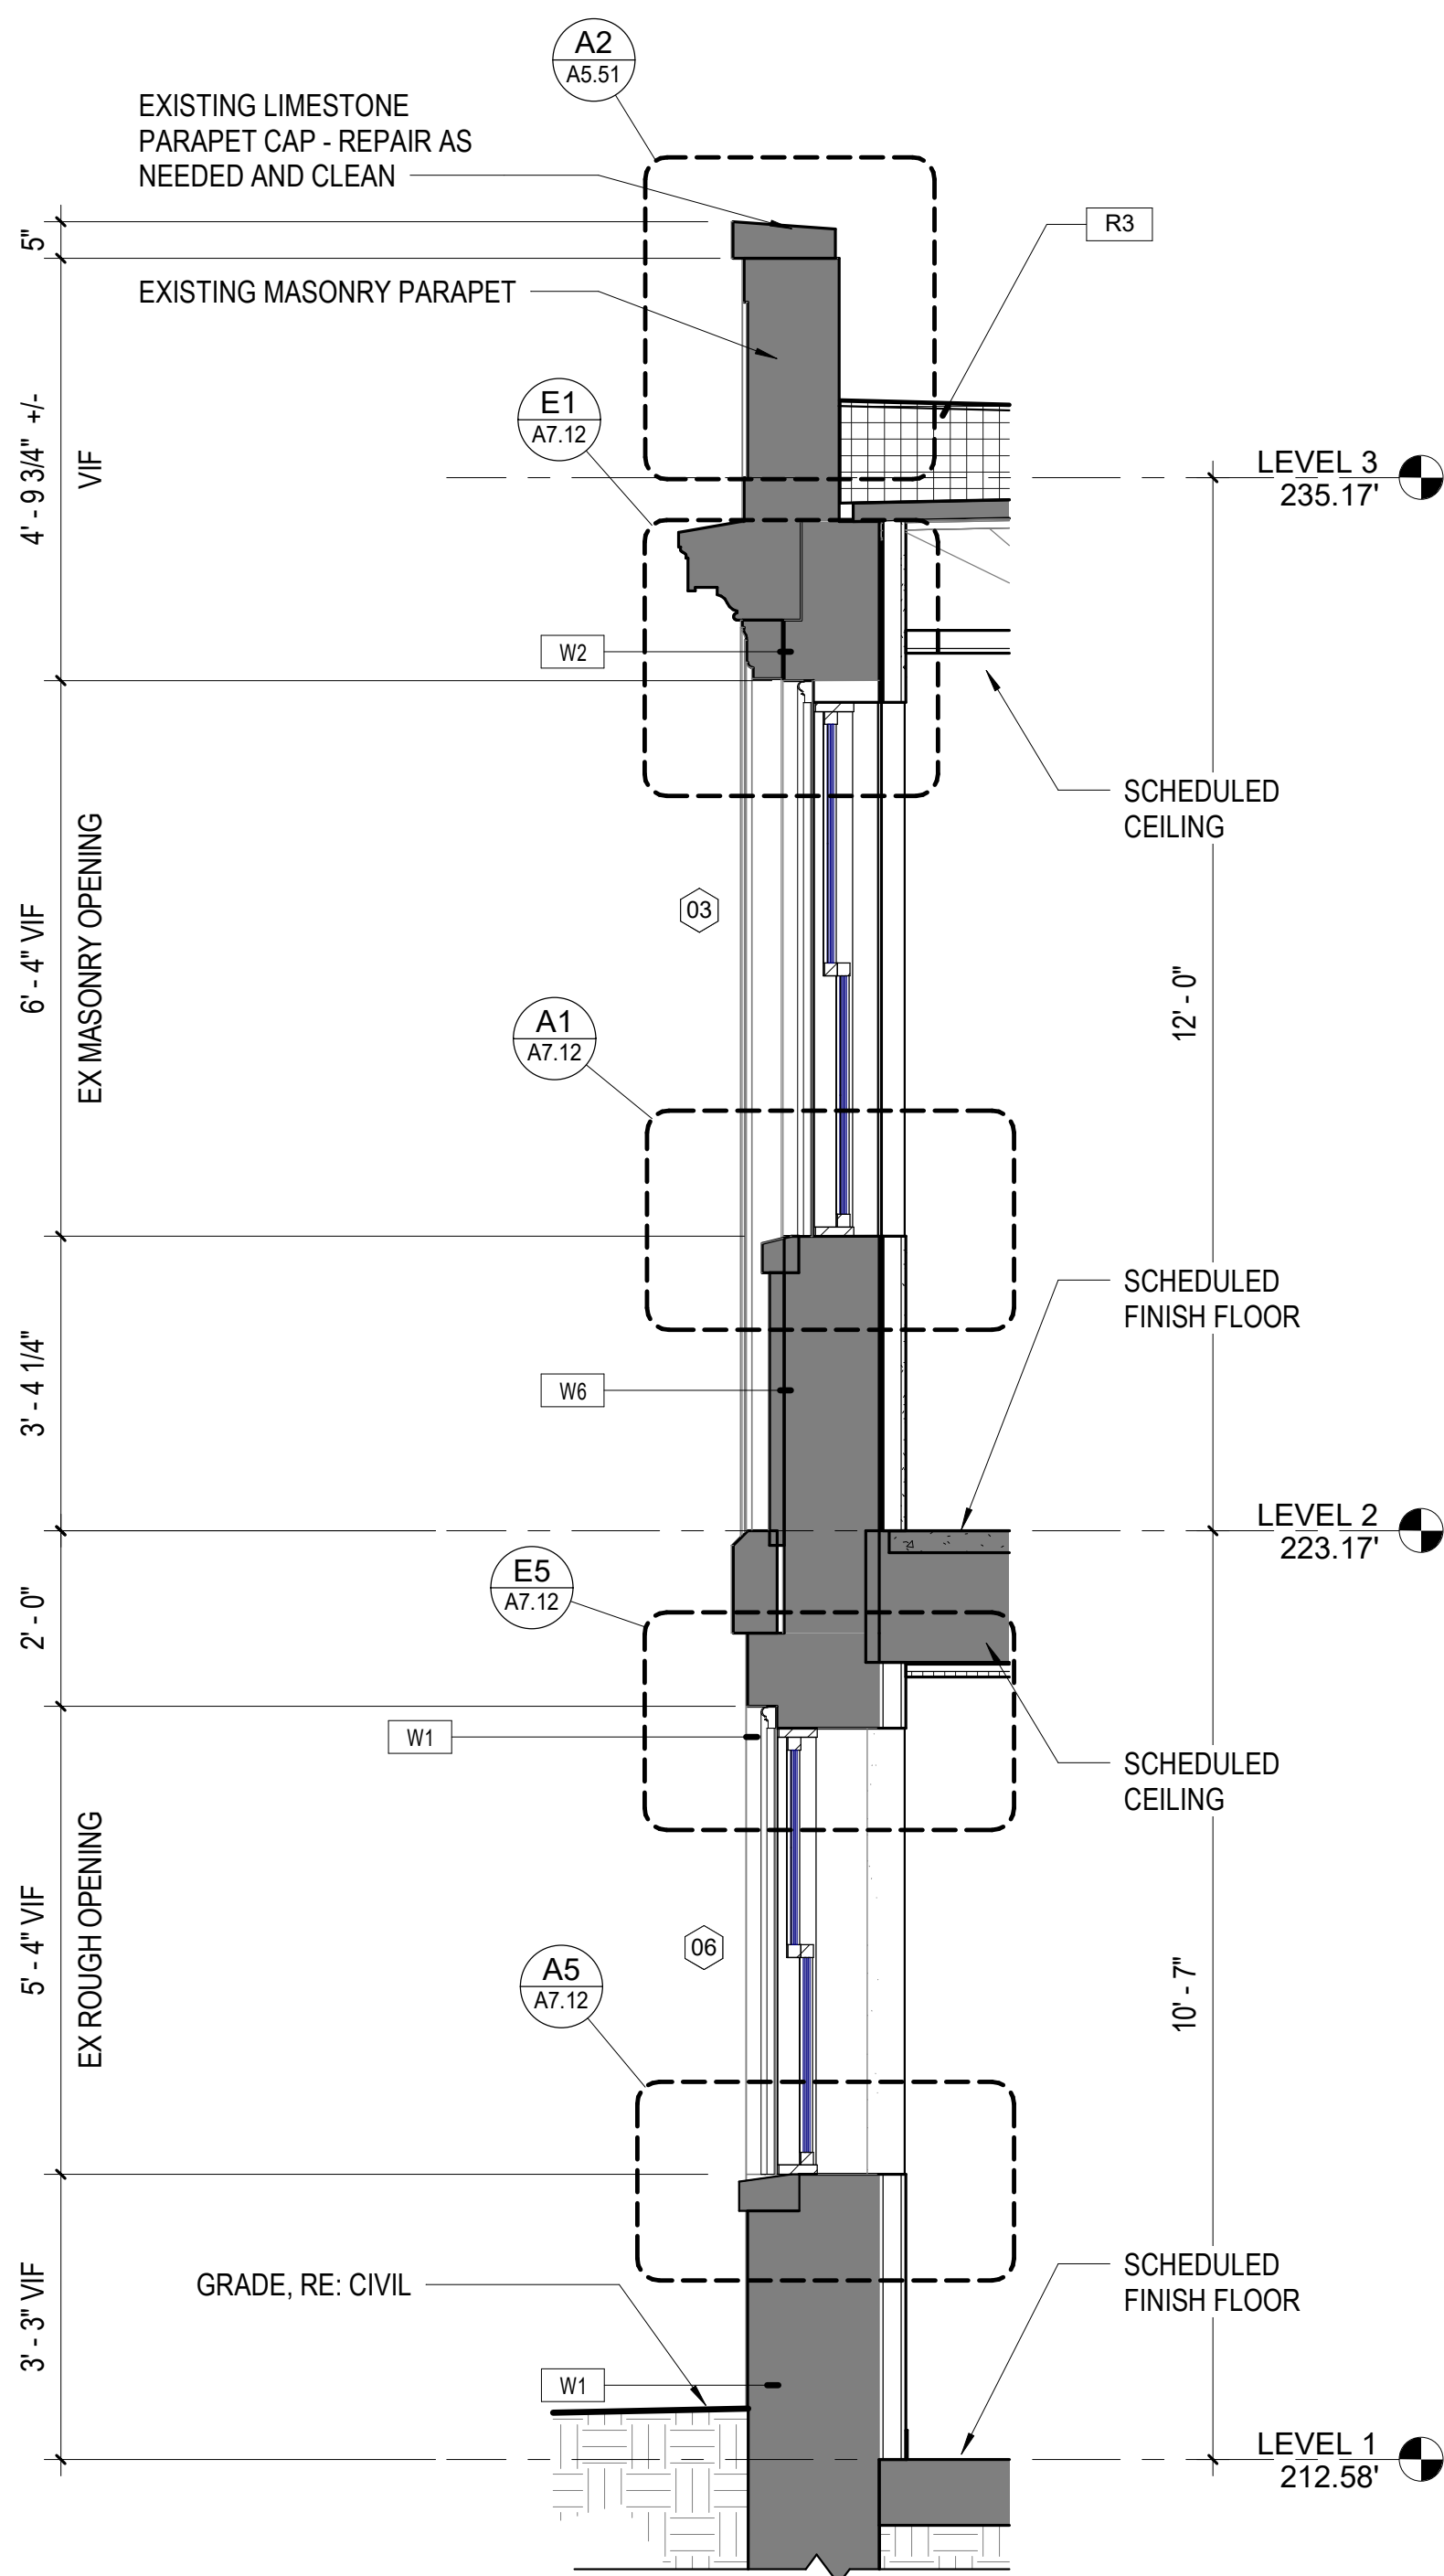

A6 WALL SECTION - EXISTING WEST FACADE
1/2" = 1'-0"

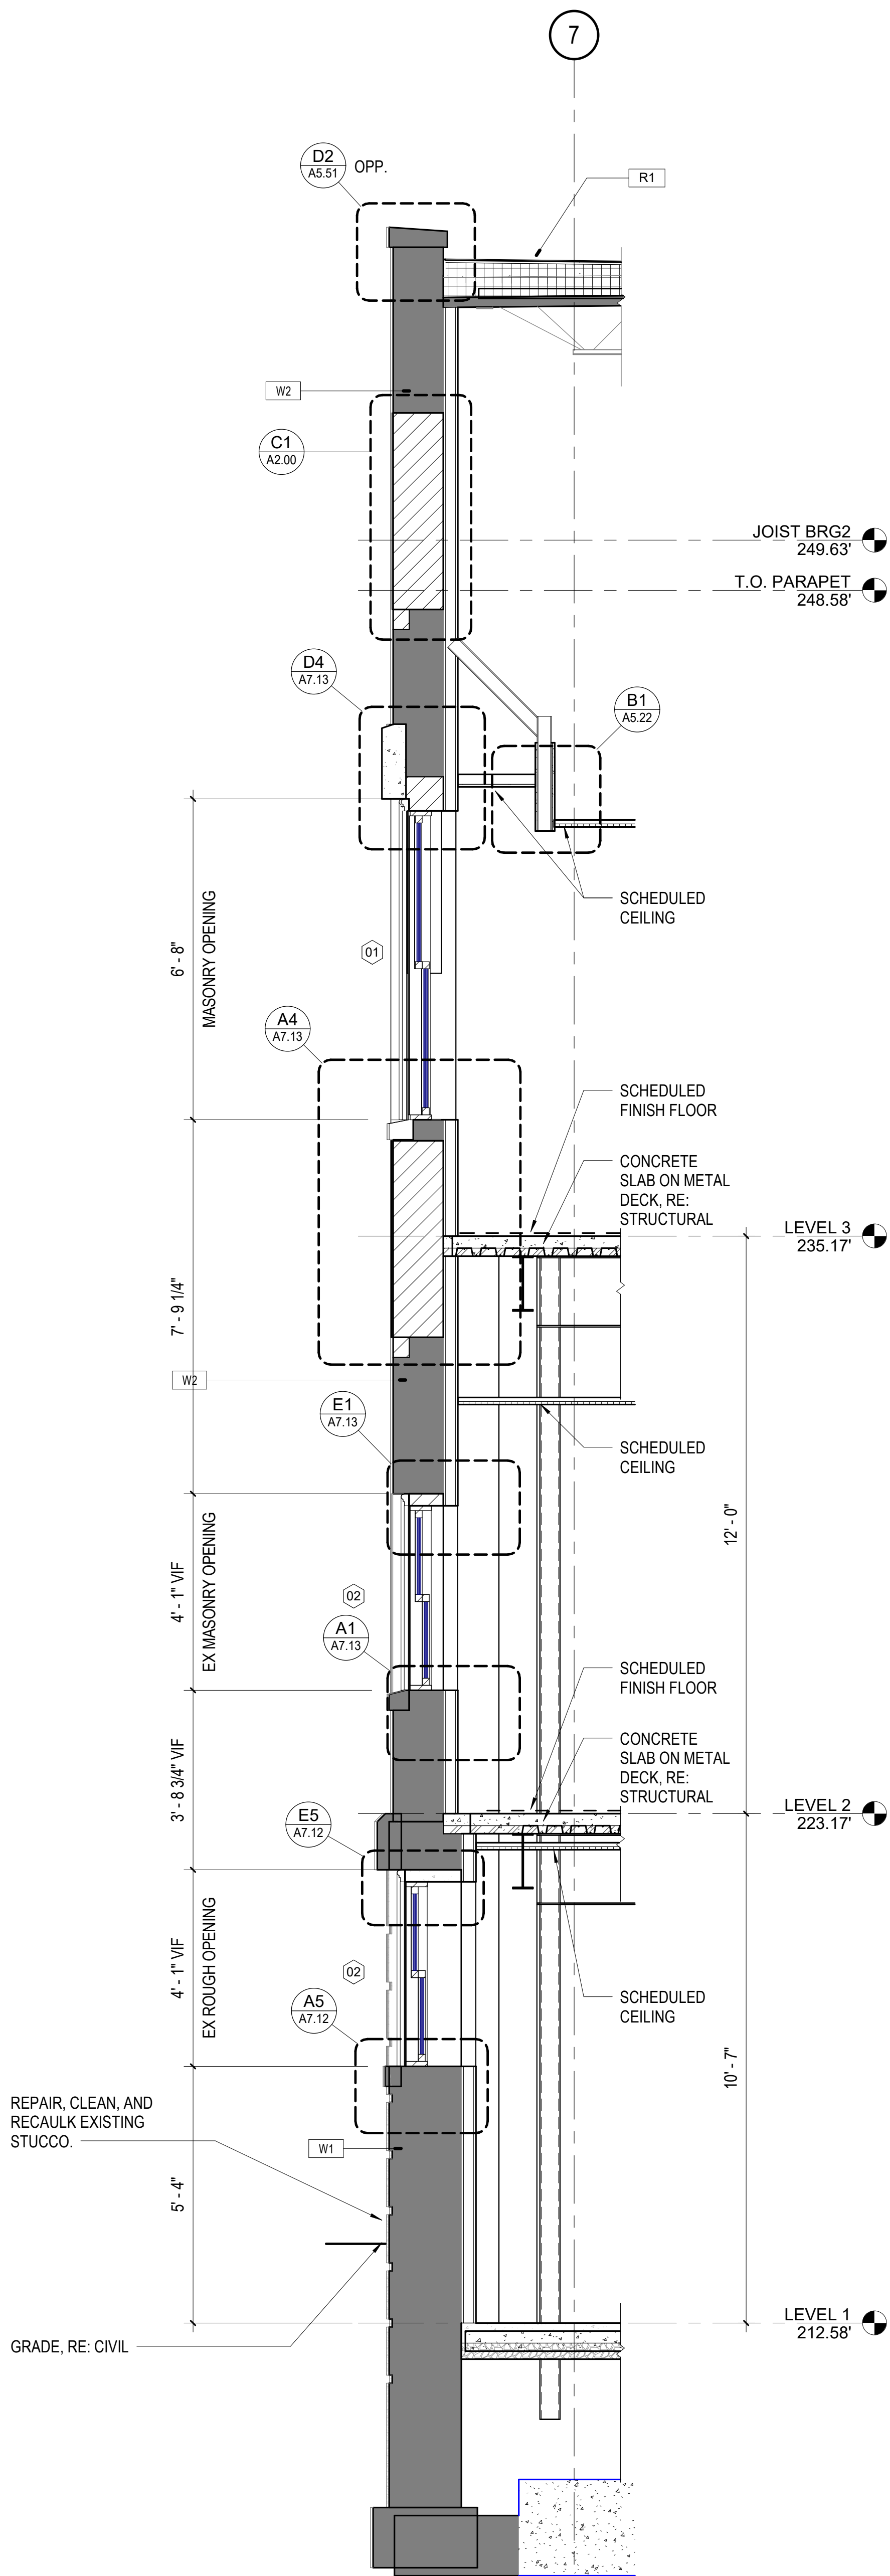


A4 WALL SECTION - FORMER BOOK STACK
1/2" = 1'-0"

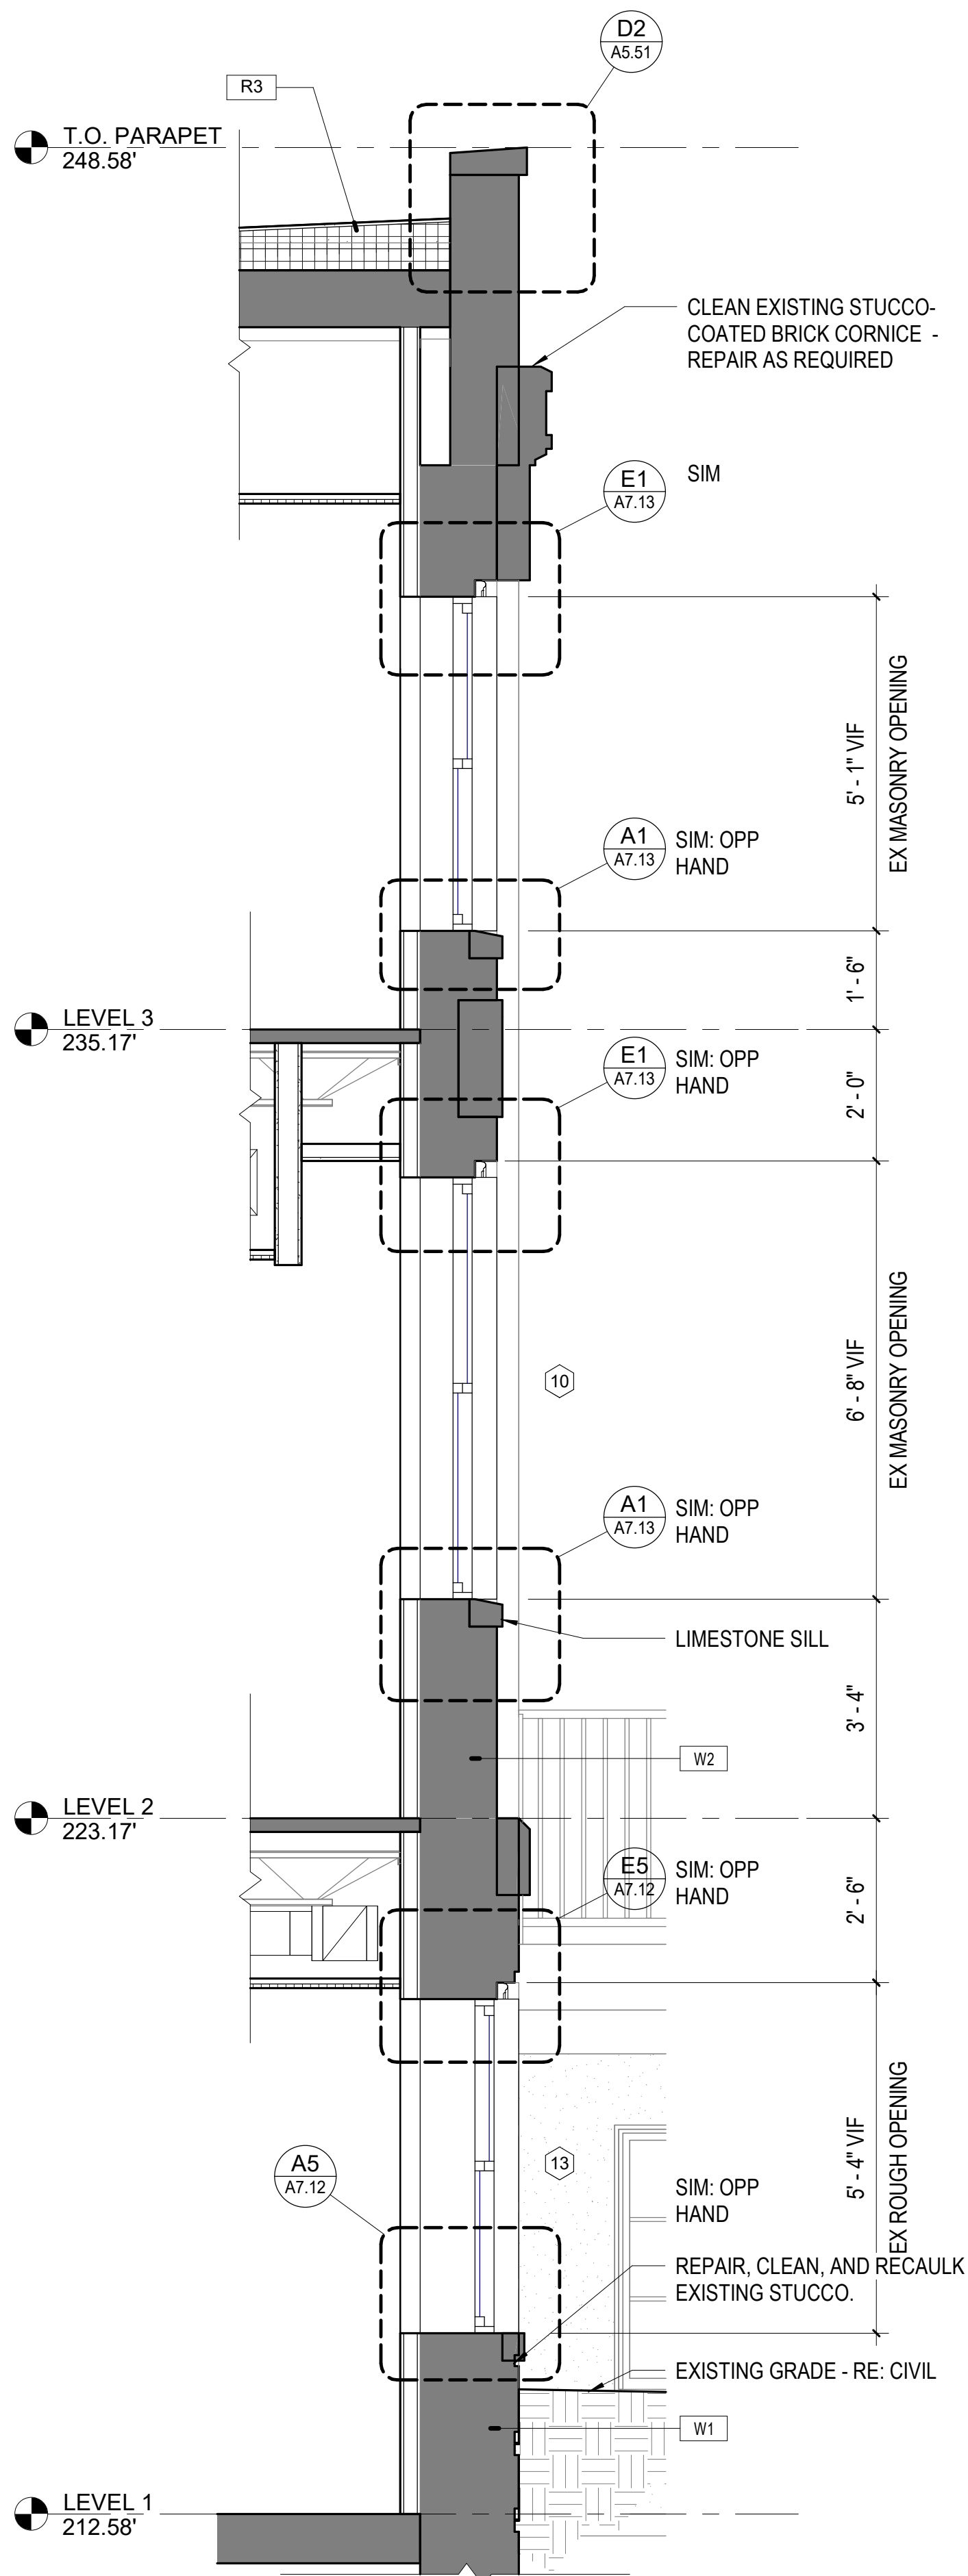


A2 WALL SECTION - EXISTING EAST FACADE
1/2" = 1'-0"

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION.
RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
 - RE: SHEET A7.11 FOR WINDOW SCHEDULE
- W1** WALL TYPE 1:
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2** WALL TYPE 2:
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3** WALL TYPE 3:
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4** WALL TYPE 4:
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- W5** WALL TYPE 5:
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6** WALL TYPE 6:
EXISTING STONE PANEL (CLEAN AND REJOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7** WALL TYPE 7:
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- 1** EXTERIOR GLAZED OPENING TYPE - RE: SHEET A7.11
- MJ** MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR
- R1** ROOF TYPE 1:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2** ROOF TYPE 2:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3** ROOF TYPE 3:
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

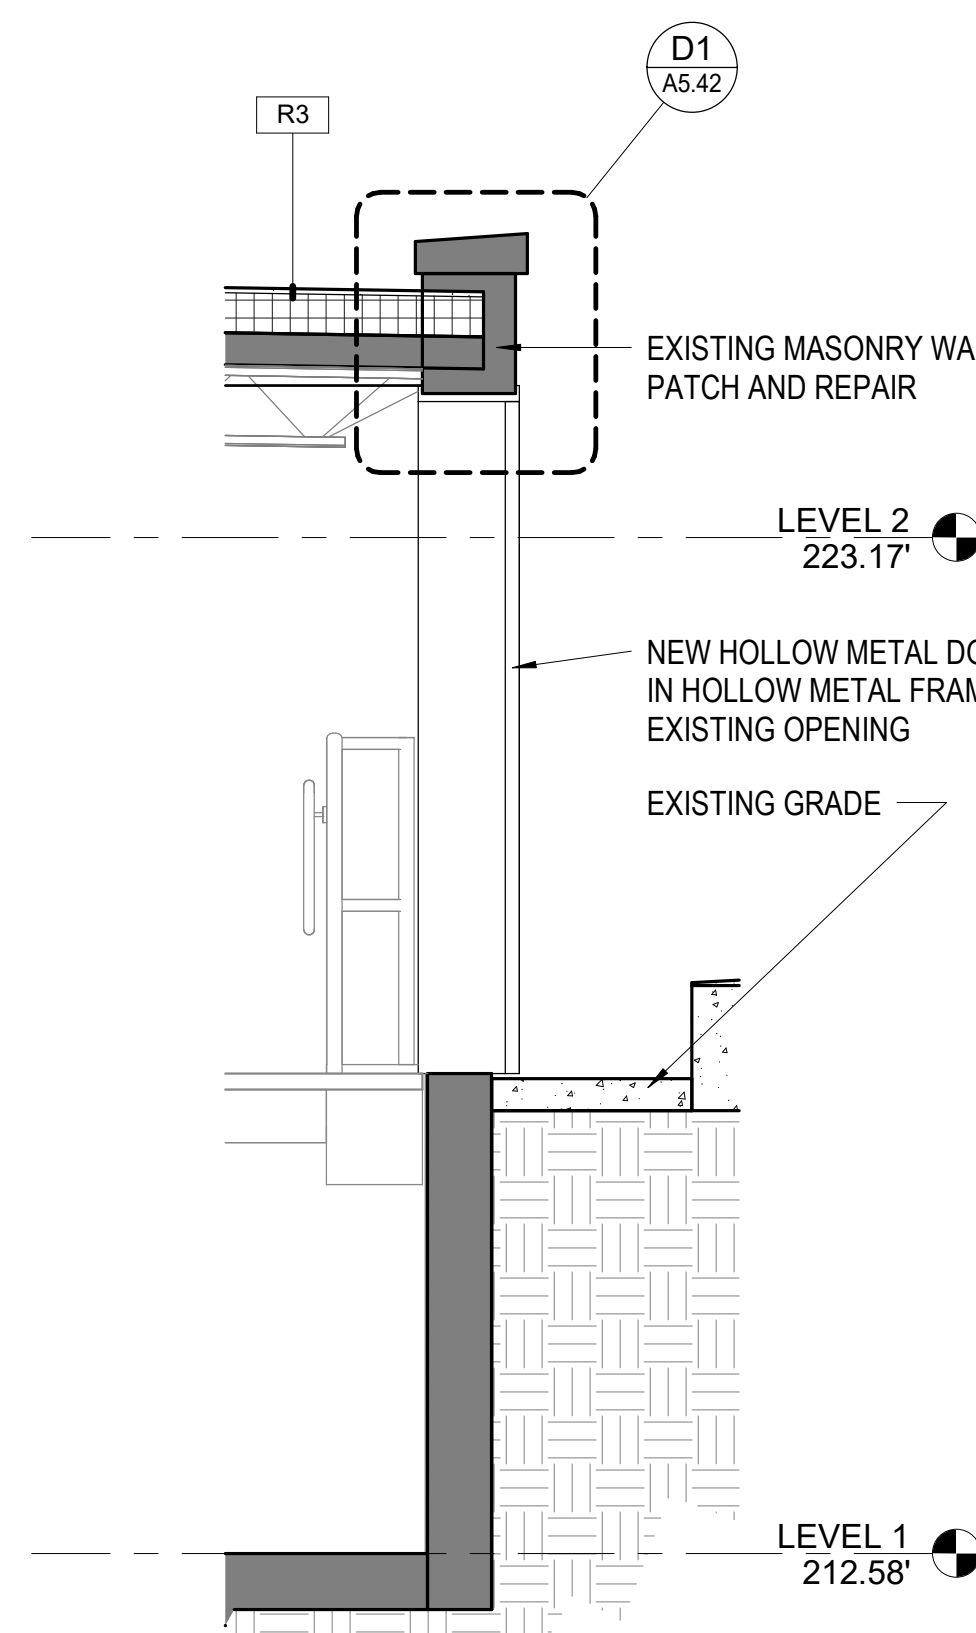

A1 WALL SECTION - MECHANICAL ROOM
1/2" = 1'-0"

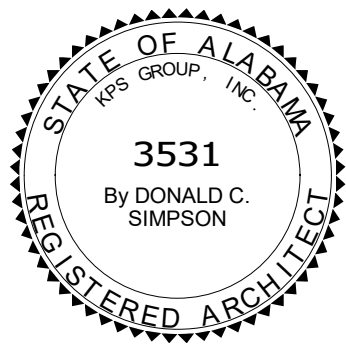

McLURE LIBRARY ADDITION AND RENOVATION


PACKAGE D - ADDITION AND RENOVATION

OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES


PROJECT ADDRESS:
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
WALL SECTIONS		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A3.22		

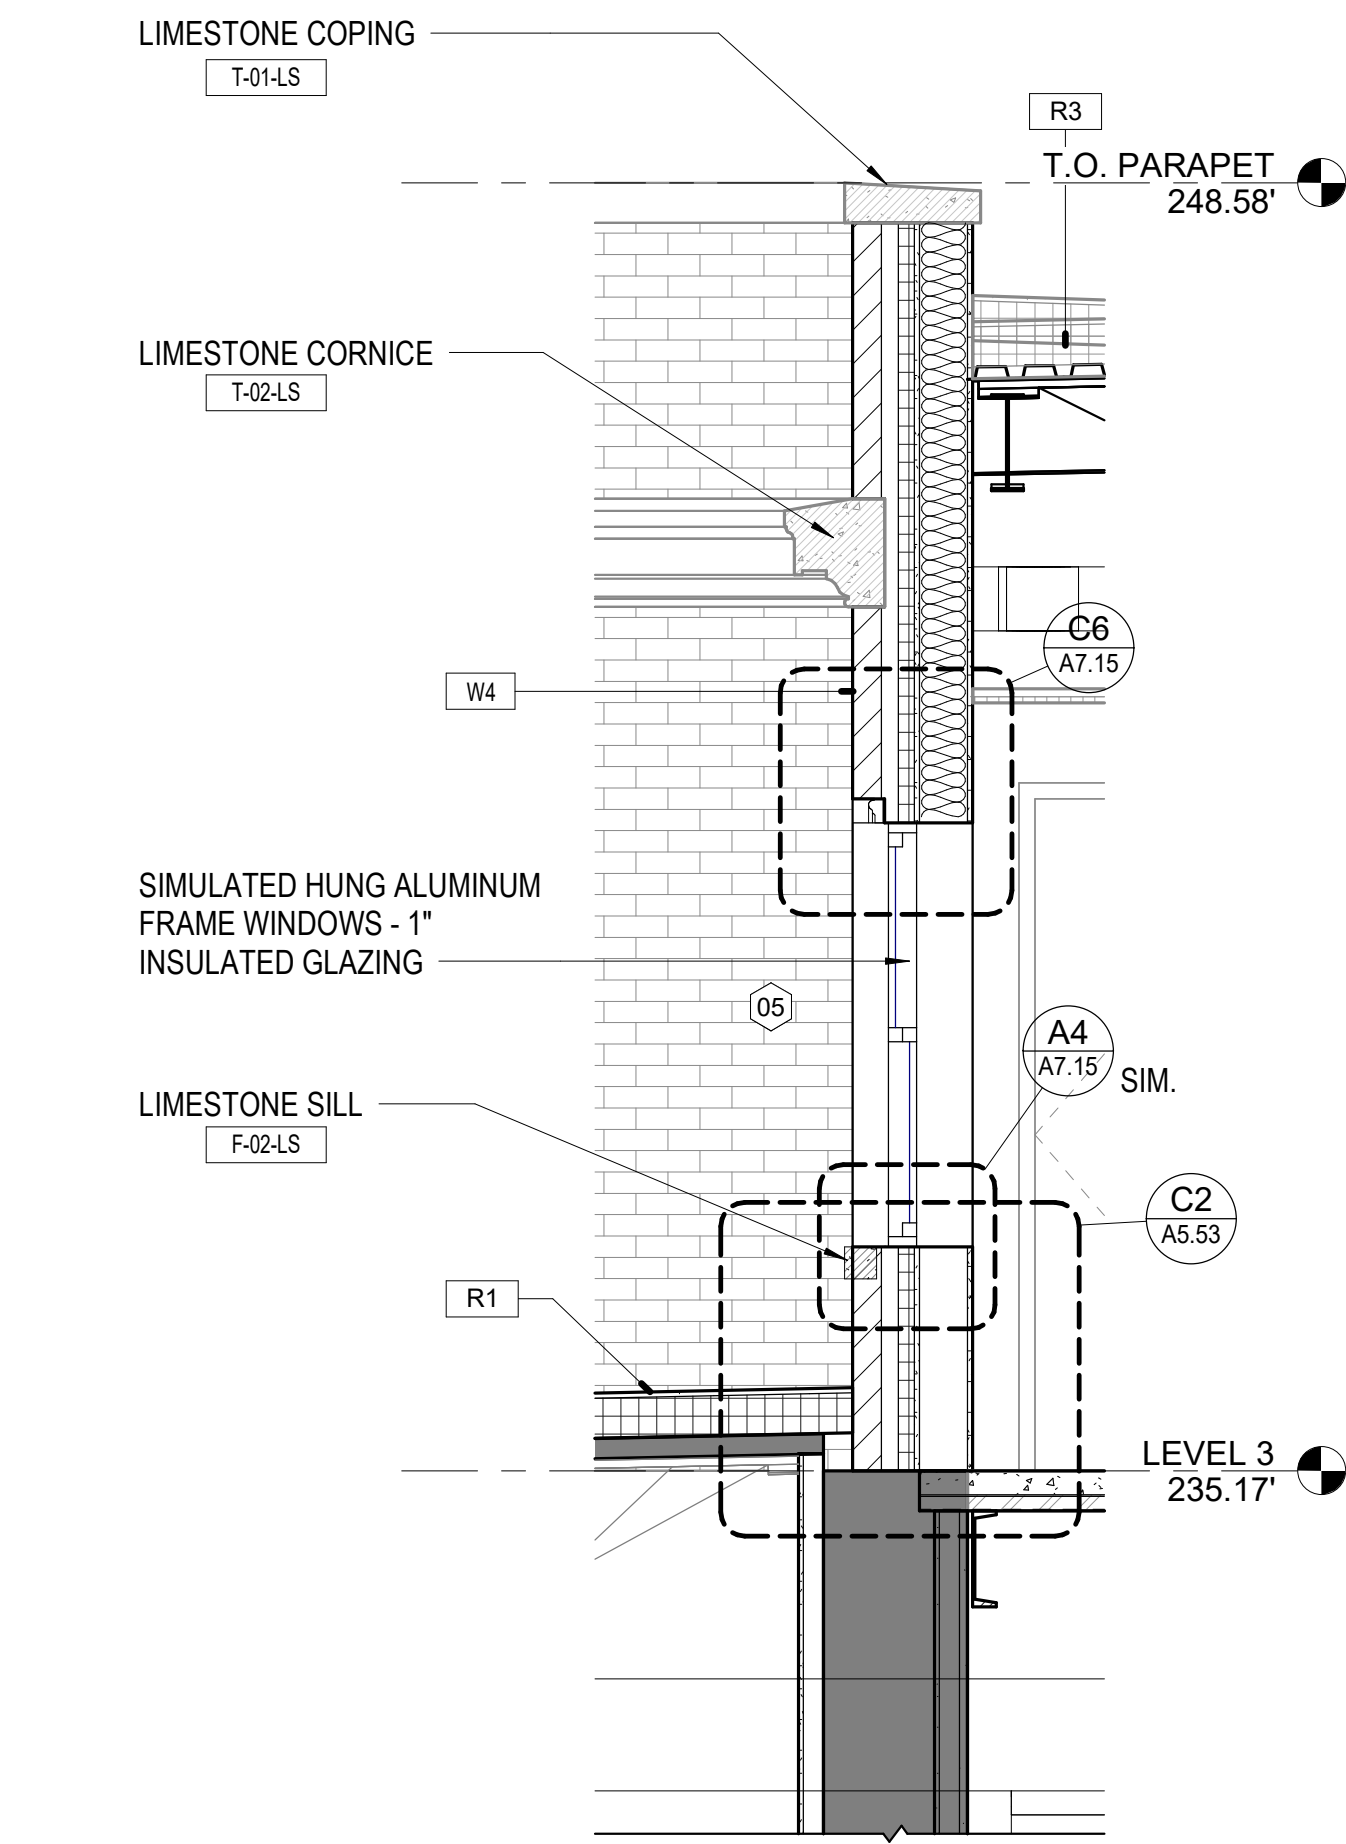


D6 WALL SECTION - AT ADDITION ABOVE ROOF
1/2" = 1'-0"

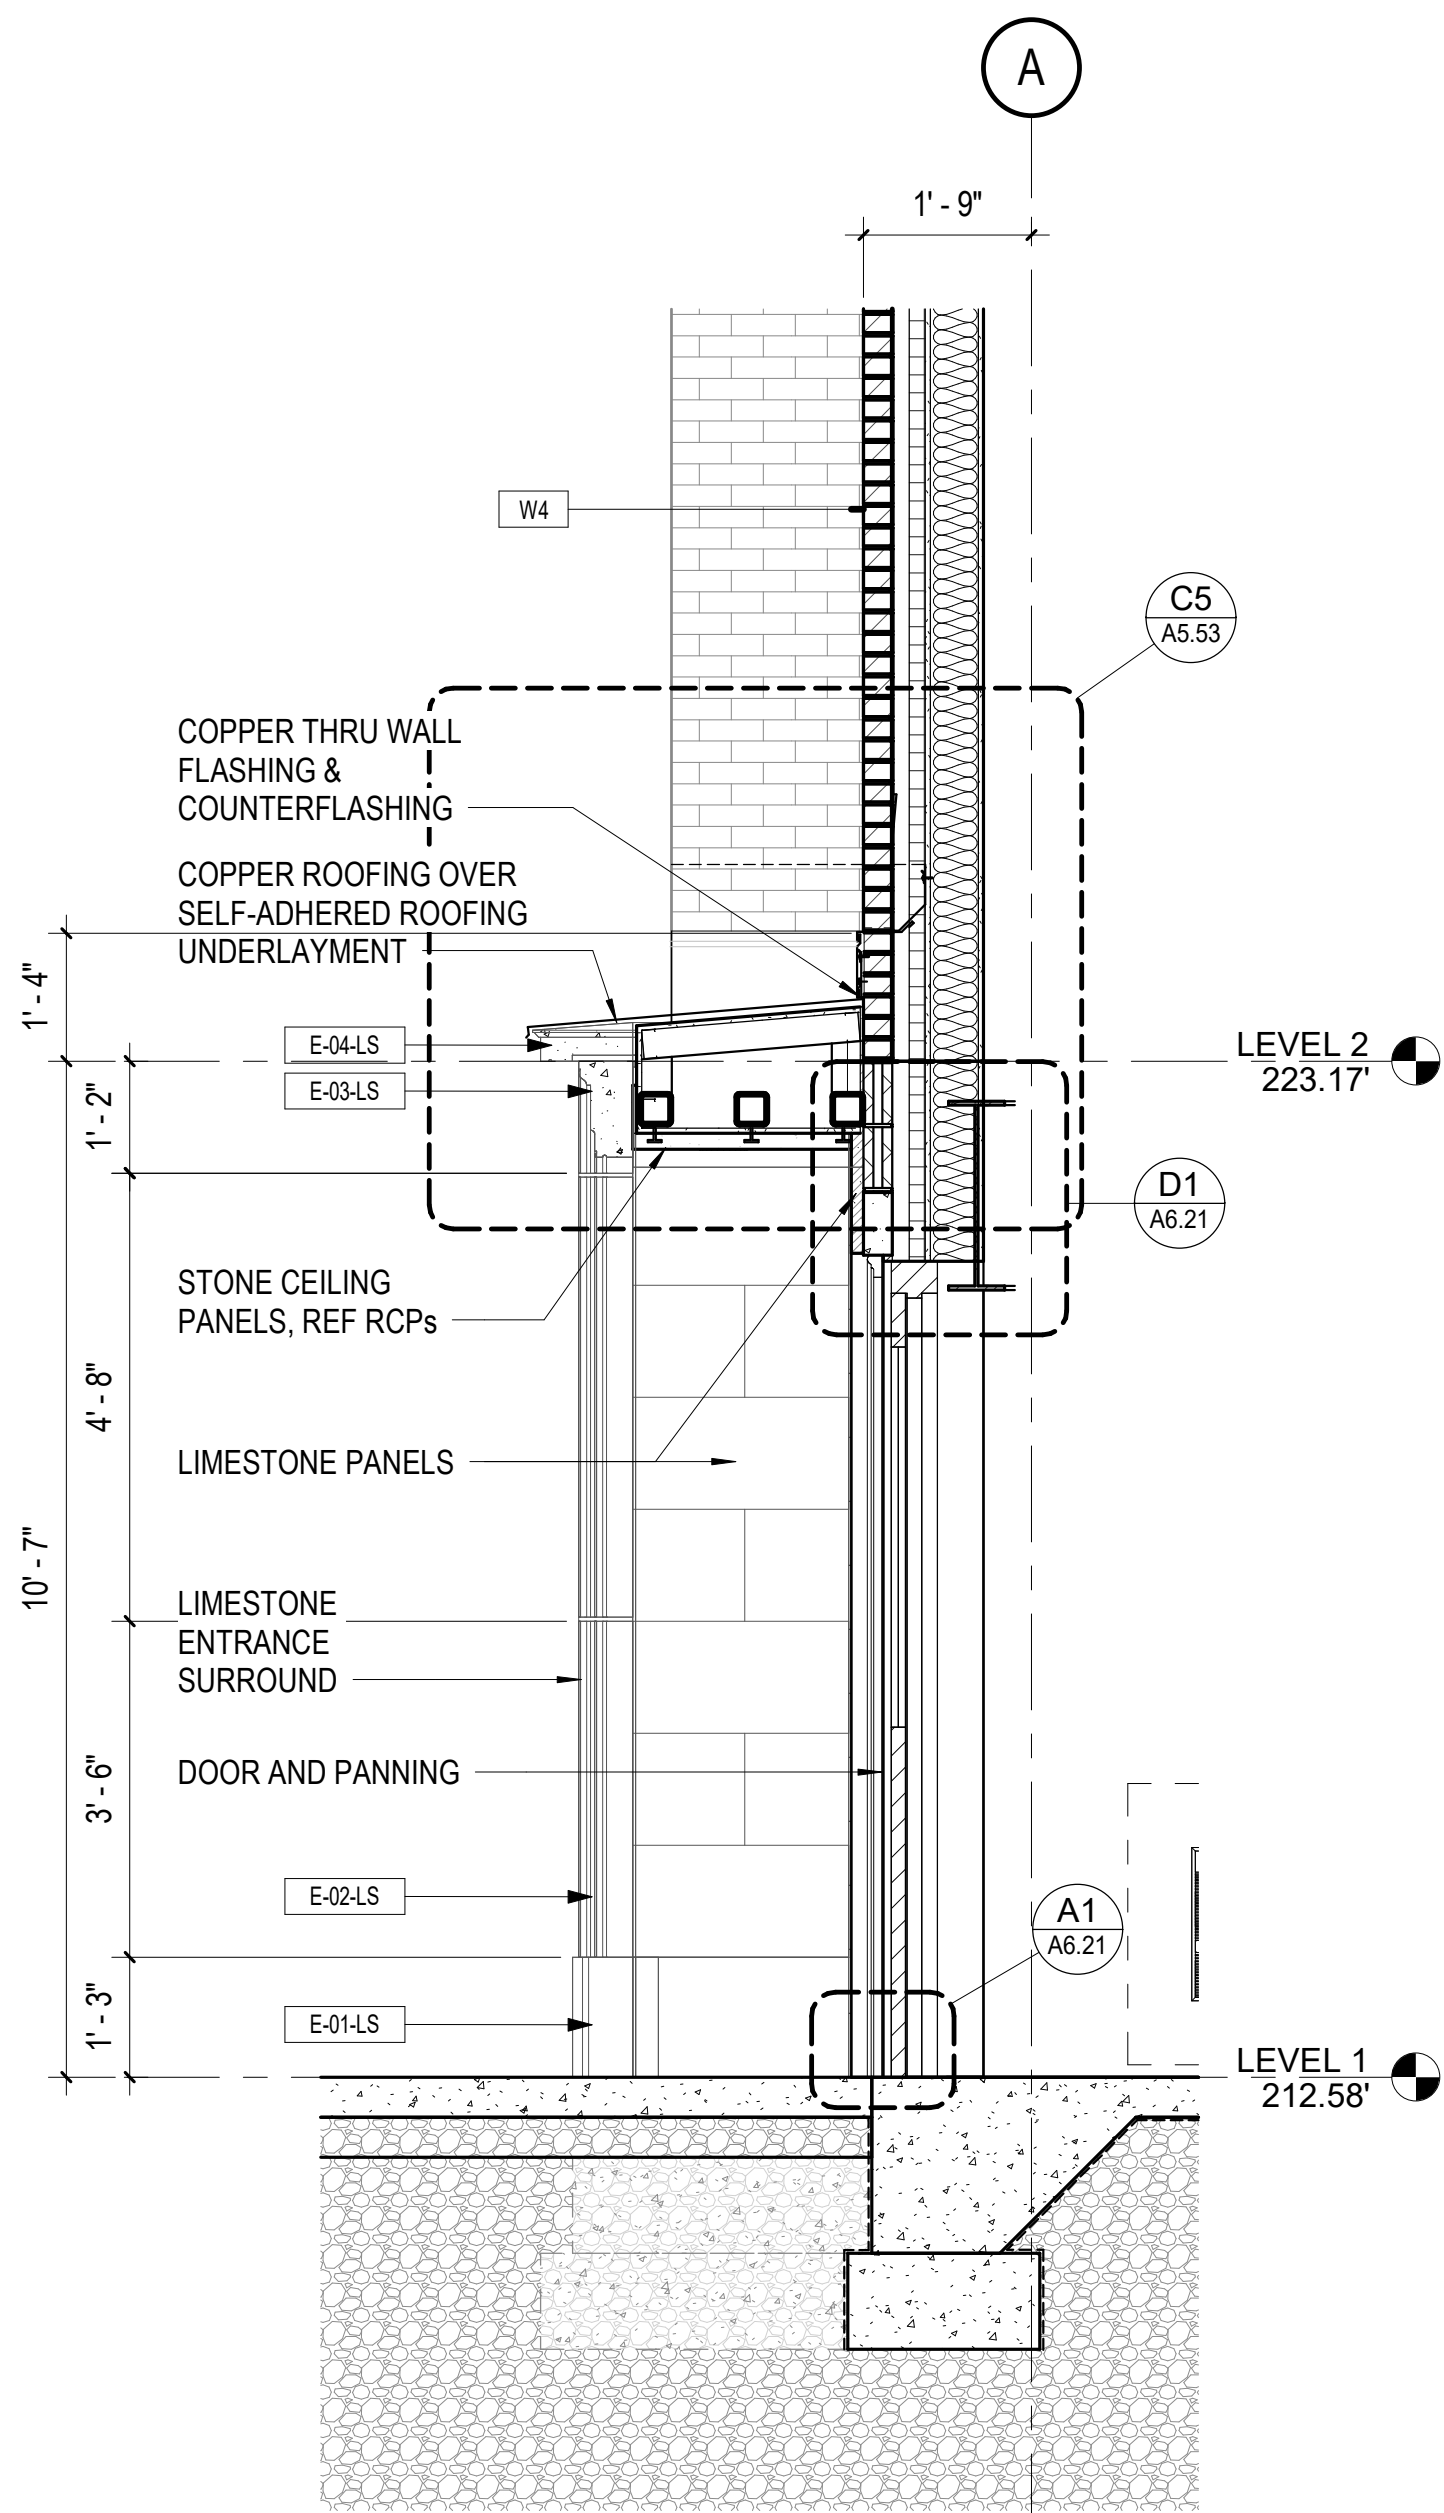

A6 WALL SECTION - CANOPY AT STAIR 2 EXIT
1/2" = 1'-0"

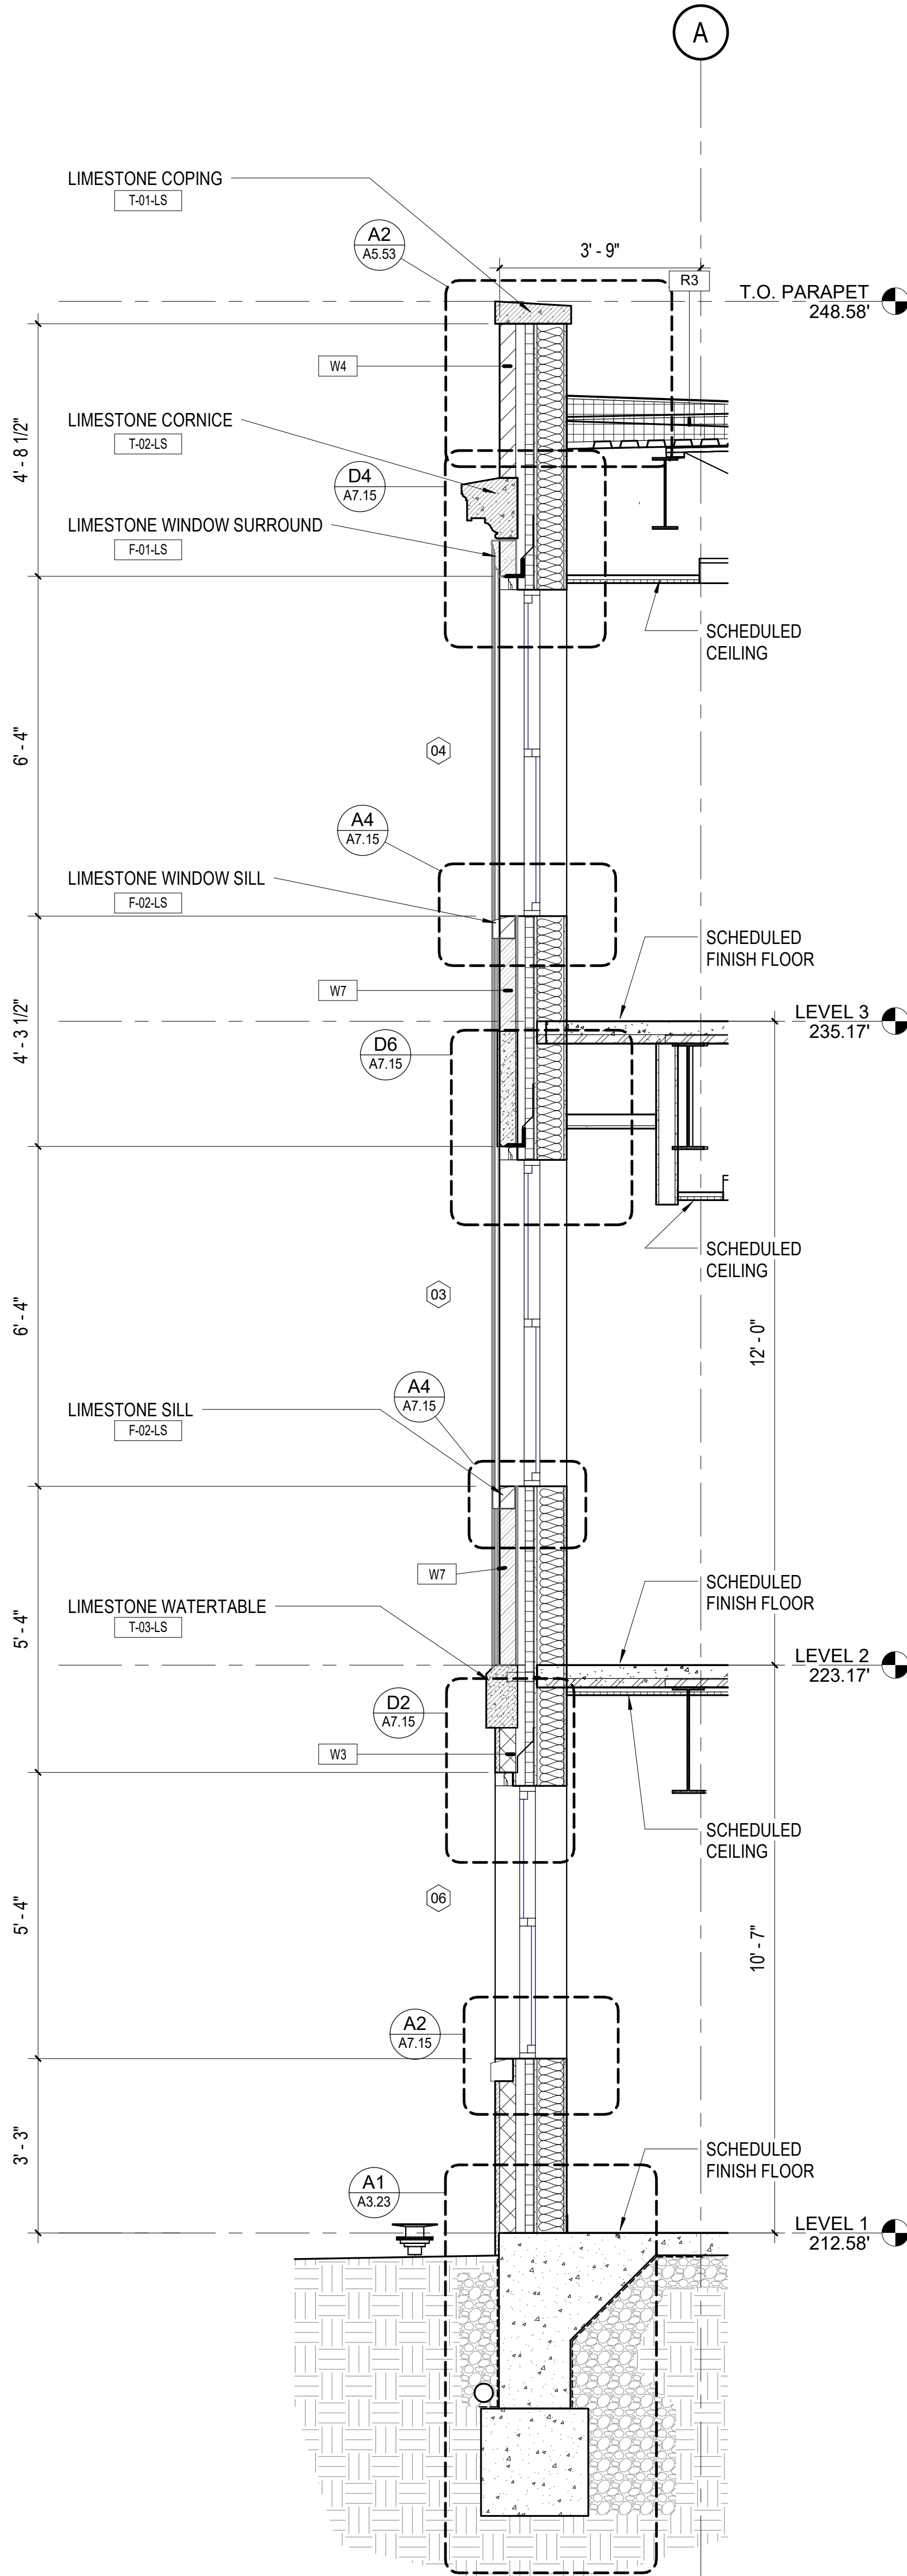

A4 WALL SECTION - AT ADDITION
1/2" = 1'-0"

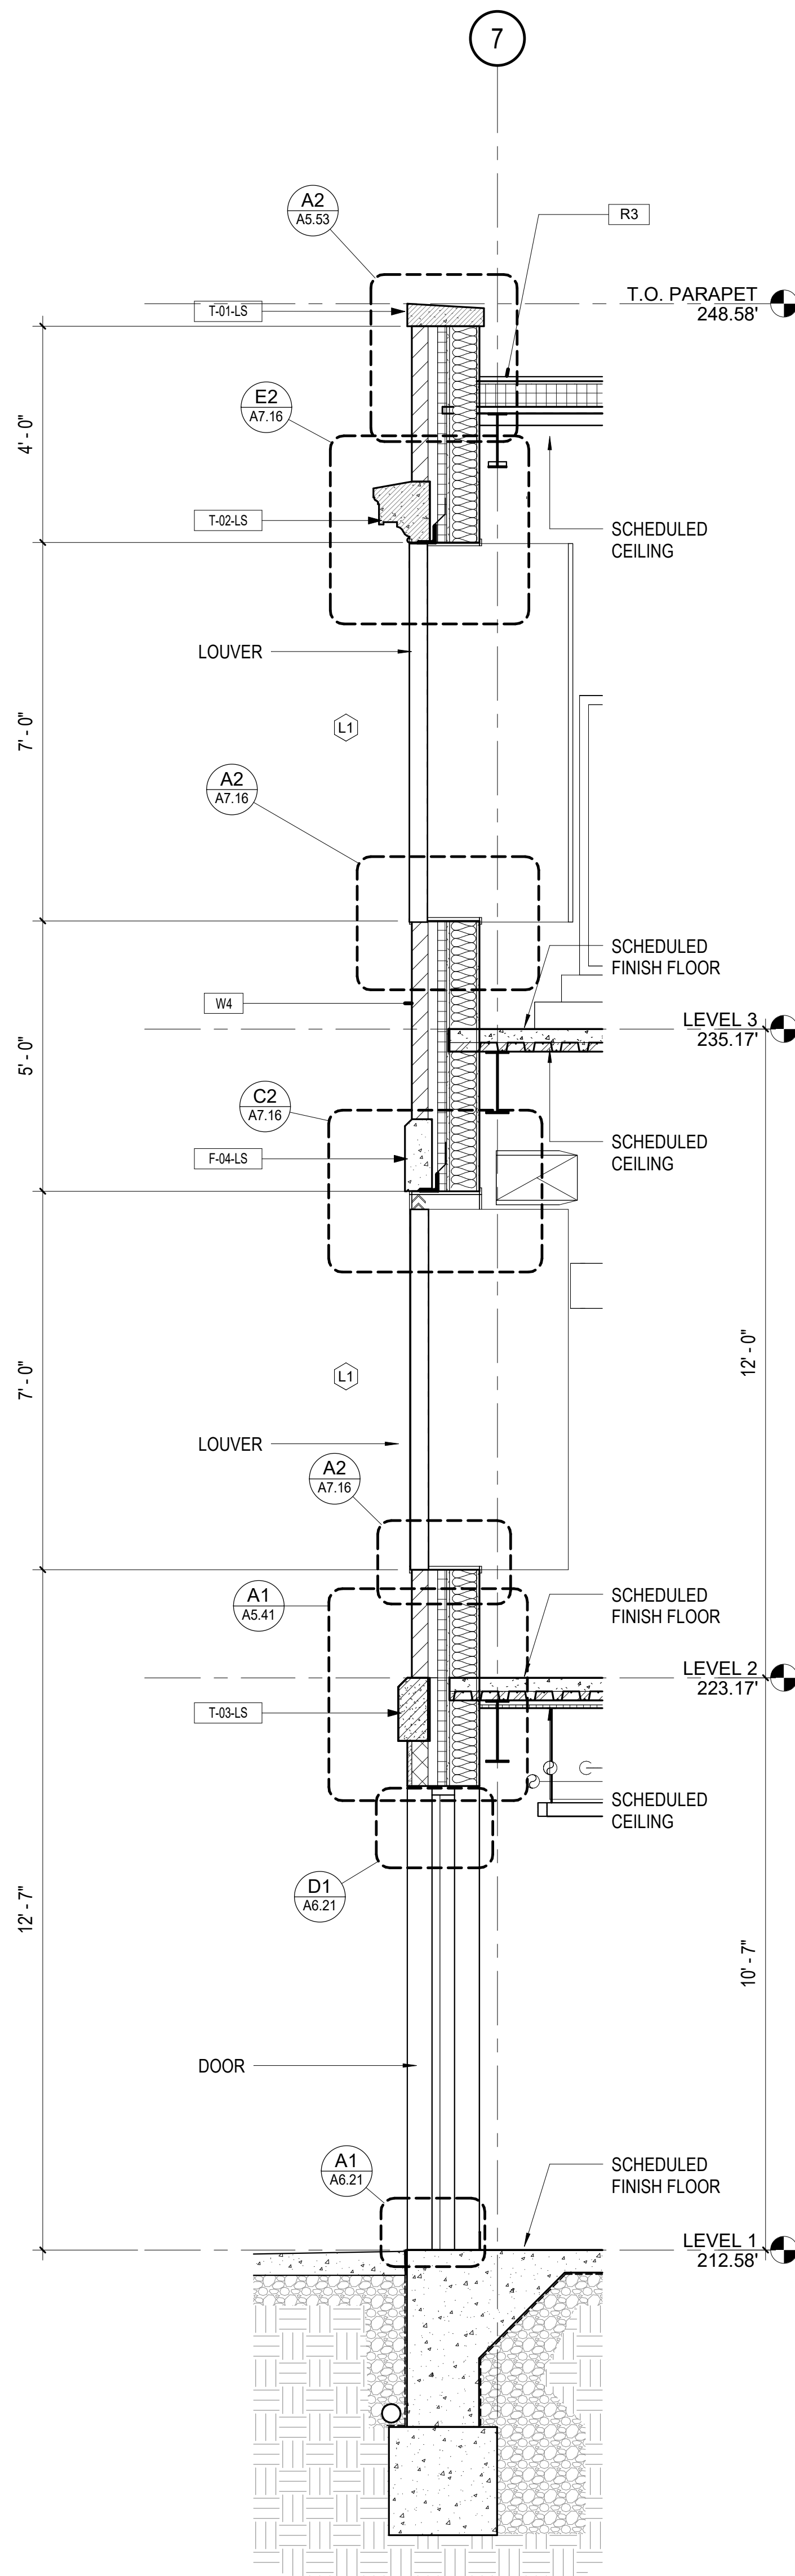


A2 WALL SECTION - AT ADDITION
1/2" = 1'-0"

EXTERIOR ASSEMBLIES LEGEND

- RE: SHEET A2.00 FOR TYPICAL EXTERIOR ASSEMBLIES CONSTRUCTION.
RE: WALL SECTIONS FOR DETAILS AND ADDITIONAL INFORMATION.
- RE: SHEET A7.11 FOR WINDOW SCHEDULE

- W1 WALL TYPE 1:**
EXISTING STUCCO (PATCH AND REPAIR AS NEEDED) / EXISTING CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W2 WALL TYPE 2:**
EXISTING STRUCTURAL BRICK MASONRY (PATCH AND REPAIR AS NEEDED) / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W3 WALL TYPE 3:**
LIME STUCCO / 4" NOM CMU / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL. MATCH STUCCO BLOCK PATTERN TO EXISTING WEST FACADE.
- W4 WALL TYPE 4:**
BRICK VENEER (RUNNING BOND) / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" O.C. W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- W5 WALL TYPE 5:**
LIME STUCCO / CONCRETE WALL / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF CONCRETE BETWEEN 2-1/2" METAL STUD FRAMING
- W6 WALL TYPE 6:**
EXISTING STONE PANEL (CLEAN AND REJOINT AS NEEDED) / STRUCTURAL BRICK MASONRY / OPEN CELL SPRAY FOAM INSULATION ON INTERIOR FACE OF BRICK BETWEEN 2-1/2" METAL STUD FRAMING
- W7 WALL TYPE 7:**
STONE PANEL TO MATCH EXISTING / AIR CAVITY / 2" XPS INSULATION (R-5 PER INCH MIN) / WEATHER BARRIER / EXTERIOR GLASS MAT GYPSUM BOARD SHEATHING / 6" COLD-FORMED METAL FRAMING @ 16" OC W/ CONTINUOUS SILL GASKETS INSTALLED AT EXTERIOR STUD WALLS, TYPICAL
- 1 EXTERIOR GLAZED OPENING TYPE - RE: SHEET A7.11**
- MJ MASONRY EXPANSION JOINT - MATCH BRICK COLOR; STUCCO CONTROL JOINT, SIMILAR**
- R1 ROOF TYPE 1:**
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD ADHERED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING CONCRETE ROOF DECK
- R2 ROOF TYPE 2:**
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON EXISTING WOOD DECKING.
- R3 ROOF TYPE 3:**
SINGLE-PLY SMOOTH-BACKED MEMBRANE FULLY ADHERED TO 1/2" COVER BOARD MECHANICALLY ANCHORED TO POLYISO ROOF INSULATION (R-25 MIN) ON METAL ROOF DECKING

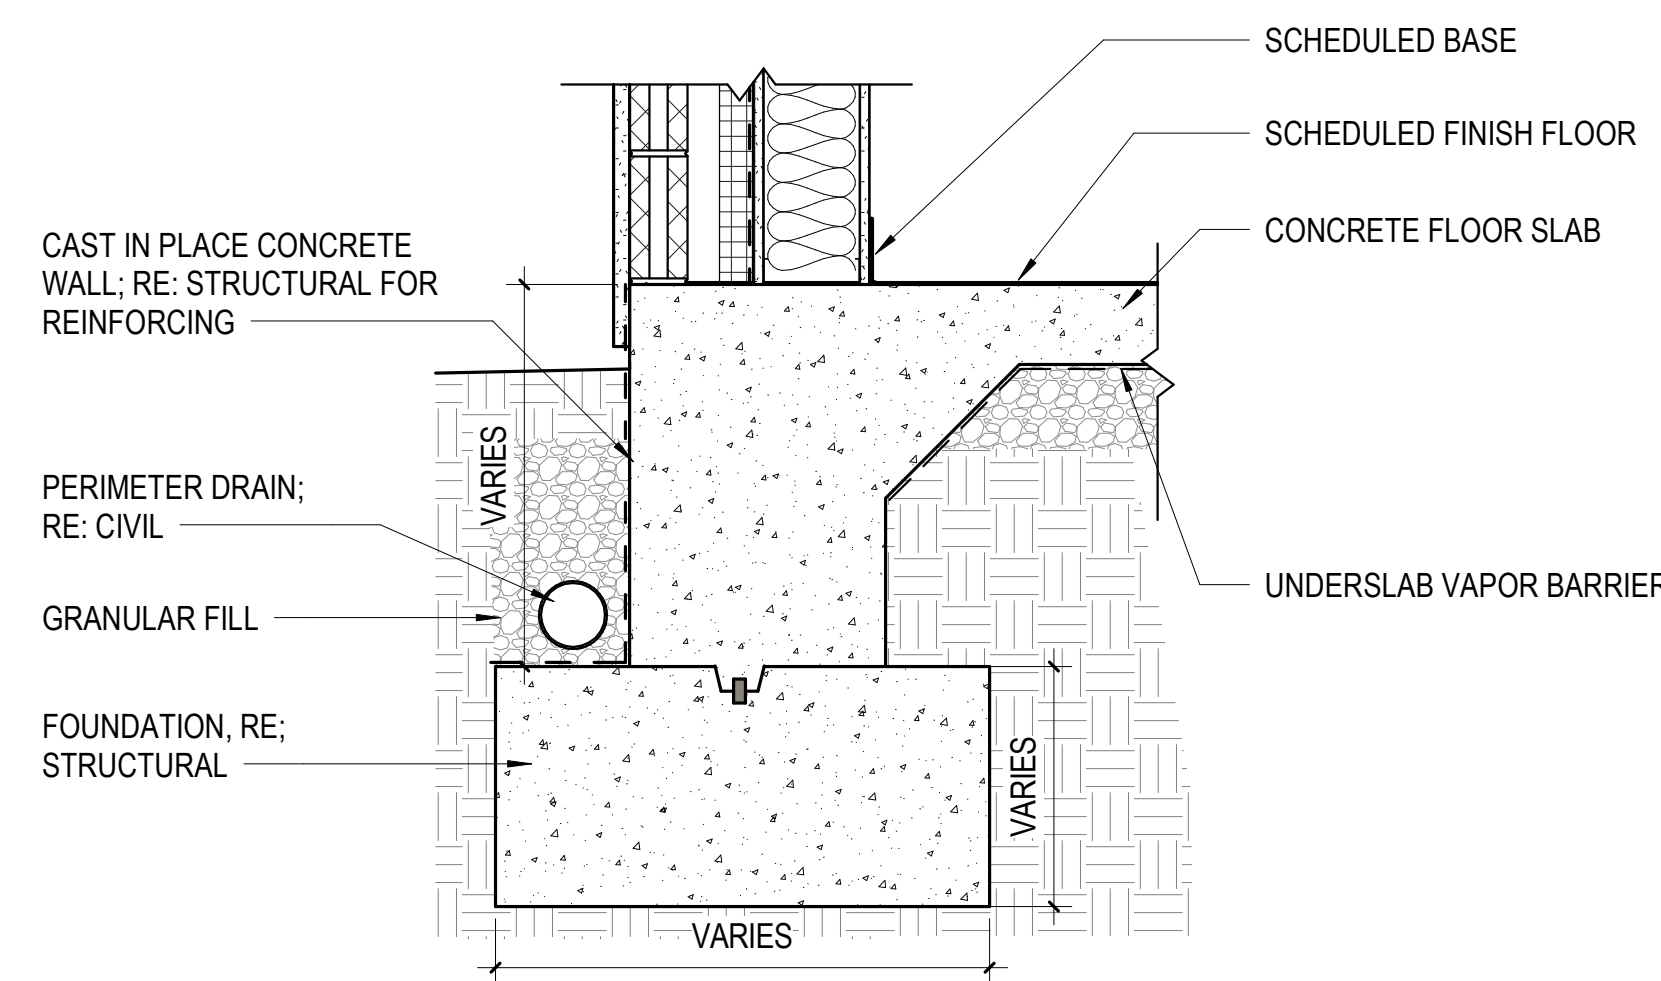

A1 DETAIL - FOUNDATION @ ADDITION
1" = 1'-0"

K|P|S GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
REGISTERED ARCHITECT
3531
By DONALD C. SIMPSON

McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE
WALL SECTIONS

DRAWN BY: Author
CHECKED BY: Checker








PROJECT NUMBER
236002-02

DRAWING NO.
A3.23


1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL, UNLESS NOTED OTHERWISE. REFER TO ARCHITECTURAL DRAFTING NOTES ON SHEET A-0.01 FOR ADDITIONAL CLARIFICATIONS.
2. PARTITION TYPES SCHEDULED ON SHEET 64.01, RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
3. RE: SHEET G-0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
4. ALL PARTITIONS TO BE TYPE S34 UNLESS NOTED OTHERWISE.
5. NOT USED
6. PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
7. PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
8. MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
9. WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
10. FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
11. CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
12. REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
13. ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

The diagram illustrates various view types and their corresponding symbols and labels:


- COLUMN LINE (NEW):** Represented by a circle containing the number 0.
- COLUMN LINE (EXISTING):** Represented by a hexagon containing the number 0.
- VIEW TYPES:**
 - BUILDING ELEVATION:** Represented by a diamond symbol with a triangle on top, containing the number 1 and the label A101. Labels include "ELEVATION #", "BUILDING ELEVATION", and "DRAWING SHEET".
 - BUILDING SECTION:** Represented by a diamond symbol with a triangle on top, containing the number 1 and the label A101. Labels include "DRAWING SHEET" and "SECTION CUT #".
 - WALL SECTION:** Represented by a diamond symbol with a triangle on top, containing the number 1 and the label A101. Labels include "DRAWING SHEET" and "CALLOUT #".
 - DETAIL / ENLARGED PLAN CALLOUT:** Represented by a circle containing the number 1 and the label A101, connected to a dashed rectangular box. Labels include "DRAWING SHEET" and "CALLOUT #".
 - INTERIOR ELEVATION VIEW:** Represented by a diamond symbol with a triangle on top, containing the number 1 and the label A101. Labels include "ELEVATION #", "INTERIOR ELEVATION VIEW", and "DRAWING SHEET".

ROOM NAME/NUMBER	
DOOR NUMBER	
WINDOW TYPE	
STOREFRONT / CURTAIN WALL	
WALL TYPE TAG	
DRAWING SHEET KEYNOTE	
REVISION NUMBER	


NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

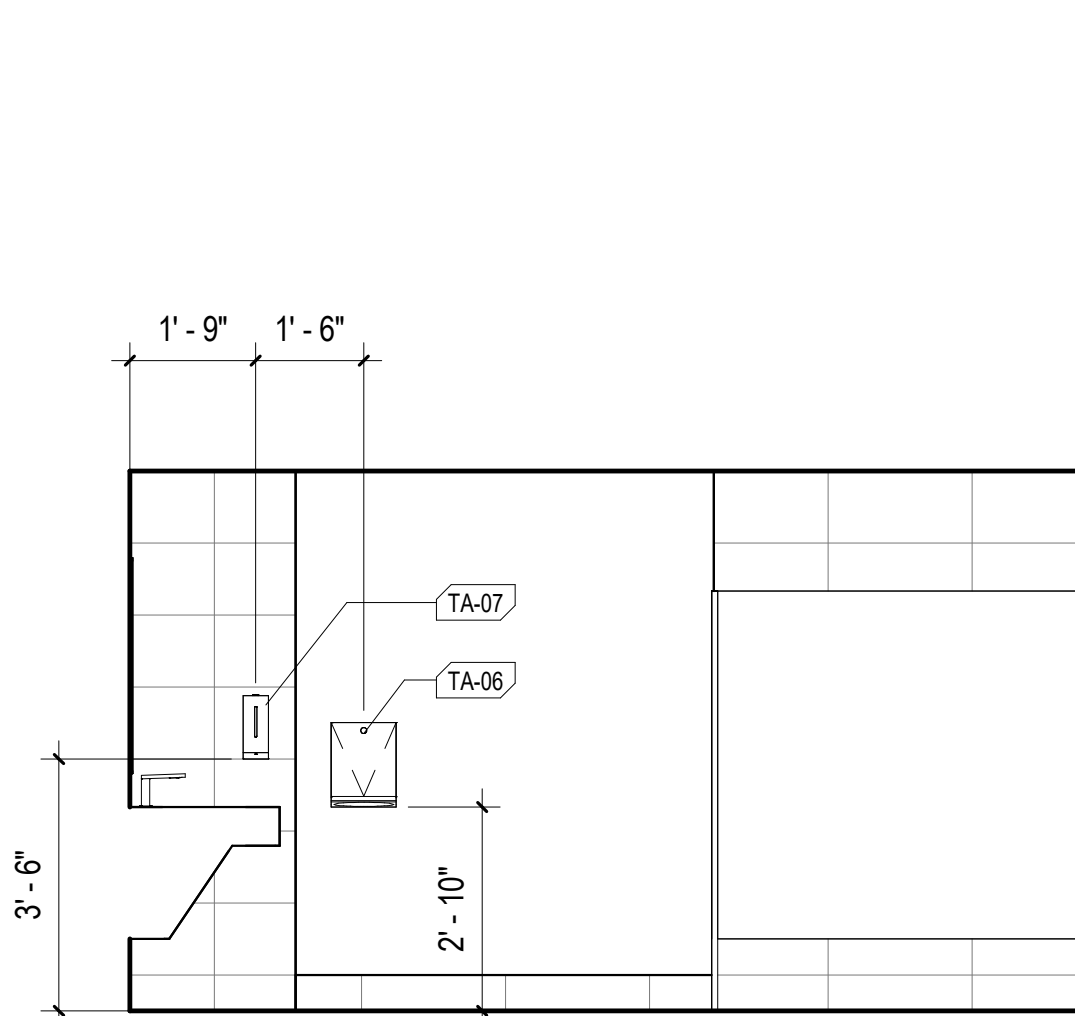


D6 ELEVATION - WOMEN (WEST)
3/8" = 1'-0"

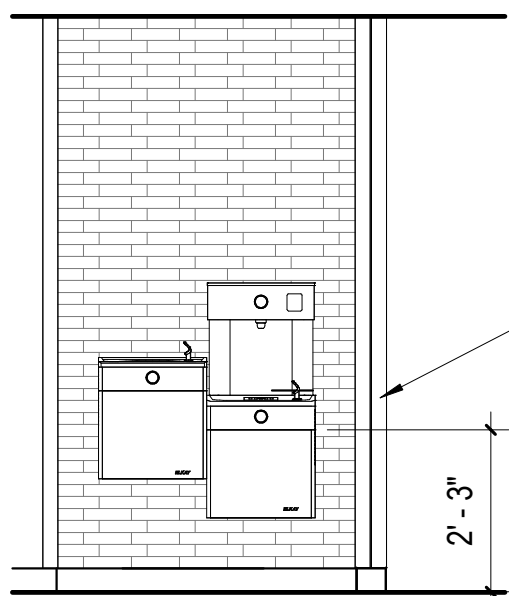


D5 ELEVATION - WATERCOOLER, TYPE
3/8" = 1'-0"

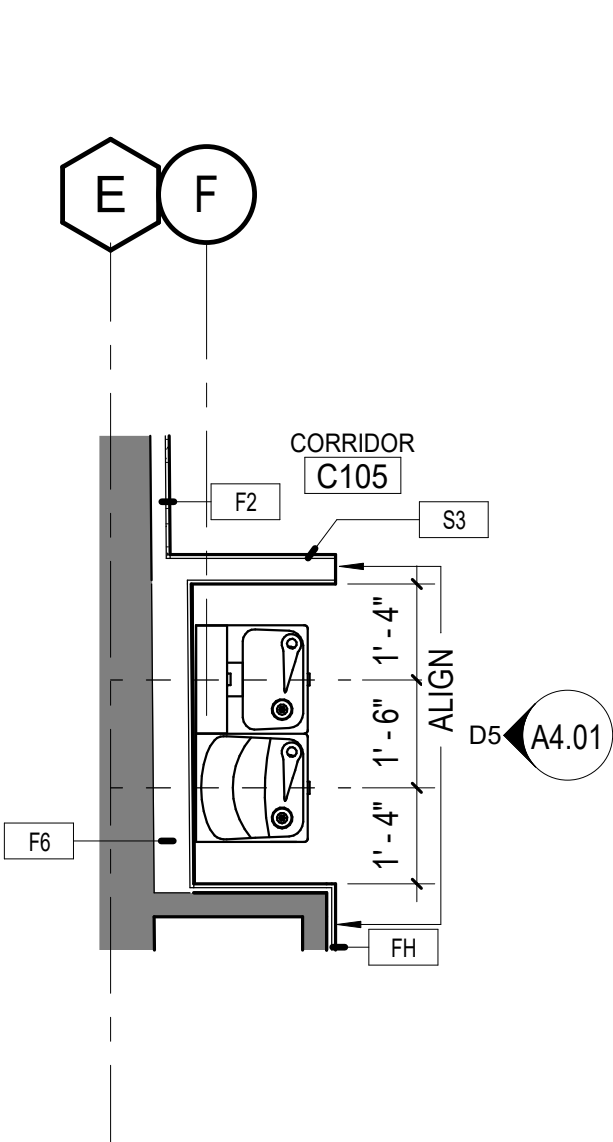


D3 ENLARGED PLAN - WATERCOOLER, TYPE
3/8" = 1'-0"

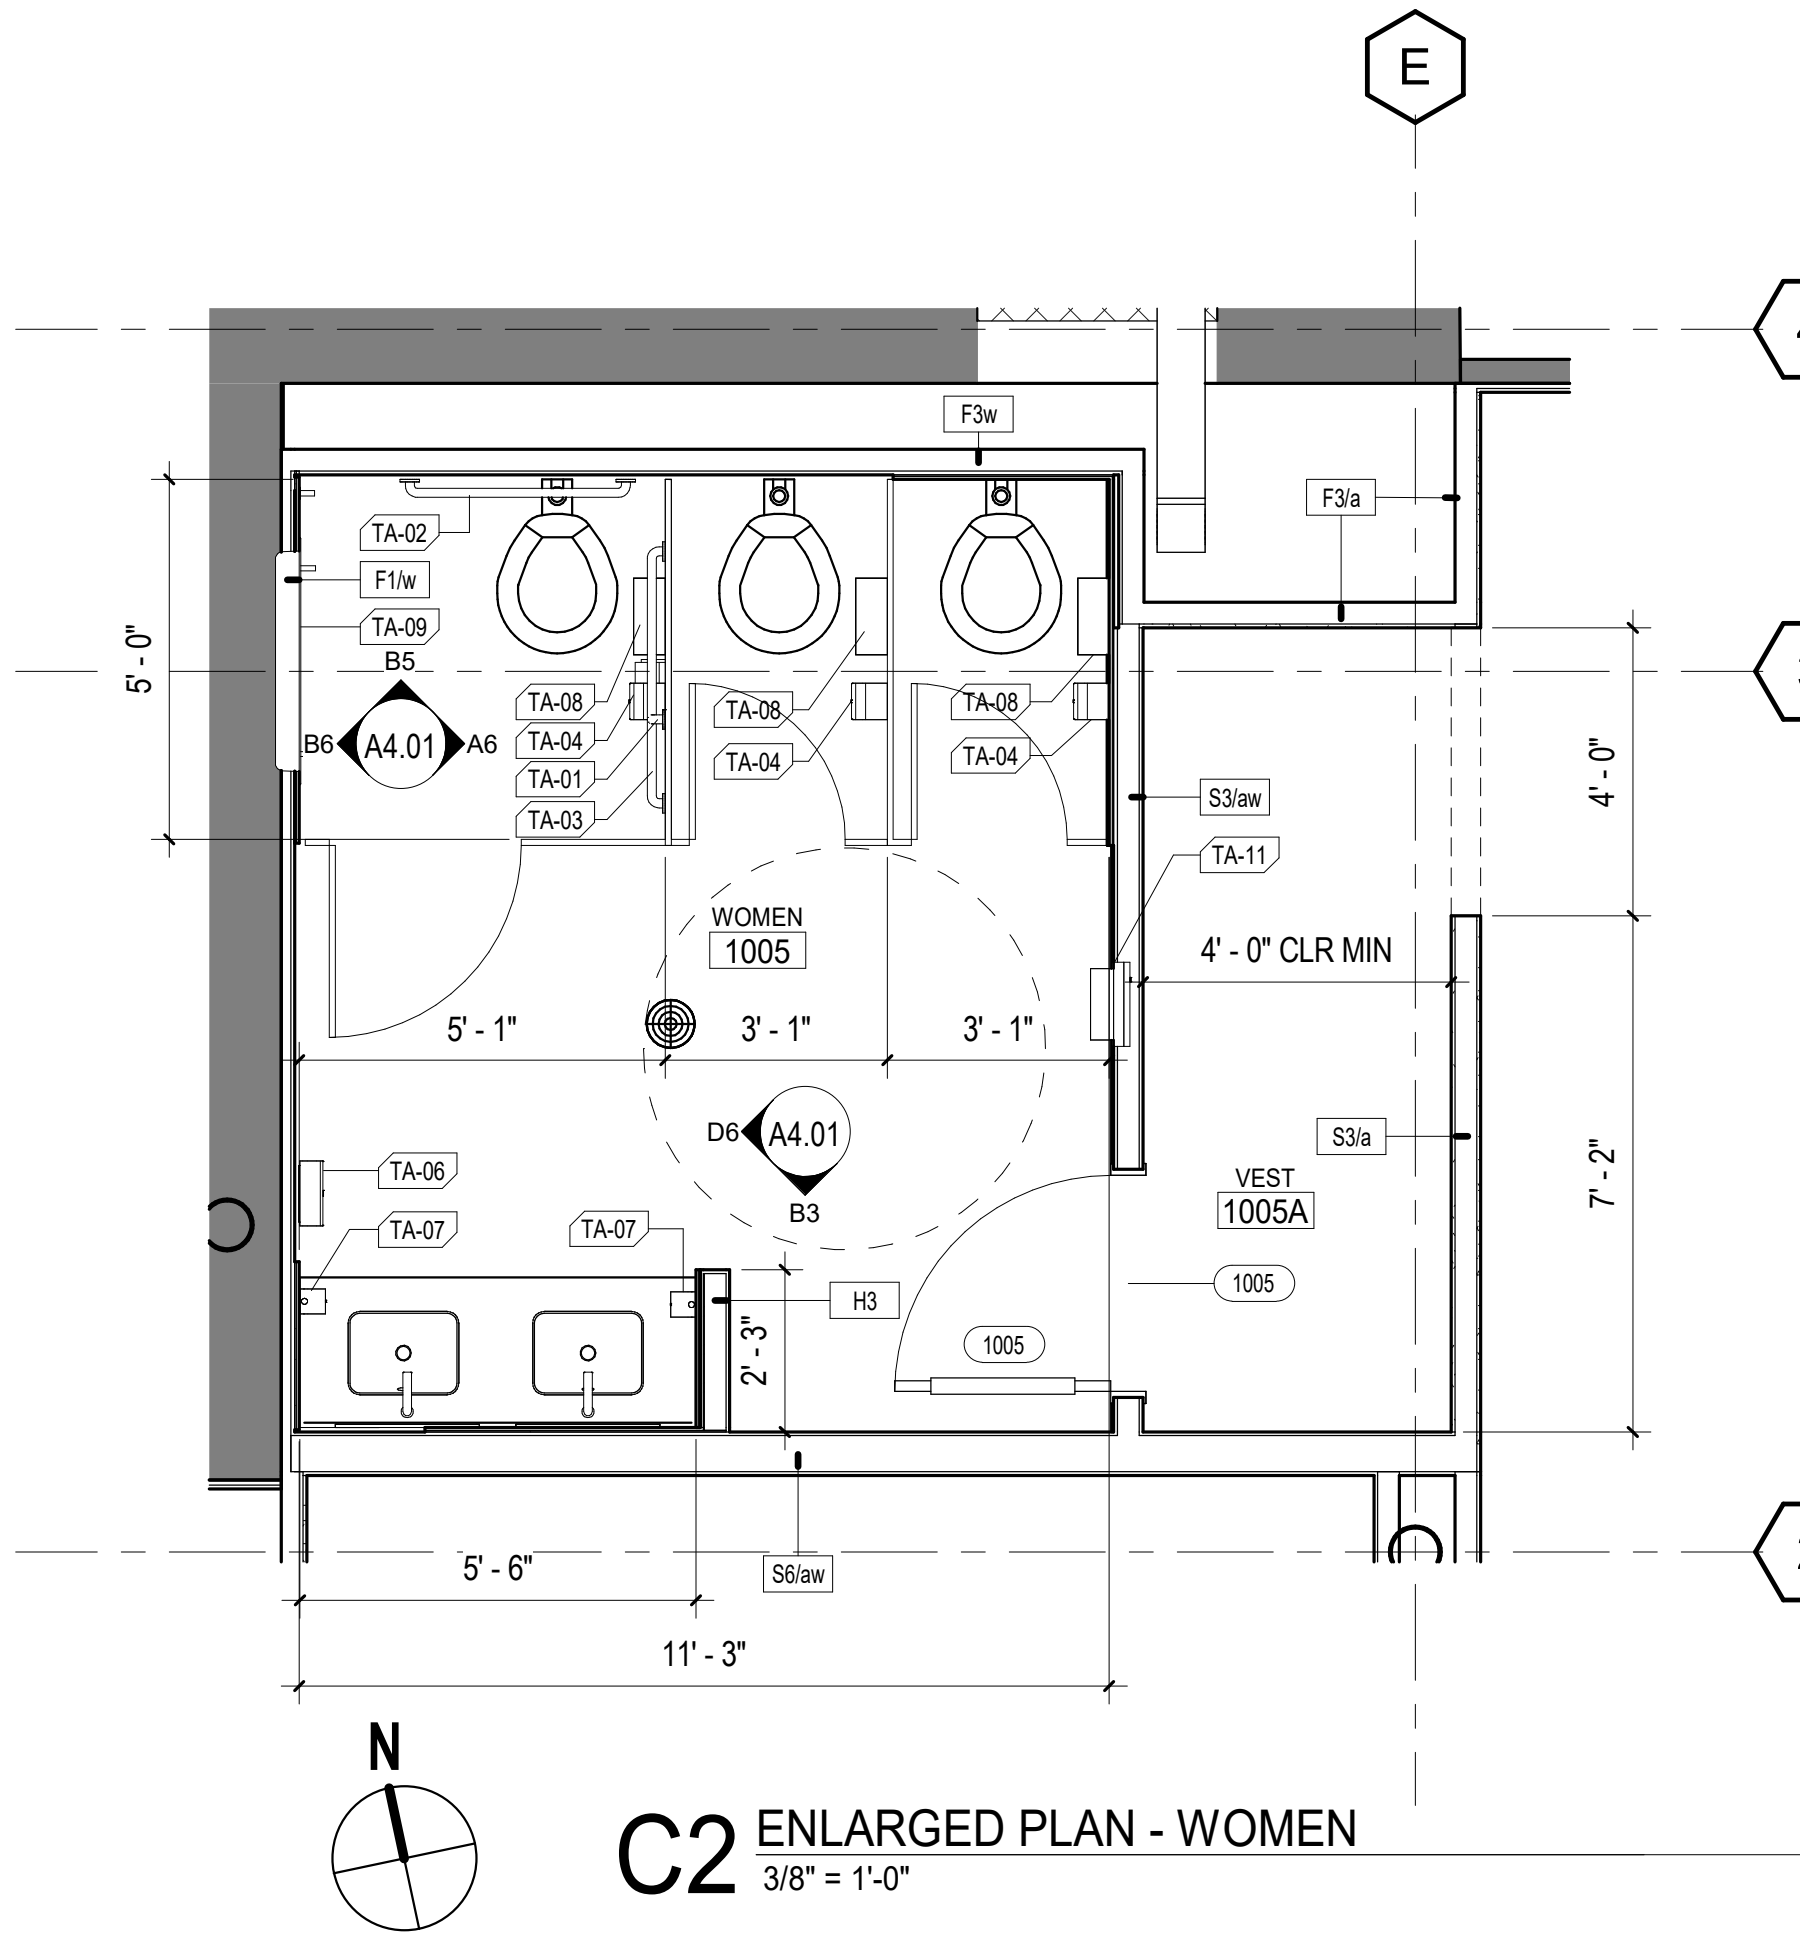


C2 ENLARGED PLAN - WOMEN
3/8" = 1'-0"

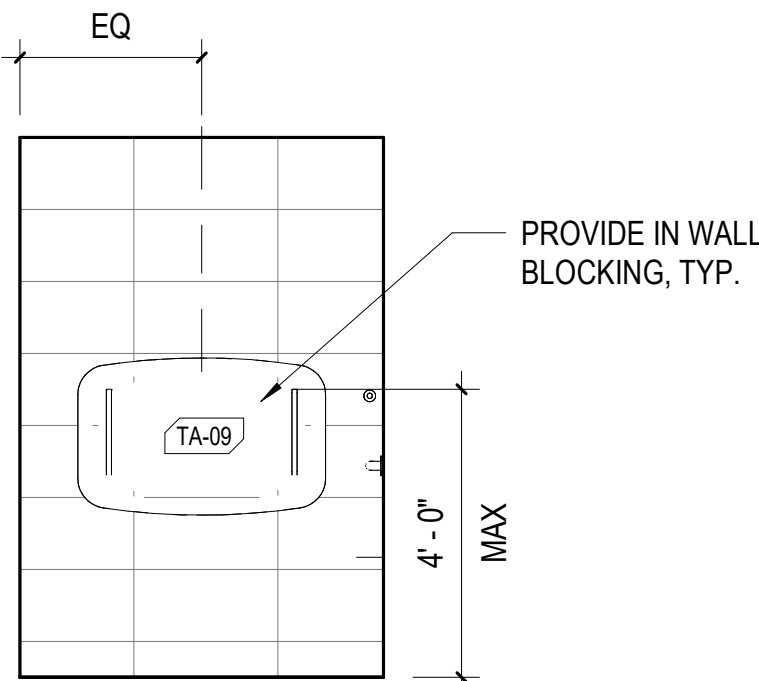


B6 ELEVATION - BABY CHANGING STATION
3/8" = 1'-0"

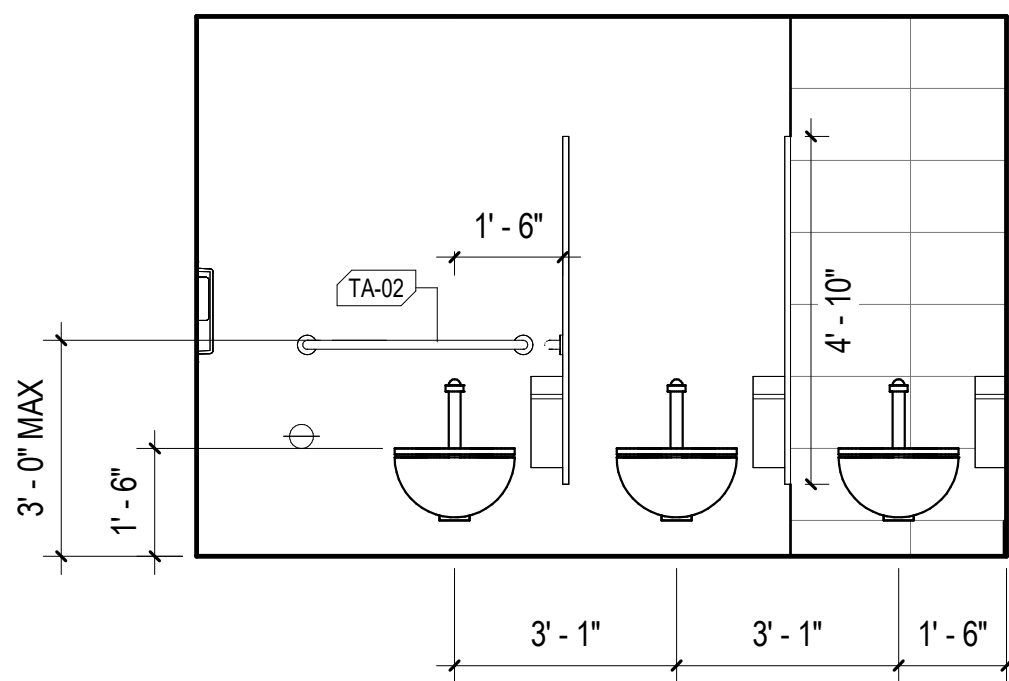


B5 ELEVATION - WOMEN (NORTH)
3/8" = 1'-0"

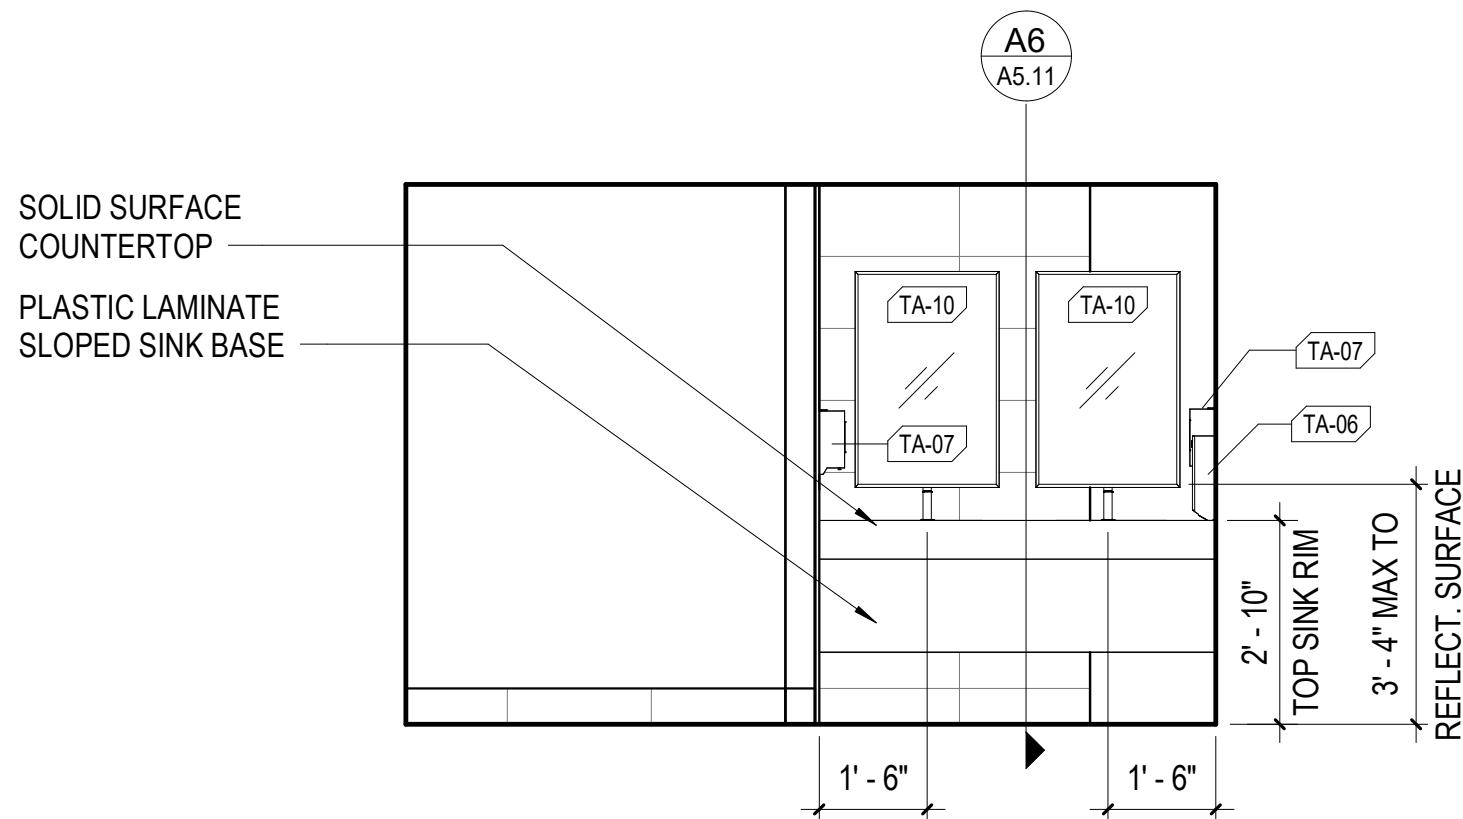


B3 ELEVATION - WOMEN (SOUTH)
3/8" = 1'-0" MEN'S NORTH SIM

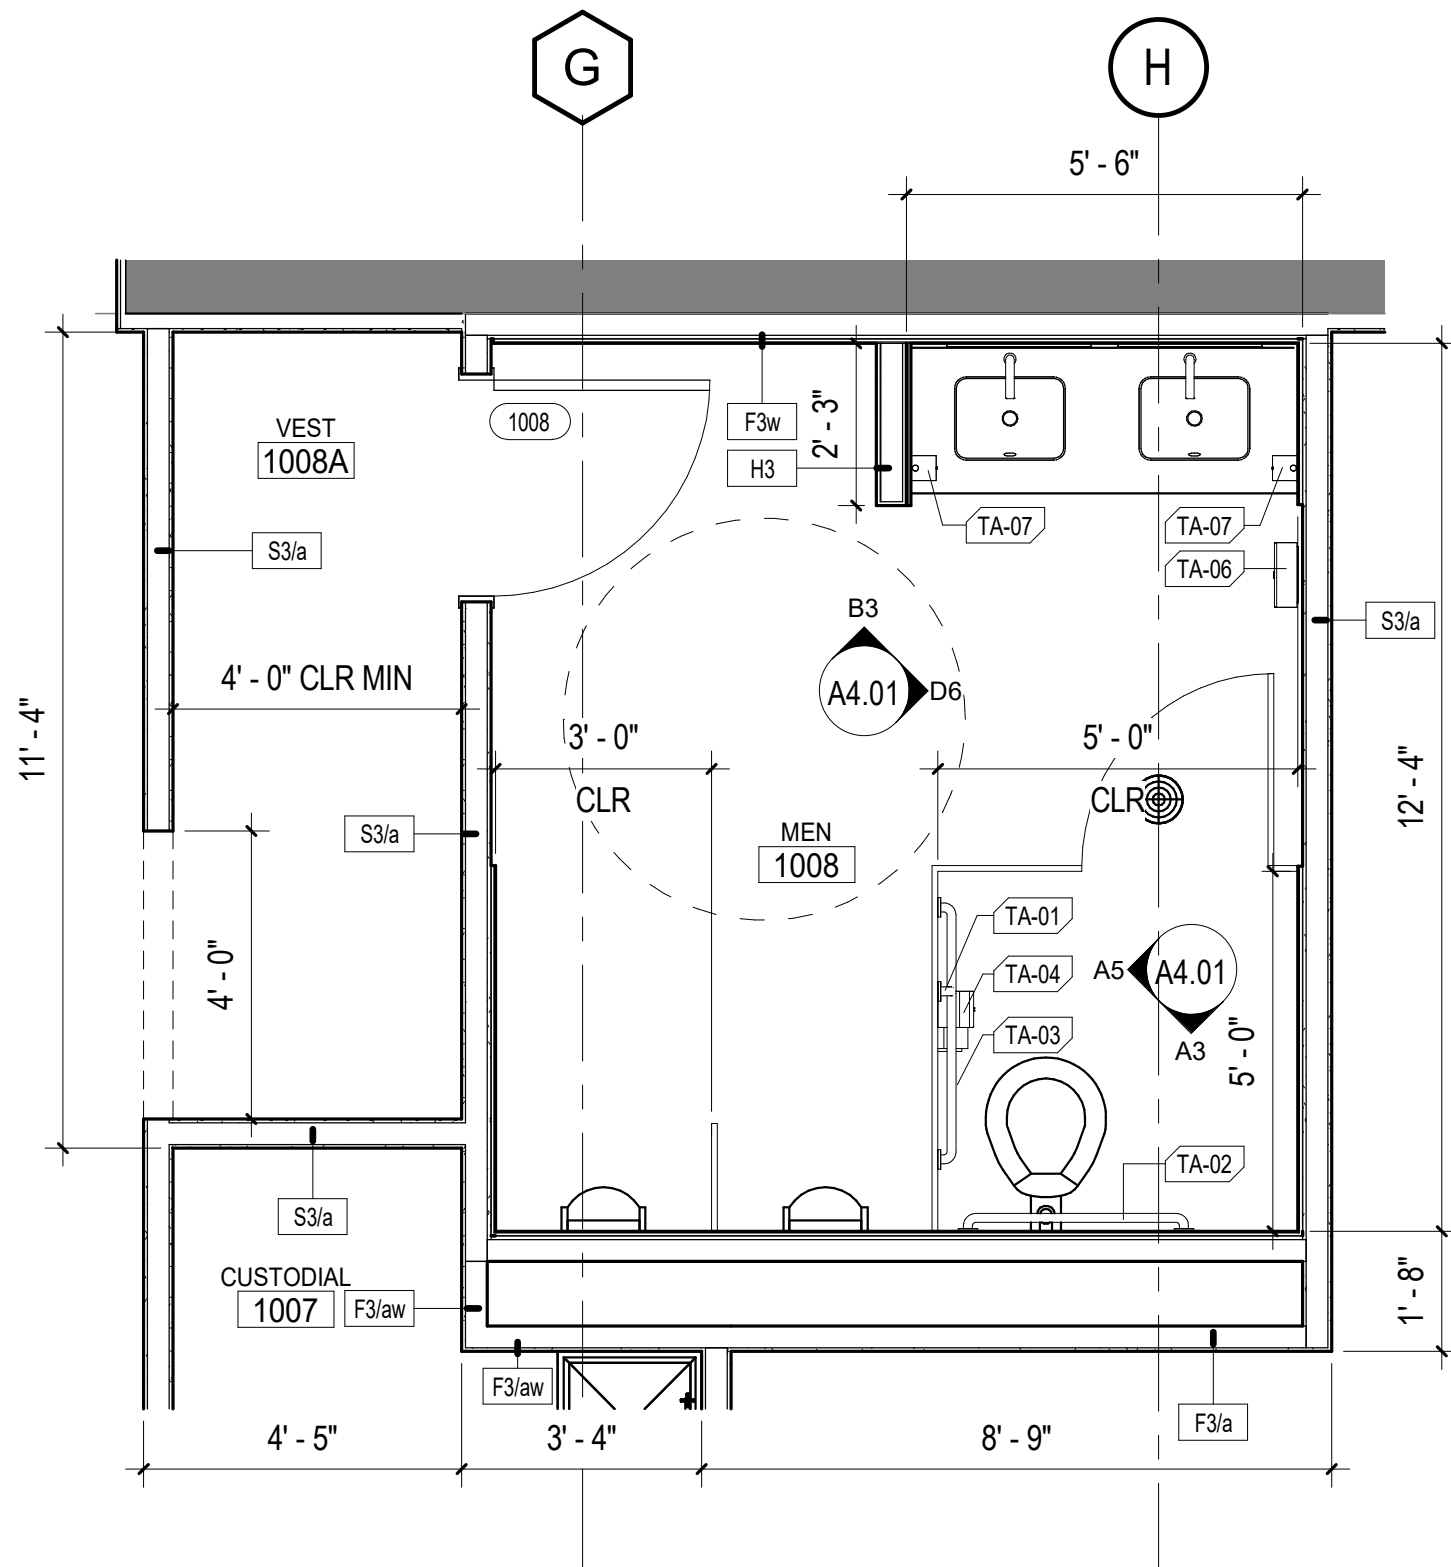


A1 ENLARGED PLAN - MEN
3/8" = 1'-0"

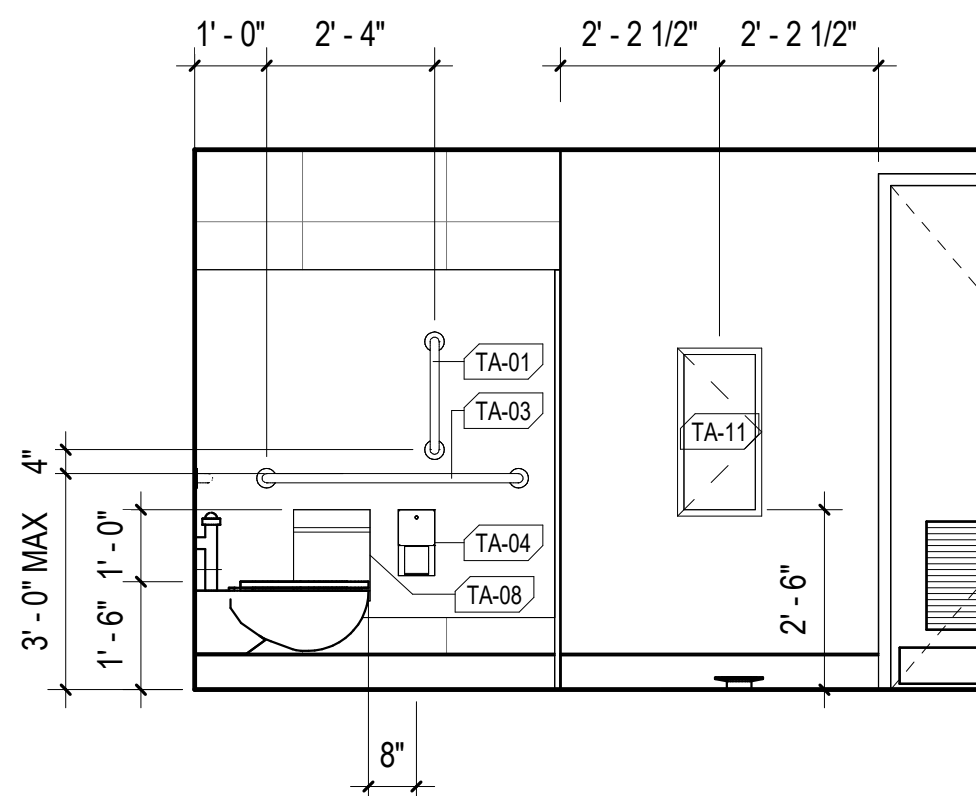

A6 ELEVATION - WOMEN (EAST)
3/8" = 1'-0"

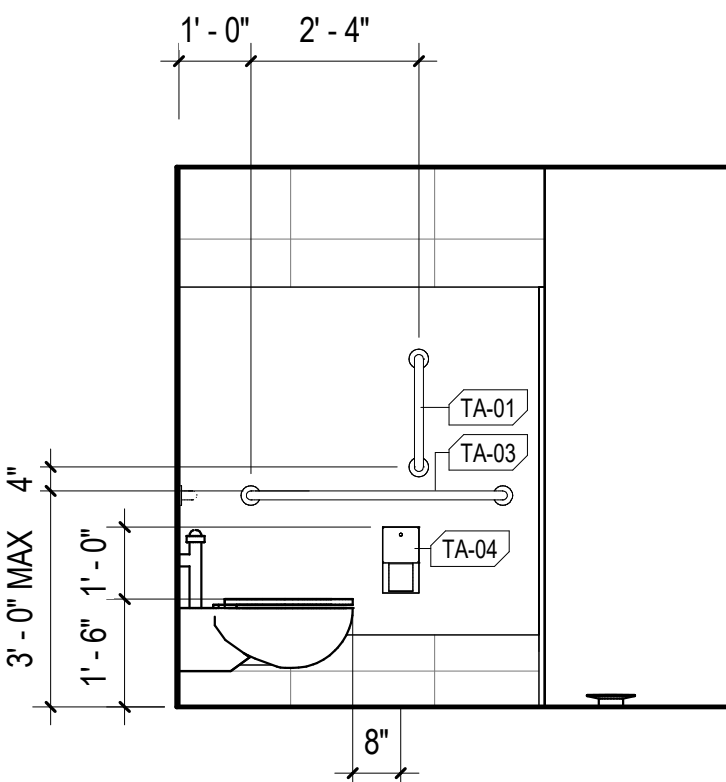

A5 ELEVATION - MEN (WEST)
3/8" = 1'-0"

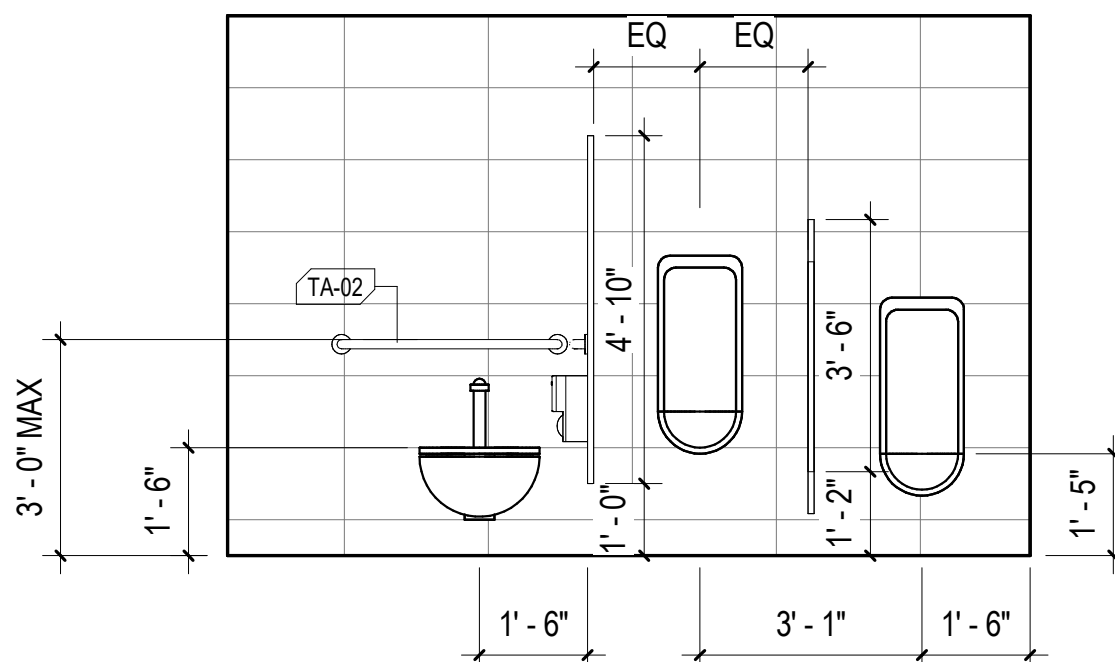

A3 ELEVATION - MEN (SOUTH)
3/8" = 1'-0"




1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/ REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
2. PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXIST OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
3. RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
4. ALL PARTITIONS TO BE TYPE S3@a UNLESS NOTED OTHERWISE.
5. NOT USED
6. PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6"MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
7. PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDE TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
8. MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
9. WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
10. FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
11. CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
12. REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
13. ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

The diagram illustrates various architectural view types and their corresponding symbols and labels:


- COLUMN LINE (NEW)**: A circle with the number **0** inside.
- COLUMN LINE (EXISTING)**: A hexagon with a circle inside, containing the number **0**.
- VIEW TYPES**: A large heading for the section below.
- BUILDING ELEVATION**: A triangle pointing up with a circle inside containing the number **1** and the label **A101**. Labels include **ELEVATION #** and **DRAWING SHEET**.
- BUILDING SECTION**: A triangle pointing up with a circle inside containing the number **1** and the label **A101**. Labels include **DRAWING SHEET** and **SECTION CUT #**.
- WALL SECTION**: A diamond shape with a circle inside containing the number **1** and the label **A101**. Labels include **DRAWING SHEET** and **CALLOUT #**.
- DETAIL / ENLARGED PLAN CALLOUT**: A circle with the number **1** and the label **A101** inside. A dashed rectangular box is shown next to it. Labels include **CALLOUT #** and **DRAWING SHEET**.
- INTERIOR ELEVATION VIEW**: A diamond shape with a circle inside containing the number **1** and the label **A101**. Labels include **ELEVATION #** and **DRAWING SHEET**.

ROOM NAME/NUMBER	ROOM NAME 101
DOOR NUMBER	101
WINDOW TYPE	1
STOREFRONT / CURTAIN WALL	SF-22
WALL TYPE TAG	S3
DRAWING SHEET KEYNOTE	1
REVISION NUMBER	1



NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

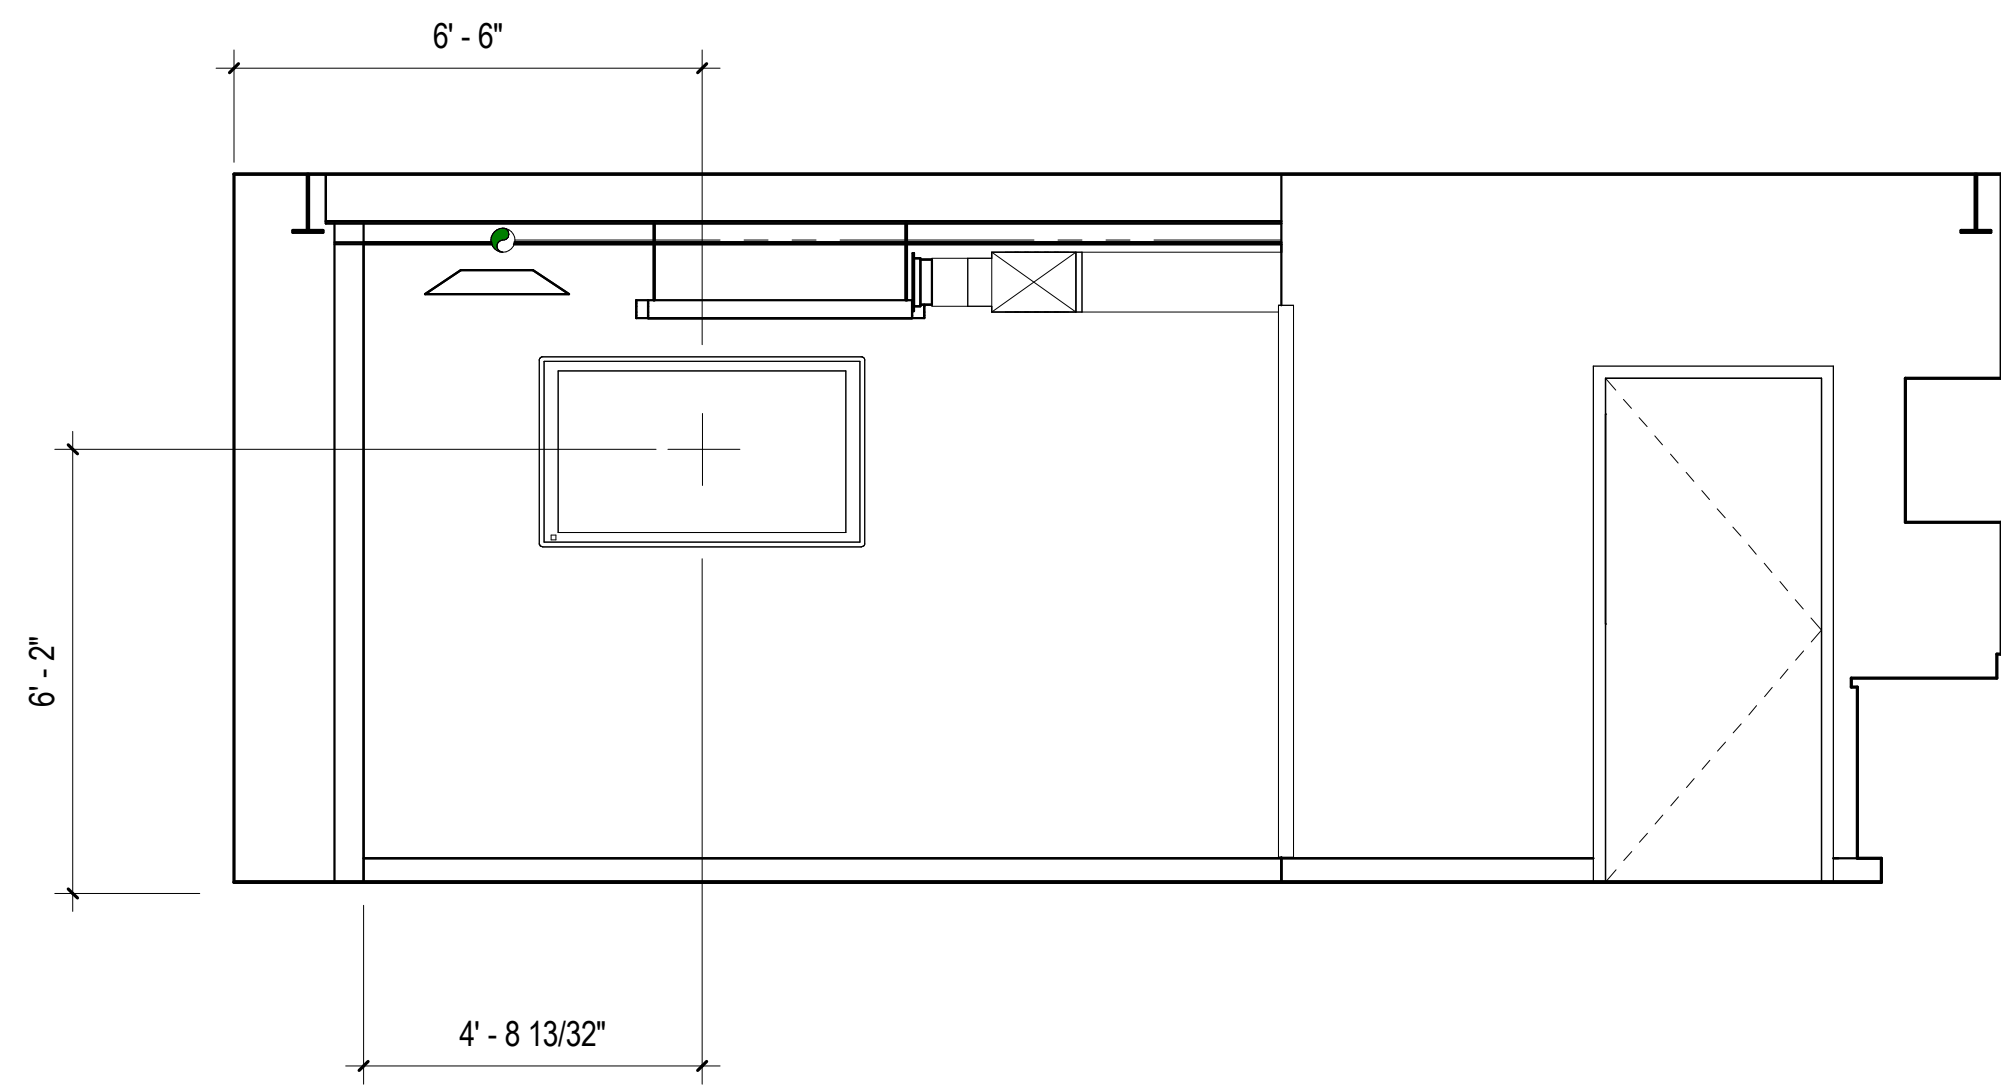

D5 ELEVATION - BINDERY (EAST)
3/8" = 1'-0"

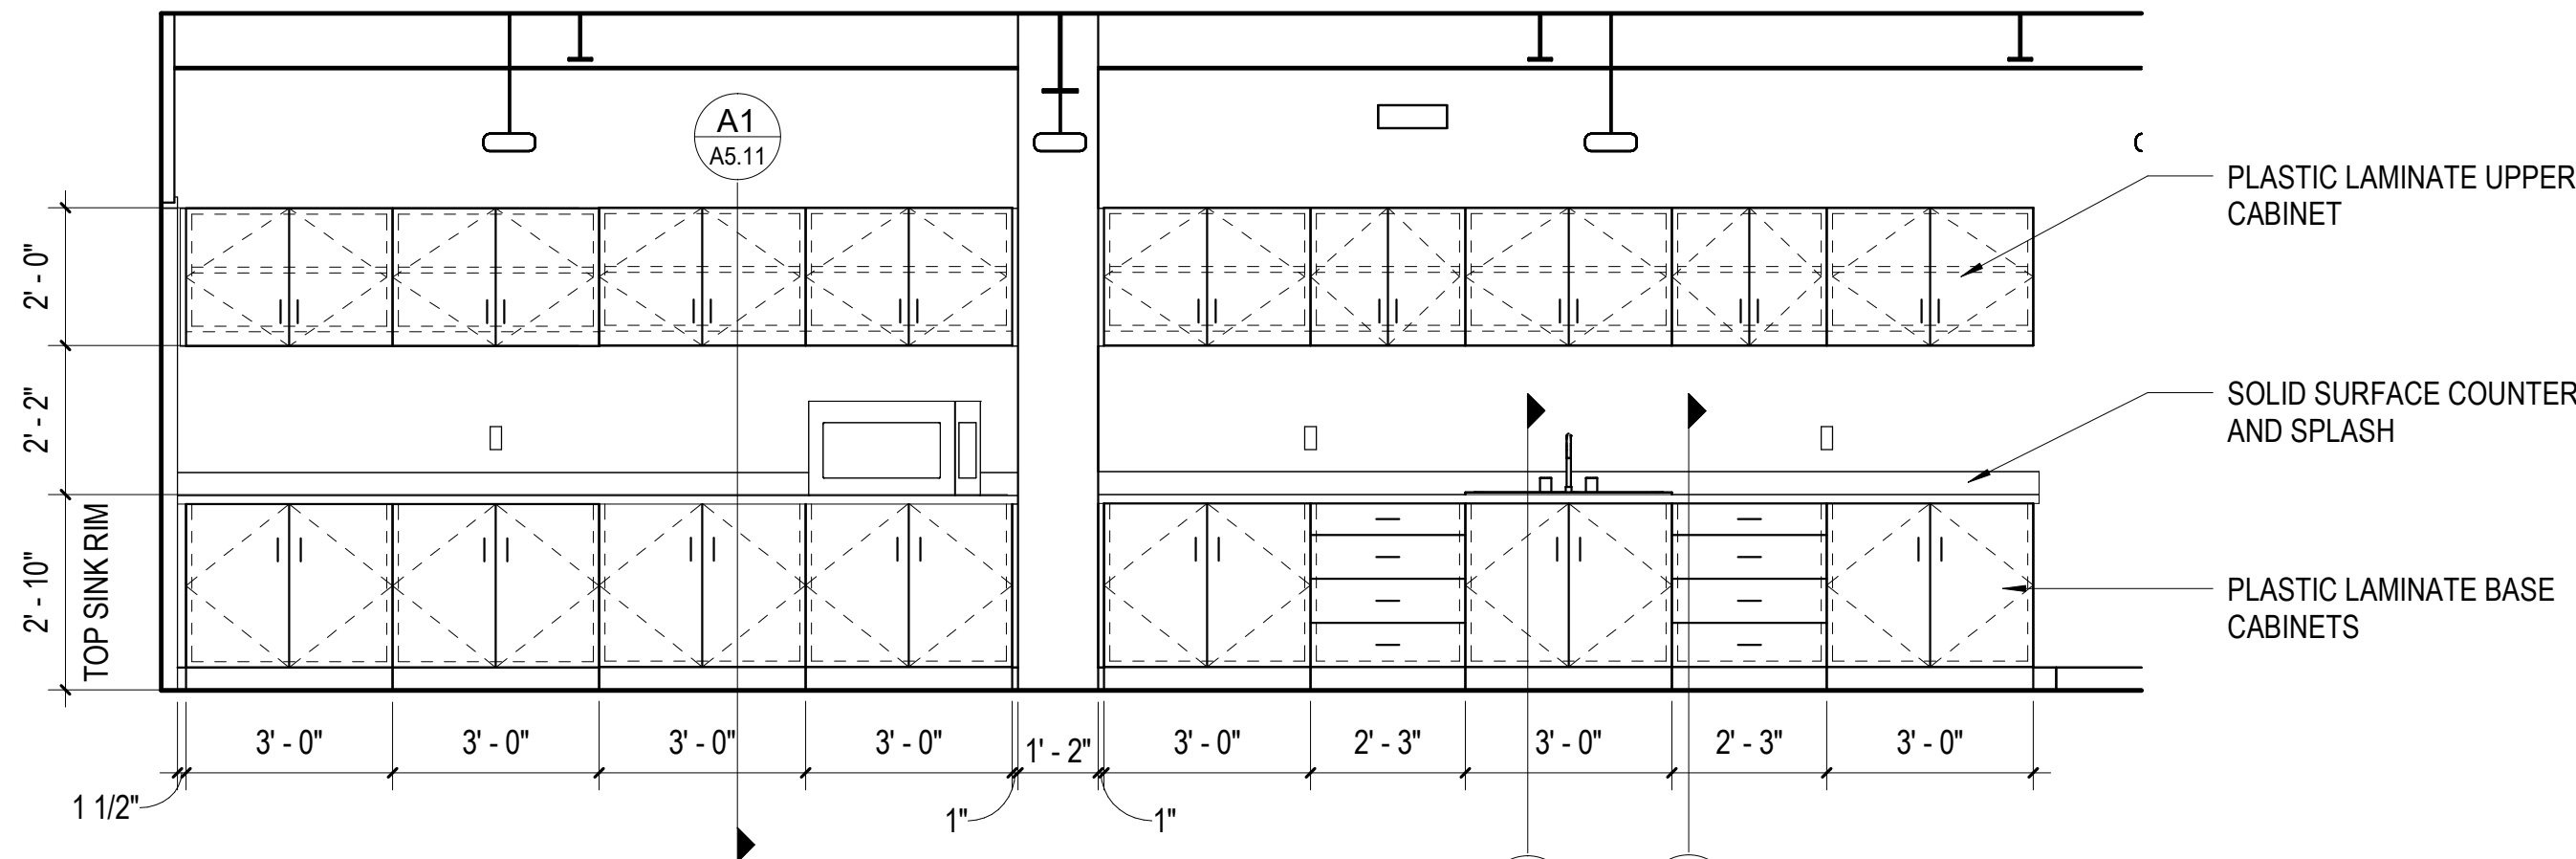

D3 ELEVATION - BINDERY (SOUTH)
3/8" = 1'-0"

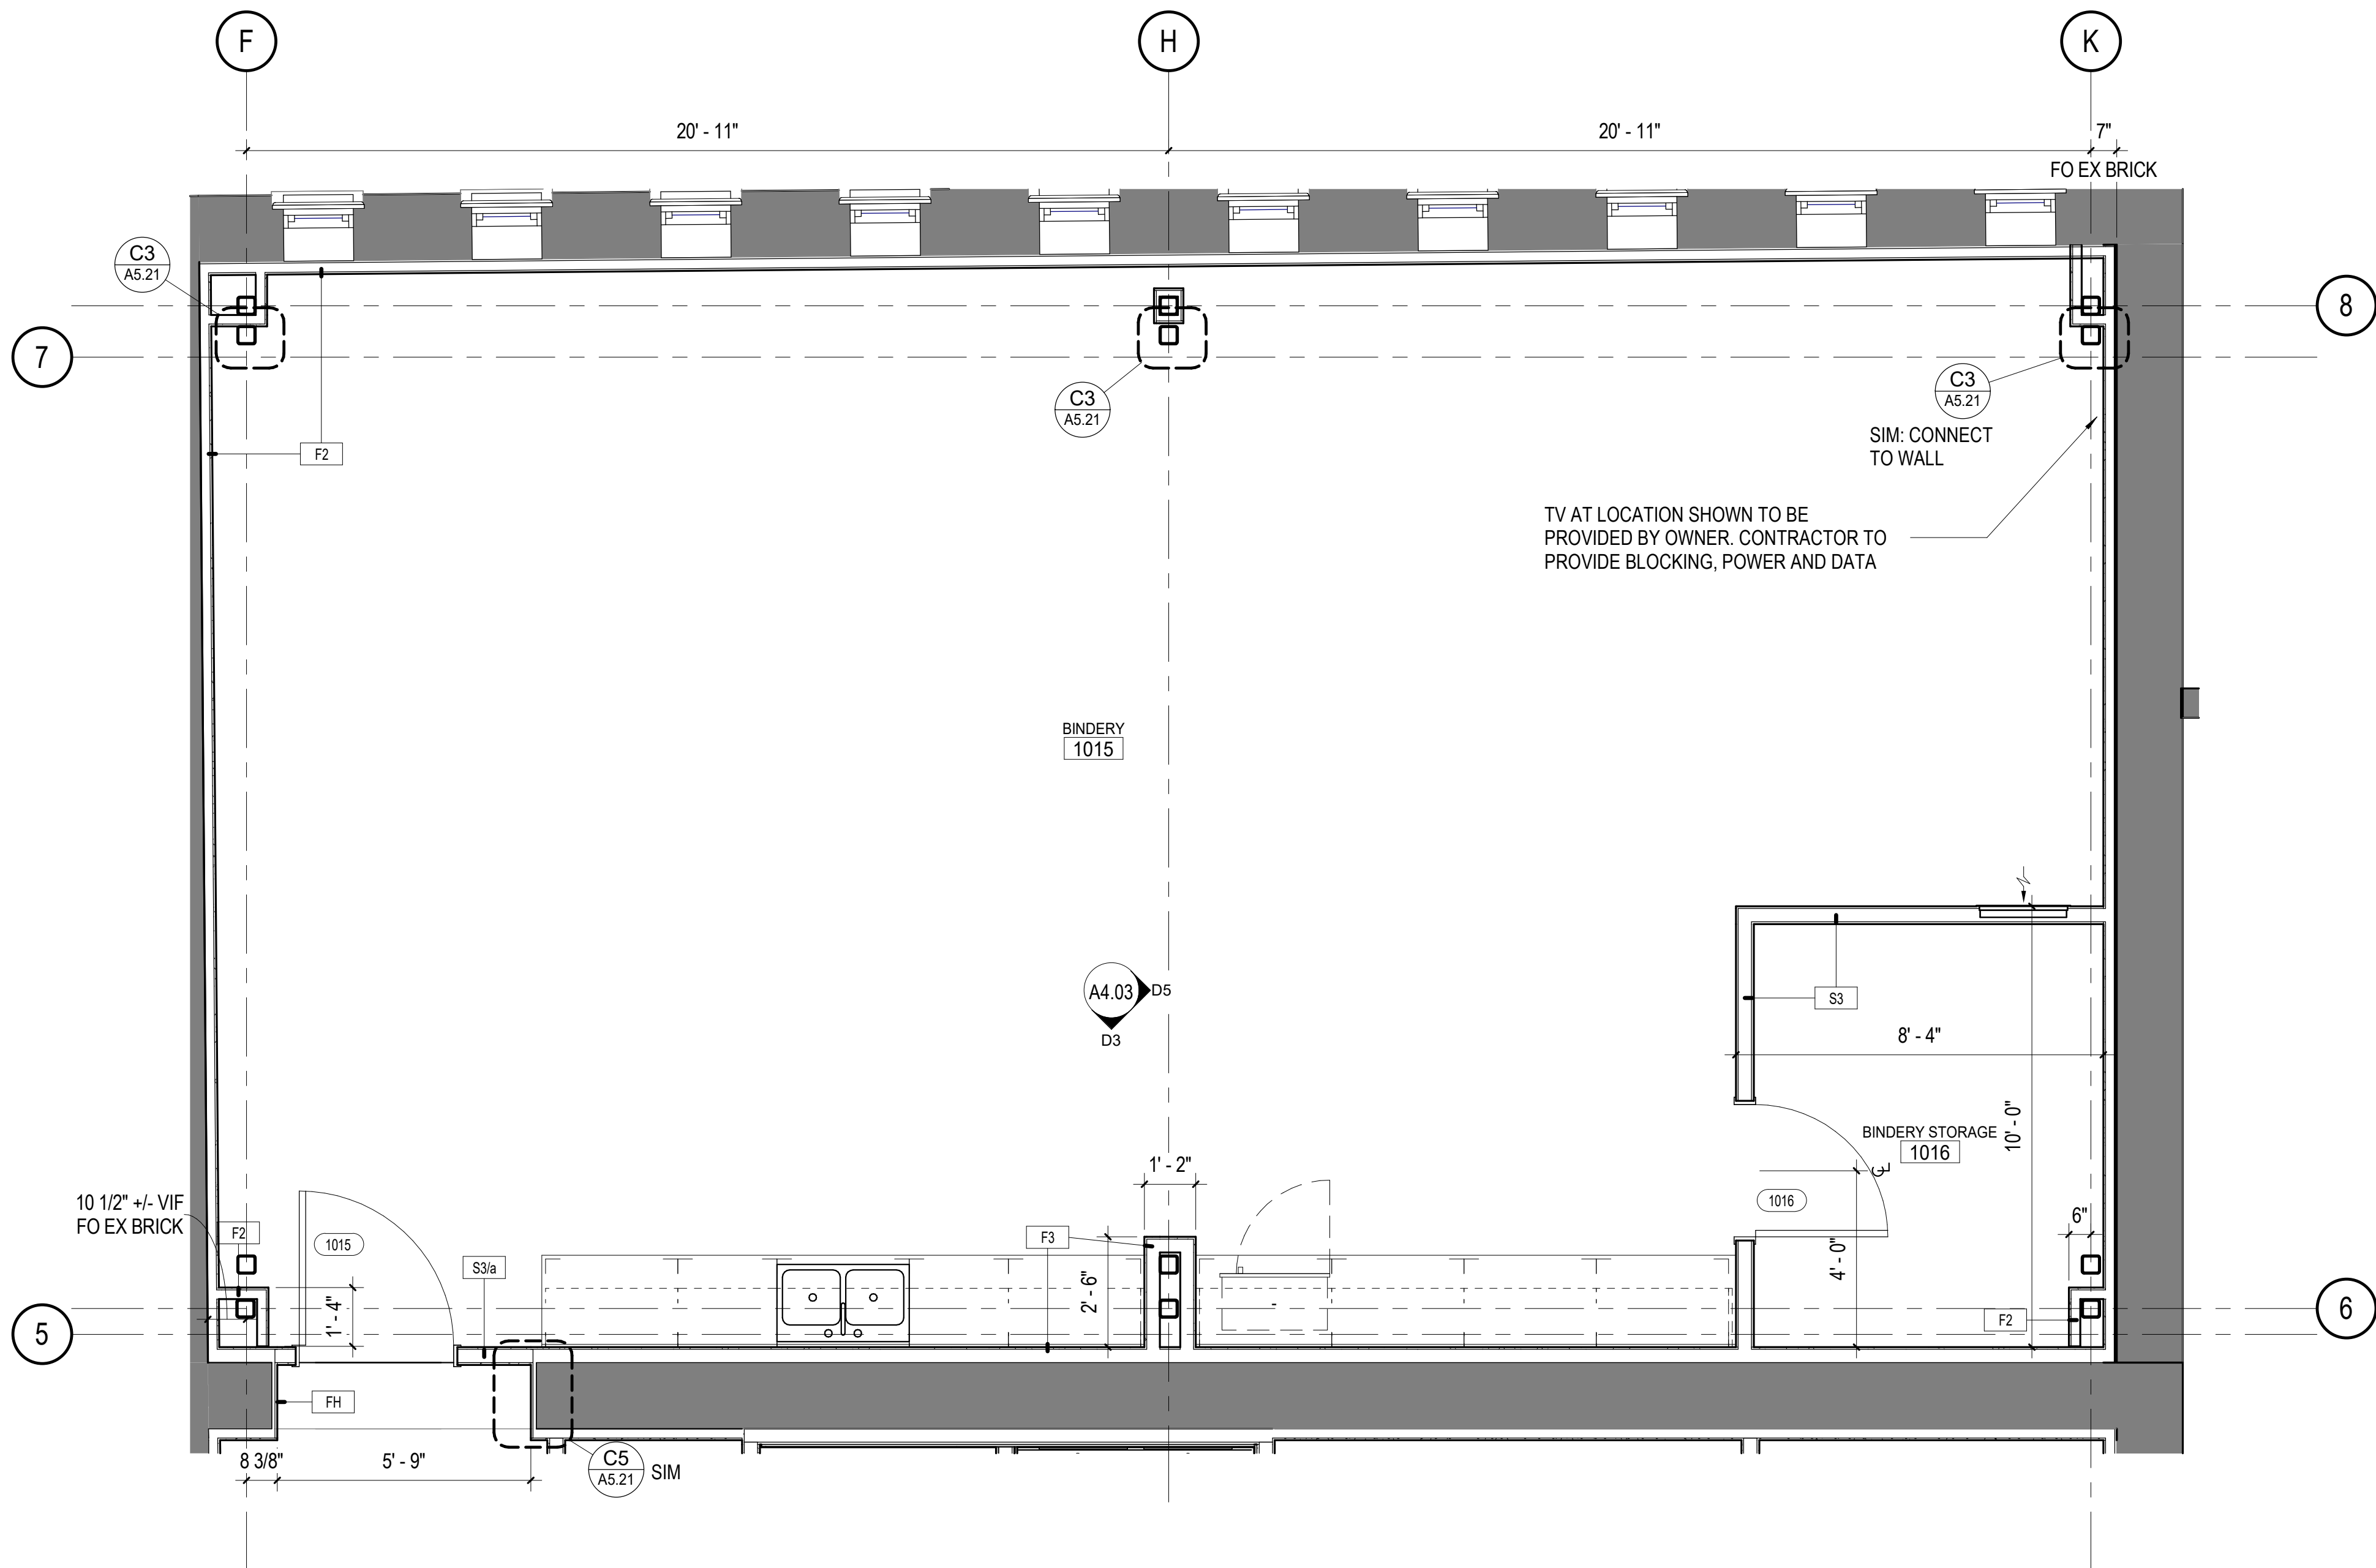

A3 ENLARGED PLAN - BINDERY LEVEL 1
3/8" = 1'-0"

ENLARGED FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- ALL PARTITIONS TO BE TYPE S3a UNLESS NOTED OTHERWISE.
- NOT USED
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
- WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
- FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
- CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
- REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
- ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

FLOOR PLAN LEGEND

COLUMN LINE (NEW) 0

COLUMN LINE (EXISTING) 0

VIEW TYPES

BUILDING ELEVATION 1 A101 ELEVATION # DRAWING SHEET

BUILDING SECTION 1 A101 DRAWING SHEET

WALL SECTION 1 A101 SECTION CUT # DRAWING SHEET

DETAIL / ENLARGED PLAN CALLOUT 1 A101 CALLOUT # DRAWING SHEET

INTERIOR ELEVATION VIEW 1 A101 ELEVATION # DRAWING SHEET

TAG TYPES

ROOM NAME/NUMBER 101 ROOM NAME

DOOR NUMBER 101

WINDOW TYPE 1

STOREFRONT / CURTAIN WALL SF-22

WALL TYPE TAG S3

DRAWING SHEET KEYNOTE 1

REVISION NUMBER 1


NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

K|P|S
GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

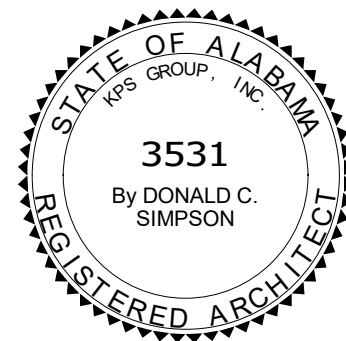

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS: DOWNS 202483

918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24


REVISIONS
No. Description Date

DRAWING TITLE
BINDERY FLOOR PLANS AND ELEVATIONS


DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02


DRAWING NO.
A4.03

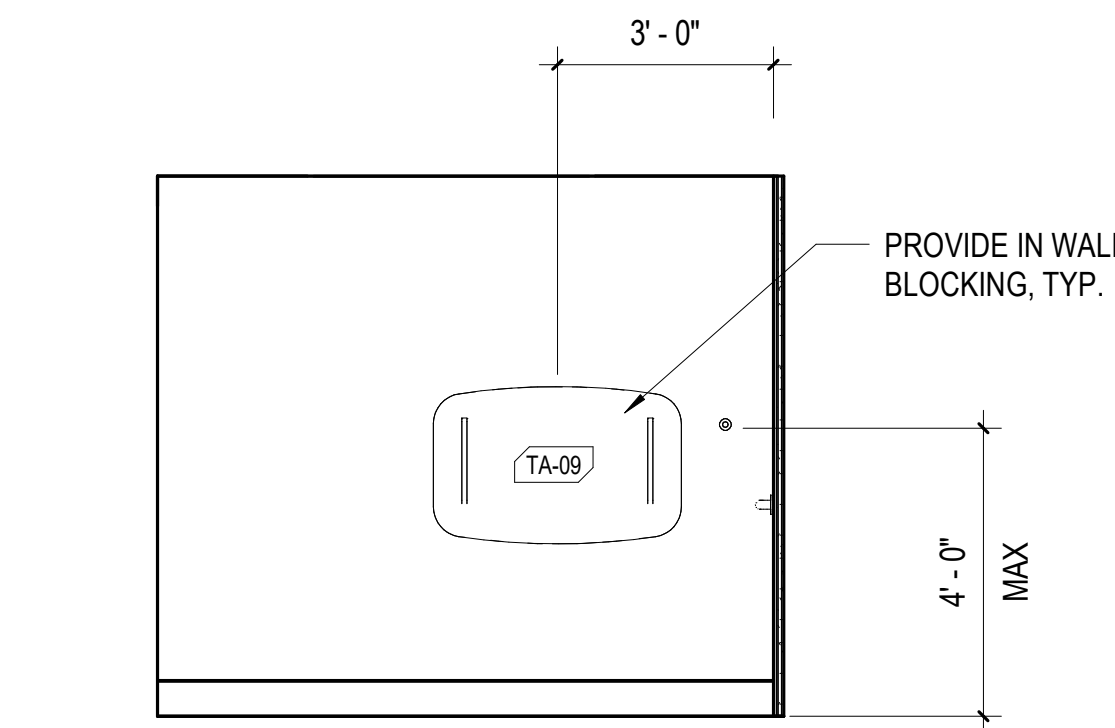



E6 ELEVATION - MULTIGENER RR EAST
3/8" = 1'-0"

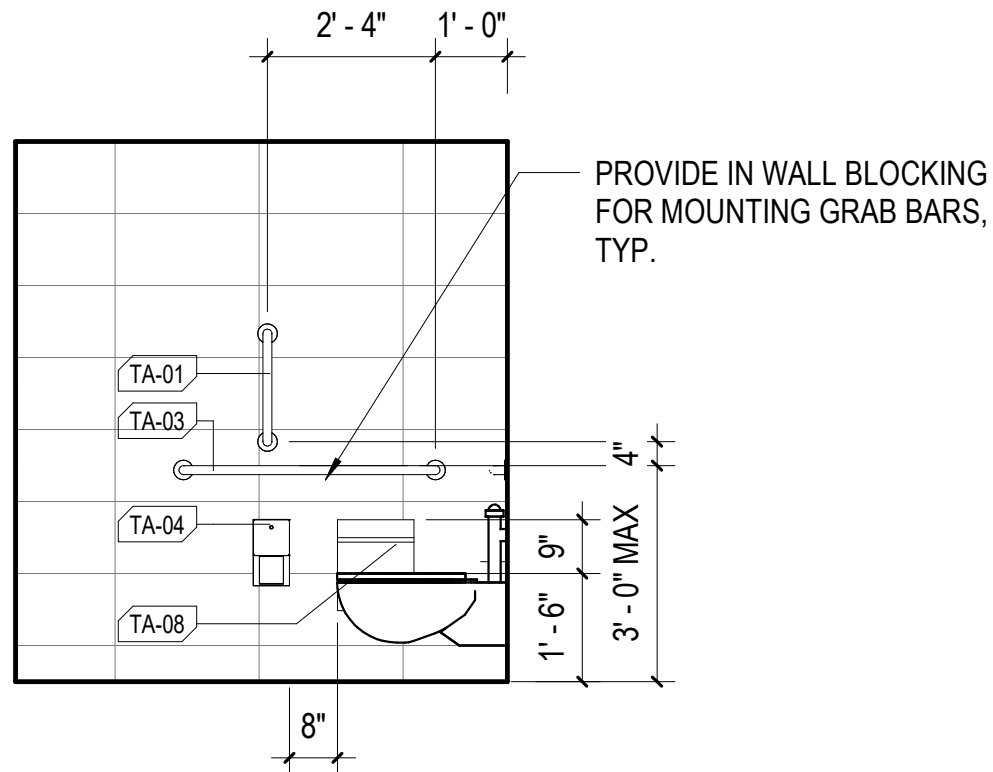


E5 ELEVATION - MULTIGENDER RR (SOUTH)
3/8" = 1'-0"

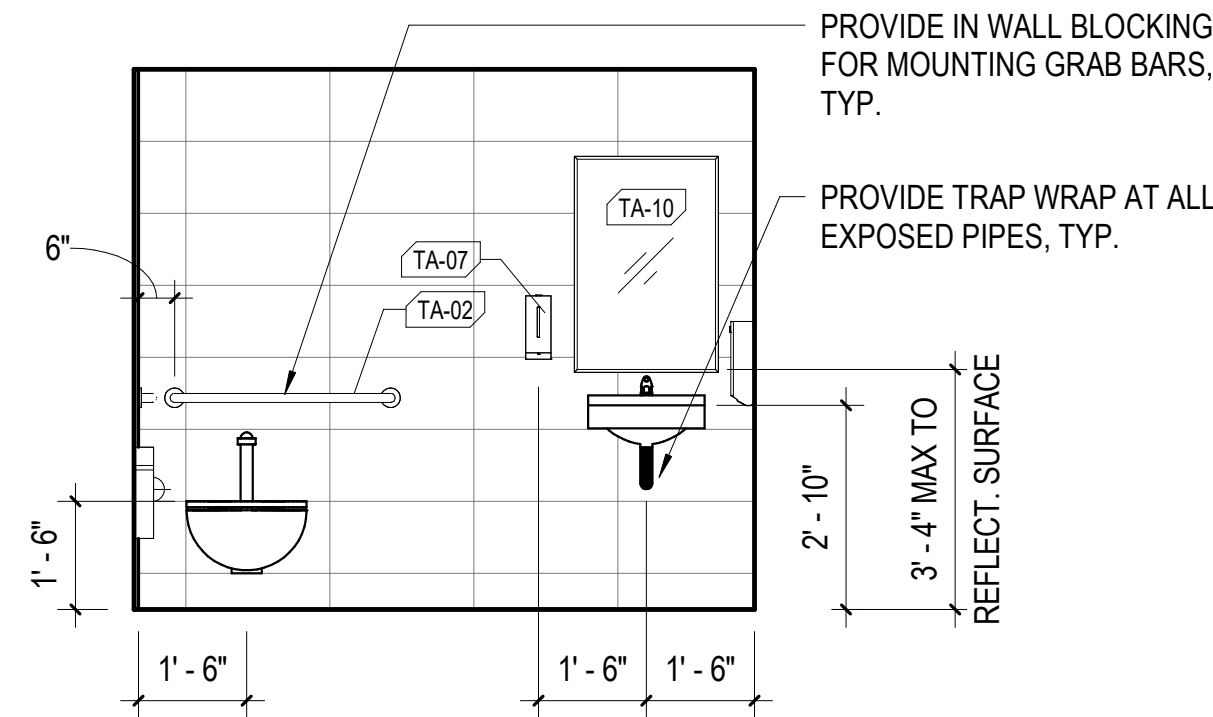


E3 ELEVATION - MULTIGENDER RR (WEST)
3/8" = 1'-0"

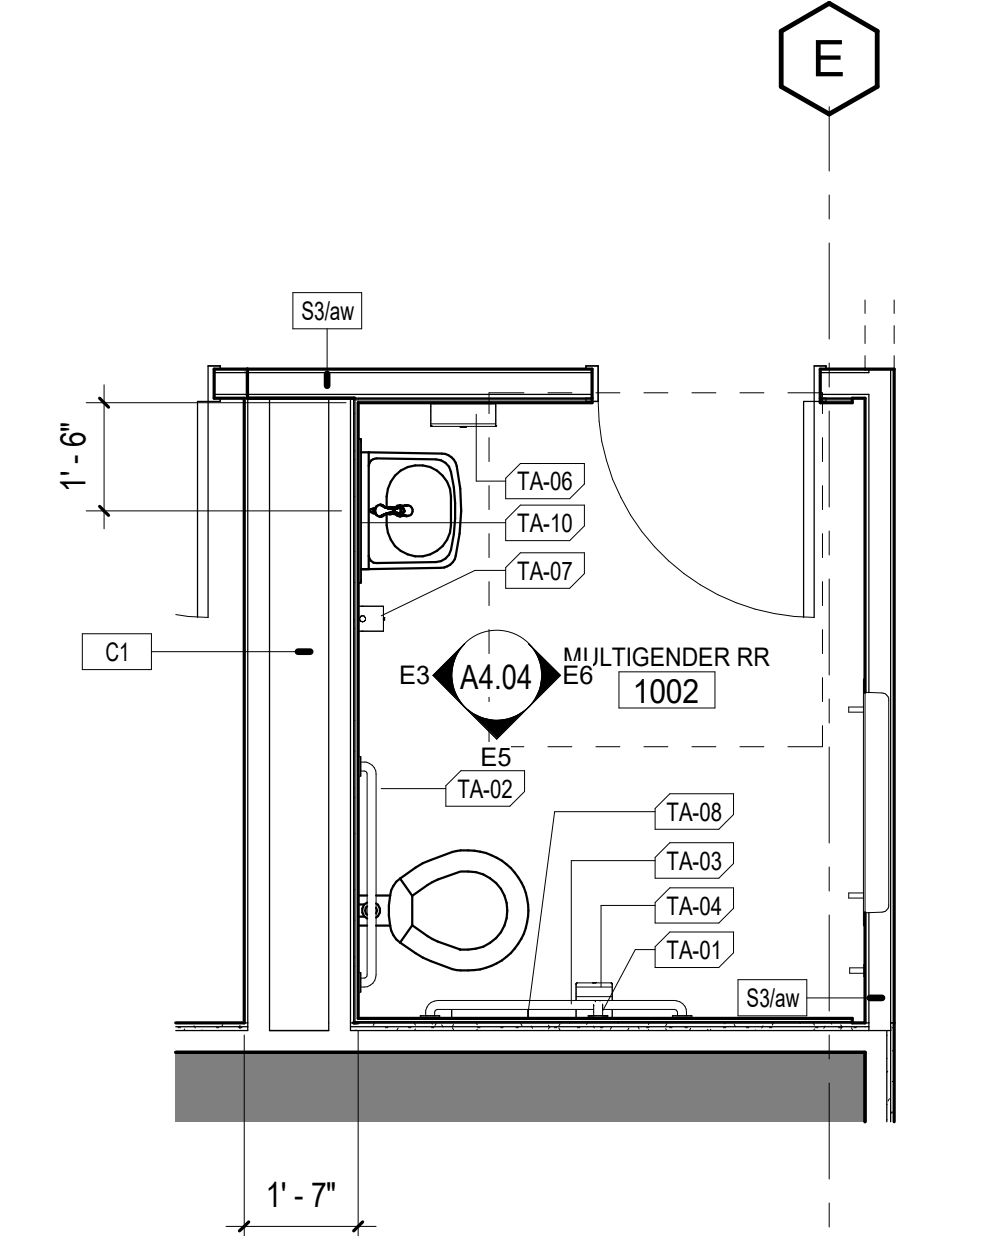



E1 FLOOR PLAN - RESTROOM
3/8" = 1'-0"

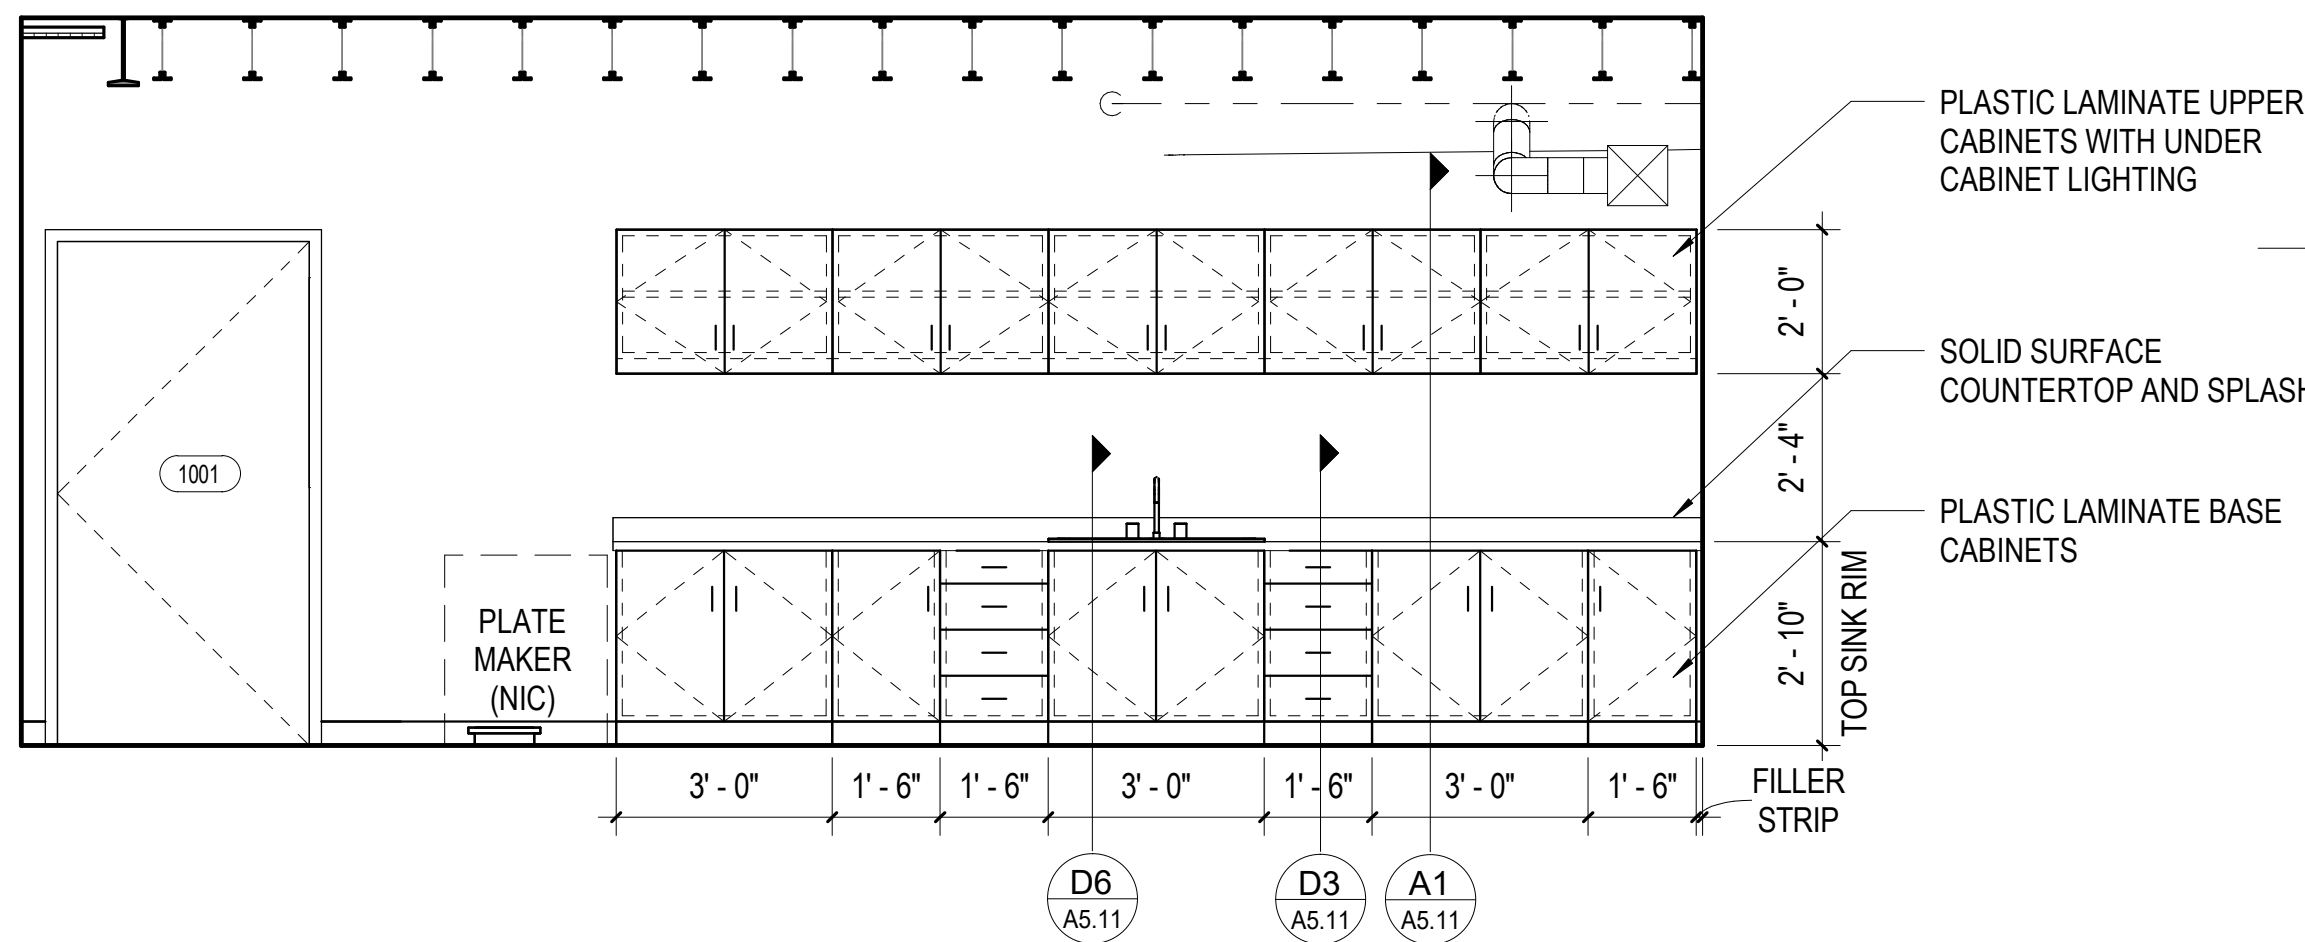

C5 ELEVATION - UNDERGRAD STUDIO (WEST)
3/8" = 1'-0"

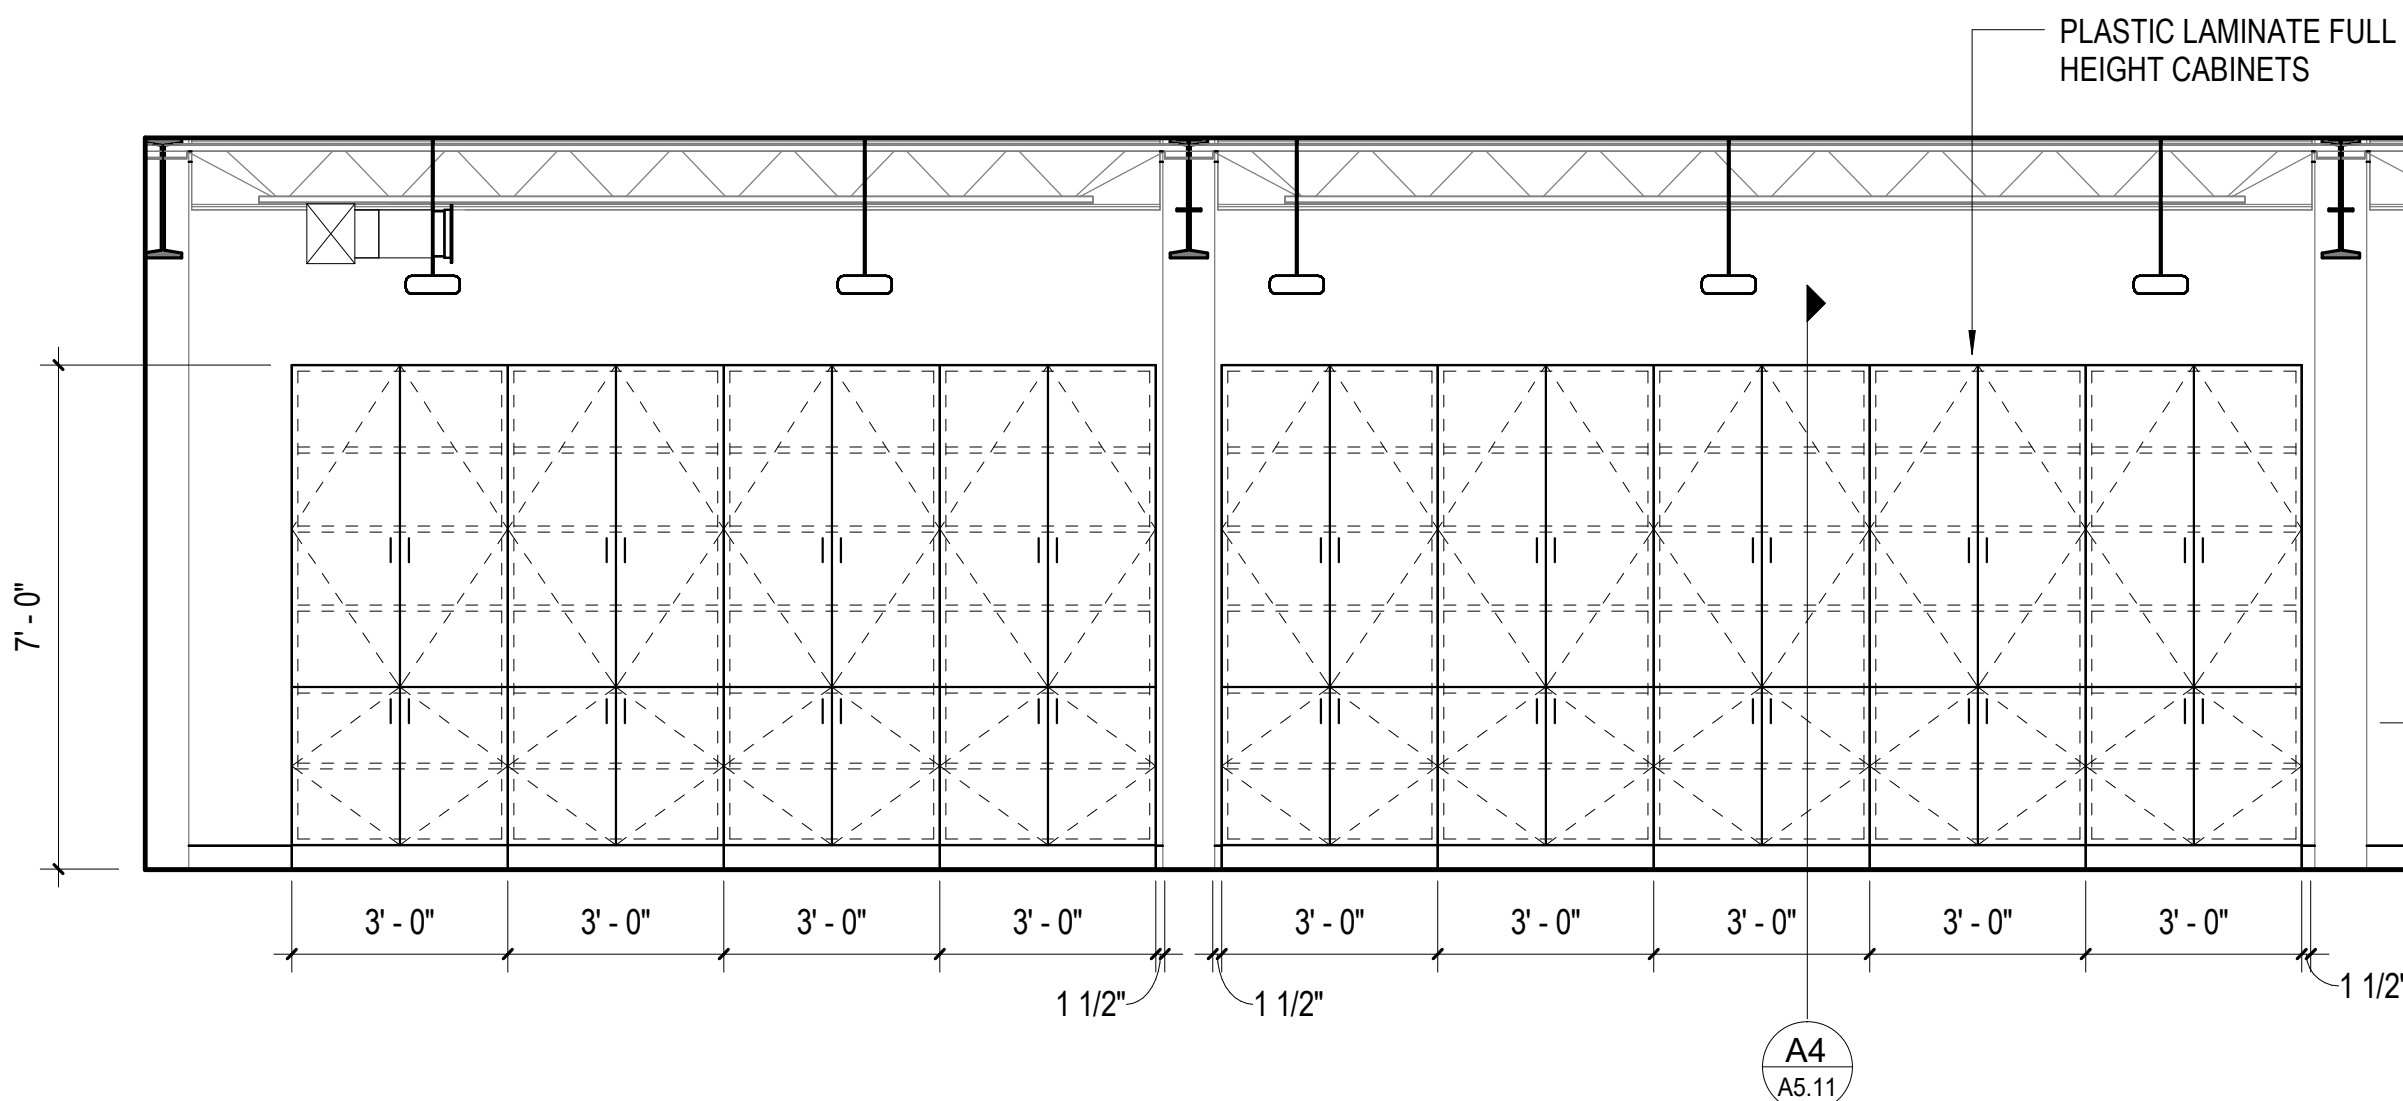

A5 UNDERGRAD STUDIO (SOUTH)
3/8" = 1'-0"

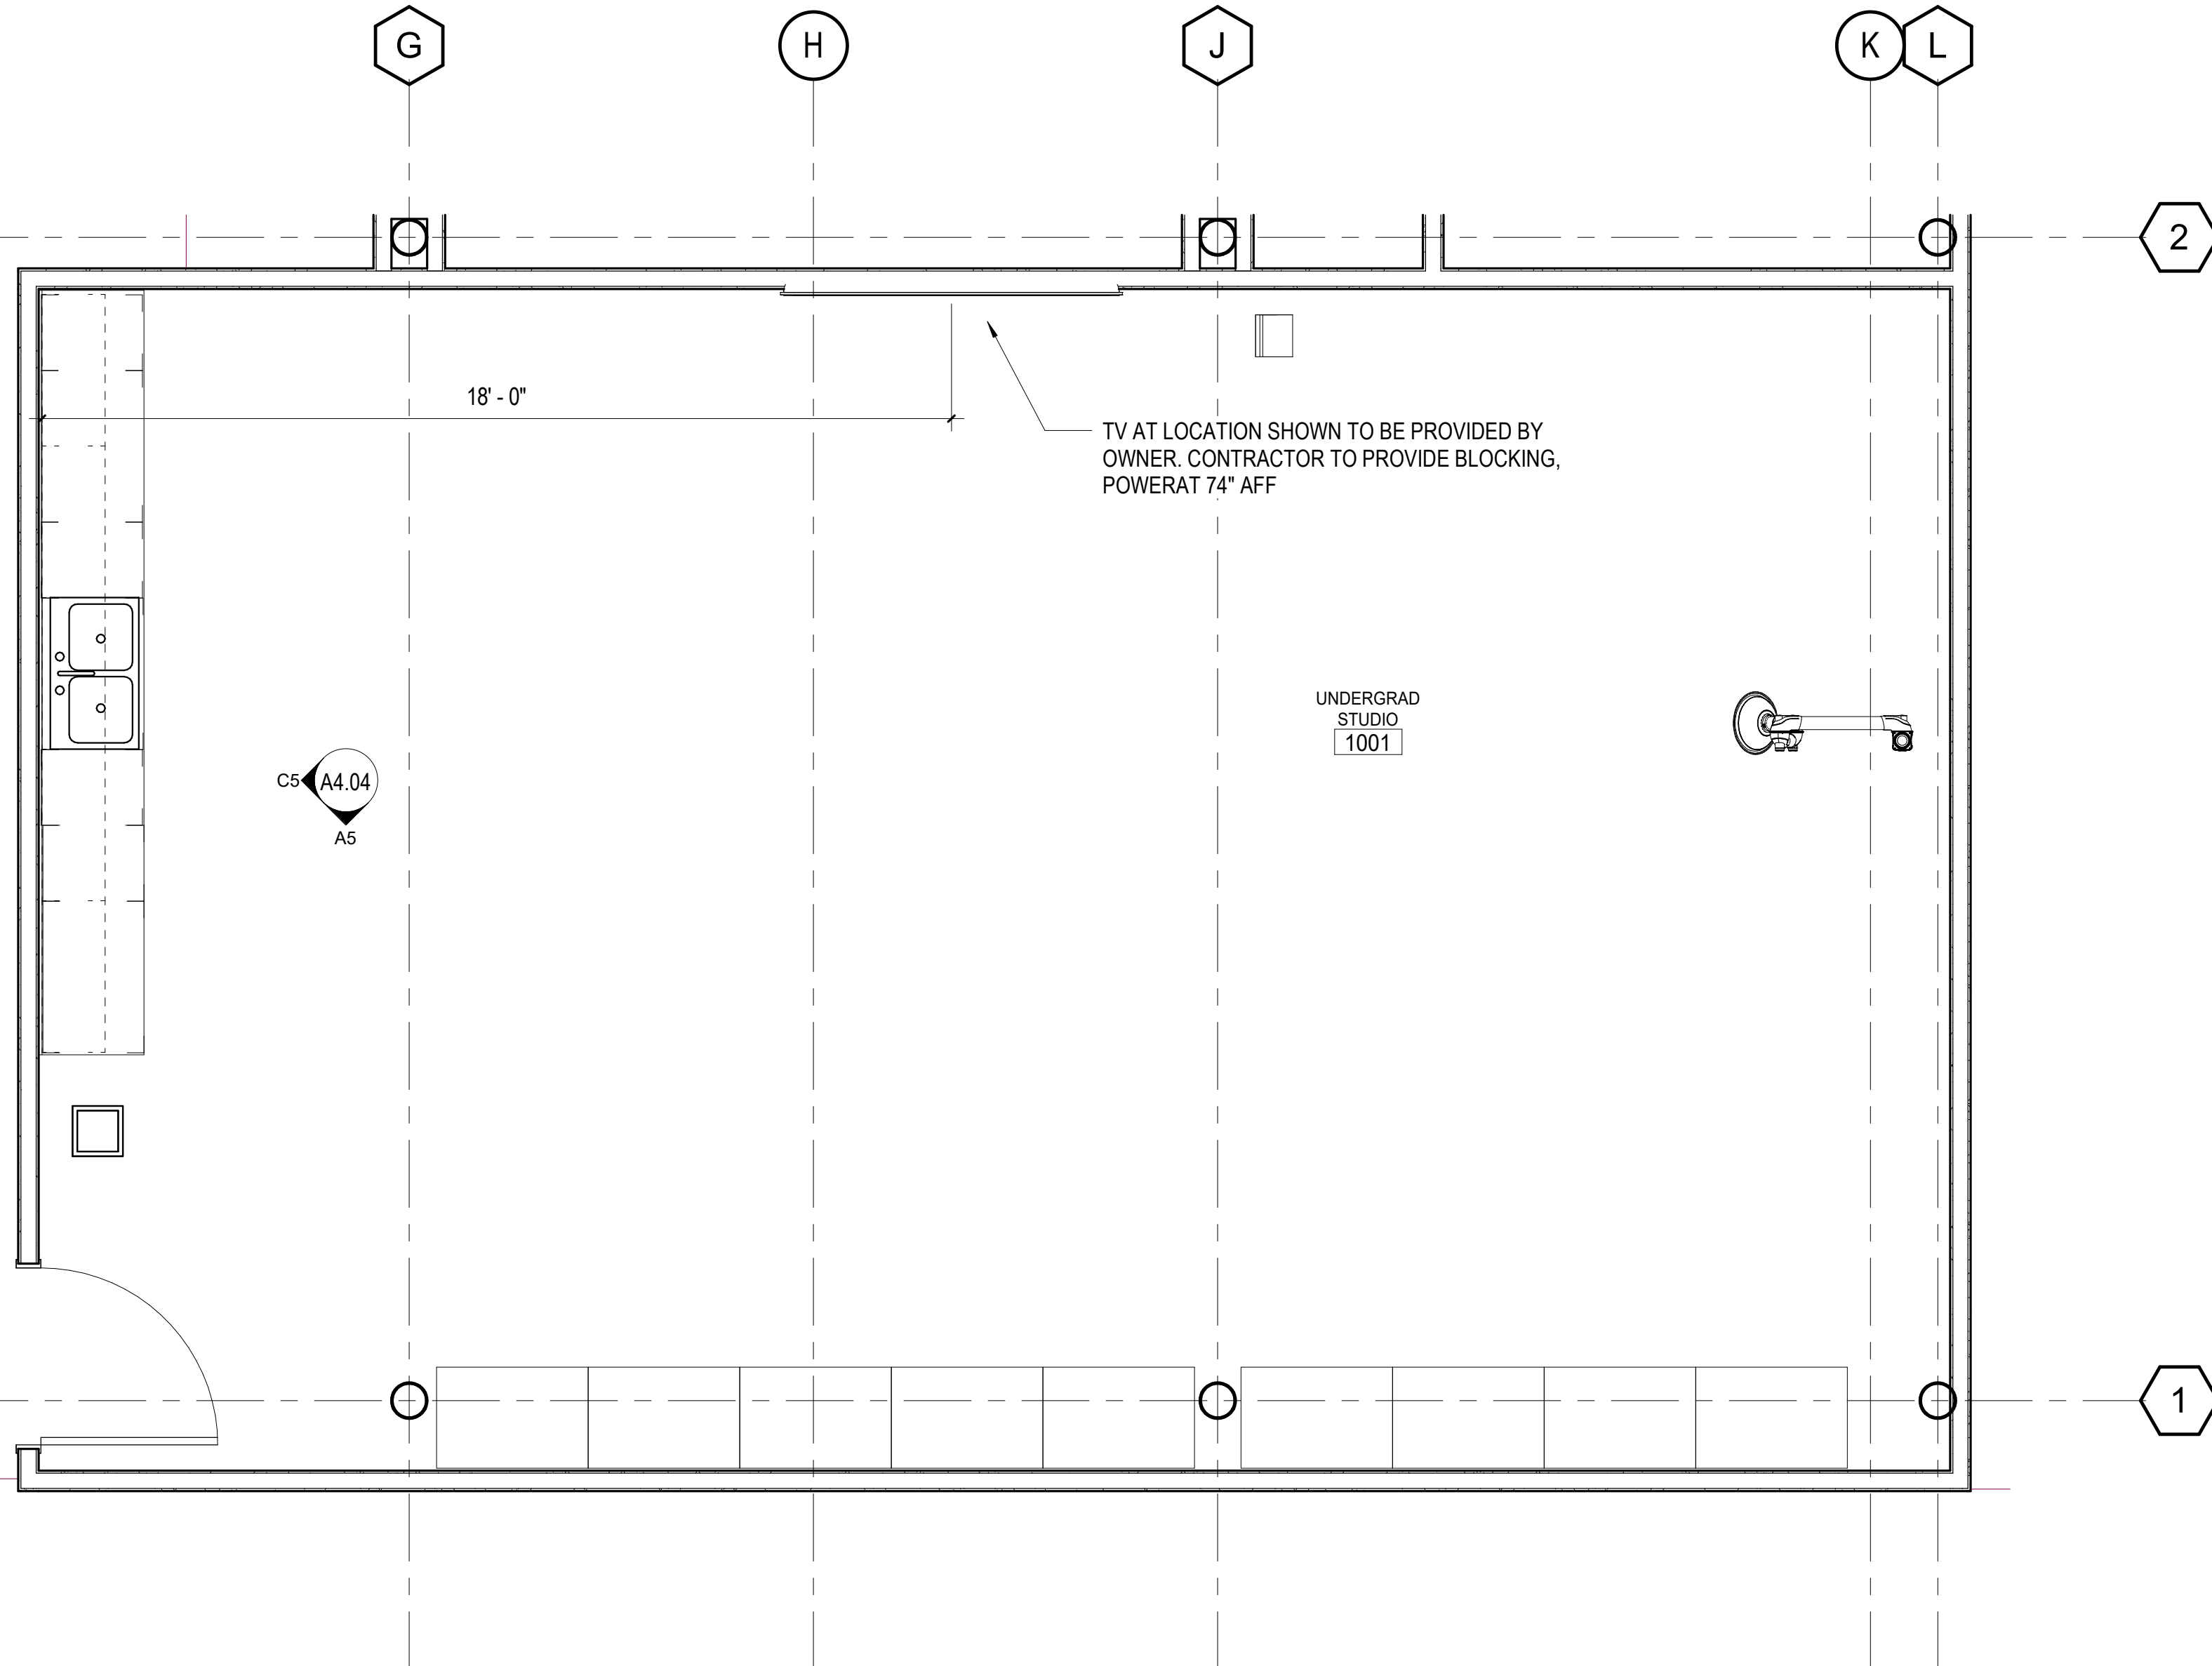

A3 ENLARGED PLAN - UNDERGRAD STUDIO
3/8" = 1'-0"

ENLARGED FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- ALL PARTITIONS TO BE TYPE S3a UNLESS NOTED OTHERWISE.
- NOT USED
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES. UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
- WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
- FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
- CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
- REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
- ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

FLOOR PLAN LEGEND

- COLUMN LINE (NEW) 0
- COLUMN LINE (EXISTING) 0


VIEW TYPES

- BUILDING ELEVATION 1 A101 ELEVATION # DRAWING SHEET
- BUILDING SECTION 1 A101 DRAWING SHEET
- WALL SECTION 1 A101 SECTION CUT # DRAWING SHEET
- DETAIL / ENLARGED PLAN CALLOUT 1 A101 CALLOUT # DRAWING SHEET
- INTERIOR ELEVATION VIEW A1 A101 ELEVATION # DRAWING SHEET

TAG TYPES

- ROOM NAME/NUMBER ROOM NAME 101
- DOOR NUMBER 101
- WINDOW TYPE 1
- STOREFRONT / CURTAIN WALL SF-22
- WALL TYPE TAG S3
- DRAWING SHEET KEYNOTE 1
- REVISION NUMBER 1

NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

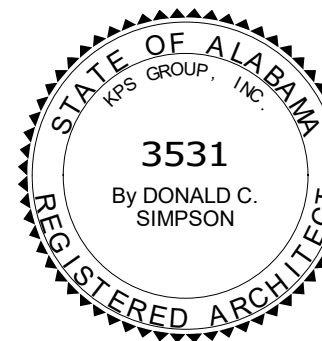

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	


REVISIONS		
No.	Description	Date

DRAWING TITLE
**STUDIO FLOOR
PLANS AND
ELEVATIONS**

DRAWN BY: Author
CHECKED BY: Checker


PROJECT NUMBER
236002-02

DRAWING NO.
A4.04

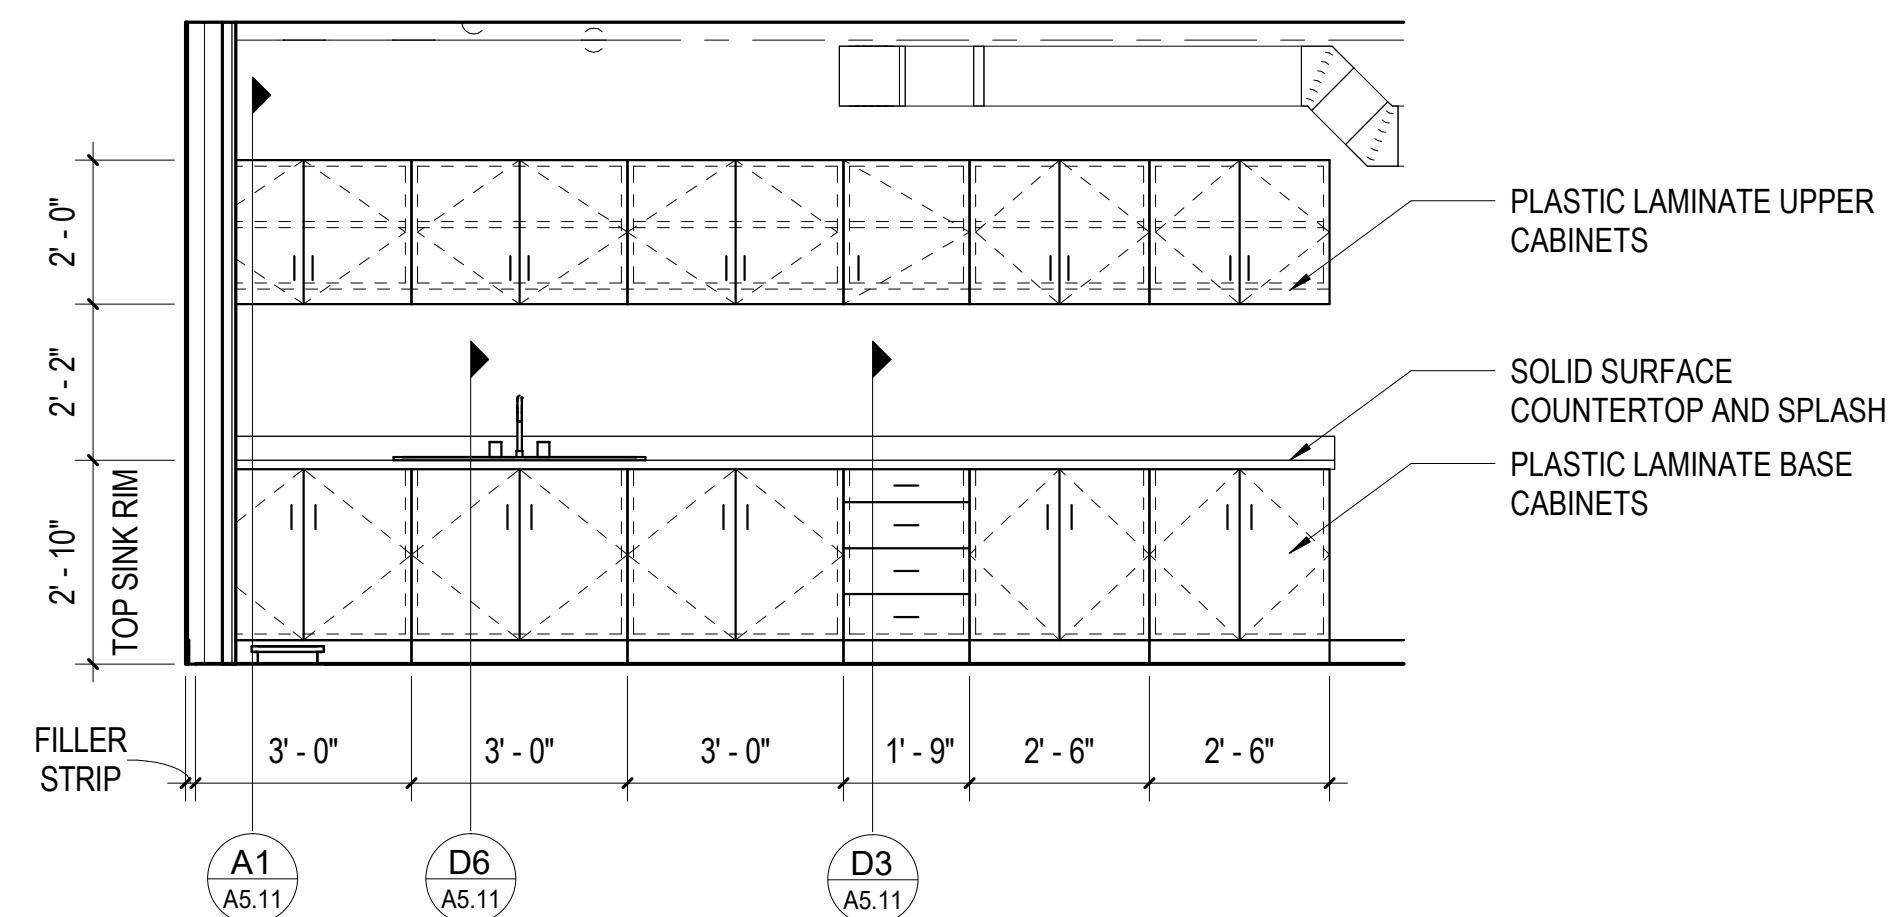



E6 ELEVATION - PRINT SHOP AND TYPE LAB (NORTH)

3/8" = 1'-0"

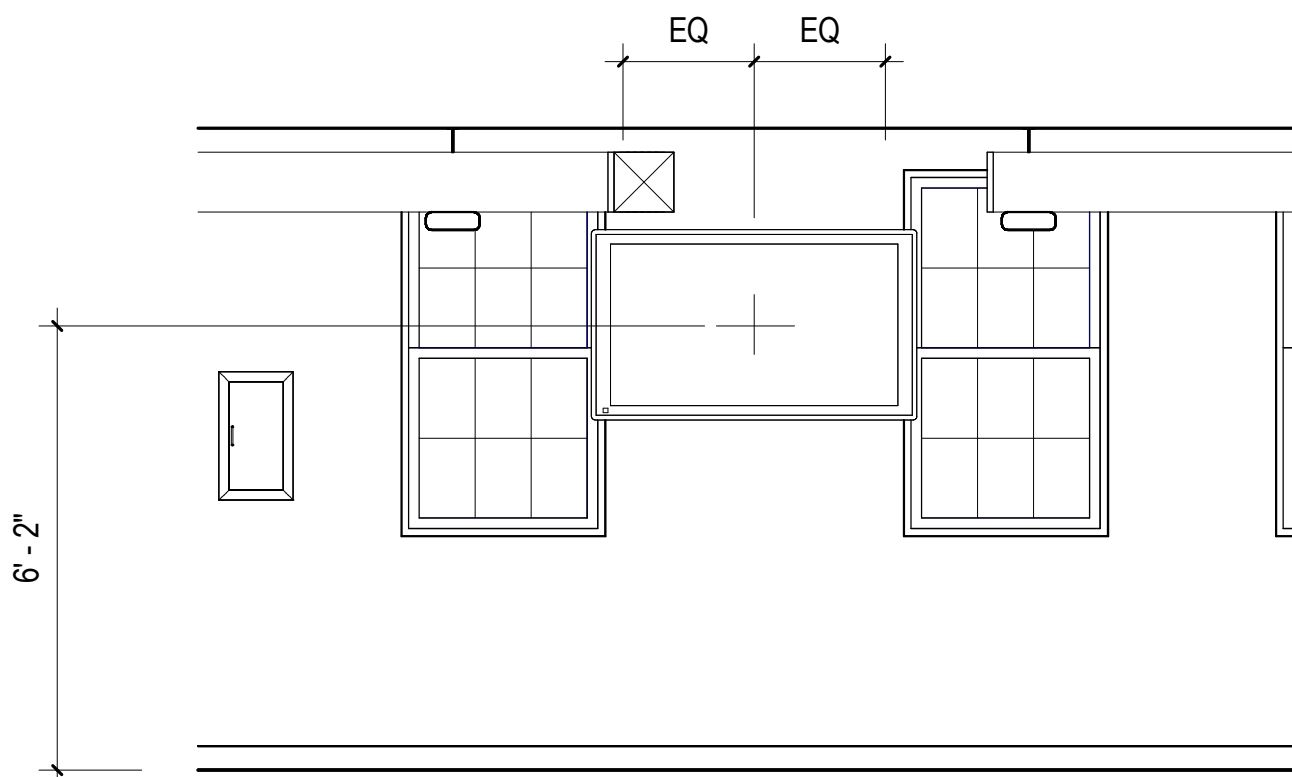

D6 ELEVATION - PRINT SHOP AND TYPE LAB (WEST)

3/8" = 1'-0"

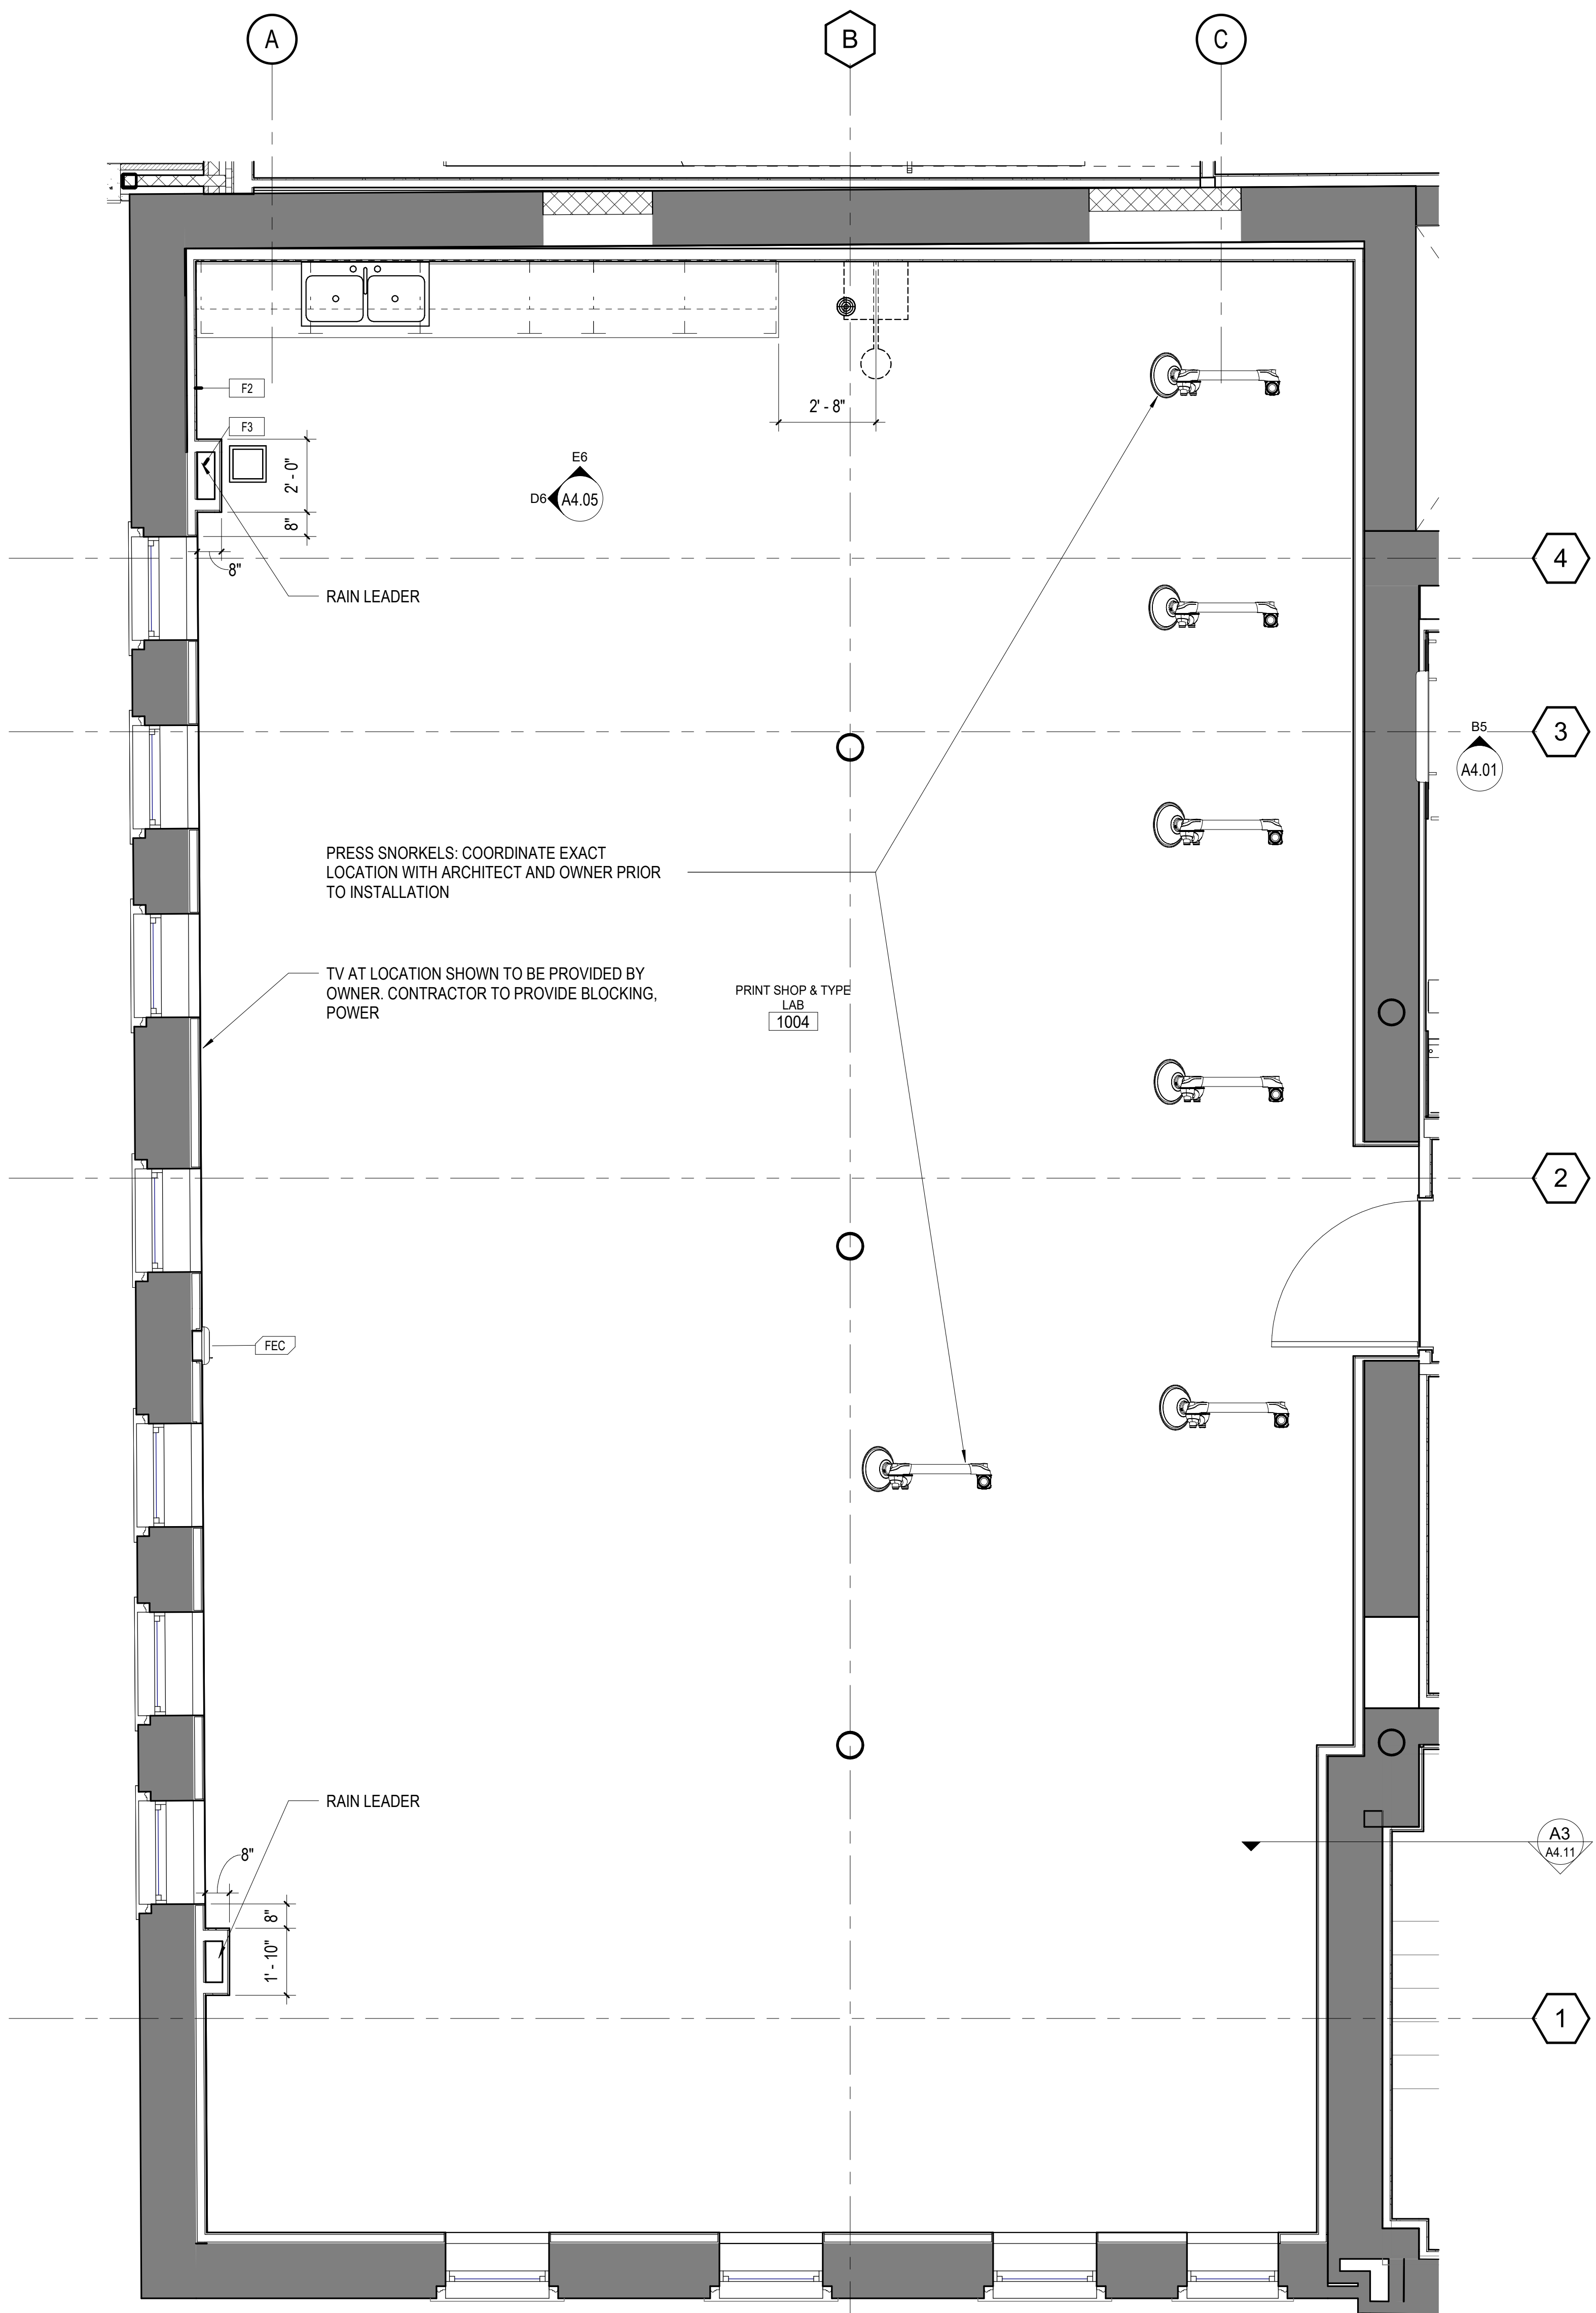

A3 ENLARGED PLAN - PRINT LAB

3/8" = 1'-0"

ENLARGED FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE, REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- ALL PARTITIONS TO BE TYPE S3a UNLESS NOTED OTHERWISE.
- NOT USED
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
- WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
- FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
- CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
- REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
- ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

FLOOR PLAN LEGEND


COLUMN LINE (NEW)	0	
COLUMN LINE (EXISTING)	0	
VIEW TYPES		
BUILDING ELEVATION	1 A101	ELEVATION # DRAWING SHEET
BUILDING SECTION	1 A101	DRAWING SHEET
WALL SECTION	1 A101	SECTION CUT # DRAWING SHEET
DETAIL / ENLARGED PLAN CALLOUT	1 A101	CALLOUT # DRAWING SHEET
INTERIOR ELEVATION VIEW	1 A101	ELEVATION # DRAWING SHEET

TAG TYPES

ROOM NAME/NUMBER	ROOM NAME 101
DOOR NUMBER	101
WINDOW TYPE	1
STOREFRONT / CURTAIN WALL	SF-22
WALL TYPE TAG	S3
DRAWING SHEET KEYNOTE	1
REVISION NUMBER	1

NOTE:

REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

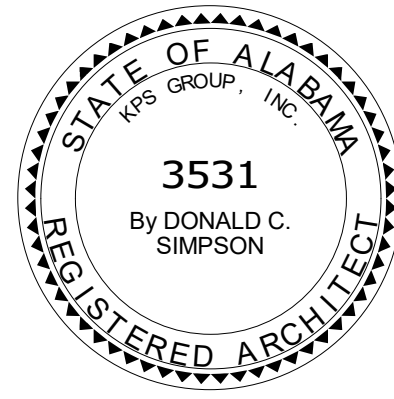

PROJECT STATUS	BID SET
ISSUED -	CONFORMANCE SET
ISSUE DATE	30 JAN 24

REVISIONS

No.	Description	Date


DRAWING TITLE
PRINT LAB FLOOR PLANS AND ELEVATIONS


DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02


DRAWING NO.
A4.05

1. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL, UNLESS NOTED OTHERWISE. REFER TO ARCHITECTURAL DRAFTING NOTES ON SHEET A-0.01 FOR ADDITIONAL CLARIFICATIONS.
2. PARTITION TYPES SCHEDULED ON SHEET 64.01, RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
3. RE: SHEET G-0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
4. ALL PARTITIONS TO BE TYPE S34 UNLESS NOTED OTHERWISE.
5. NOT USED
6. PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
7. PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
8. MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
9. WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
10. FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
11. CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
12. REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
13. ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

COLUMN LINE (NEW)  — — —

COLUMN LINE (EXISTING)  — — —

BUILDING SECTION



DRAWING SHEET








WALL SECTION

DRAWING SHEET


INTERIOR
ELEVATION VIEW

A1 — ELEVATION #

A101 — DRAWING SHEET

ROOM NAME/NUMBER	
DOOR NUMBER	
WINDOW TYPE	
STOREFRONT / CURTAIN WALL	
WALL TYPE TAG	
DRAWING SHEET KEYNOTE	
REVISION NUMBER	

NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS





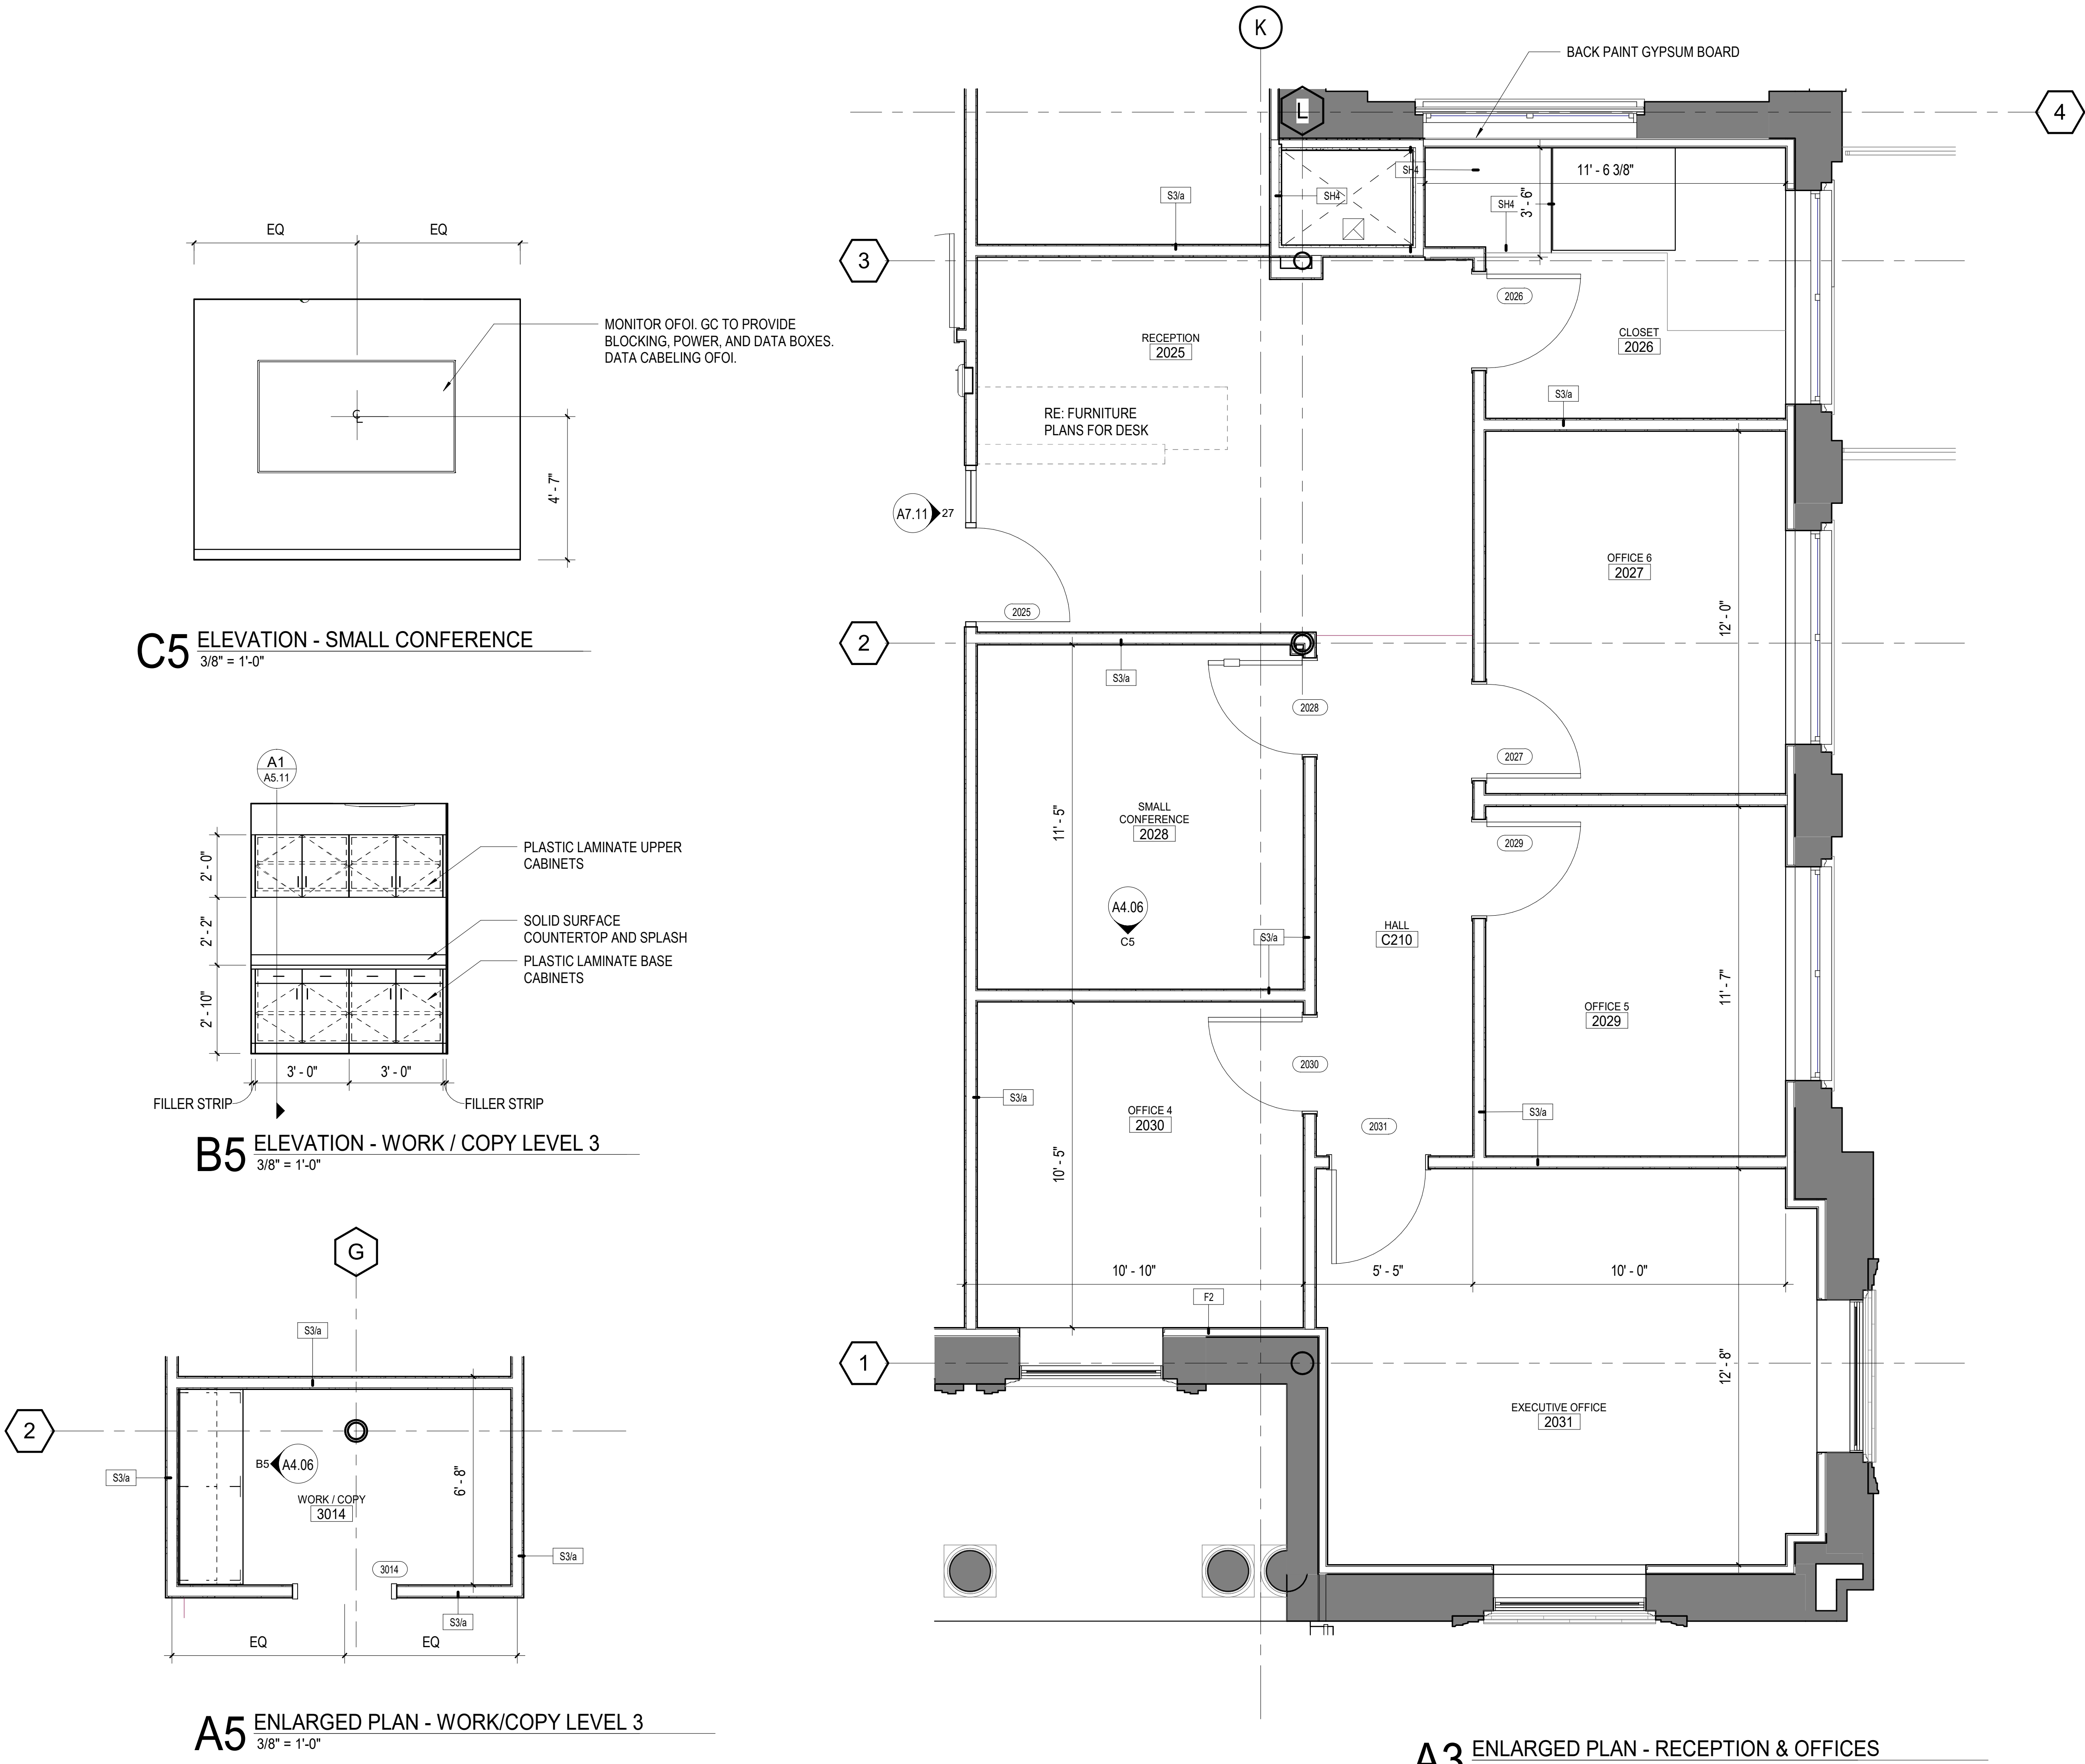


C5 ELEVATION - SMALL CONFERENCE
3/8" = 1'-0"

B5 ELEVATION - WORK / COPY LEVEL 3
3/8" = 1'-0"

A5 ENLARGED PLAN - WORK/COPY LEVEL 3
3/8" = 1'-0"

A3 ENLARGED PLAN - RECEPTION & OFFICES

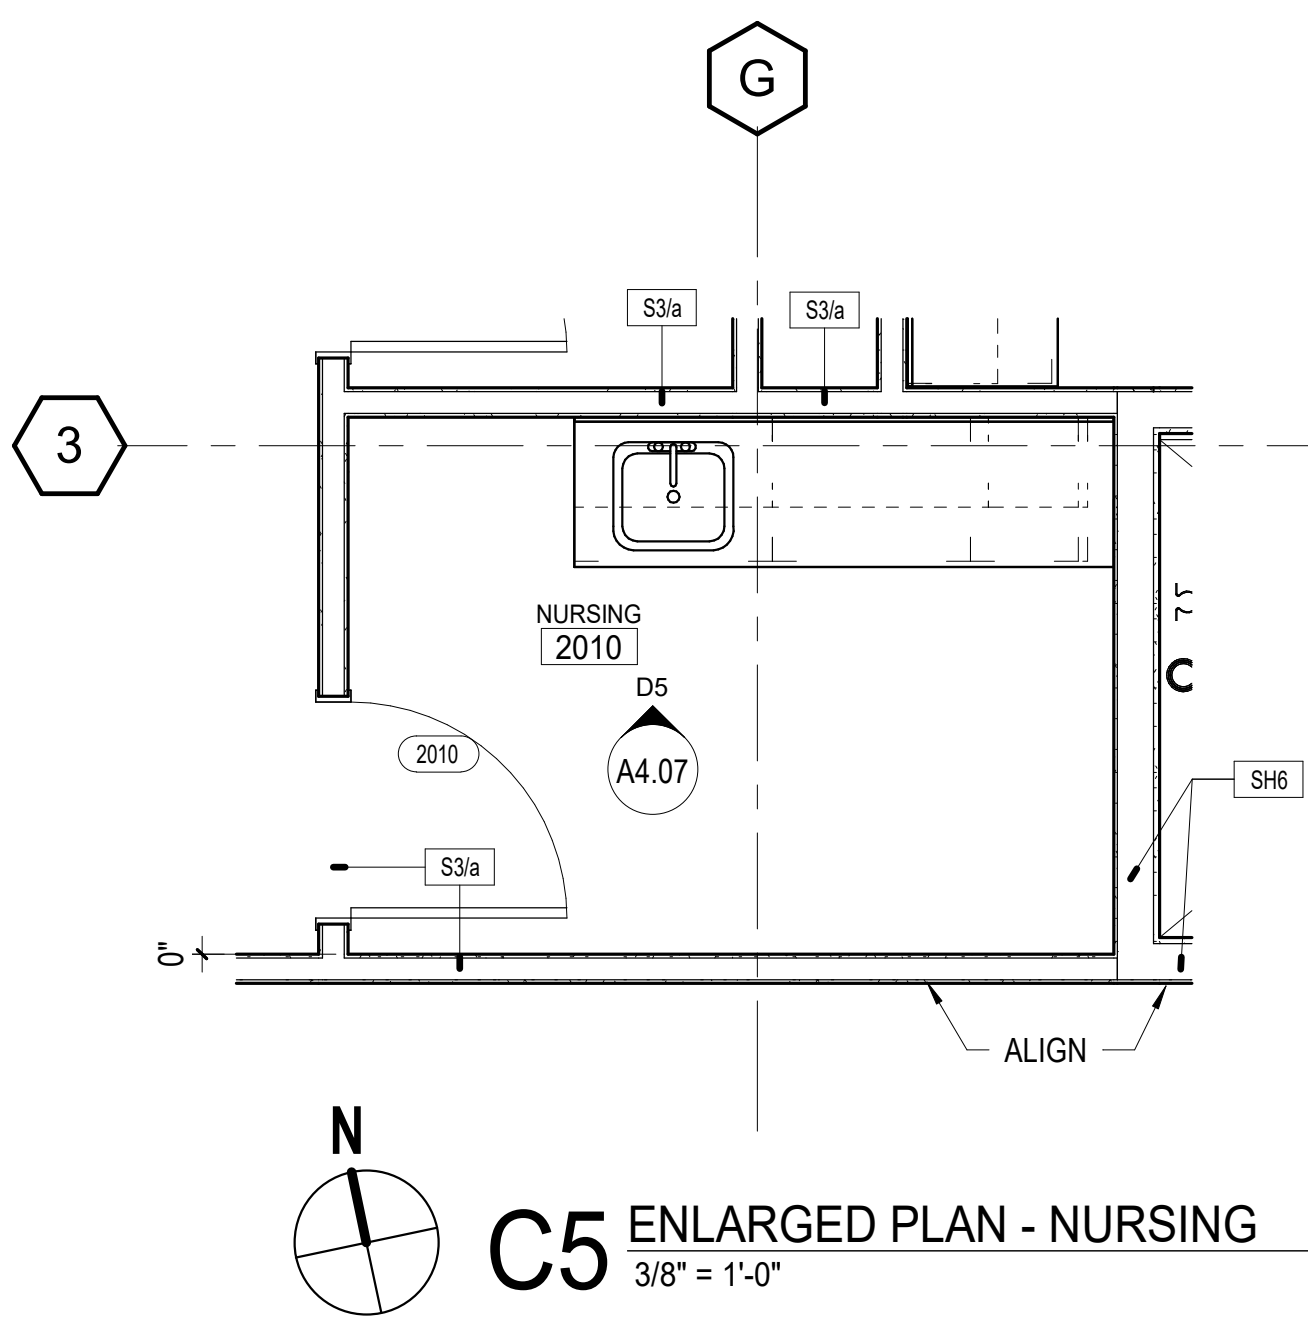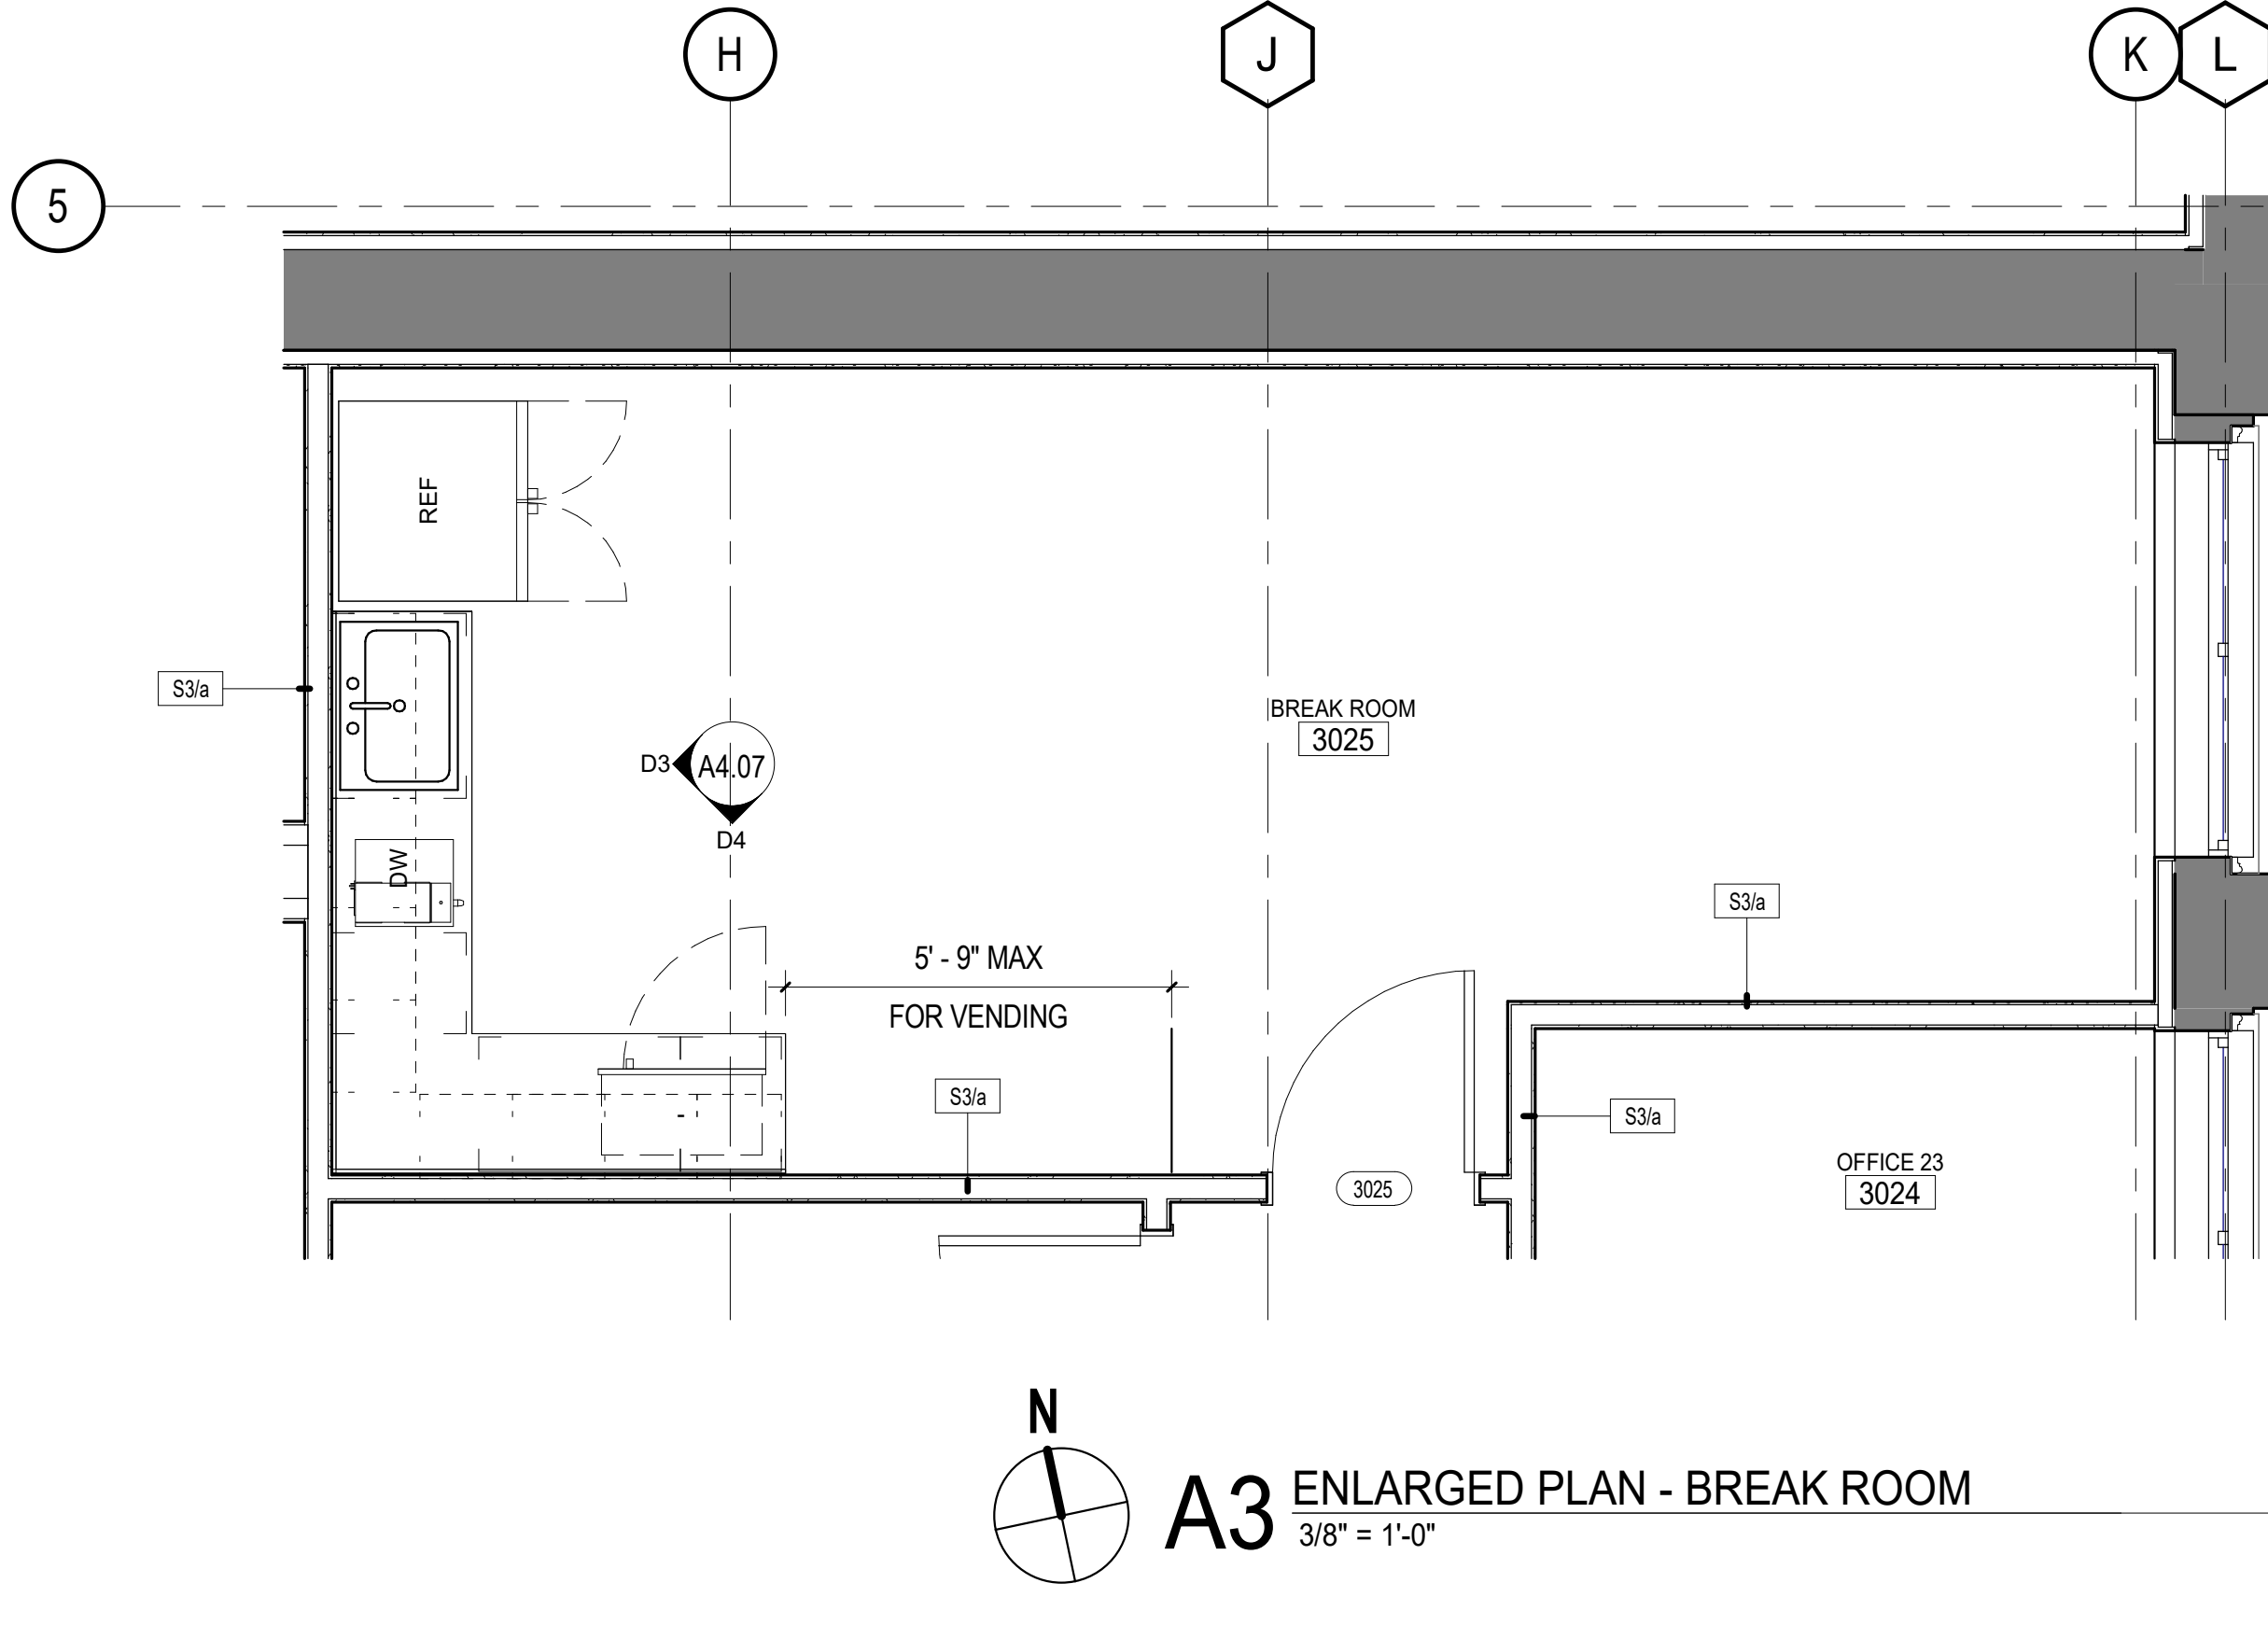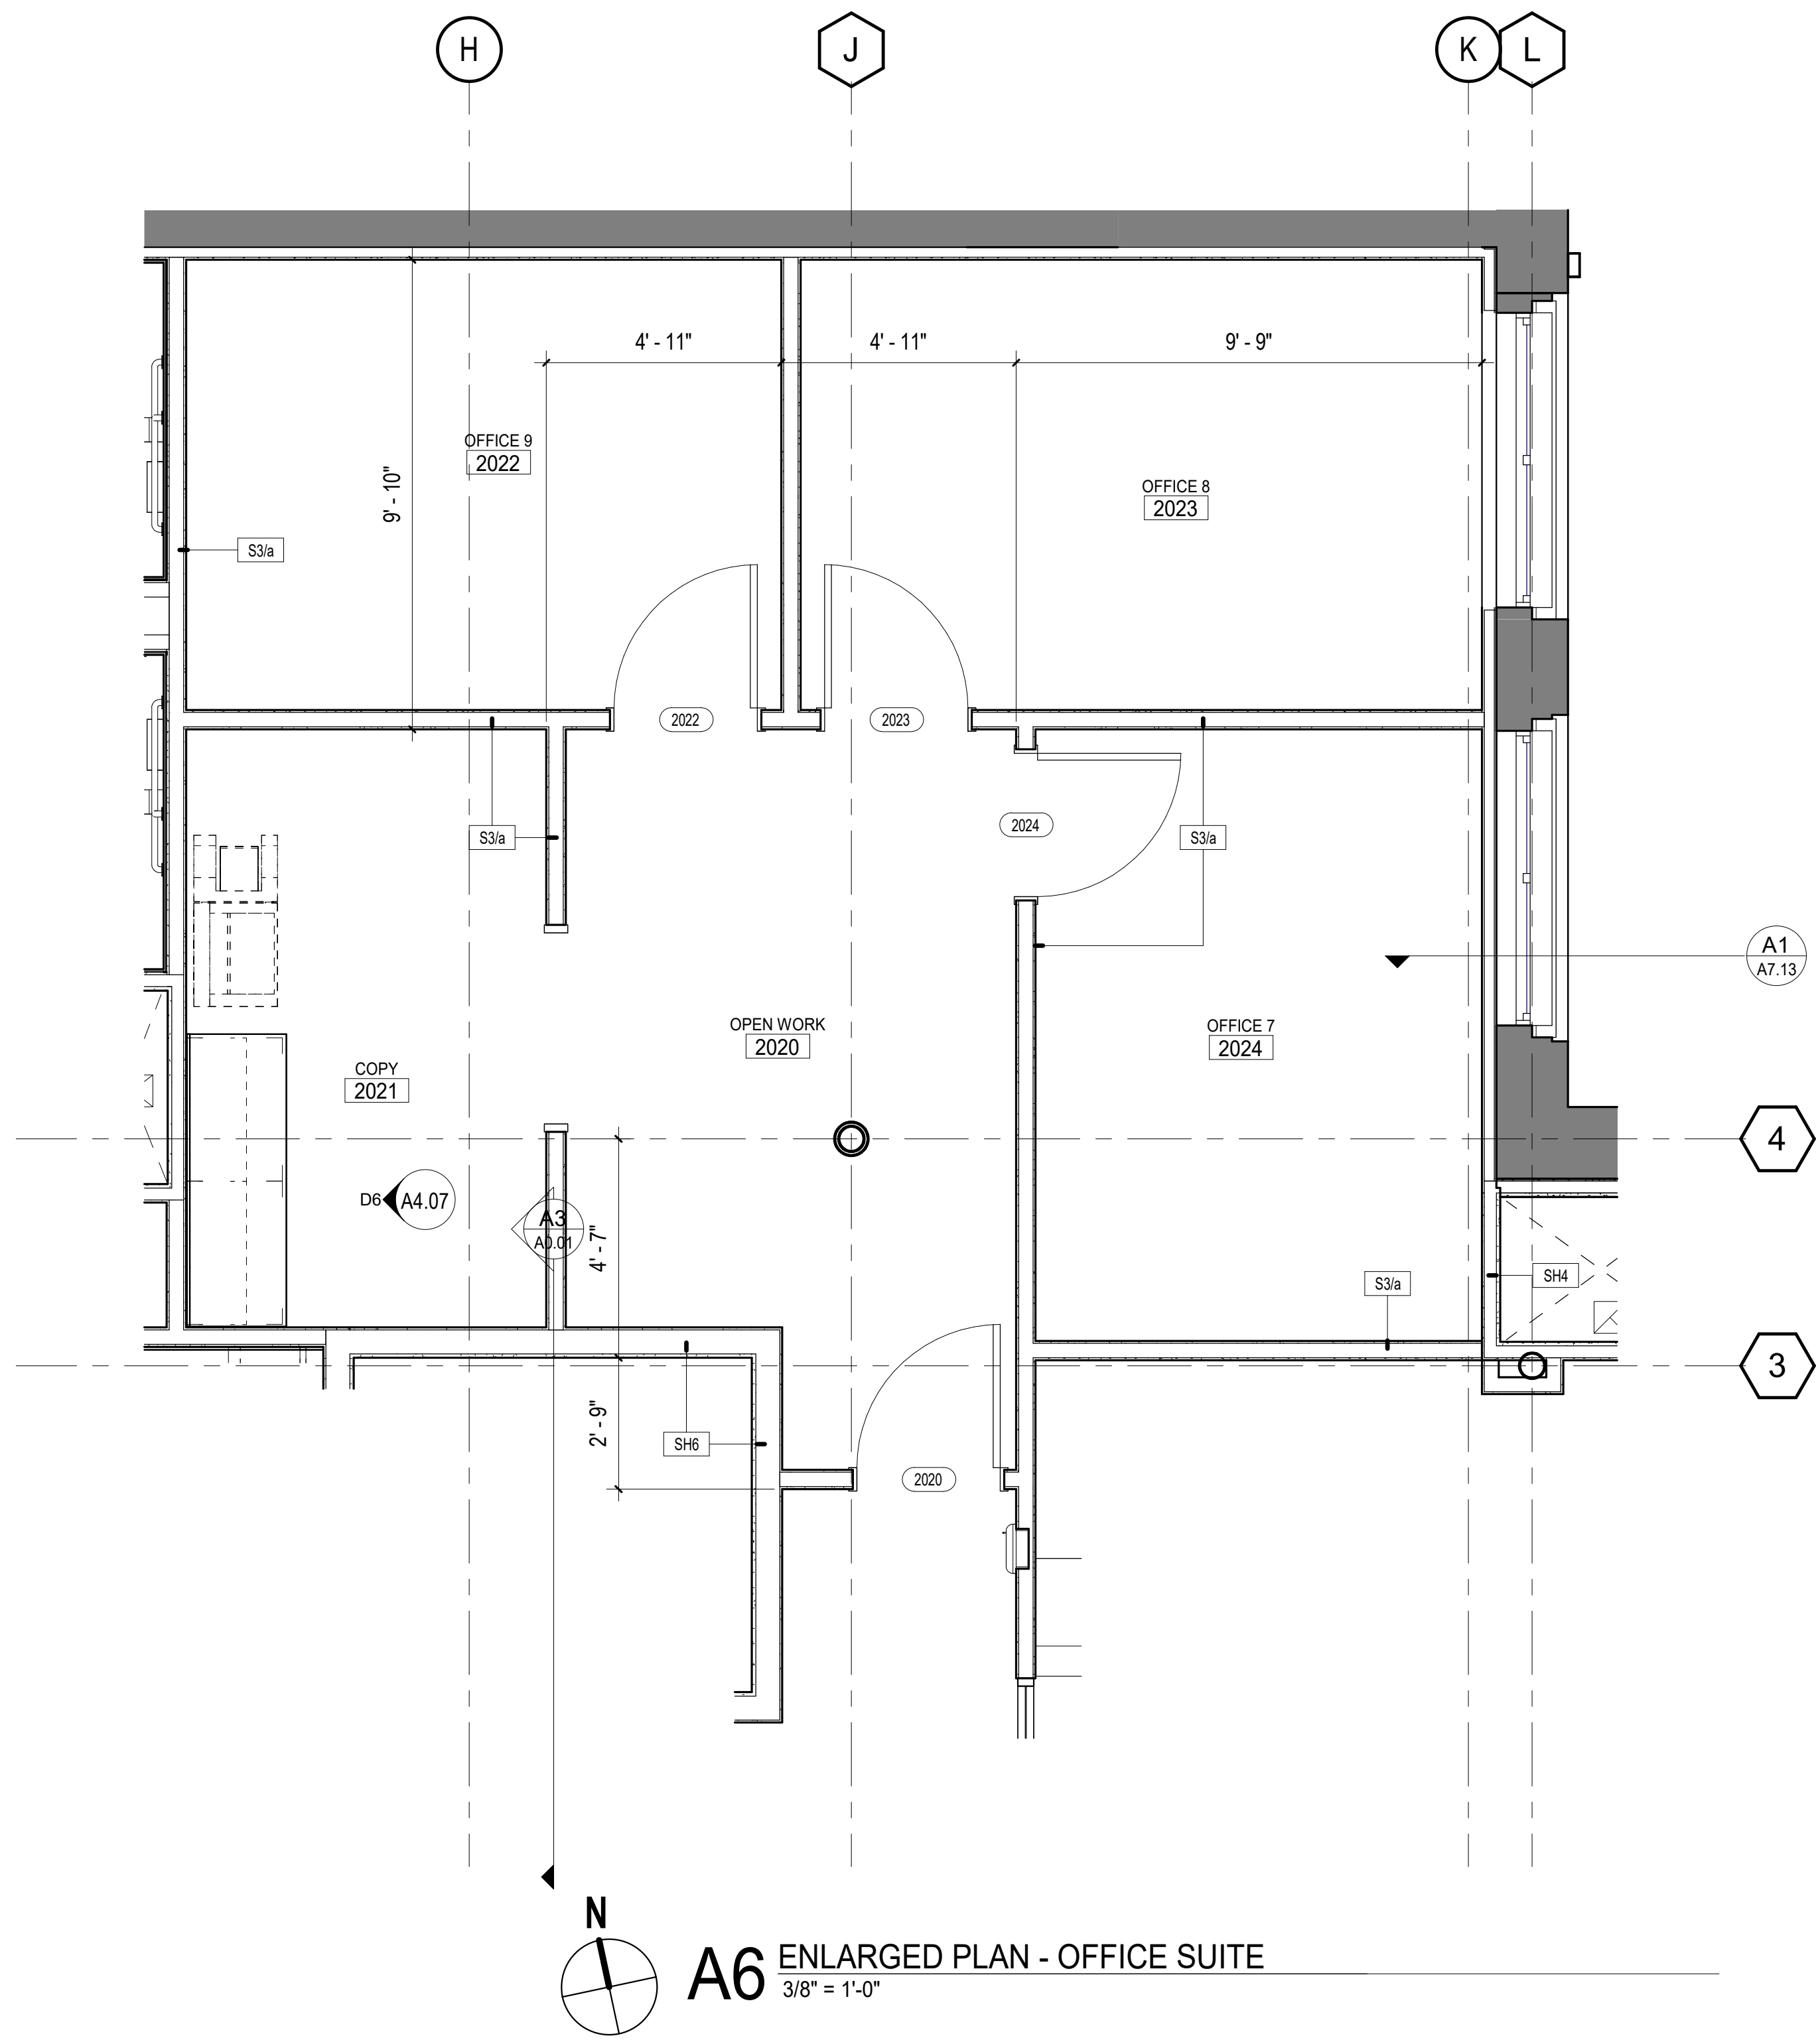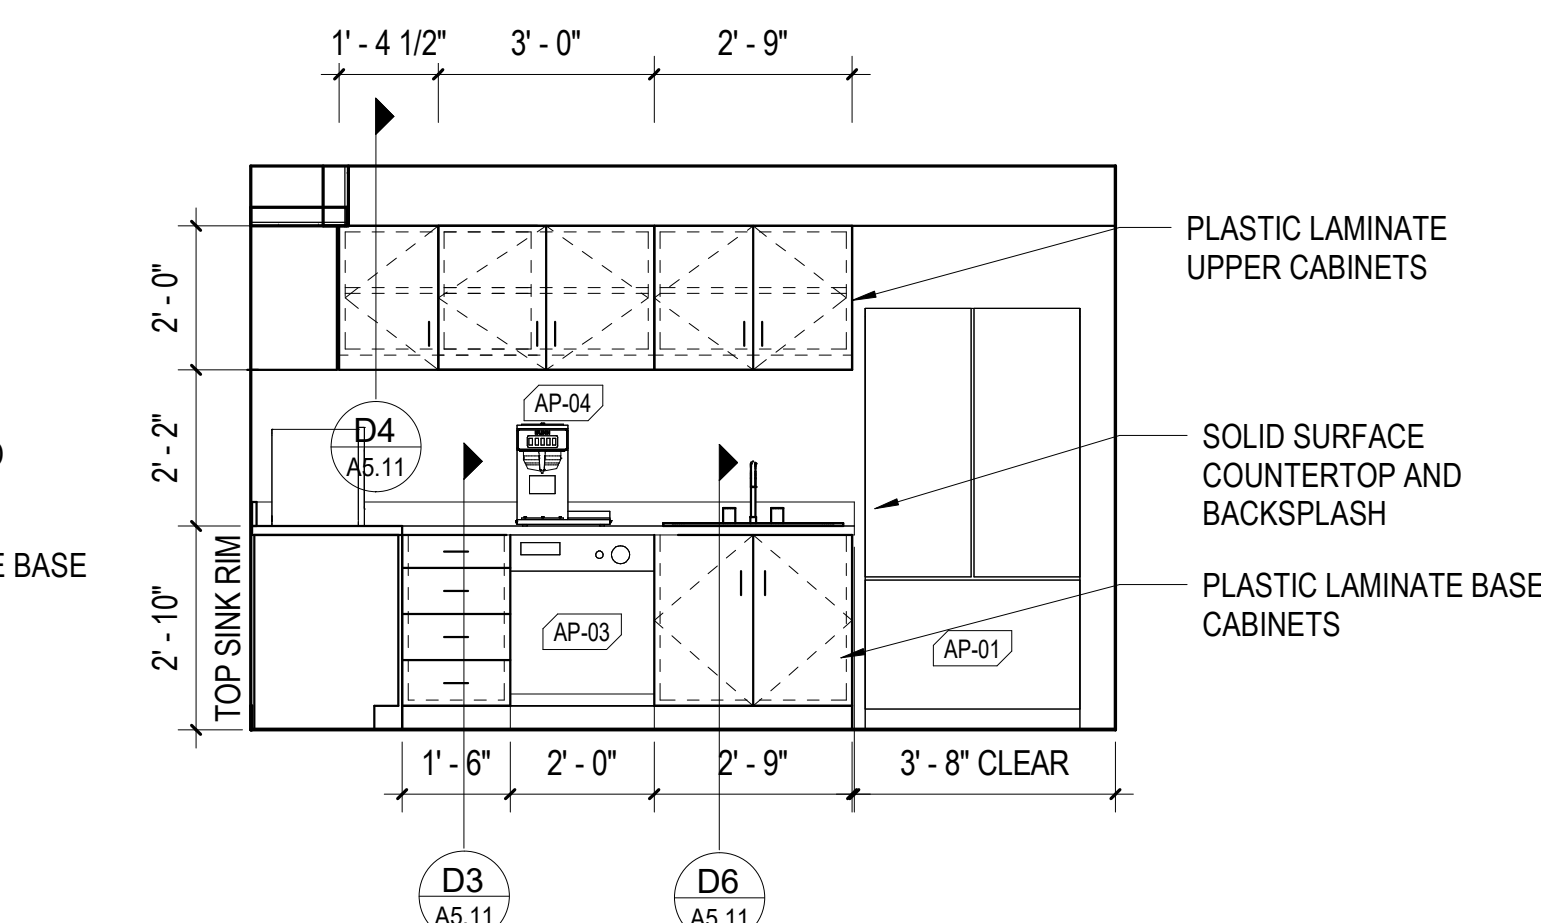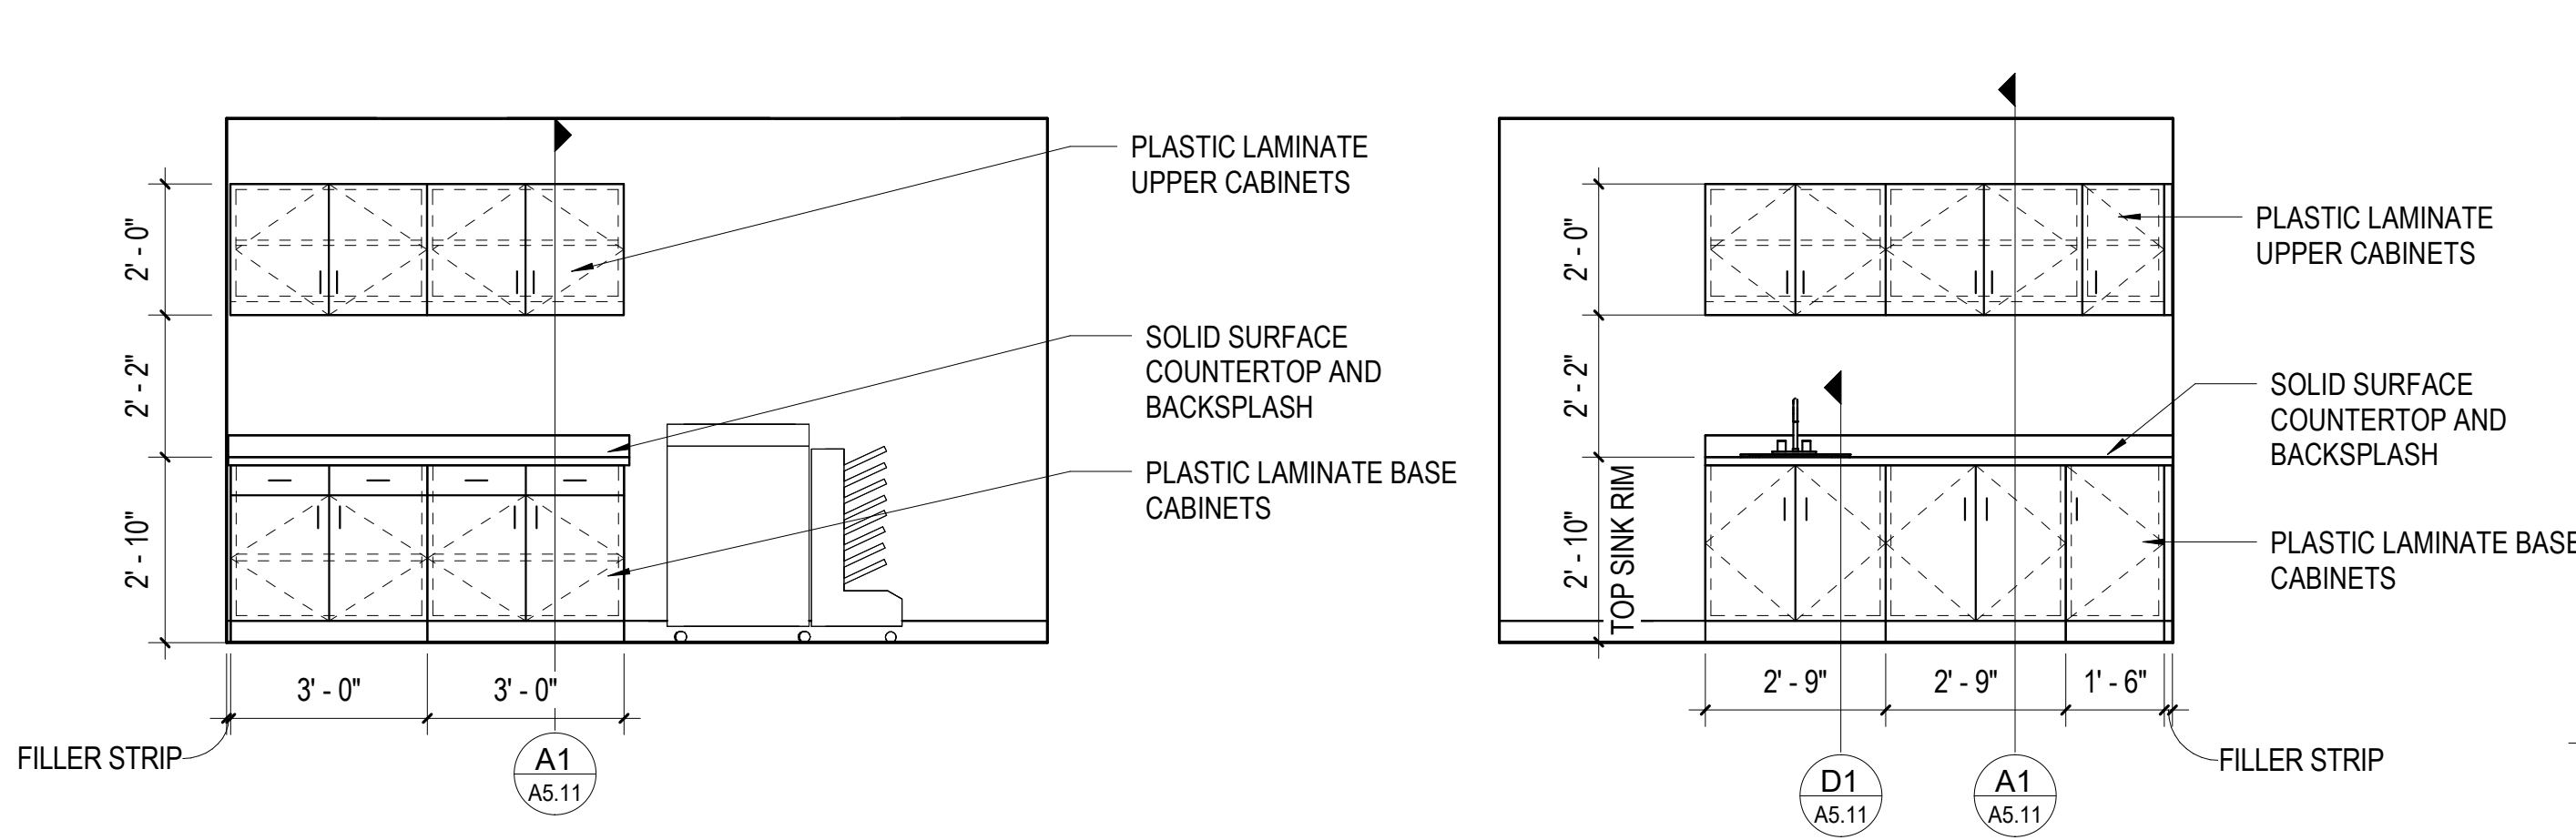

APPLIANCE LEGEND

TAG	APPLIANCE	MANUFACTURER	MODEL	PLUMBED	FURNISHED/IN STALLED
AP-01	REFRIGERATOR - 36" FRENCH DOOR	GE	GNE27JYMFS	YES	CF/CI
AP-02	MICROWAVE	GE	PES7227SLSS	---	CF/CI
AP-03	DISHWASHER	GE	GDT226SSLSS	YES	CF/CI
AP-04	COFFEE	TBD	TBD	YES	OF/CI

ENLARGED FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE/REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- ALL PARTITIONS TO BE TYPE S3/a UNLESS NOTED OTHERWISE.
- NOT USED
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES. UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
- WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
- FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
- CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
- REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
- ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

FLOOR PLAN LEGEND

COLUMN LINE (NEW) 0
COLUMN LINE (EXISTING) 0

VIEW TYPES

- BUILDING ELEVATION: ELEVATION # 1, DRAWING SHEET A101
- BUILDING SECTION: SECTION CUT # 1, DRAWING SHEET A101
- WALL SECTION: SECTION CUT # 1, DRAWING SHEET A101
- DETAIL / ENLARGED PLAN CALLOUT: CALLOUT # 1, DRAWING SHEET A101
- INTERIOR ELEVATION VIEW: ELEVATION # A1, DRAWING SHEET A101

TAG TYPES

- ROOM NAME/NUMBER: ROOM NAME 101
- DOOR NUMBER: 101
- WINDOW TYPE: 1
- STOREFRONT / CURTAIN WALL: SF-22
- WALL TYPE TAG: S3
- DRAWING SHEET KEYNOTE: 1
- REVISION NUMBER: 1

NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
3531
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOMING 2024B3
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

THE UNIVERSITY OF ALABAMA
1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
101		

DRAWING TITLE

BREAK ROOM FLOOR PLANS AND ELEVATIONS

DRAWN BY: Author

CHECKED BY: Checker

PROJECT NUMBER


236002-02

DRAWING NO.


A4.07

TYPICAL TV MOUNTING HEIGHT UNLESS NOTED OTHERWISE. CONTRACTOR TO PROVIDE BLOCKING & POWER


E5 ELEVATION - TYPICAL TV MOUNT
3/8" = 1'-0"

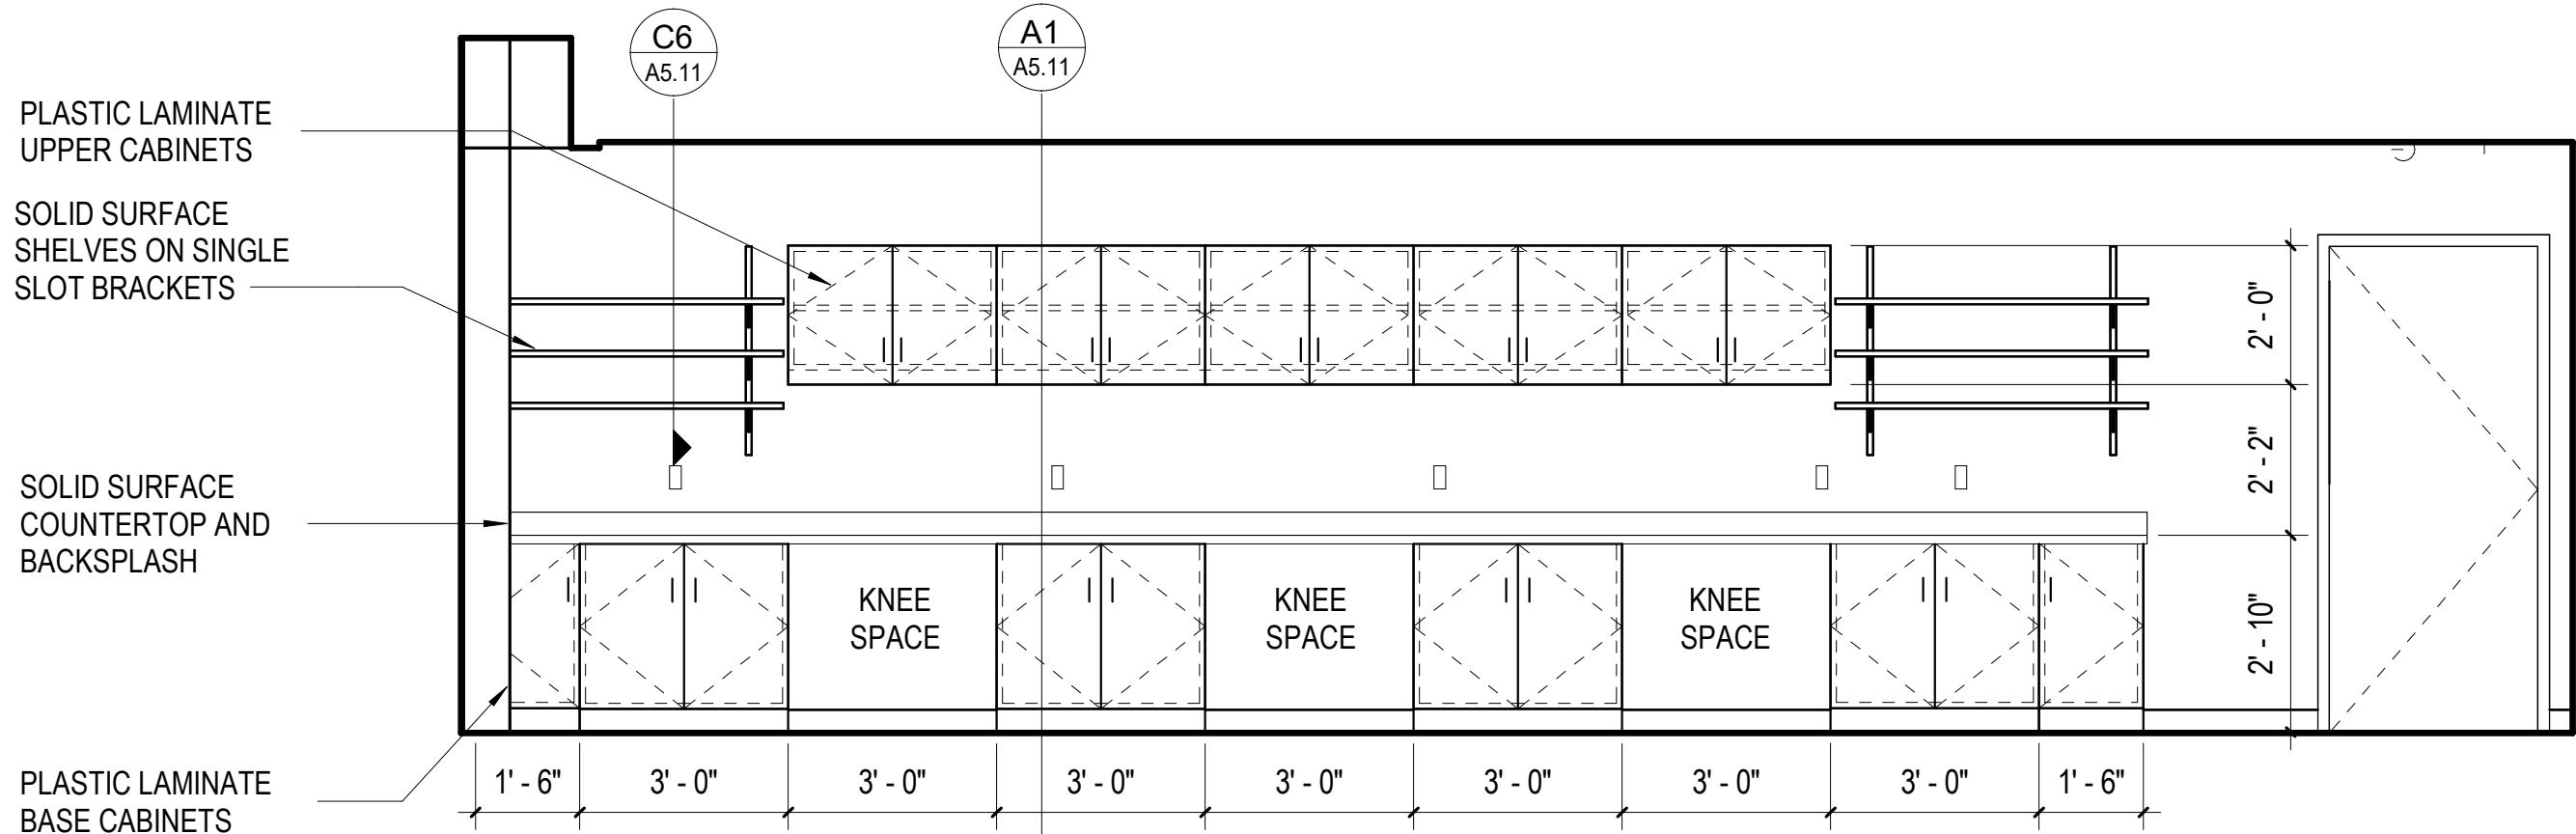


D5 ELEVATION - ACADEMIC MAKER SPACE (NORTH)
3/8" = 1'-0"

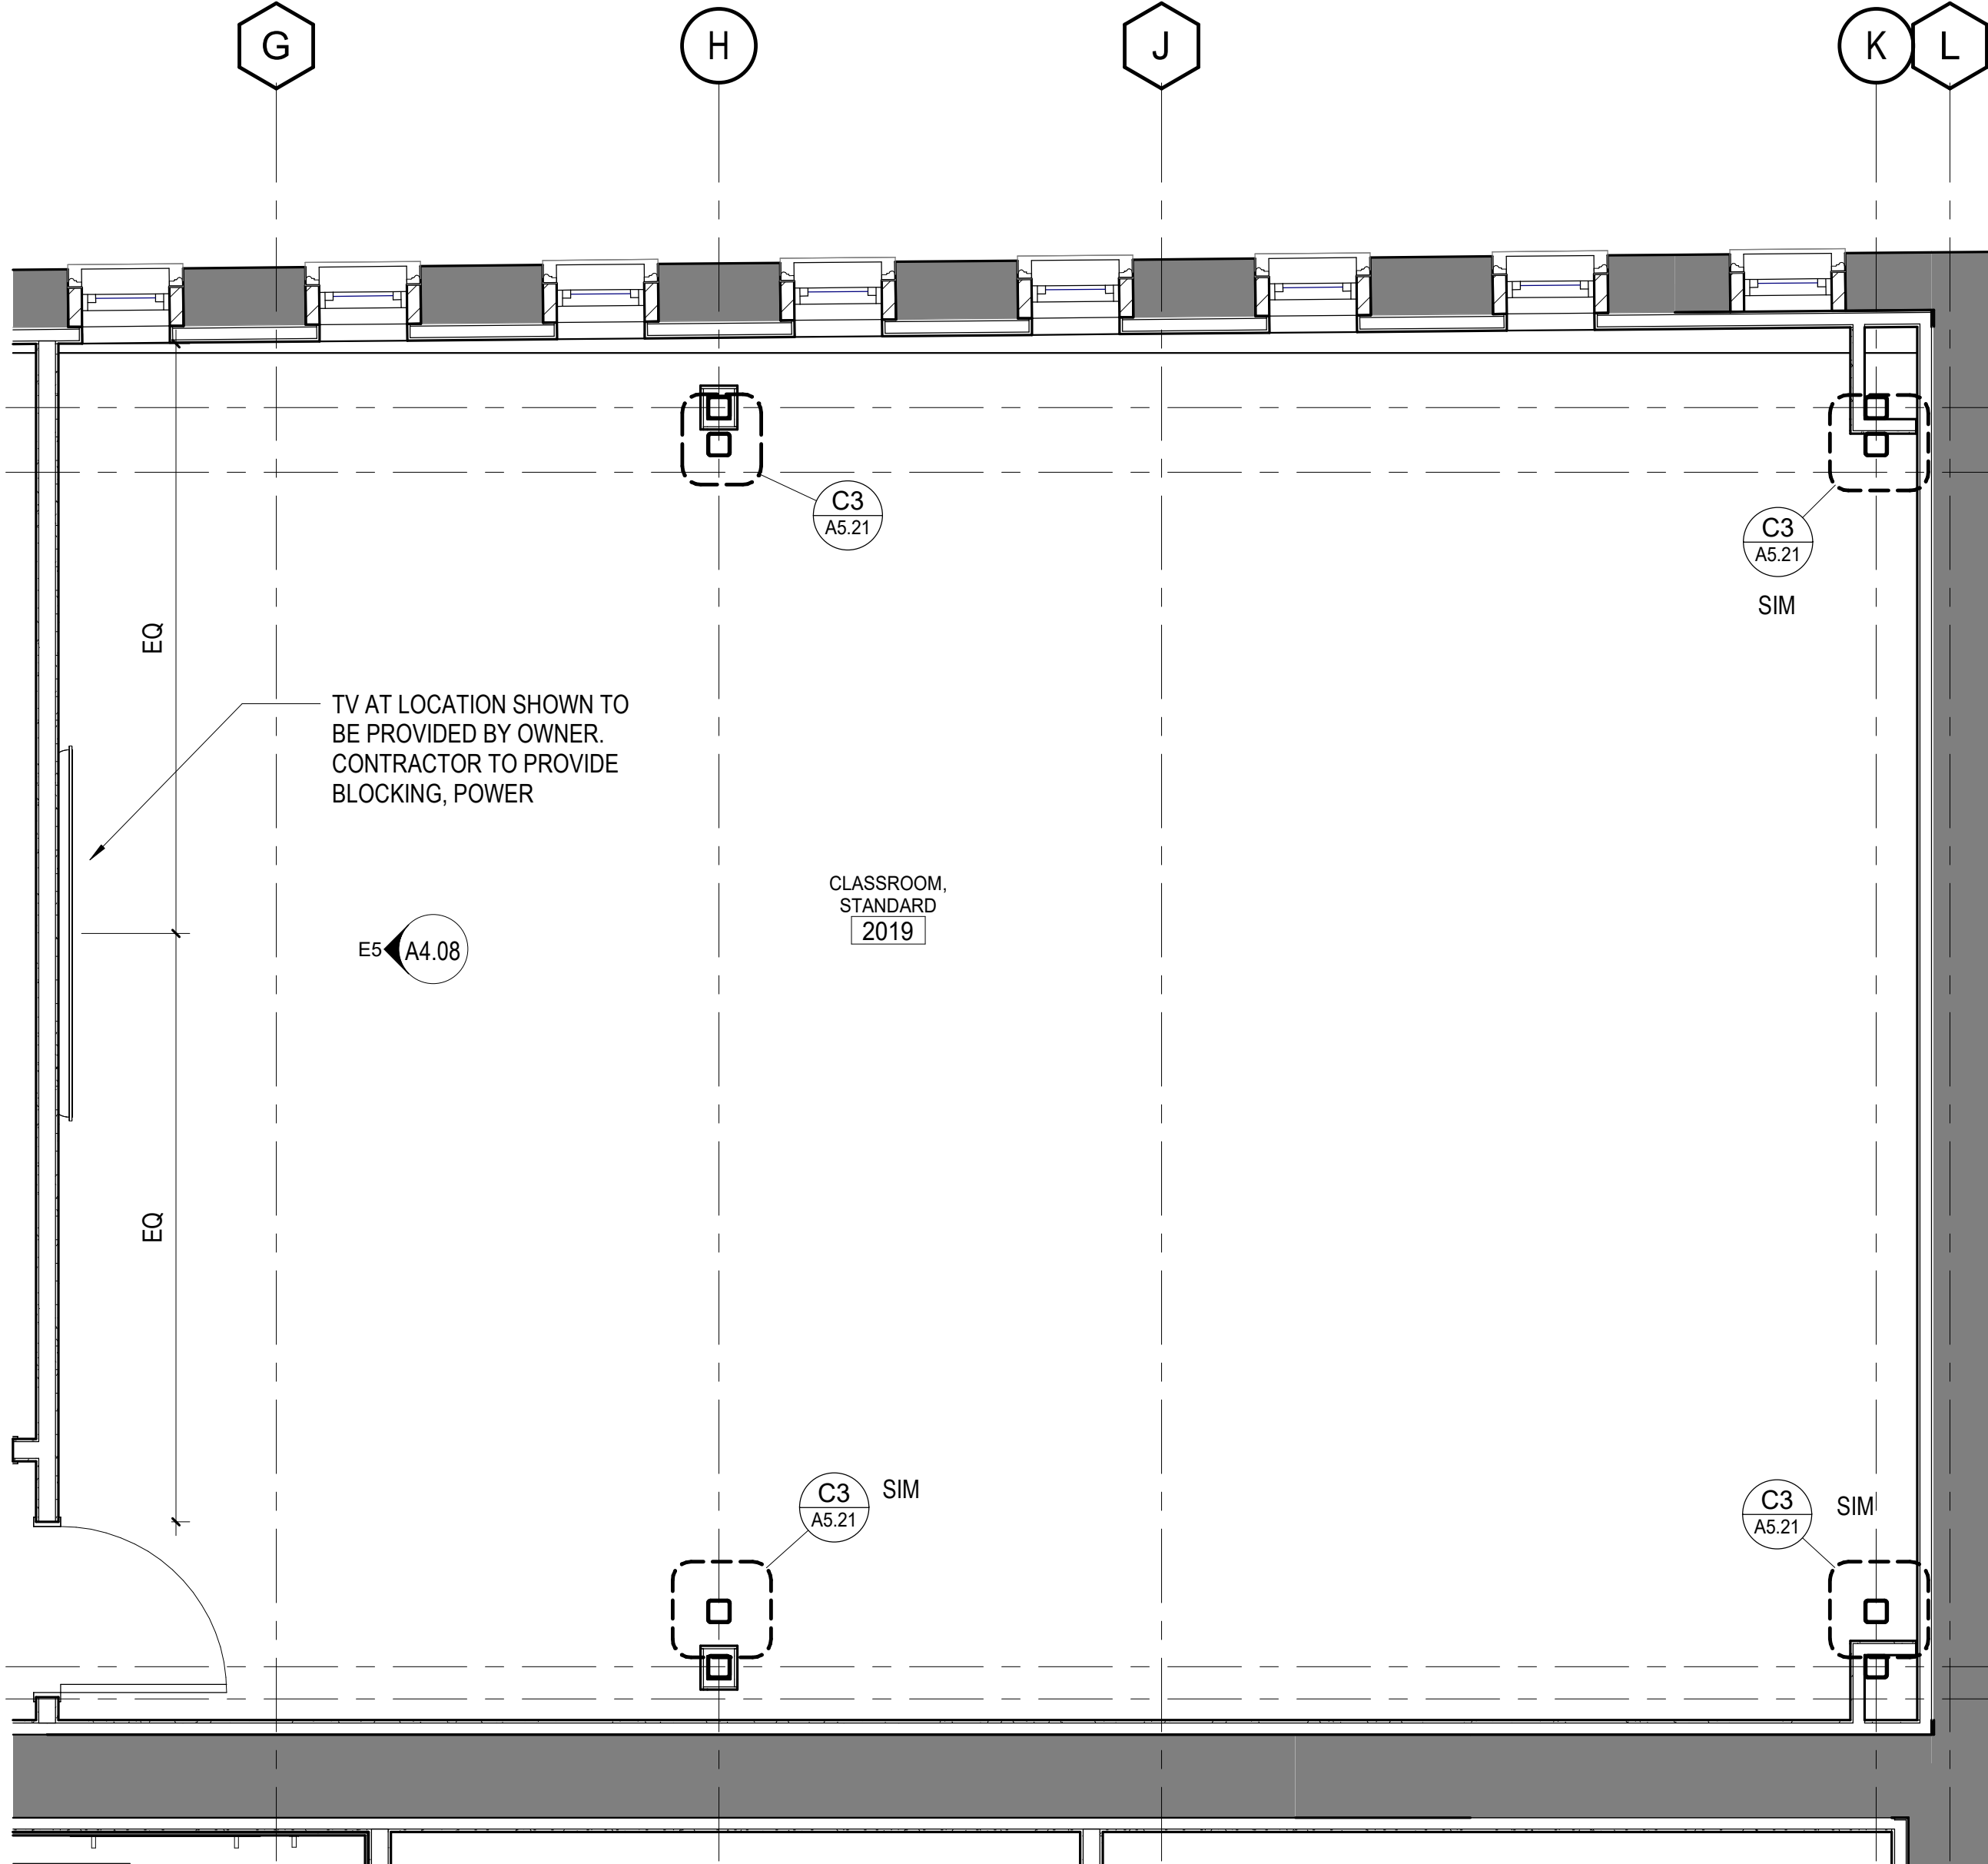

A5 ENLARGED PLAN - CLASSROOM, STANDARD
3/8" = 1'-0"

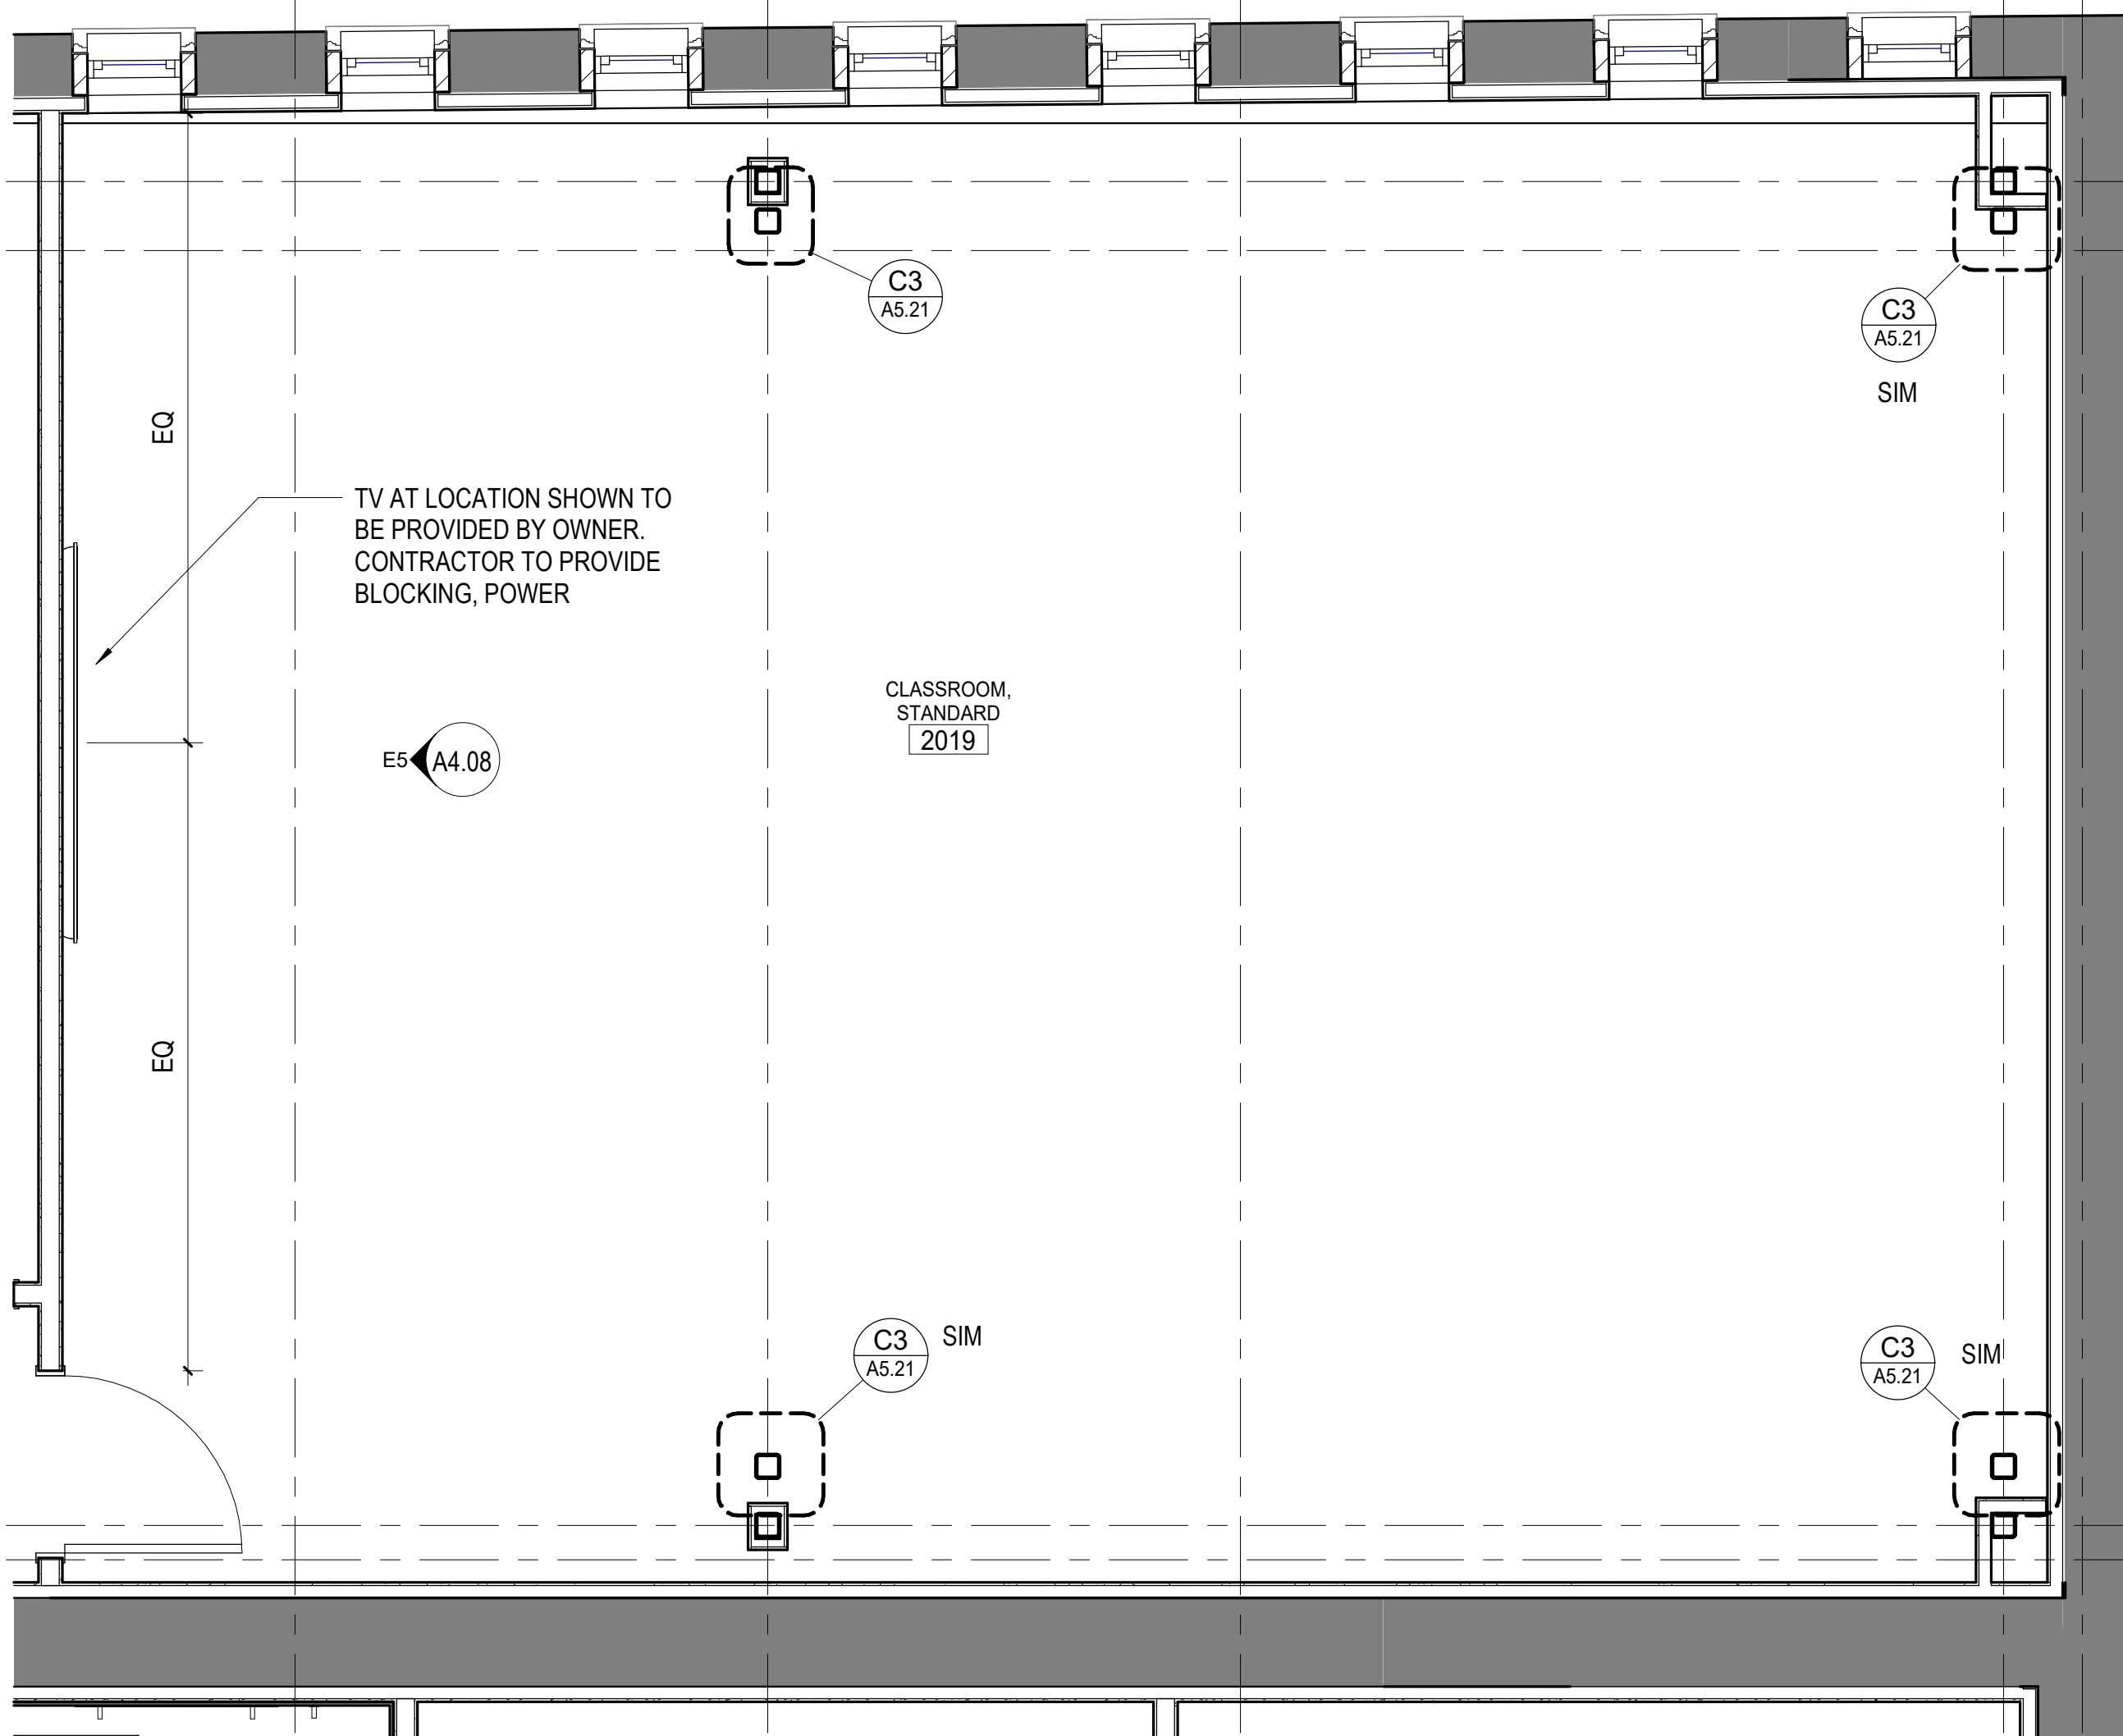

A3 ENLARGED PLAN - COLLEGE OF EDUCATION INSTRUCTIONAL AREA
3/8" = 1'-0"

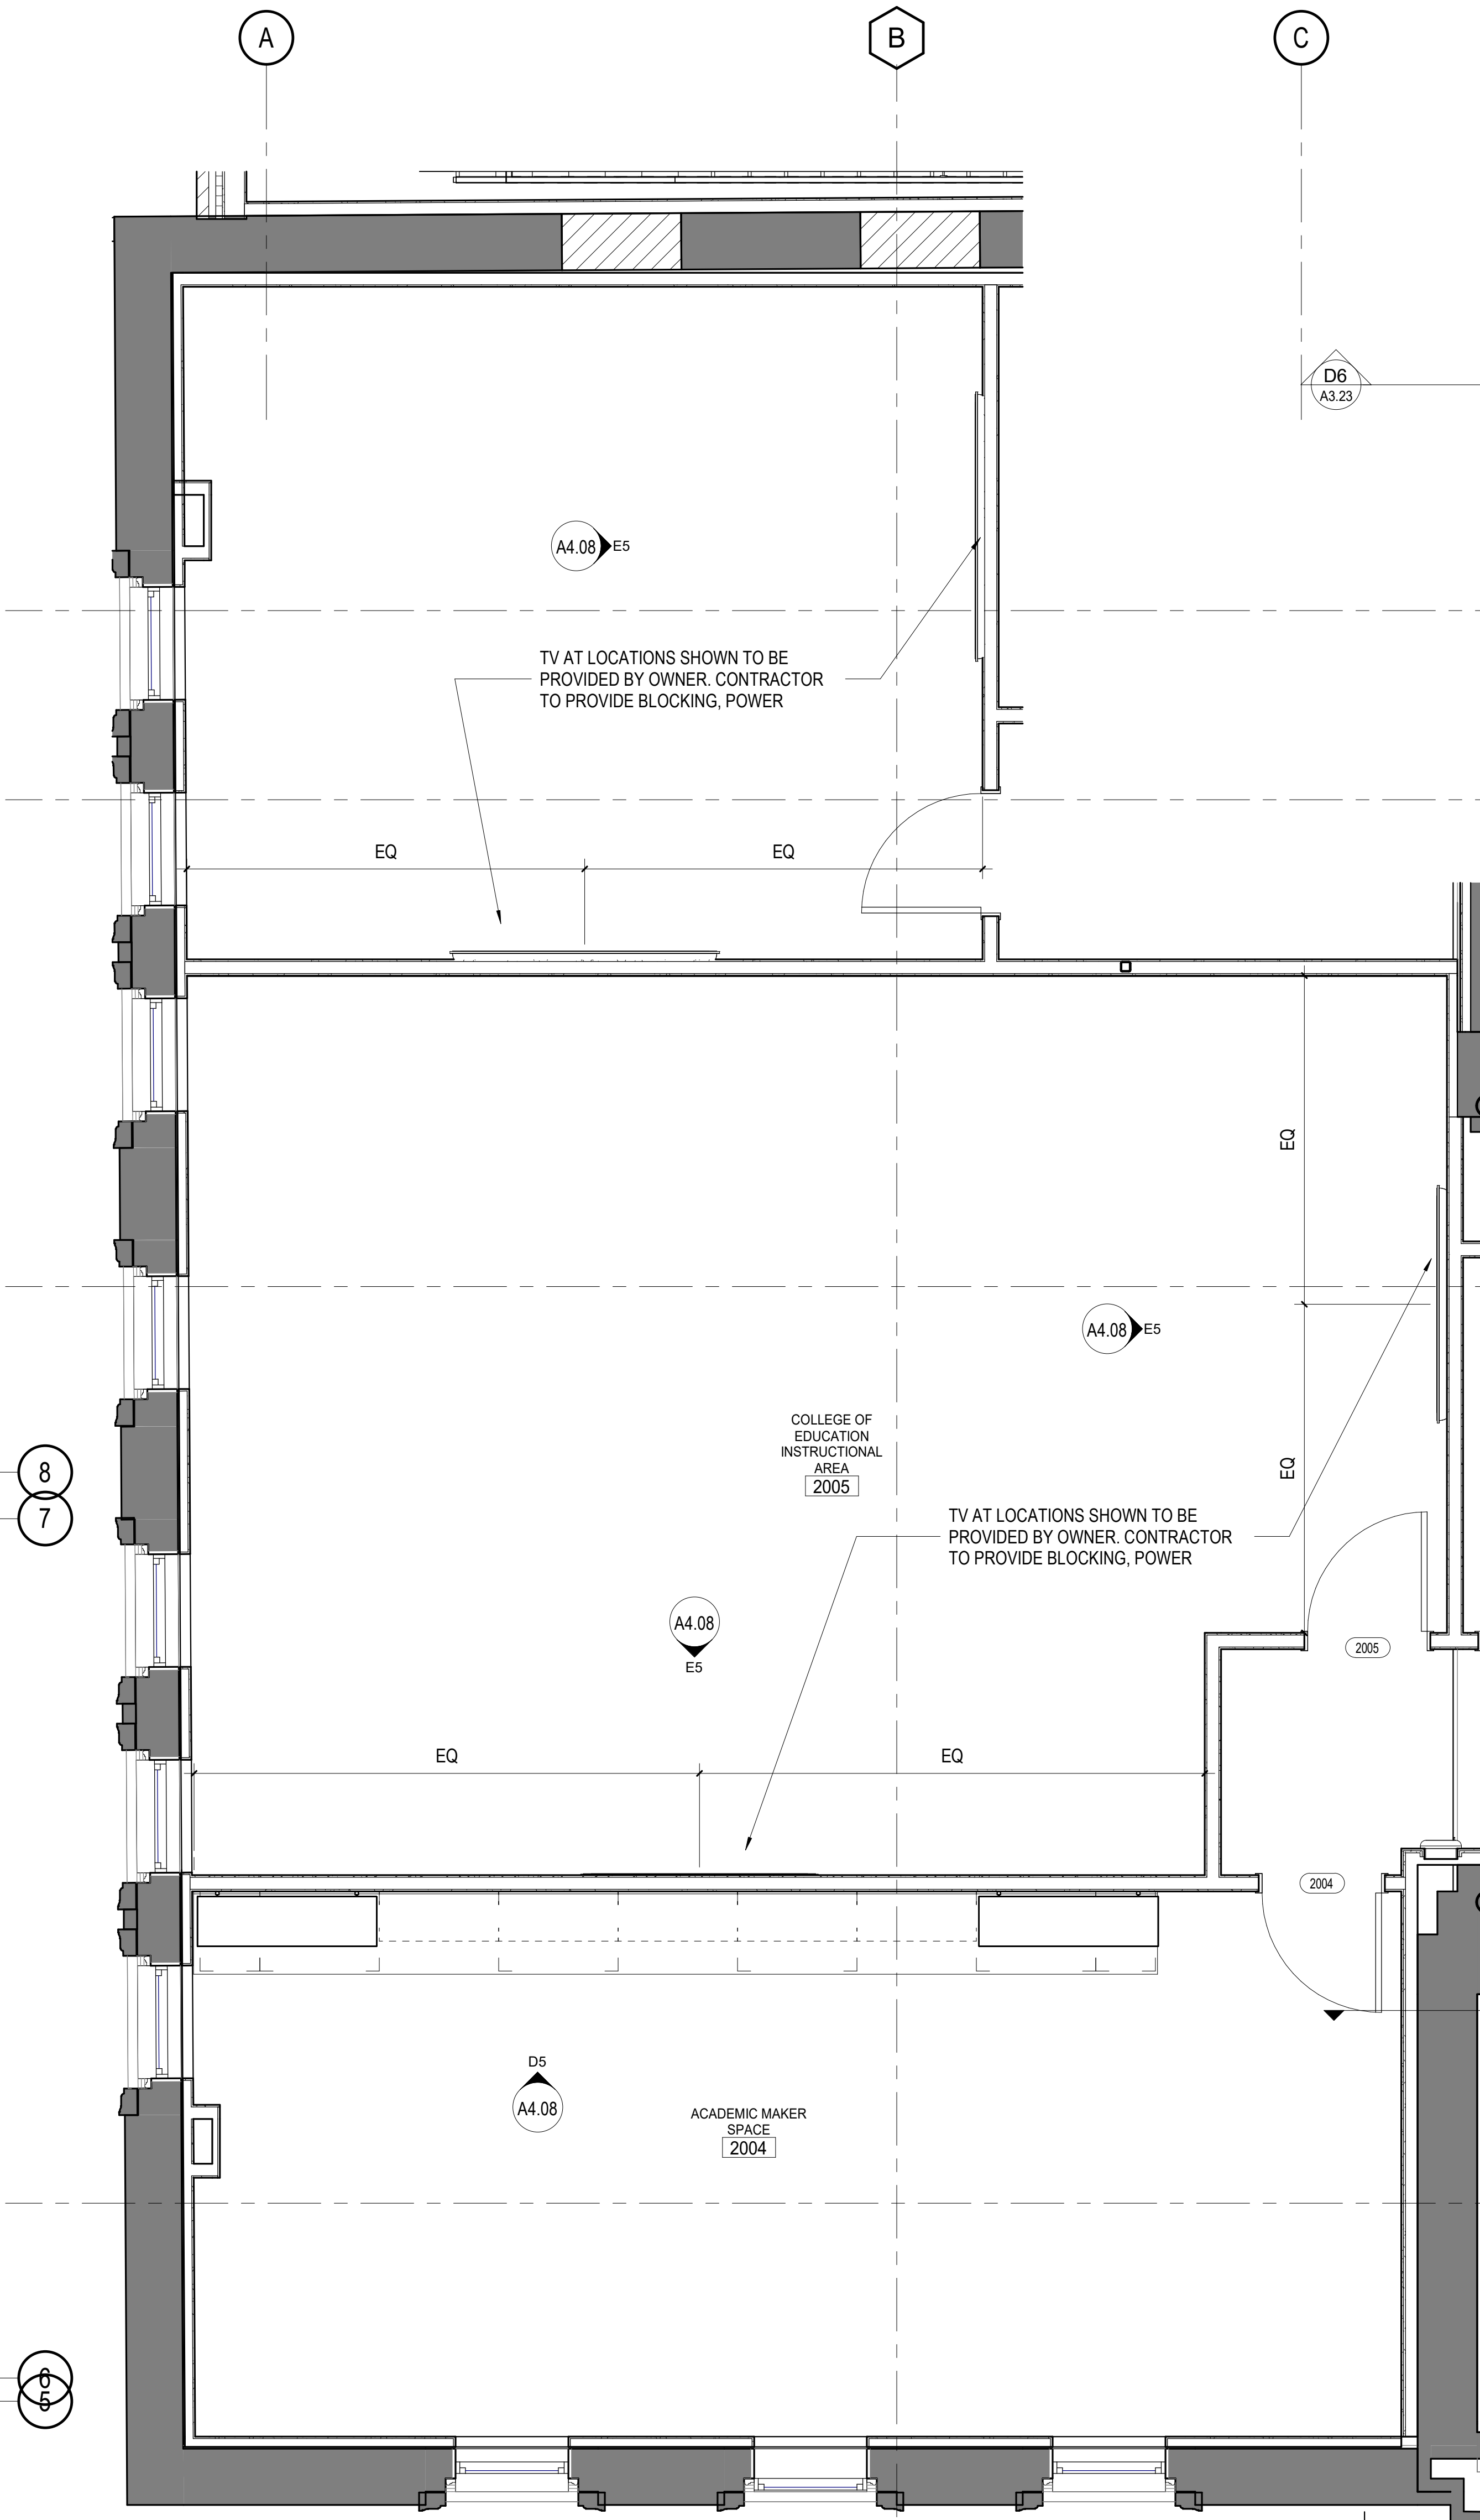

ENLARGED FLOOR PLAN GENERAL NOTES

- DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL. UNLESS NOTED OTHERWISE, REFER TO ARCHITECTURAL DRAFTING NOTES AN SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
- PARTITION TYPES SCHEDULED ON SHEET A6.01. RE: LIFE SAFETY PLANS FOR GRAPHIC EXTENT OF FIRE-RATED PARTITIONS. RE: PARTITION TYPE SCHEDULE FOR LOCATION OF SOUND ATTENUATION BLANKETS.
- RE: SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS AND LAYOUTS OF PLUMBING FIXTURES AND TOILET ACCESSORIES.
- ALL PARTITIONS TO BE TYPE S3a UNLESS NOTED OTHERWISE.
- NOT USED
- PROVIDE 1'-0" MINIMUM CLEAR FLOOR SPACE AT PUSH SIDE OF EACH DOOR. PROVIDE 1'-6" MINIMUM CLEAR FLOOR SPACE AT PULL SIDE OF EACH DOOR, UNLESS SPECIFICALLY DIMENSIONED OR NOTED OTHERWISE.
- PROVIDE 1'-4" WIDE CHASE BEHIND SINGLE-SIDED TOILETS FOR WALL-HUNG FIXTURES, UNLESS DIMENSIONED OTHERWISE. FOR FLOOR-MOUNTED FIXTURES, PROVIDE A 6" STUD, MINIMUM. PROVIDE BLOCKING FOR WALL MOUNTED FIXTURES.
- MOUNT LAVATORIES AND SINKS 1'-3" MINIMUM FROM CENTERLINE OF FIXTURE TO FINISHED FACE OF ADJACENT PARTITION.
- WATER CLOSETS SHALL BE MOUNTED 1'-6" FROM THE CENTER OF THE WATER CLOSET TO THE FINISHED SURFACE OF THE SIDE WALL.
- FLUSH CONTROLS SHALL BE MOUNTED ON THE OPEN SIDE OF TOILETS, 44 INCHES MAX ABOVE FINISHED FLOOR.
- CENTER MIRROR AND LIGHT FIXTURE OVER LAVATORY, TYPICAL, UNLESS NOTED OTHERWISE.
- REFER TO PLUMBING SHEETS FOR DRAIN SIZES AND LOCATIONS.
- ALL APPLIANCES TO BE PROVIDED AND INSTALLED BY OWNER.

FLOOR PLAN LEGEND

- COLUMN LINE (NEW) 0
- COLUMN LINE (EXISTING) 0


VIEW TYPES

- BUILDING ELEVATION 1 A101 ELEVATION # DRAWING SHEET
- BUILDING SECTION 1 A101 SECTION CUT # DRAWING SHEET
- WALL SECTION 1 A101 CALLOUT # DRAWING SHEET
- DETAIL / ENLARGED PLAN CALLOUT 1 A101 ELEVATION # DRAWING SHEET
- INTERIOR ELEVATION VIEW 1 A101 ELEVATION # DRAWING SHEET


TAG TYPES

- ROOM NAME/NUMBER 101
- DOOR NUMBER 1
- WINDOW TYPE SF-22
- STOREFRONT / CURTAIN WALL S3
- WALL TYPE TAG 1
- DRAWING SHEET KEYNOTE 1
- REVISION NUMBER 1


NOTE:
REFER TO SHEET G0.02 FOR ADDITIONAL SYMBOLS

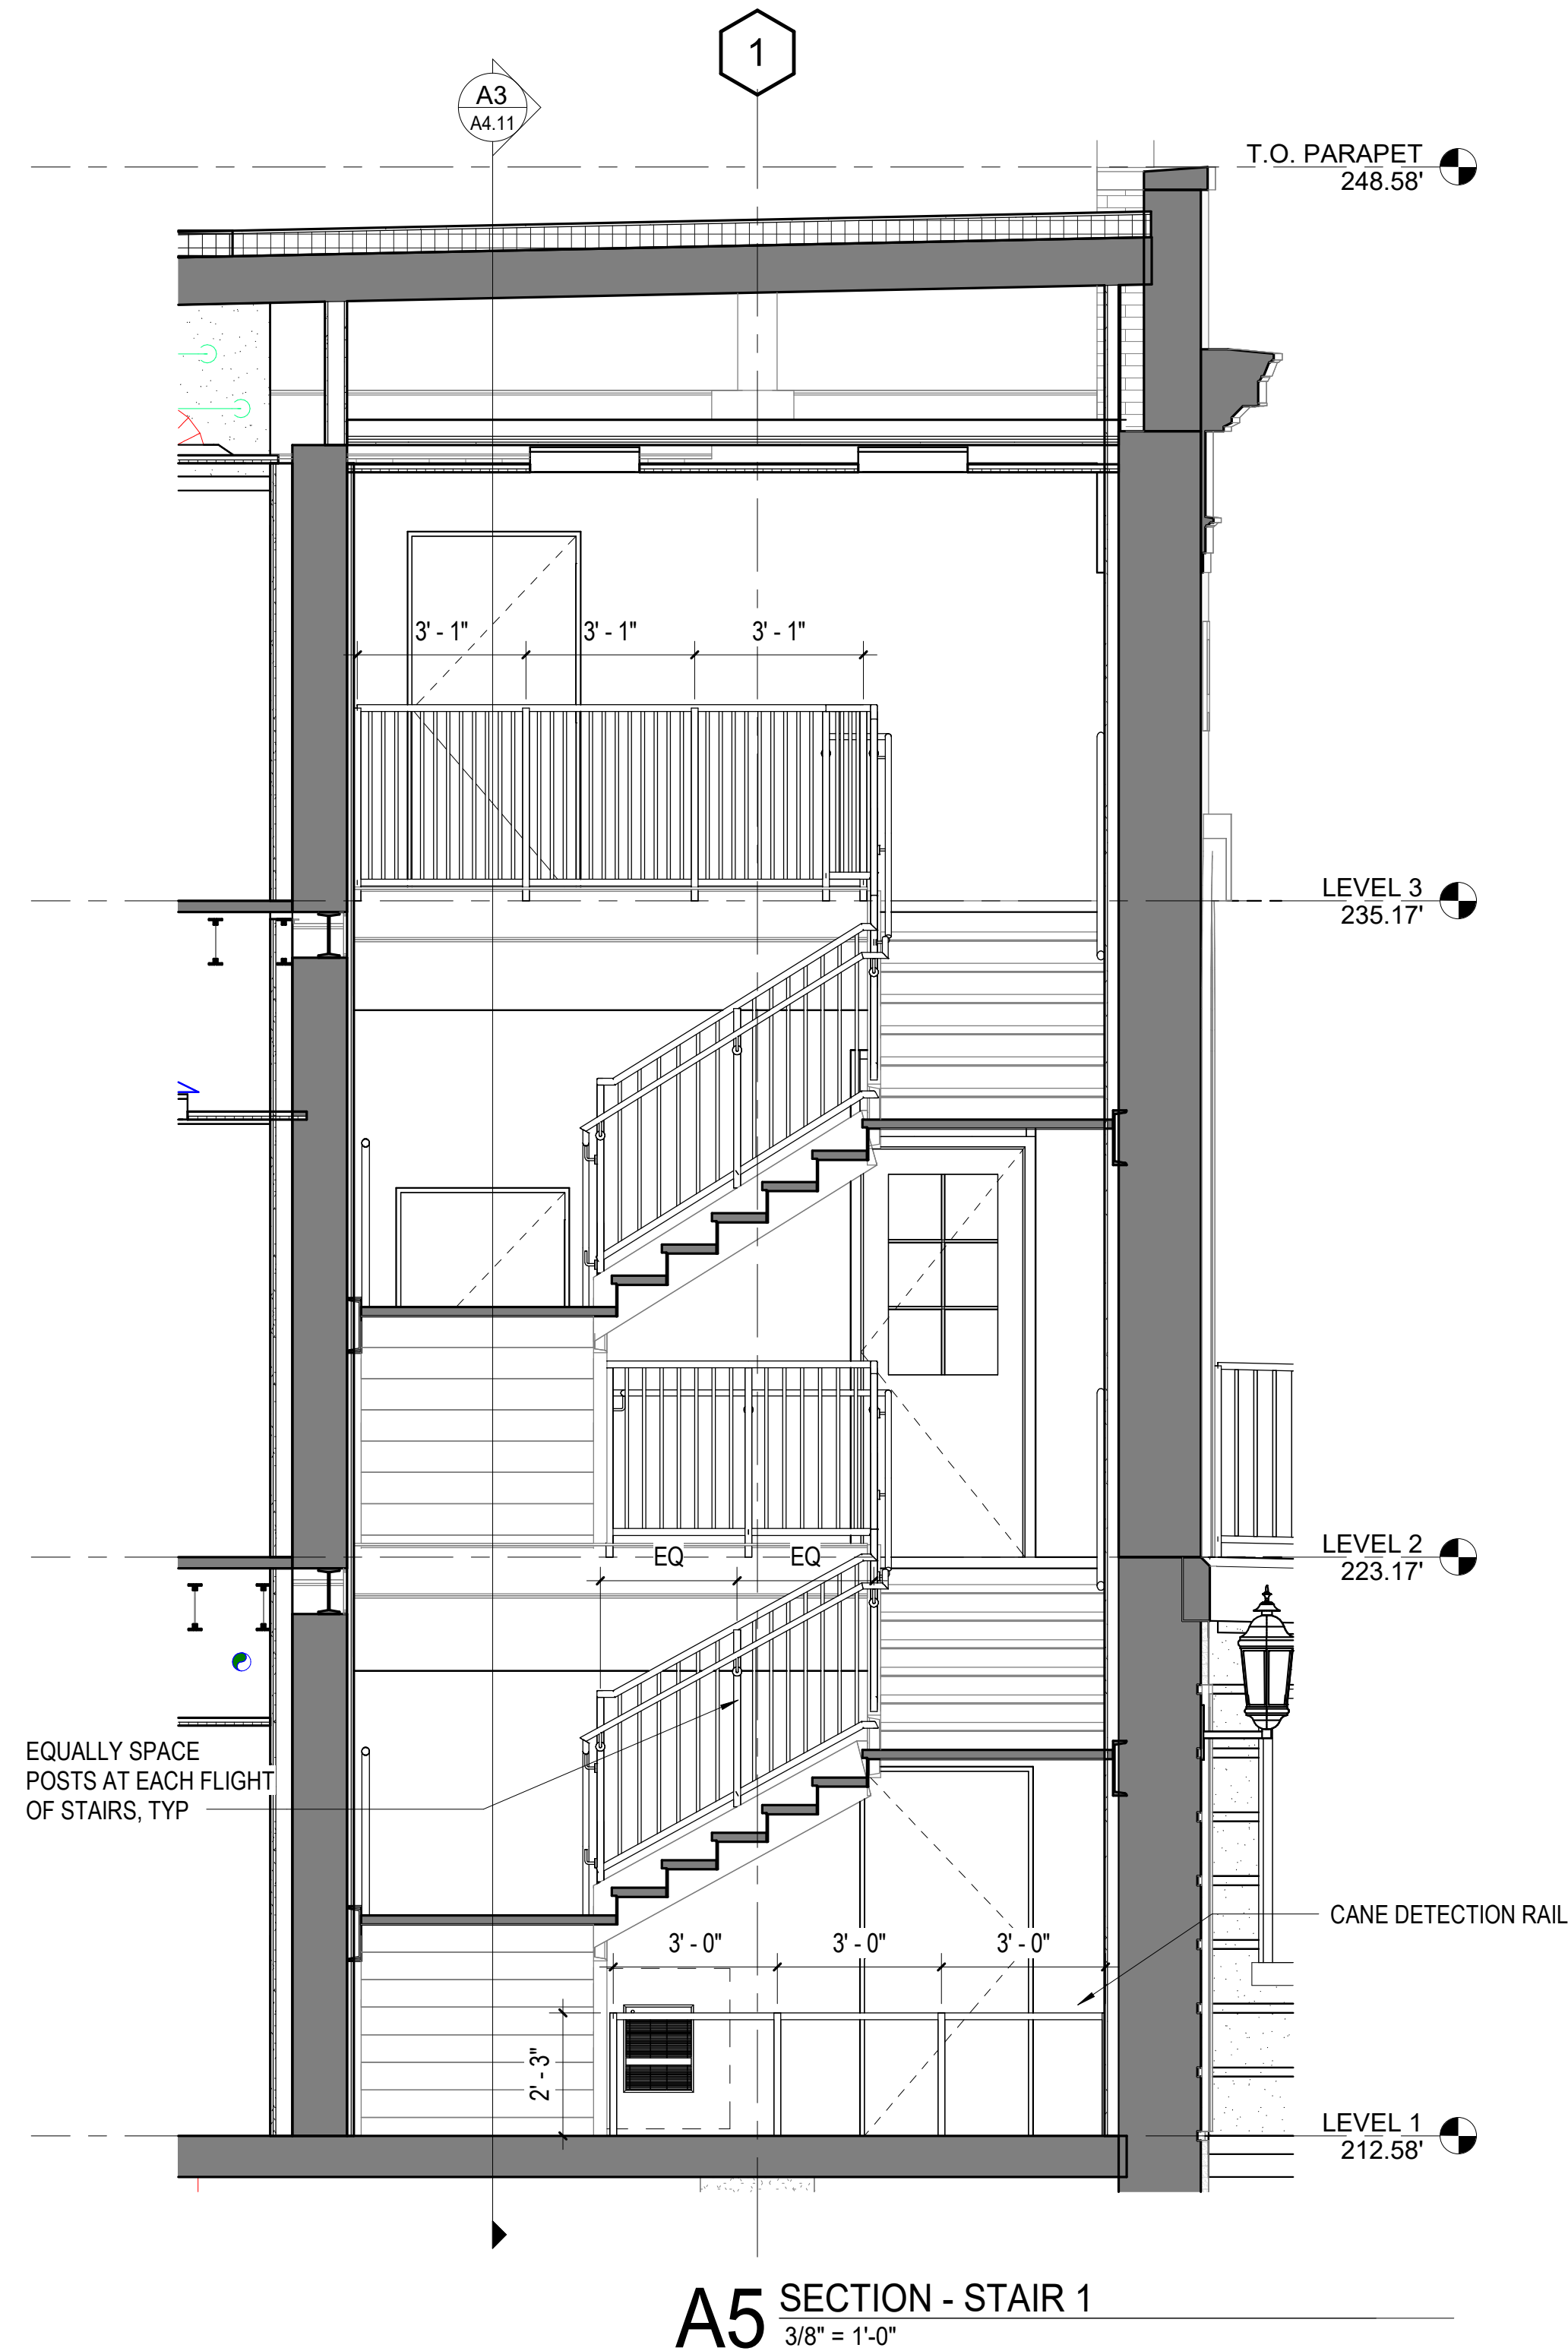


A5 SECTION - STAIR 1
3/8" = 1'-0"

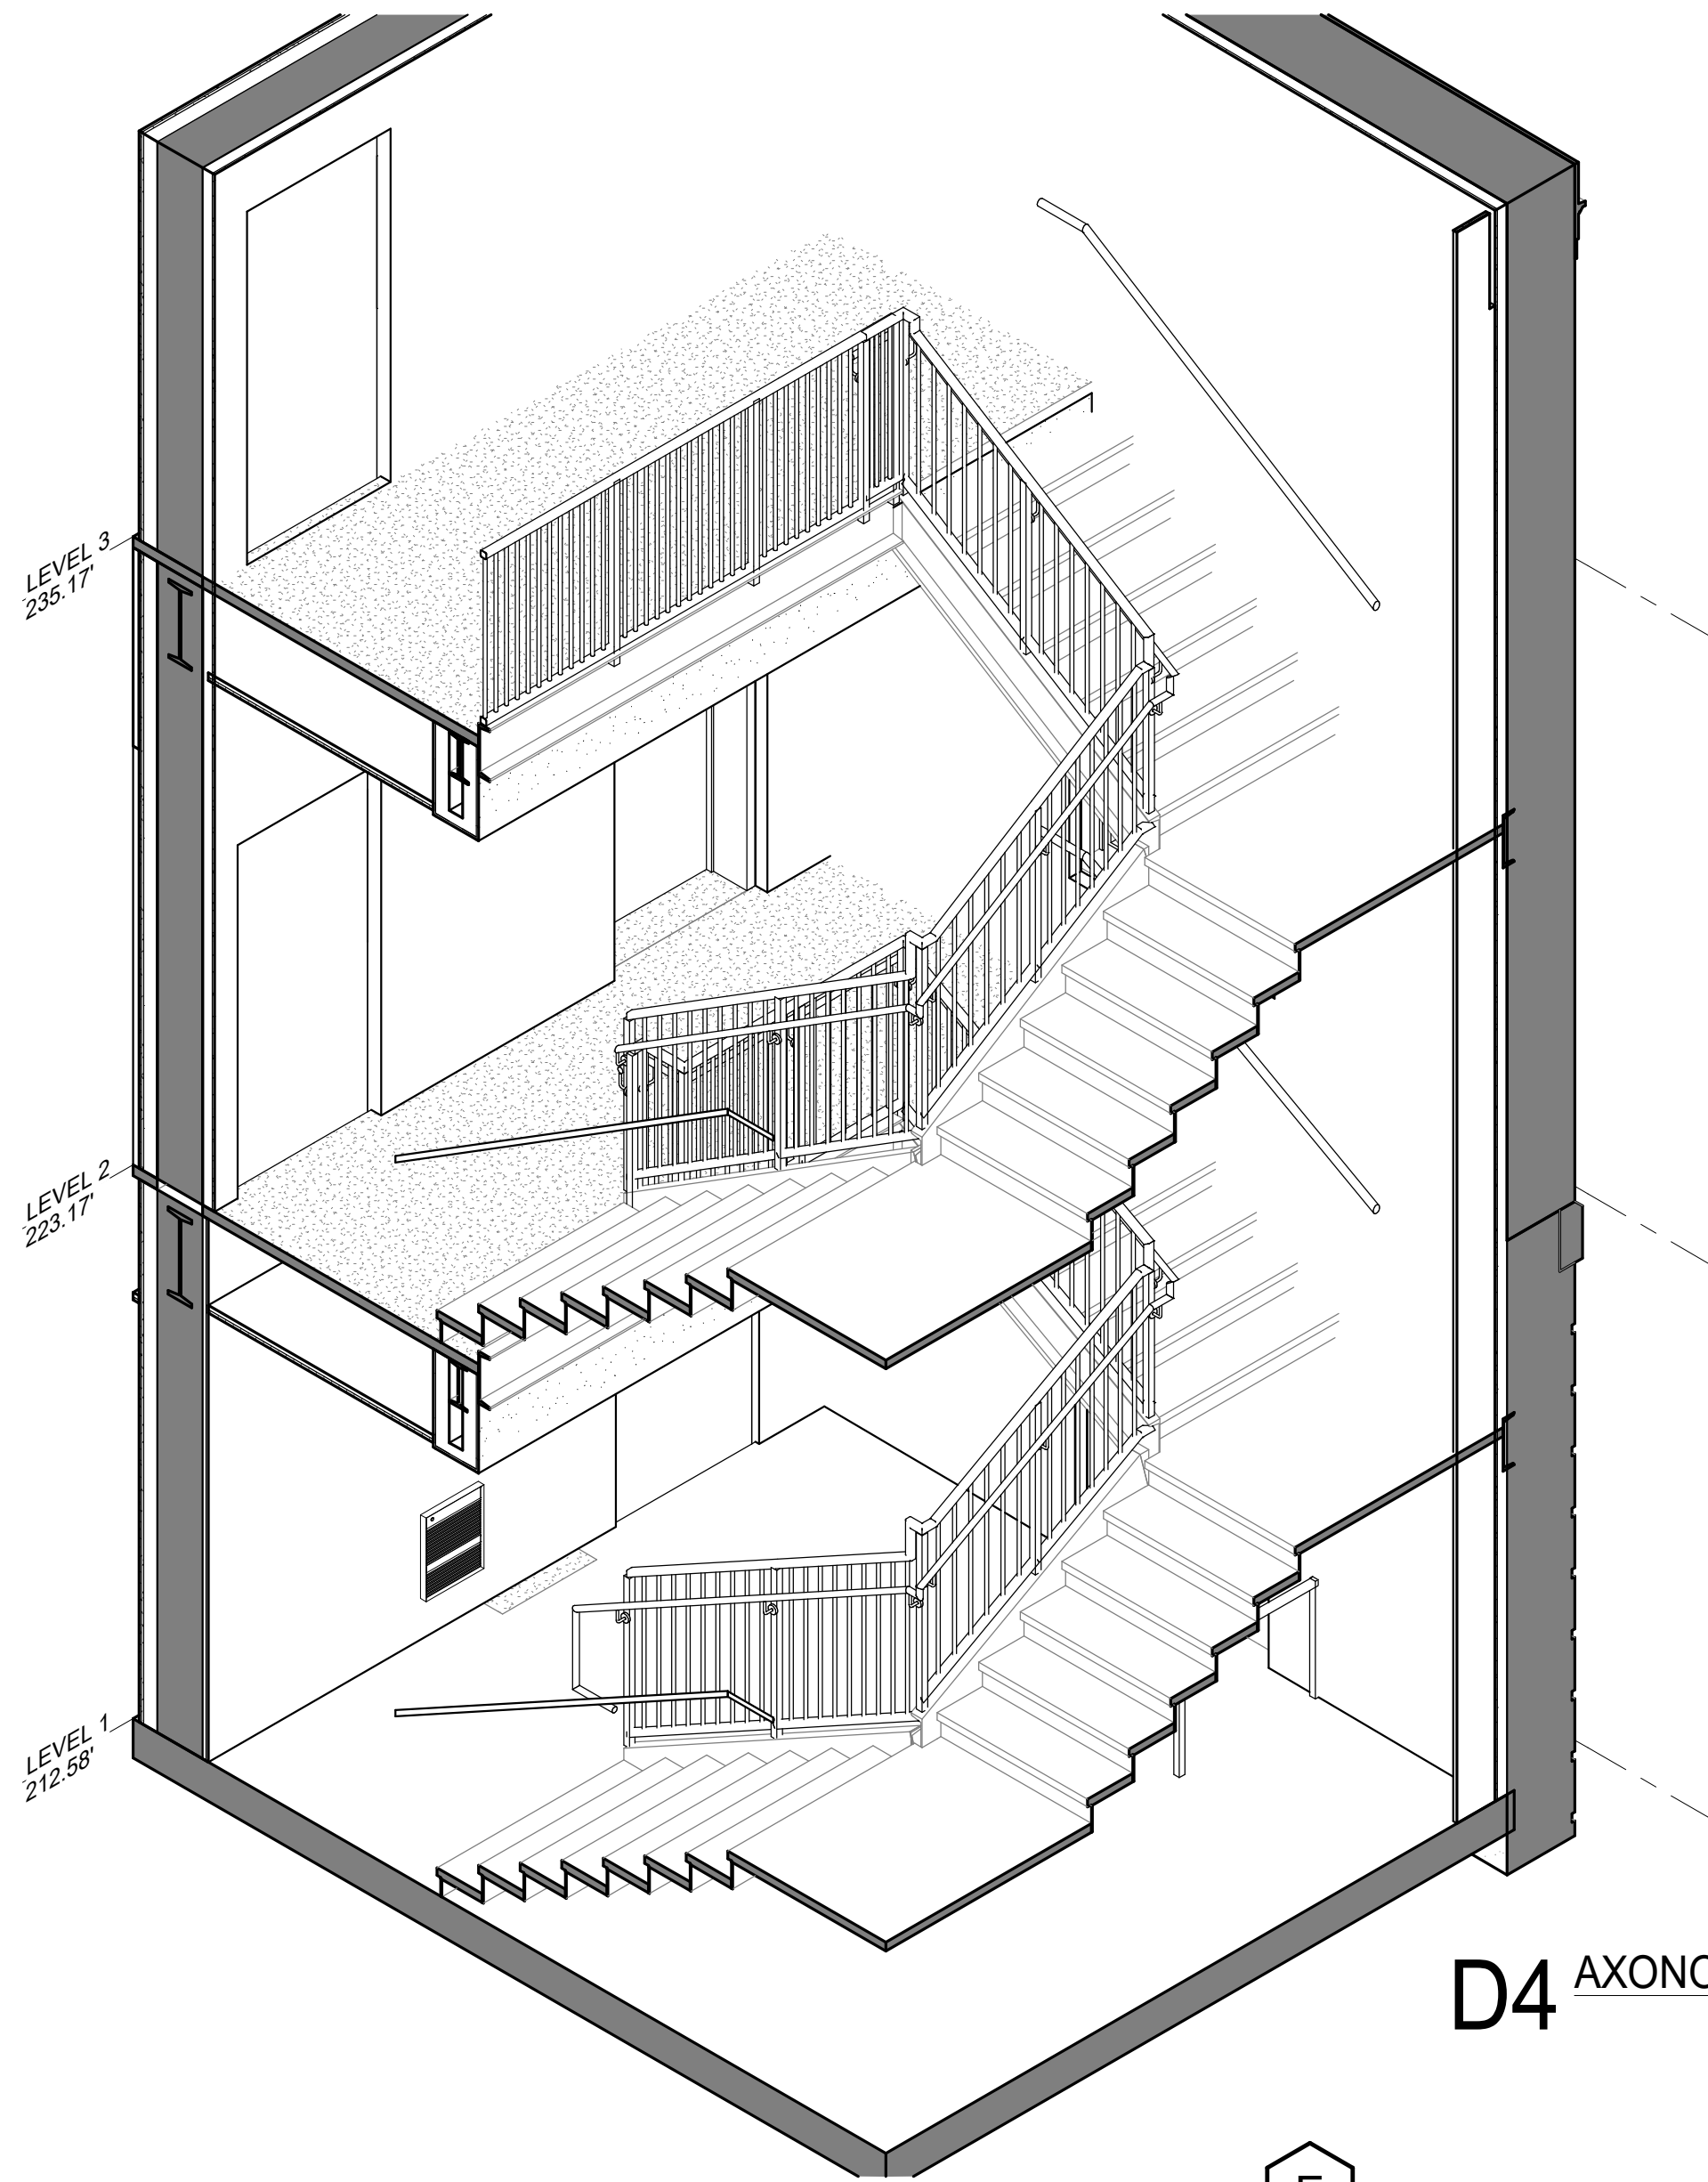


D4 AXONOMETRIC - STAIR 1

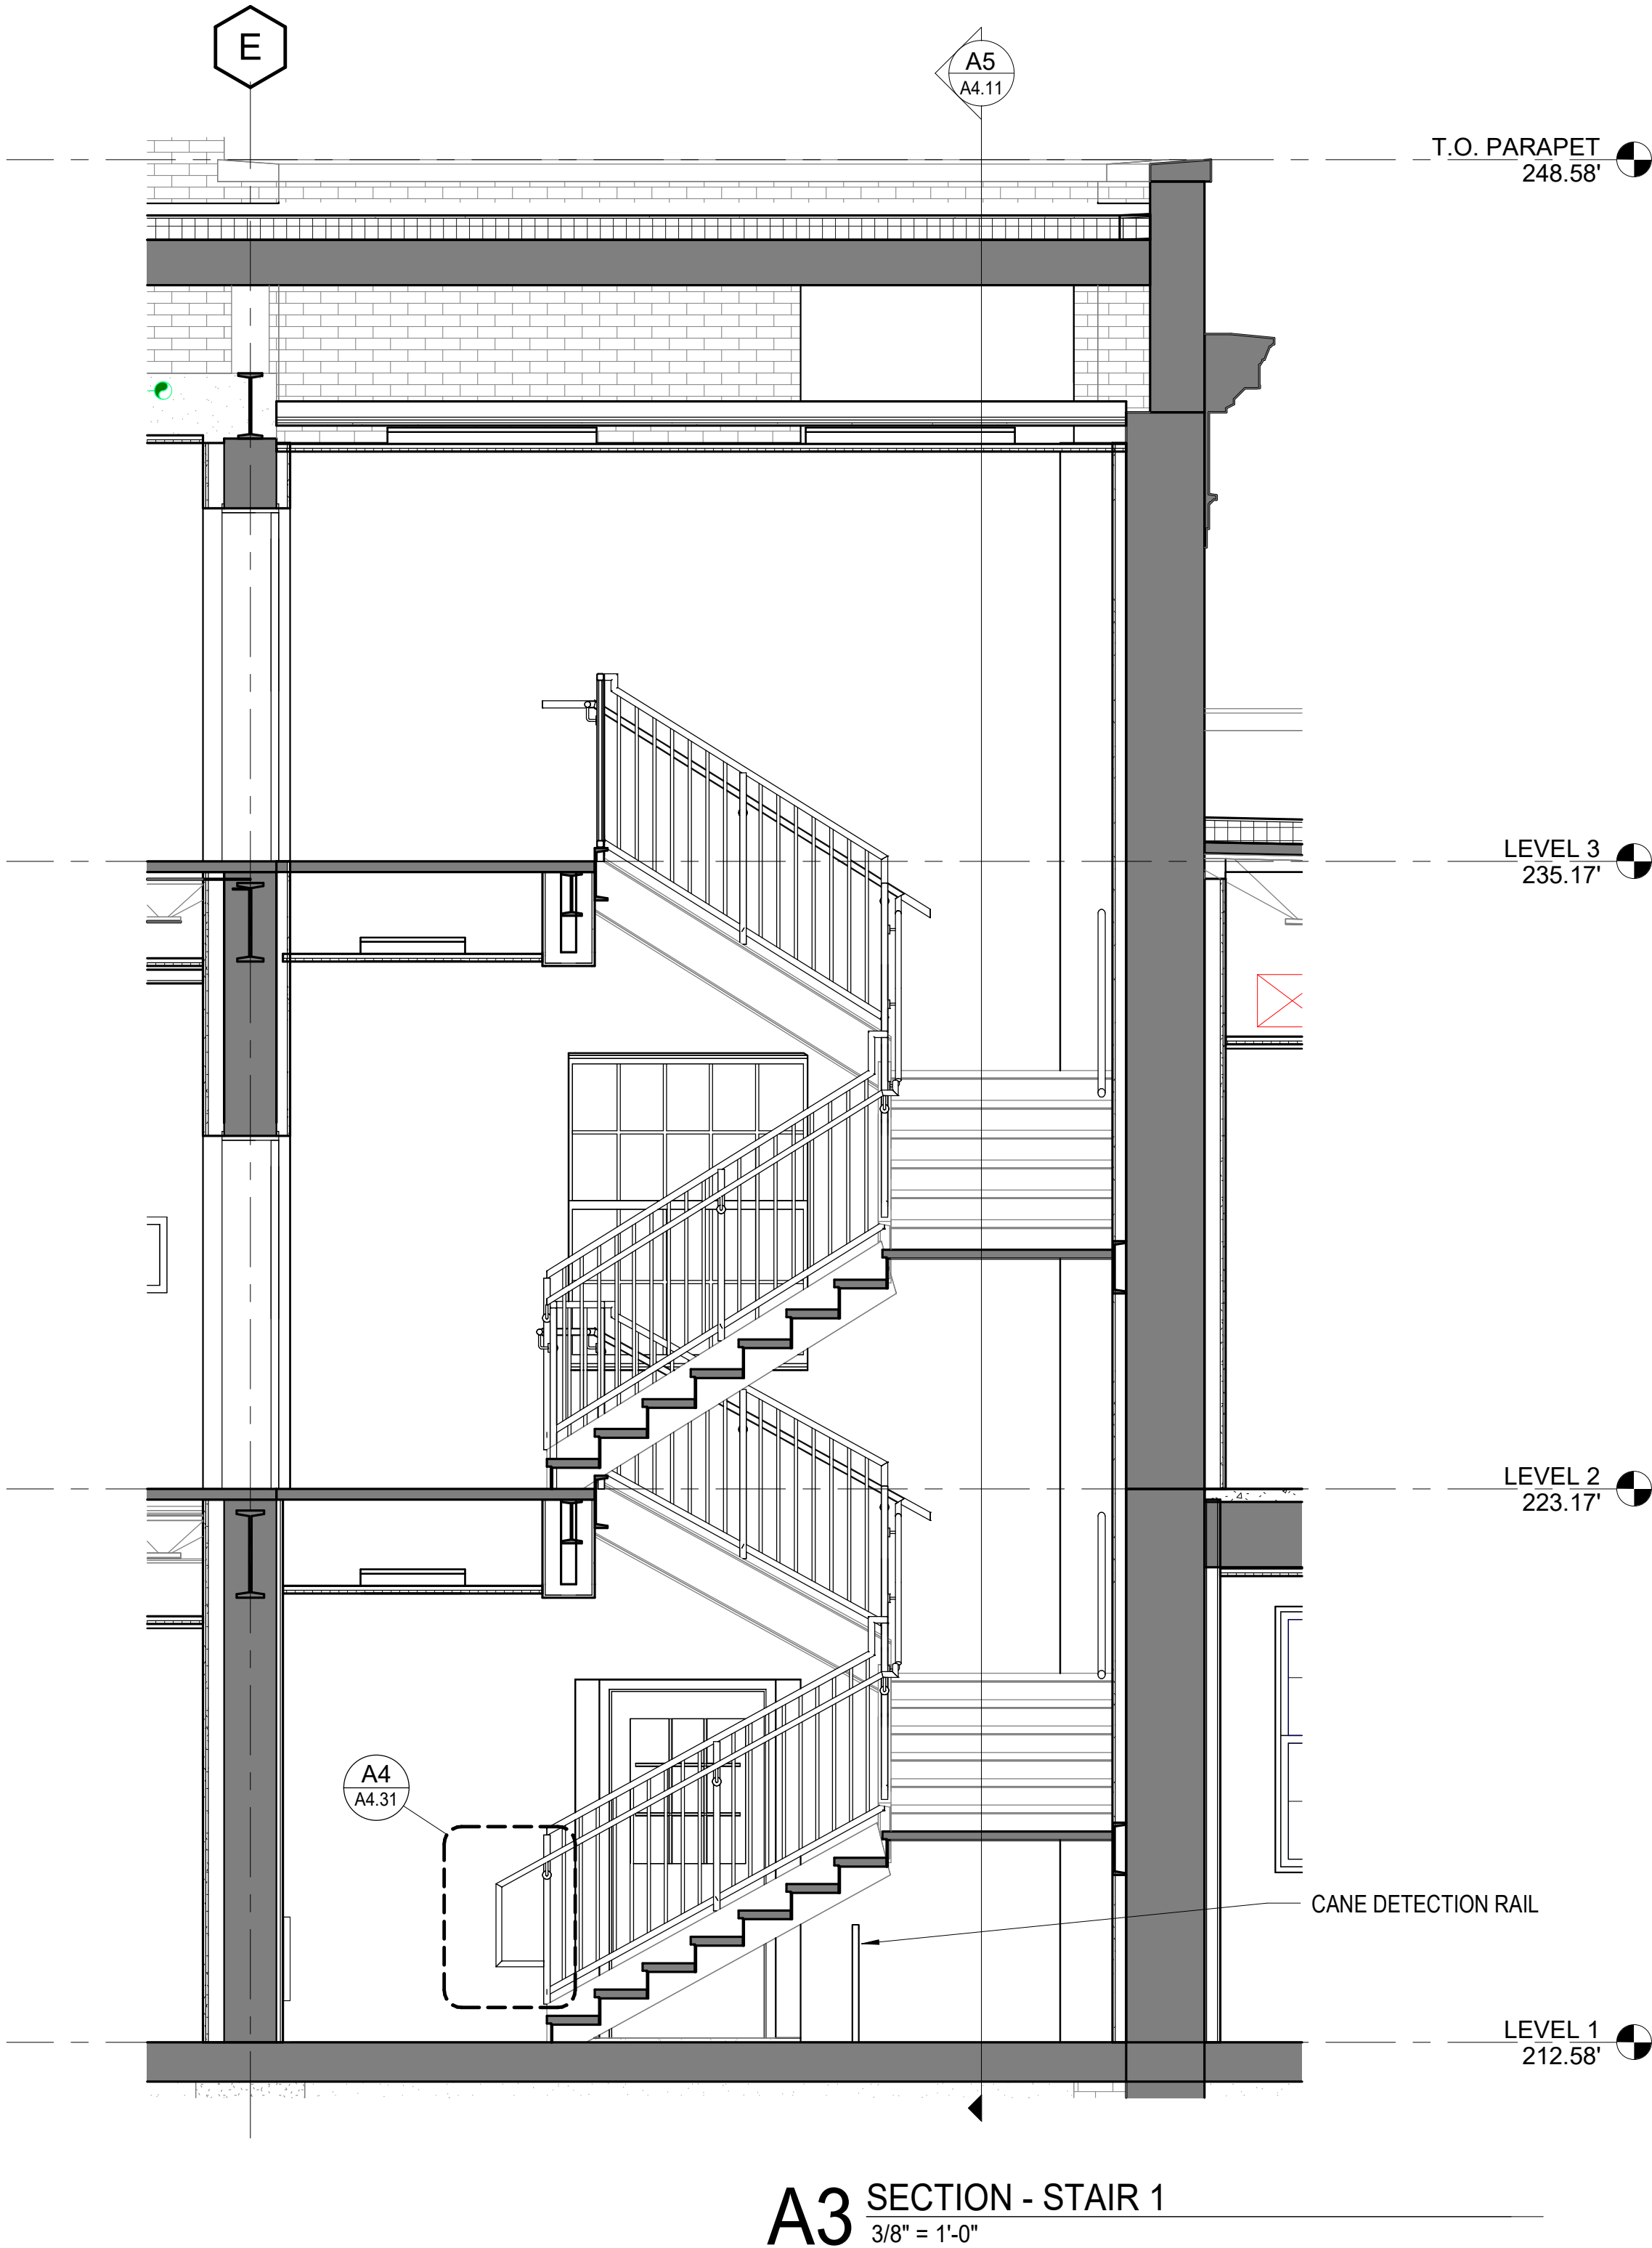


A3 SECTION - STAIR 1
3/8" = 1'-0"

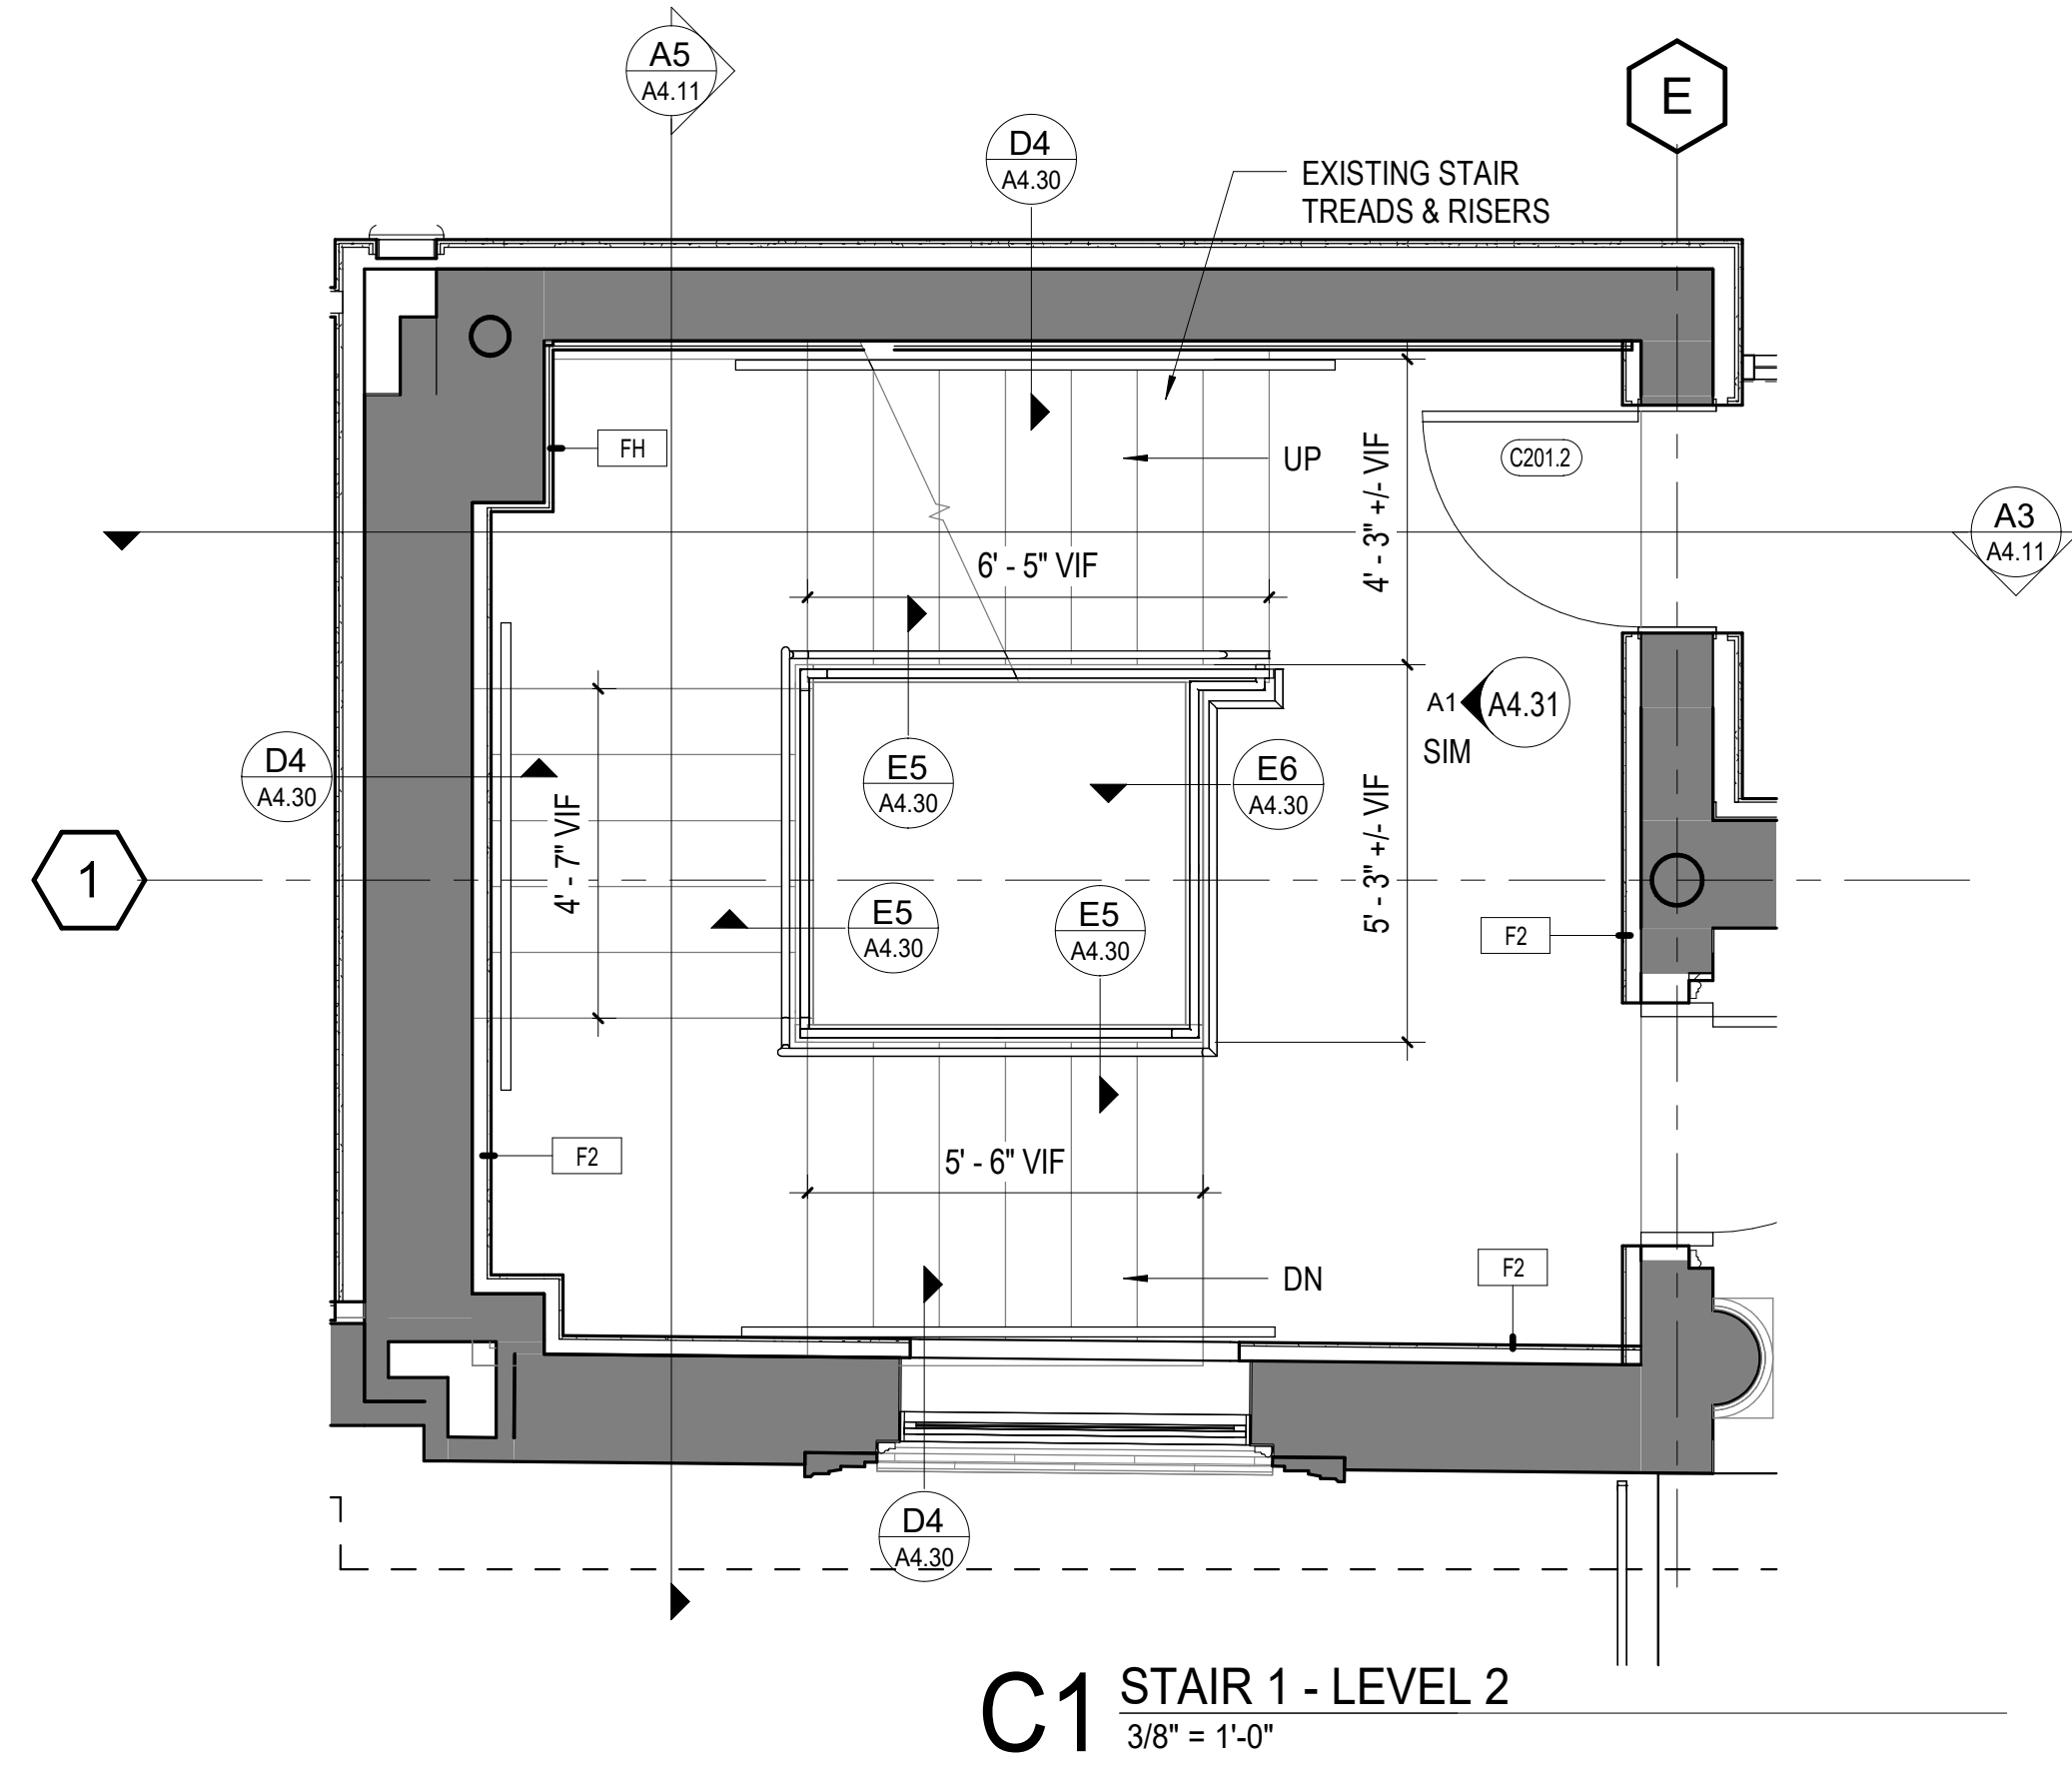


C1 STAIR 1 - LEVEL 2
3/8" = 1'-0"

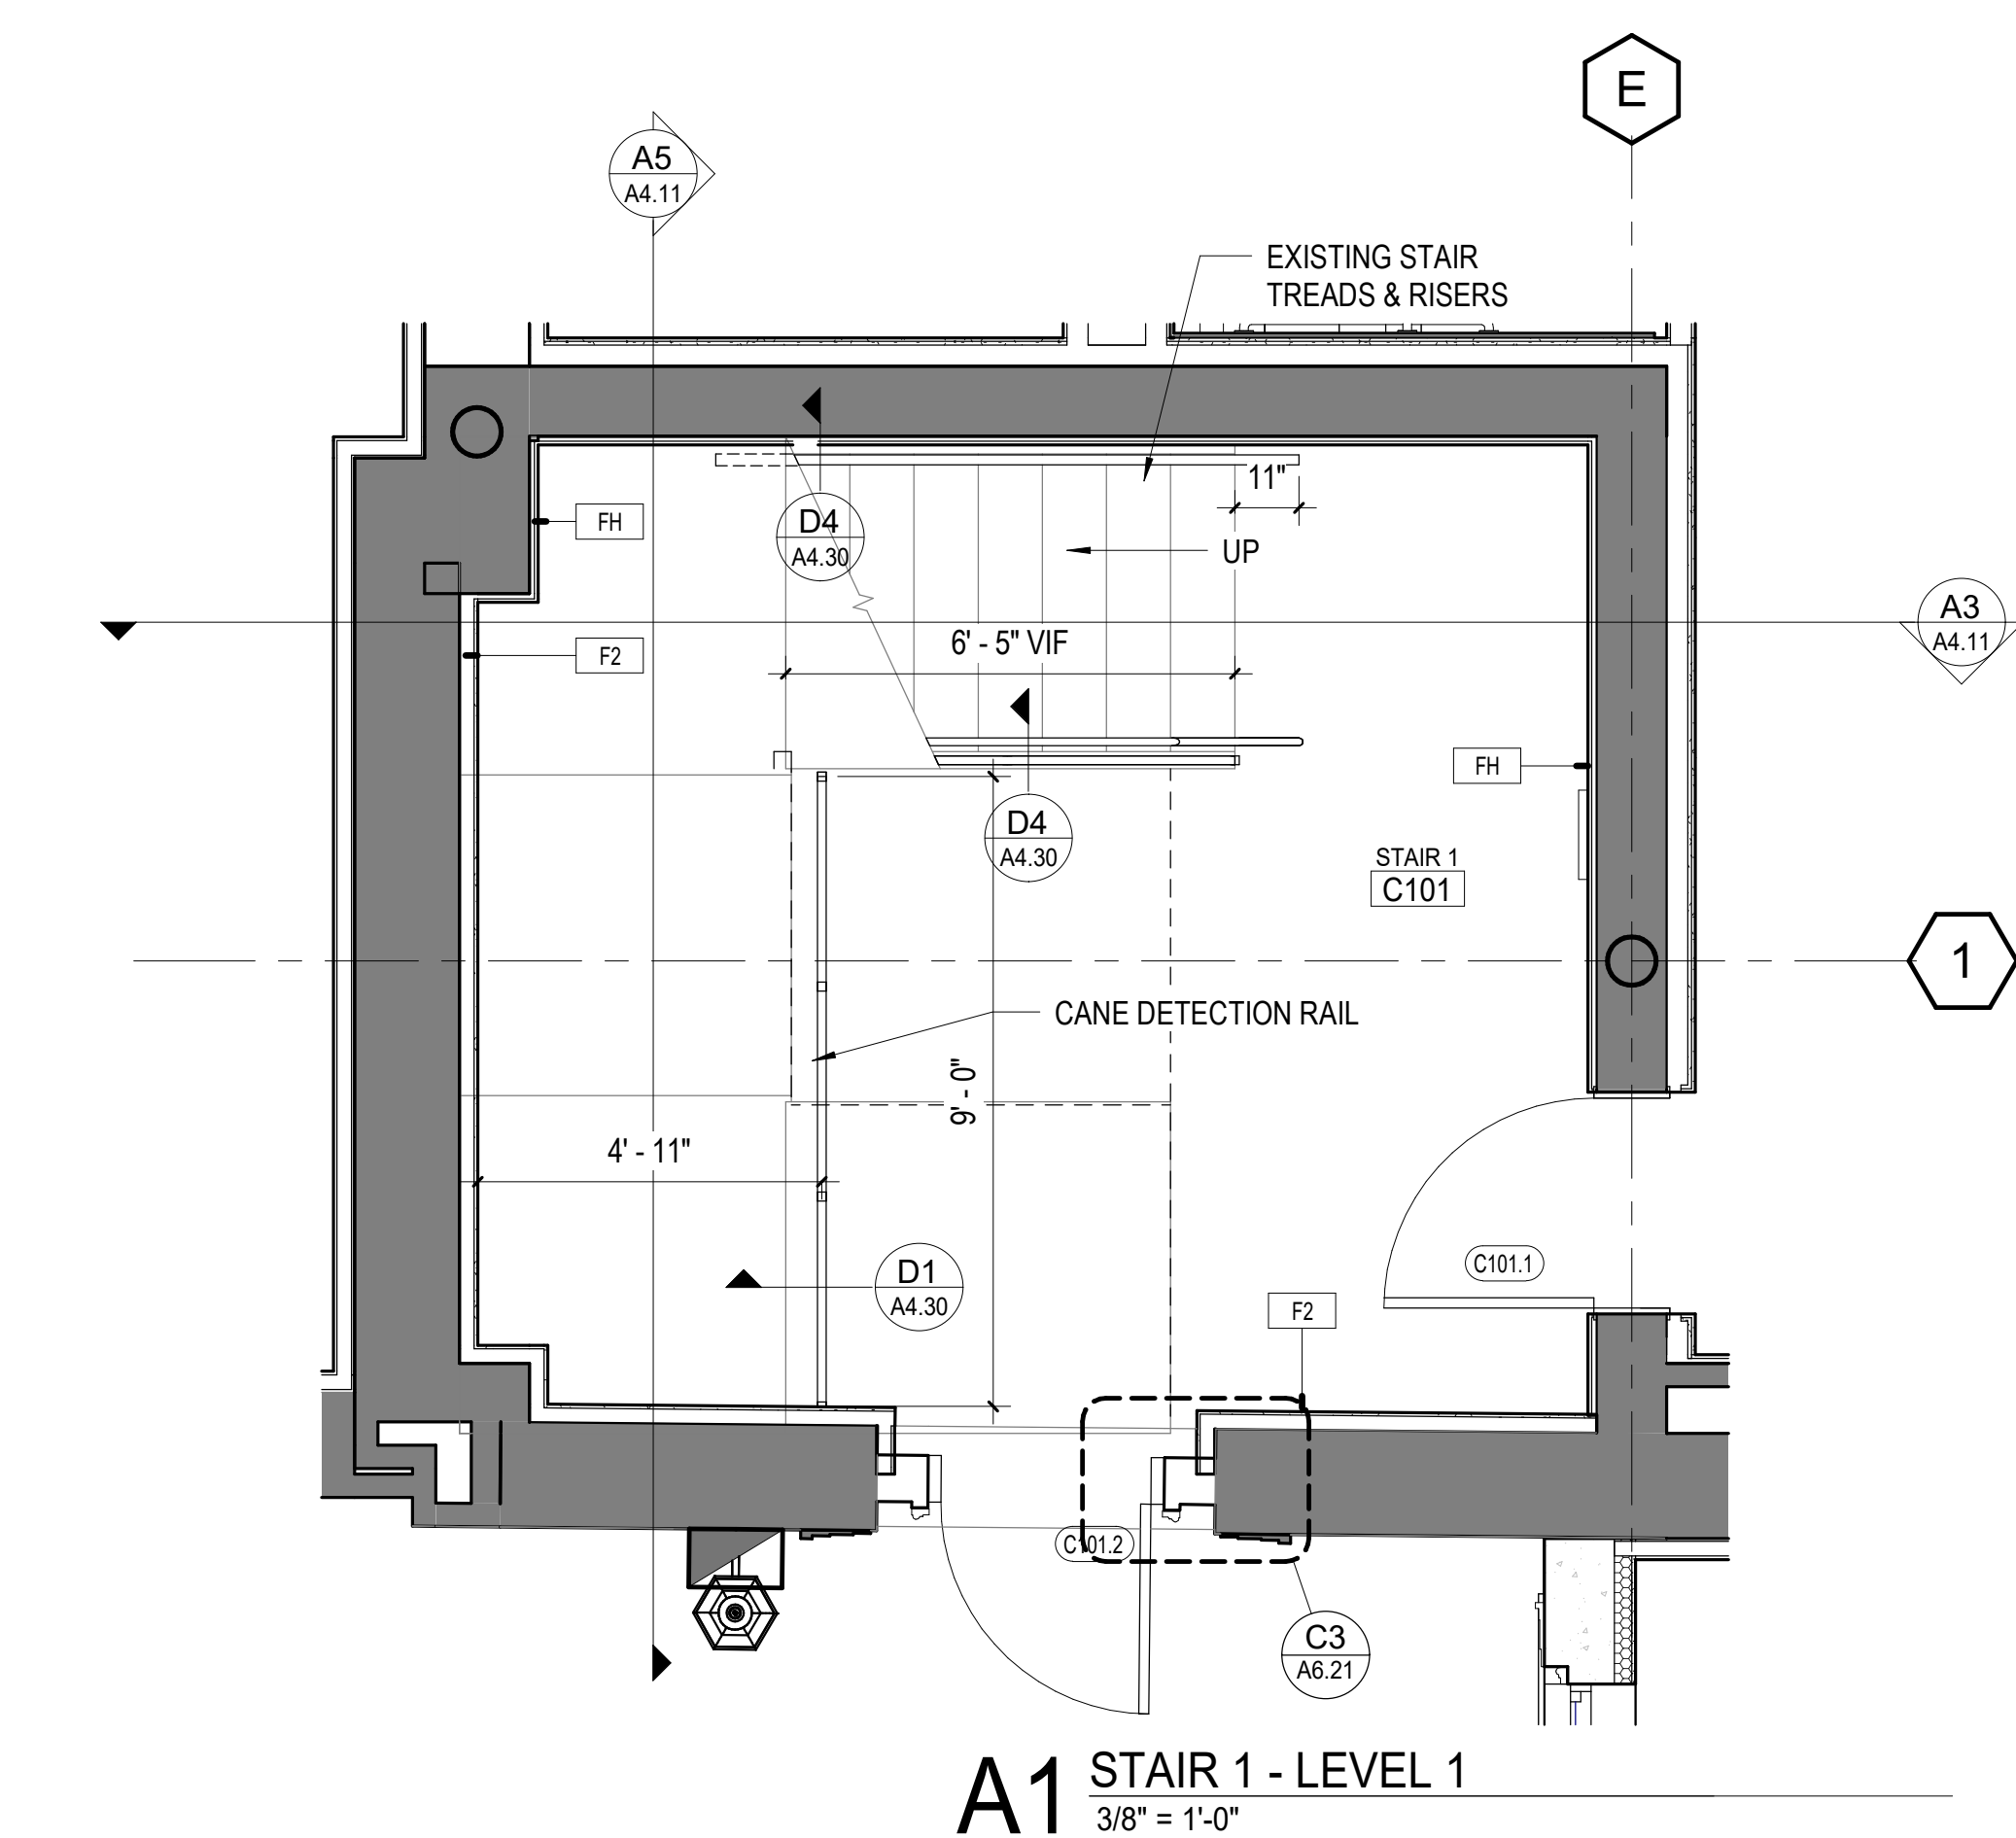


A1 STAIR 1 - LEVEL 1
3/8" = 1'-0"

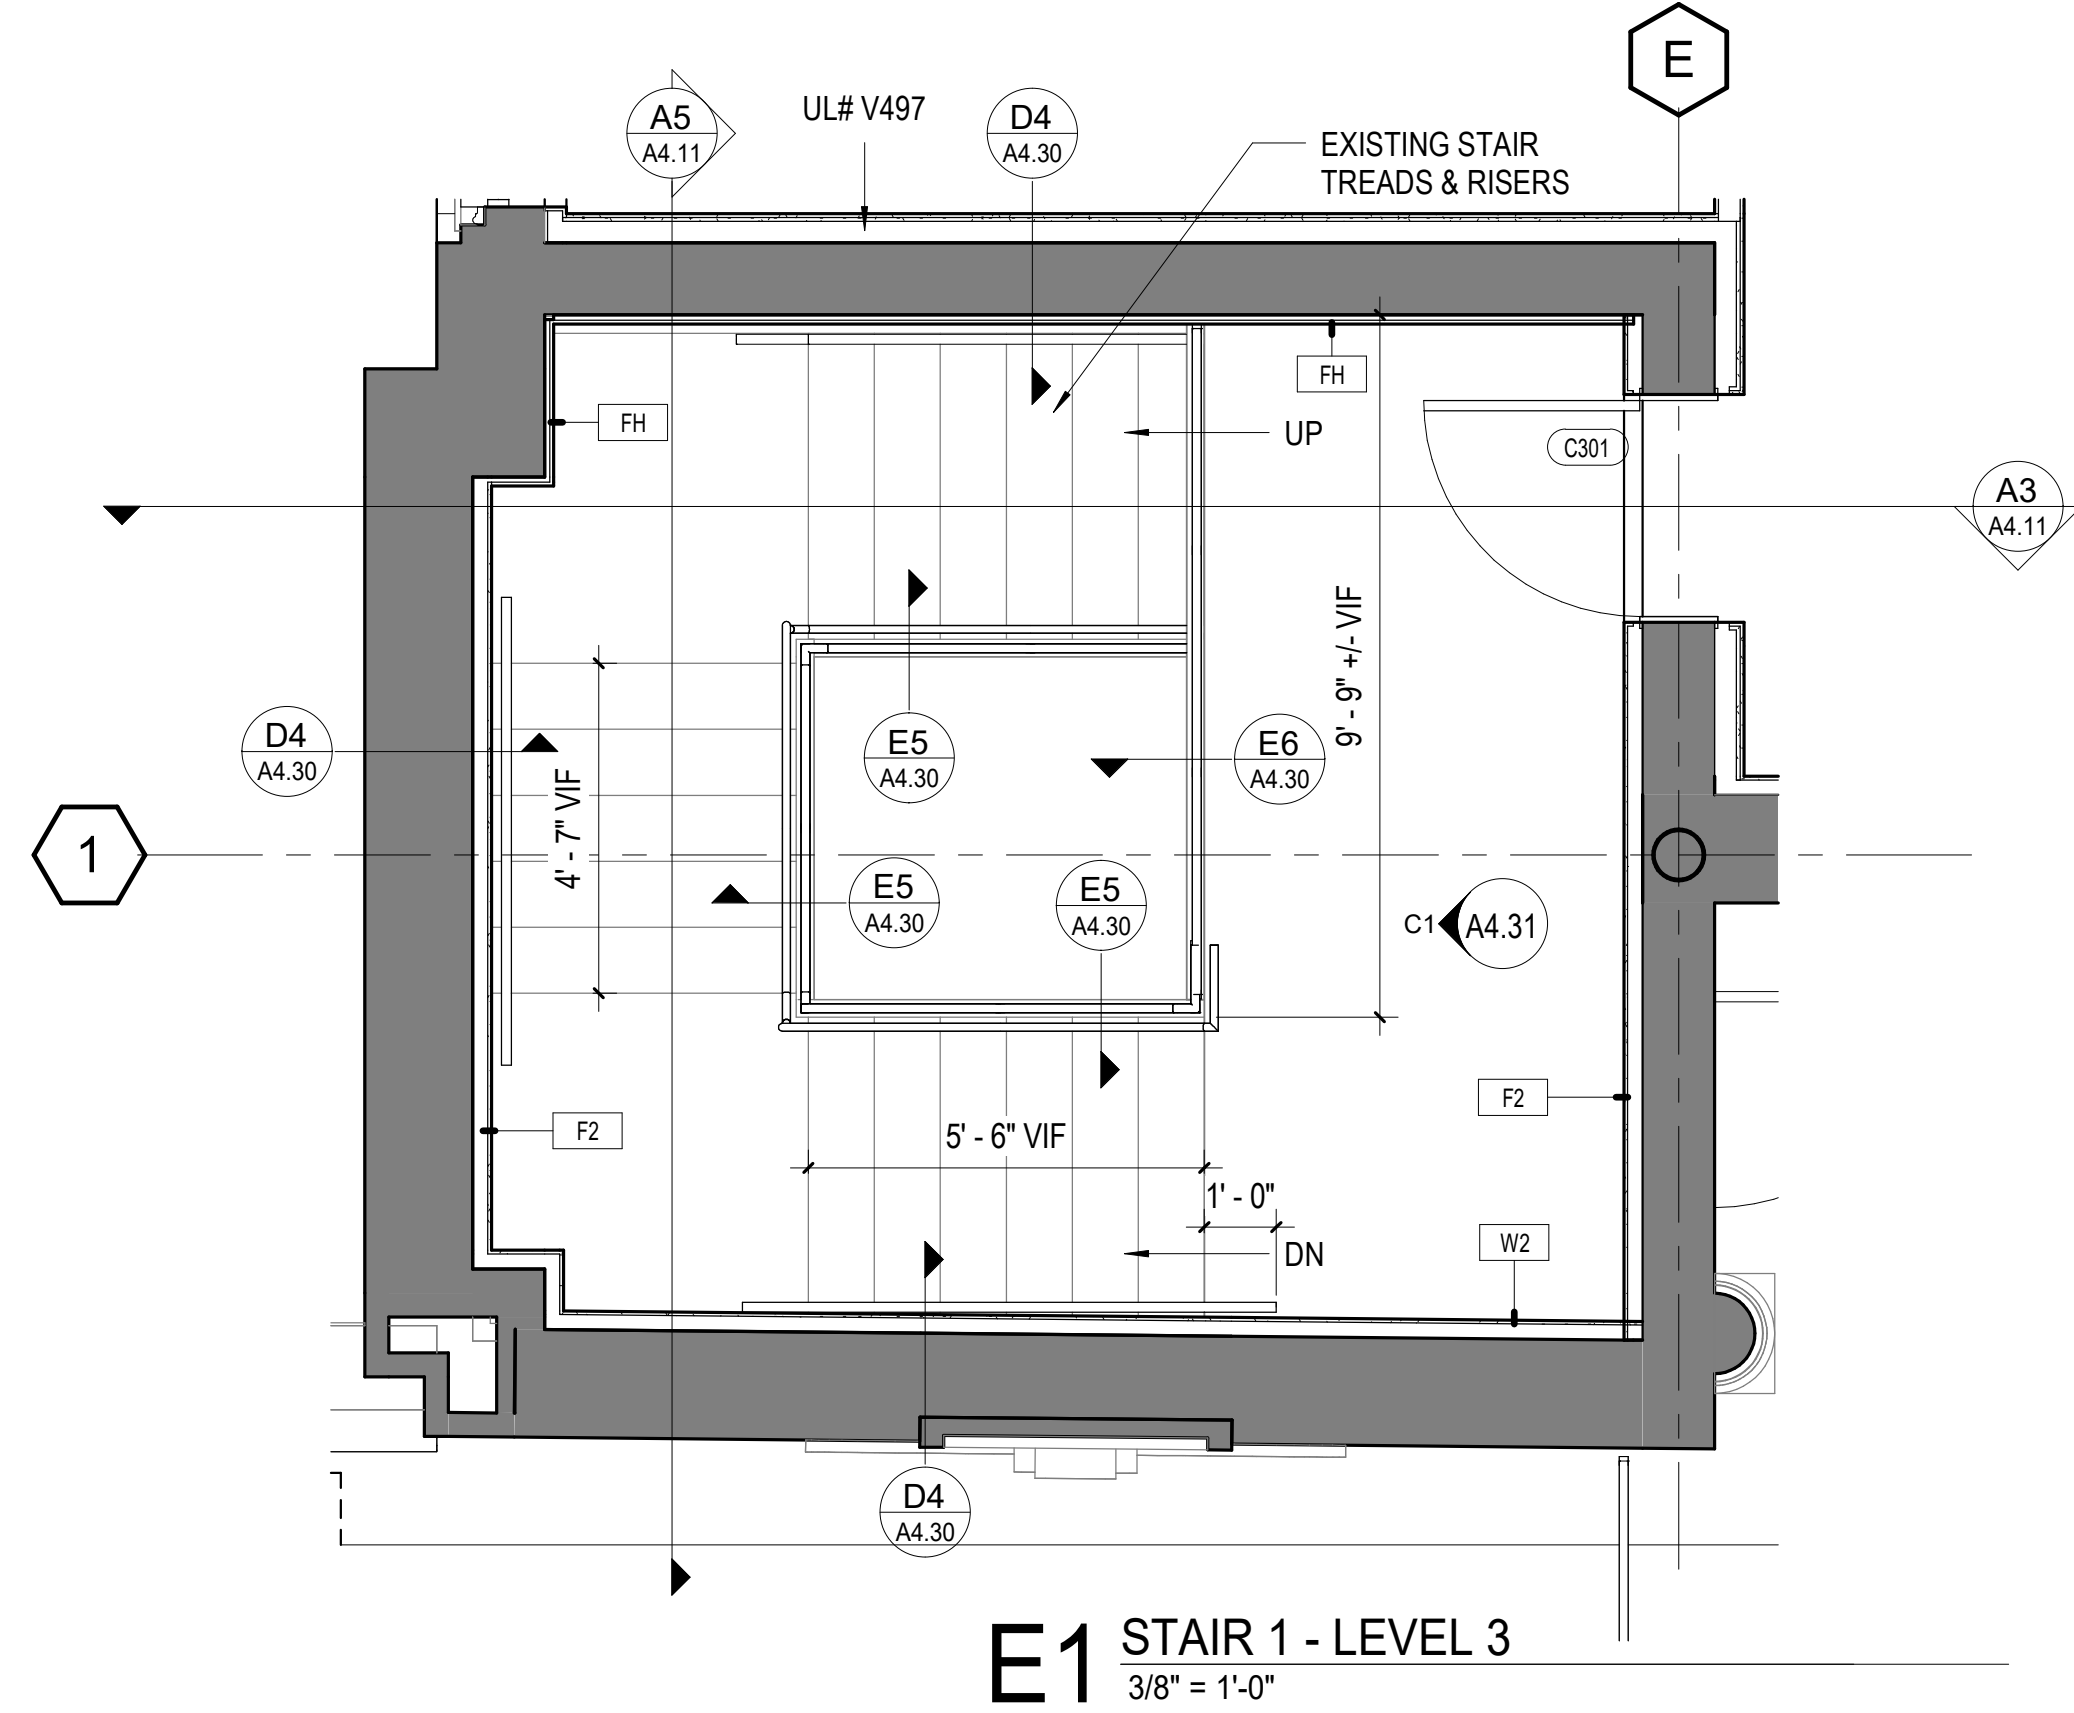


E1 STAIR 1 - LEVEL 3
3/8" = 1'-0"

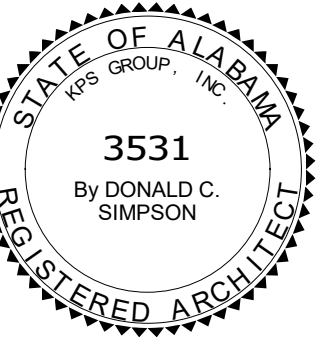


PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
ENLARGED STAIR PLANS AND SECTIONS		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		A4.11

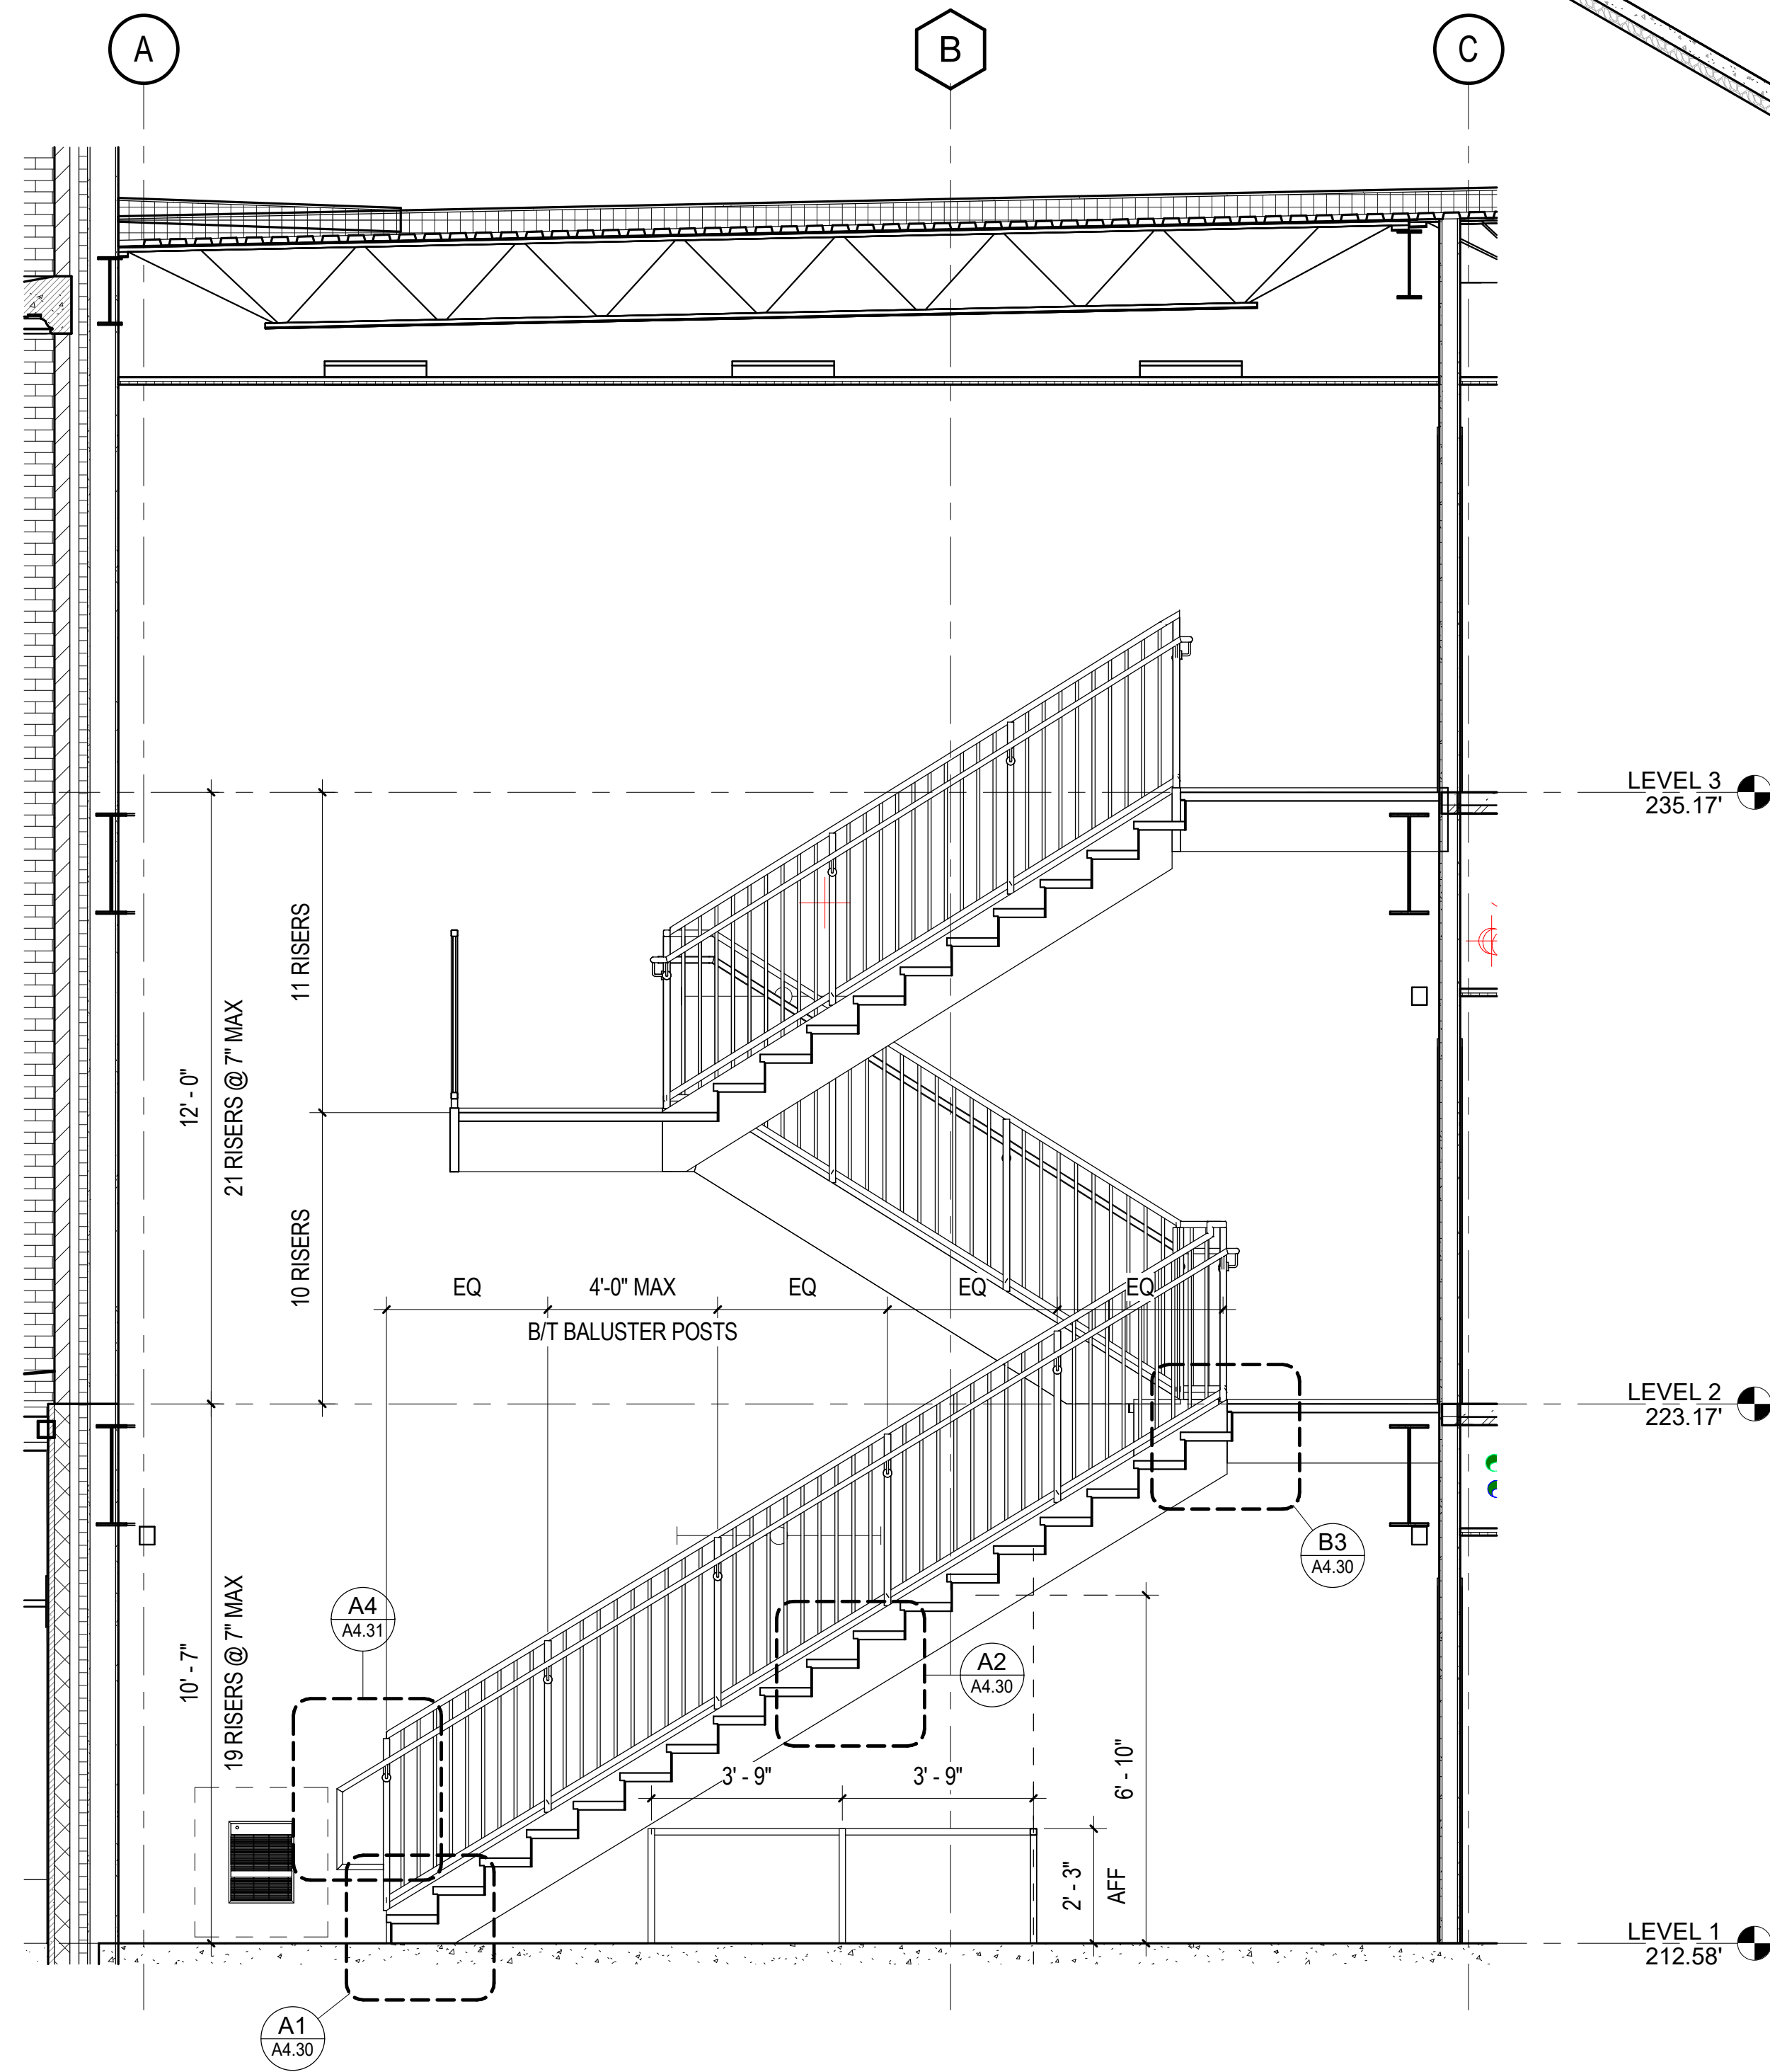


A5 SECTION - STAIR 2
3/8" = 1'-0"

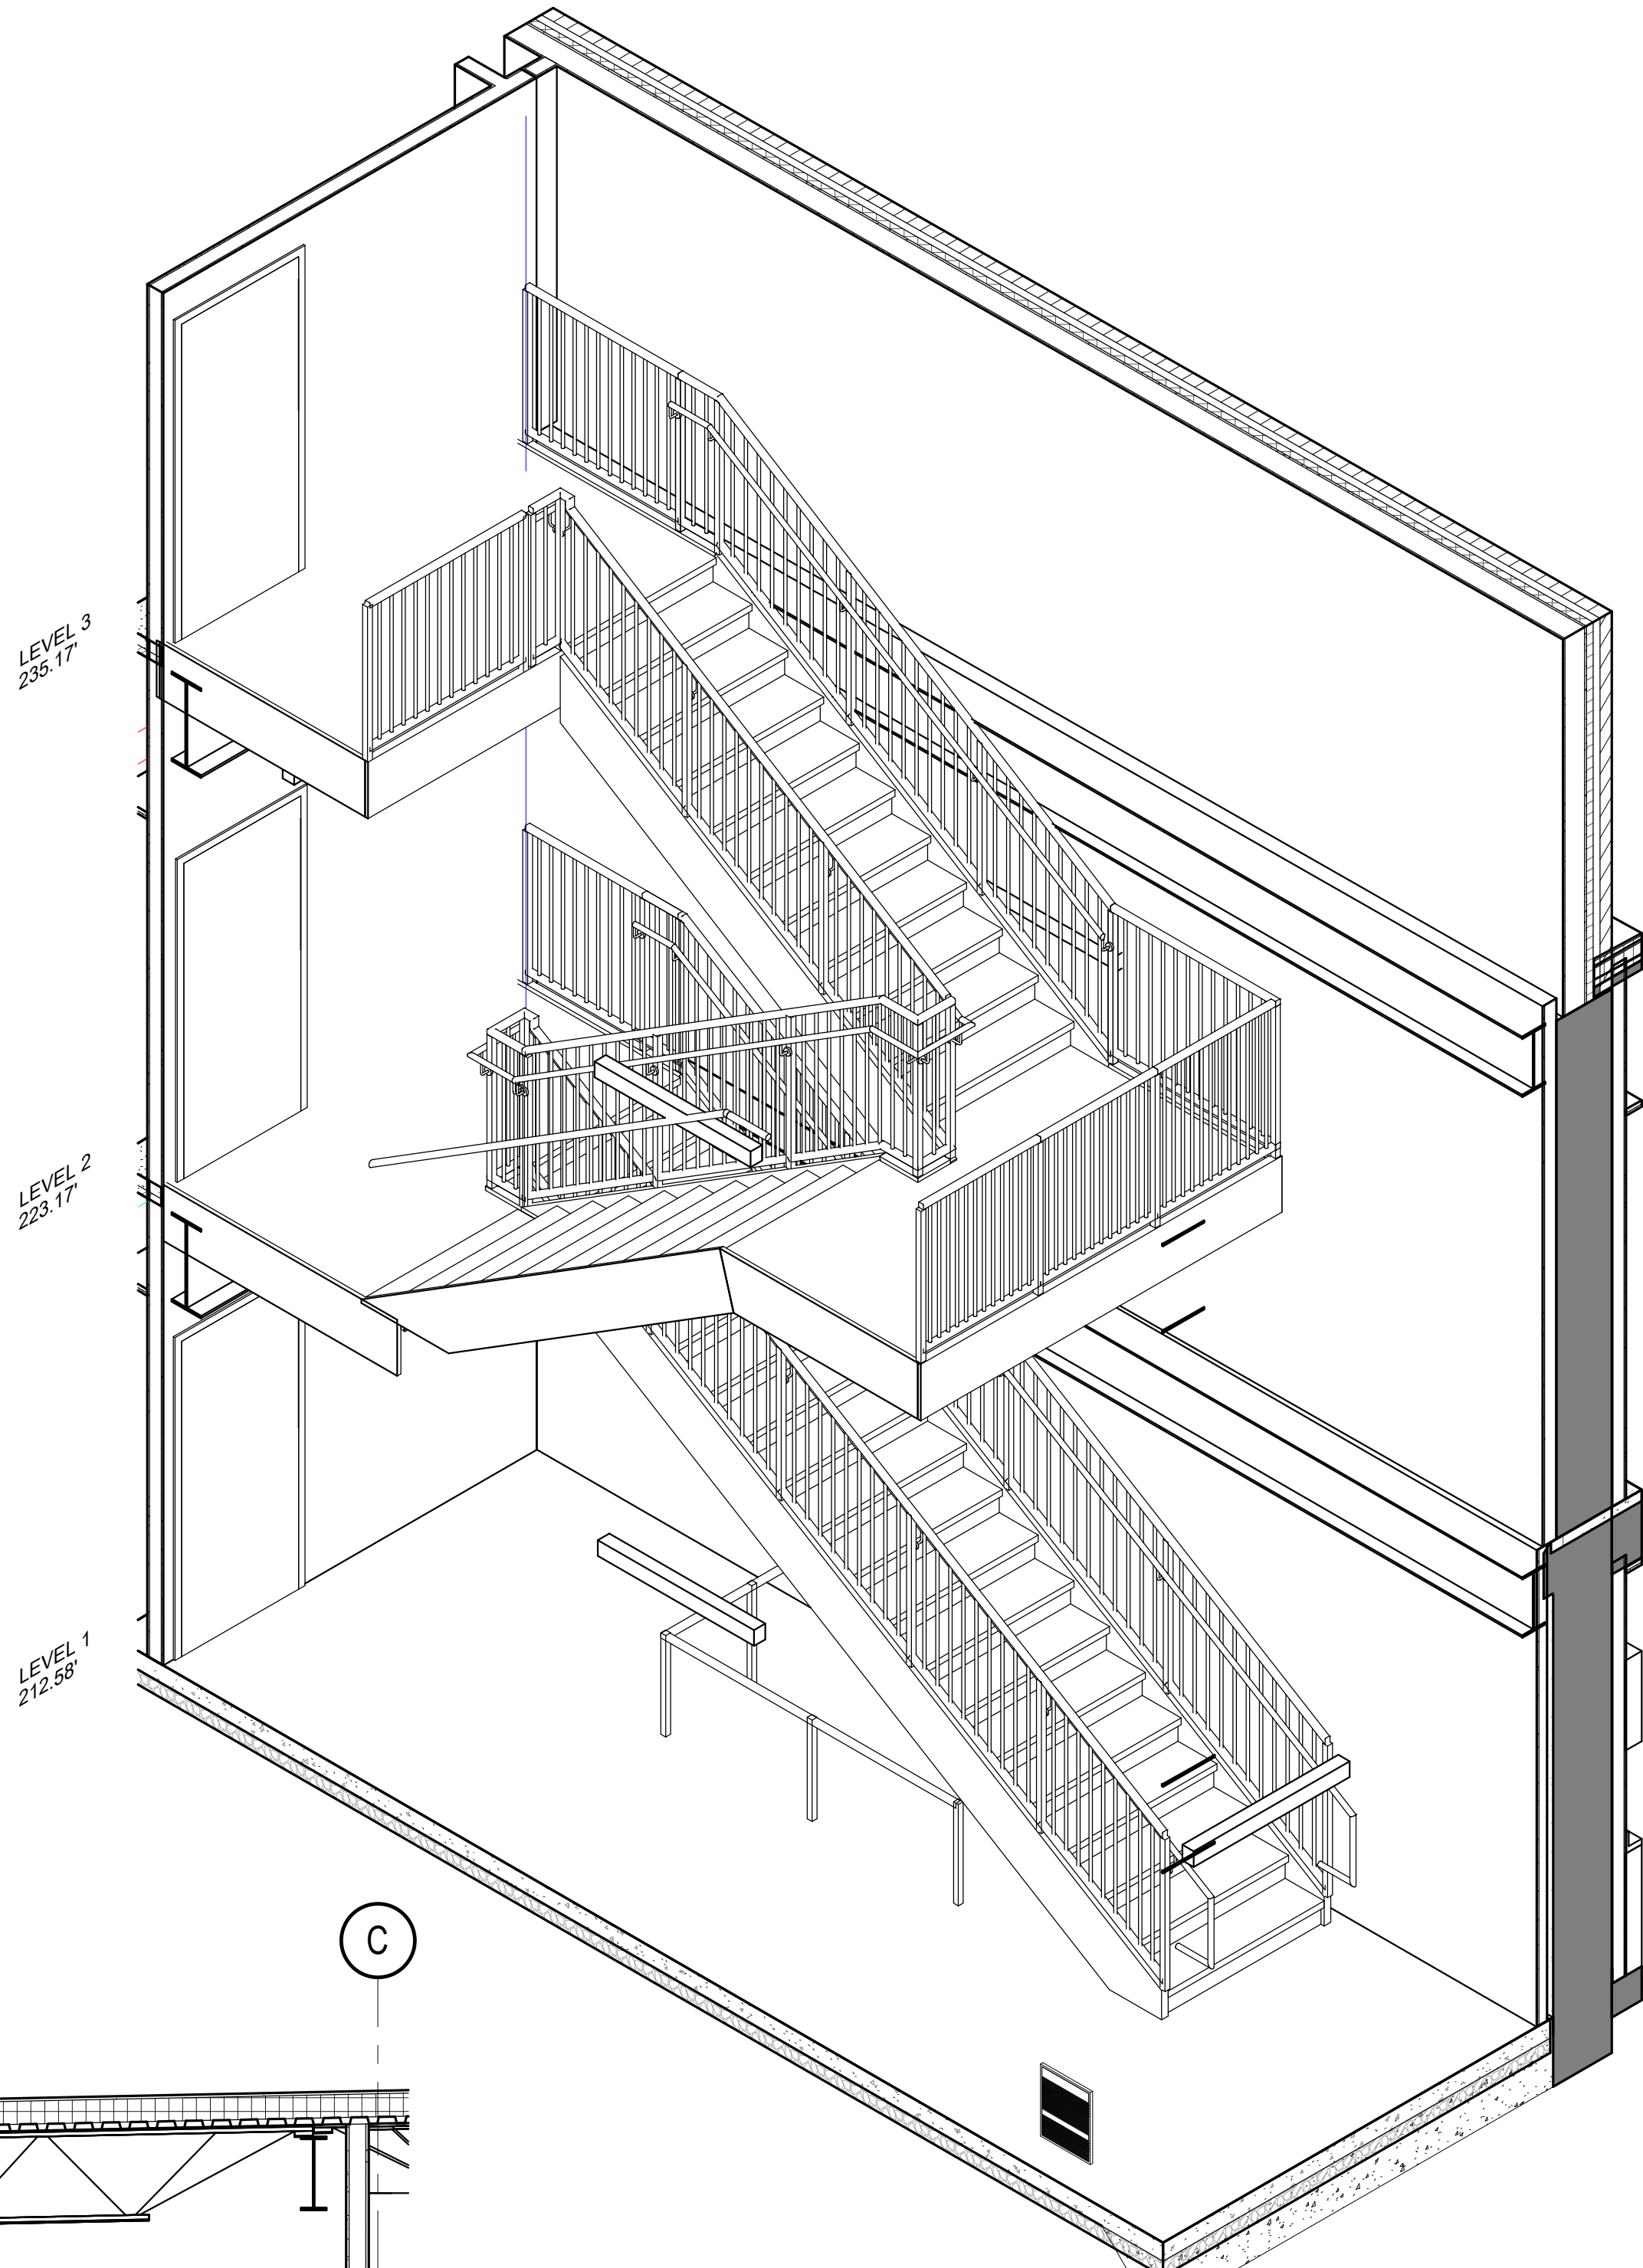


D3 AXONOMETRIC - STAIR 2

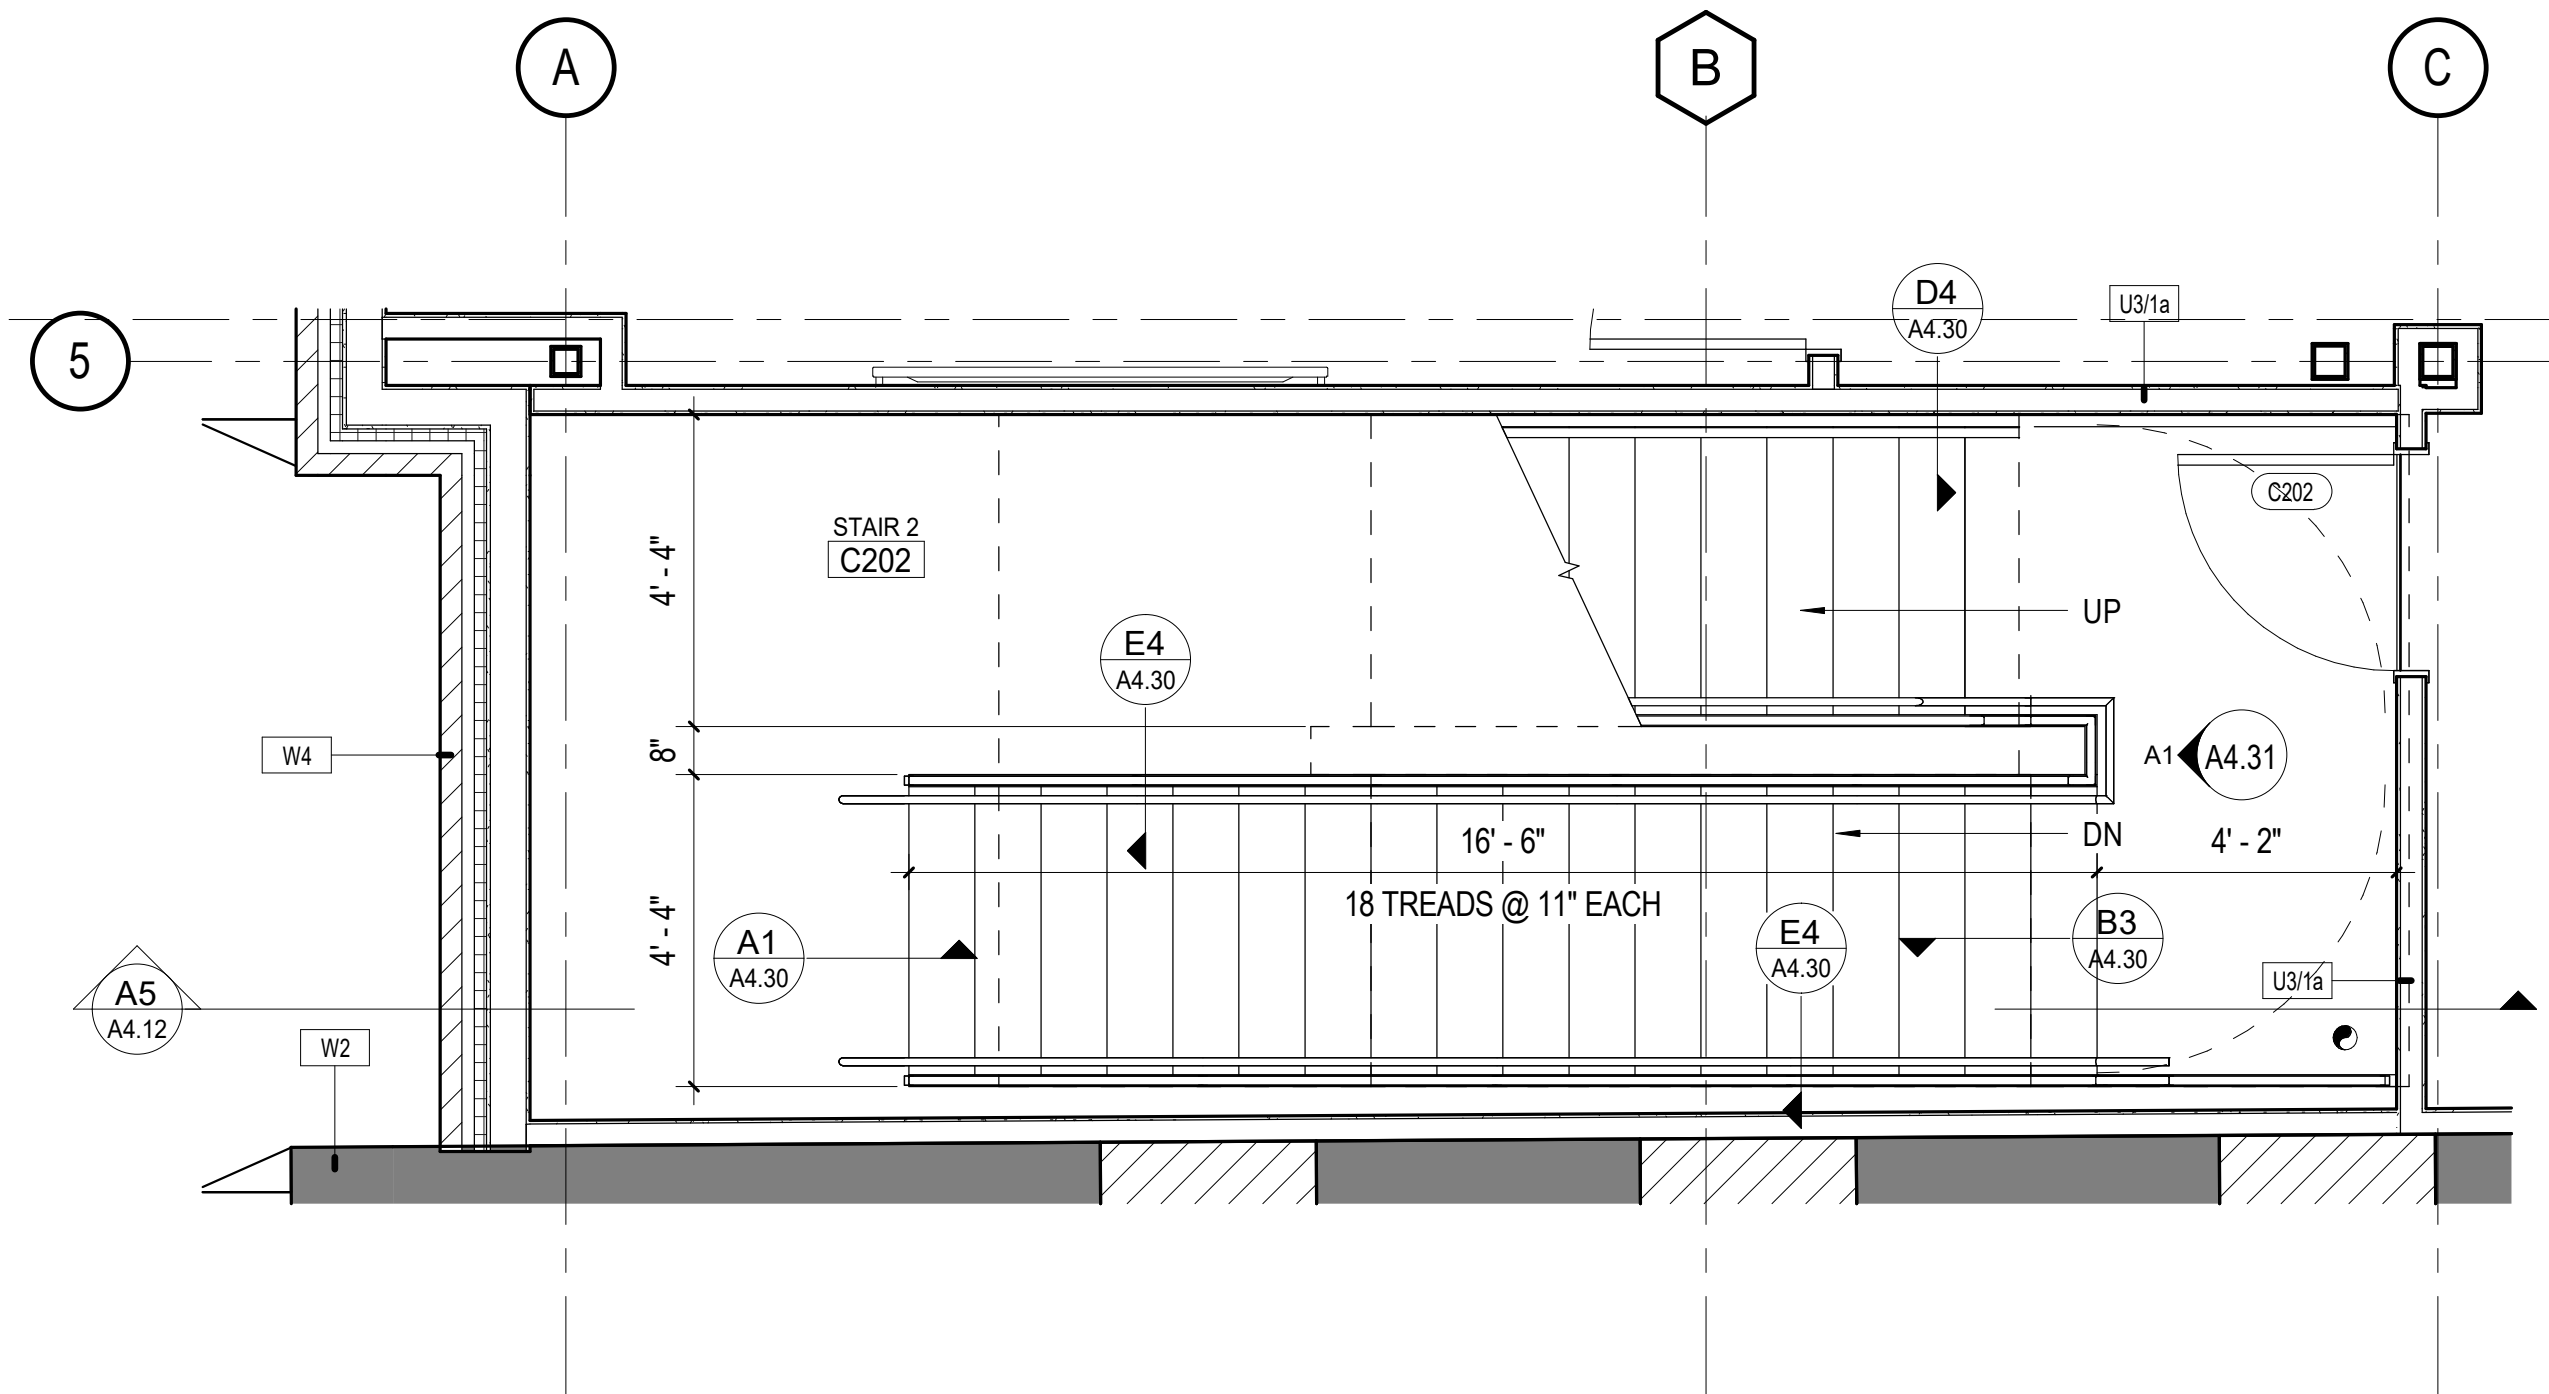

C1 STAIR 2 - LEVEL 2
3/8" = 1'-0"

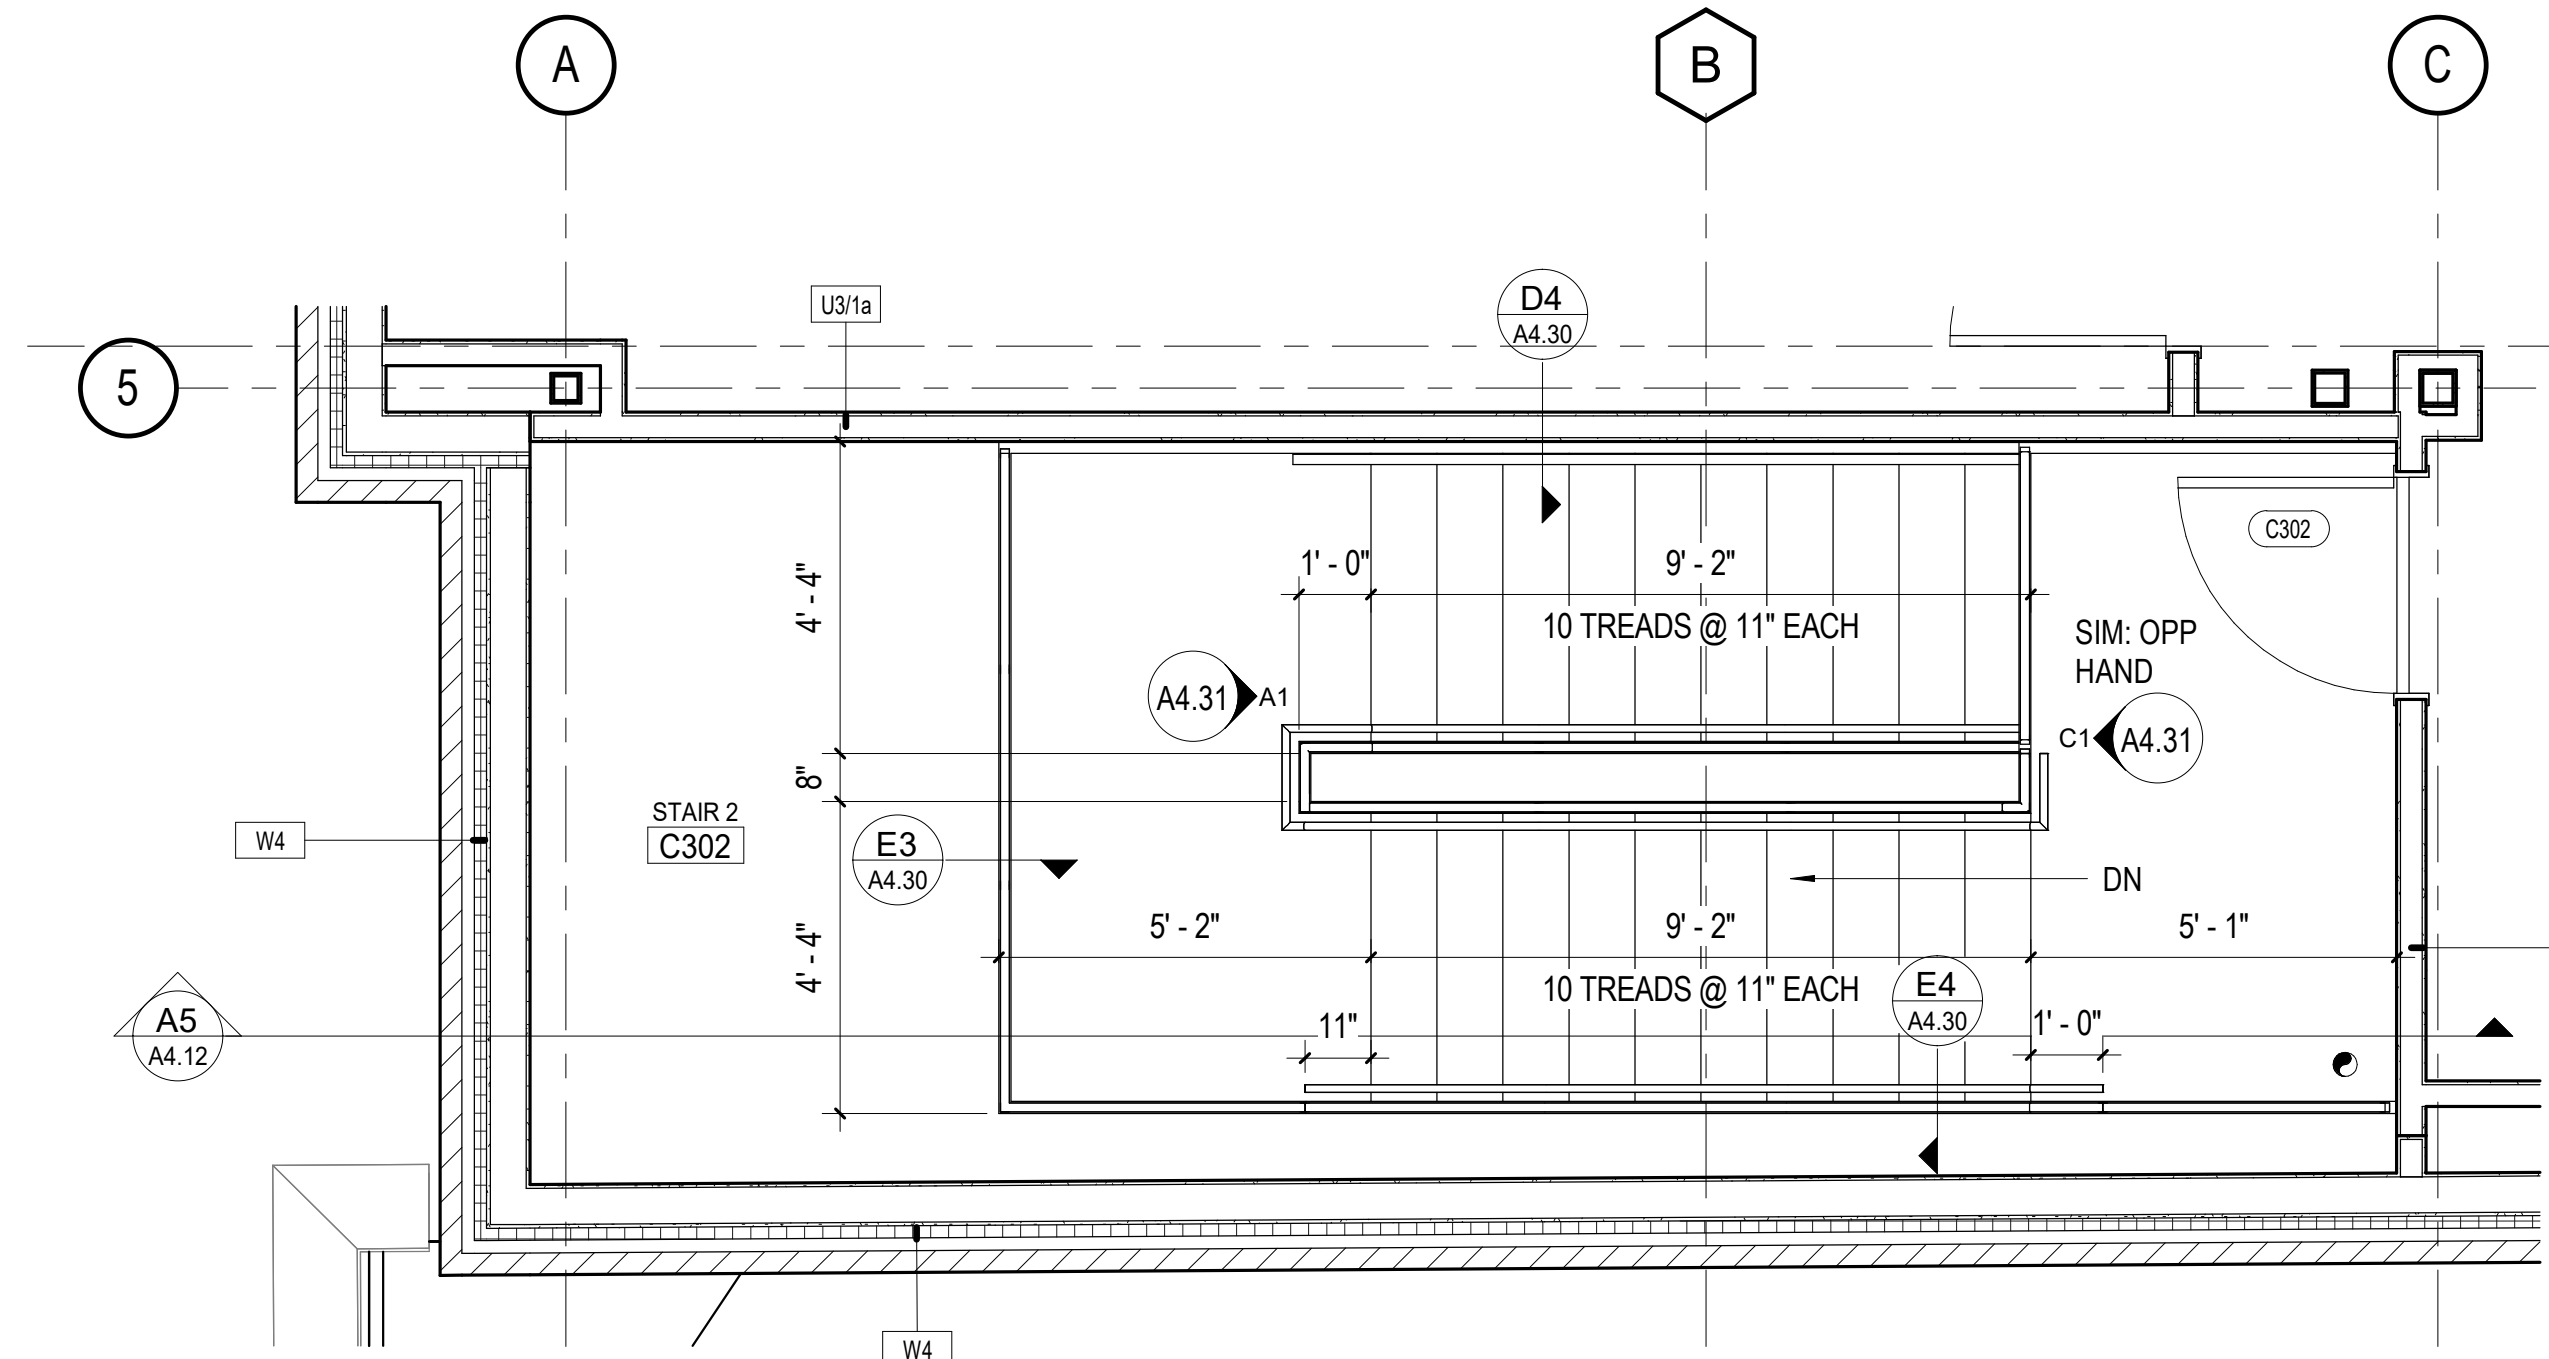

E1 STAIR 2 - LEVEL 3
3/8" = 1'-0"

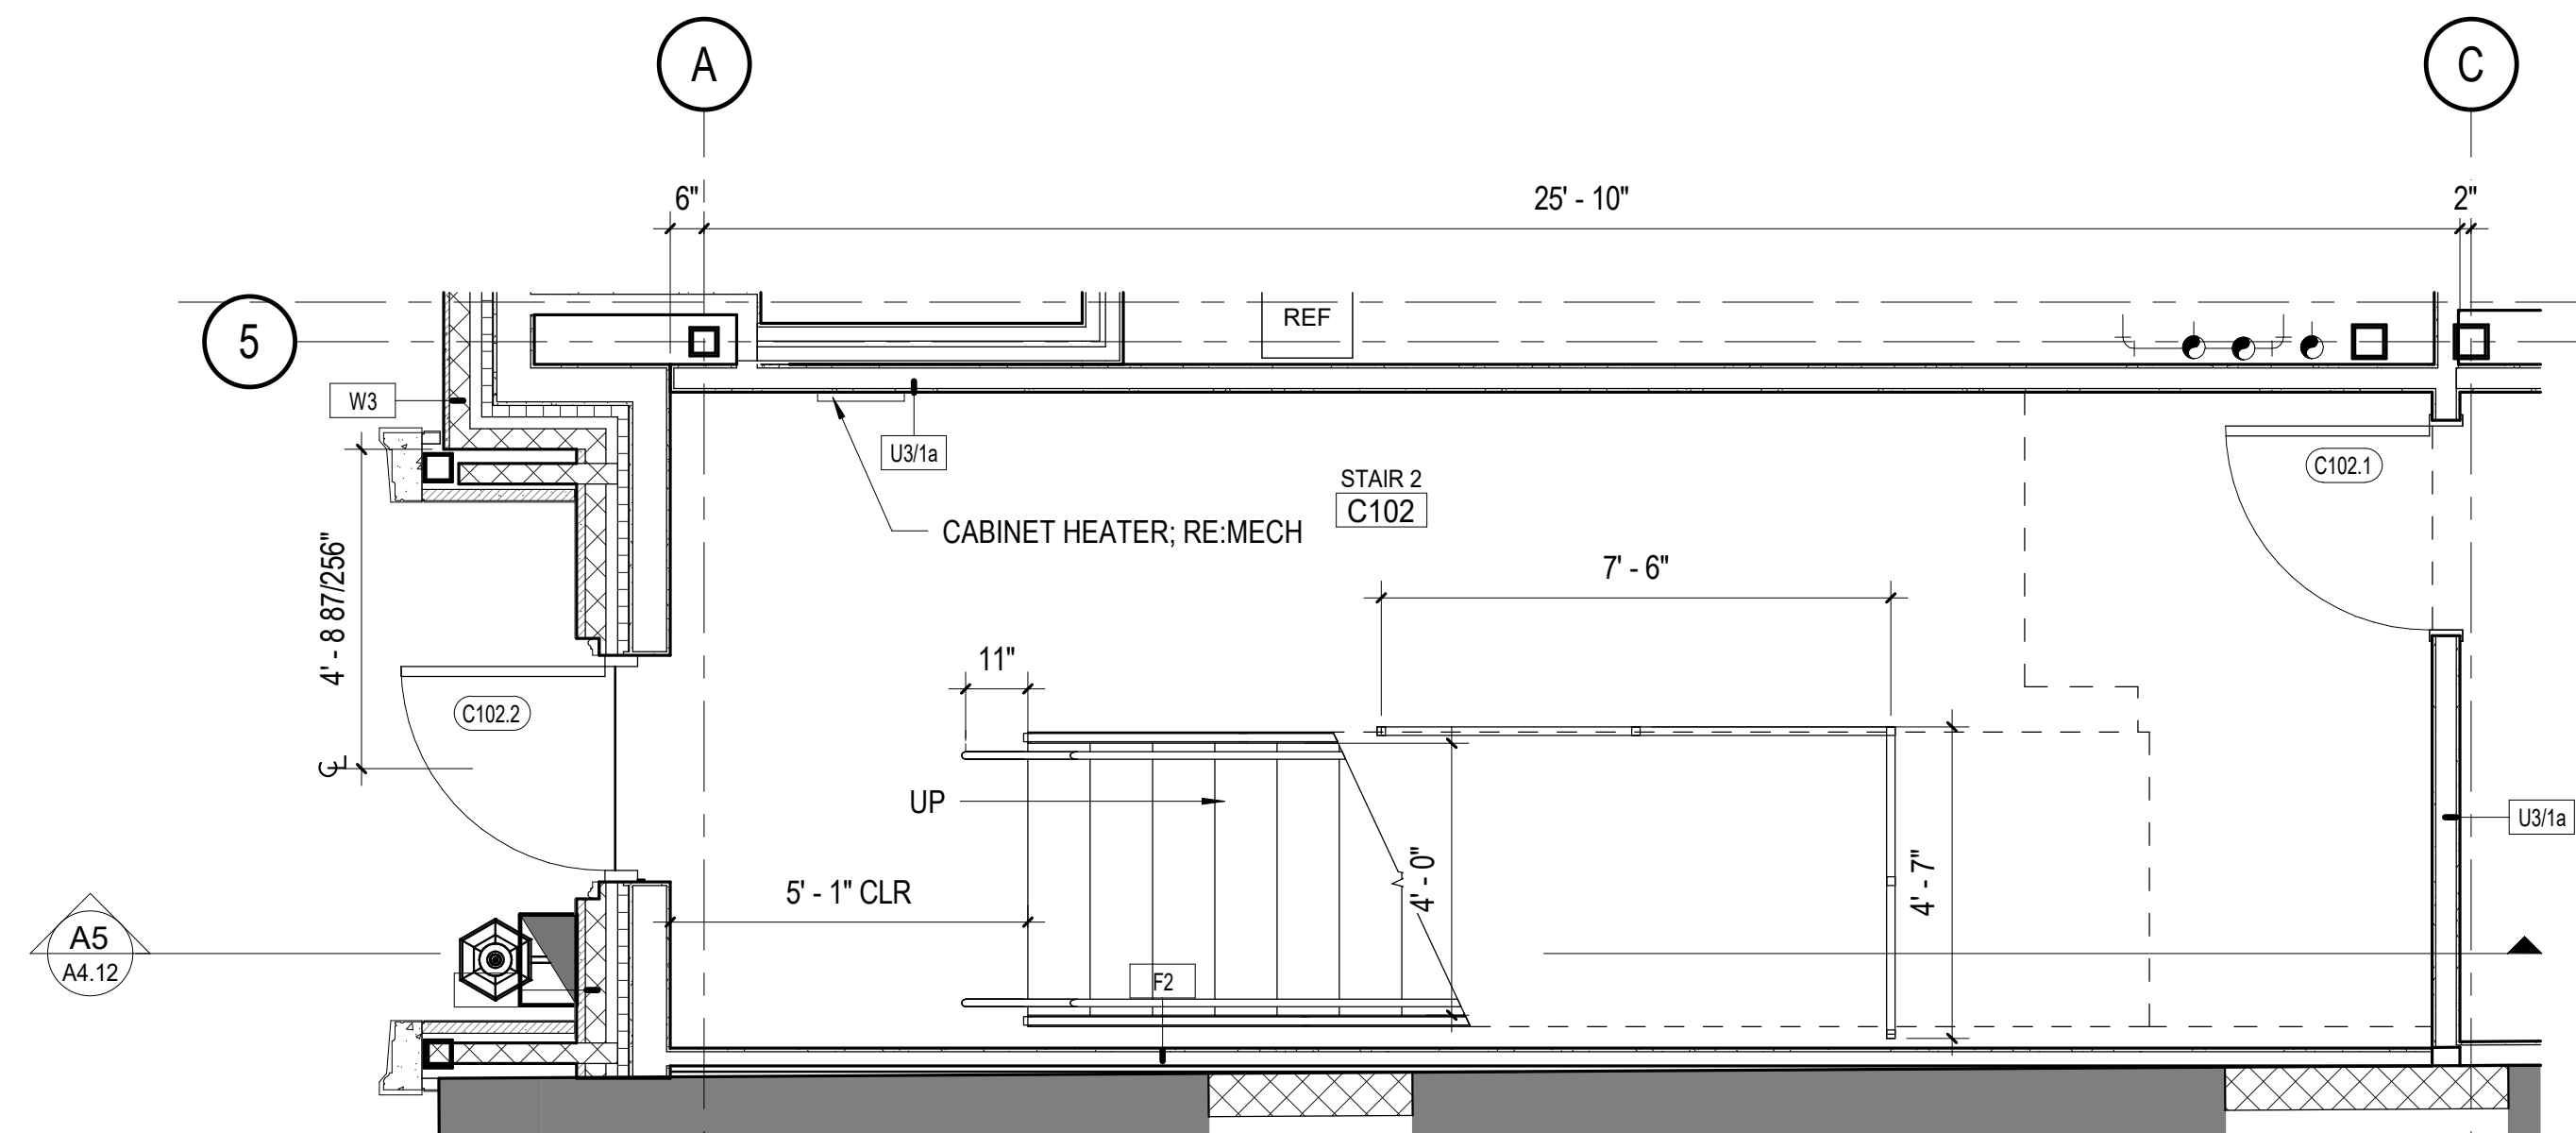

A1 STAIR 2 - LEVEL 1
3/8" = 1'-0"

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
DONALD C. SIMPSON
REGISTERED ARCHITECT
3531

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOING 202403
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date

DRAWING TITLE
ENLARGED STAIR PLANS AND SECTIONS


DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A4.12

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

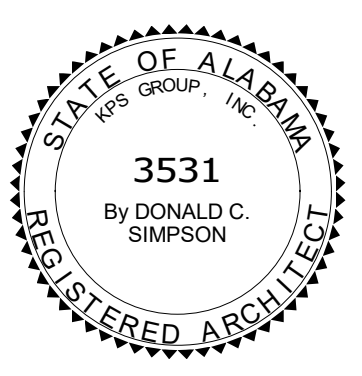


McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DRAWING: 236002-02
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
ENLARGED STAIR PLANS AND SECTIONS		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A4.13		

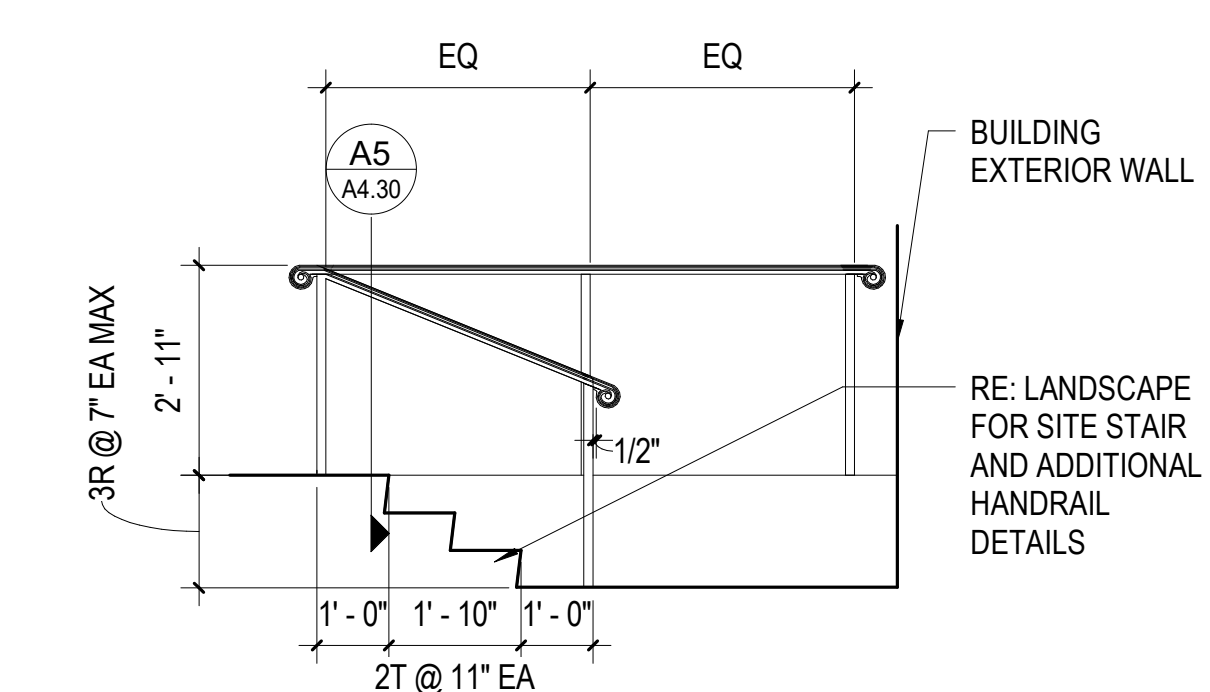


E1 SECTION - EAST SITE STAIR
3/8" = 1'-0"

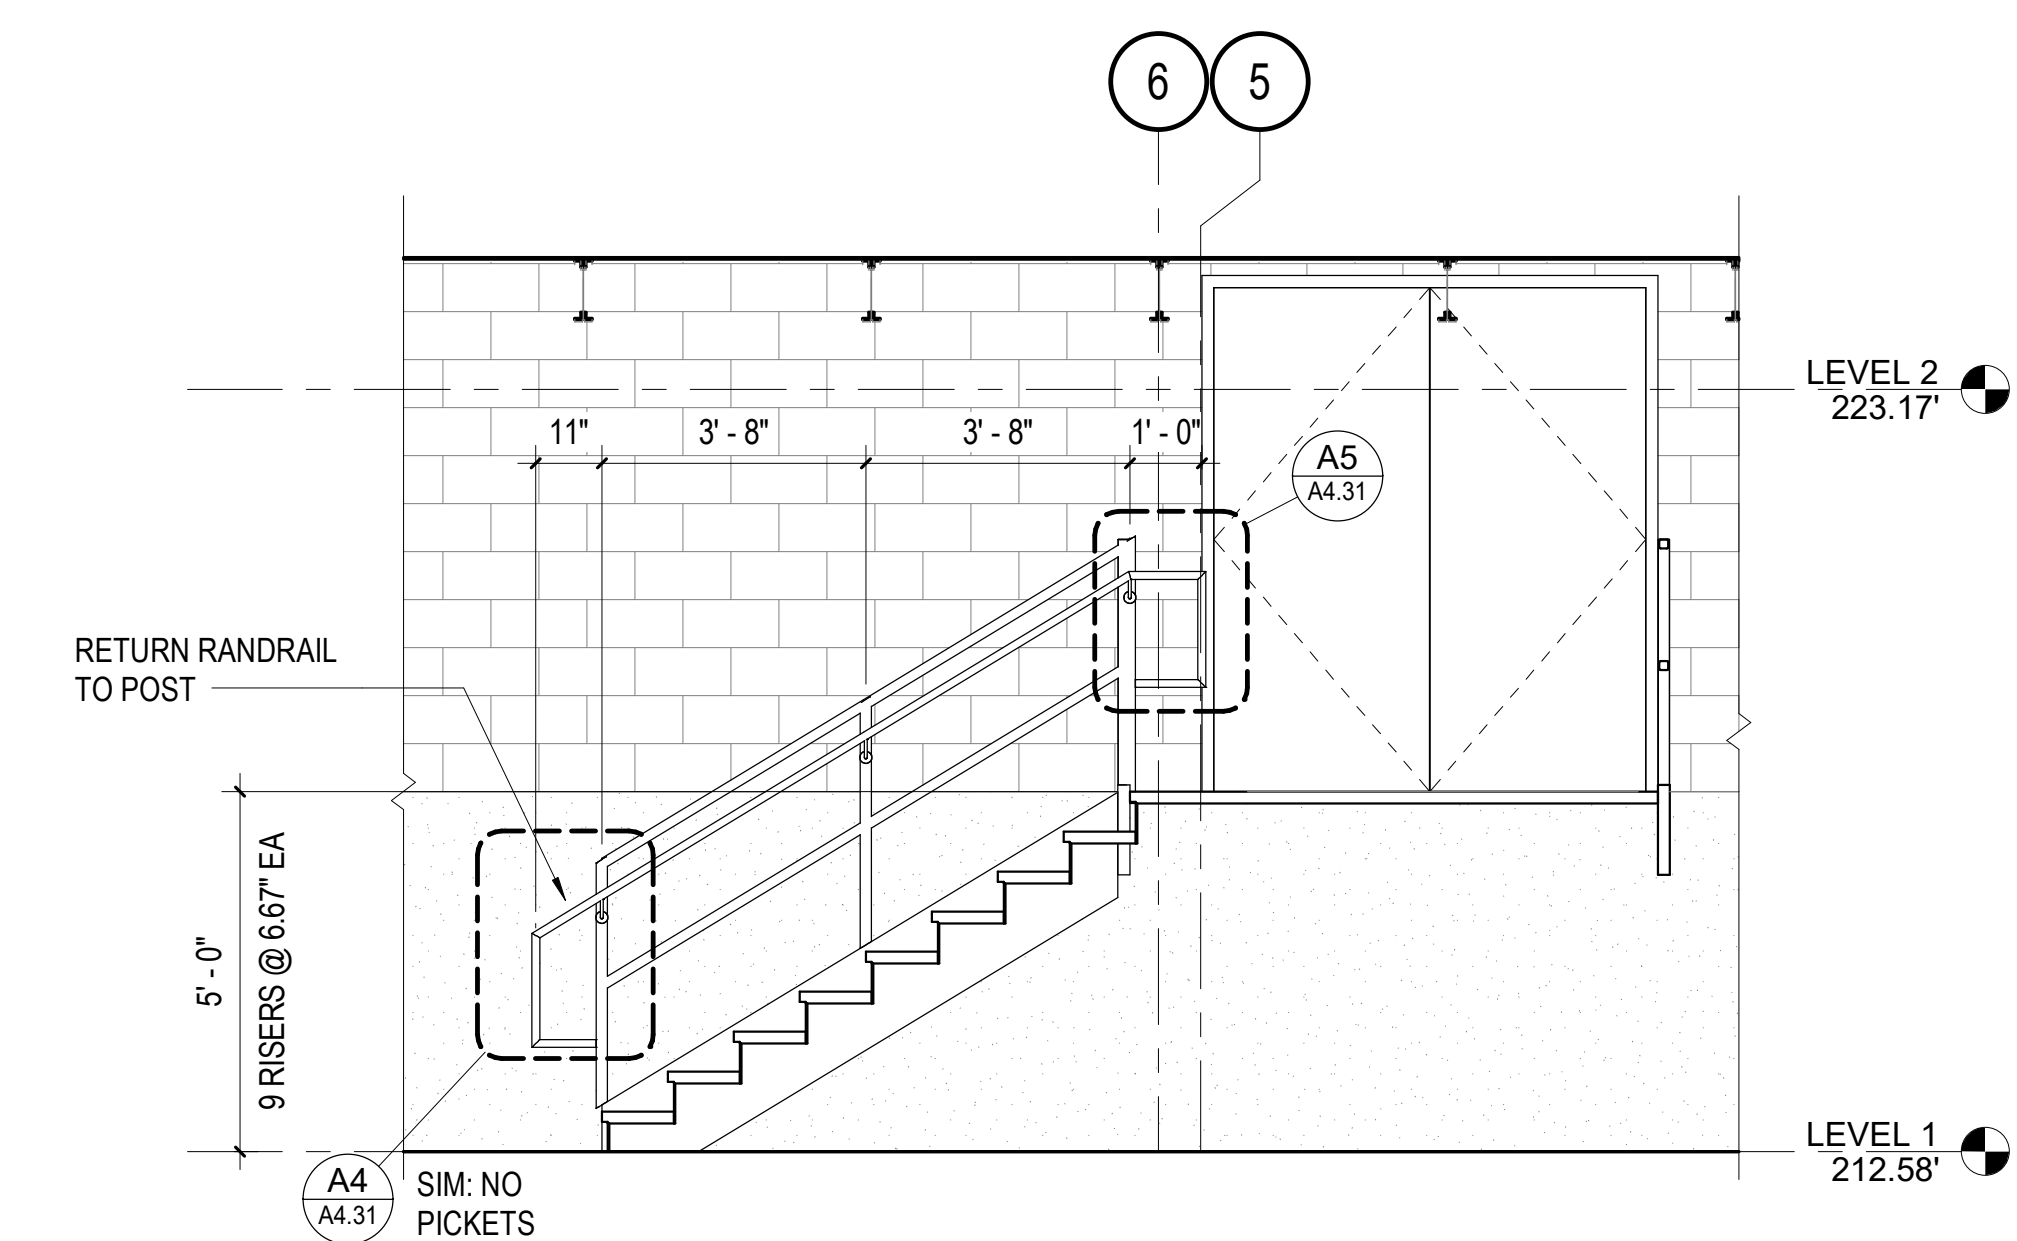


C1 SECTION - STAIR 3
3/8" = 1'-0"

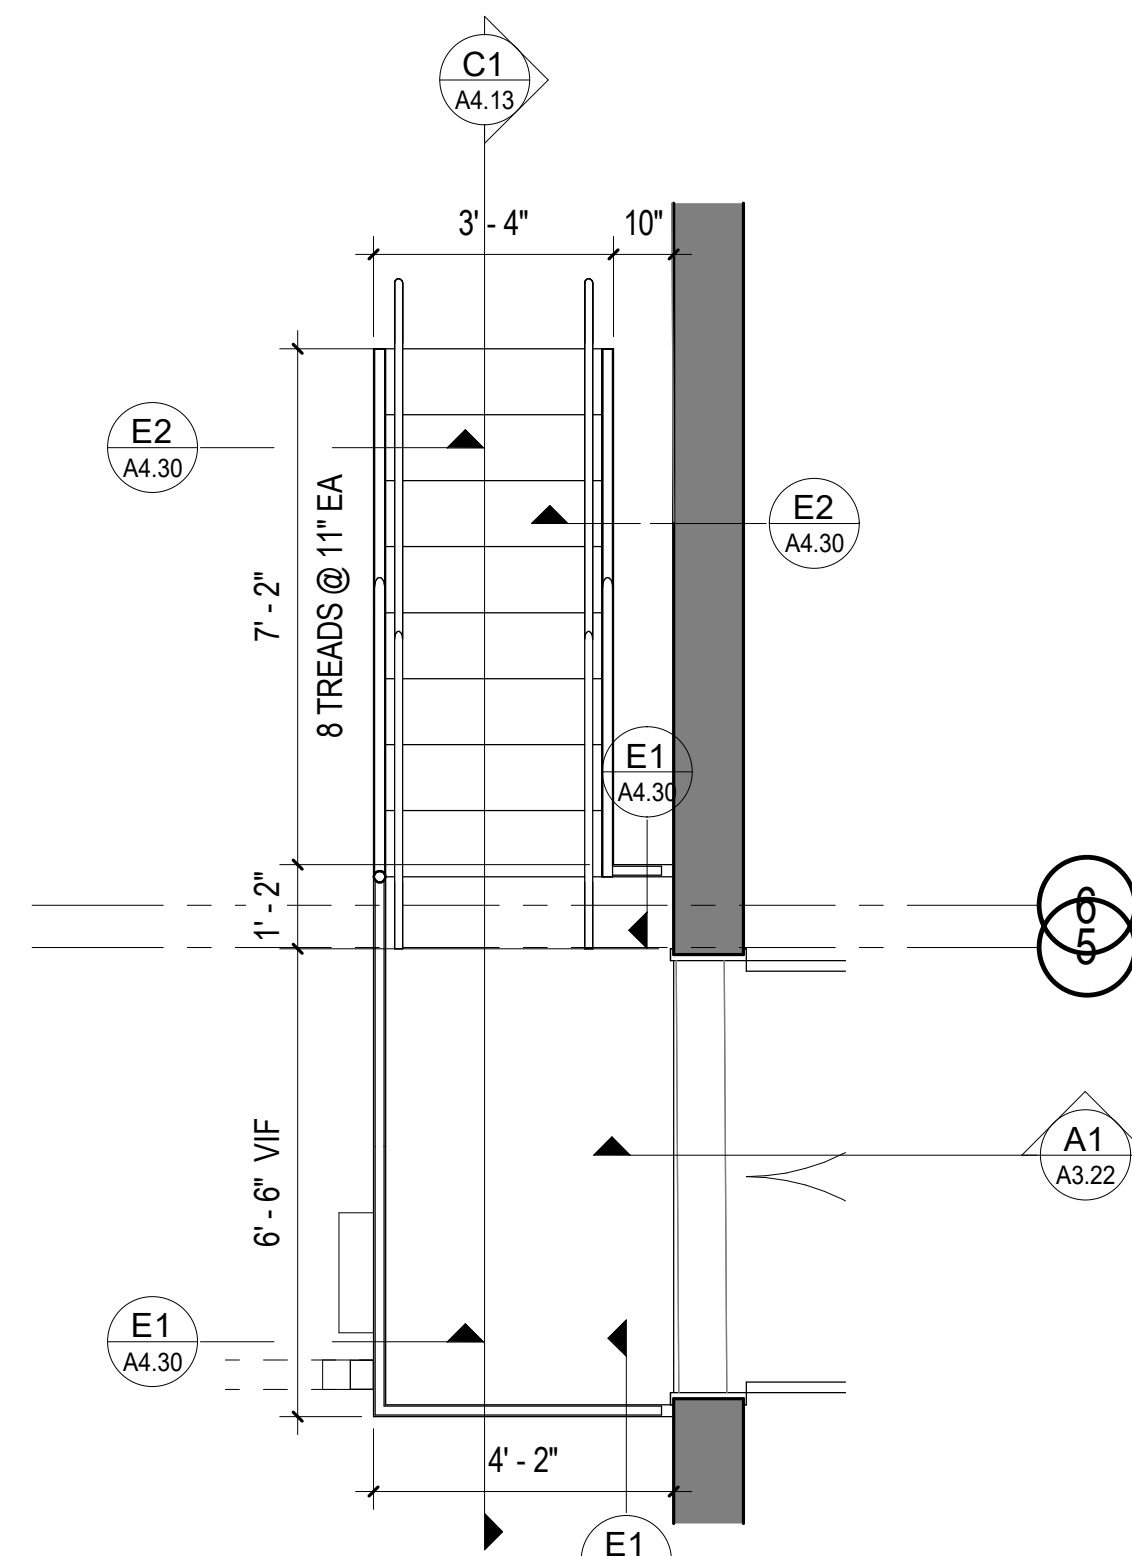


A1 PLAN - STAIR 3
3/8" = 1'-0"

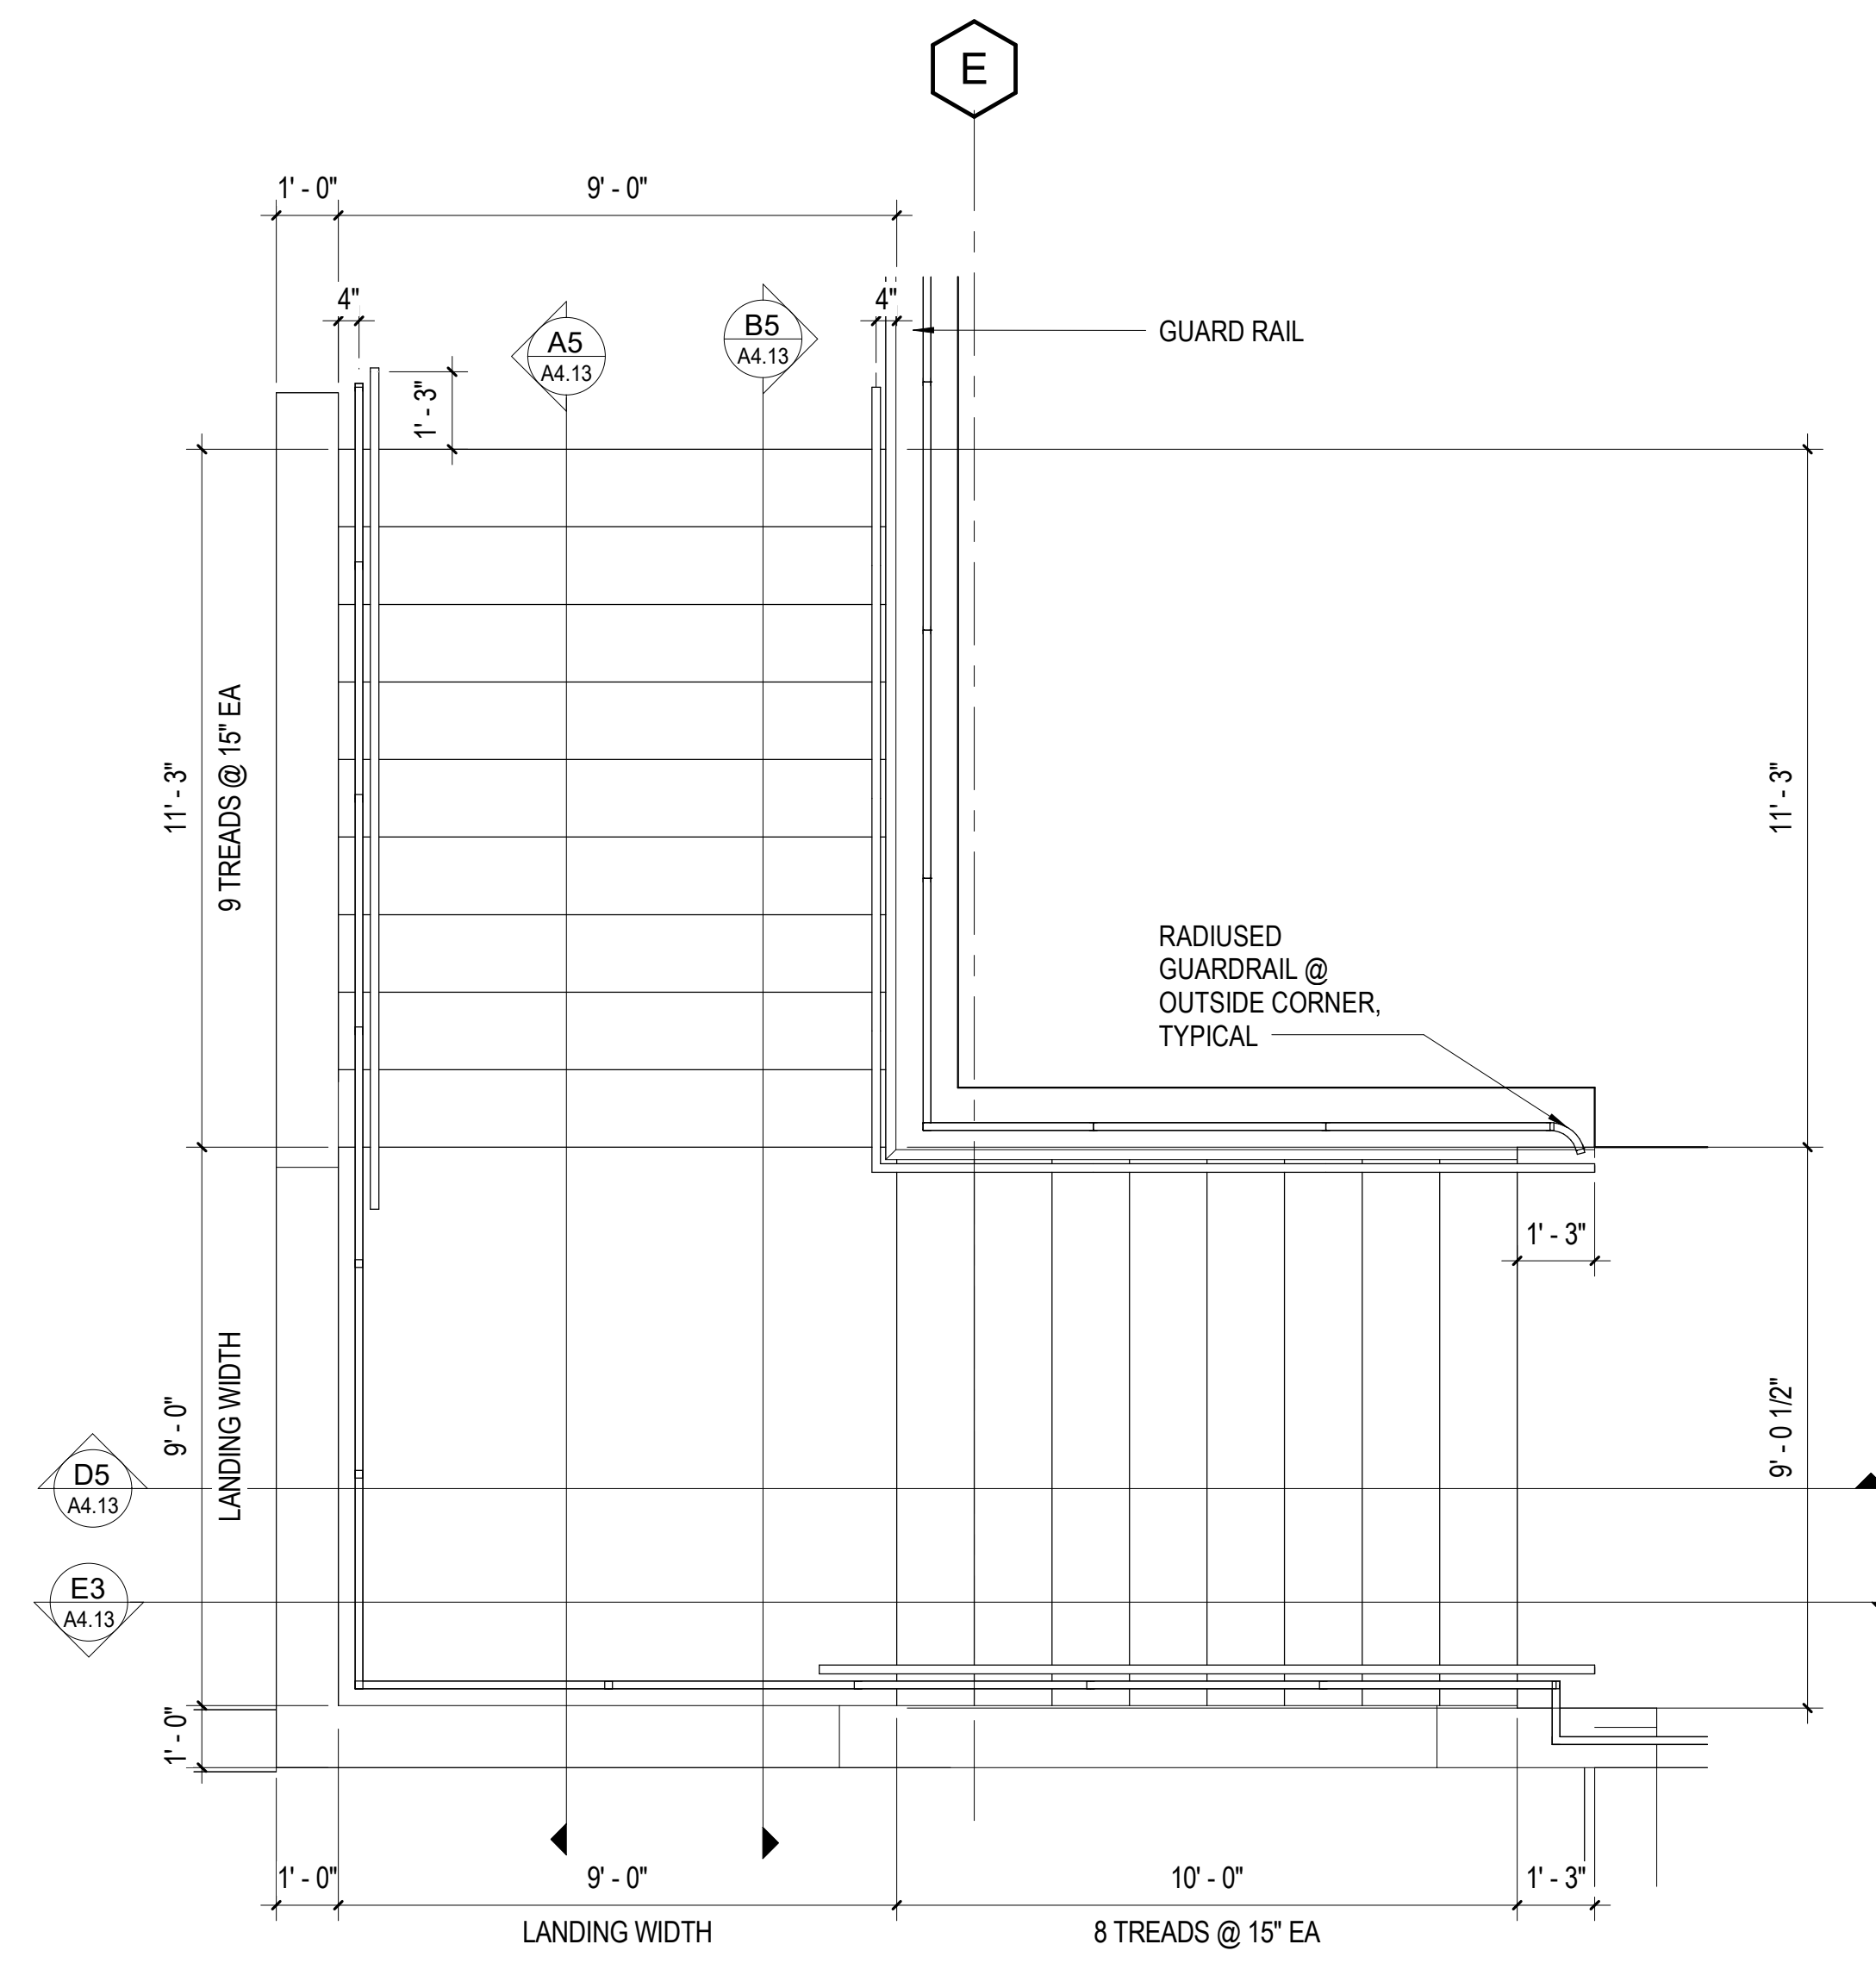


A2 PLAN - EXTERIOR STAIRS ON GRADE
3/8" = 1'-0"

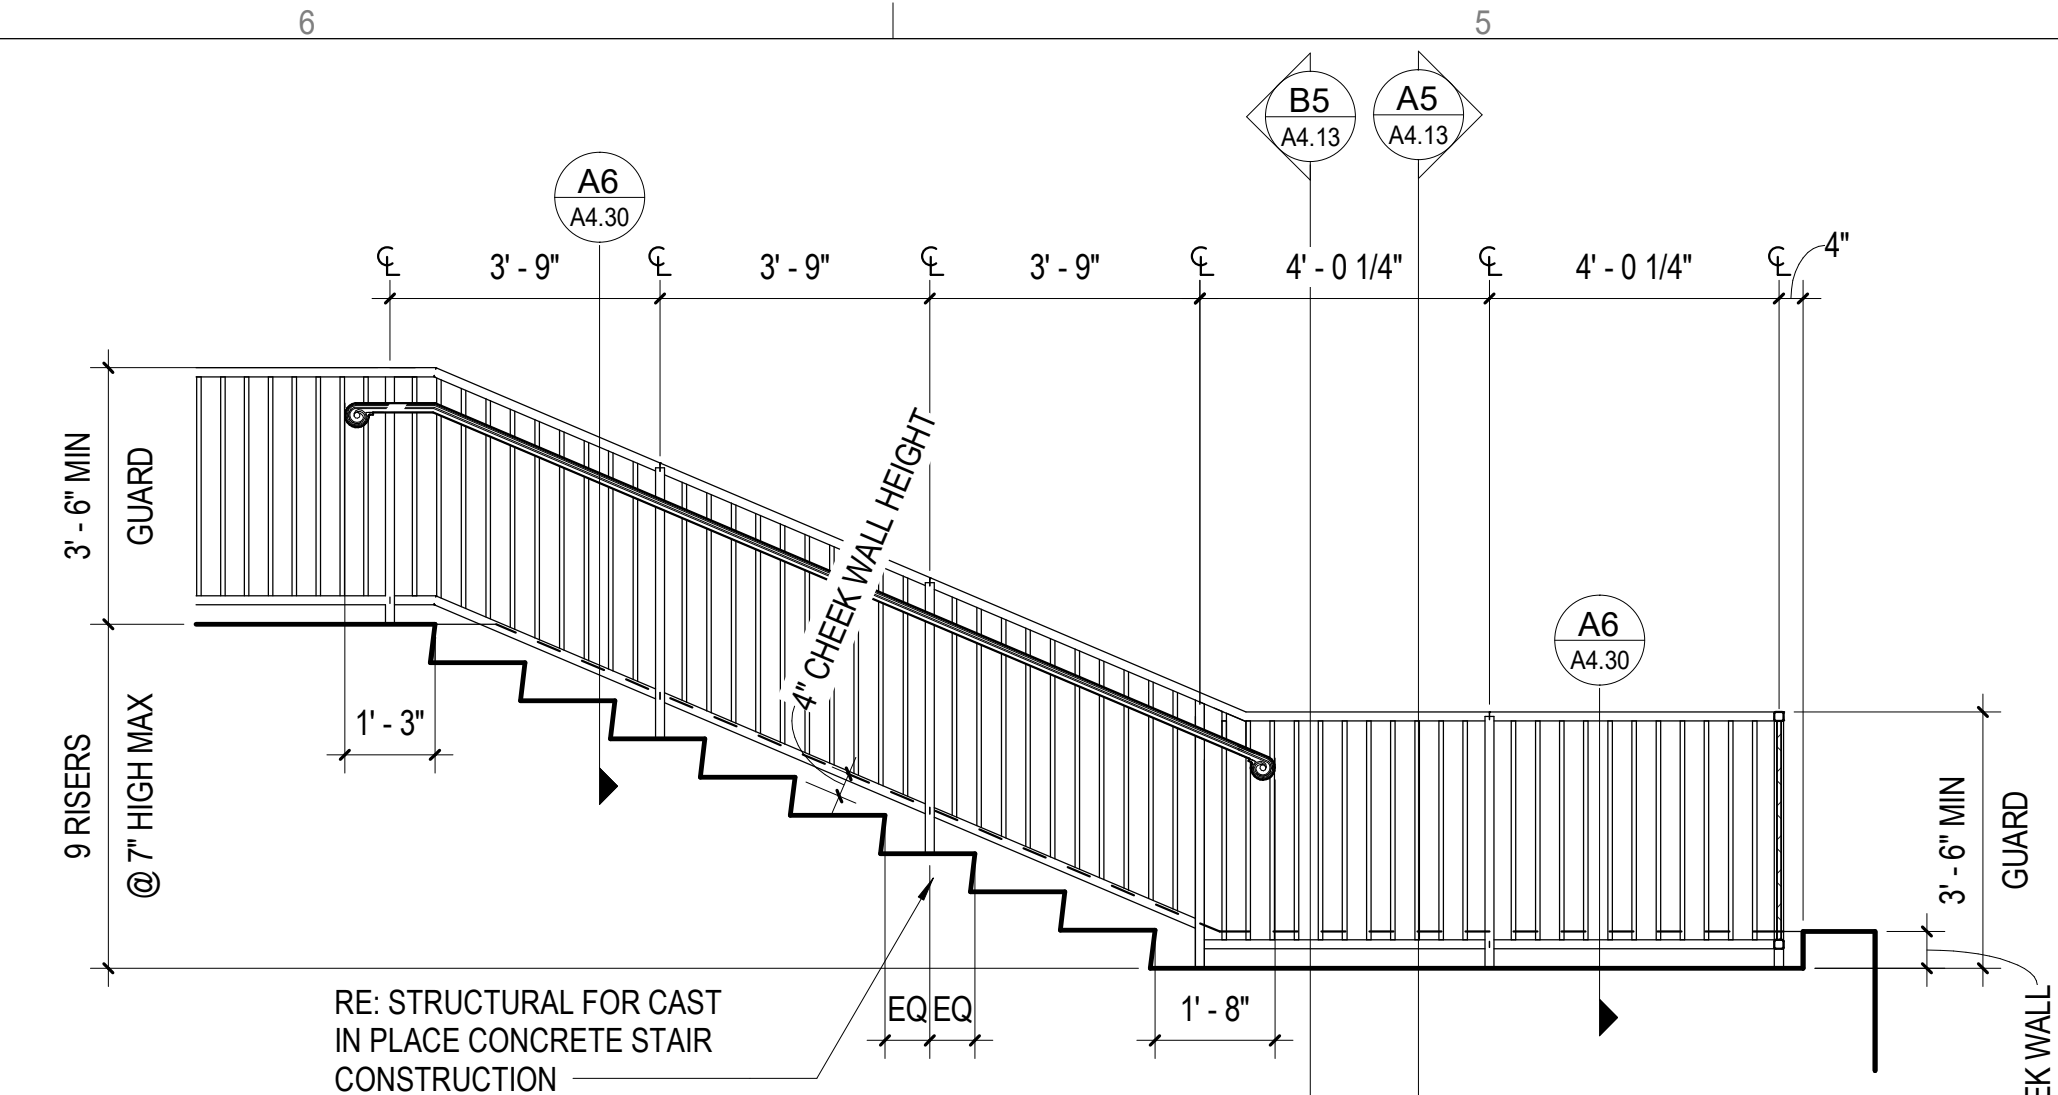


E3 SECTION - STAIR ON GRADE
3/8" = 1'-0"

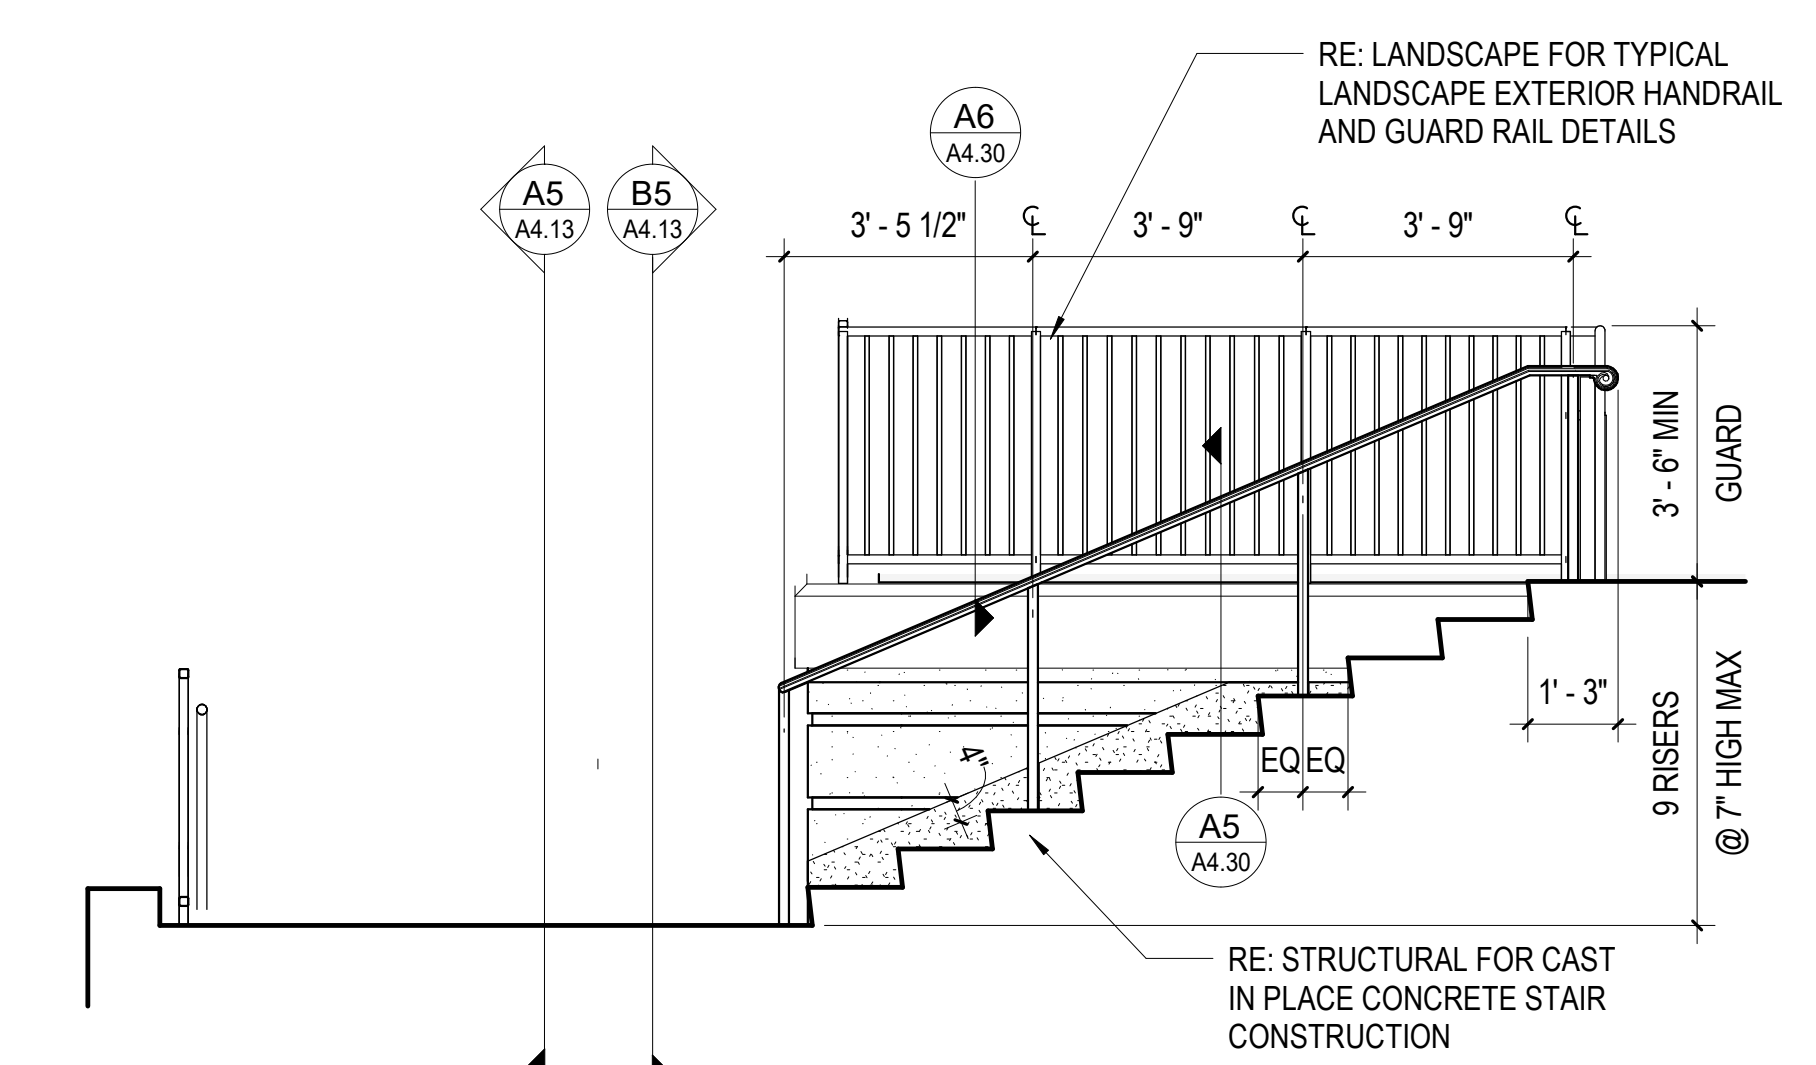


D5 SECTION - STAIR ON GRADE
3/8" = 1'-0"

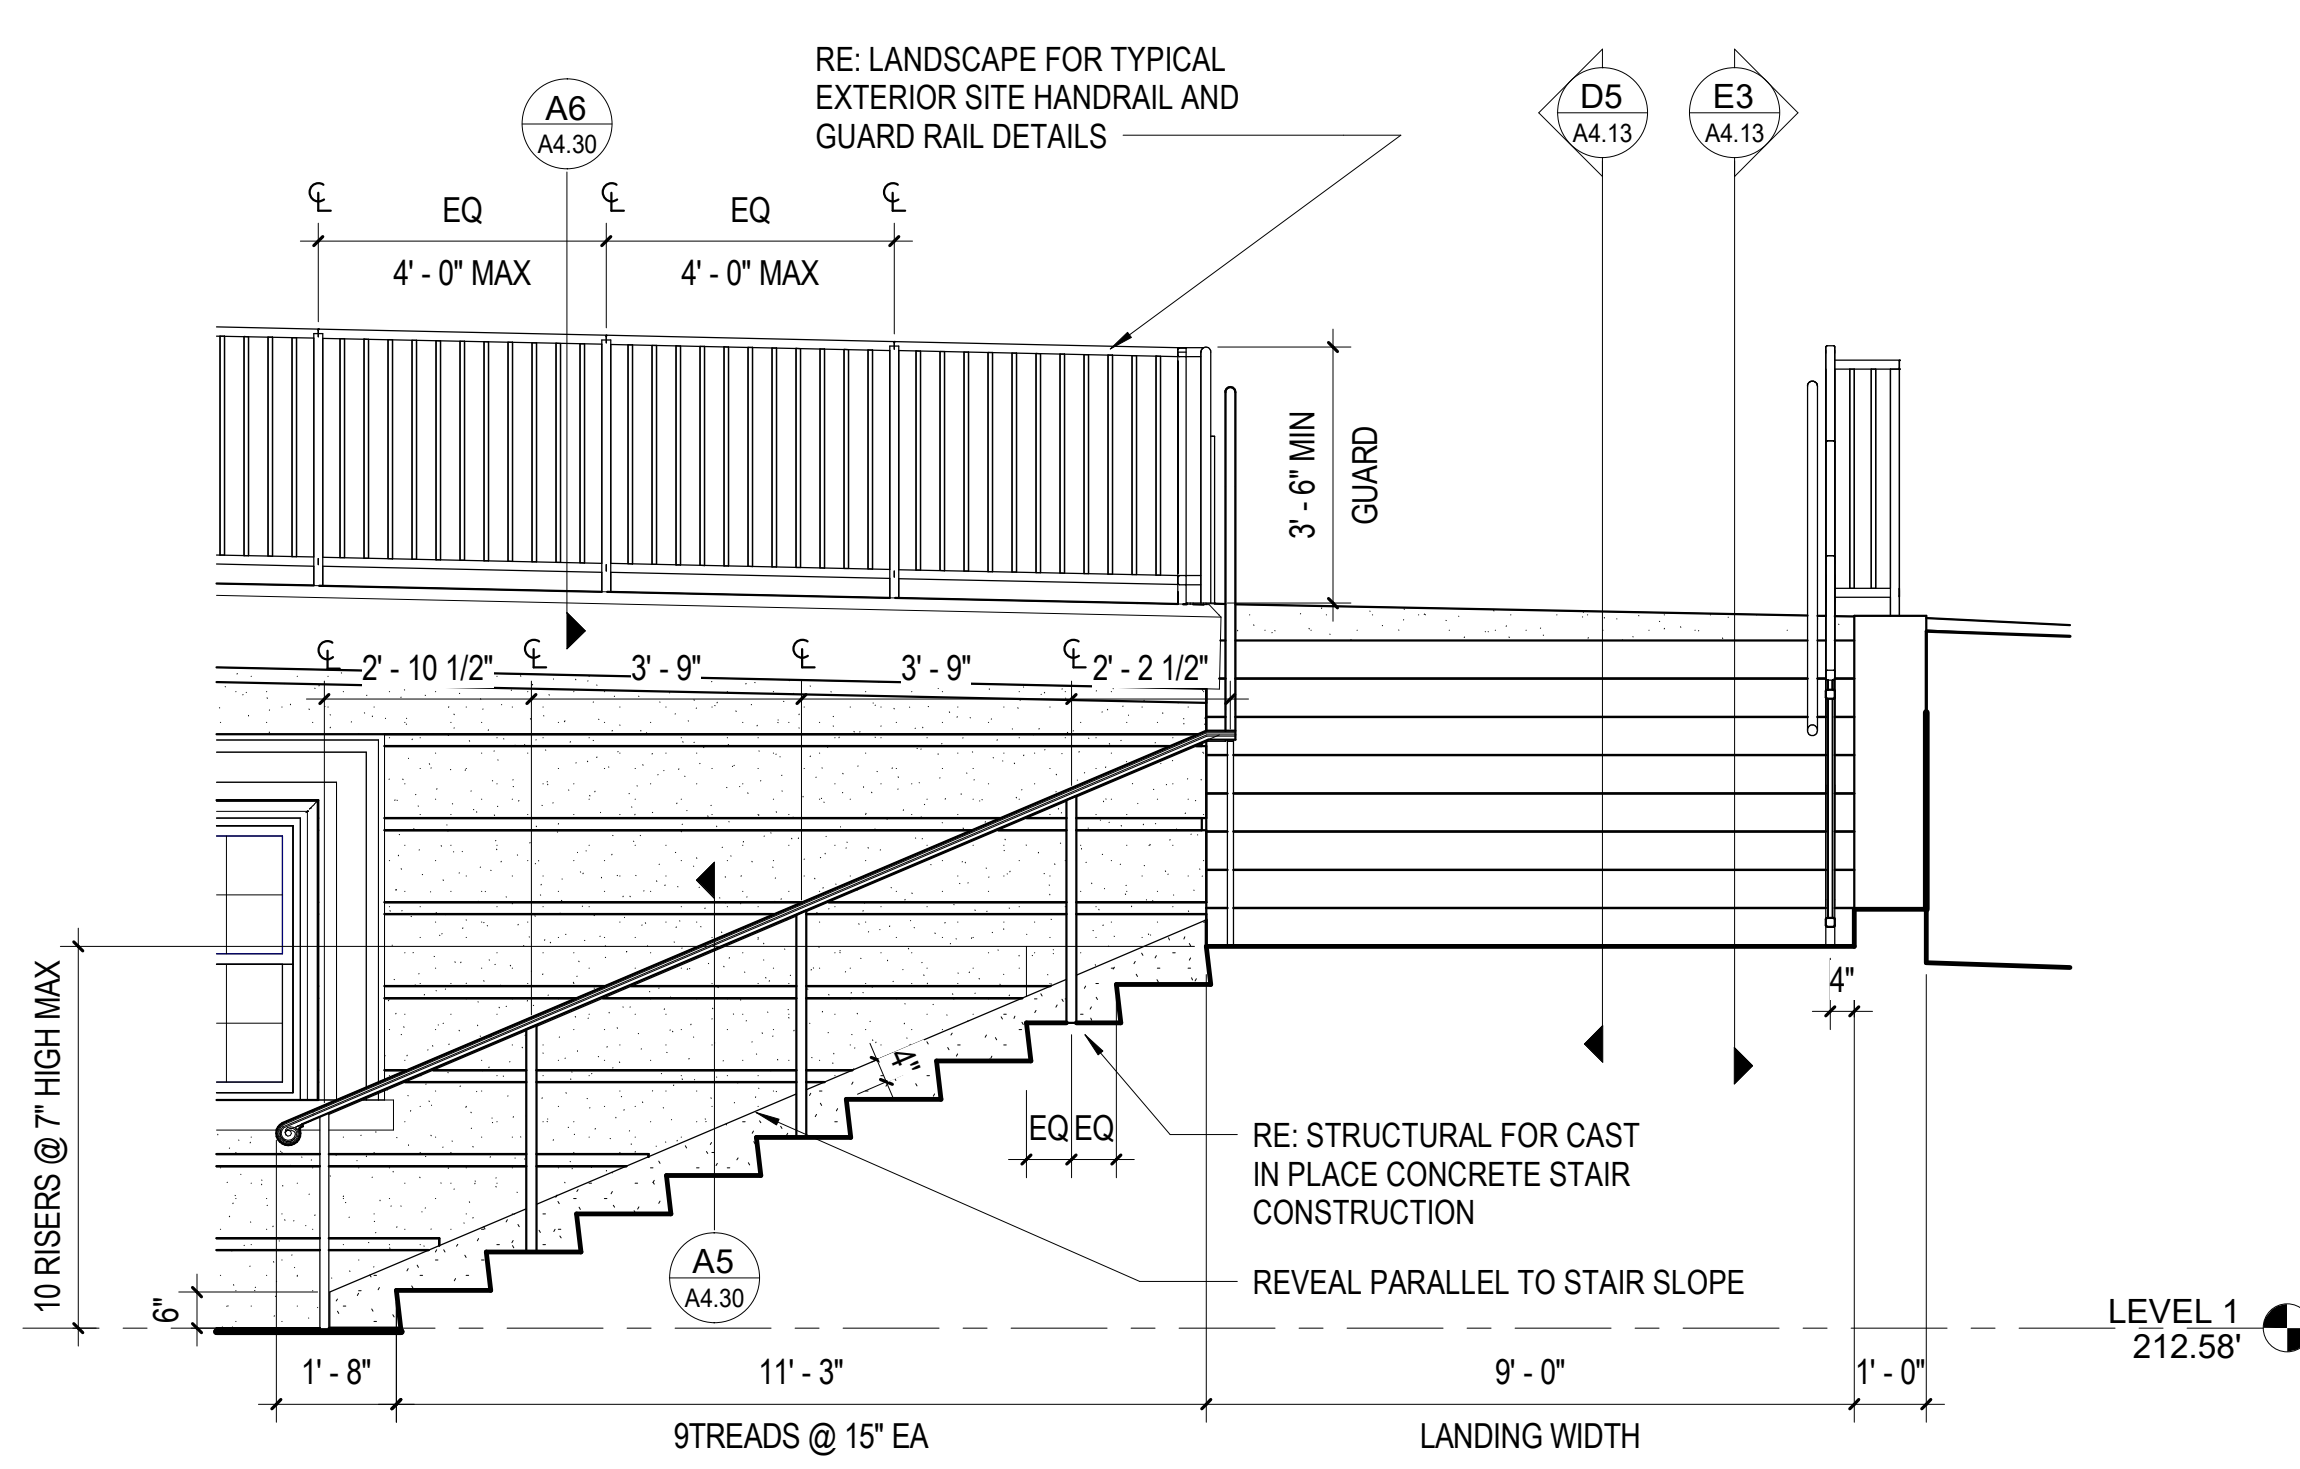


B5 SECTION - STAIR ON GRADE
3/8" = 1'-0"

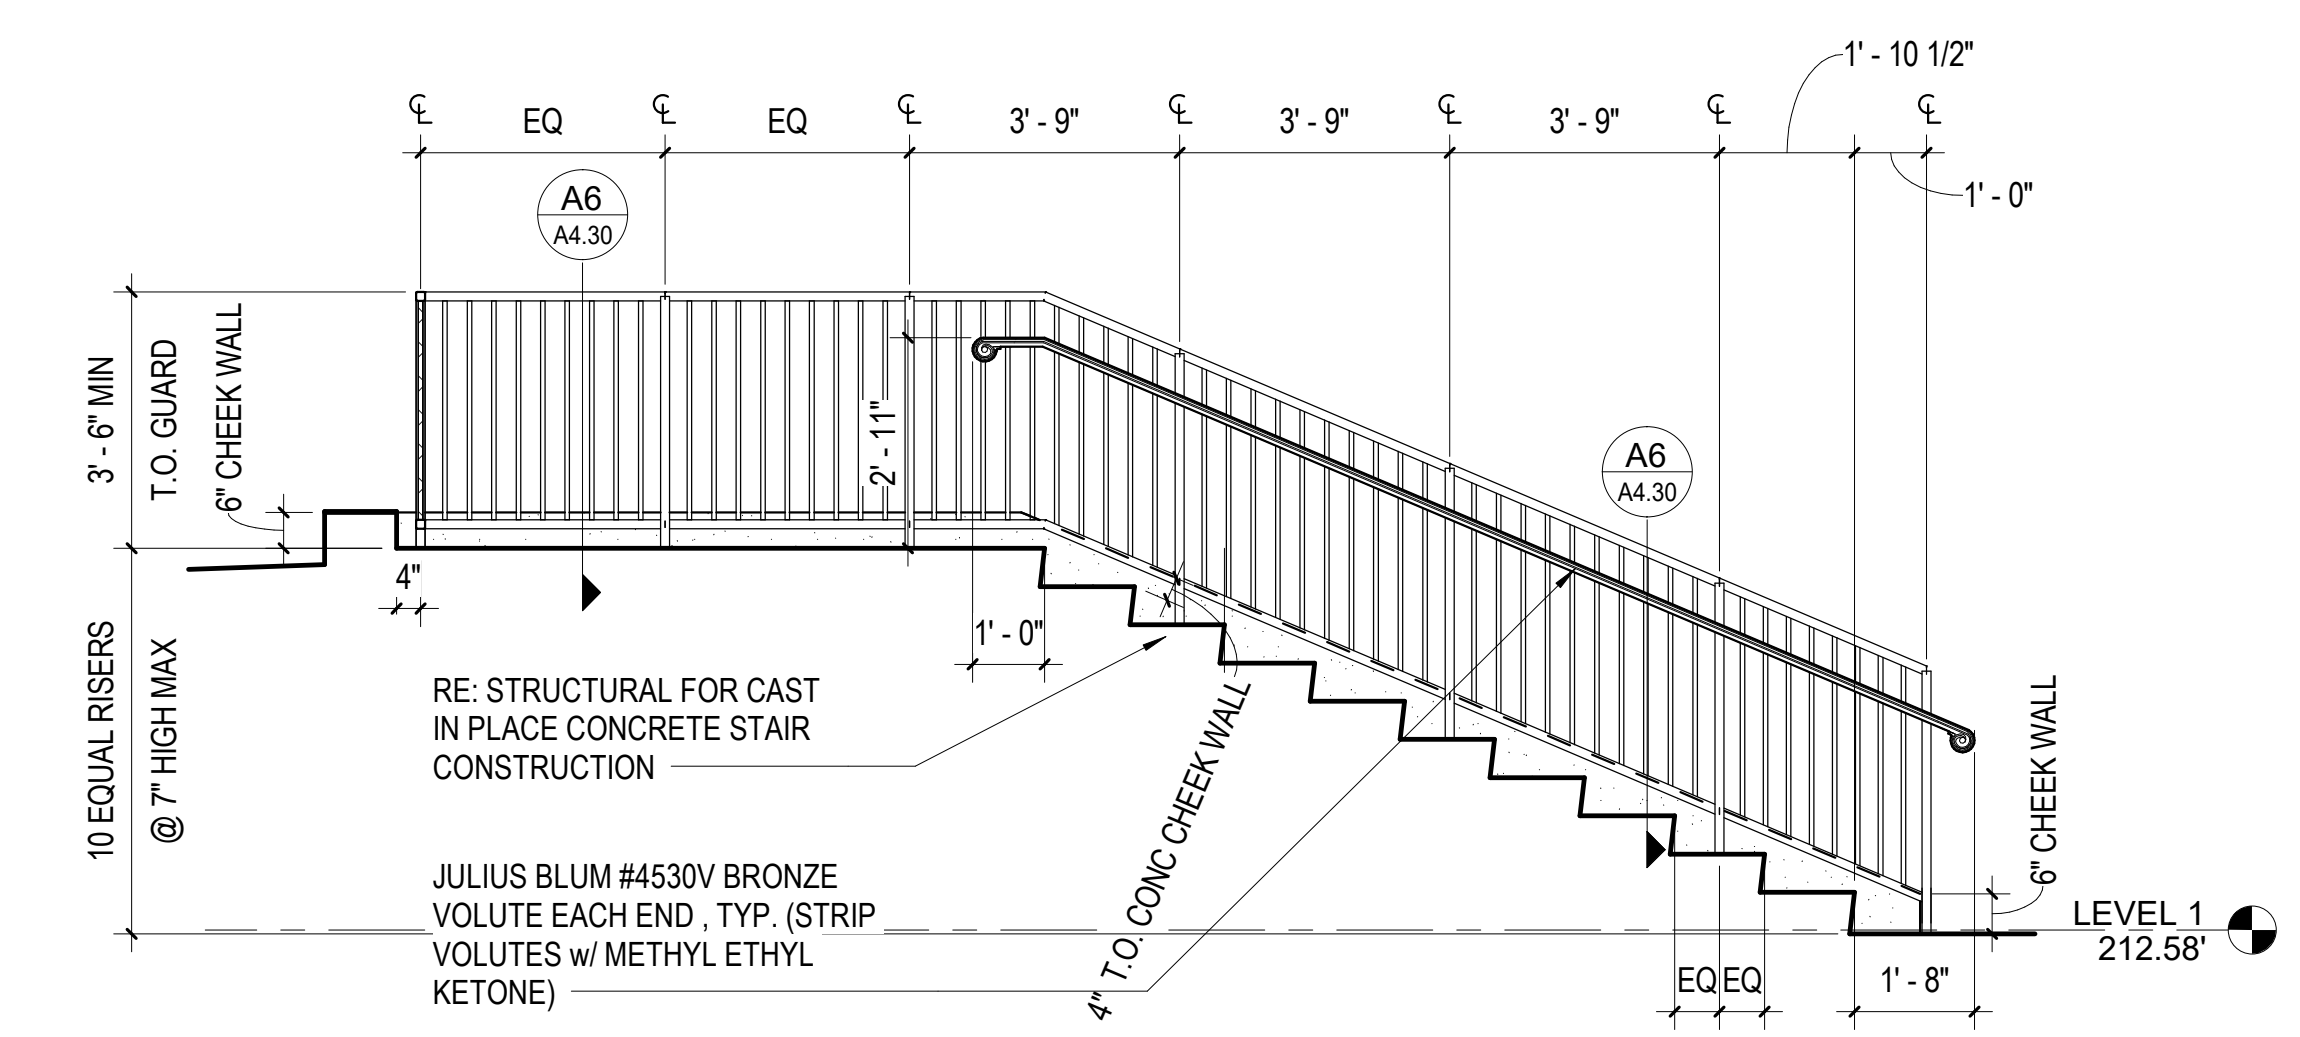


A5 SECTION - STAIR ON GRADE
3/8" = 1'-0"

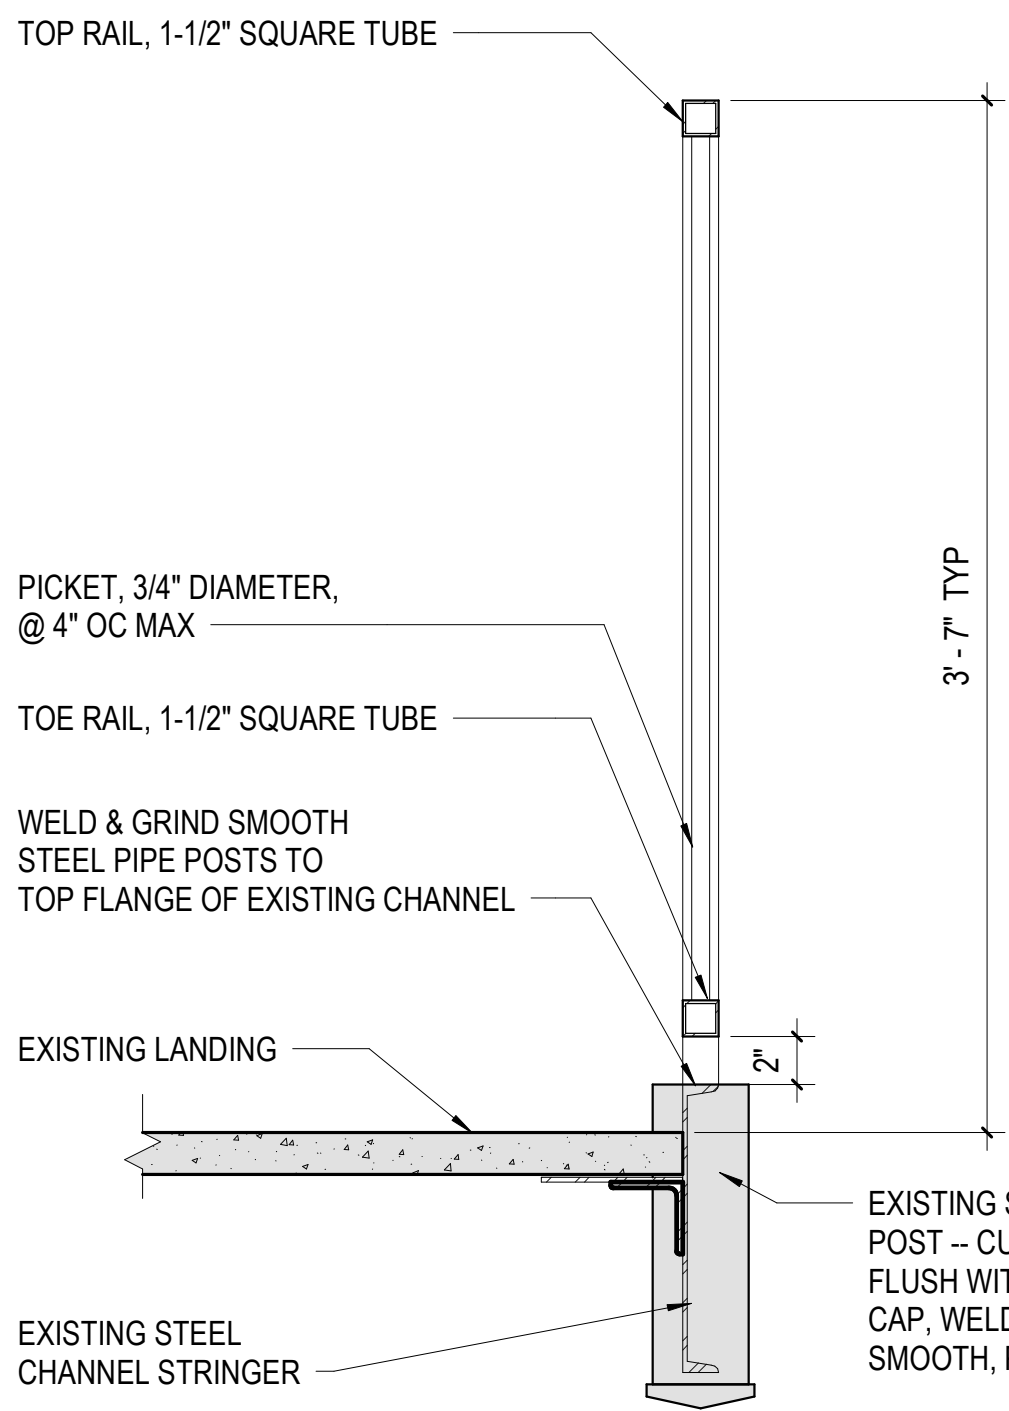


E6 TYPICAL GUARDRAIL - STAIR 1
1 1/2" = 1'-0"

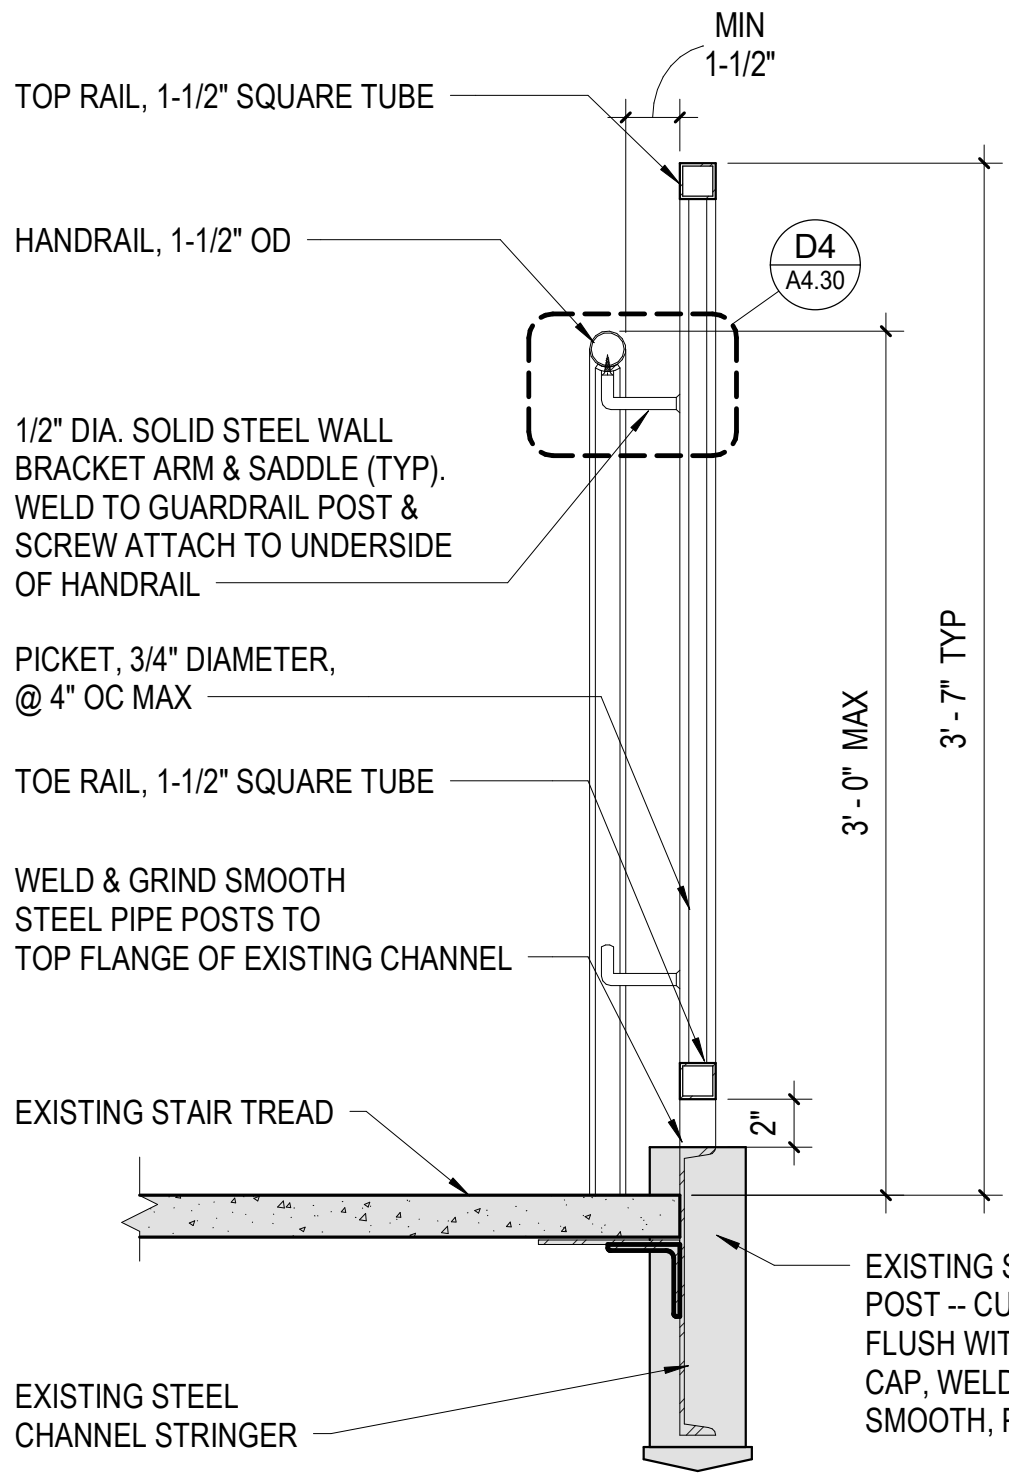


E5 TYPICAL GUARDRAIL & HANDRAIL - STAIR 1
1 1/2" = 1'-0"

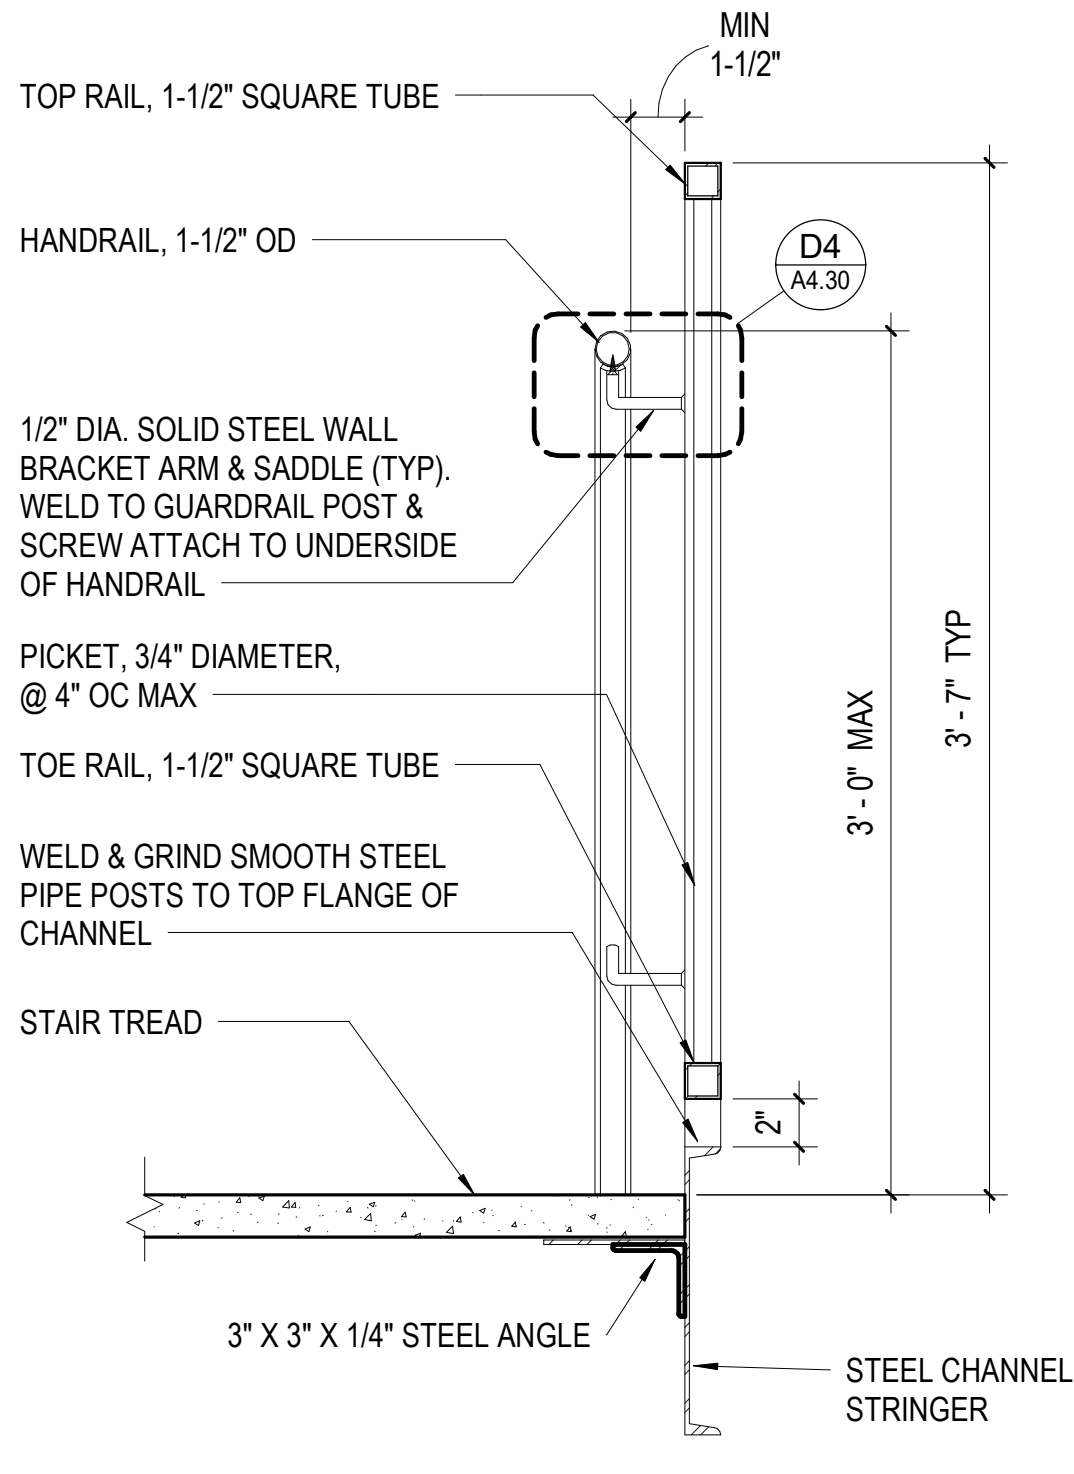


E4 TYPICAL GUARDRAIL & HANDRAIL - STAIR 2
1 1/2" = 1'-0"

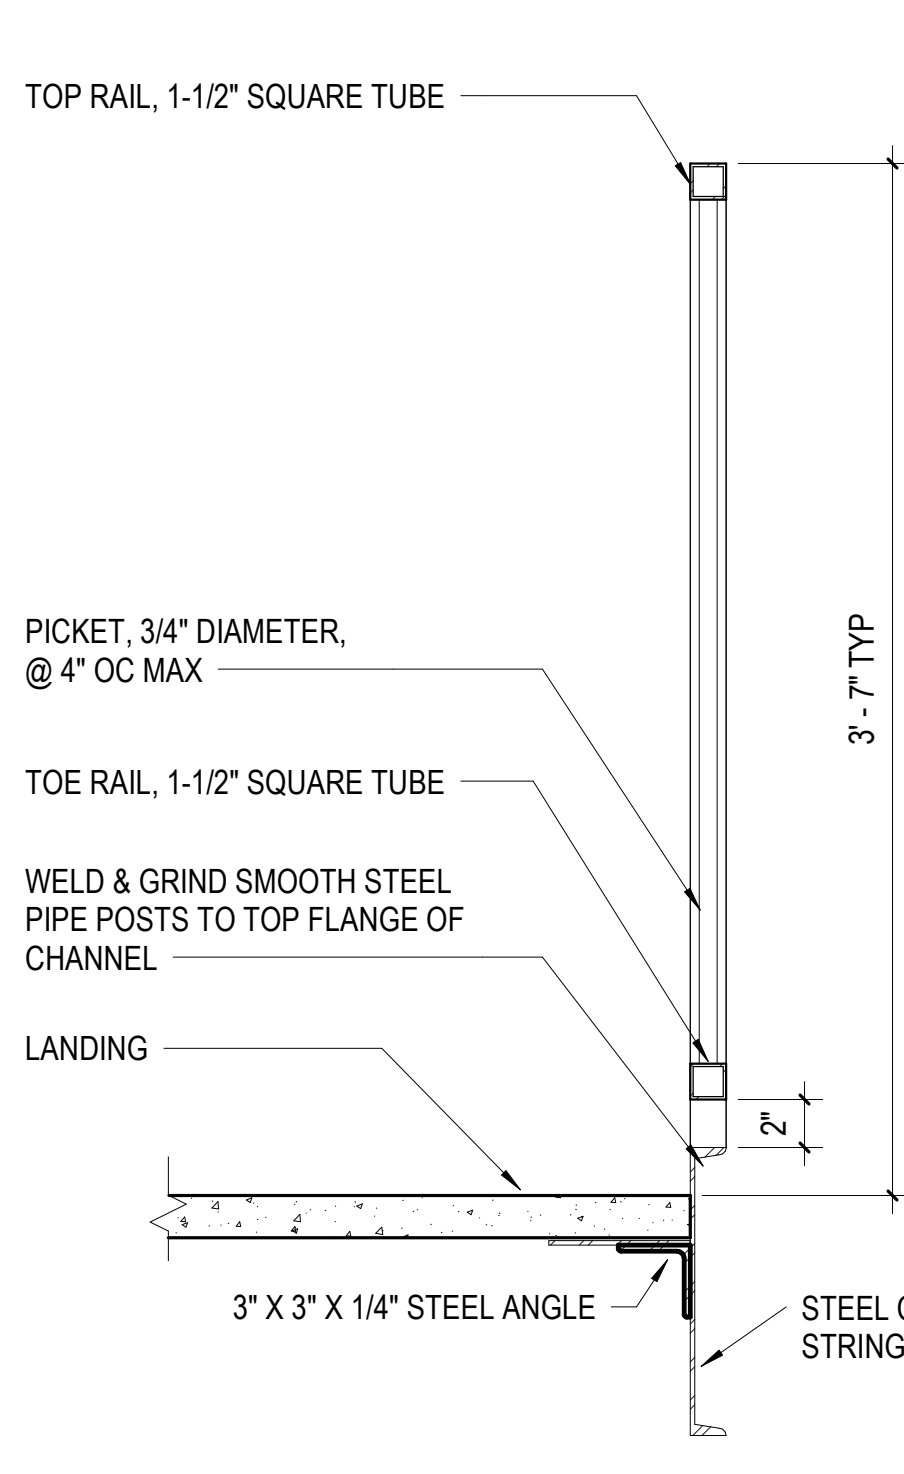


E3 TYPICAL GUARDRAIL - STAIR 2
1 1/2" = 1'-0"

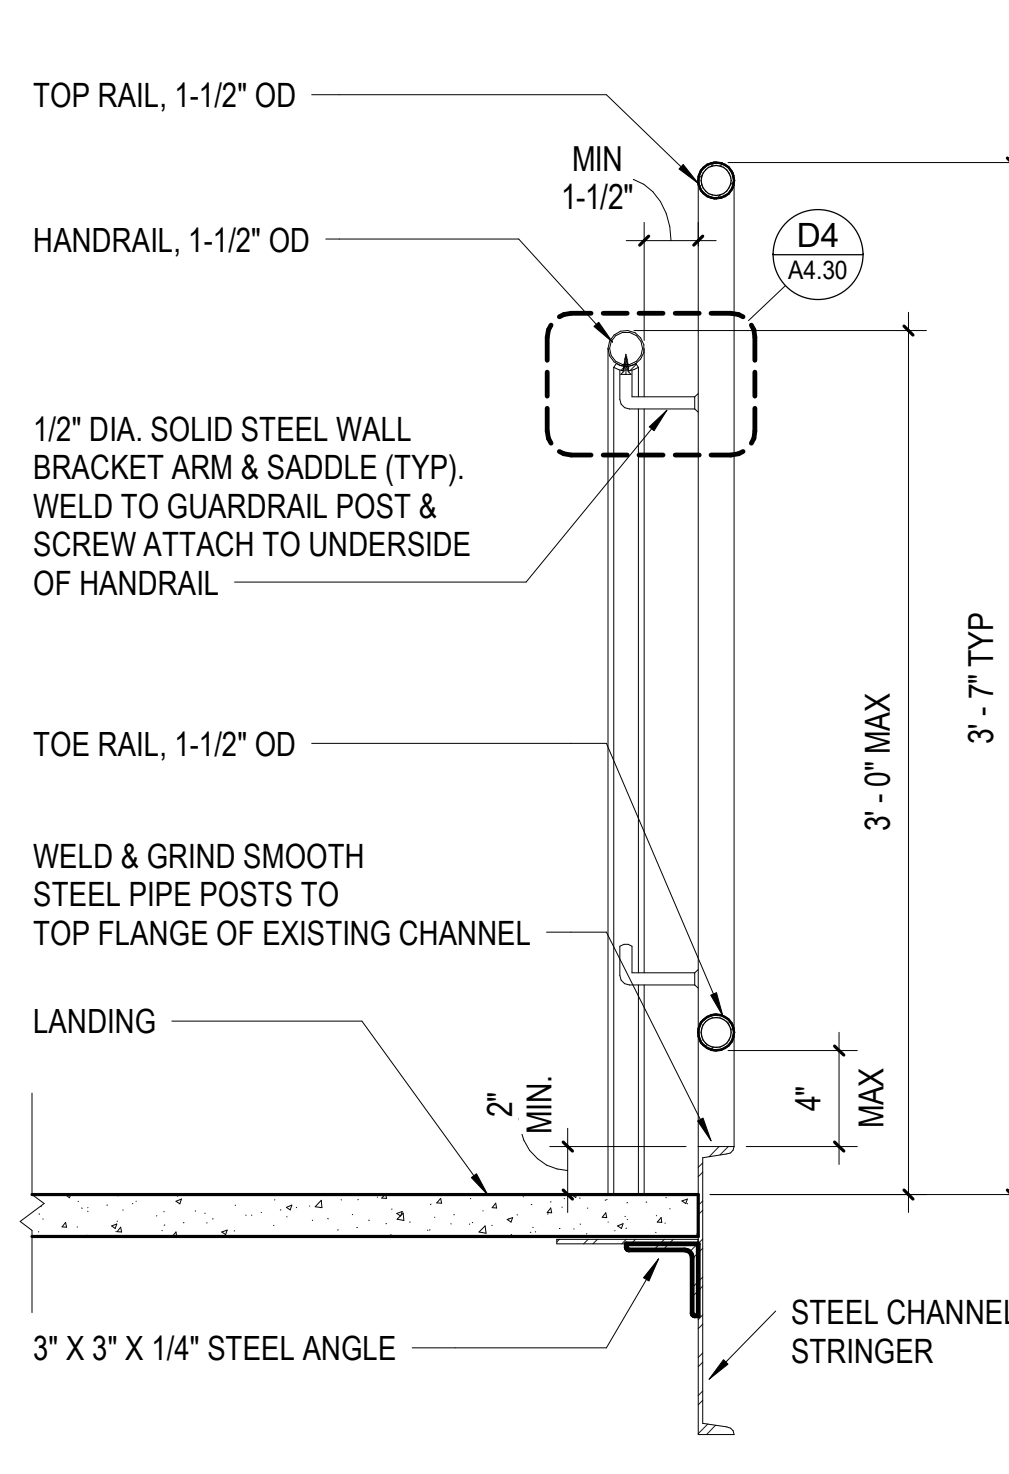


E2 TYPICAL GUARDRAIL & HANDRAIL - STAIR 3
1 1/2" = 1'-0"

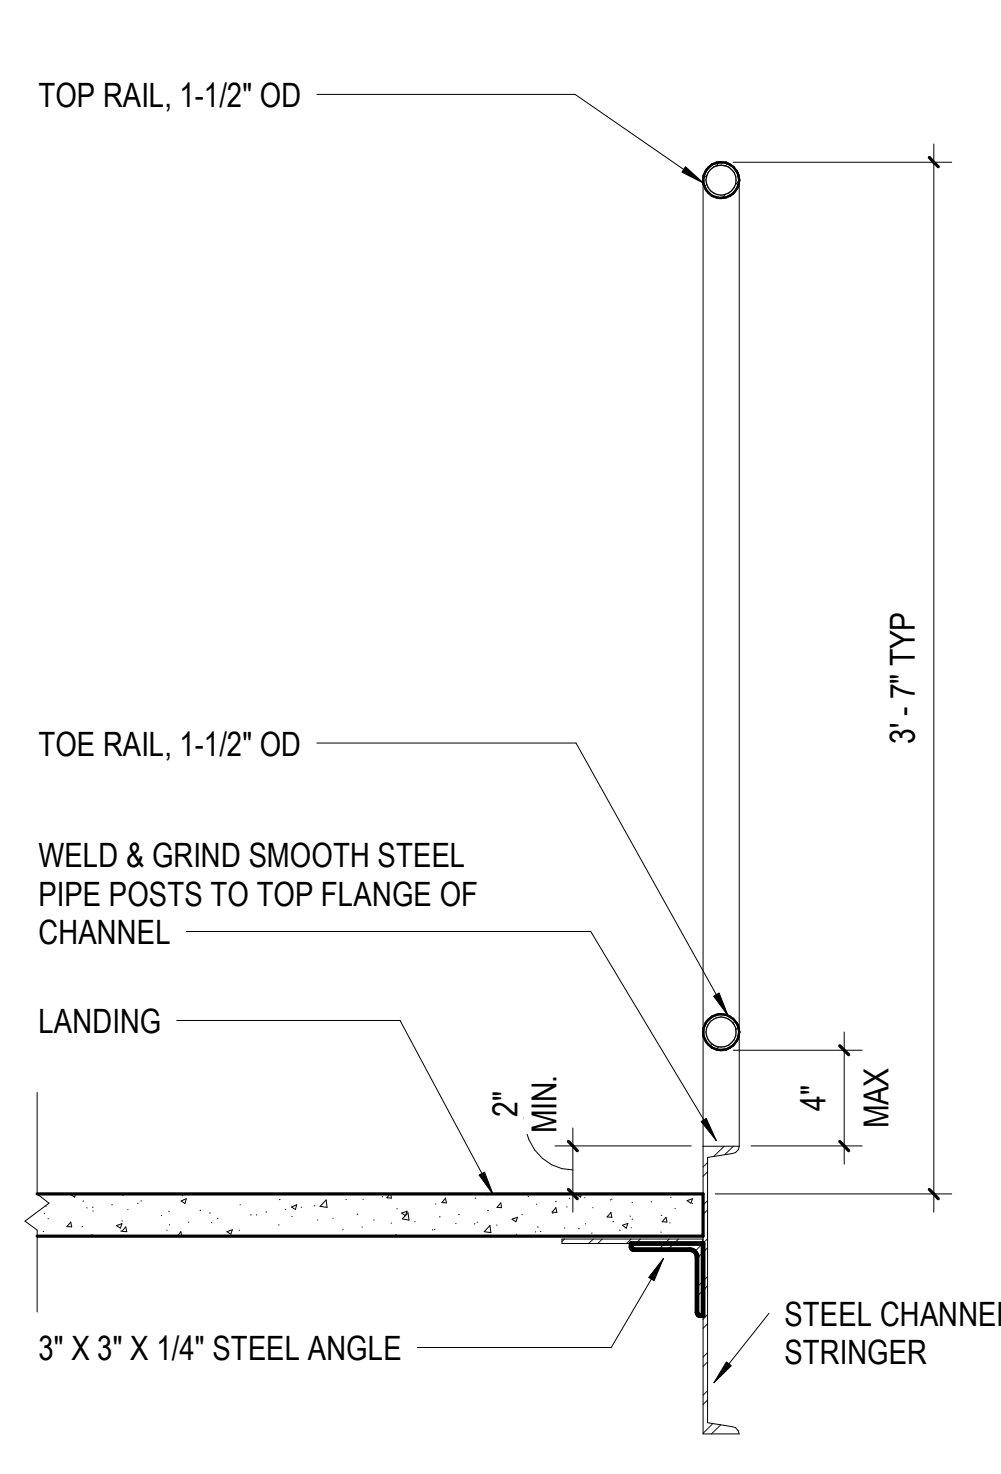



E1 TYPICAL GUARDRAIL - STAIR 3
1 1/2" = 1'-0"

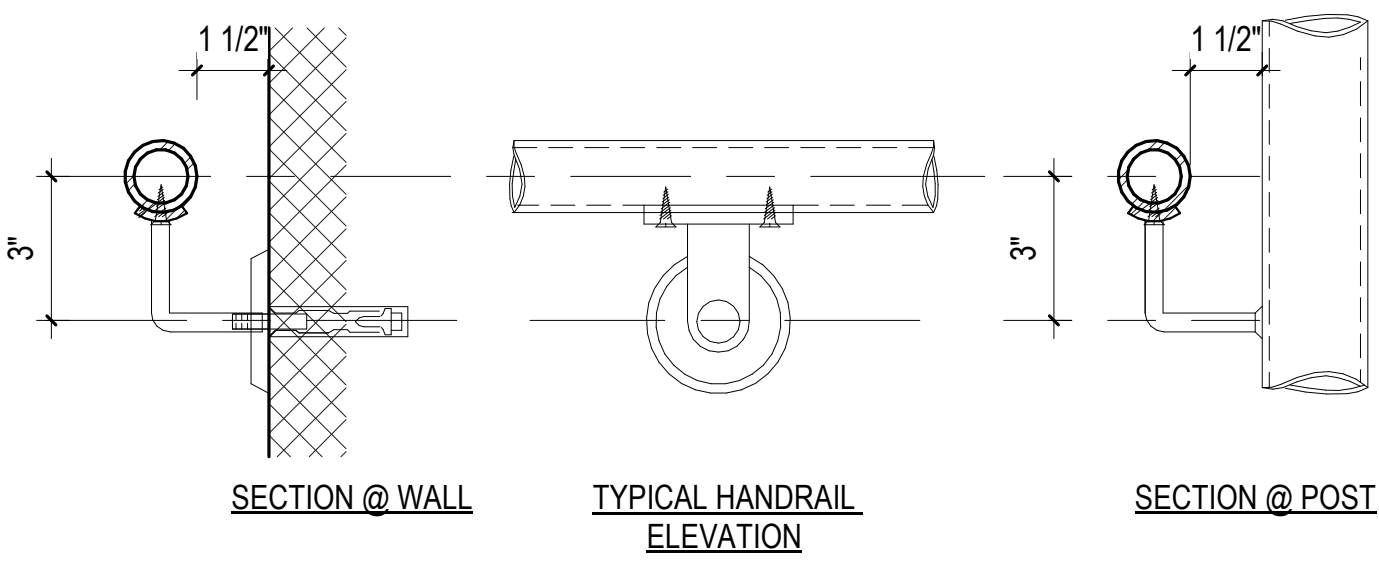


D4 TYPICAL HANDRAIL
3" = 1'-0"

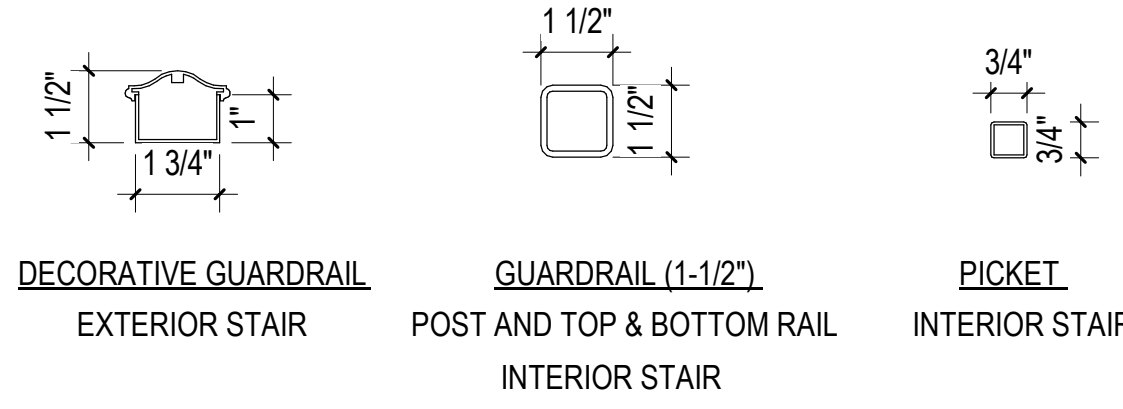


D3 TYPICAL HAND/GUARDRAIL PROFILES
3" = 1'-0"

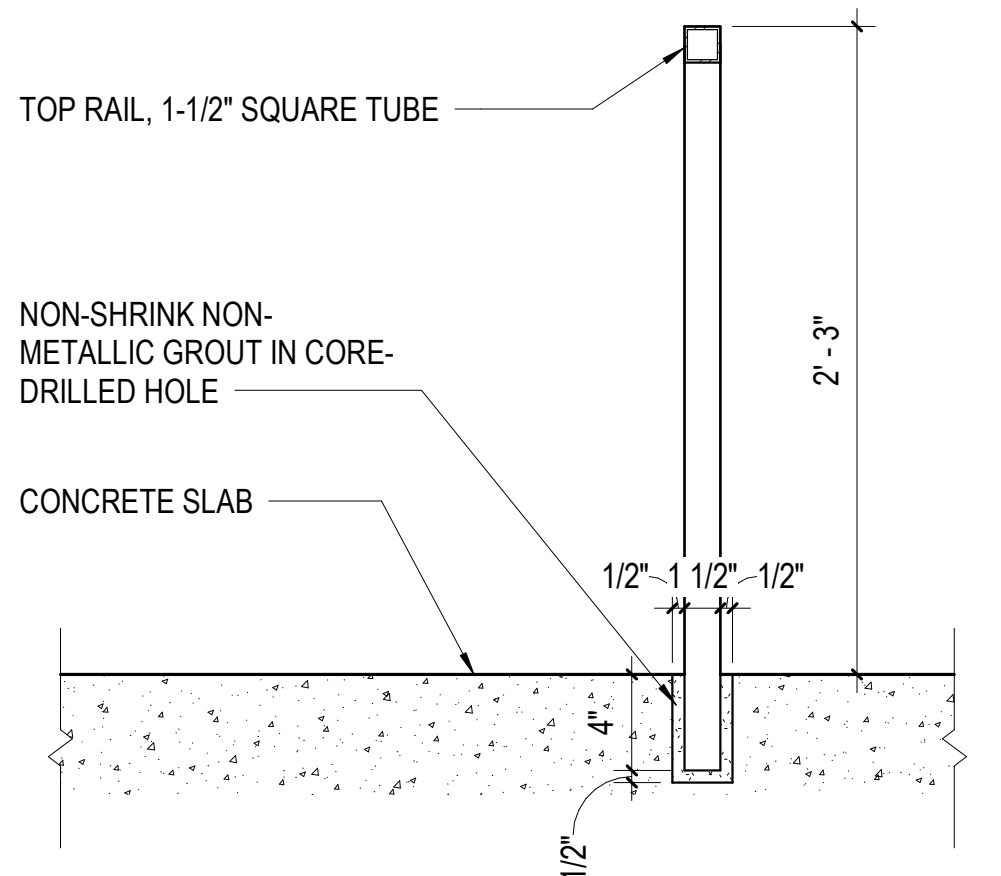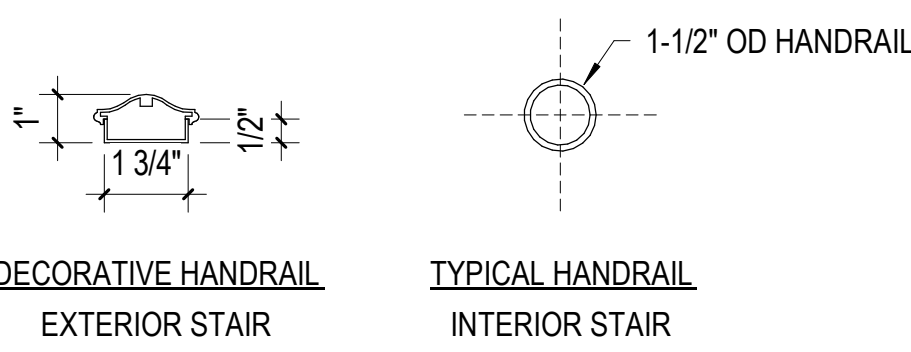


D1 DETAIL - TYPICAL CANE DETECTION RAIL
1 1/2" = 1'-0"

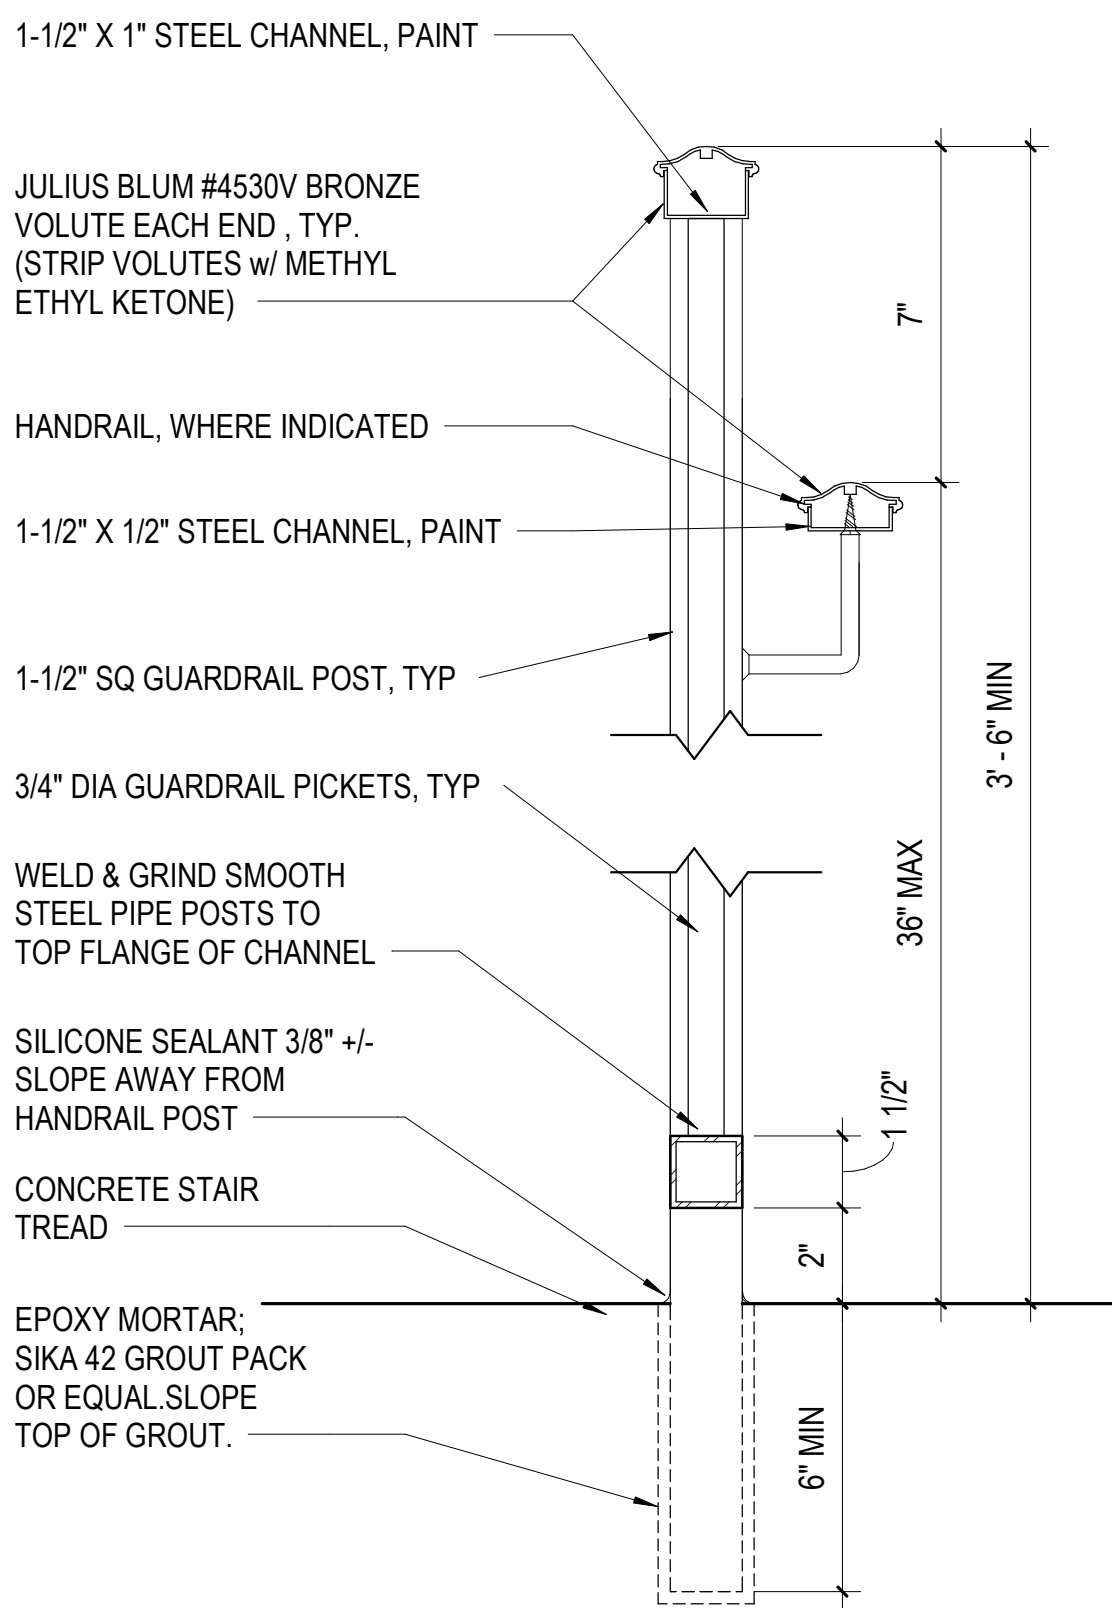


A6 TYPGUARDRAIL & HANDRAIL - EXTERIOR STAIR
3" = 1'-0"

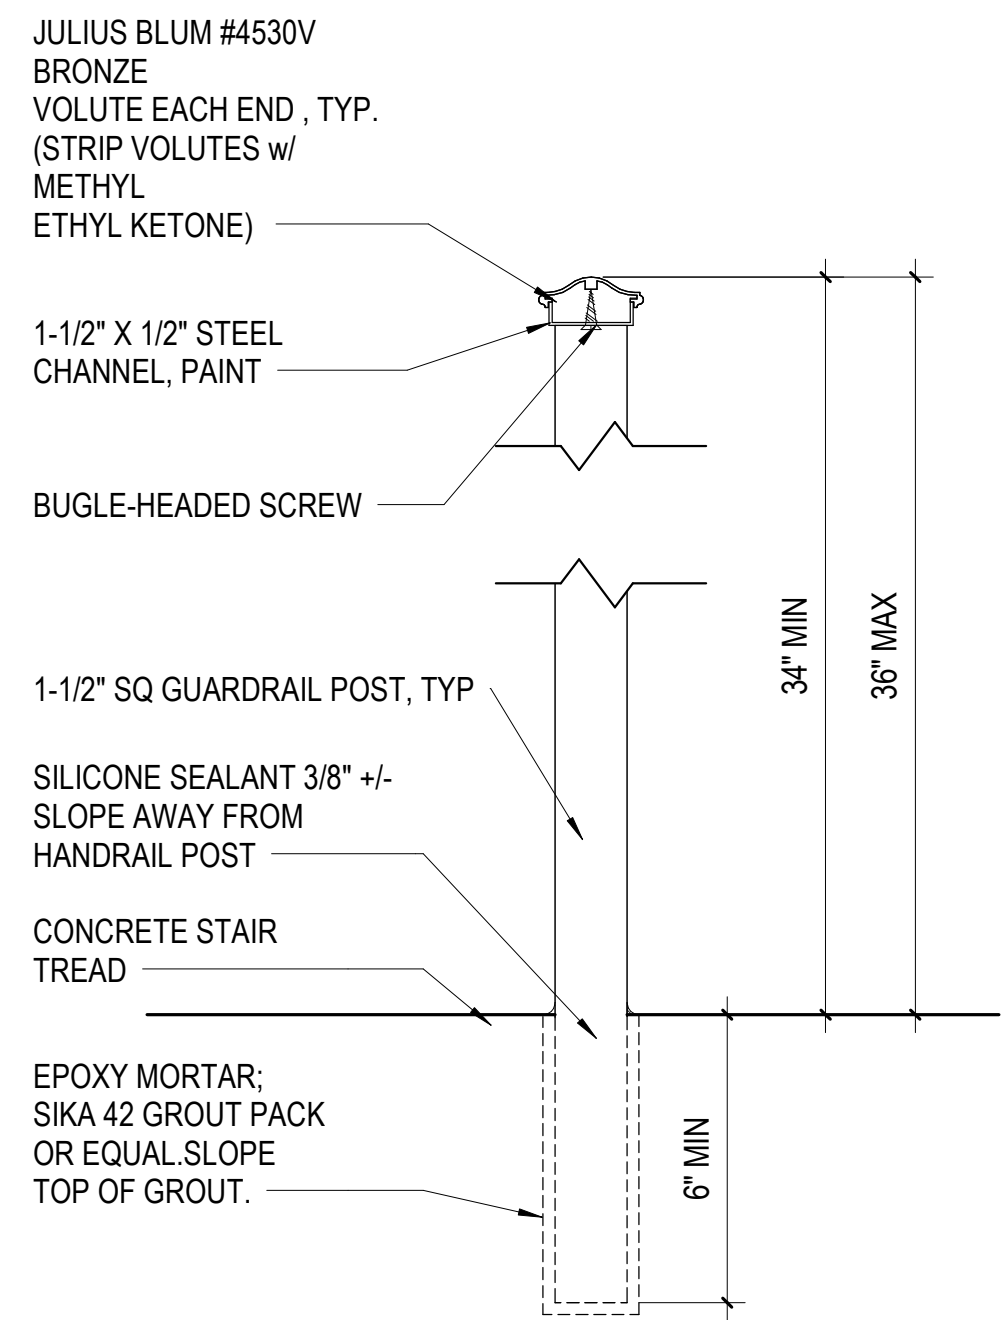


A5 TYPICAL HANDRAIL - EXTERIOR STAIR
3" = 1'-0"

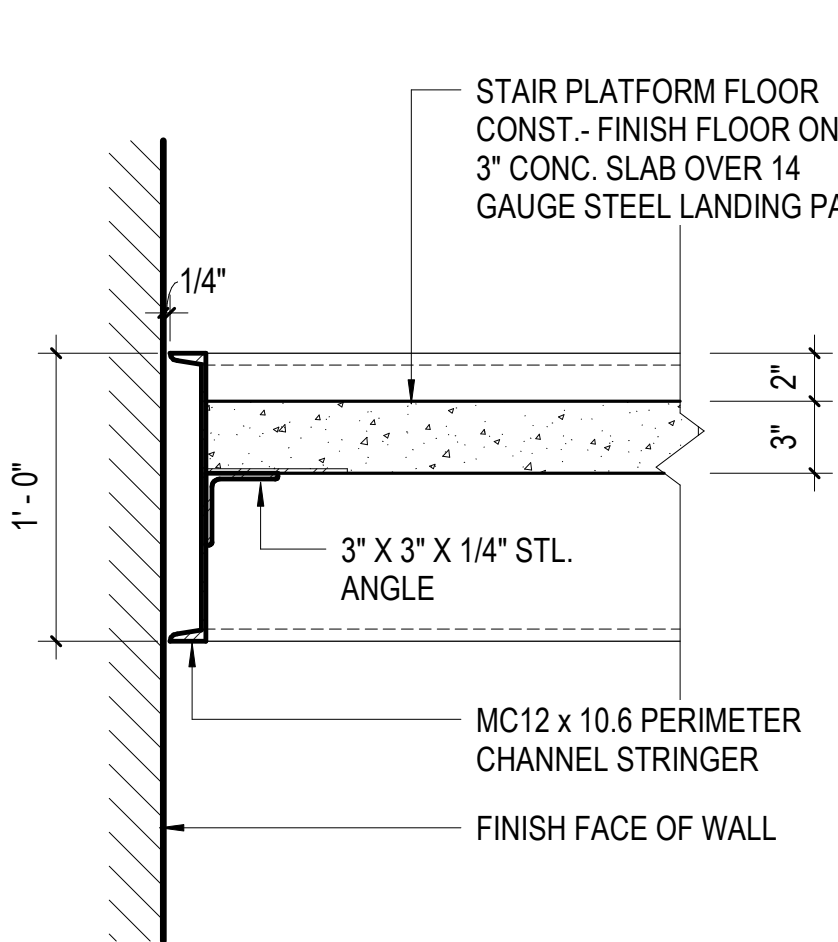


B4 STAIR - TYPICAL@ LANDING
1 1/2" = 1'-0"

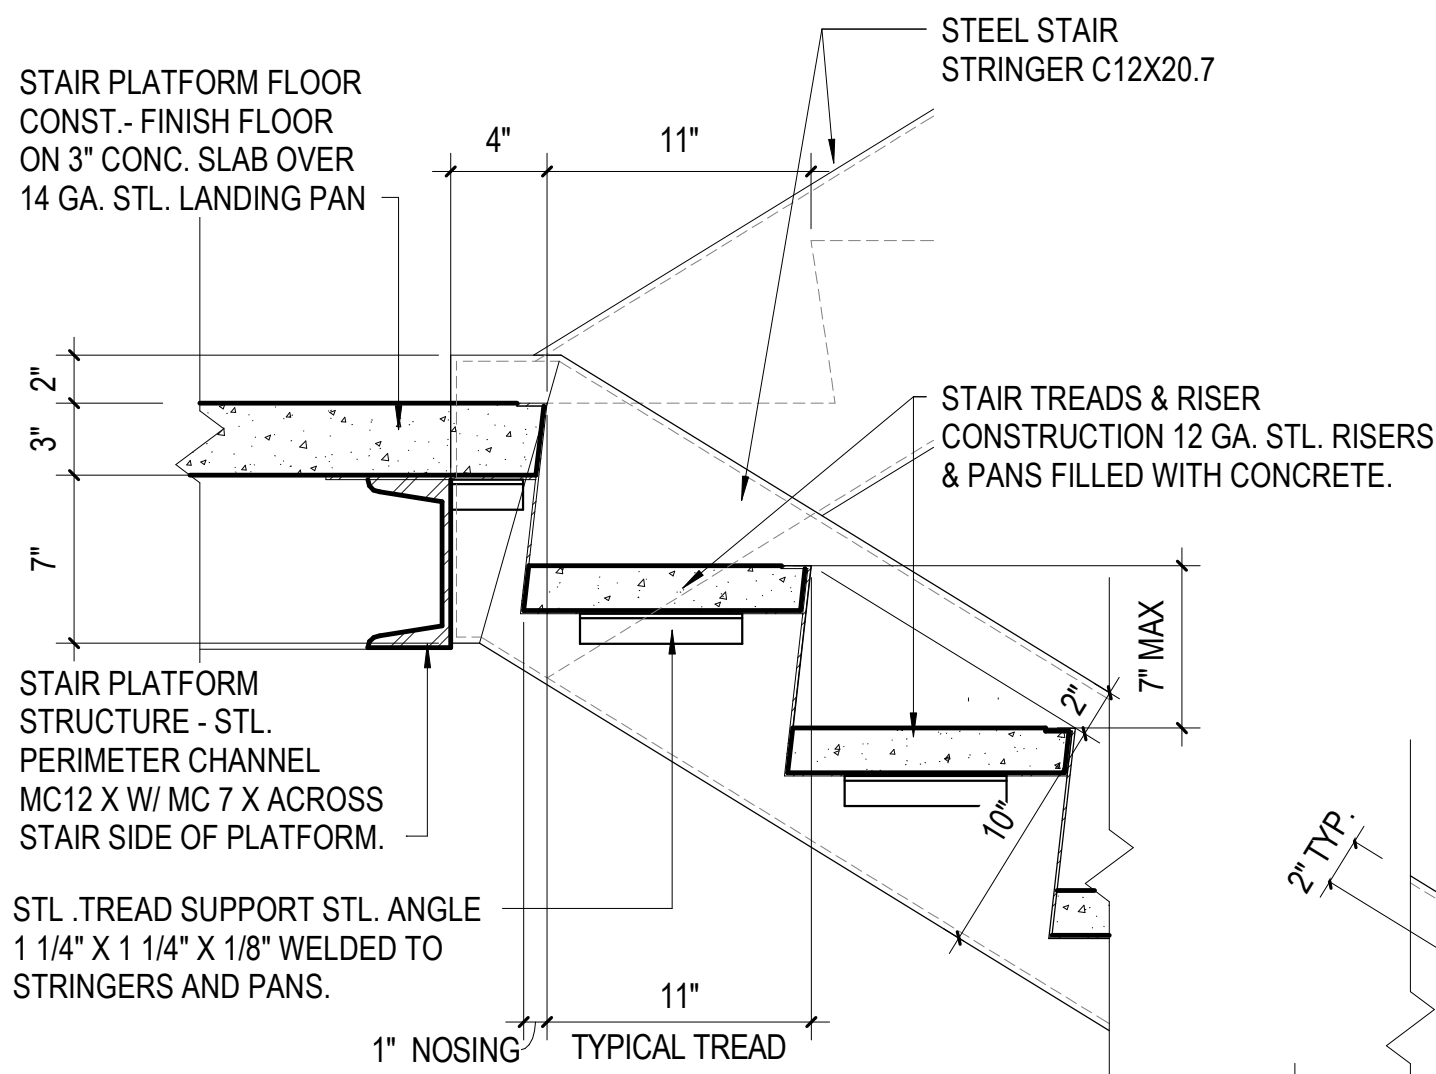


B3 STAIR - TREAD / RISER @ LANDING
1 1/2" = 1'-0"

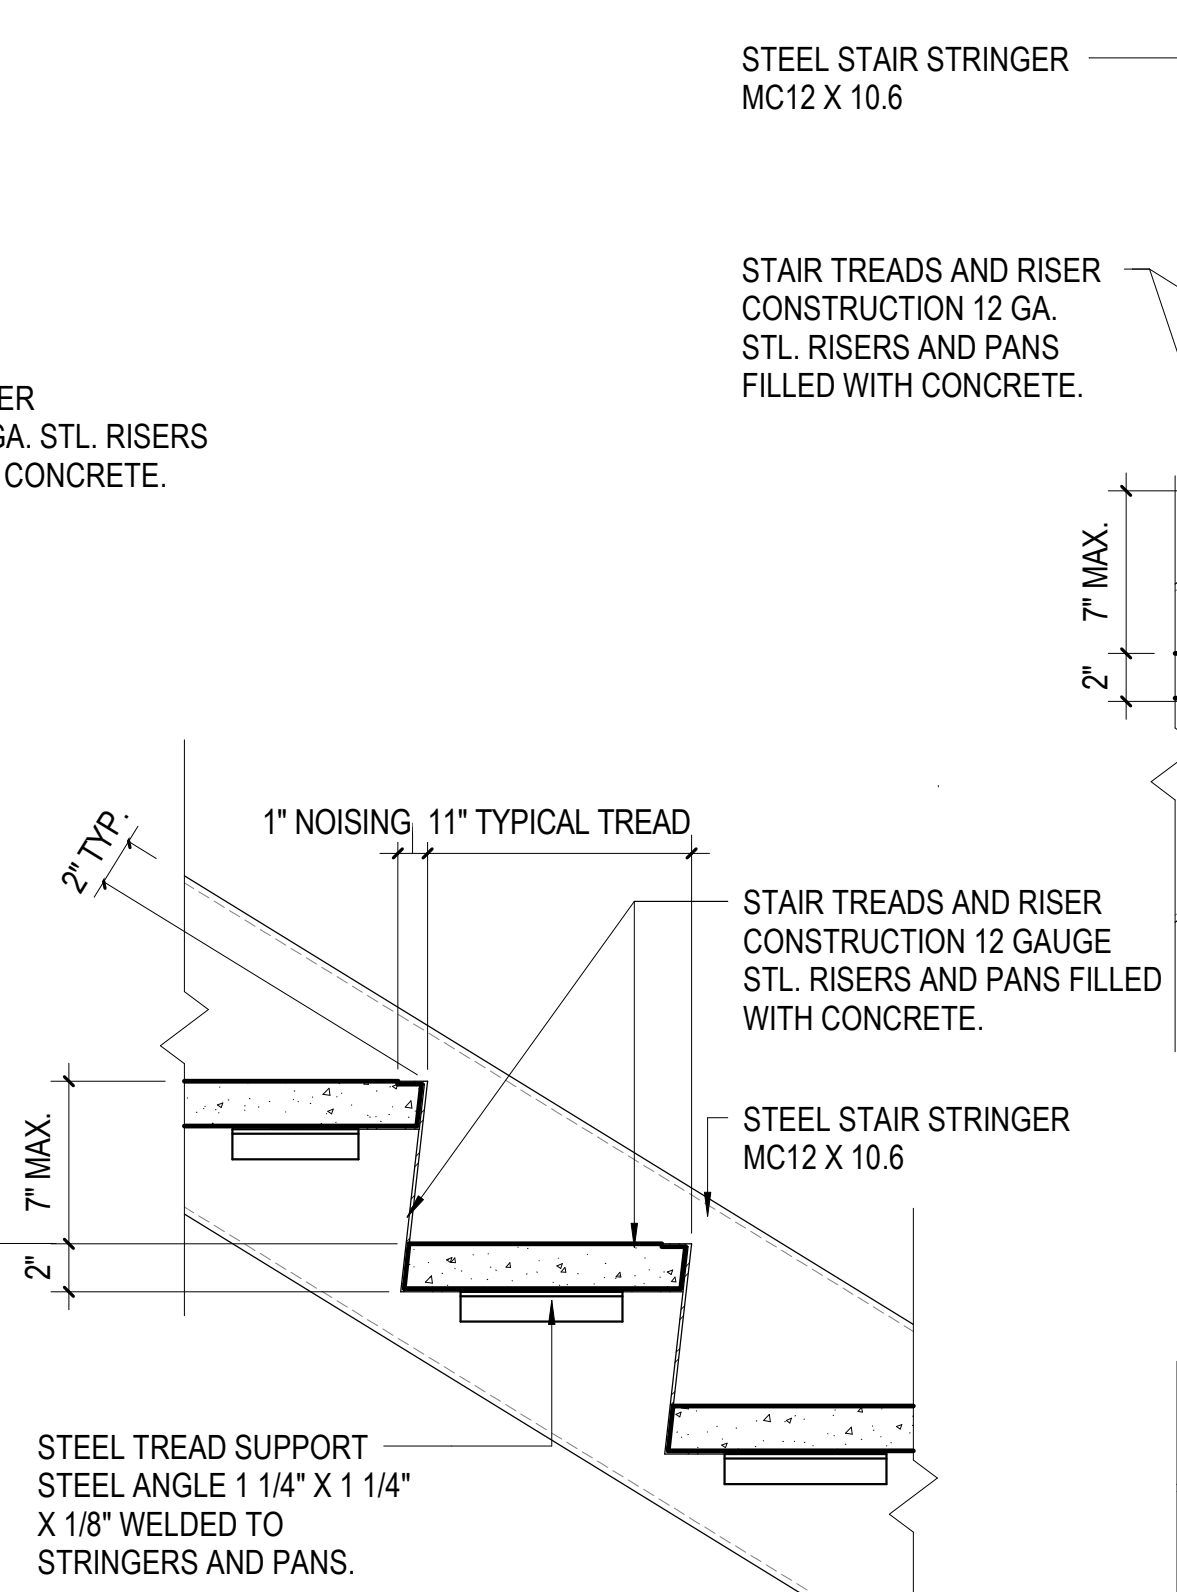


A2 STAIR - TREAD / RISER - TYPICAL
1 1/2" = 1'-0"

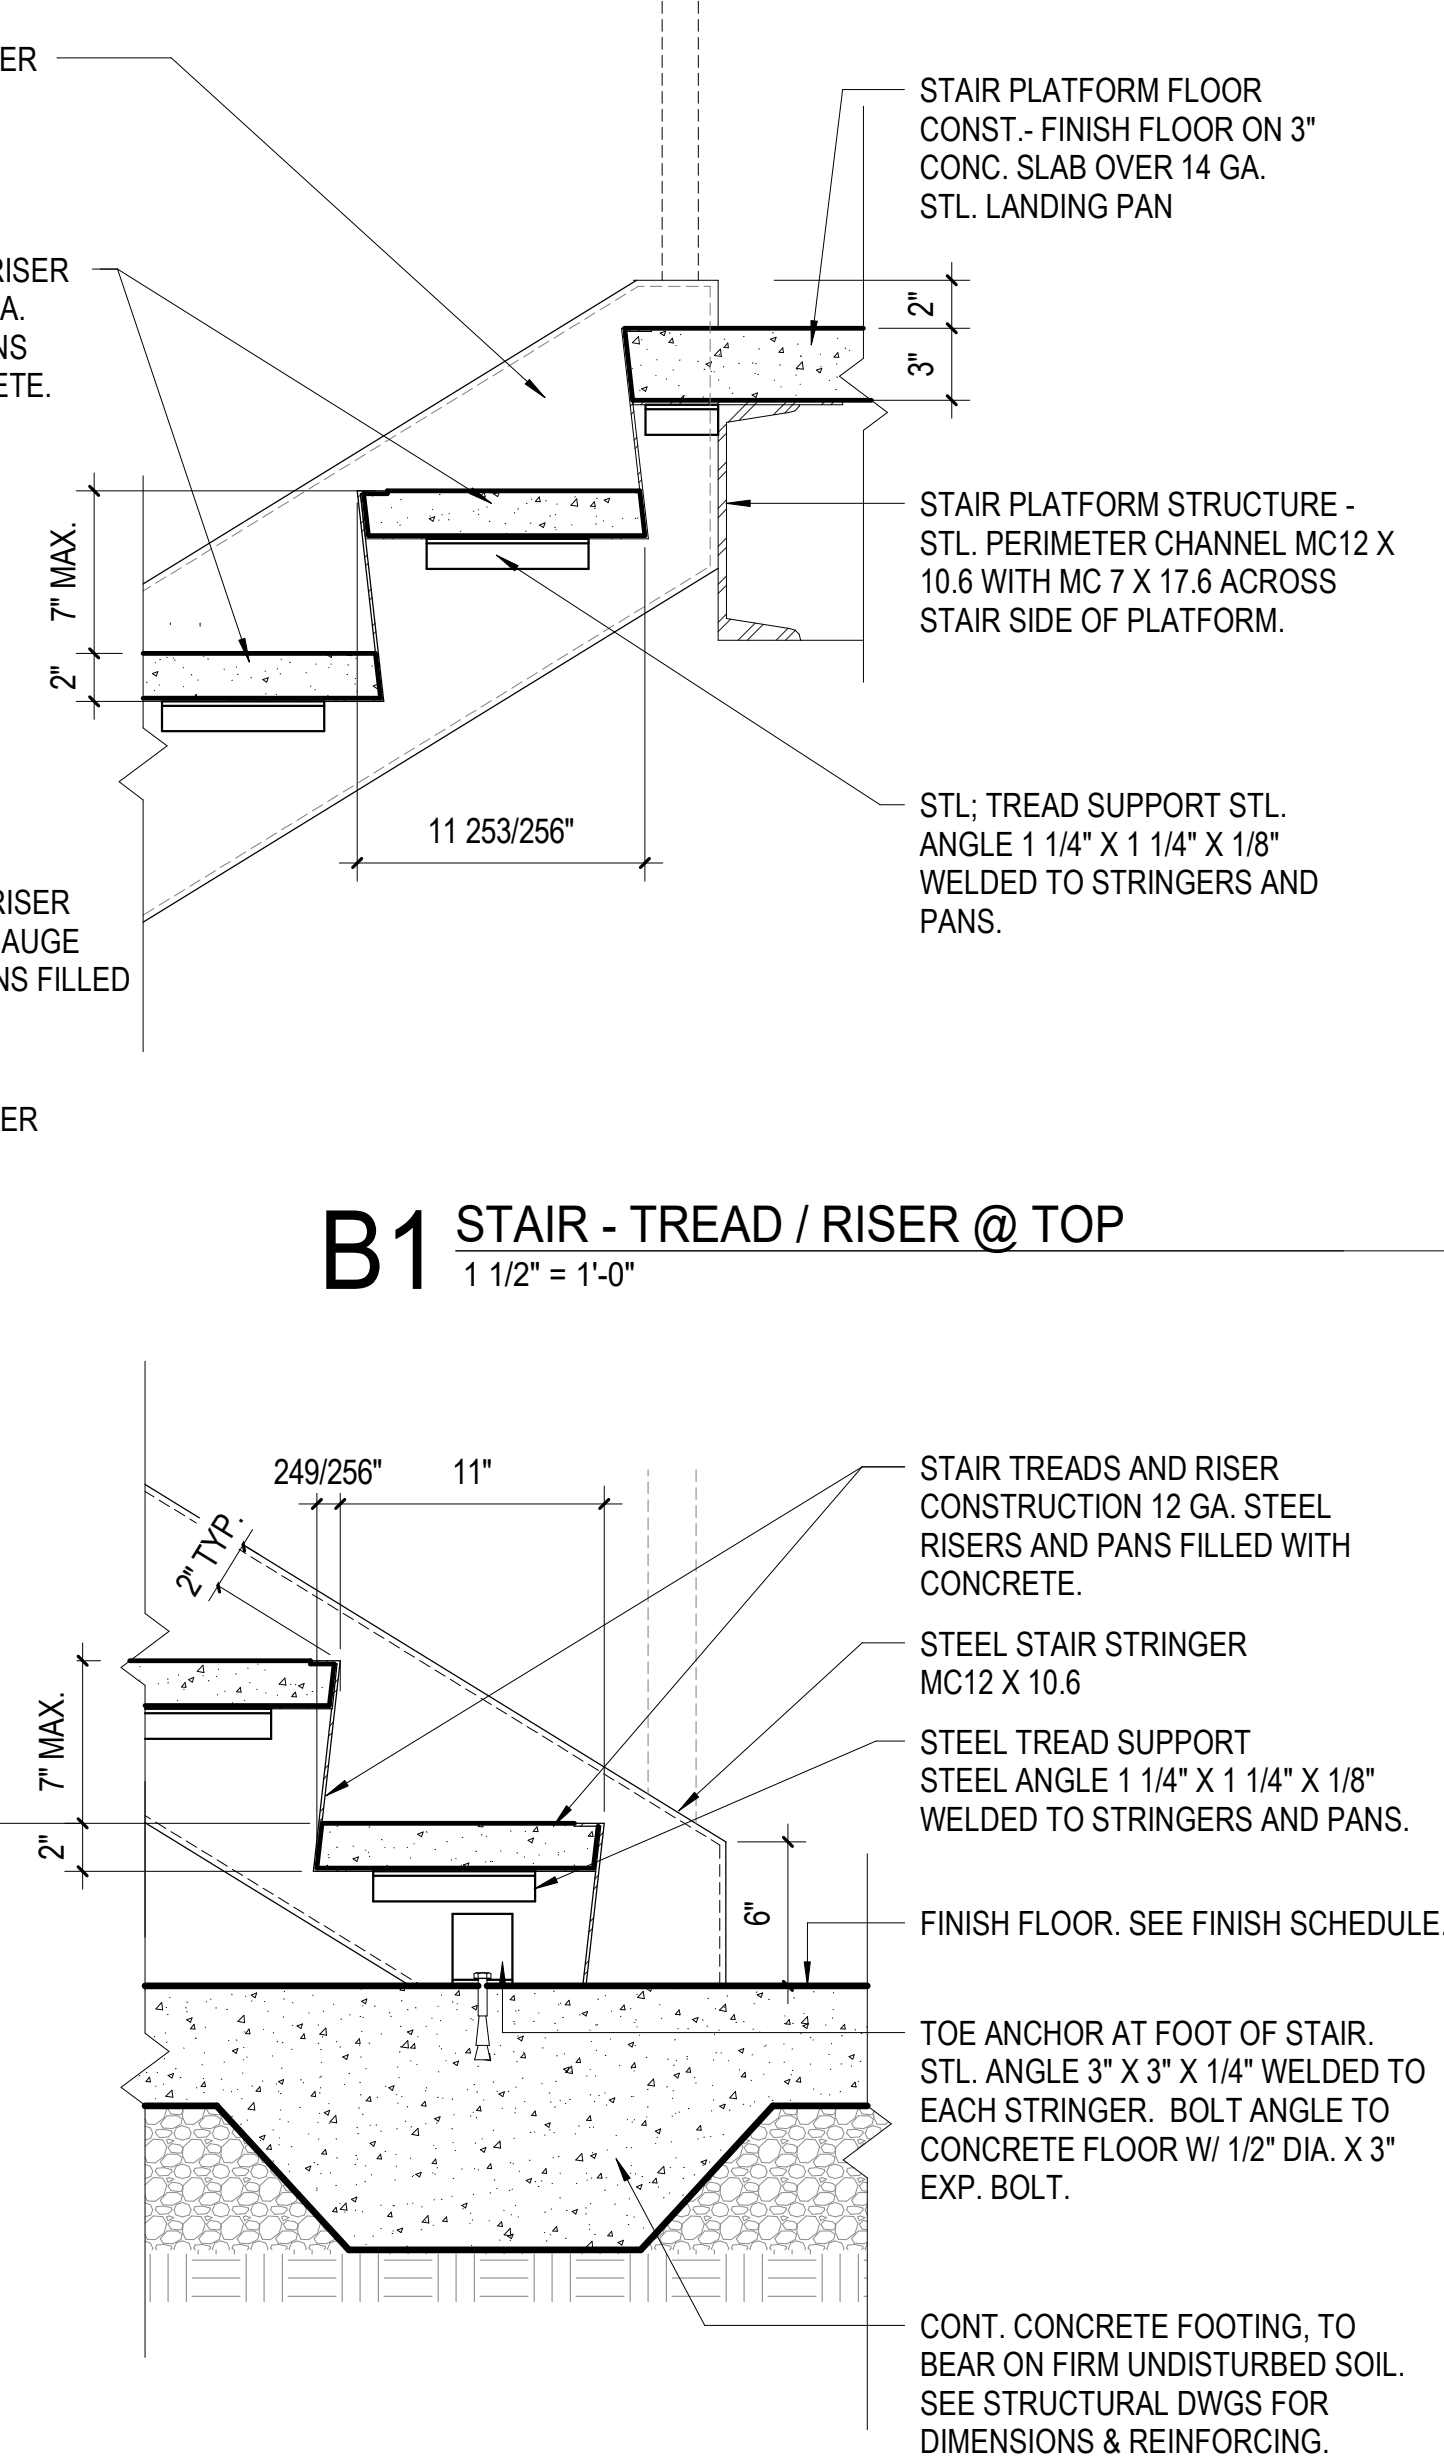


B1 STAIR - TREAD / RISER @ TOP
1 1/2" = 1'-0"

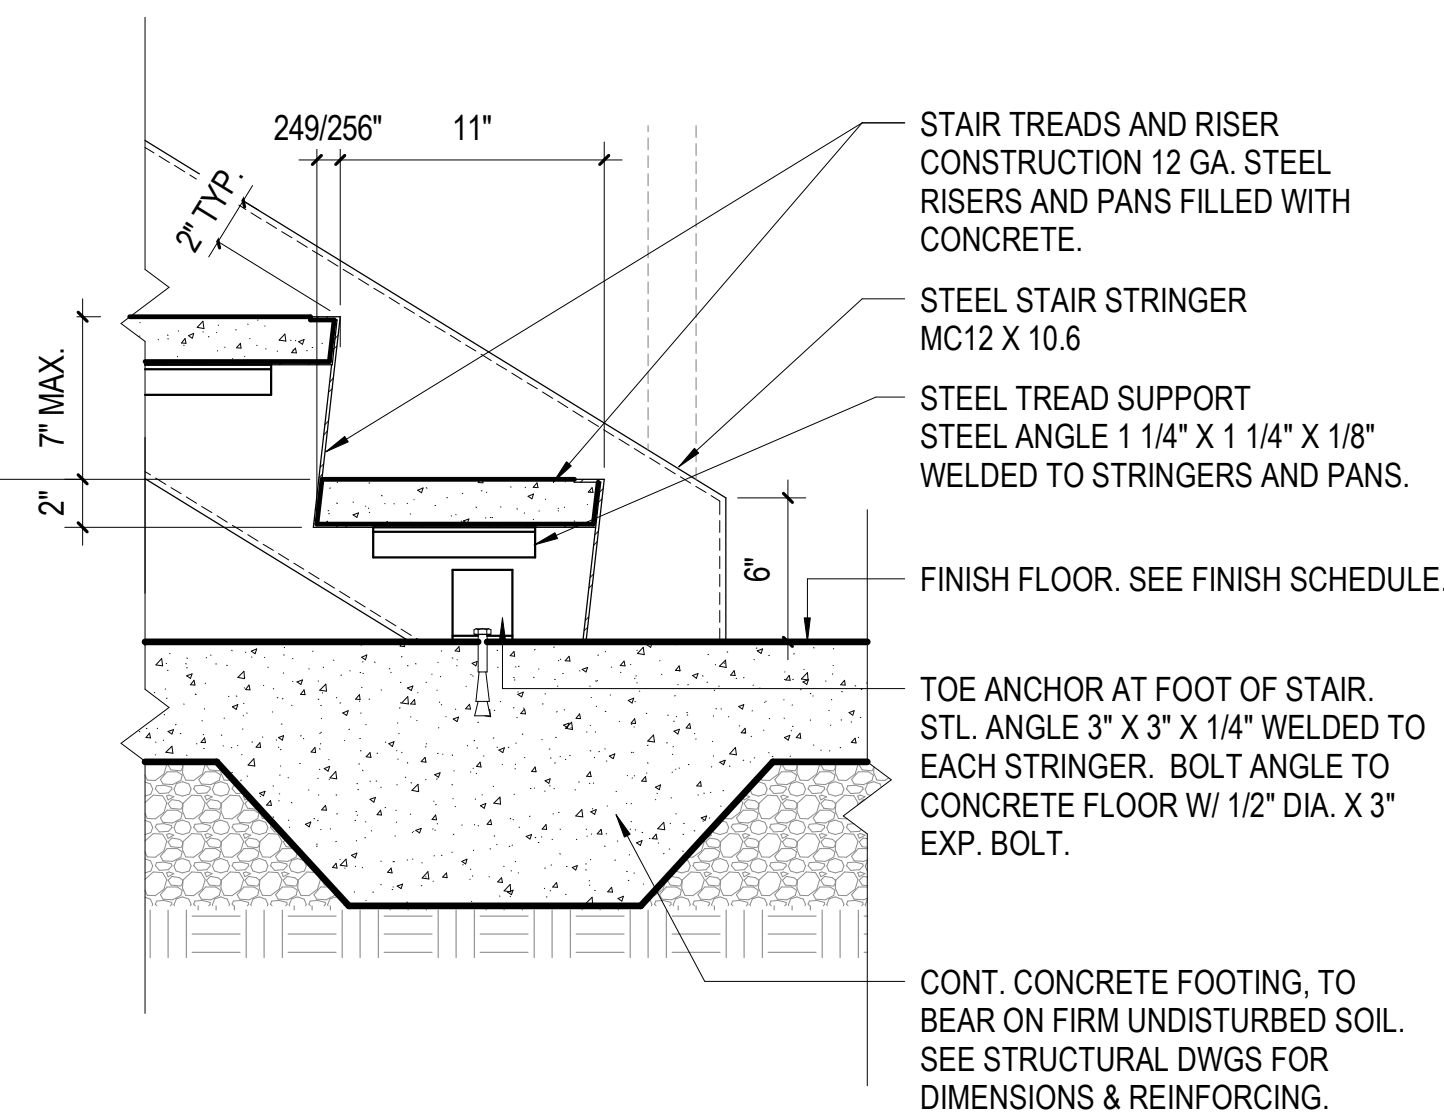


A1 STAIR - TREAD / RISER @ BOTTOM
1 1/2" = 1'-0"

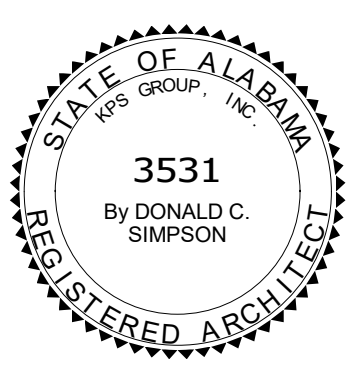


PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
STAIR DETAILS		
DRAWN BY: Author		
CHECKED BY: Checker		
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A4.30		

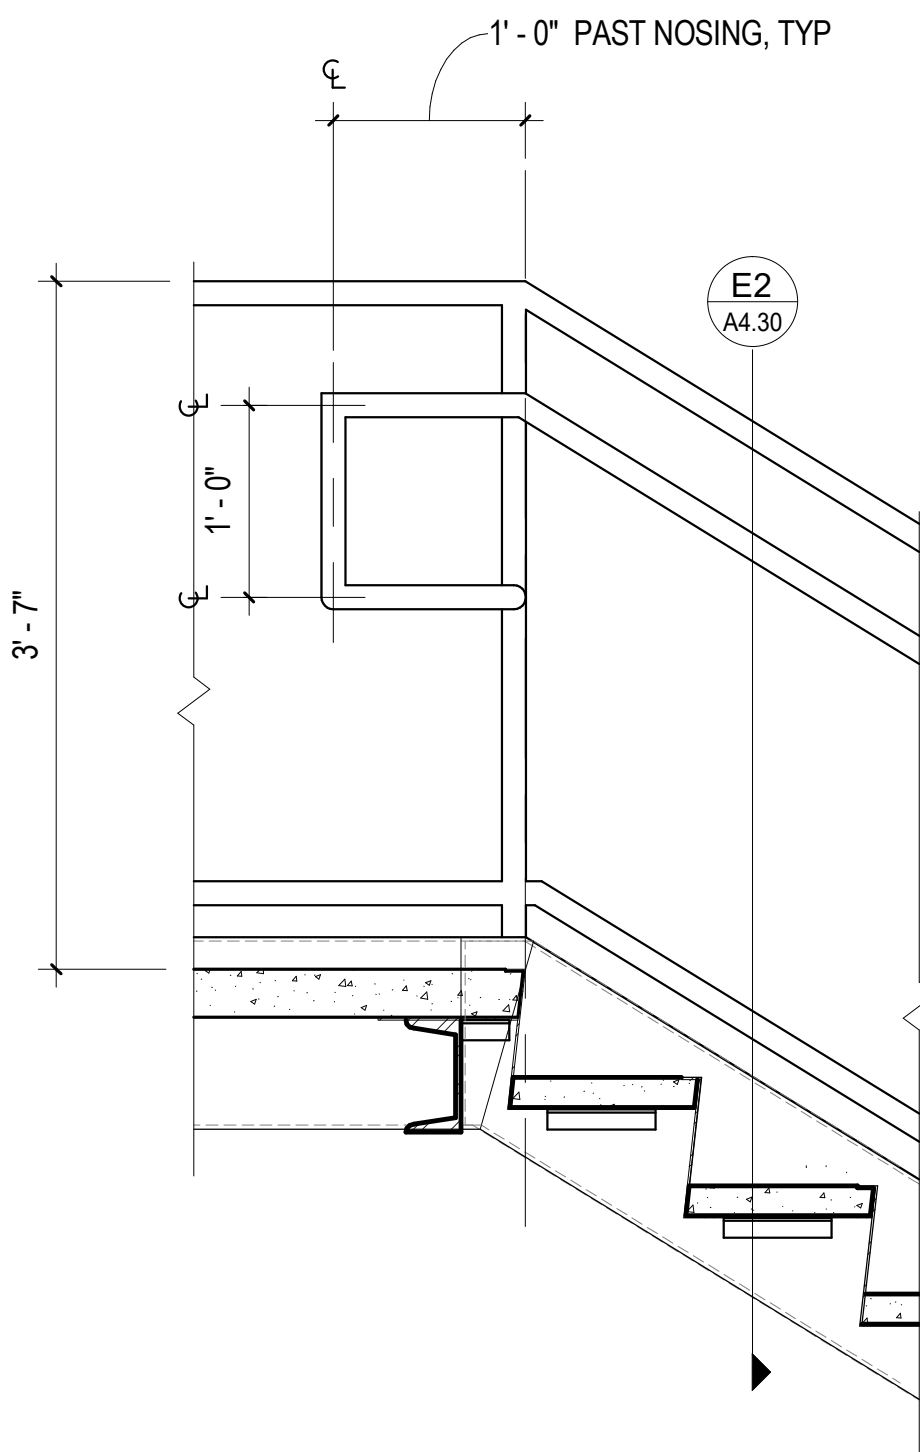


A5 TOP OF STAIR HANDRAIL END
1" = 1'-0"

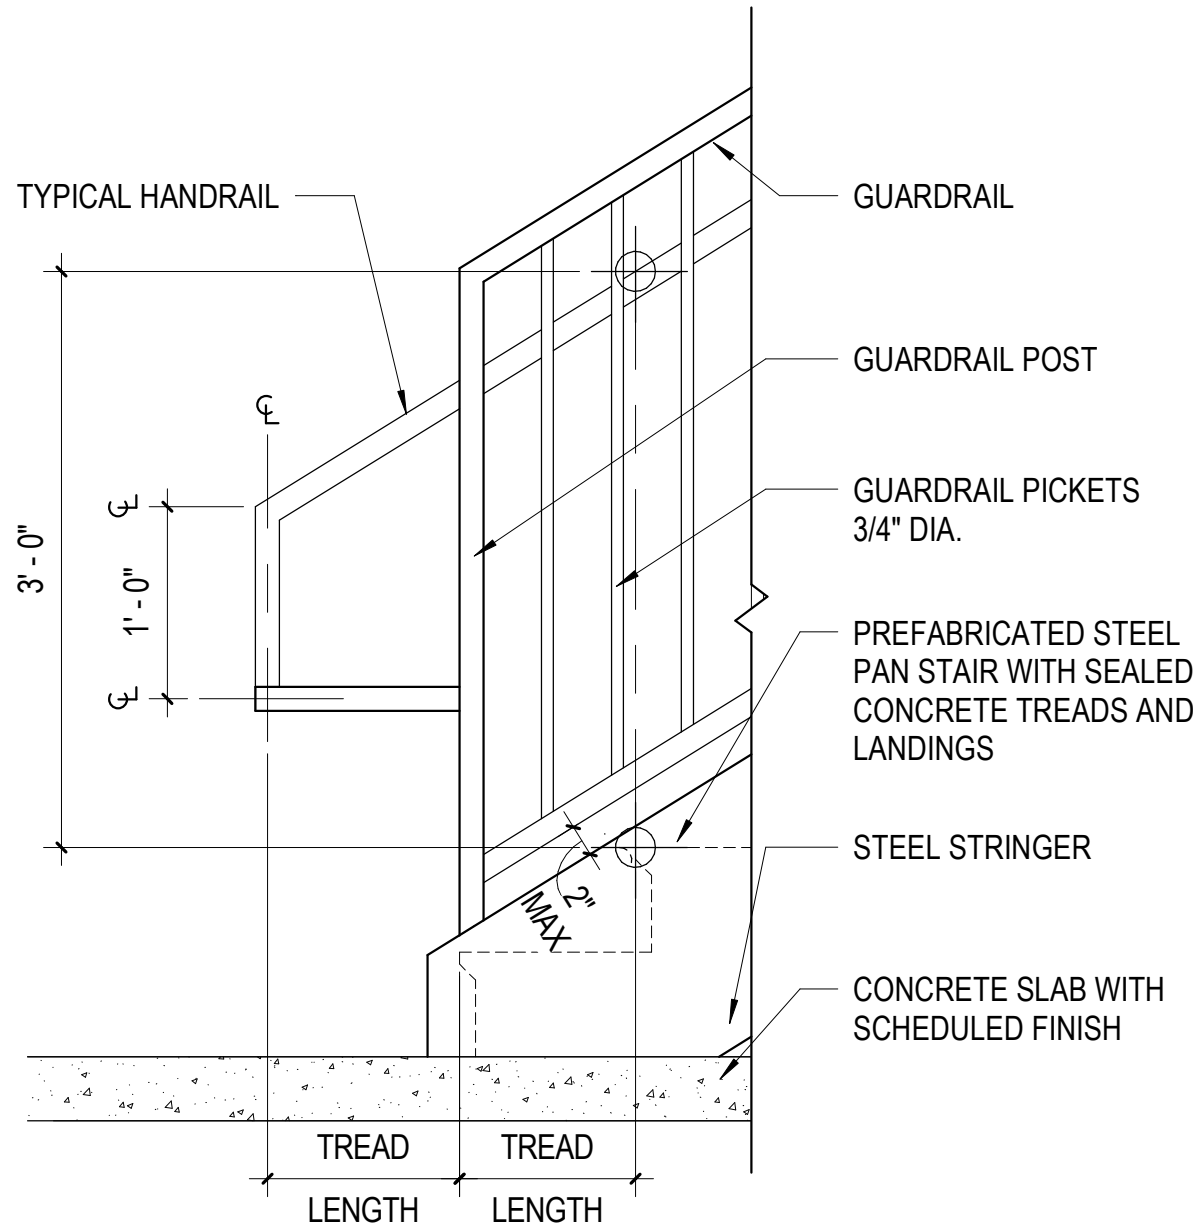


A4 BOTTOM OF STAIR HANDRAIL END
1" = 1'-0"

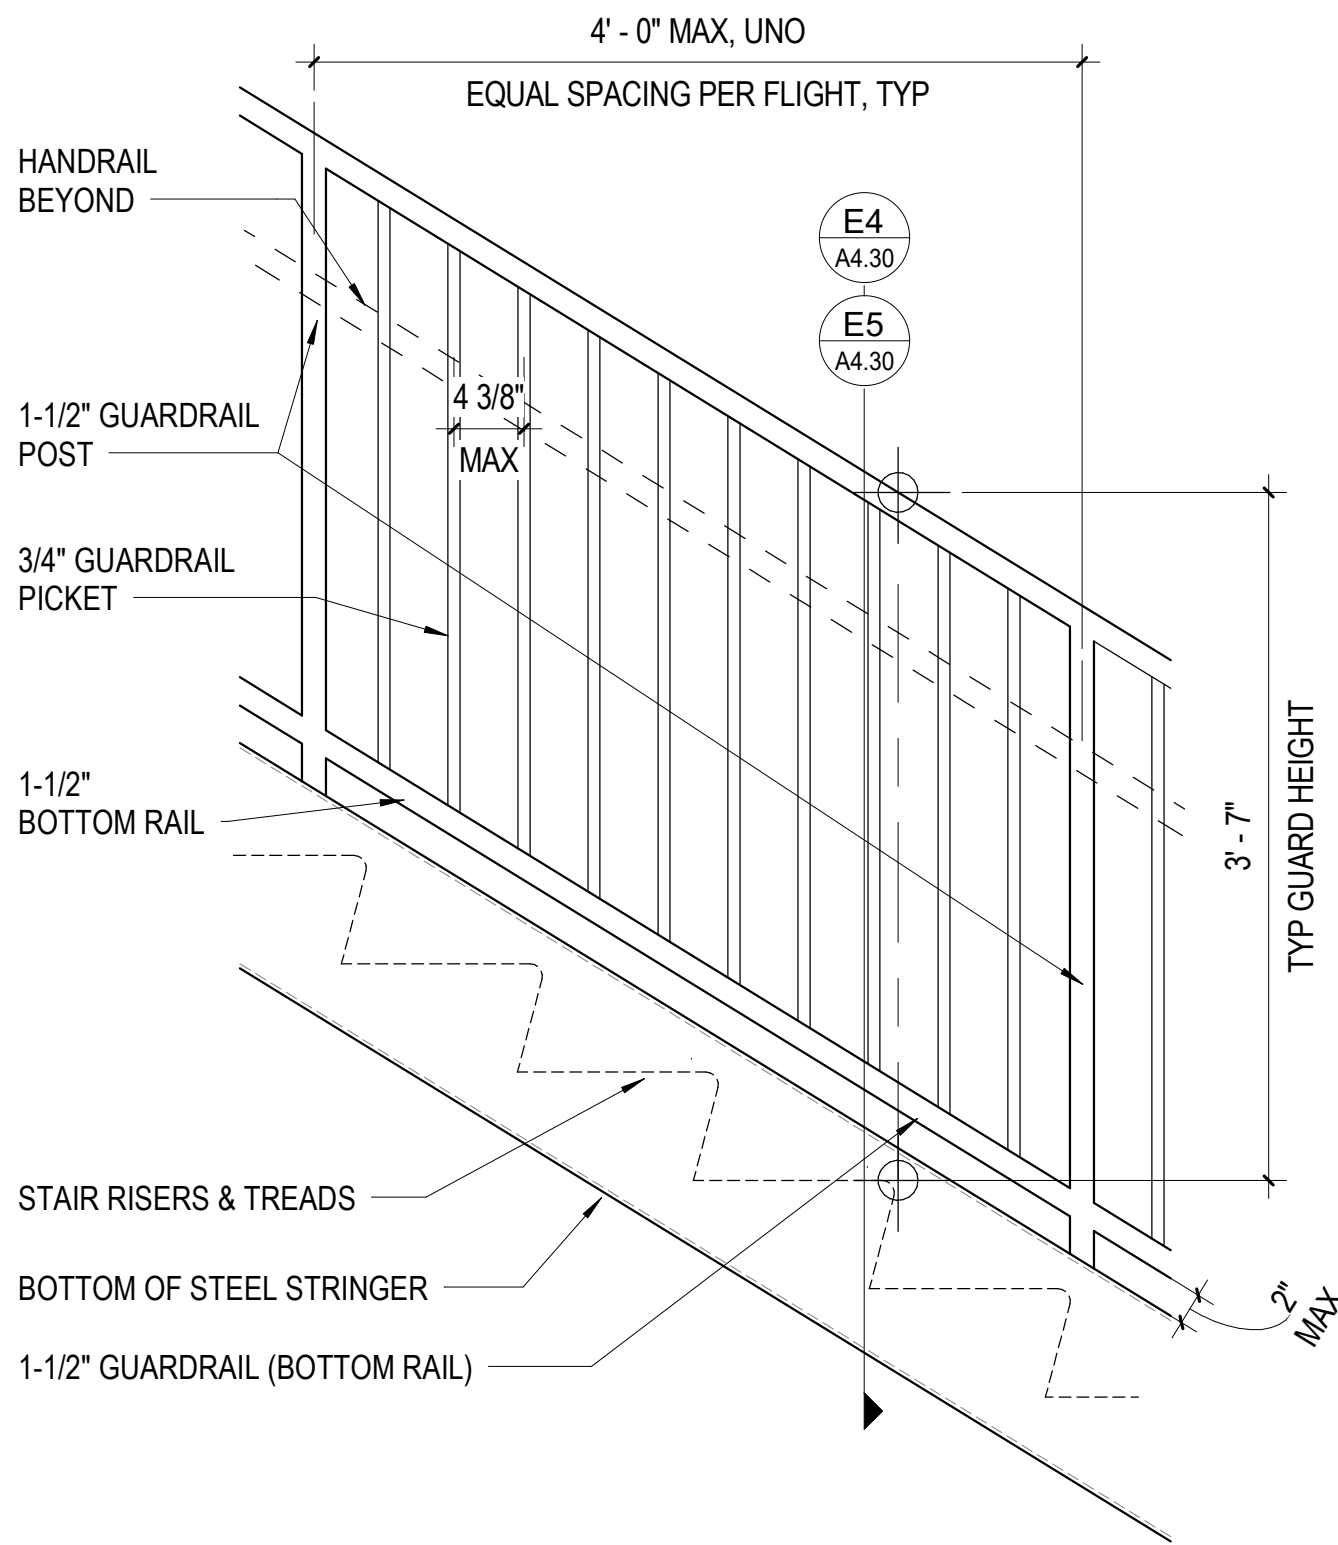

A3 TYPICAL RAILING/POST SPACING
1" = 1'-0"

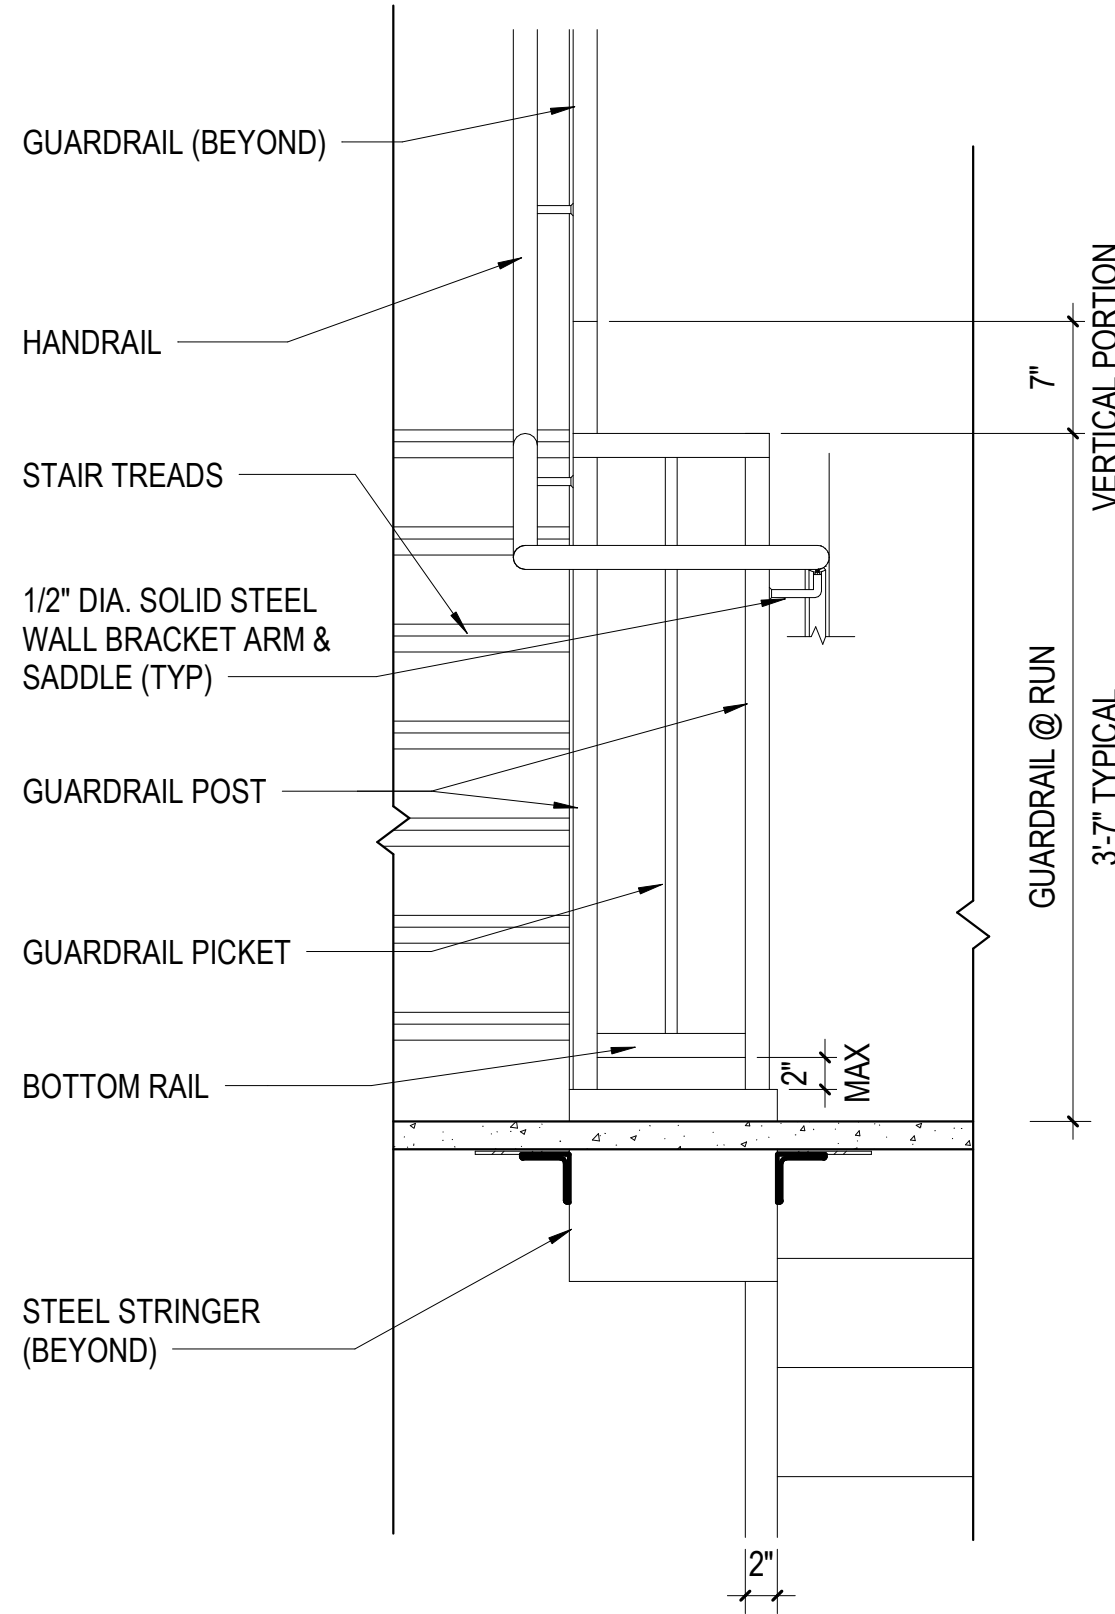

A1 WELDED HANDRAIL AT GUARDRAIL RETURN
1" = 1'-0"

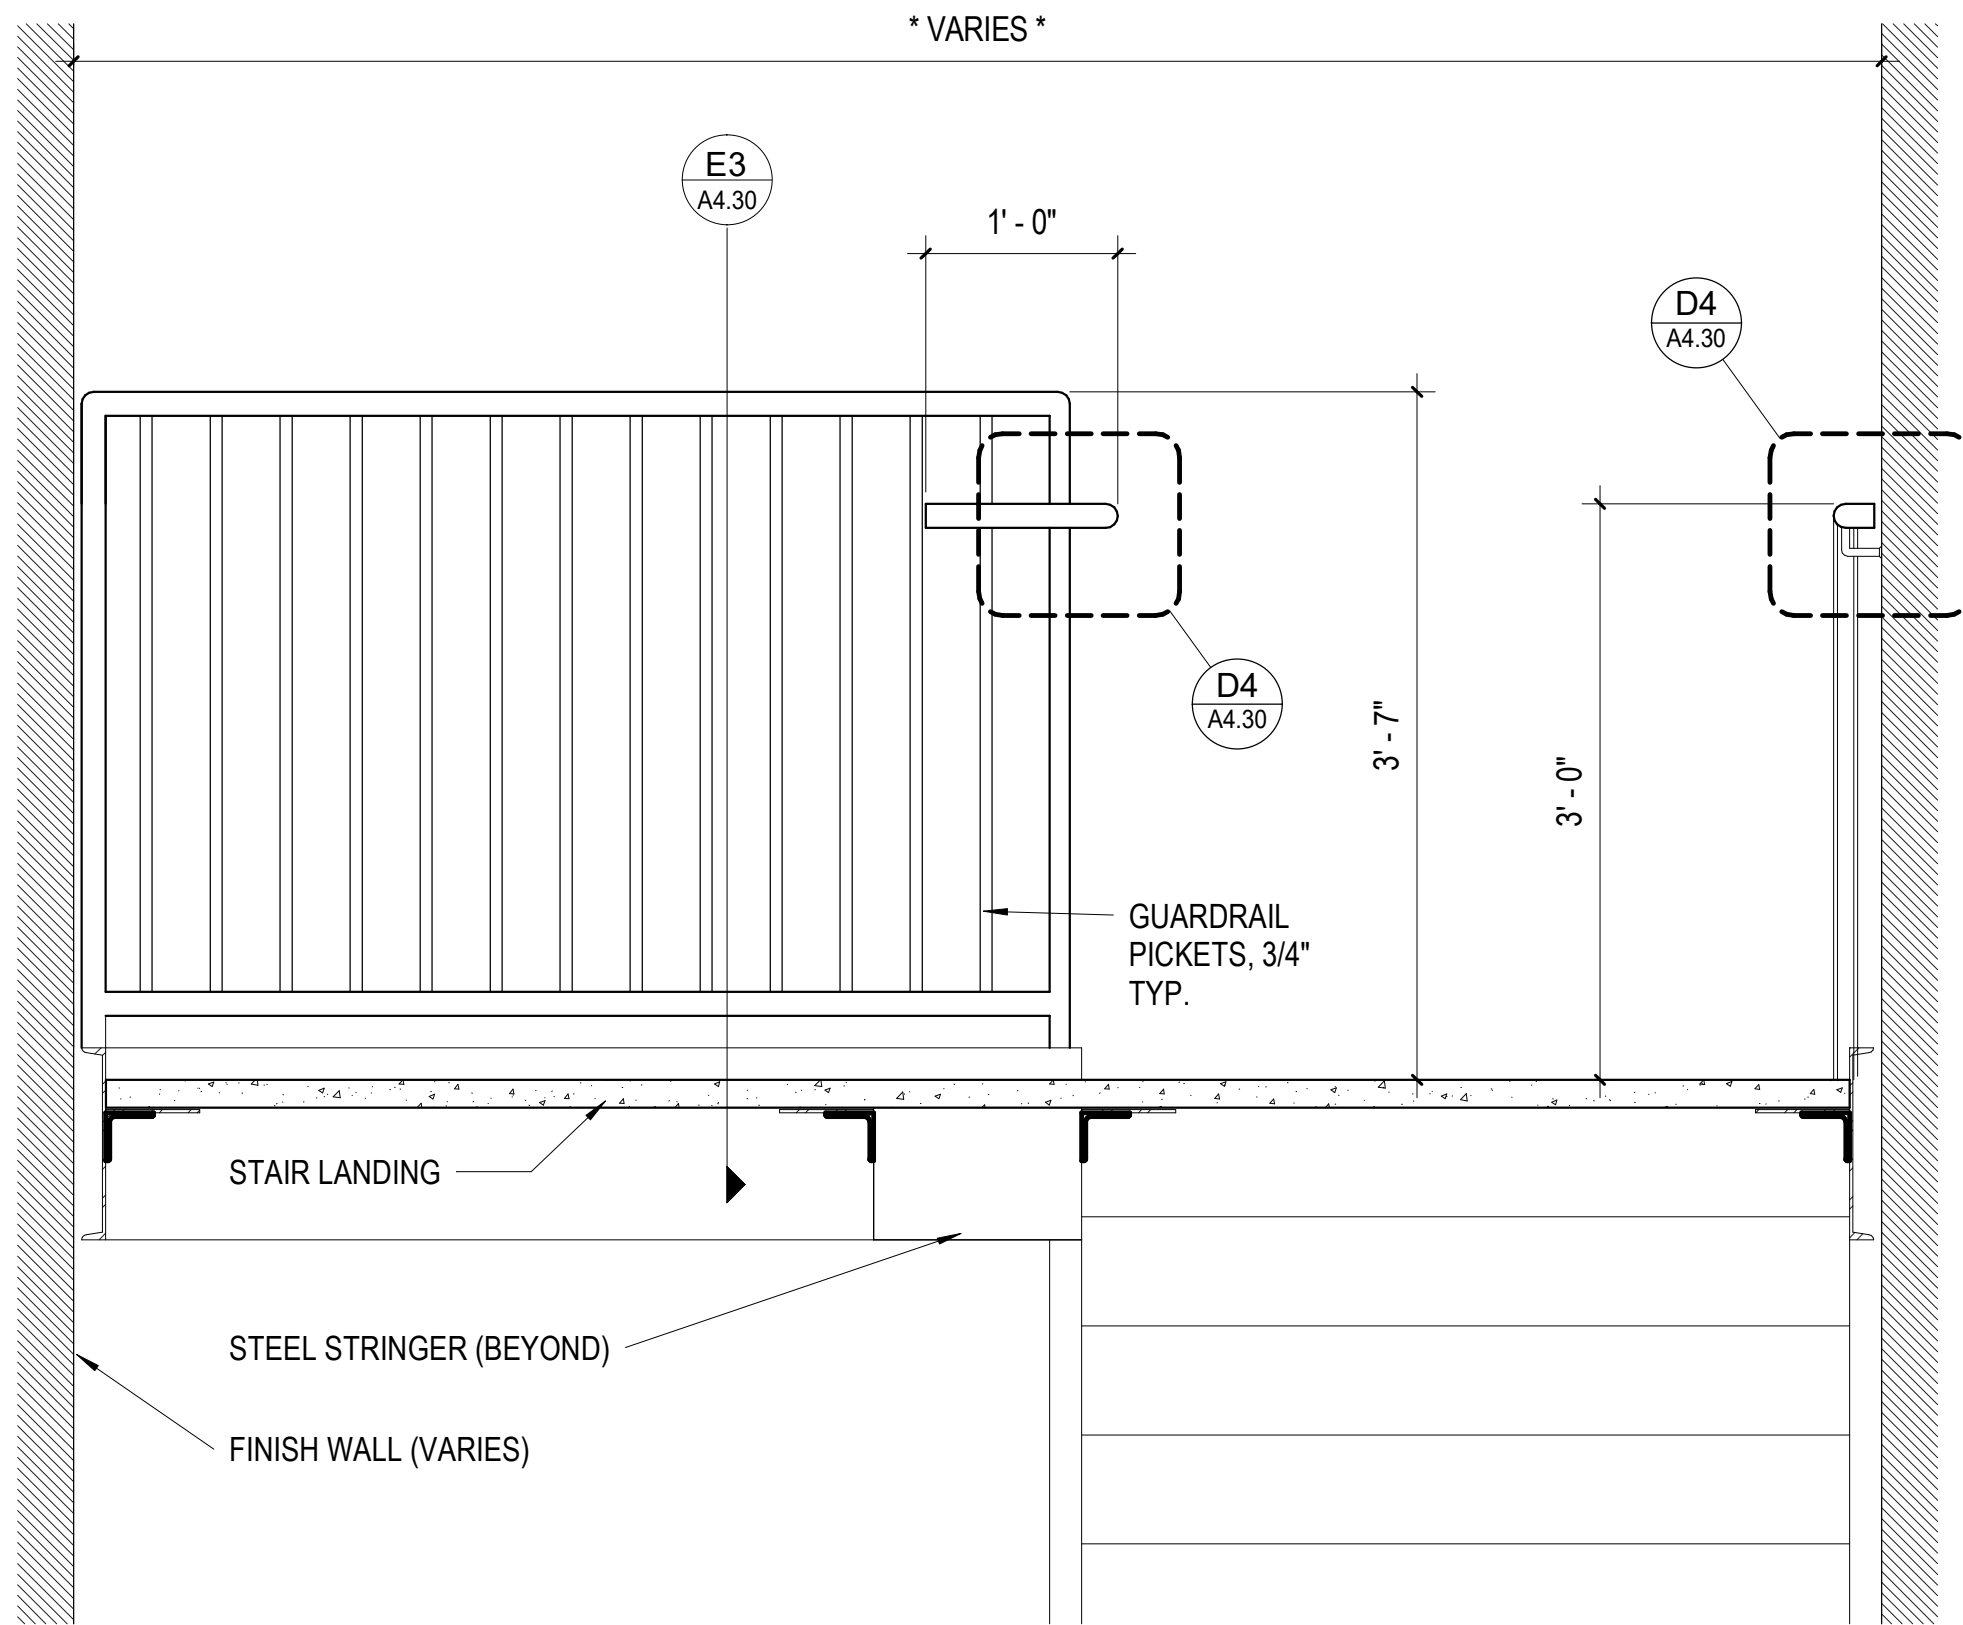

C1 DETAIL - TOP OF STAIR LANDING
1" = 1'-0"

K|P|S

G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
KPS GROUP, INC.
3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOING 2024B3
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

UNIVERSITY OF ALABAMA
1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE

STAIR DETAILS

DRAWN BY: Author


CHECKED BY: Checker

PROJECT NUMBER


236002-02

DRAWING NO.


A4.31

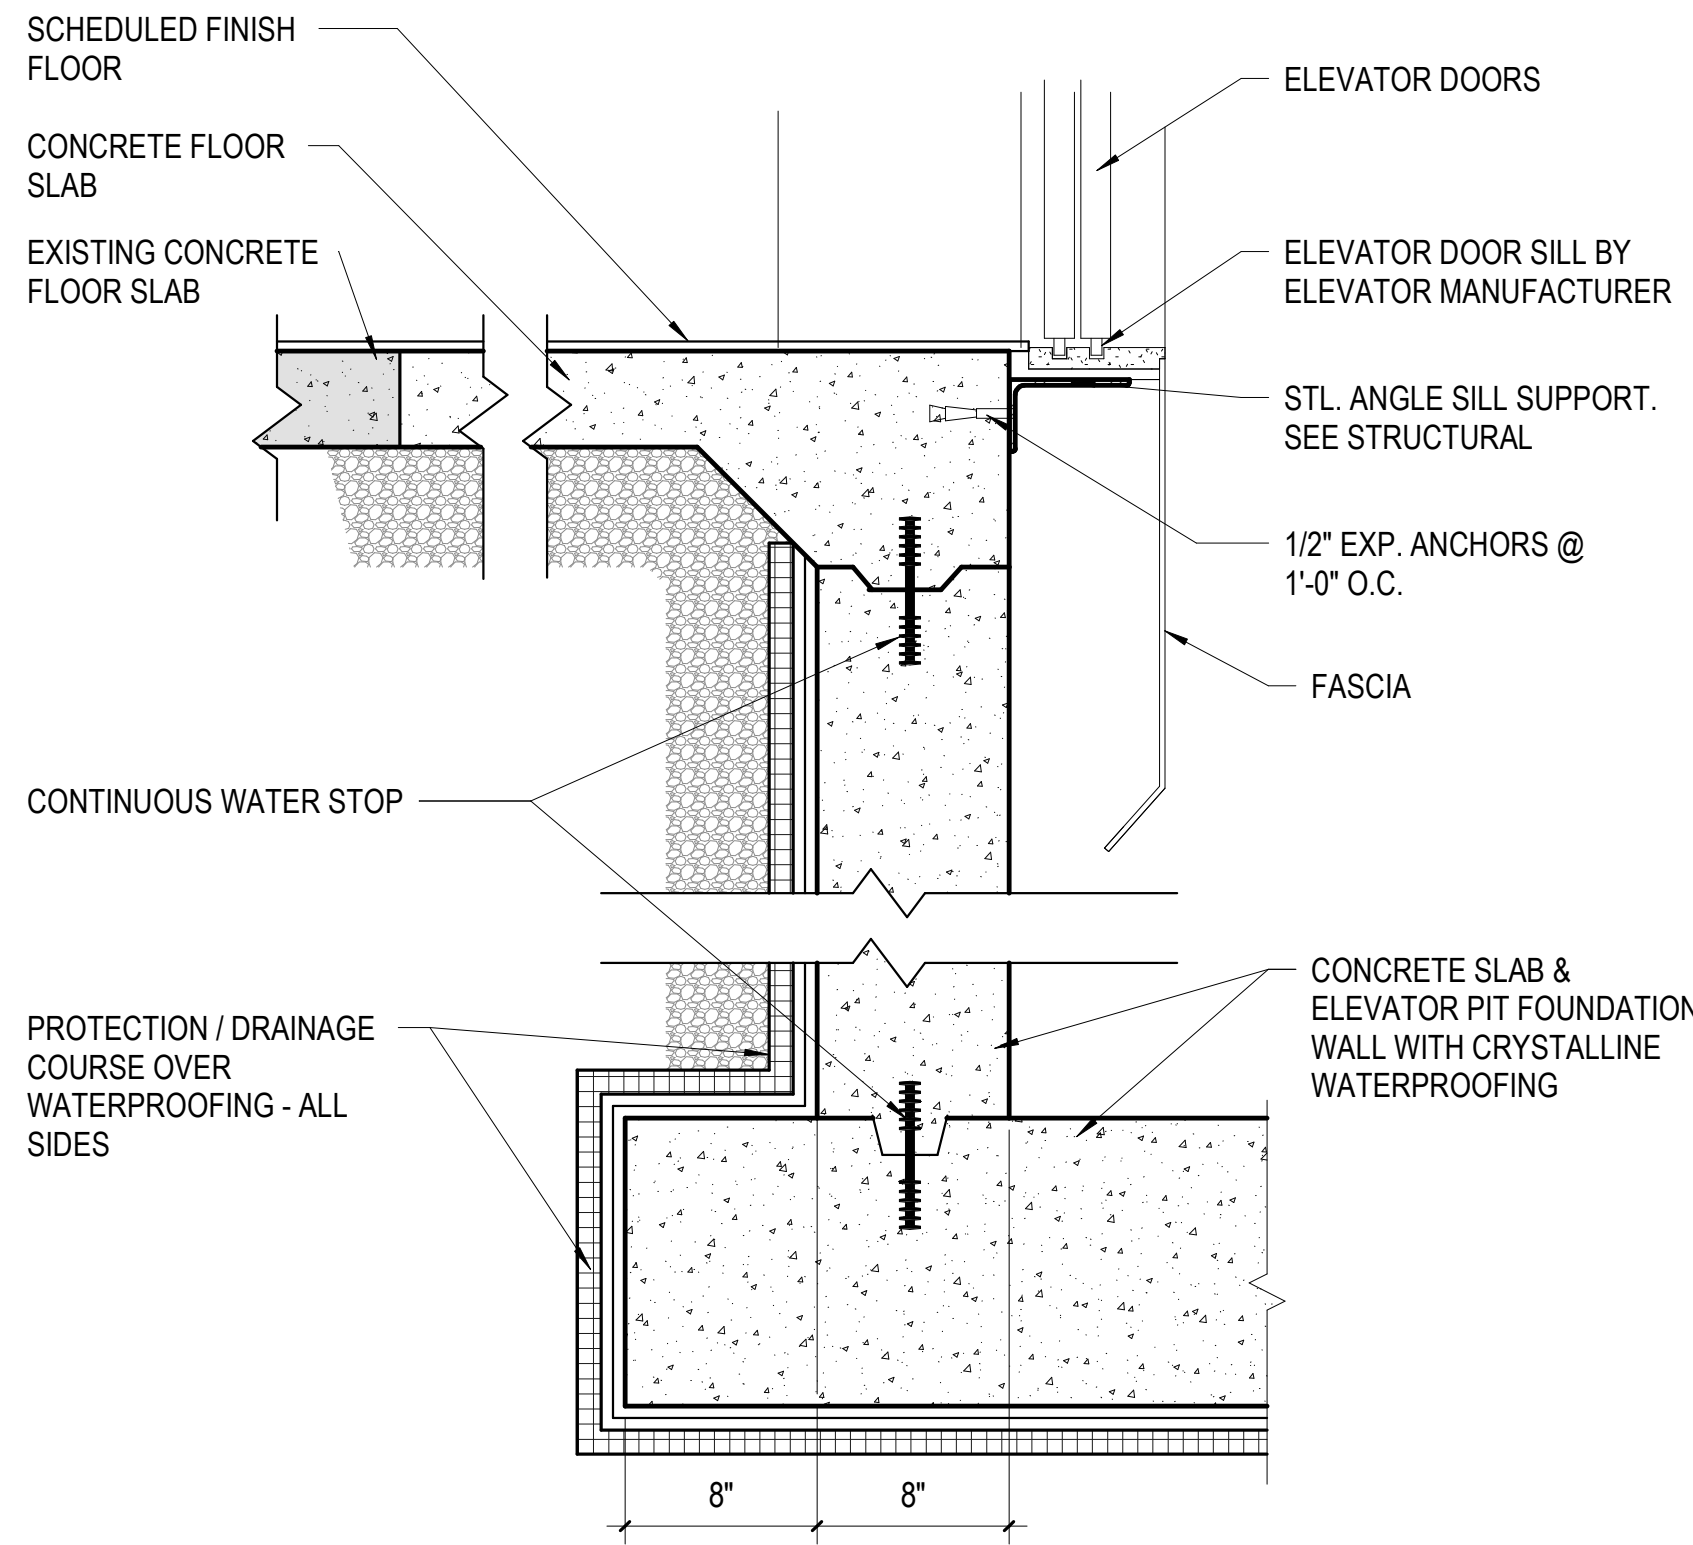


E5 ELEVATOR DOOR SILL - UPPER LEVELS
1 1/2" = 1'-0"

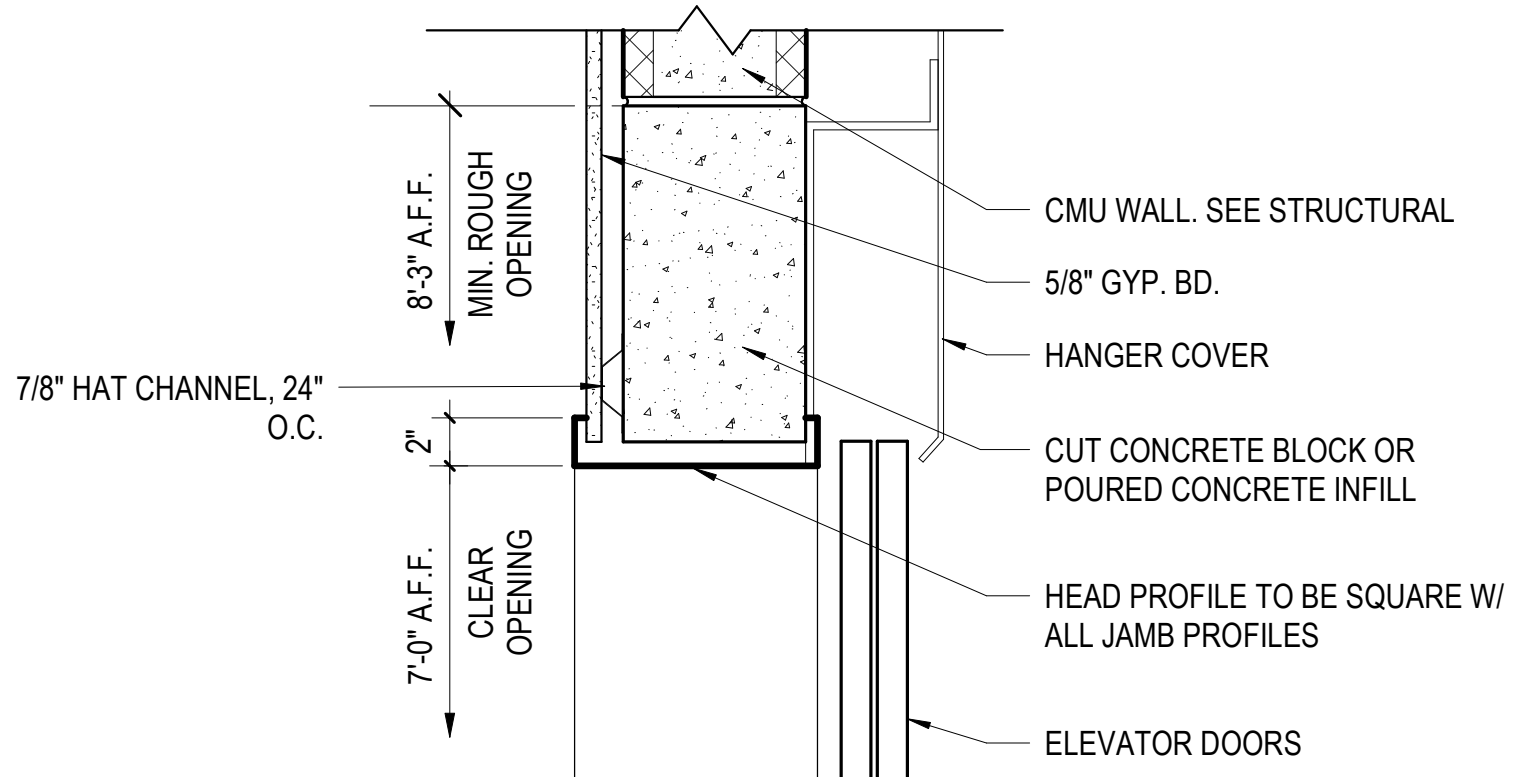


E3 ELEVATOR HEAD
1 1/2" = 1'-0"

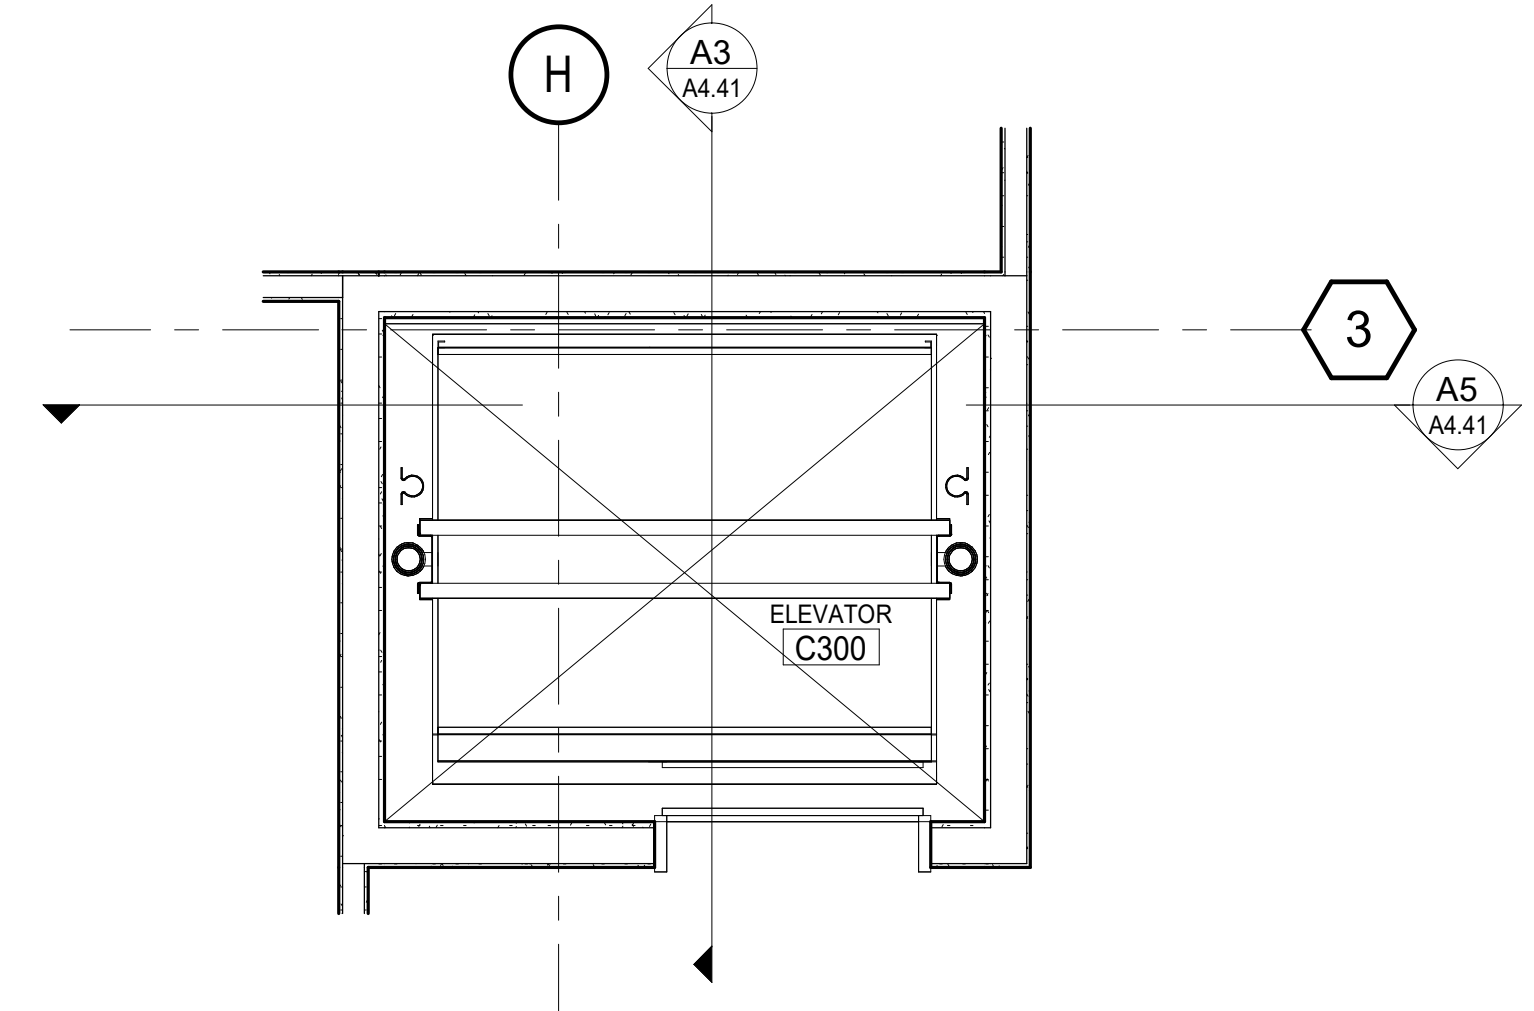


E1 ELEVATOR - LEVEL 3
3/8" = 1'-0"

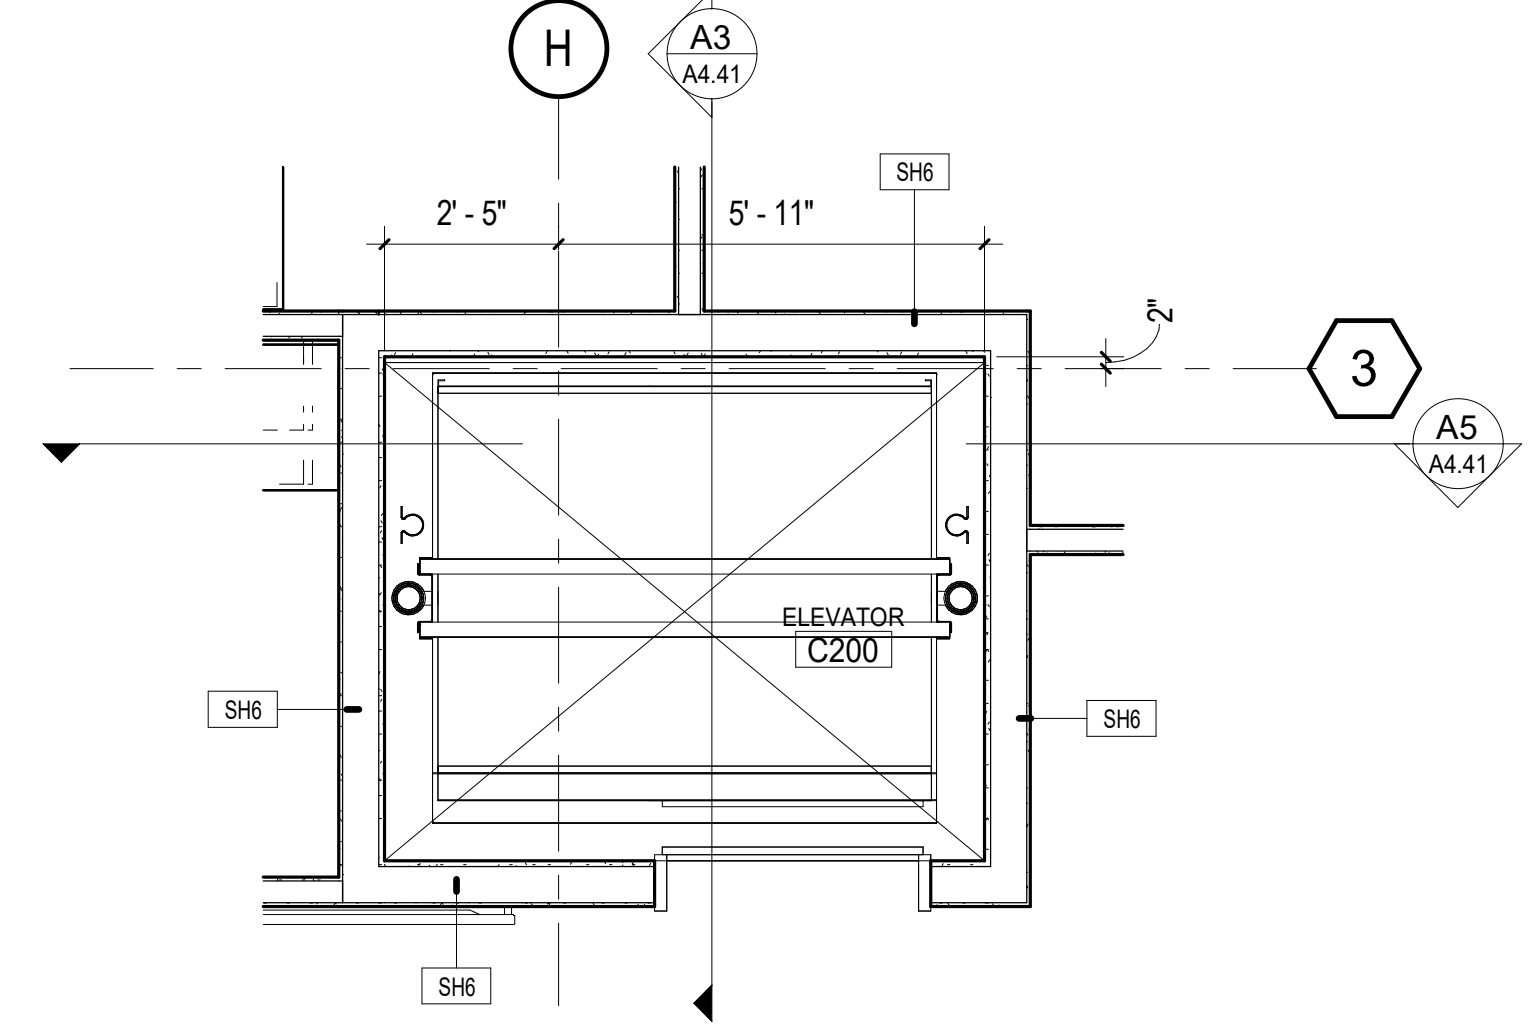

D1 ELEVATOR - LEVEL 2
3/8" = 1'-0"

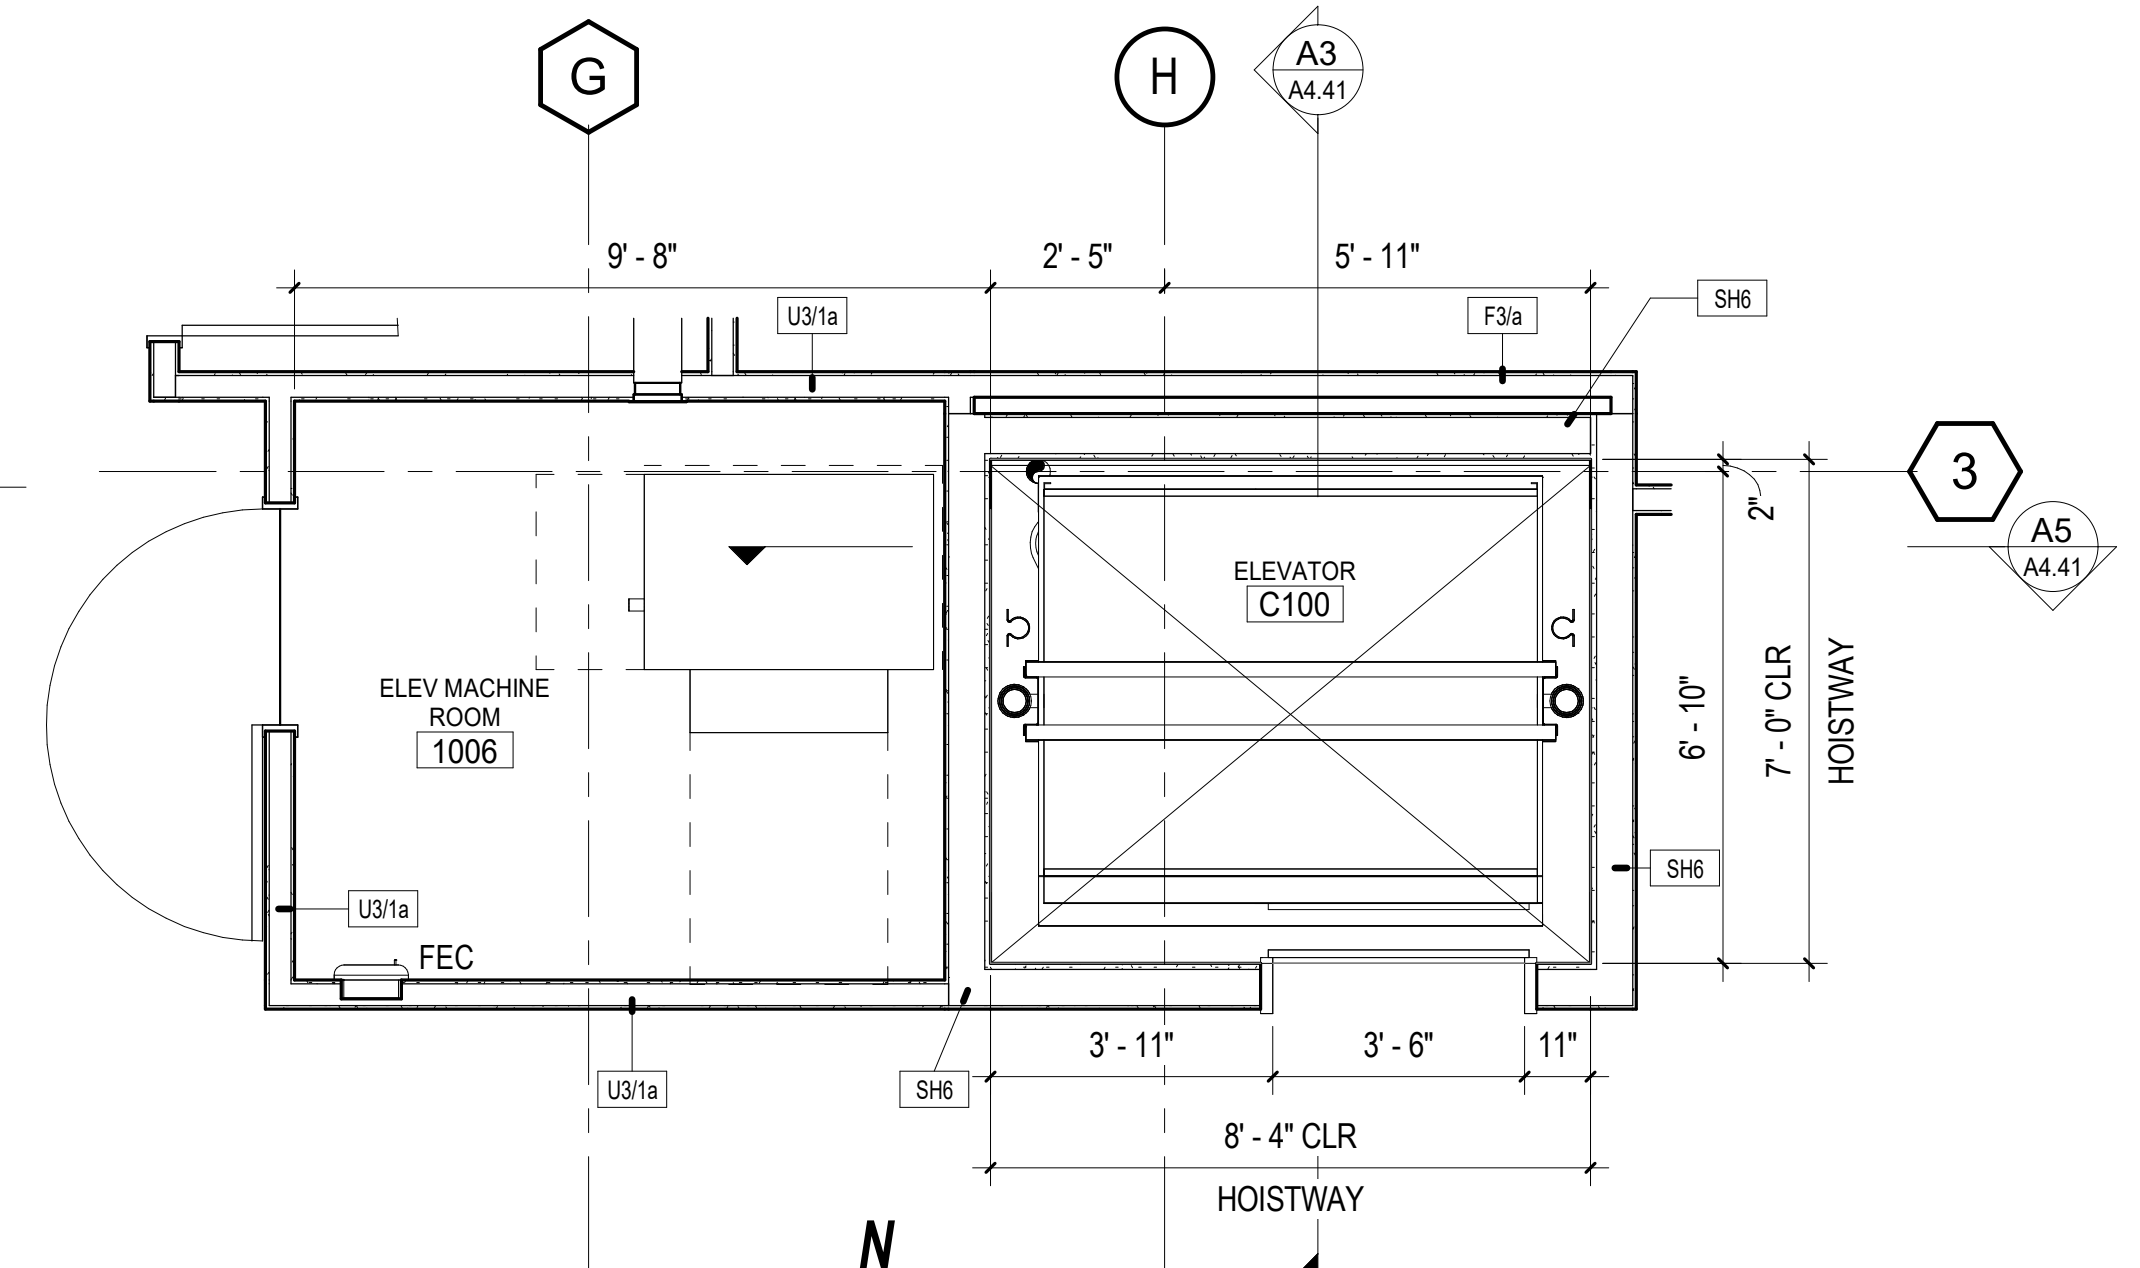


B1 ELEVATOR - LEVEL 1
3/8" = 1'-0"

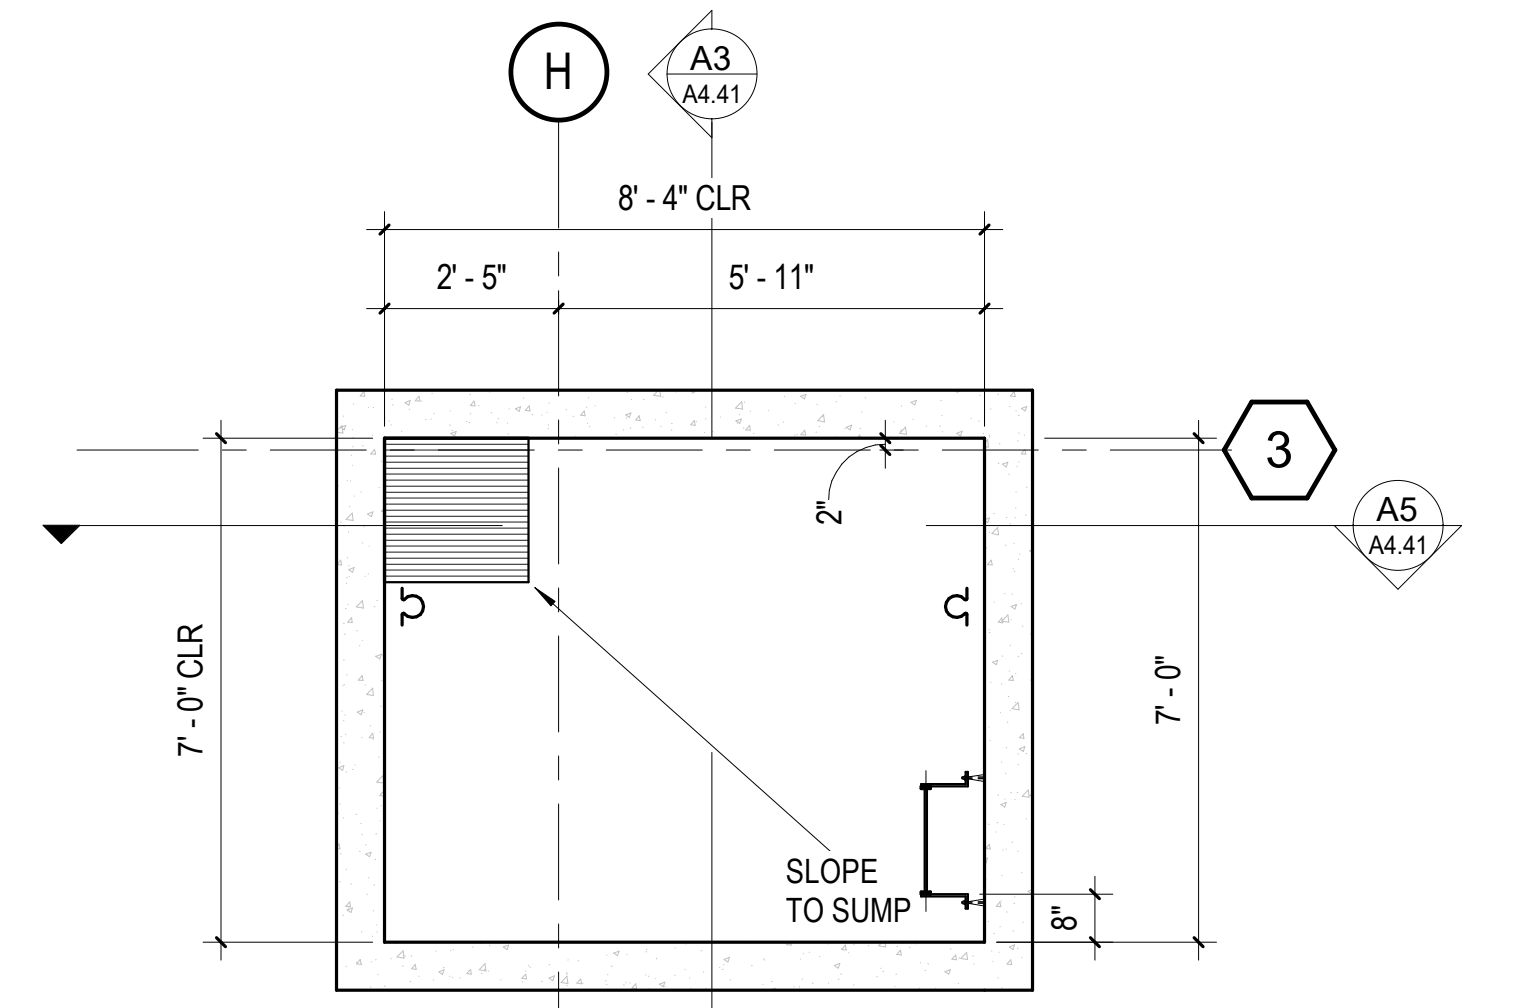


A1 ELEVATOR - PIT PLAN
3/8" = 1'-0"

C6 ELEVATOR SILL @ 1ST FLOOR
1 1/2" = 1'-0"

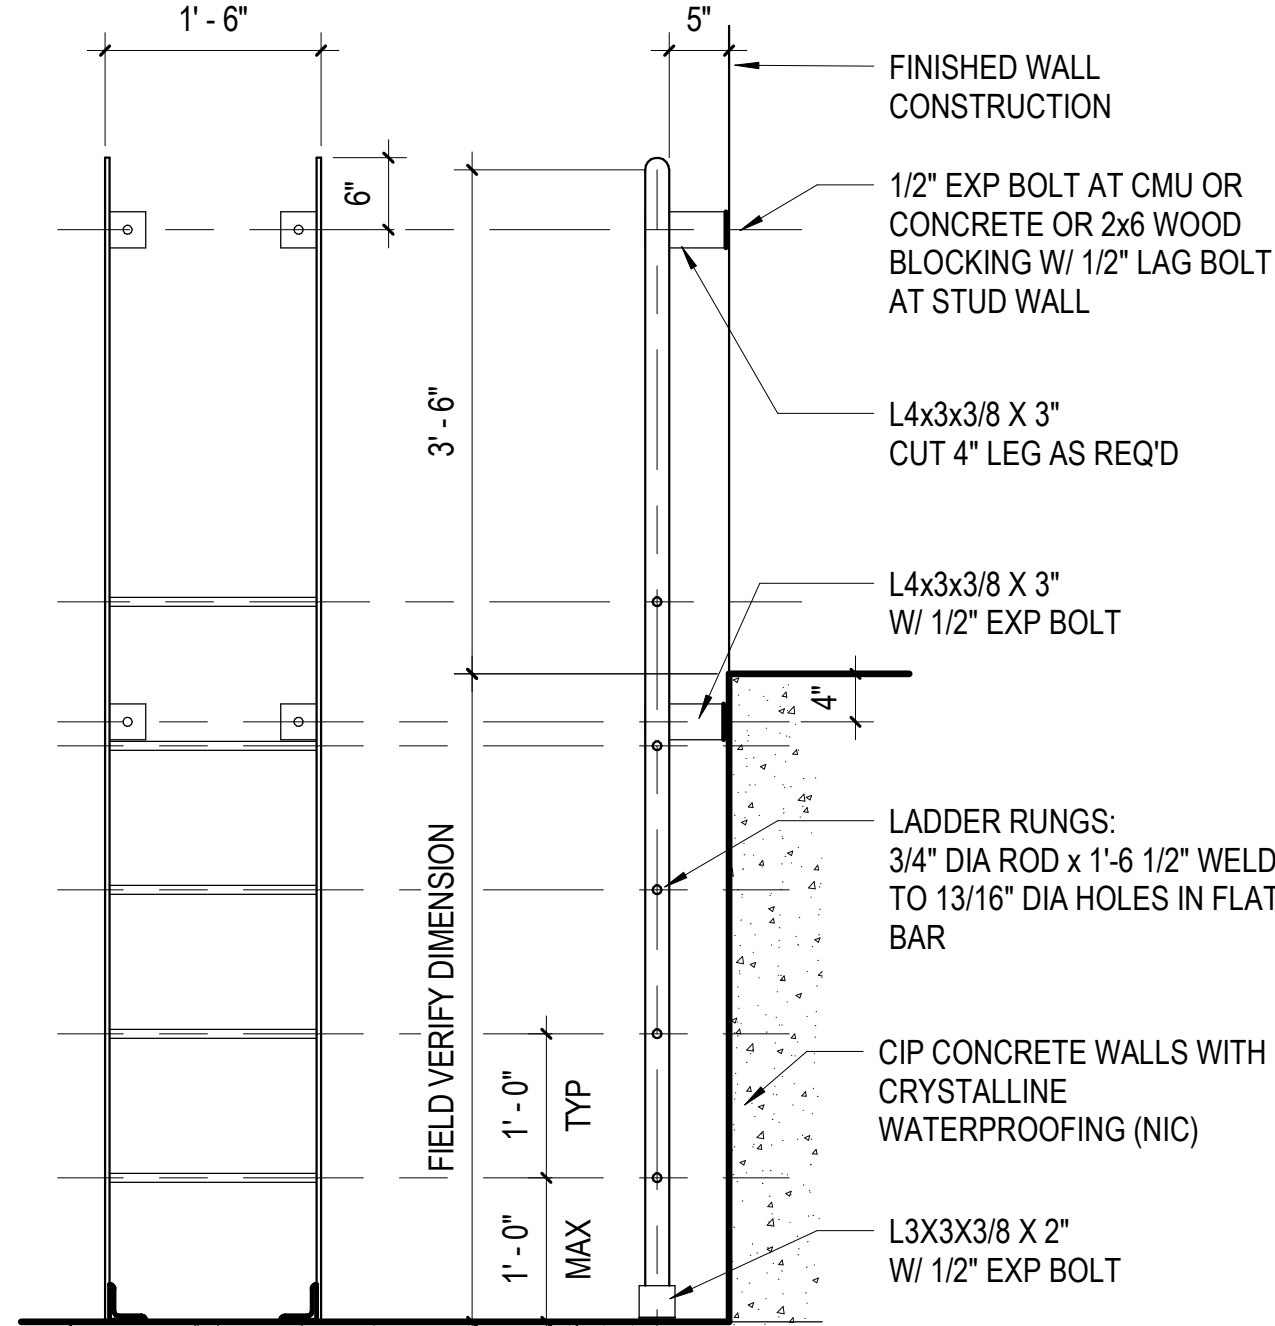


NOTE: GRIND AND SAND ALL WELD AND EDGES SMOOTH

A6 ELEVATOR PIT LADDER
3/4" = 1'-0"

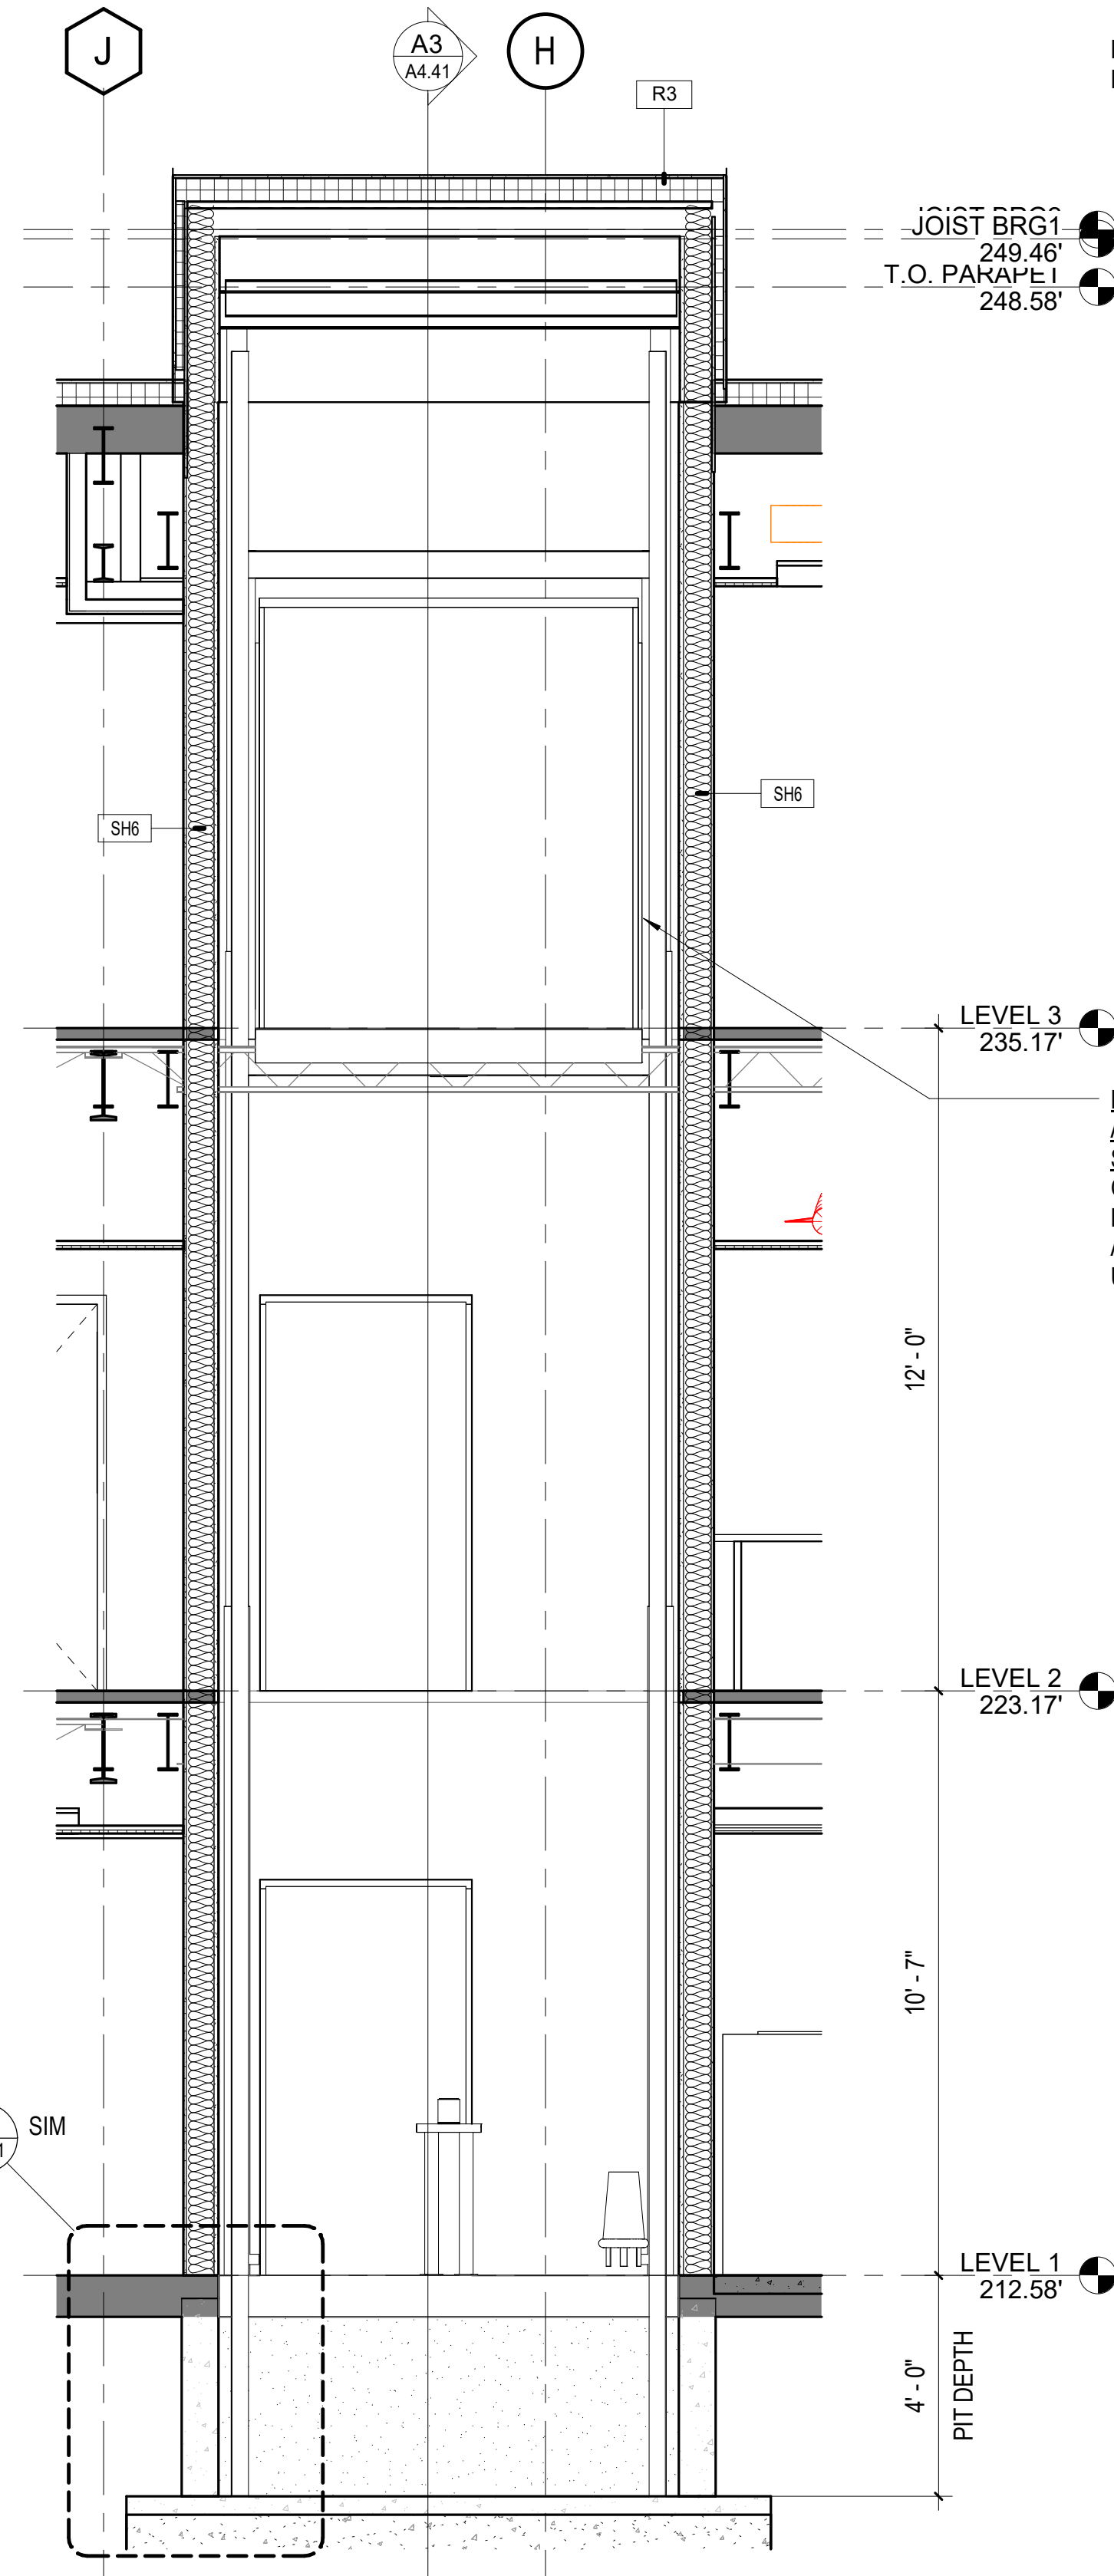


A5 SECTION - ELEVATOR
3/8" = 1'-0"

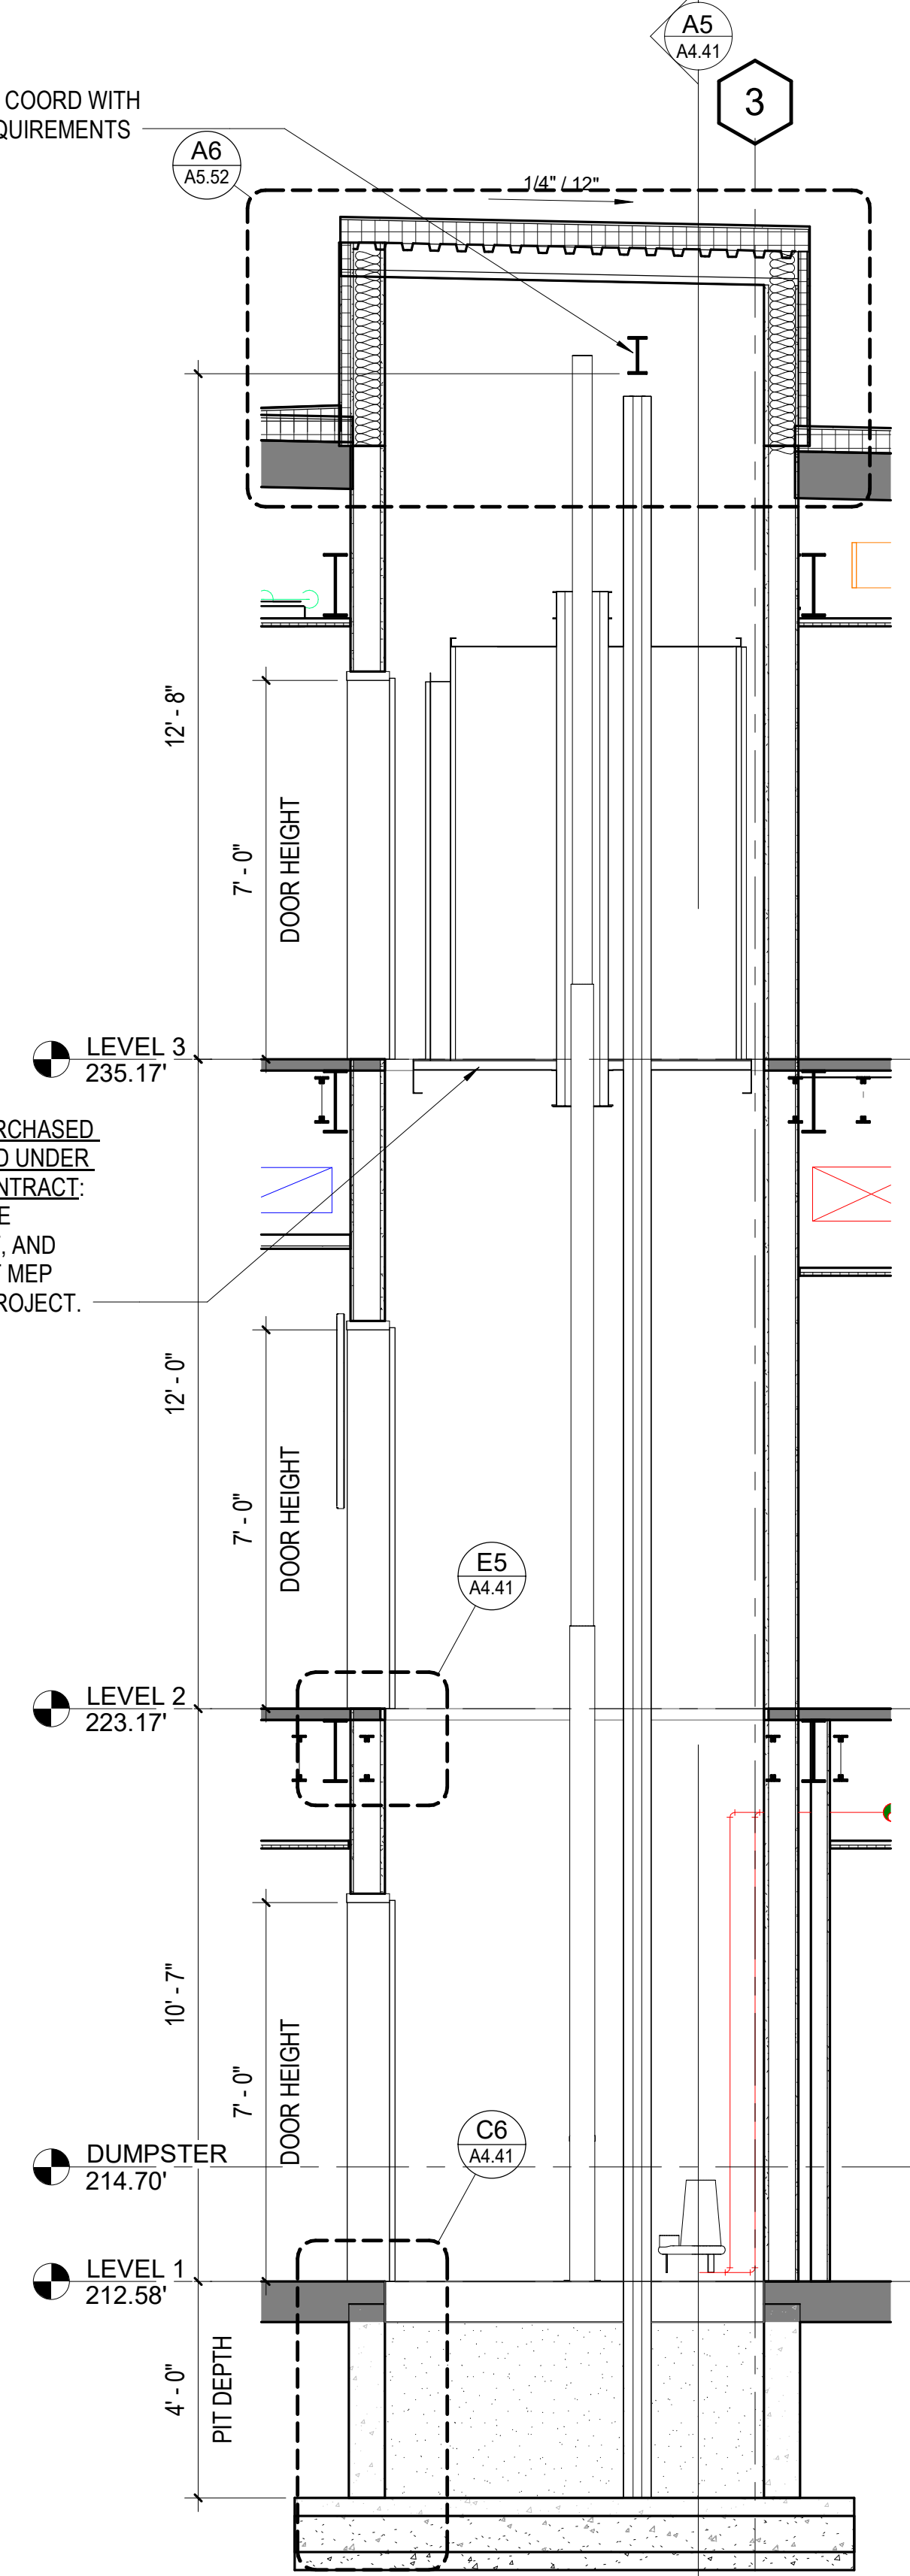

A3 SECTION - ELEVATOR
3/8" = 1'-0"

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

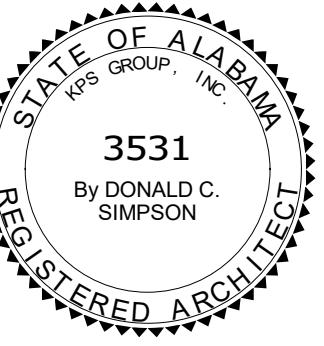

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
ENLARGED ELEVATOR PLANS AND SECTIONS		
DRAWN BY: Author		
CHECKED BY: Checker		
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A4.41		


A6 PUBLIC TOILET VANITY SINK

1 1/2" = 1'-0"

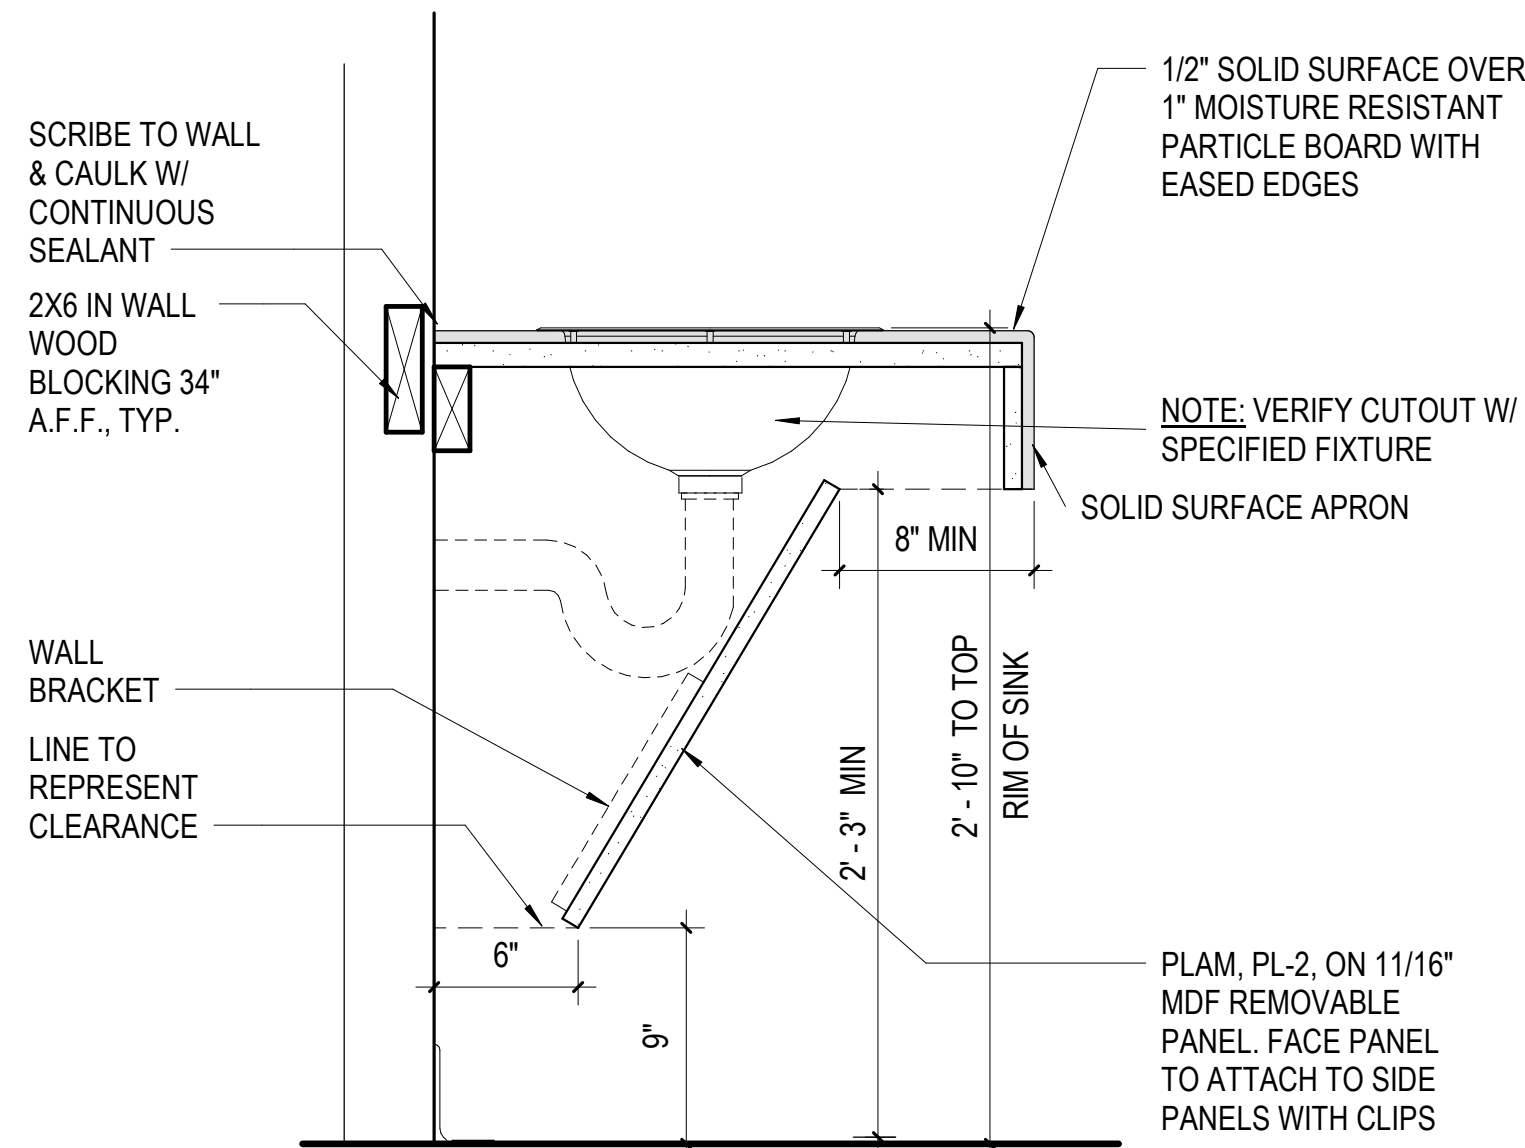


C6 ADJUSTABLE SHELVEING

1 1/2" = 1'-0"

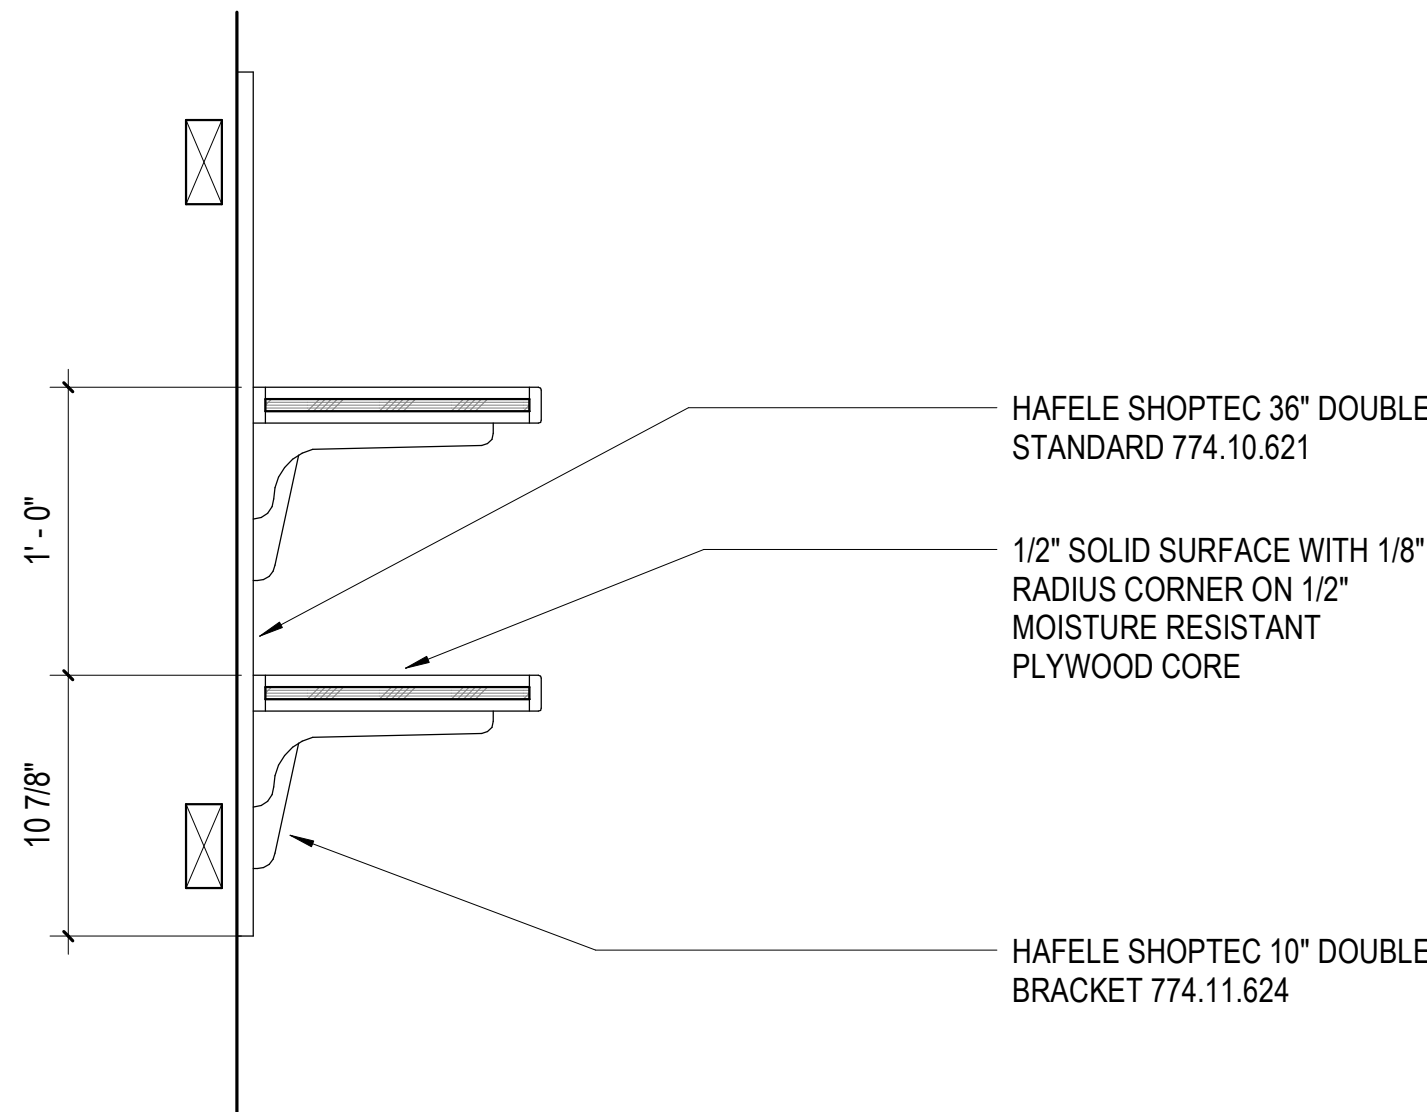


D6 SINK BASE CABINET OPERABLE

1 1/2" = 1'-0"

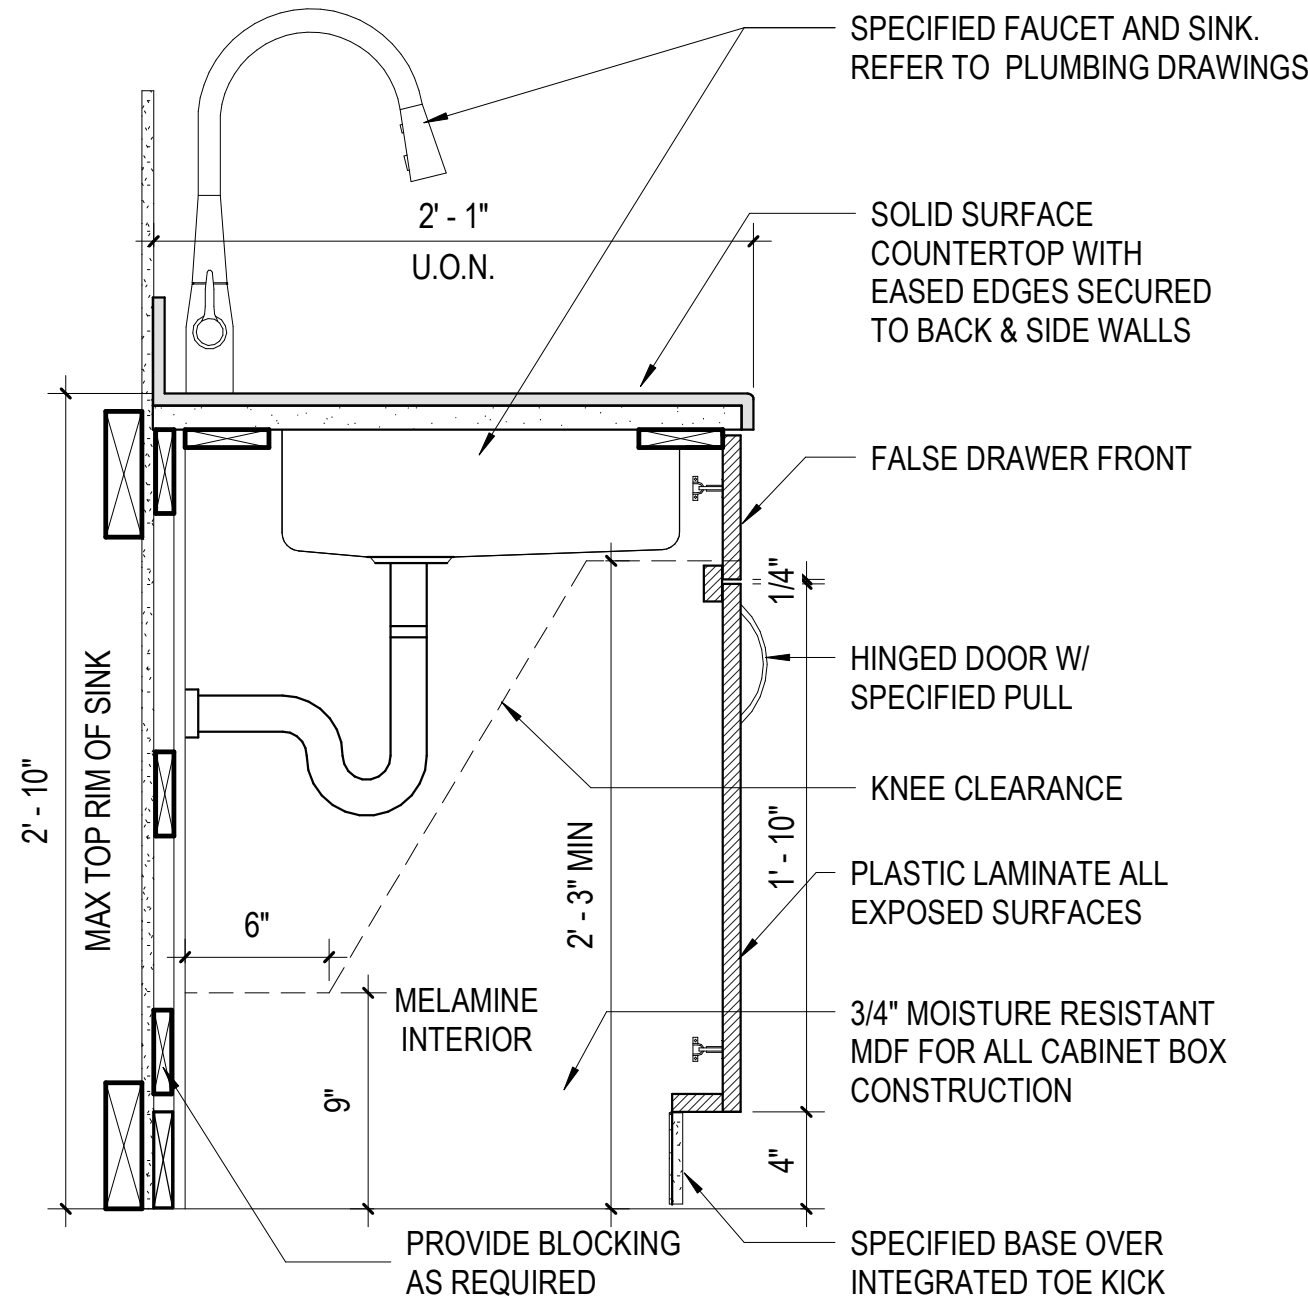


A4 2 LANE STANDING CABINET - 2'-0"

1 1/2" = 1'-0"

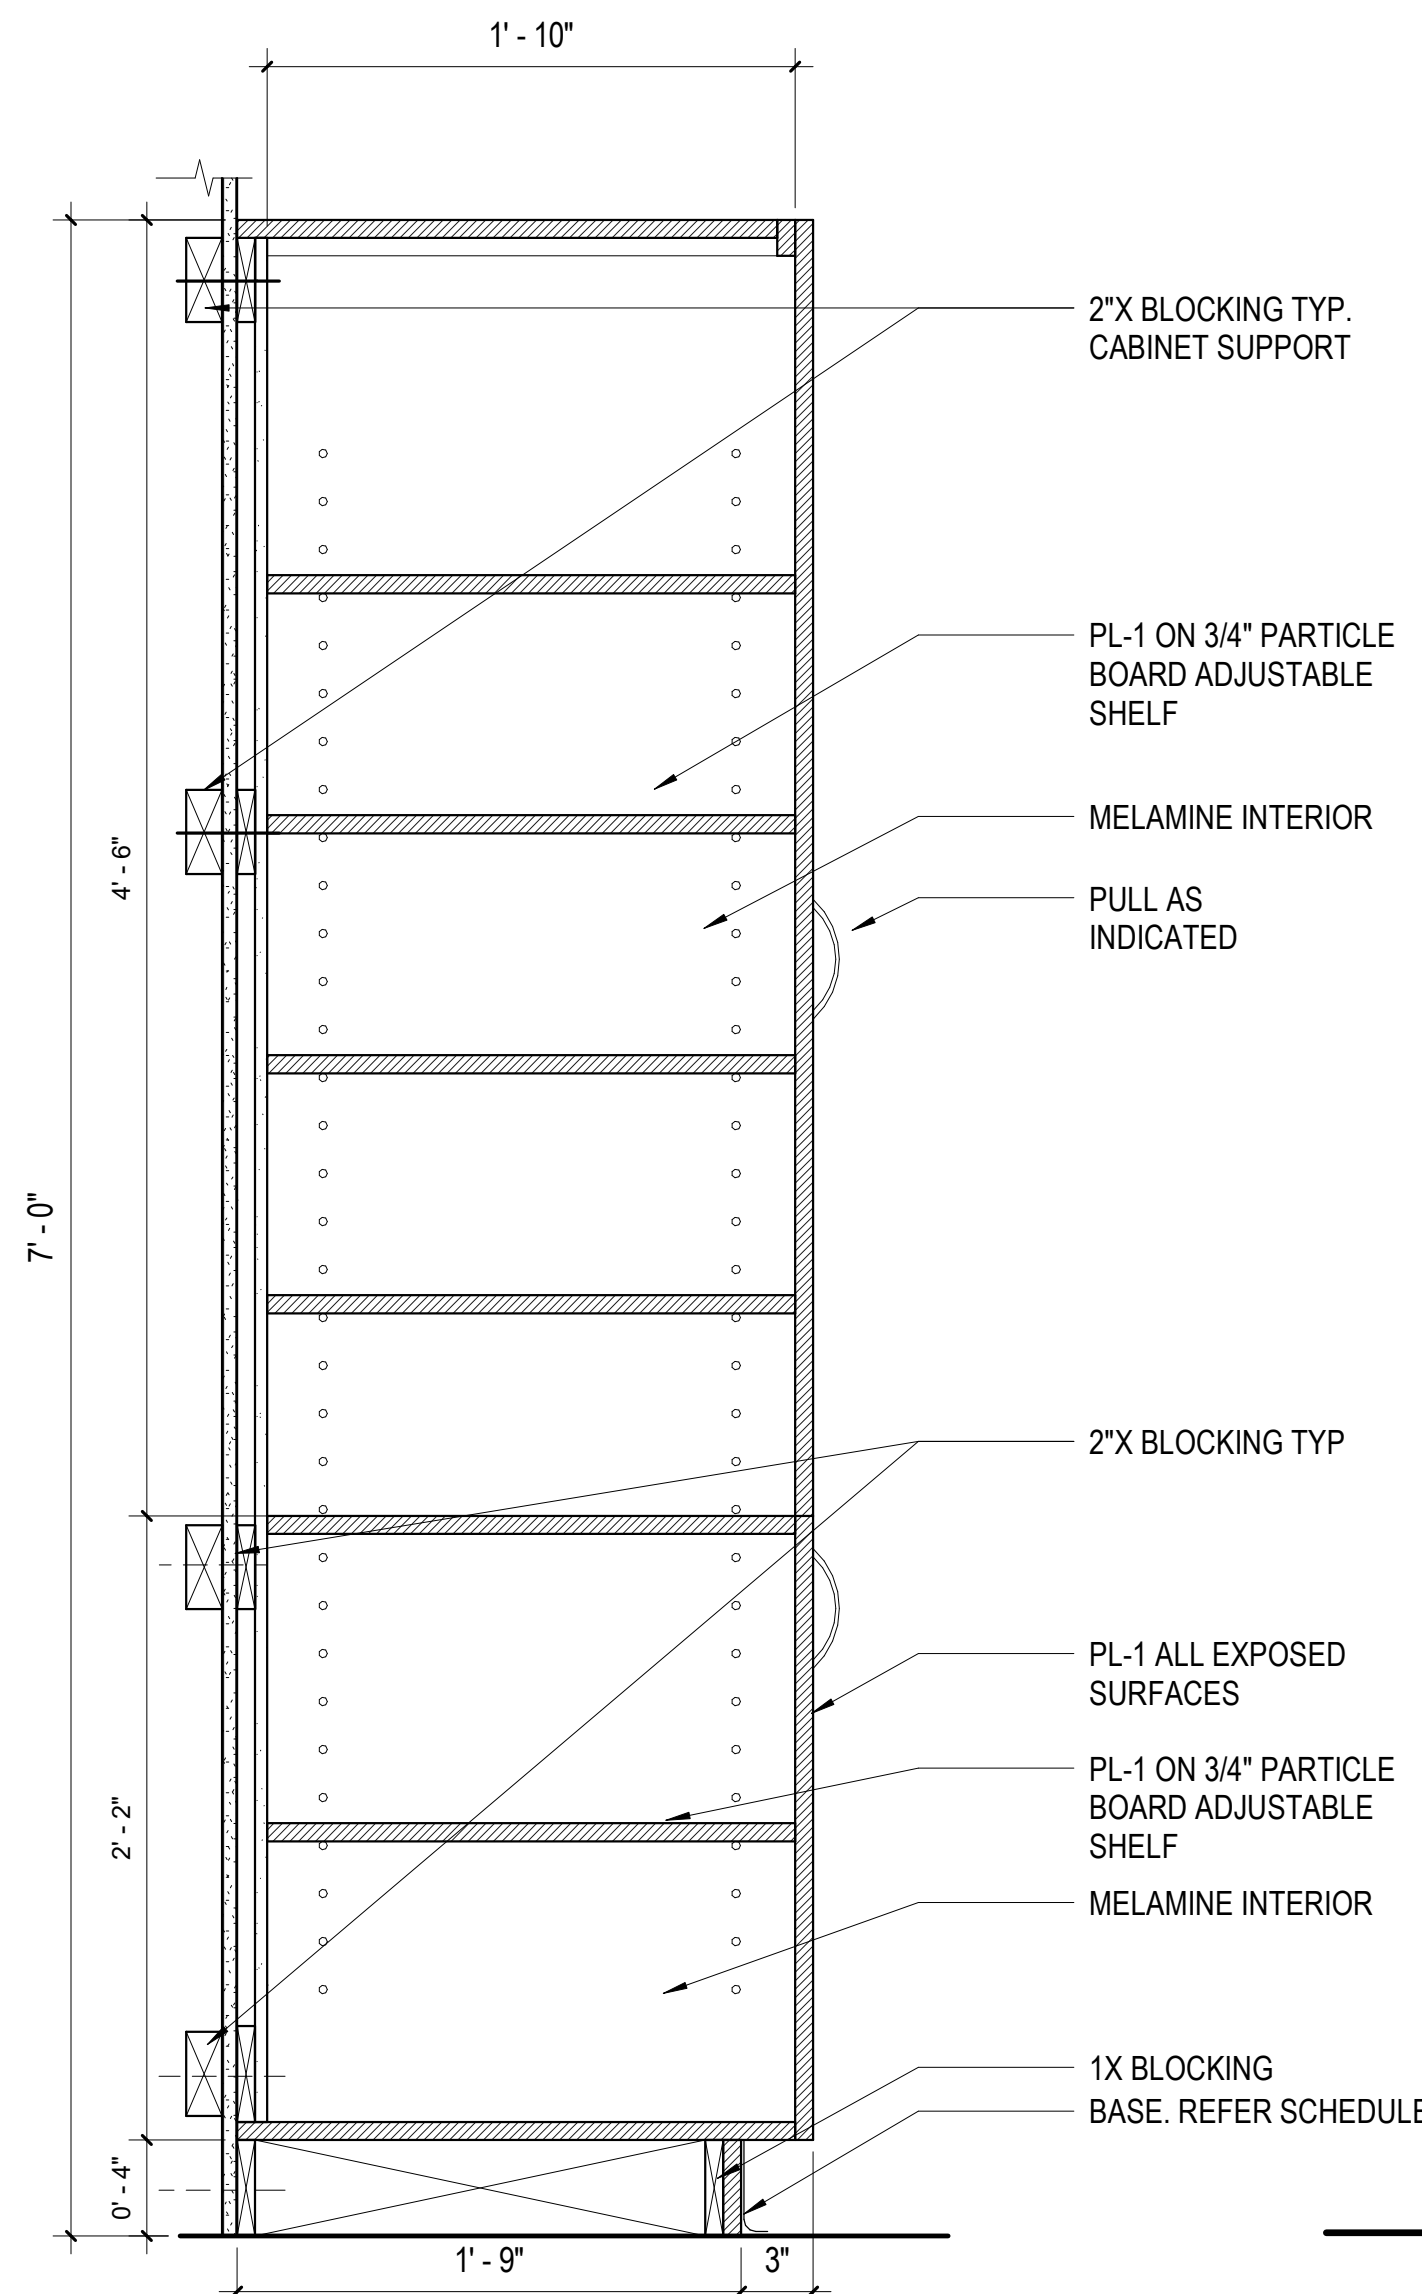


D4 UPPER CABINET - KITCHEN, TYP.1

1 1/2" = 1'-0"

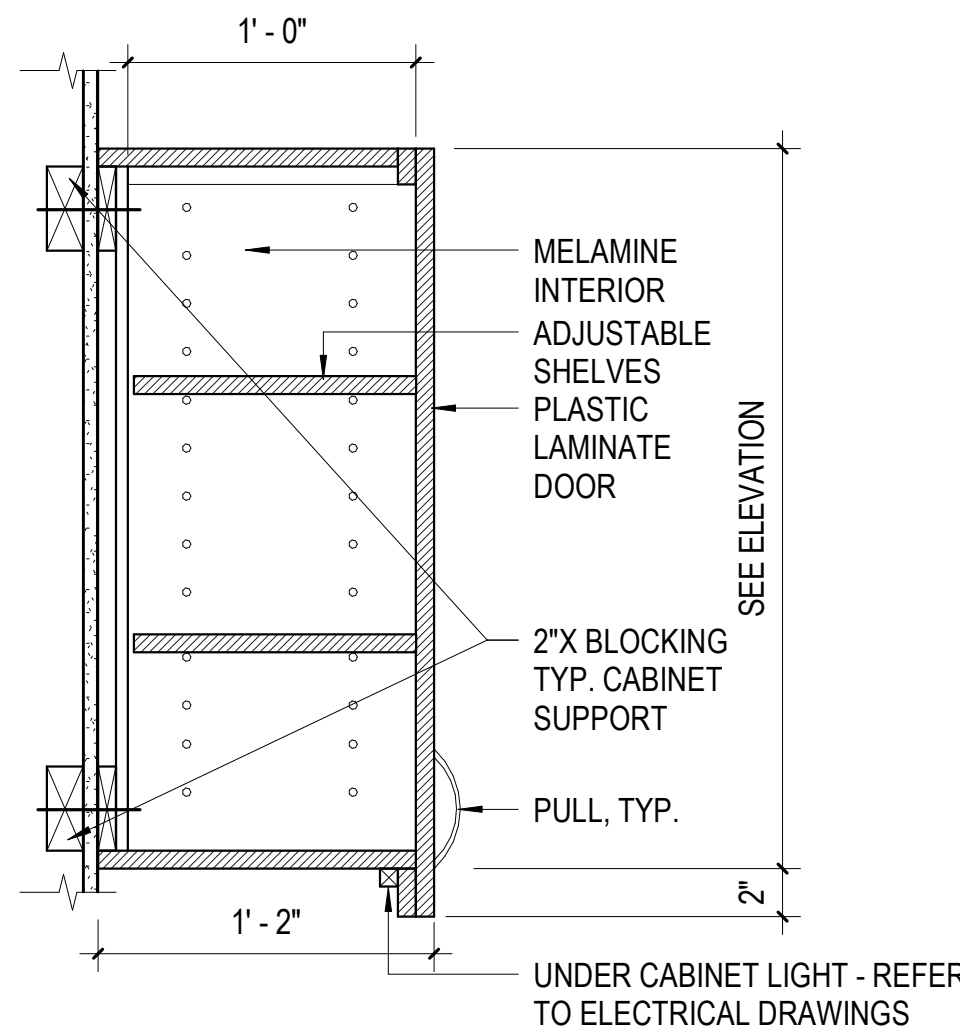


A3 PAPER MILL WORK TABLE

1 1/2" = 1'-0"

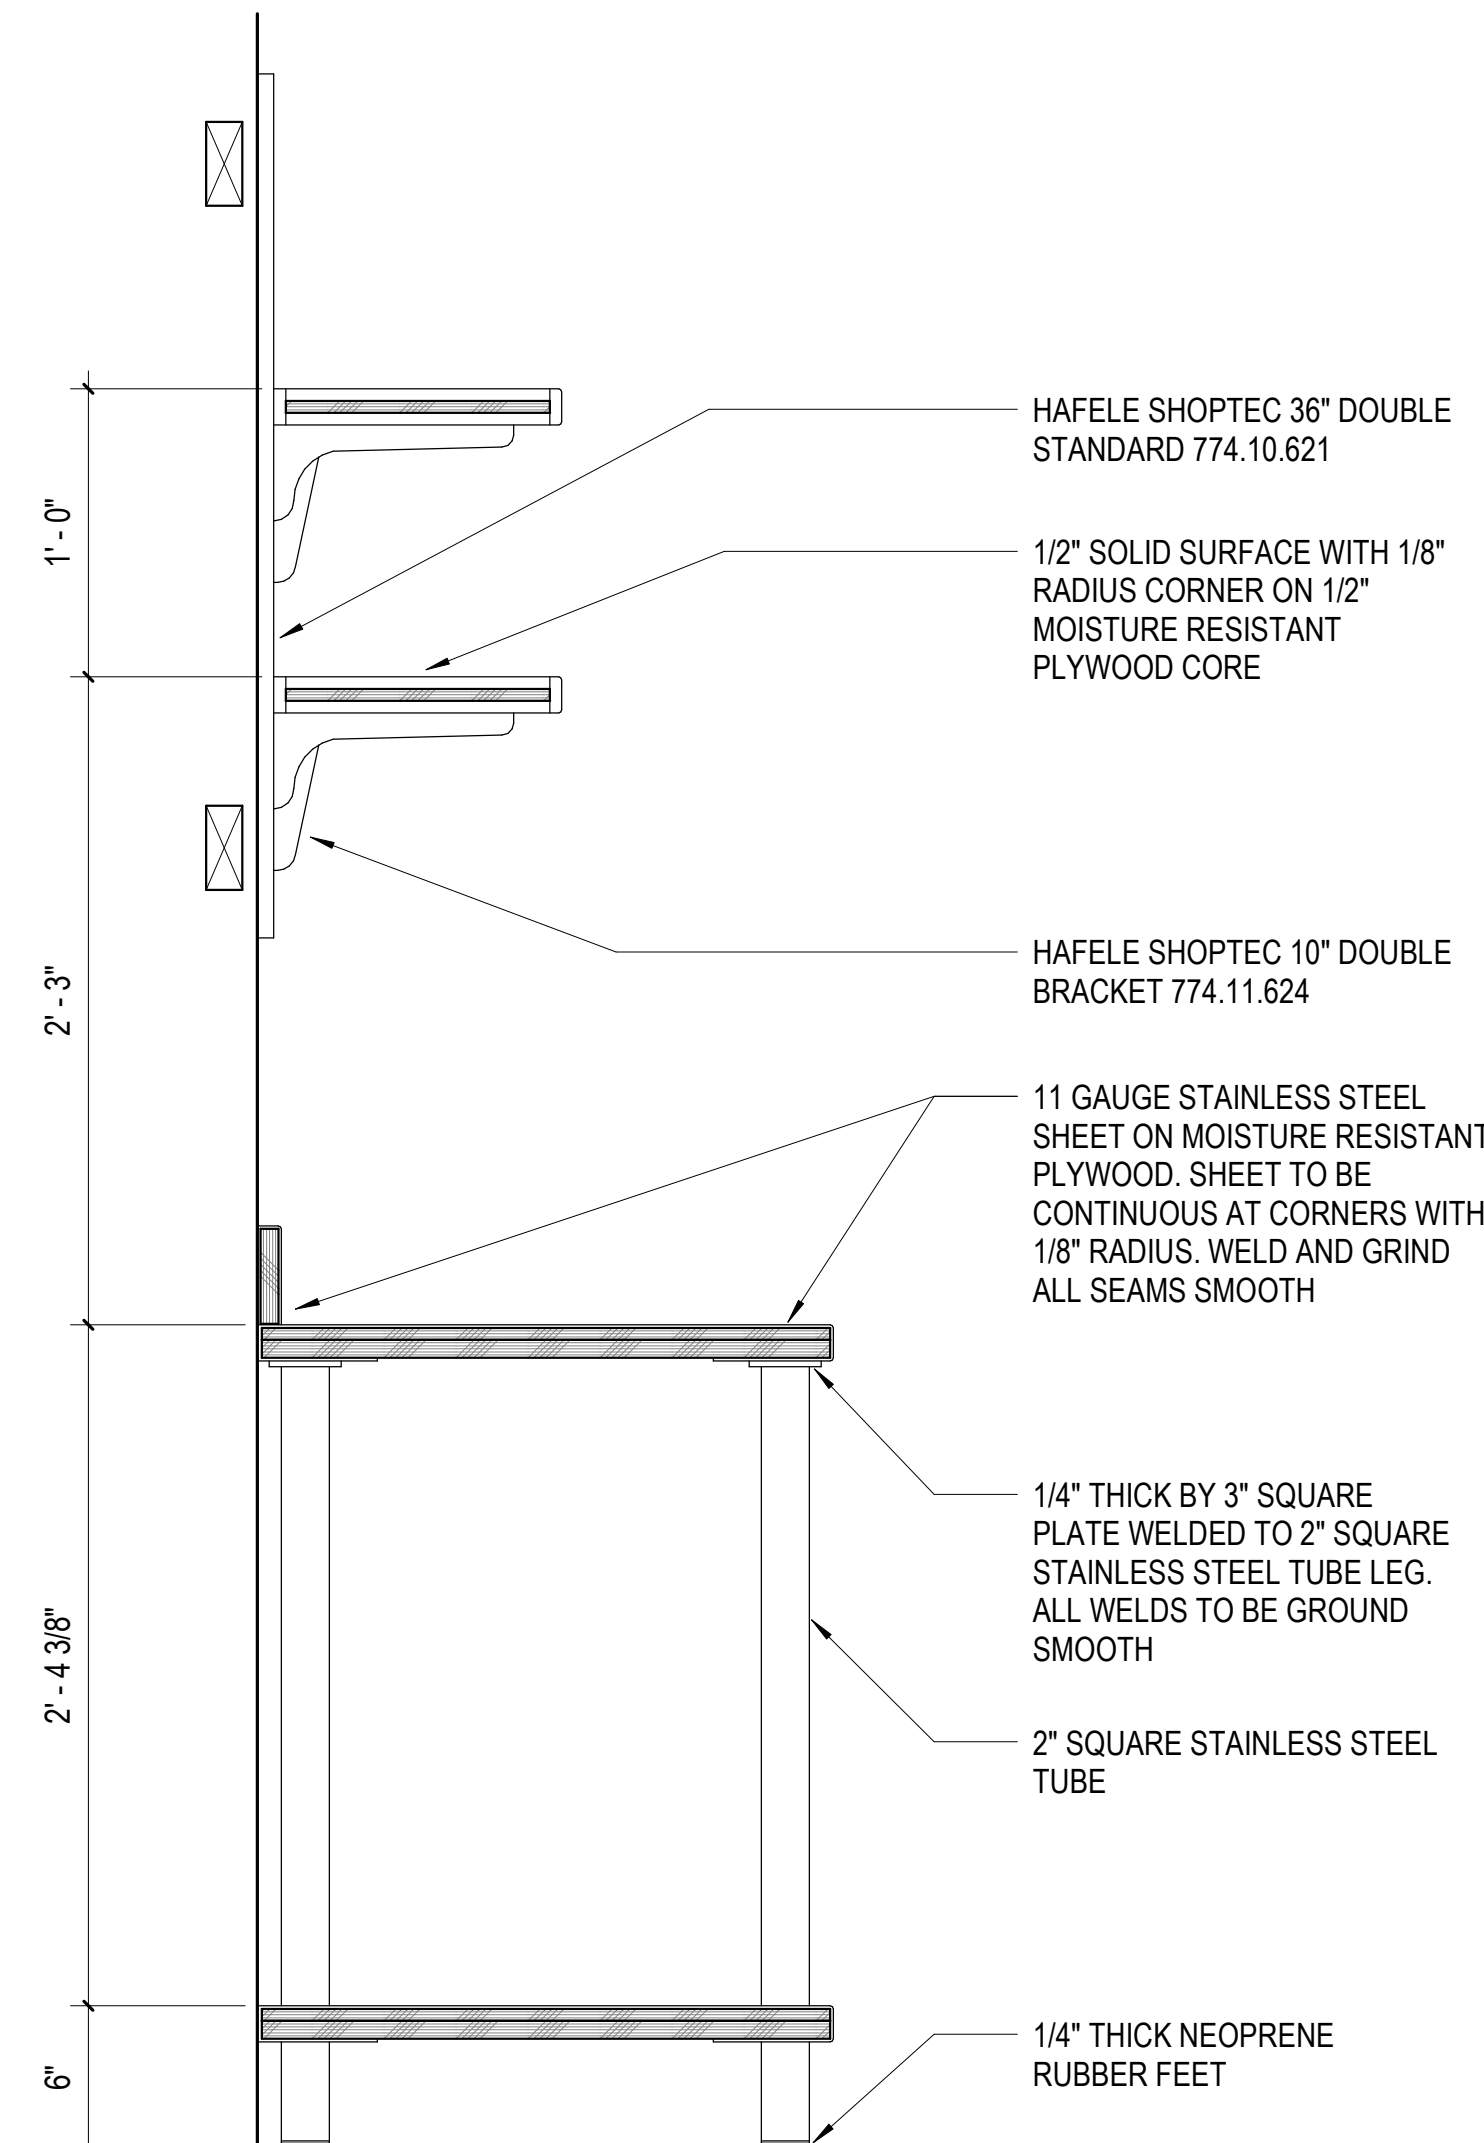


D3 FOUR DRAWERS

1 1/2" = 1'-0"

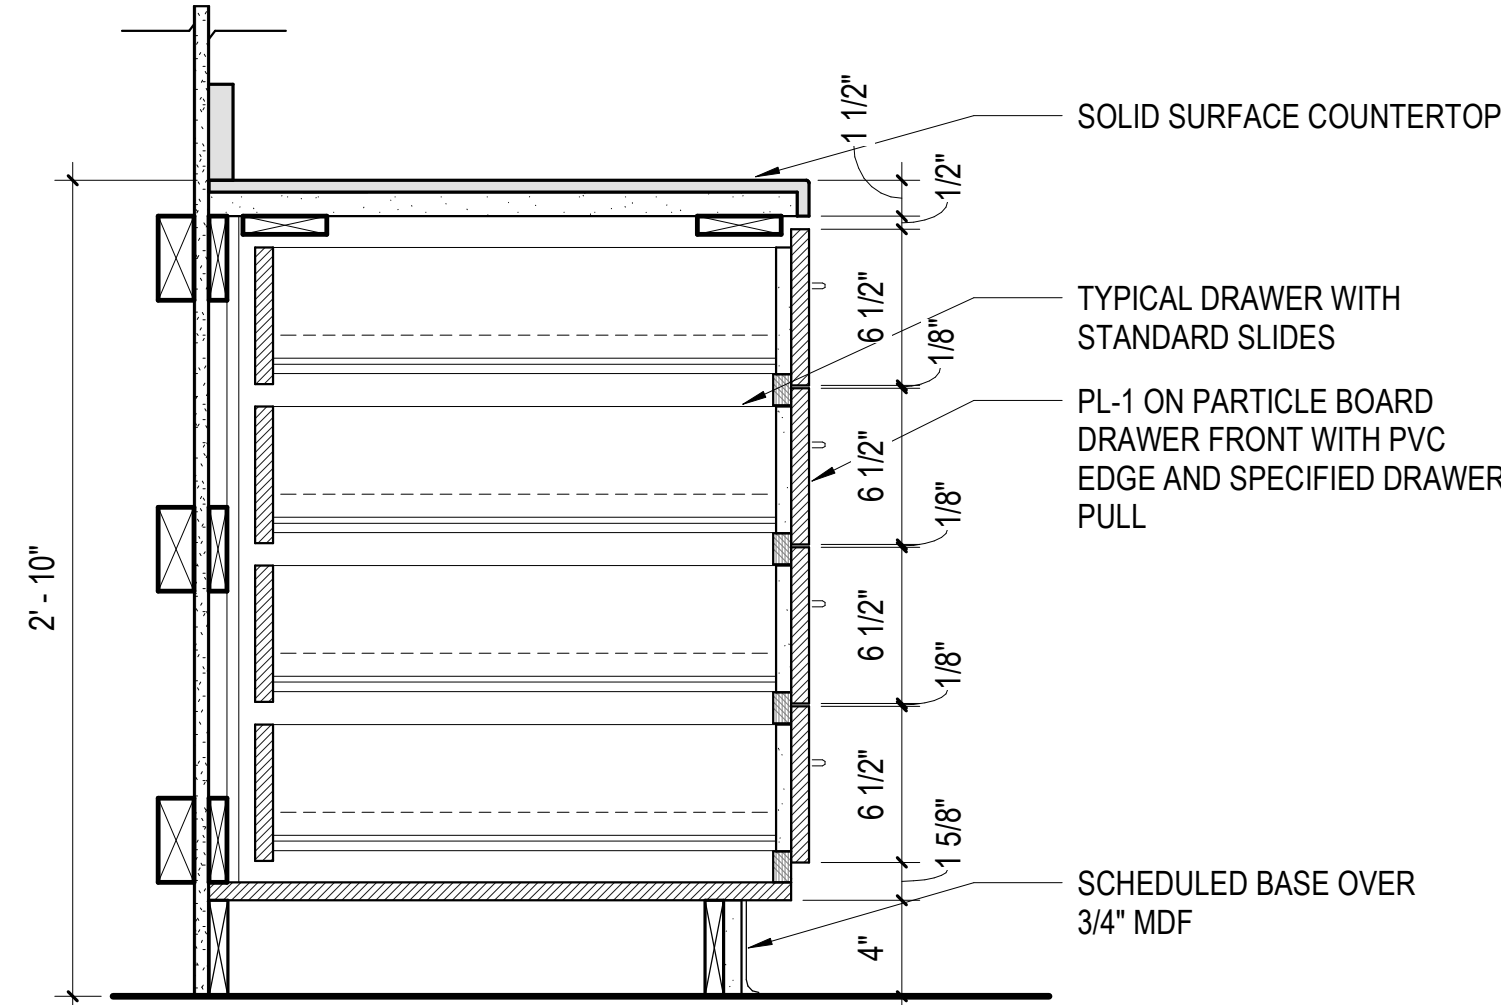


E2 CABINET EDGE CONDITIONS

6\"/>

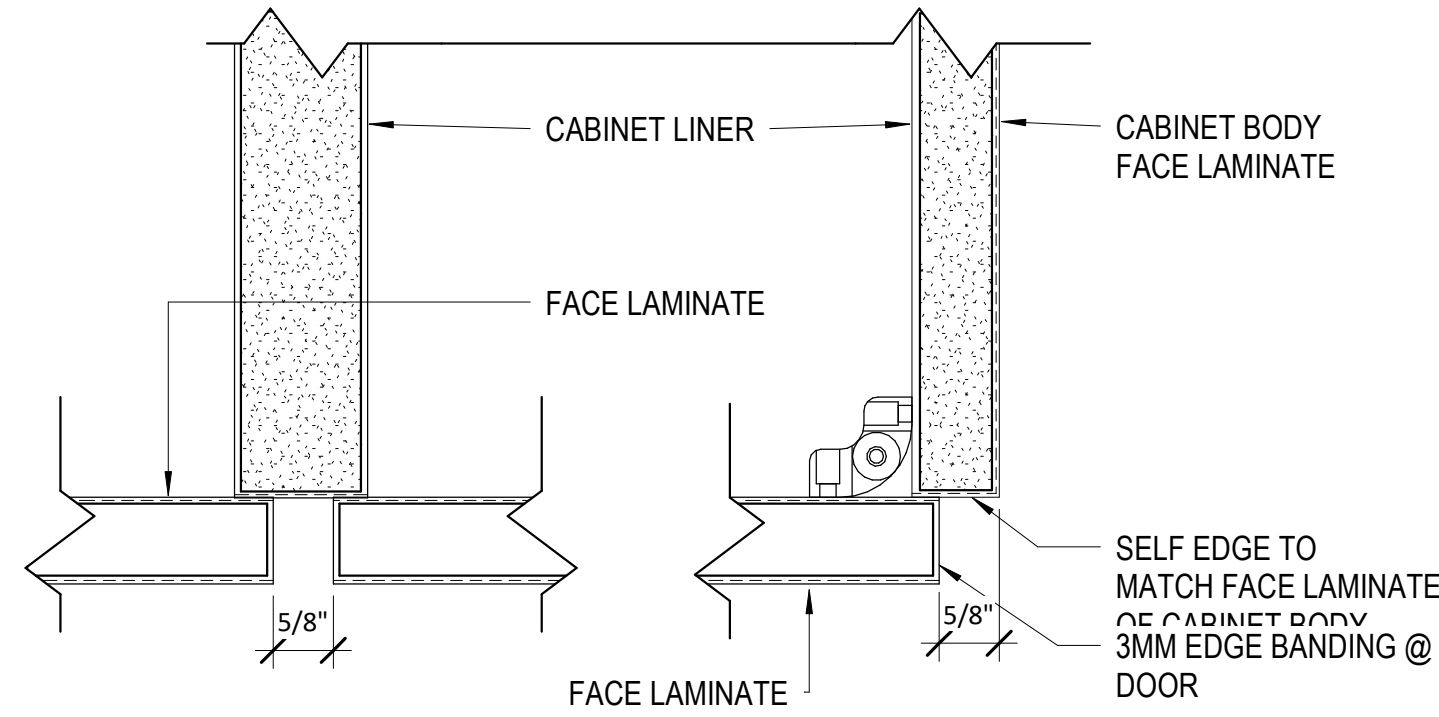


A1 BASE CABINET W/ OVERHEAD CABINET - TYPICAL

1 1/2" = 1'-0"

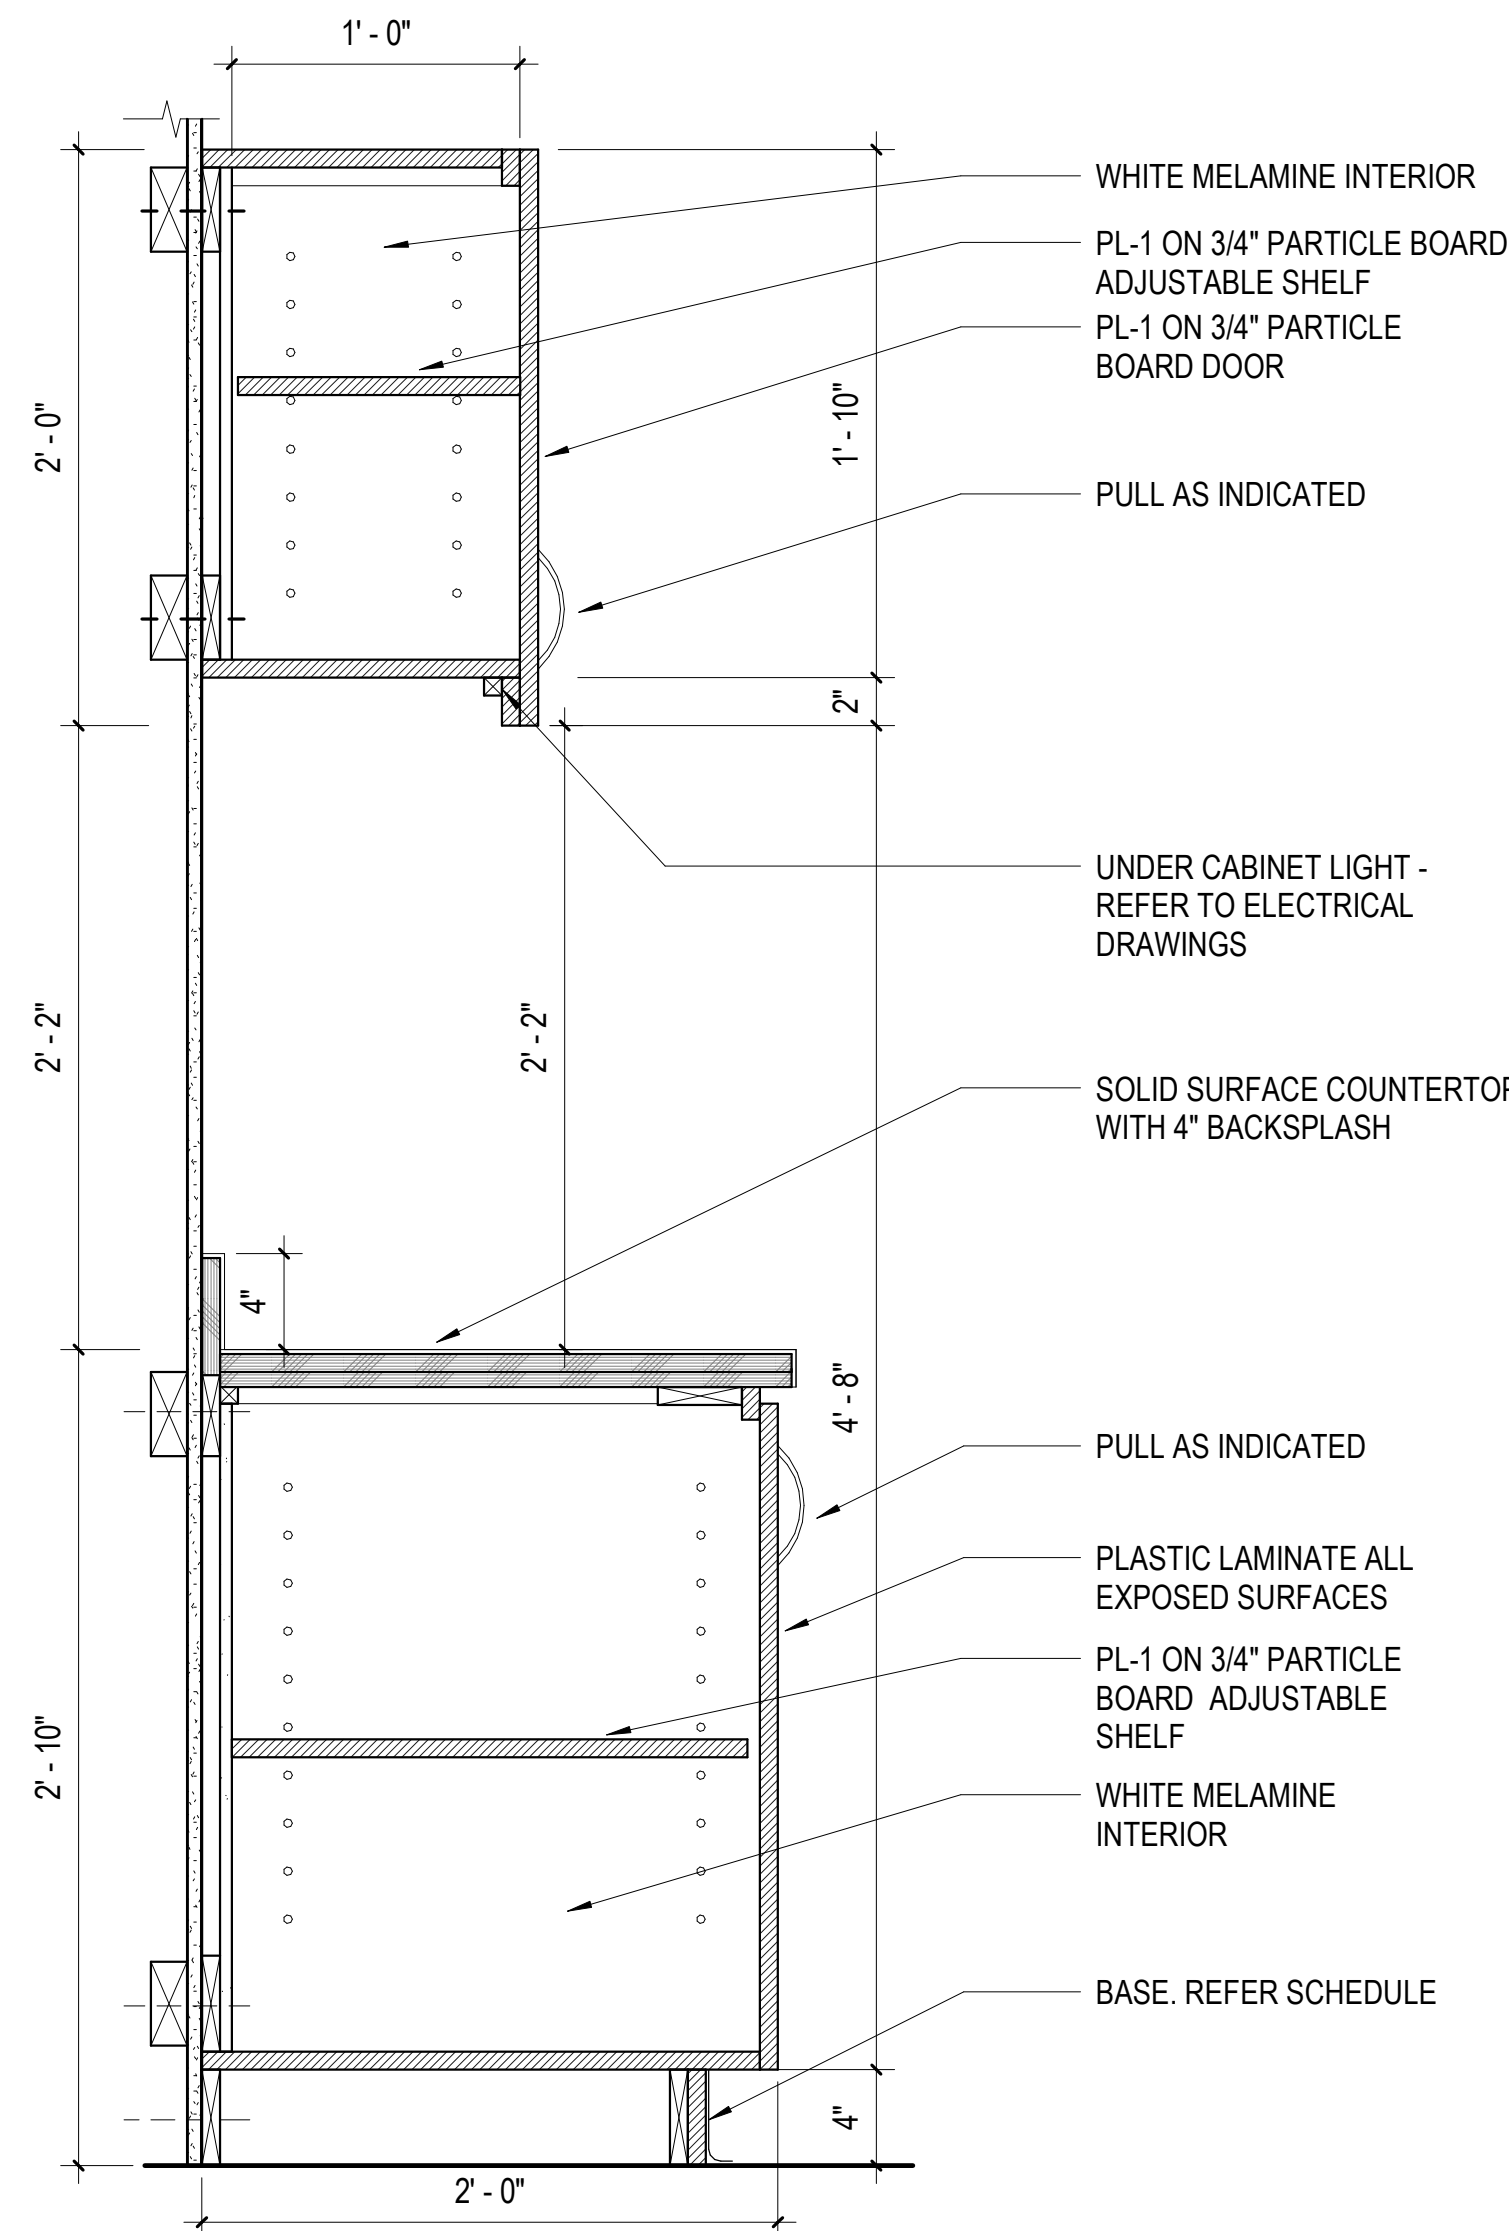


D1 SINK BASE CABINET

1 1/2" = 1'-0"

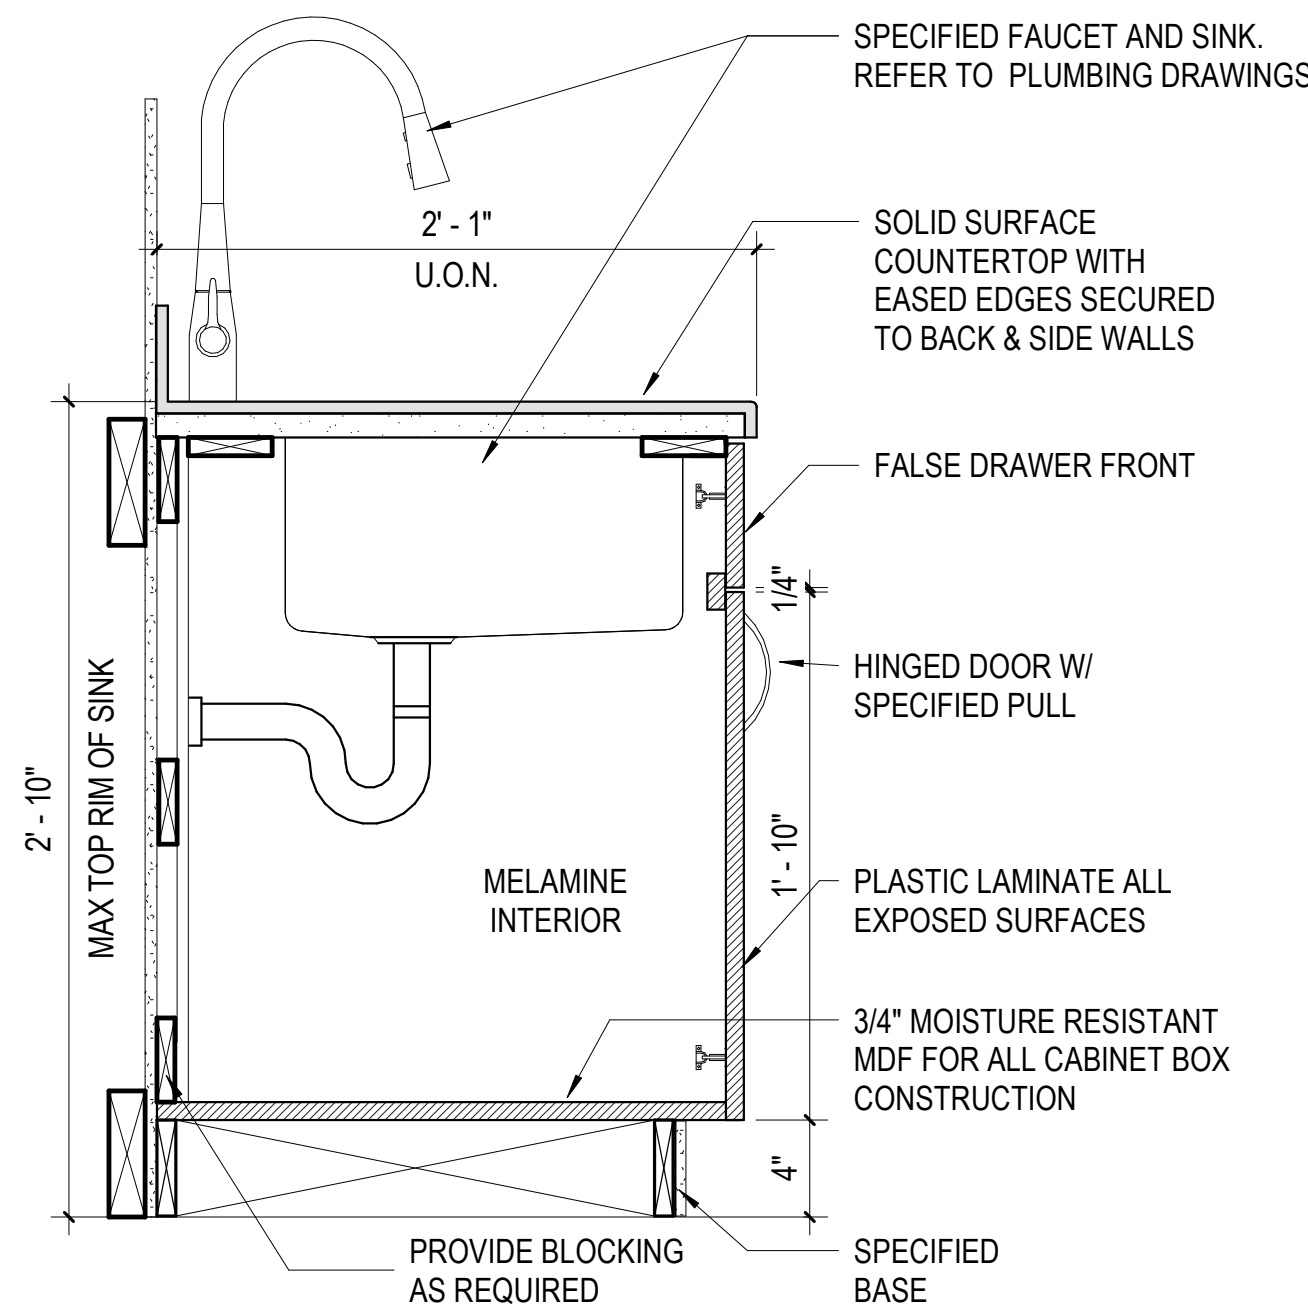


D3 FOUR DRAWERS

1 1/2" = 1'-0"

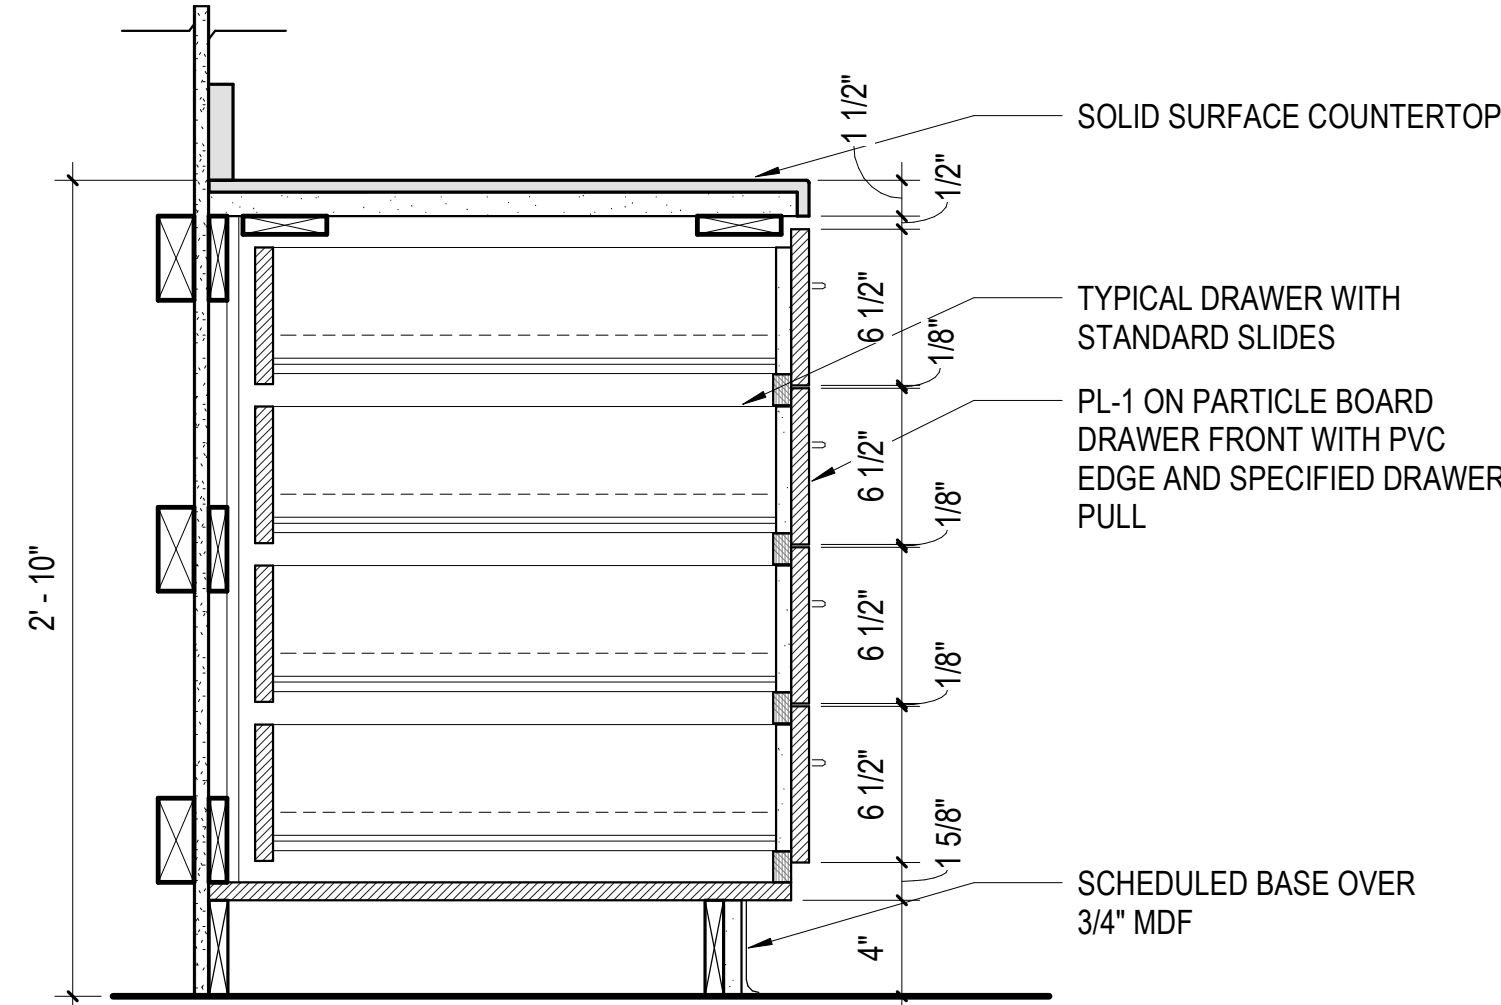

E2 CABINET EDGE CONDITIONS

6\"/>

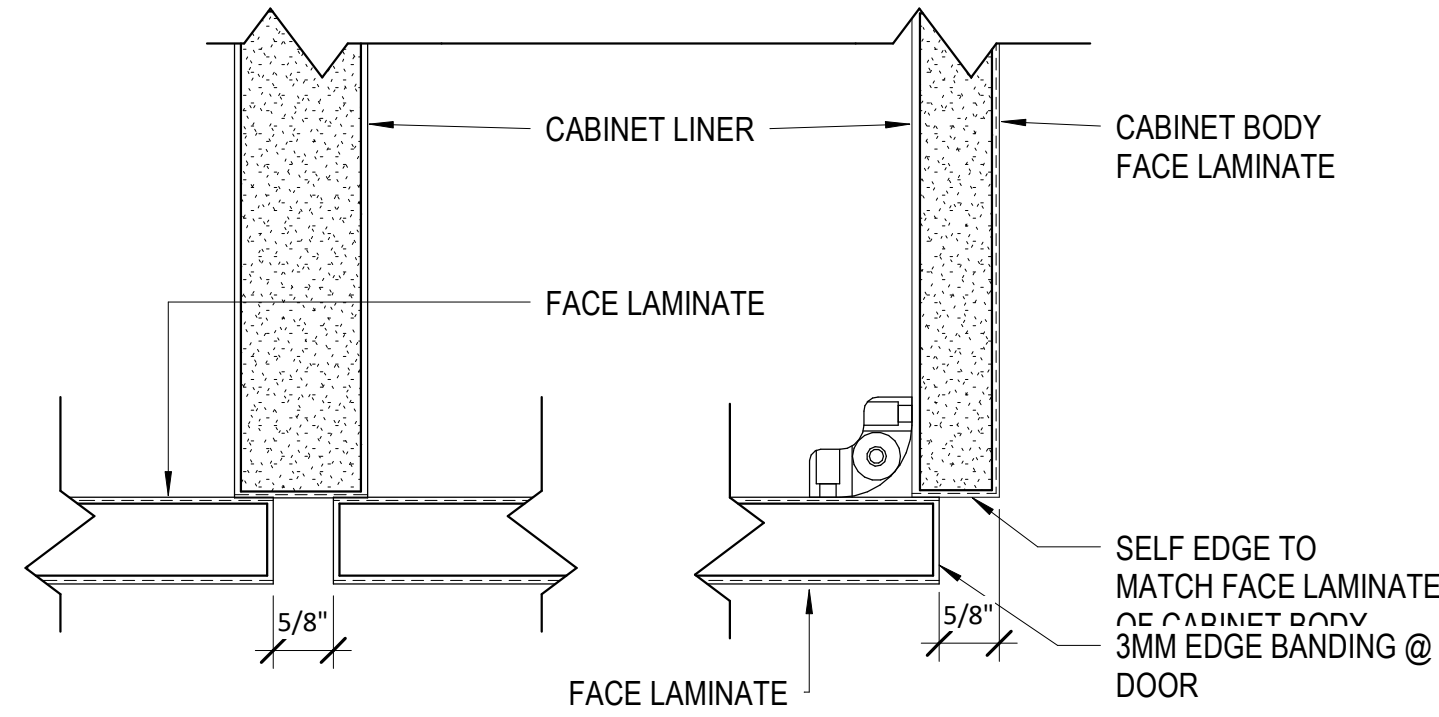


MILLWORK GENERAL NOTES

1. TYPICAL IN PARTITION CAVITIES AT ALL WALL MOUNTED MILLWORK, CASEWORK, EQUIPMENT, GRAB BARS, ACCESSORIES ETC. PROVIDE BLOCKING AS REQUIRED TO SUIT THE INSTALLATION OF THE ITEM. ANCHOR BLOCKING ENDS TO METAL STUDS SPACED AT 24\"/>
2. ALL PLASTIC LAMINATE MILLWORK TO BE PL-1, UNLESS NOTED OTHERWISE.
3. ALL PULLS AT PLASTIC LAMINATE MILLWORK TO BE STAINLESS STEEL WIRE PULLS



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DETAILS - MILLWORK		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A5.11		


McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401
DRAWING: 202403

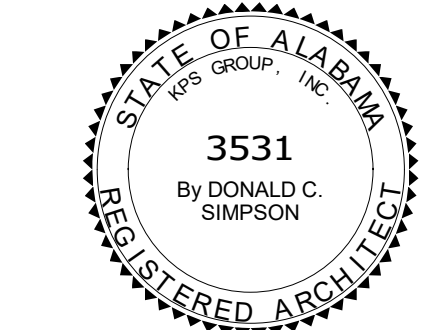


This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.


K|P|S
GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

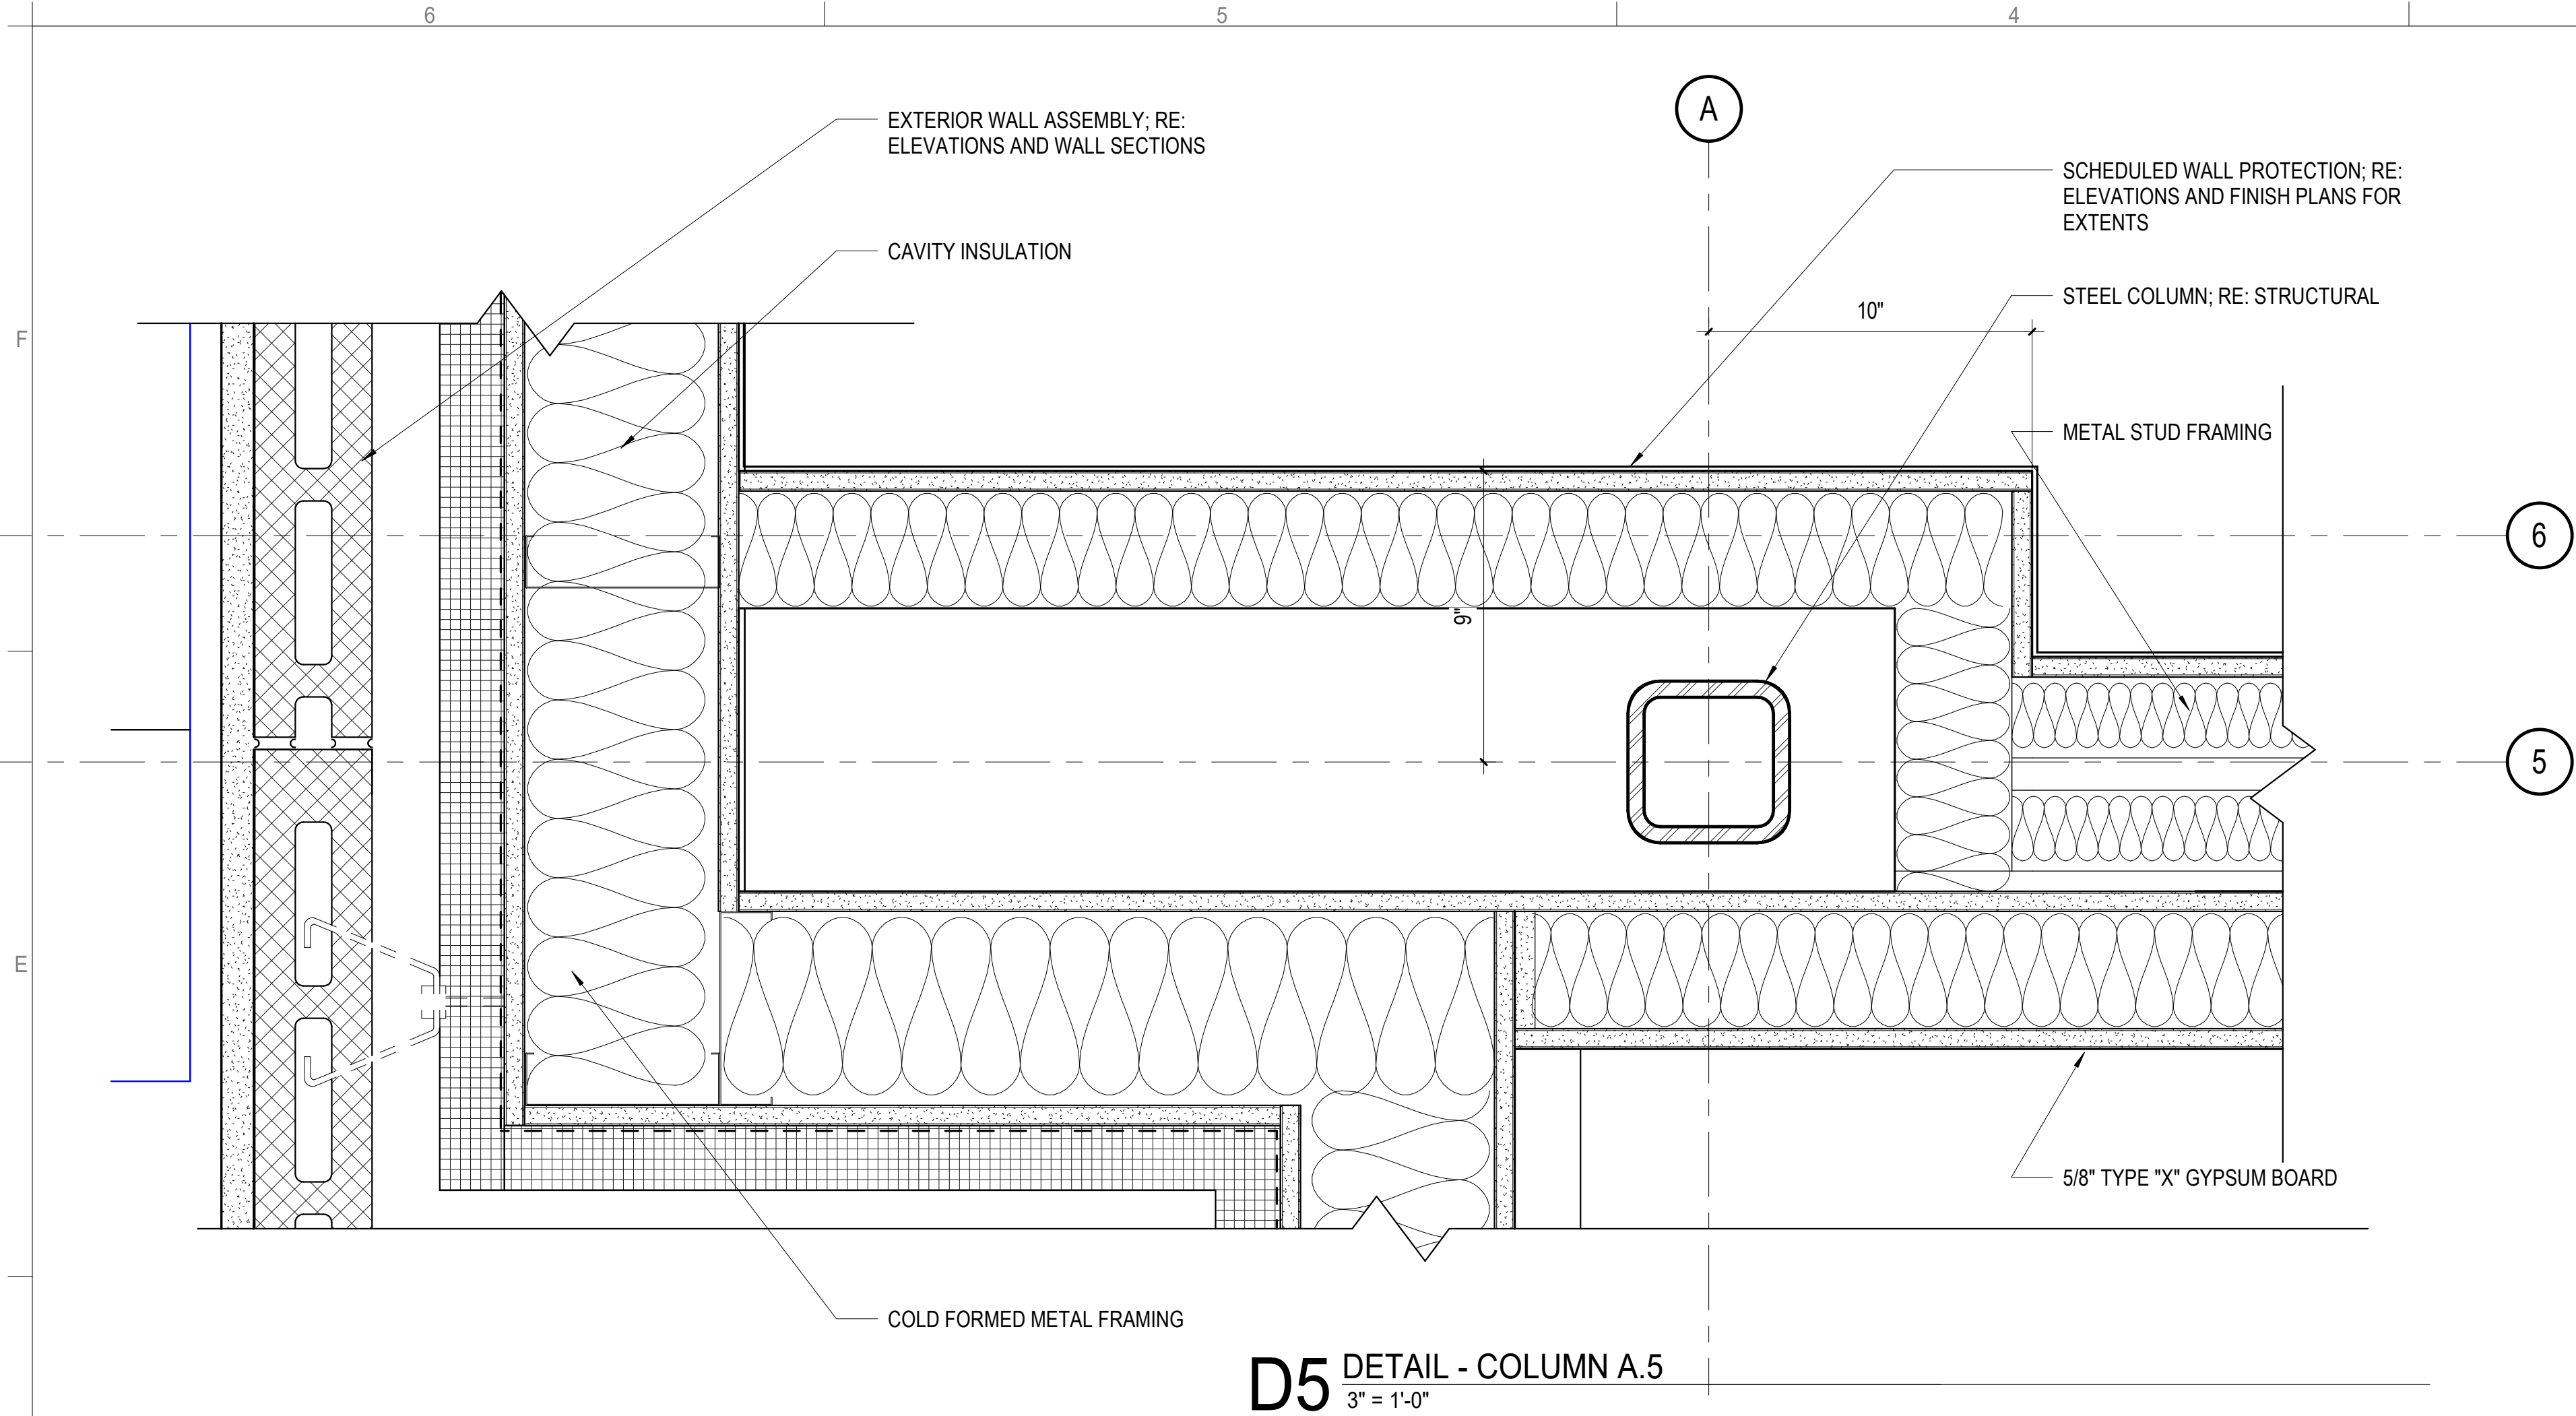


D5 DETAIL - COLUMN A.5
3" = 1'-0"

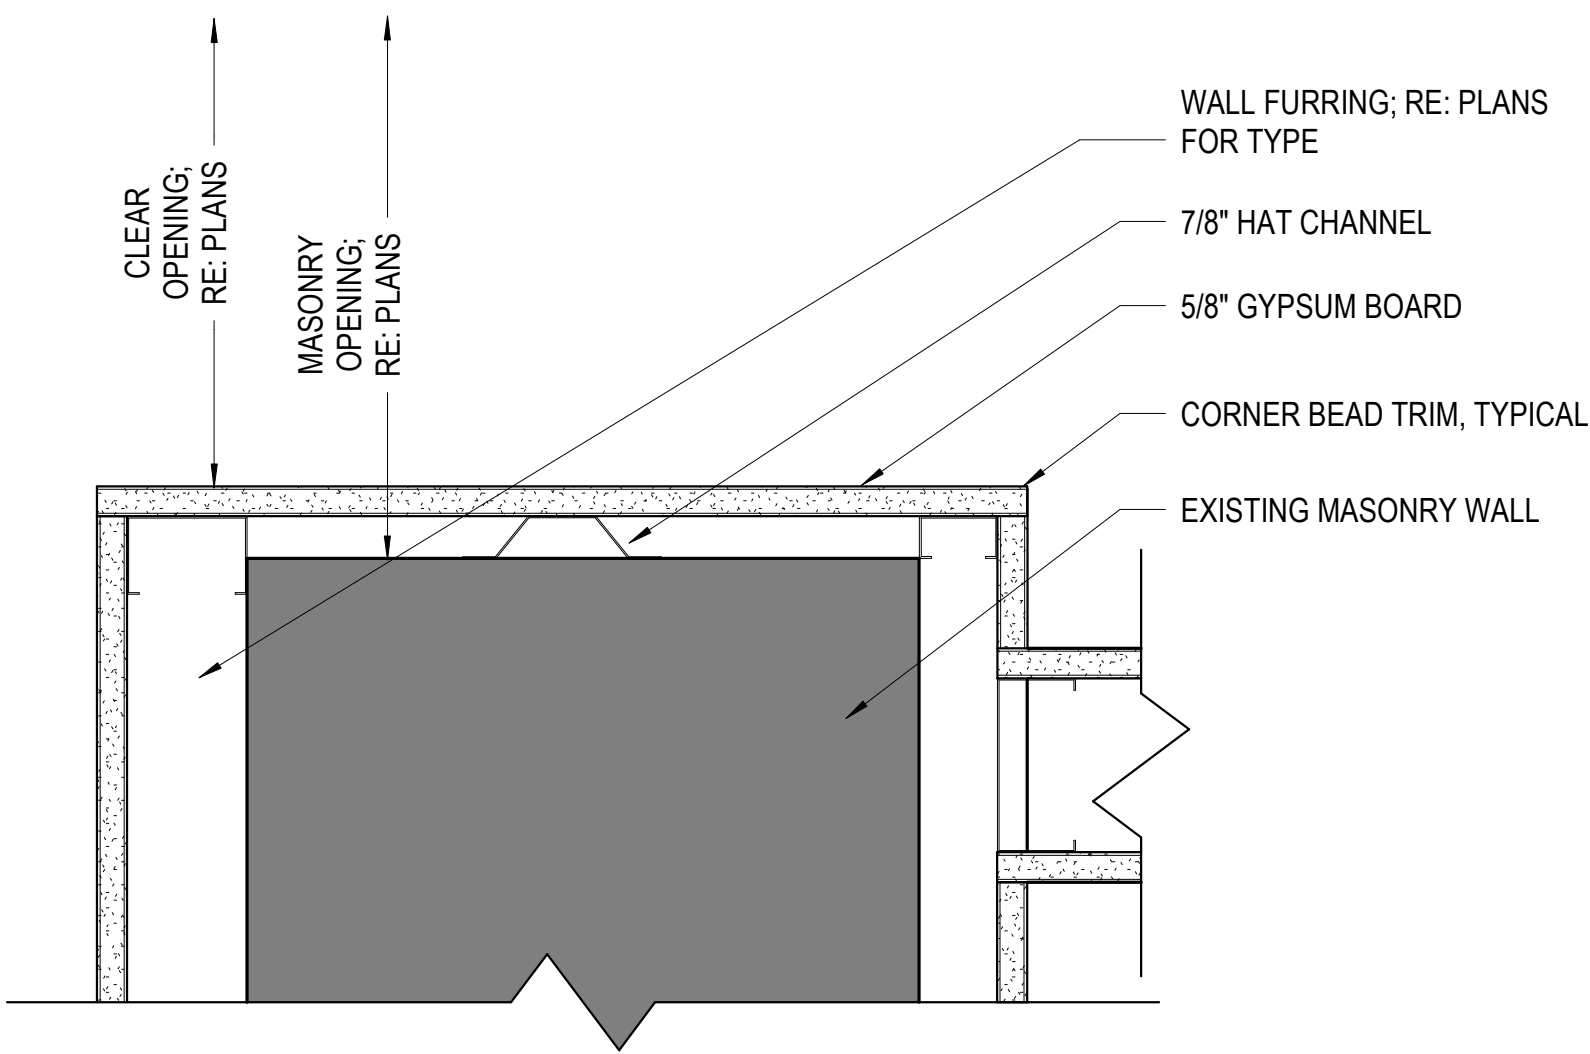


C5 DETAIL - TYPICAL MASONRY JAMB OPENING
3" = 1'-0"

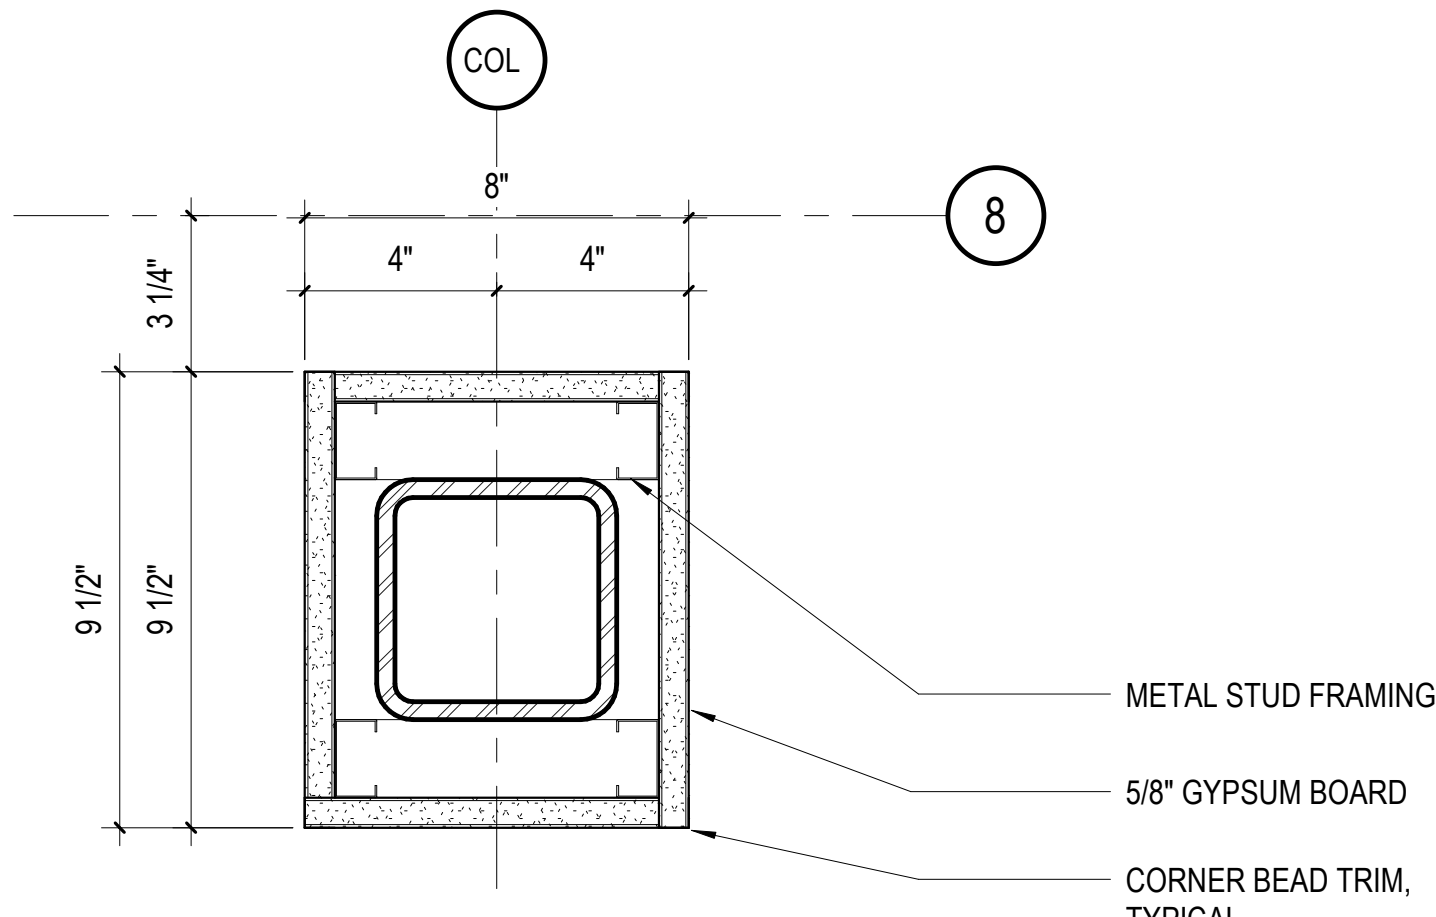


C3 DETAIL - COLUMN H.8
3" = 1'-0"

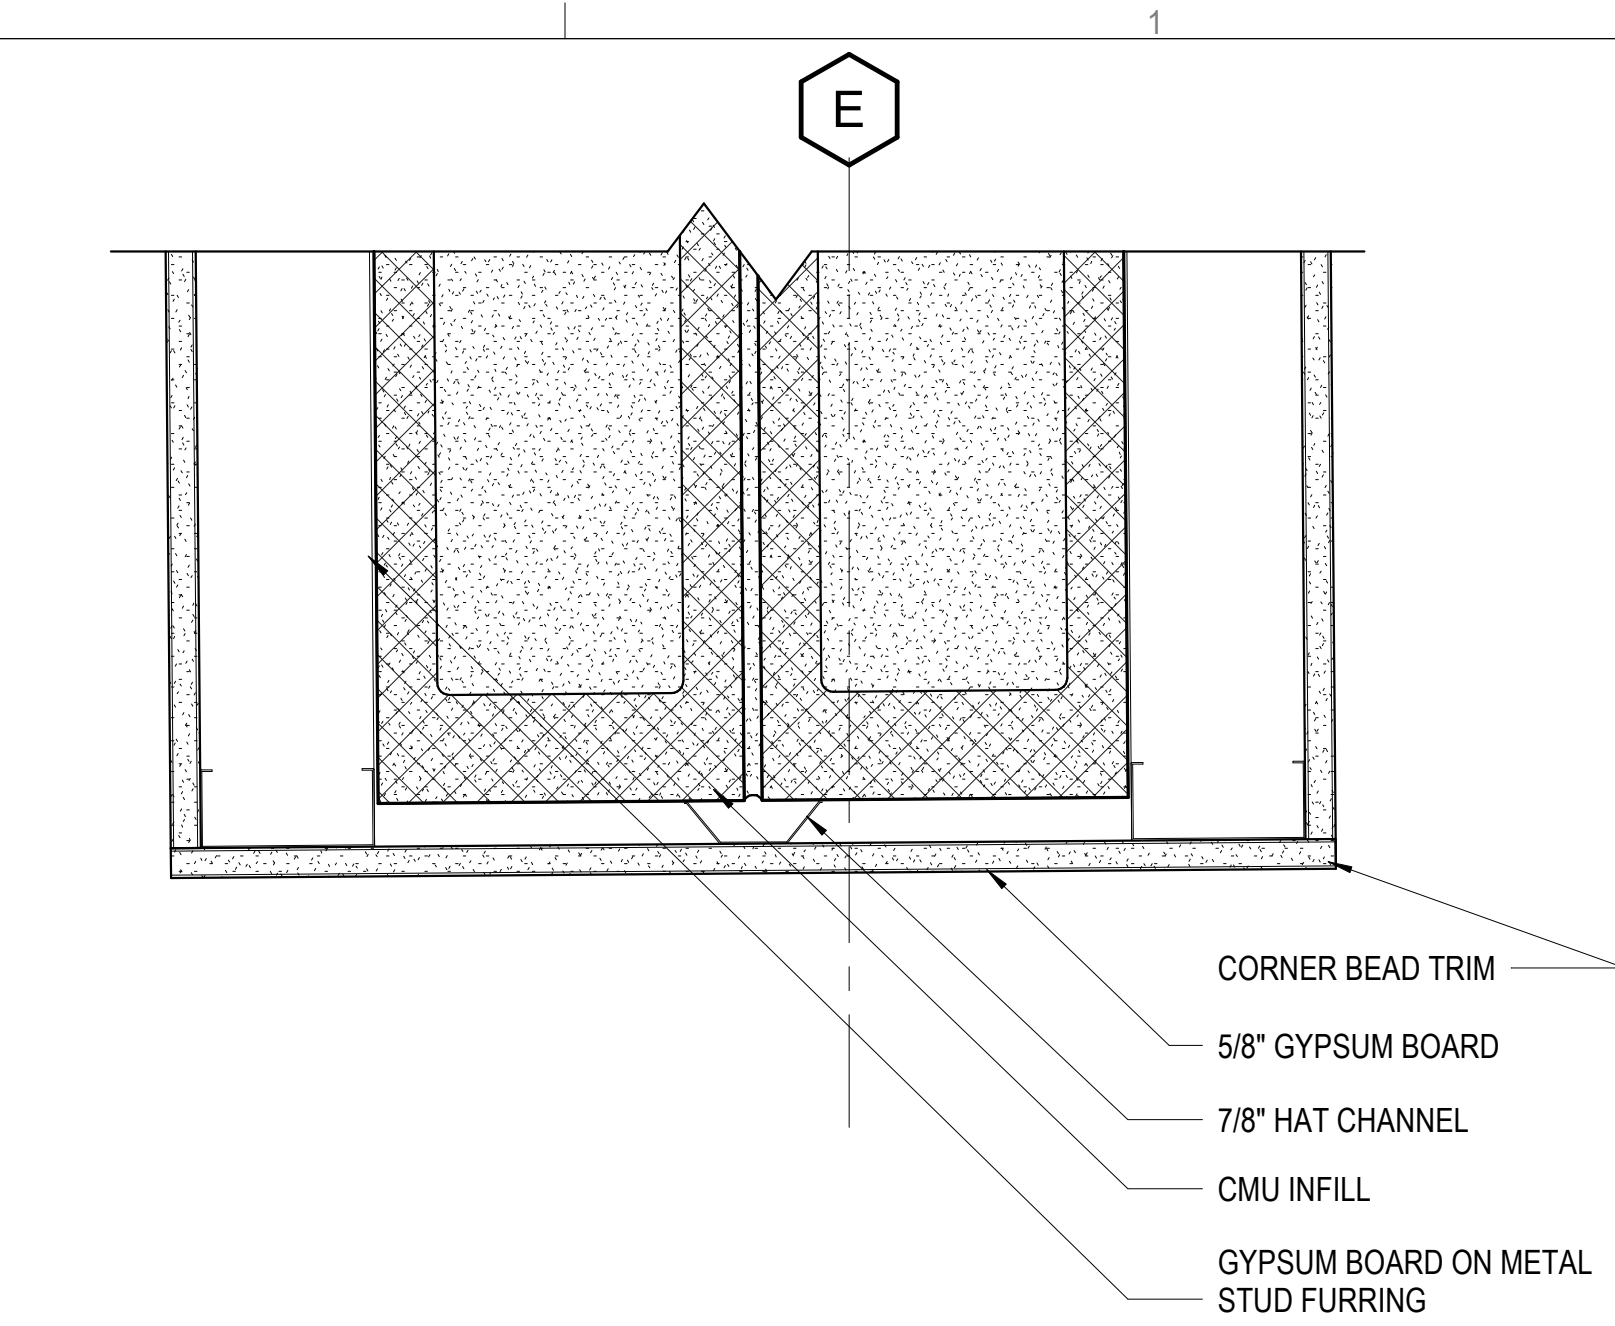


E1 MASONRY JAMB
3" = 1'-0"

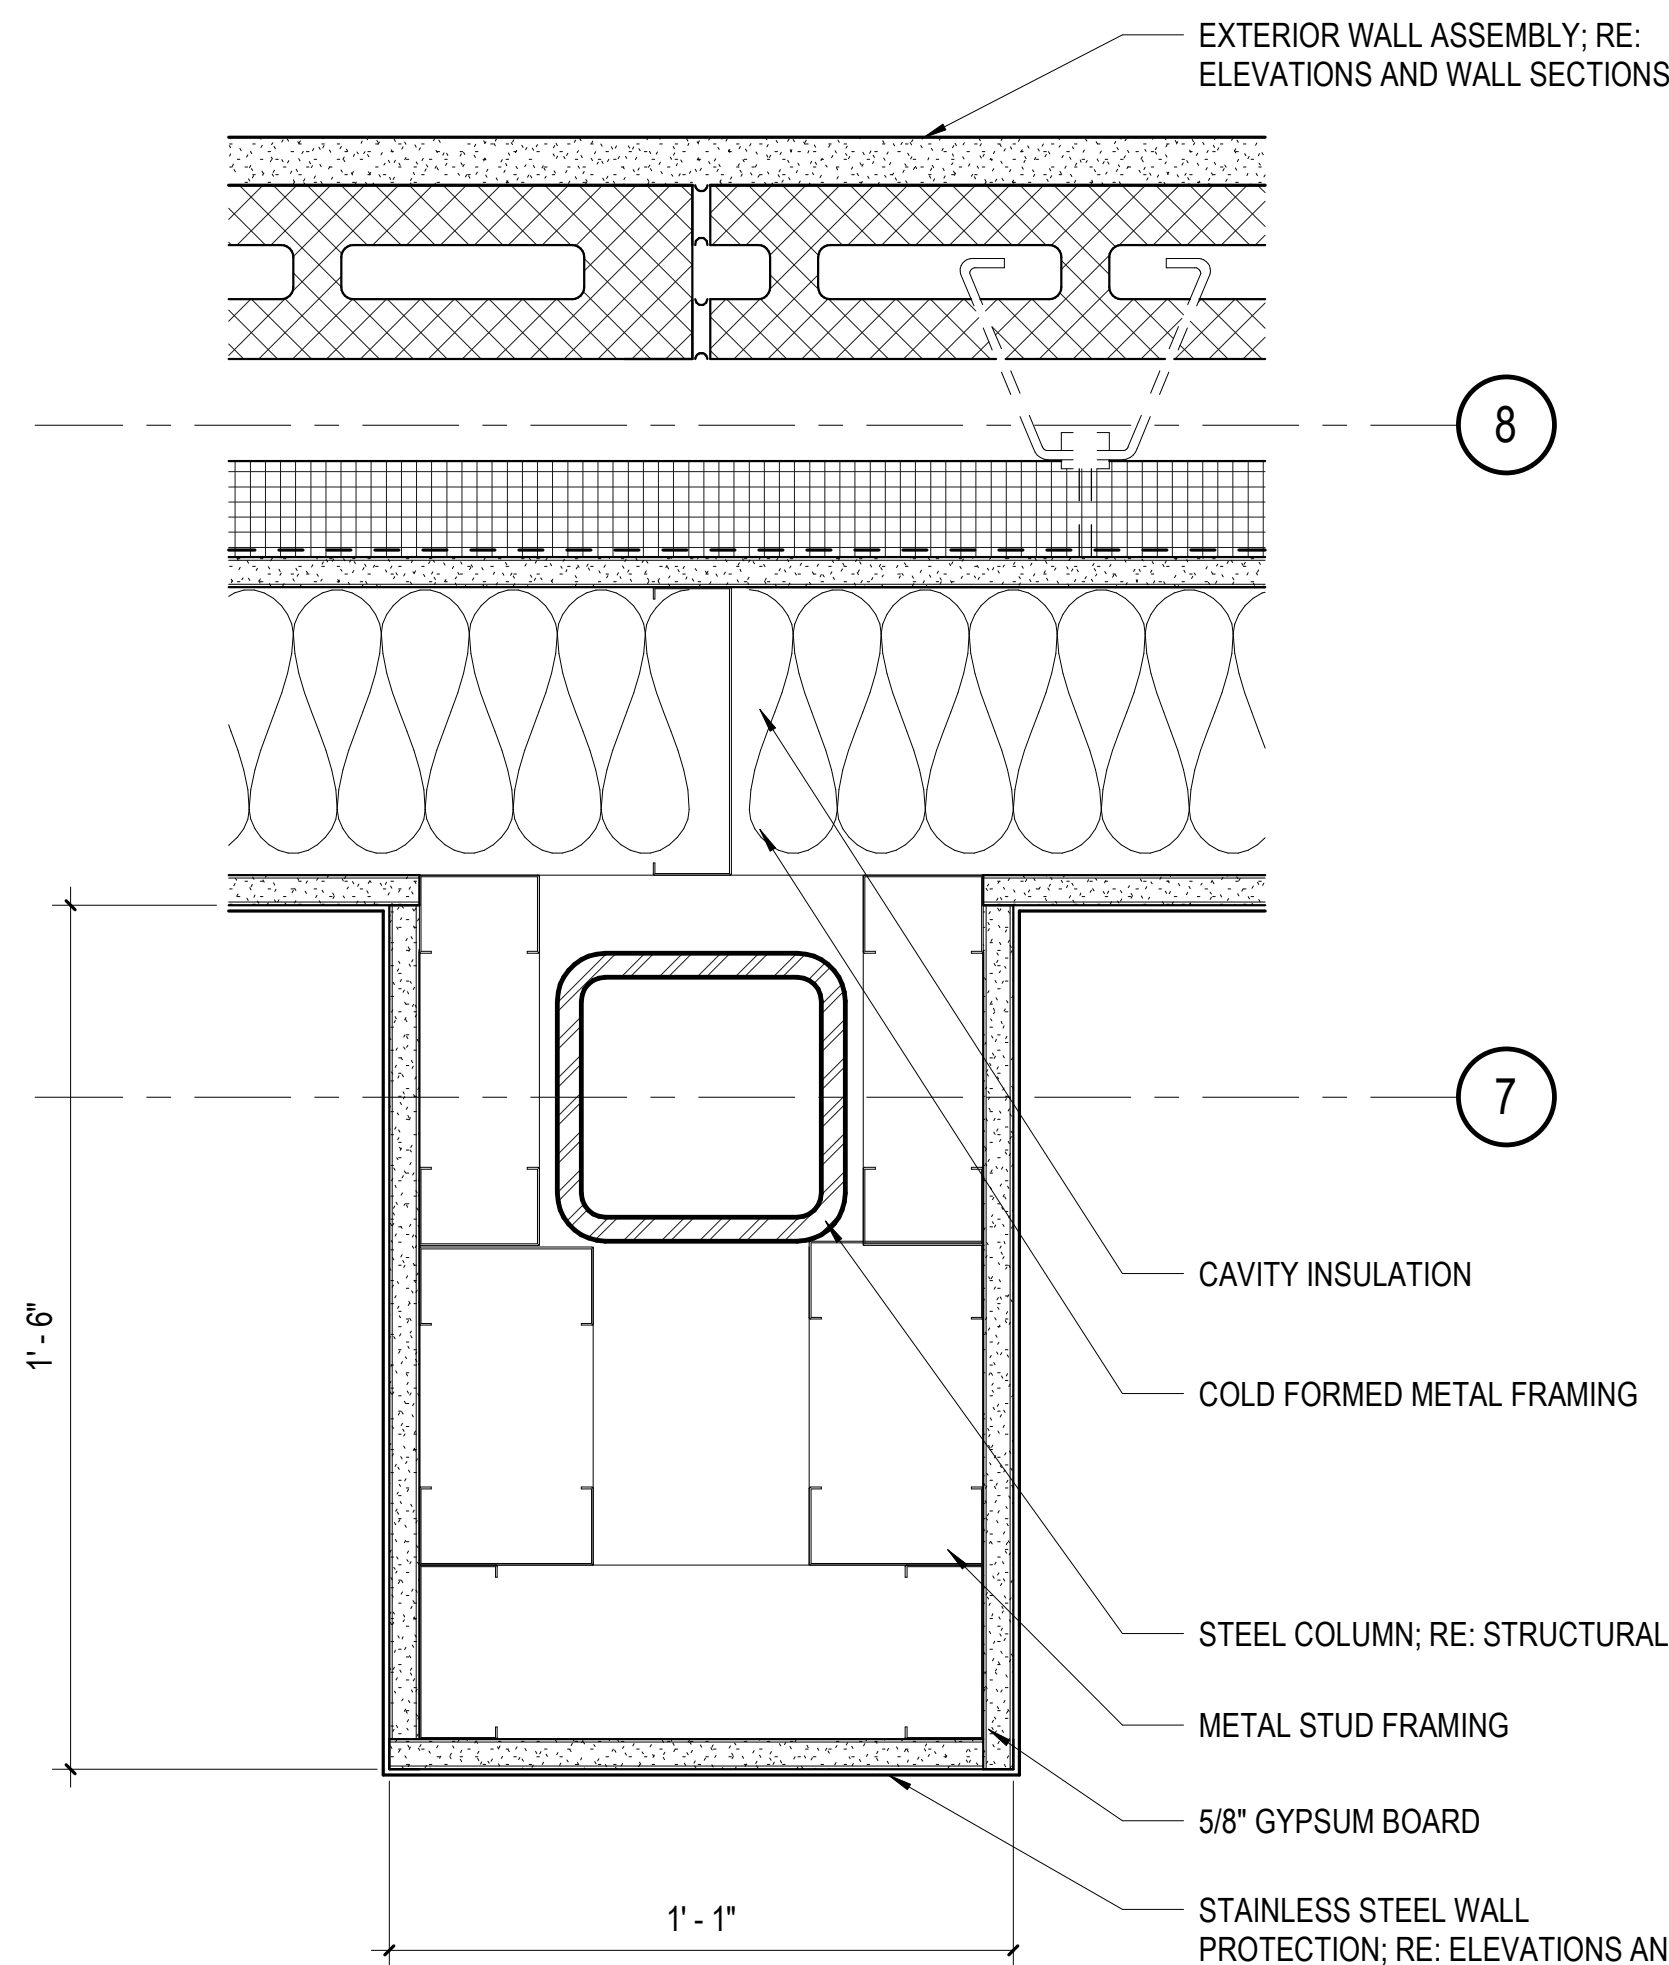


C1 DETAIL - COLUMN C.8
3" = 1'-0"

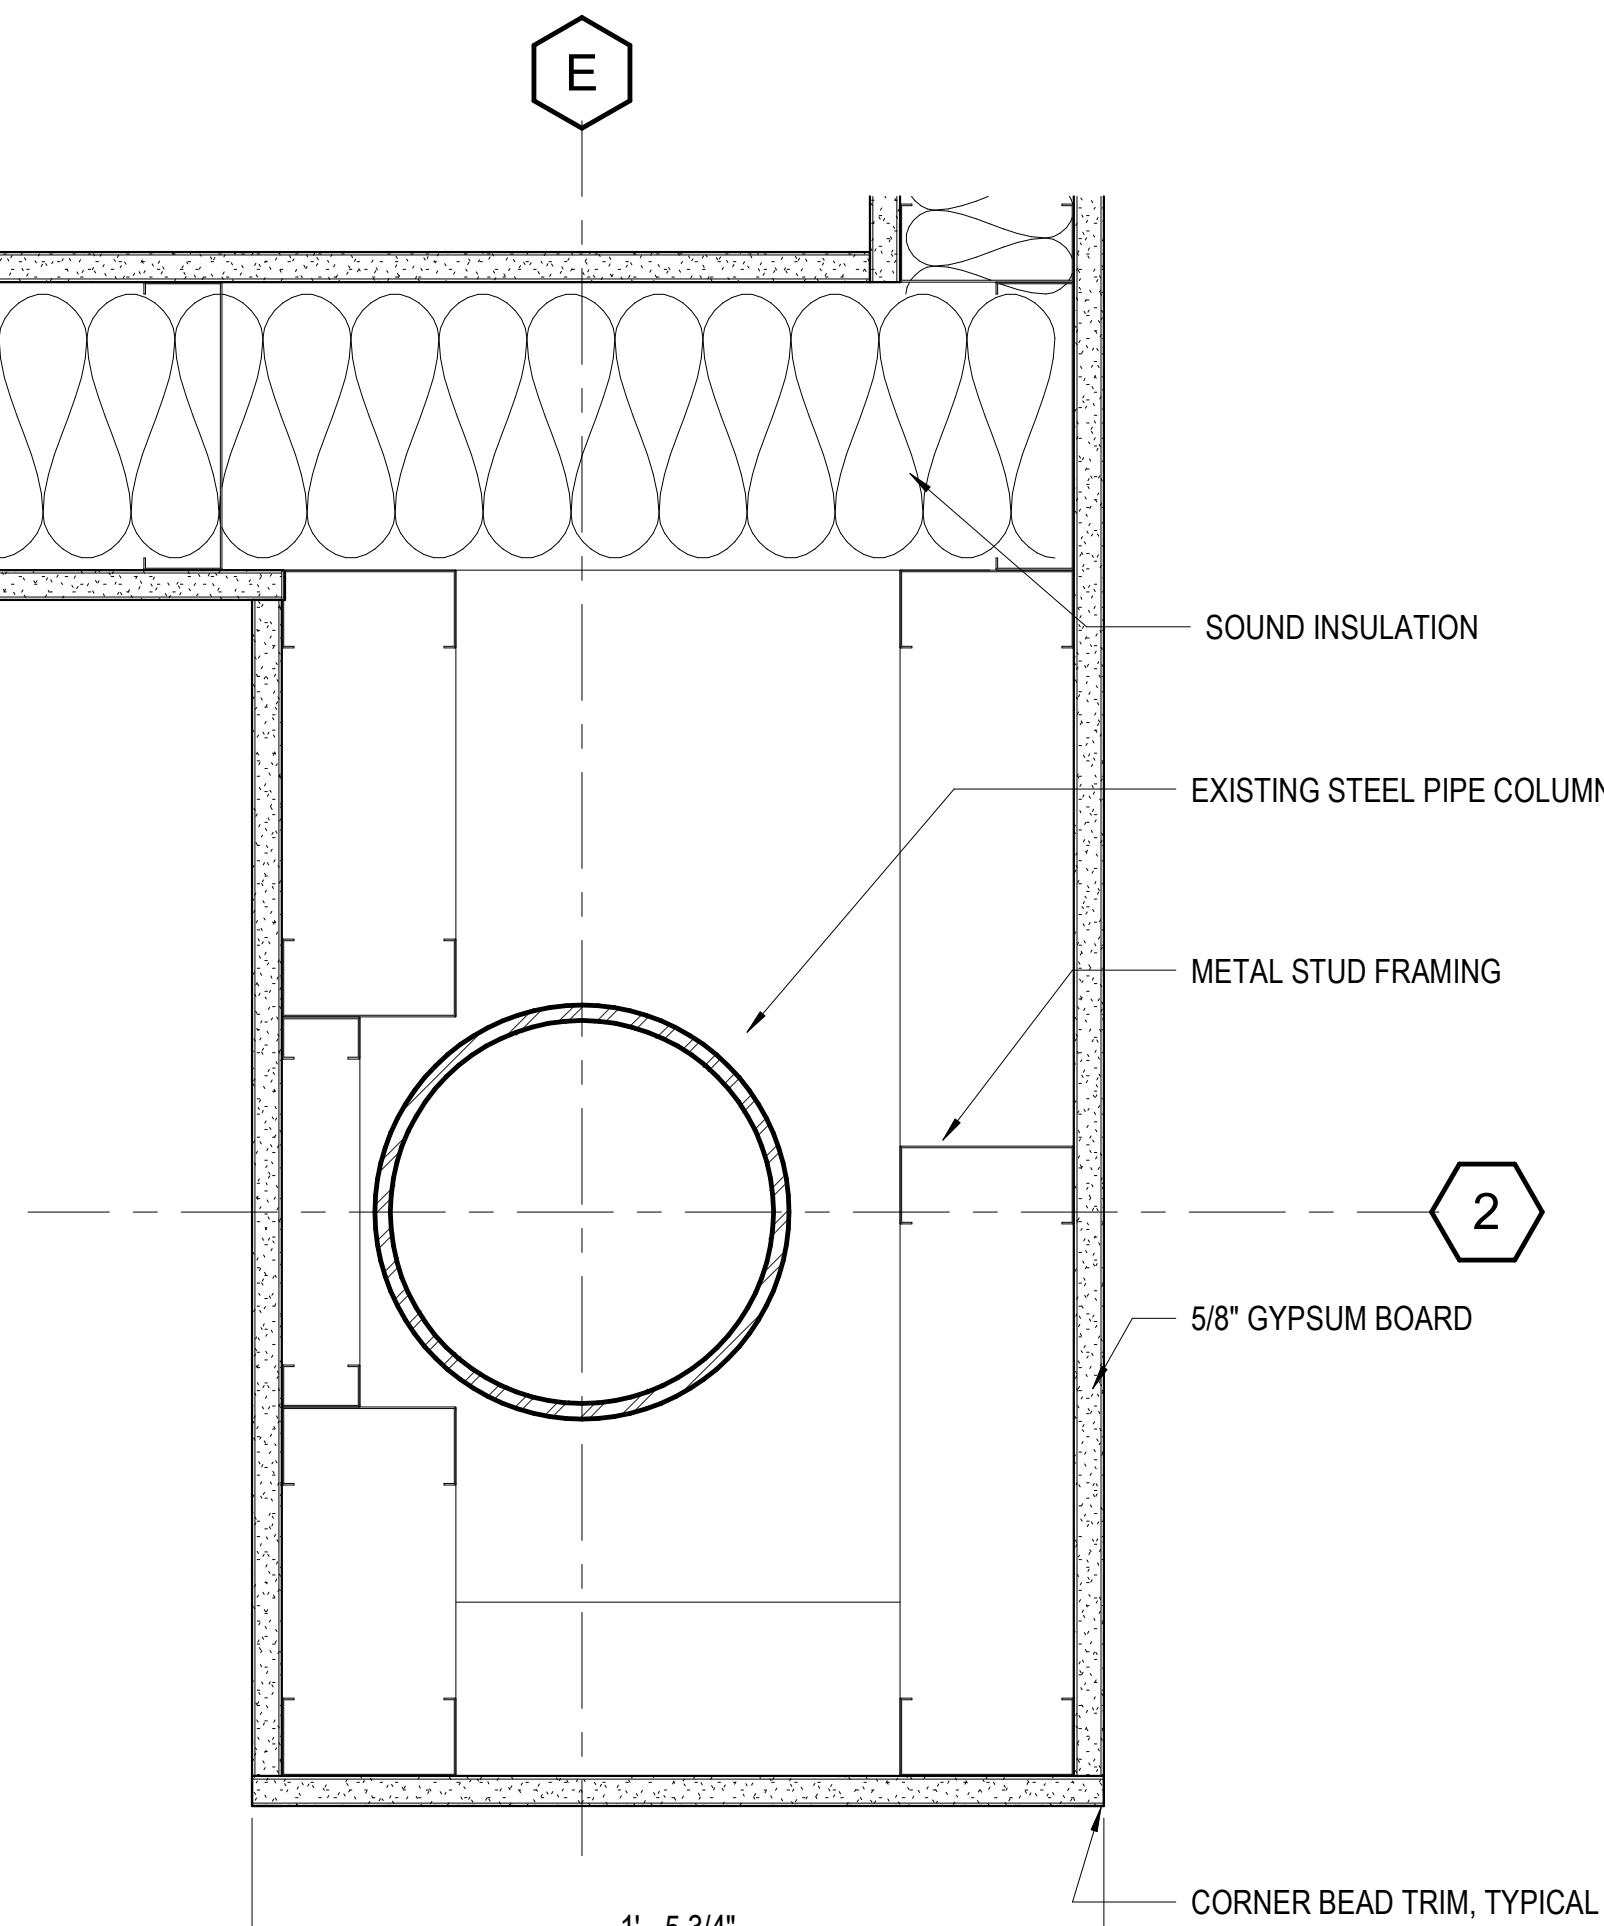


A6 DETAIL - COLUMN E.2
3" = 1'-0"

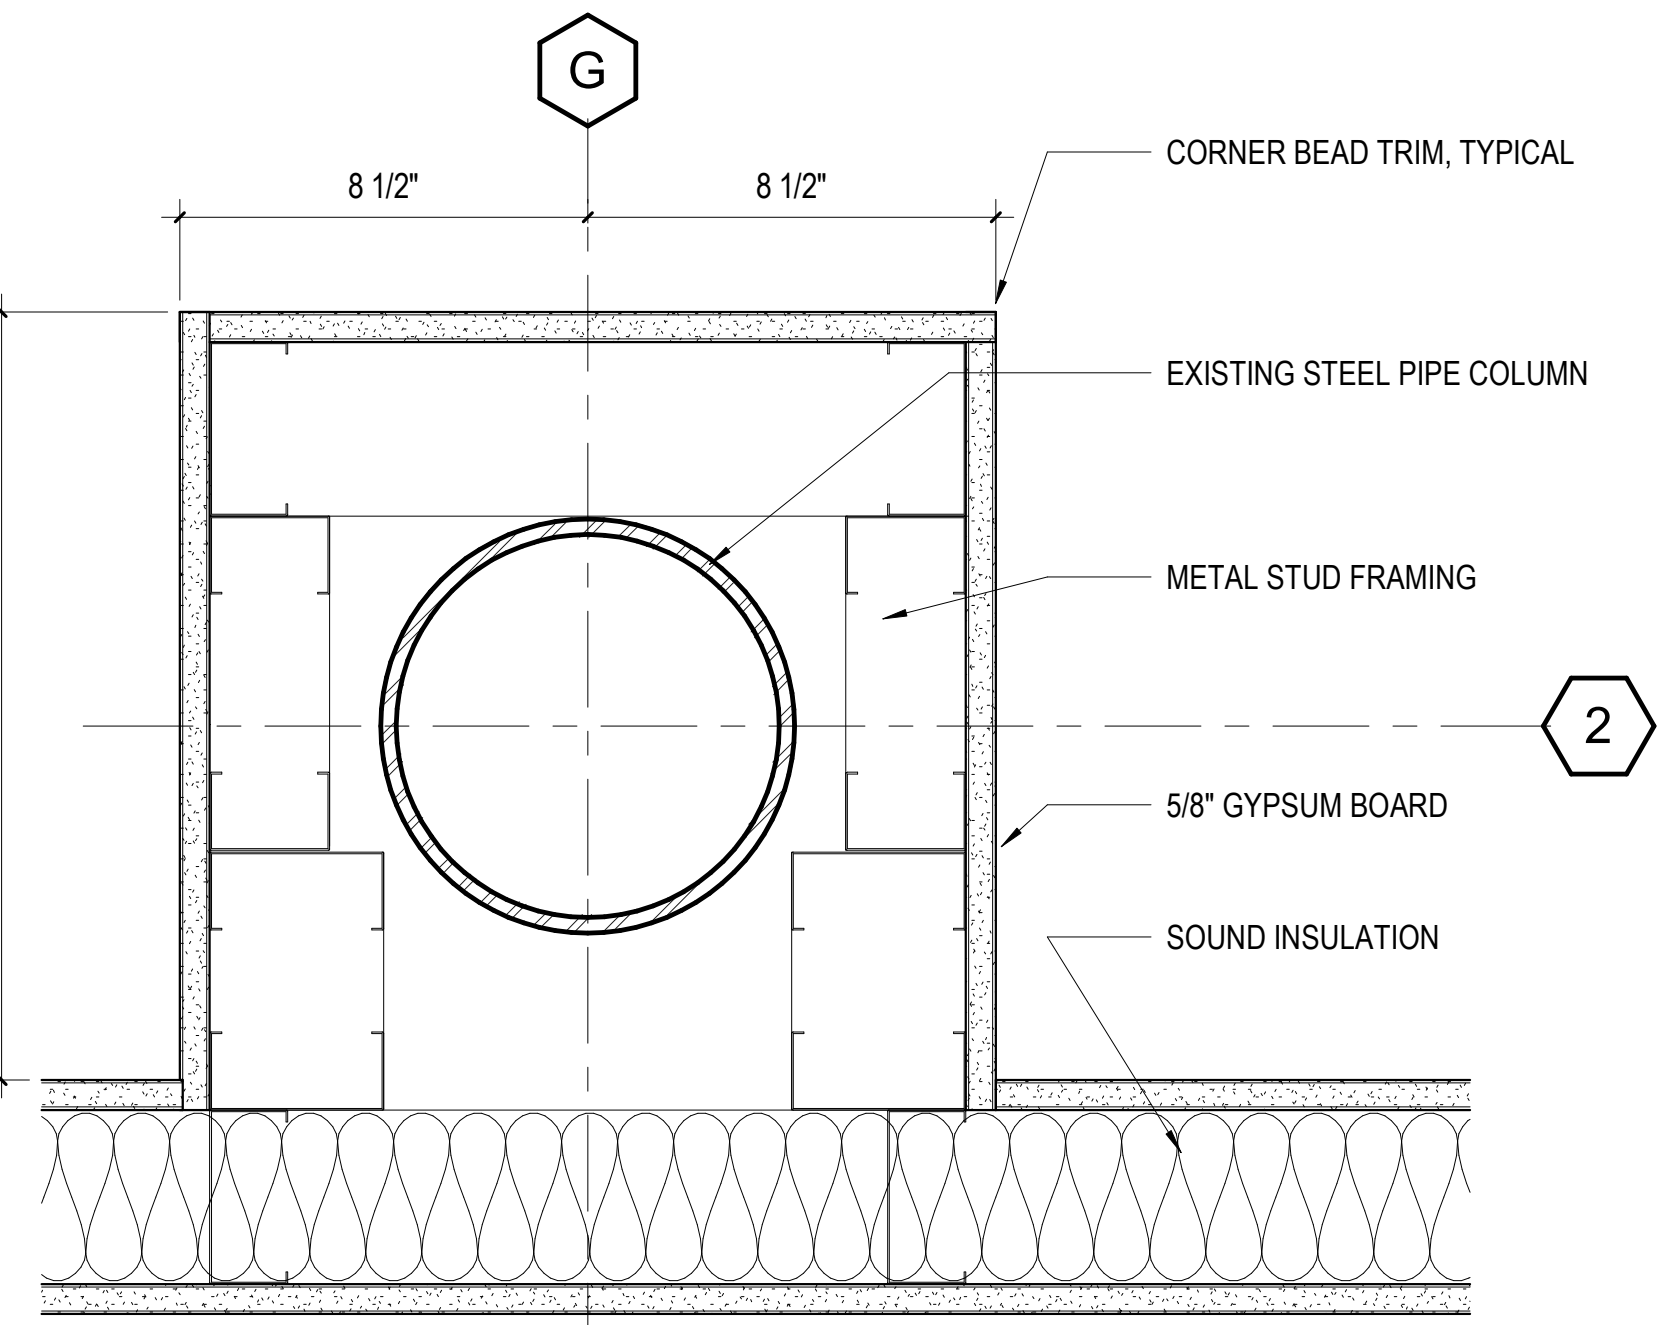

A5 DETAIL - COLUMN G.1
3" = 1'-0"

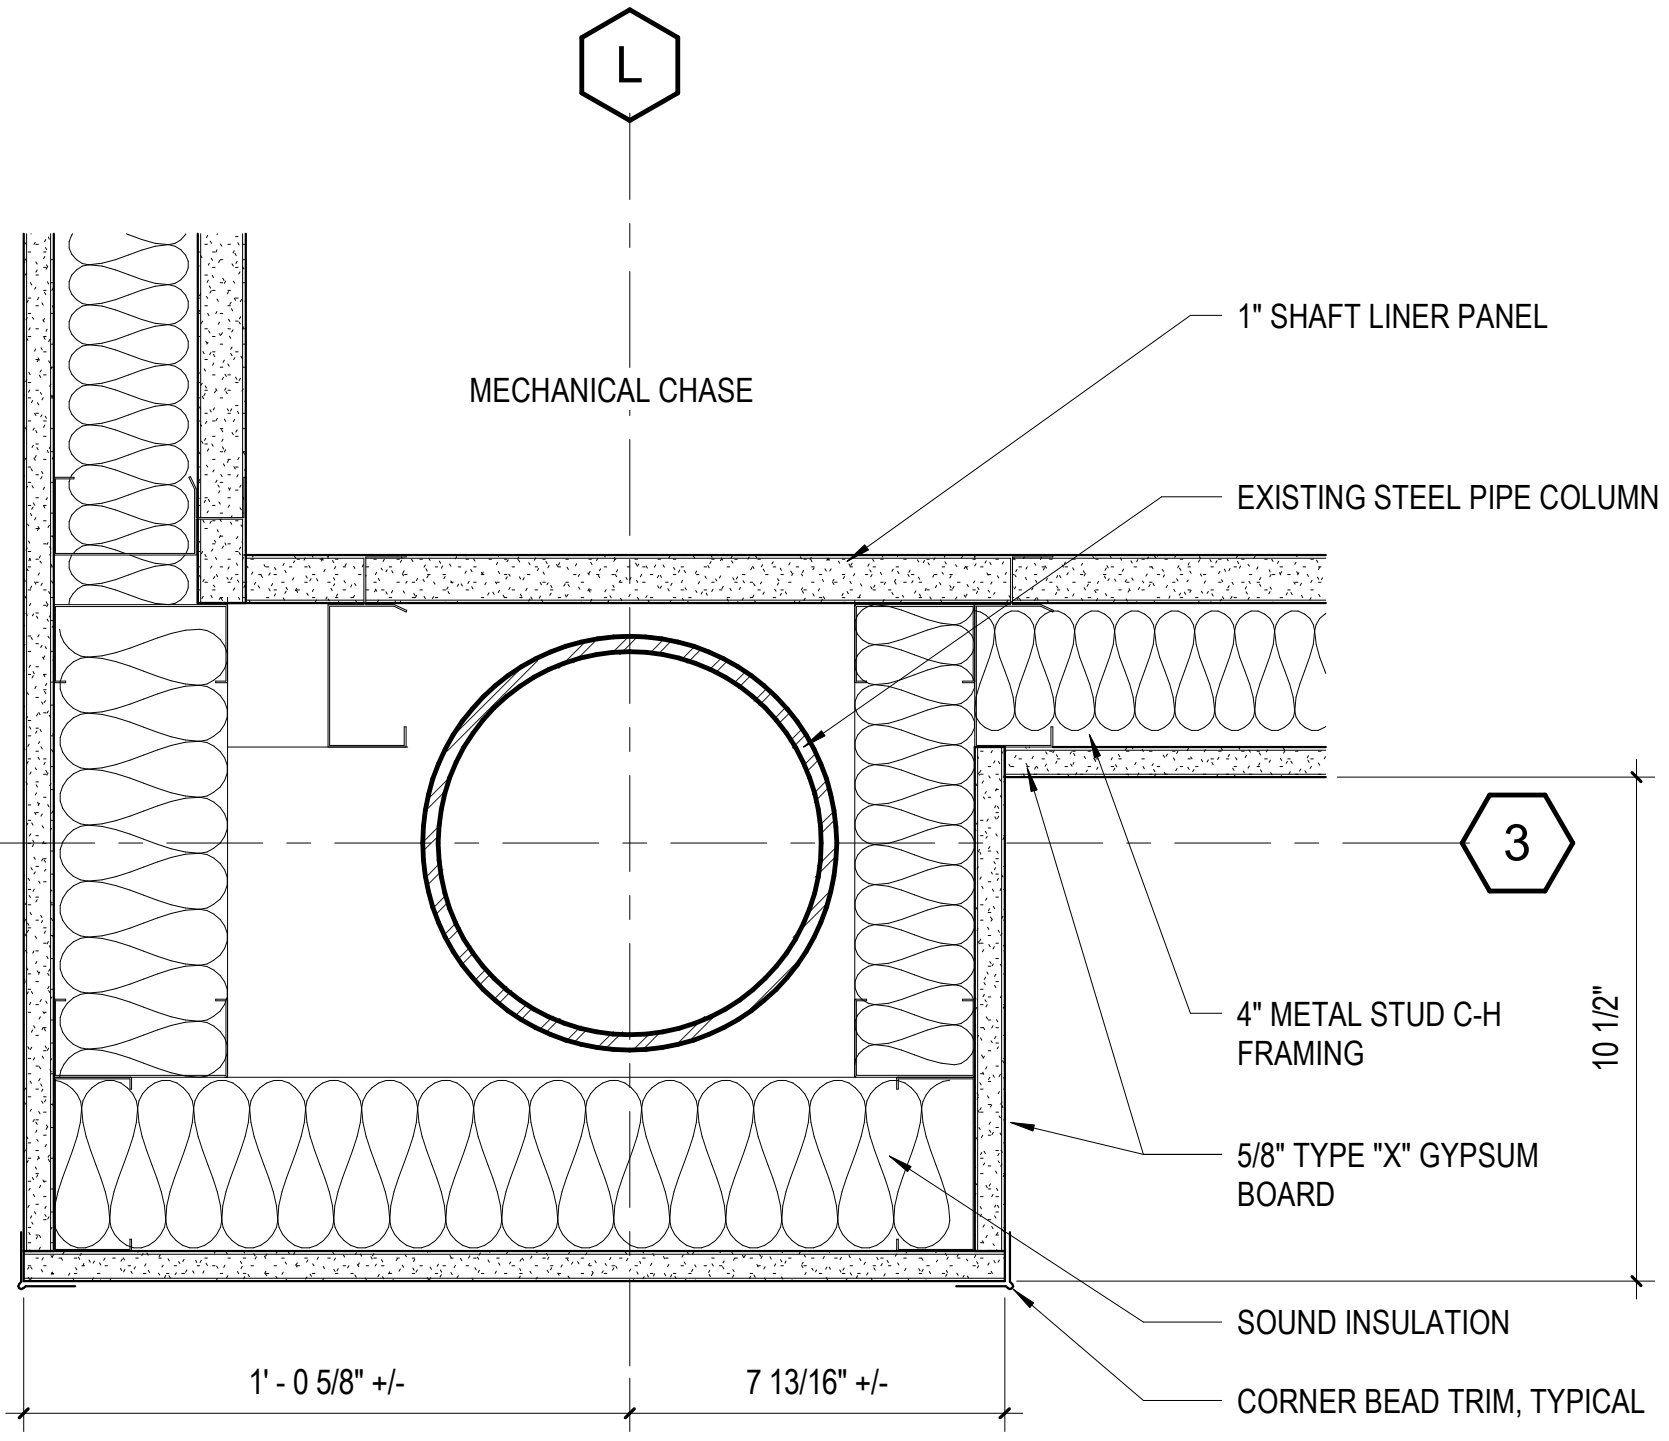

A3 DETAIL - COLUMN L.3
3" = 1'-0"

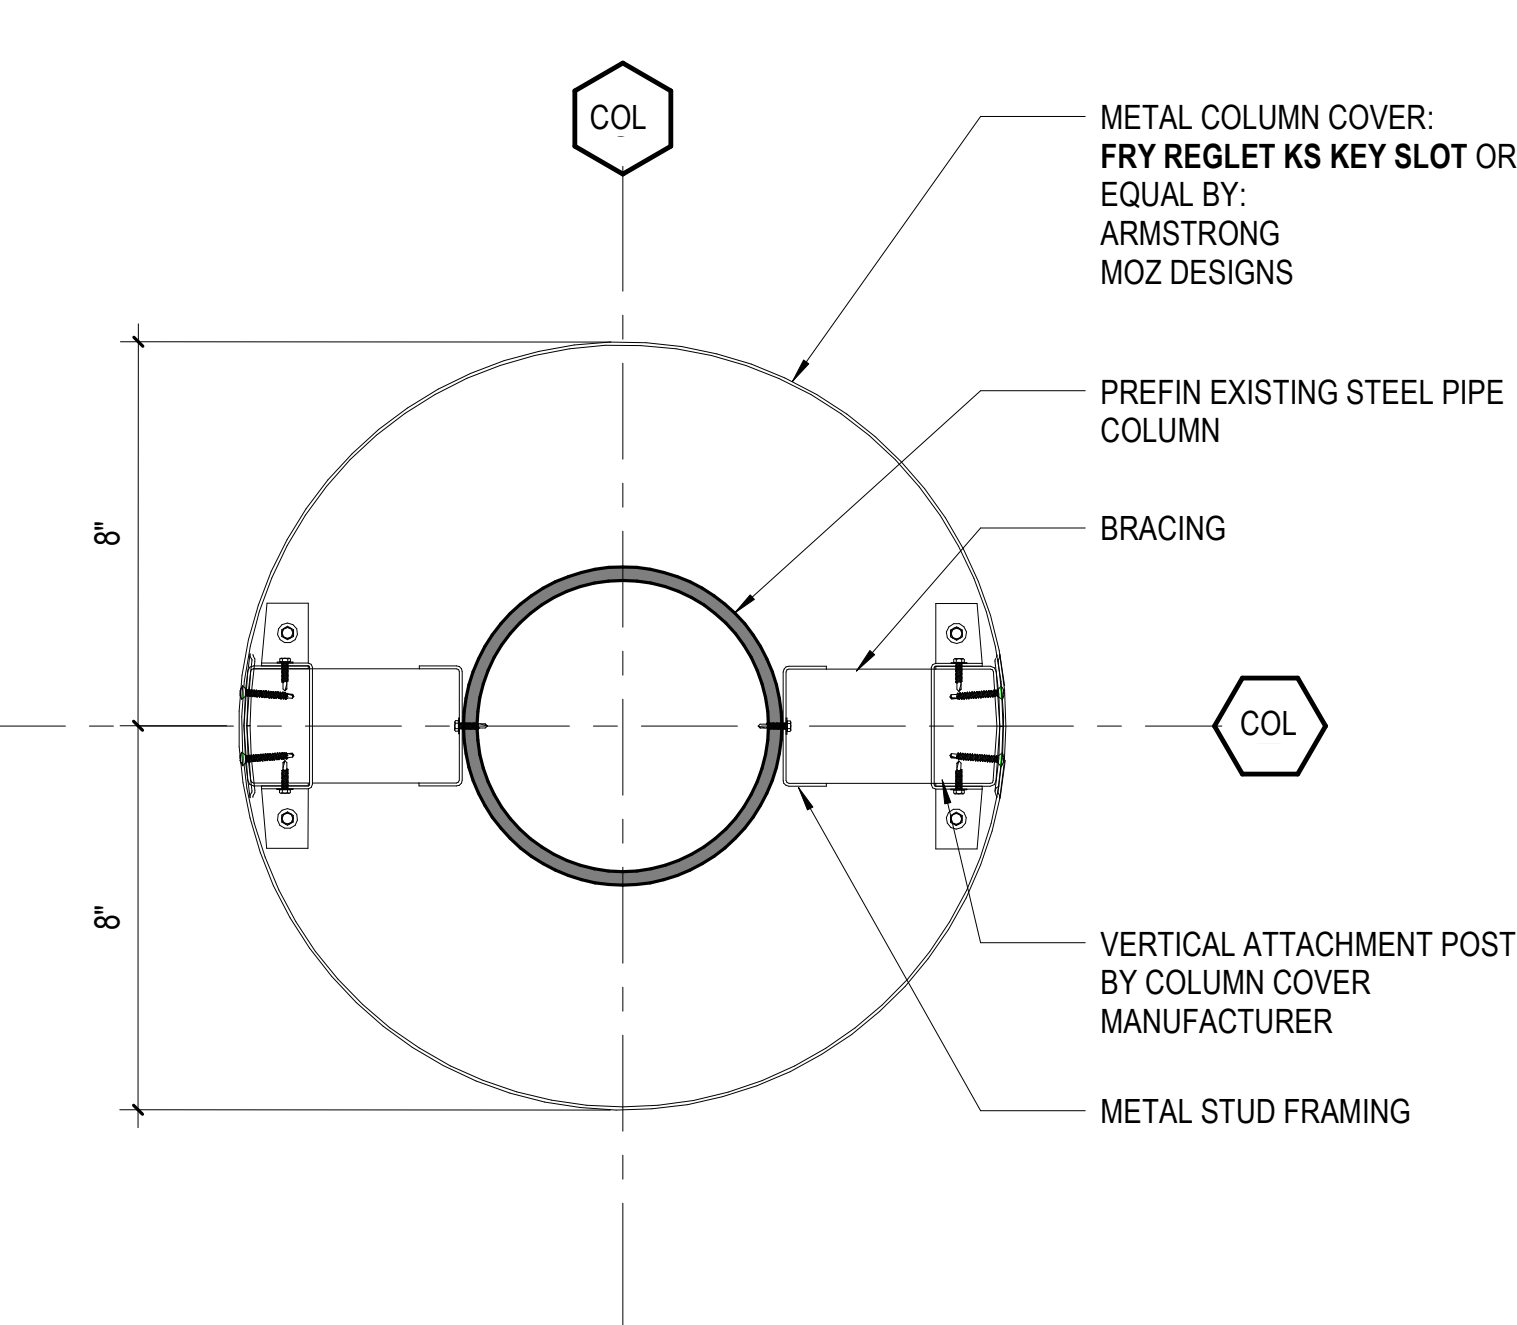

A1 COLUMN COVER DETAIL
3" = 1'-0"

K|P|S
GROUP


BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
REGISTERED ARCHITECT
3531
By DONALD C. SIMPSON

McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: DOWNS 202483
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24
REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE
DETAILS - PLAN INTERIOR





DRAWN BY: Author
CHECKED BY: Checker
PROJECT NUMBER
236002-02
DRAWING NO.
A5.21

PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



B4 STONE - MOUNTING BLOCK


3" = 1'-0"

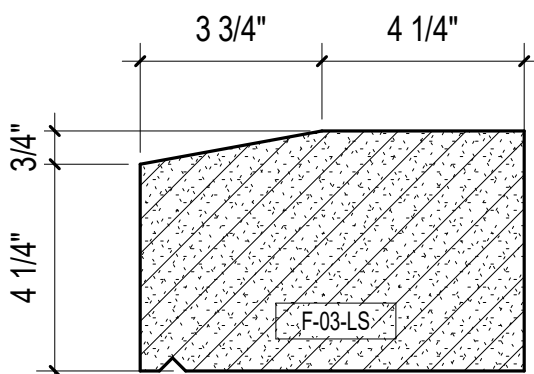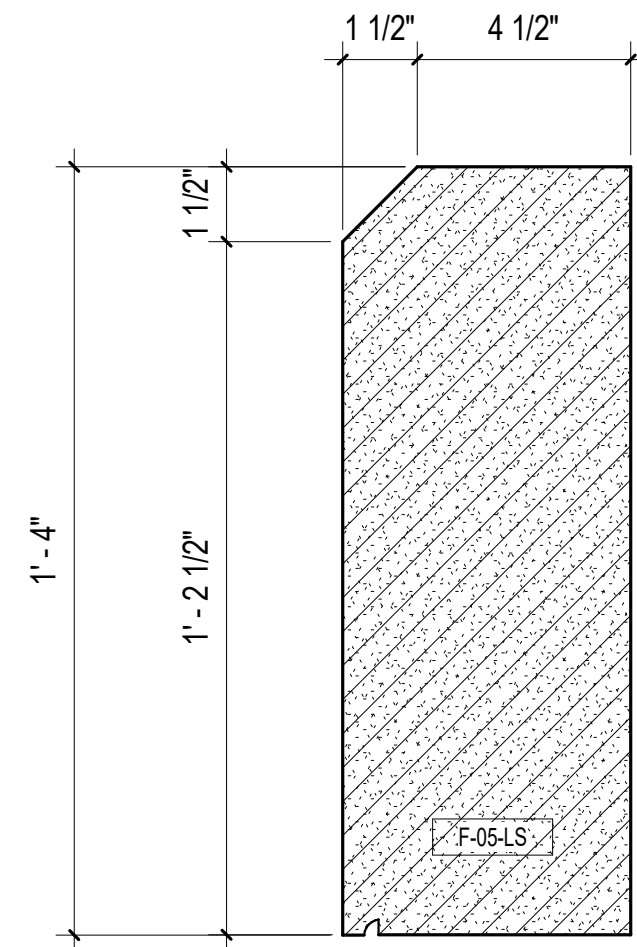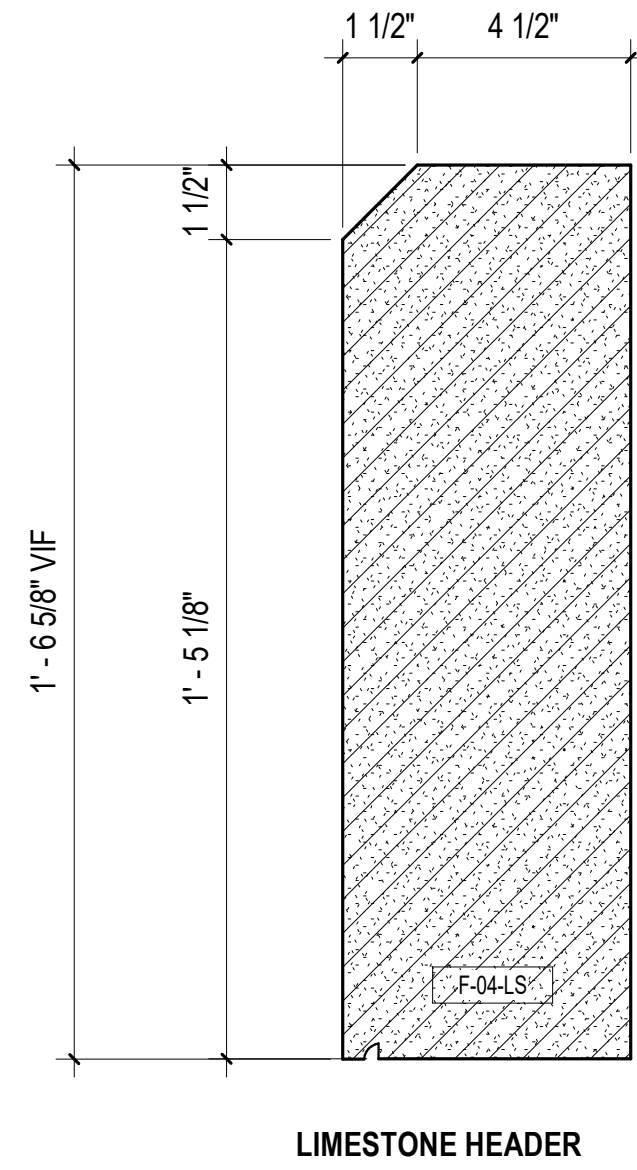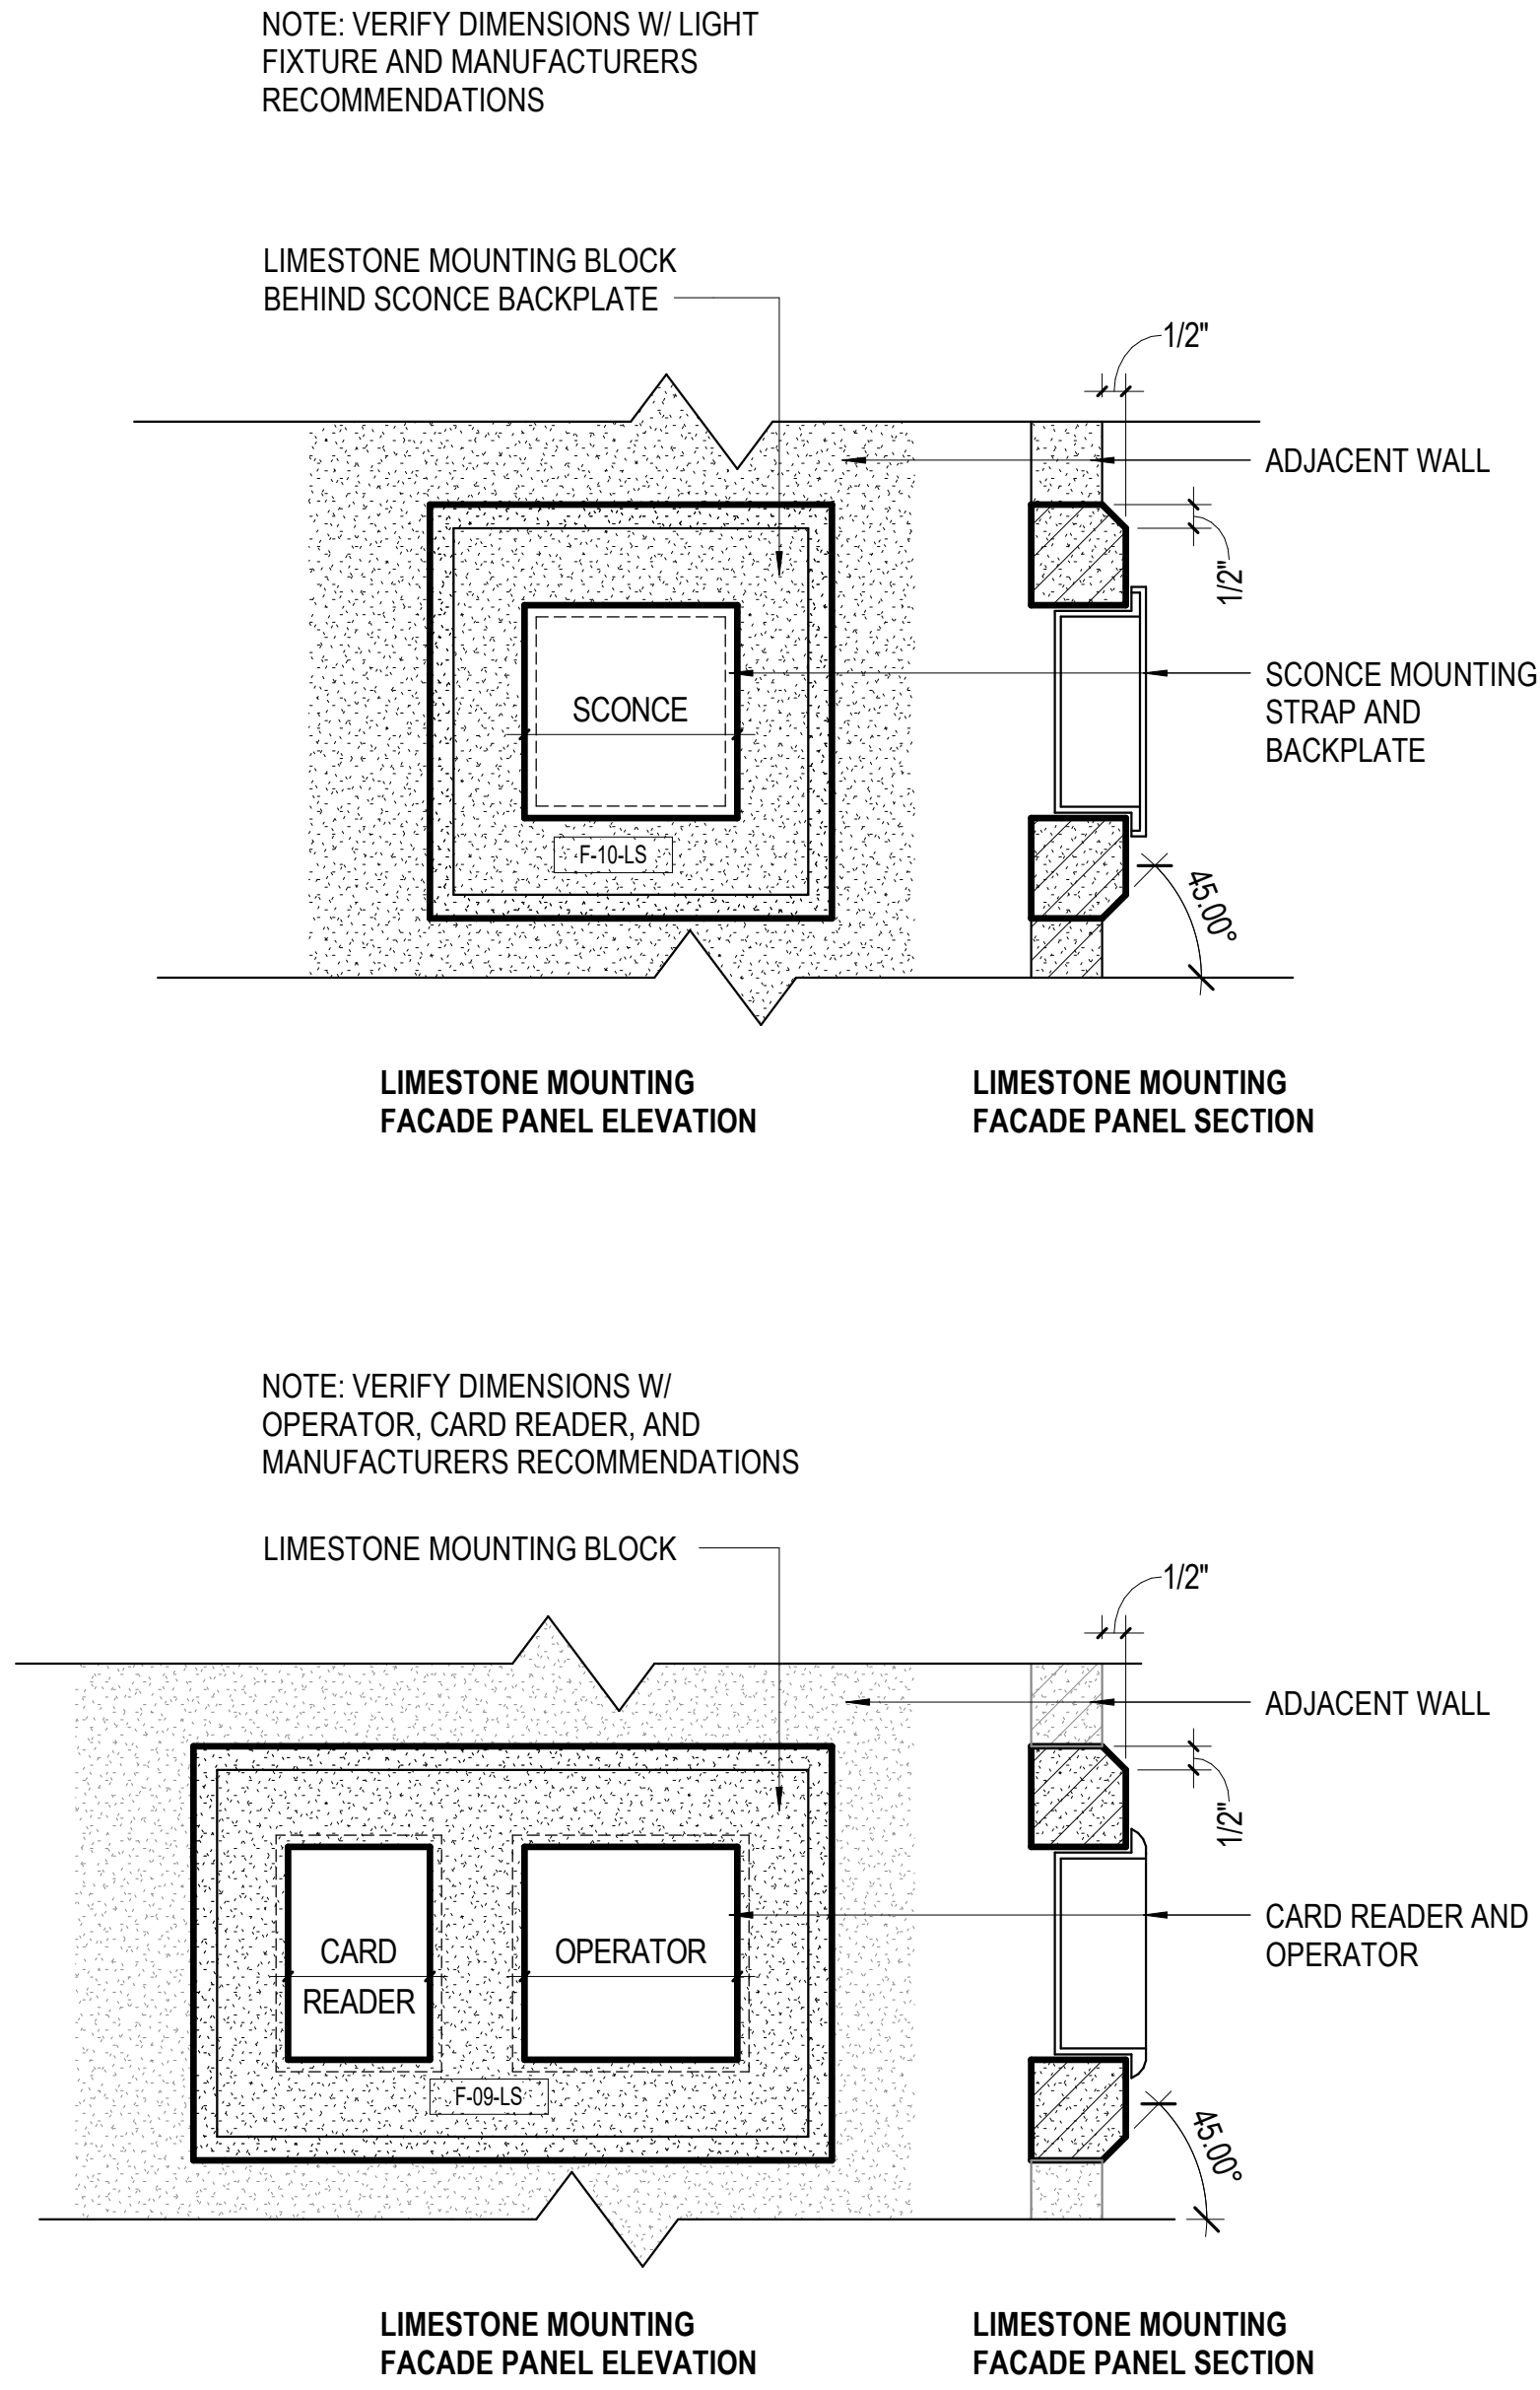

LIMESTONE SILL TO MATCH EXISTING (VERIFY IN FIELD)


B2 STONE - NEW WALL COMPONENTS

3" = 1'-0"

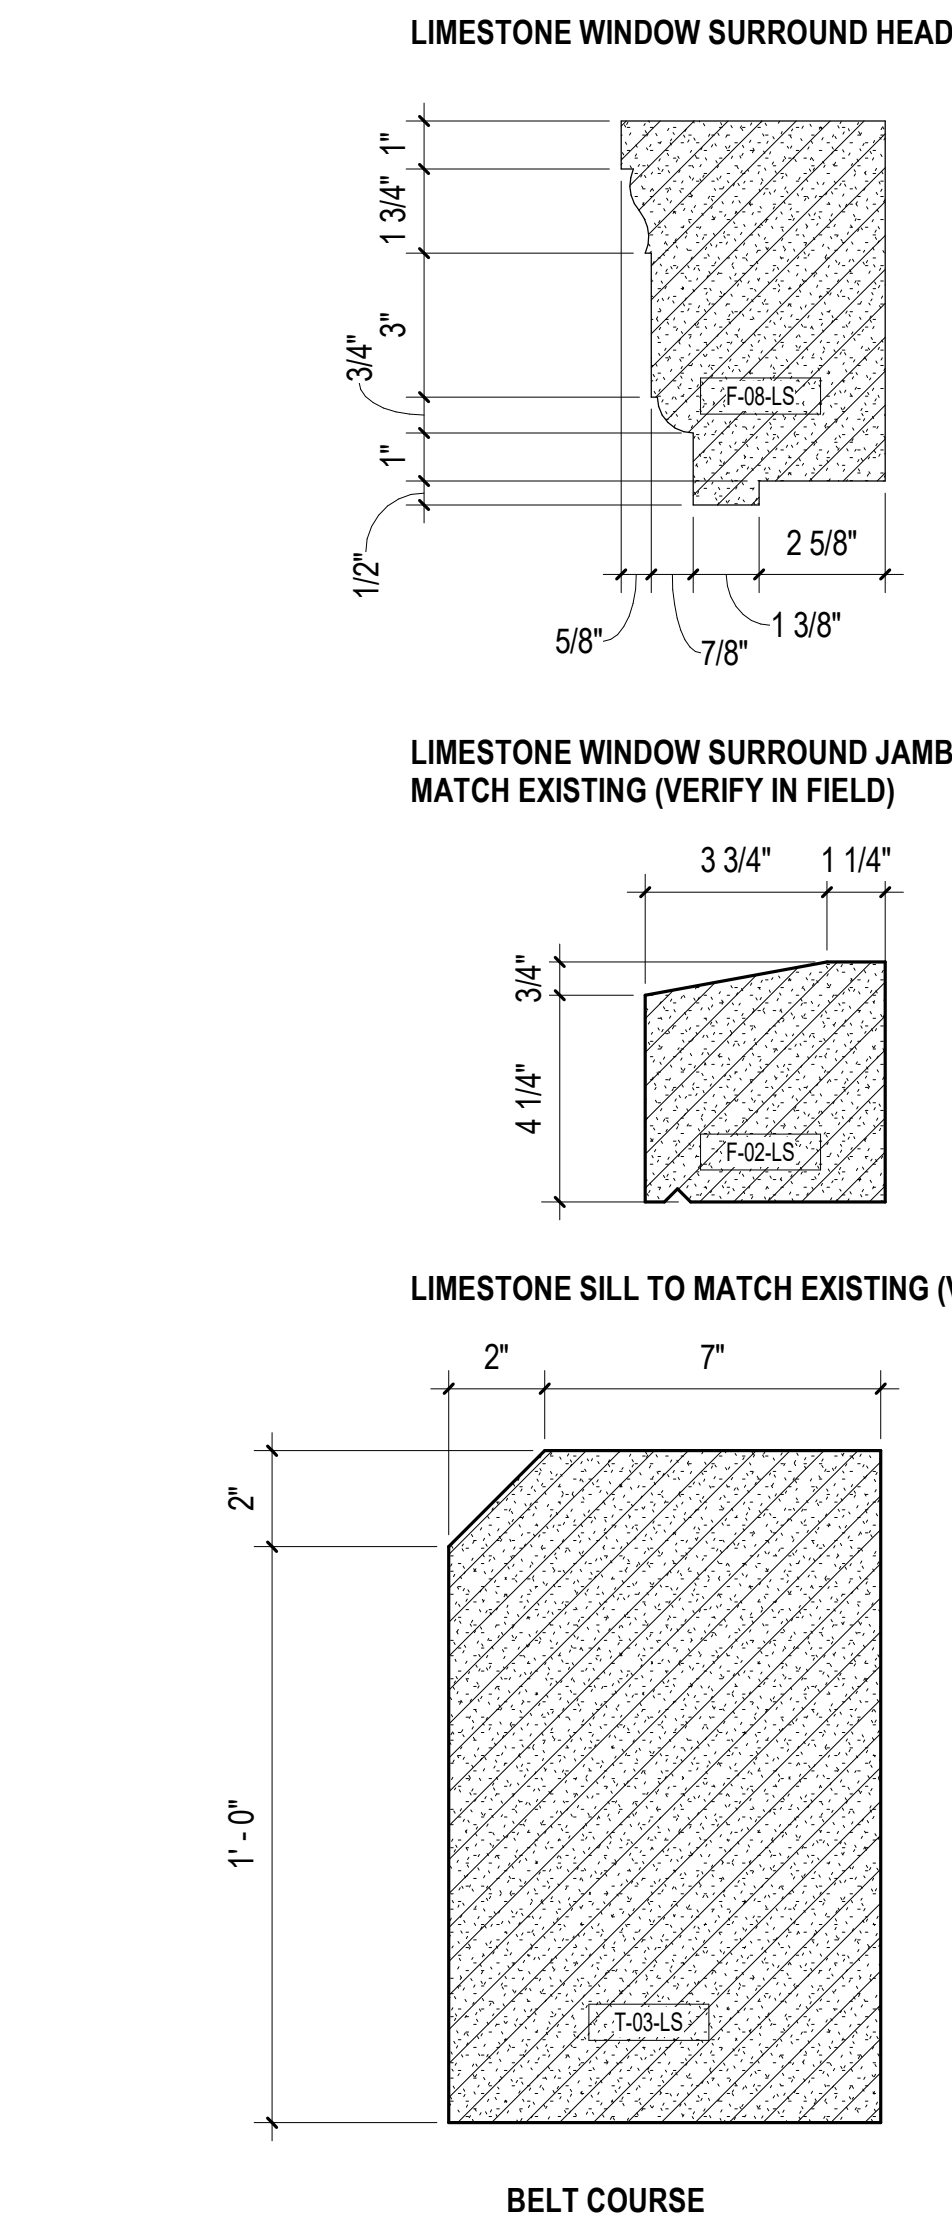


B1 STONE - WEST ENTRY

3" = 1'-0"

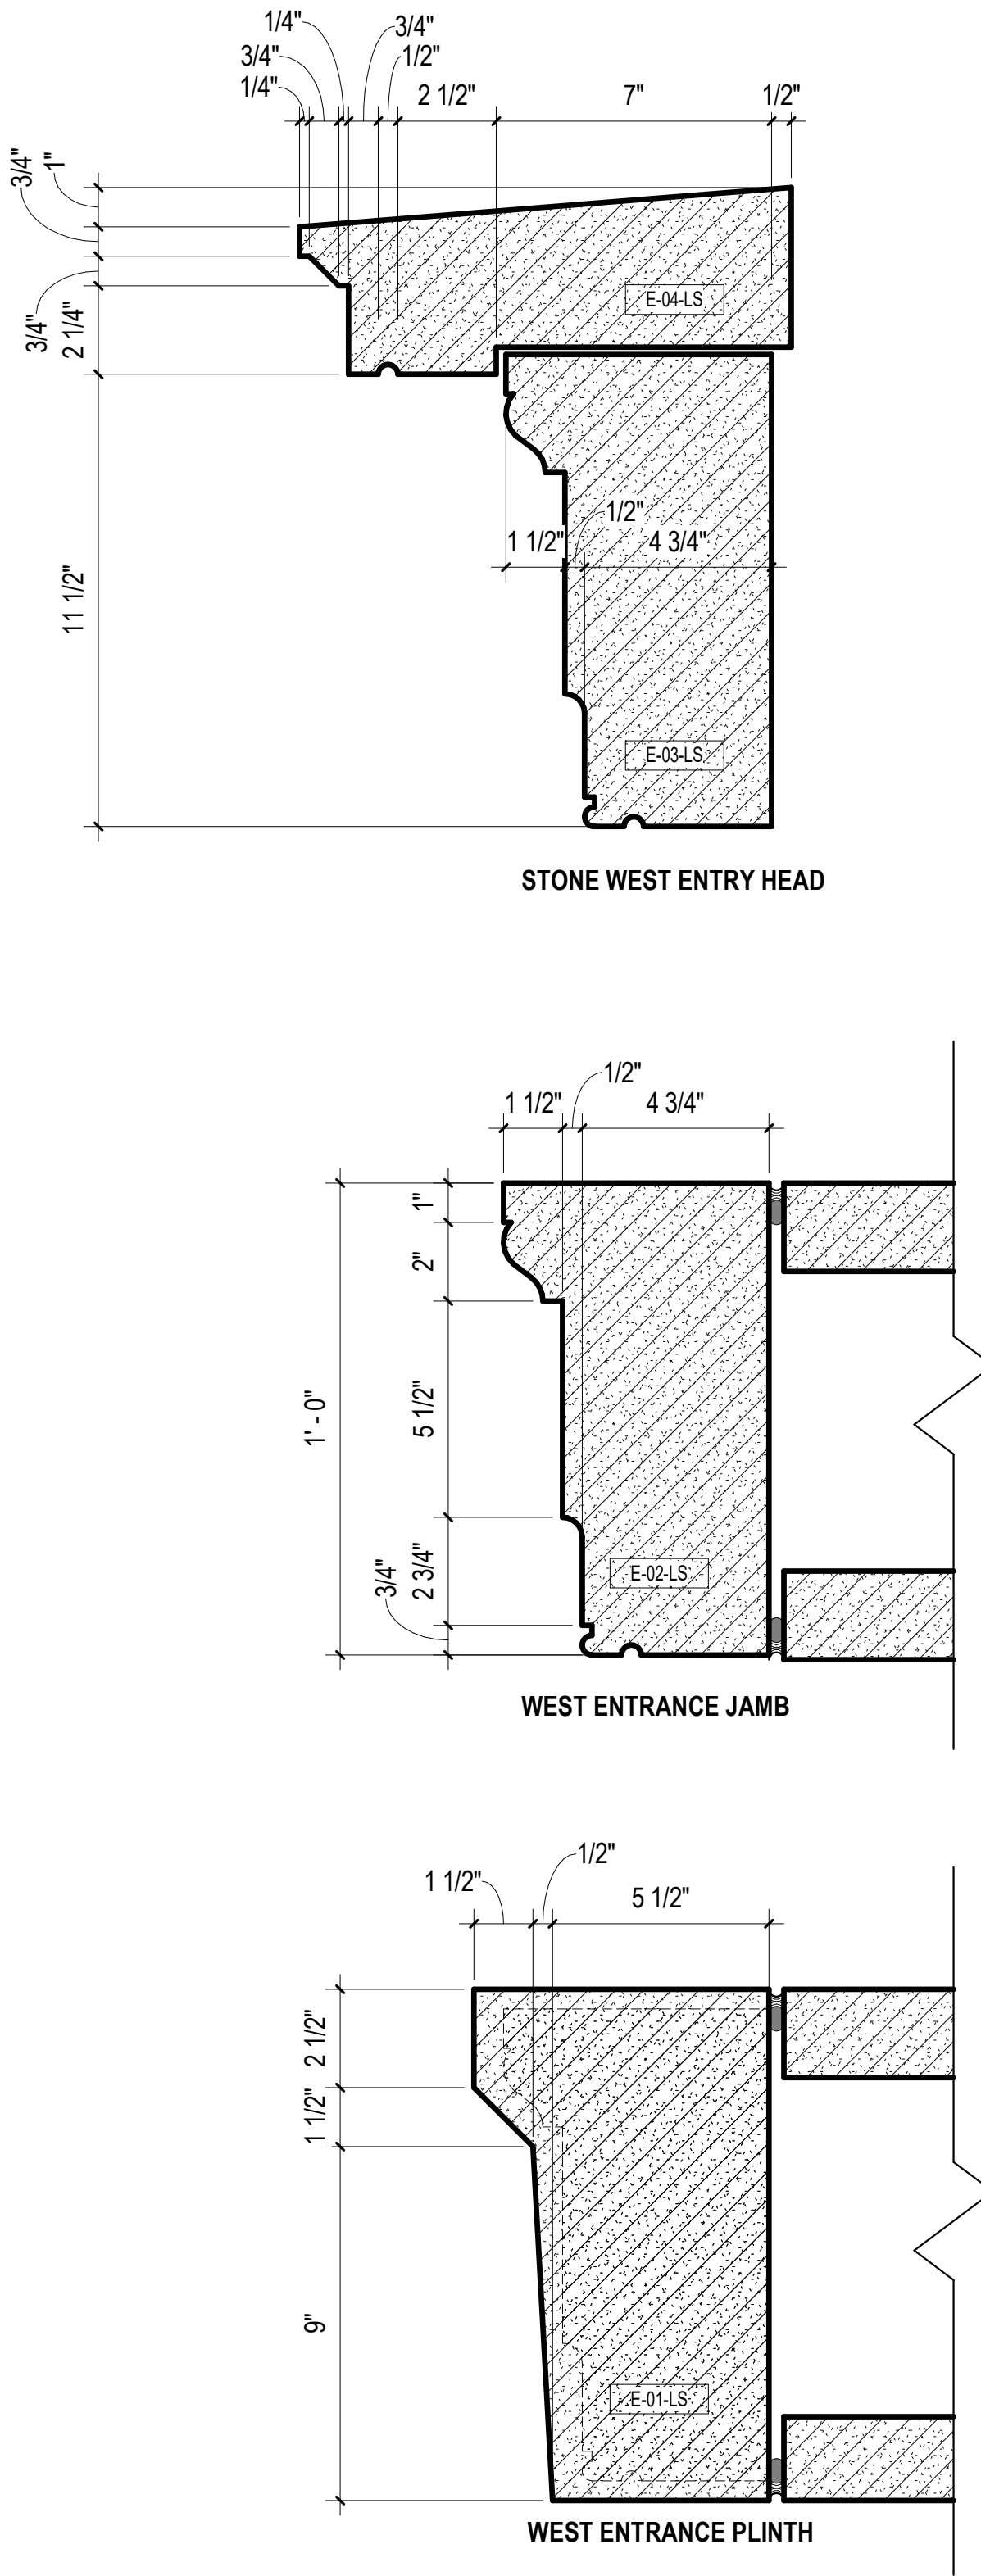

STONE LEGEND

DESIGNATION KEY:

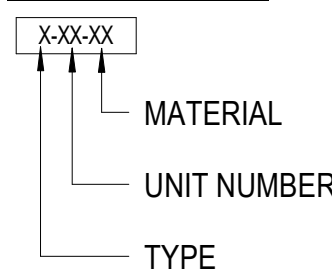

TYPES:

E - ENTRANCES
F - FACADES
S - SITE ELEMENTS
T - TRIM

MATERIALS:

LS - LIMESTONE

STONE SCHEDULE

STONE NUMBER	STONE TYPE	DESCRIPTION	DETAIL / PROFILE
--------------	------------	-------------	------------------

C-1212

T03-LS	C-1212	QUARTZ RESTROOM VANITY	
--------	--------	------------------------	--

ENTRANCE

E-01-LS	ENTRANCE	WEST LIMESTONE ENTRANCE SURROUND - PLINTH	B1 / A5.42
E-02-LS	ENTRANCE	WEST LIMESTONE ENTRANCE SURROUND - JAMB	B1 / A5.42
E-03-LS	ENTRANCE	WEST LIMESTONE ENTRANCE SURROUND - HEAD 01	B1 / A5.42
E-04-LS	ENTRANCE	WEST LIMESTONE ENTRANCE SURROUND - HEAD 02	B1 / A5.42

ENTRANCES

A-07-LS	ENTRANCES	LIMESTONE ENTRANCE SURROUND - SOFFIT PANEL	B1 / A2.22
A-12-LS	ENTRANCES	LIMESTONE ENTRANCE DOOR FRAME - HEAD	B2 / A2.22

FACADE


F-01-LS	FACADE	LIMESTONE HEAD @ LARGE WINDOW SURROUND	B2 / A5.42
F-02-LS	FACADE	LIMESTONE SILL - TYPICAL	B2 / A5.42
F-03-LS	FACADE	LIMESTONE SILL - TYPICAL	B2 / A5.42
F-04-LS	FACADE	<varies>	B2 / A5.42
F-05-LS	FACADE	LIMESTONE SILL - TYPICAL	B2 / A5.42
F-08-LS	FACADE	LIMESTONE JAMB @ LARGE WINDOW SURROUND	B2 / A5.42
F-09-LS	FACADE	LIMESTONE - MOUNTING PANEL	B4 / A5.42
F-10-LS	FACADE	LIMESTONE - MOUNTING PANEL	B4 / A5.42

SITE

S-01-LS	SITE	LIMESTONE SITE PIER CAP	A1 / A1.02
S-02-LS	SITE	LIMESTONE SITE WALL CAP	A2 / A1.02
S-03-LS	SITE	LIMESTONE SITE WALL CAP	A6 / A1.02

TRIM

T-01-LS	TRIM	LIMESTONE - TYPICAL COPING	B2 / A5.42
T-02-LS	TRIM	LIMESTONE - TYPICAL CORNICE	B2 / A5.42
T-03-LS	TRIM	LIMESTONE - TYPICAL WATERTABLE	B2 / A5.42

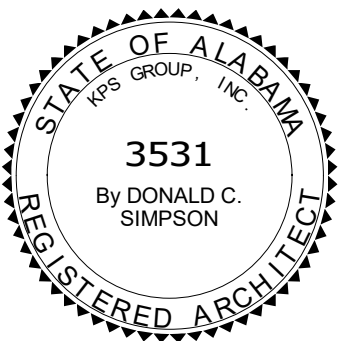

PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24







REVISIONS		
No.	Description	Date

DRAWING TITLE
DETAILS - STONE
PROFILES

DRAWN BY:	Author
CHECKED BY:	Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A5.40

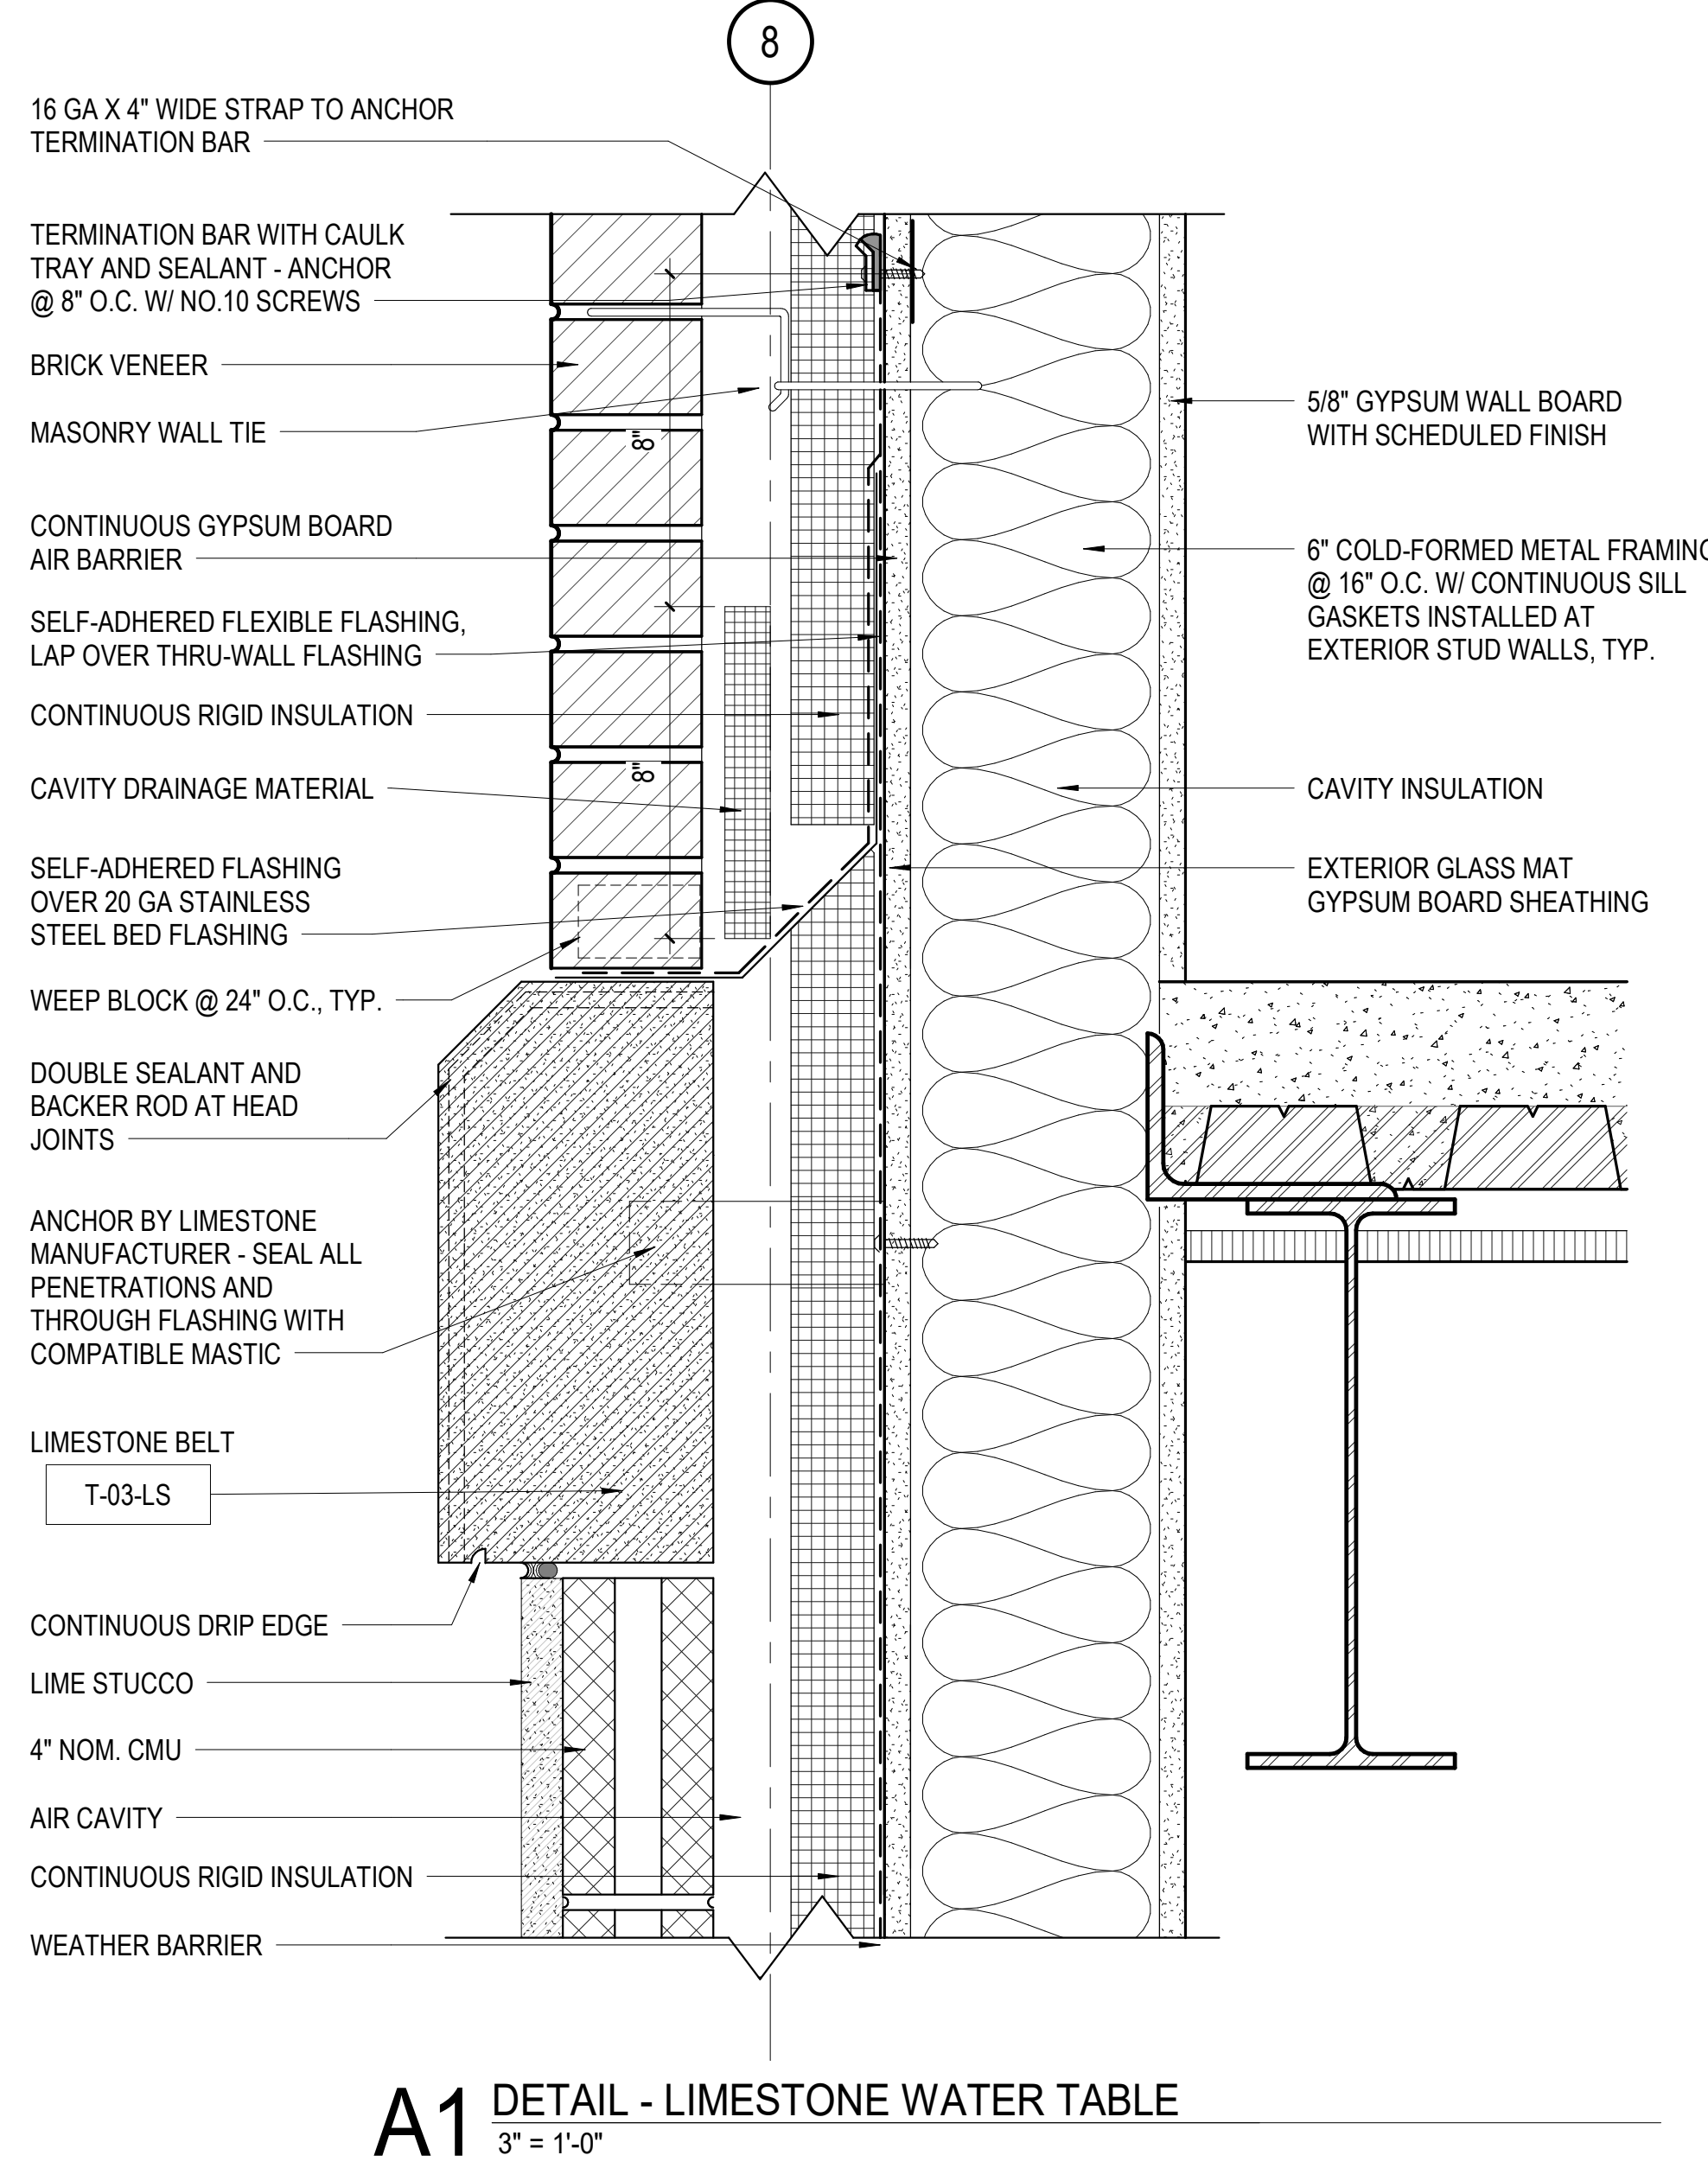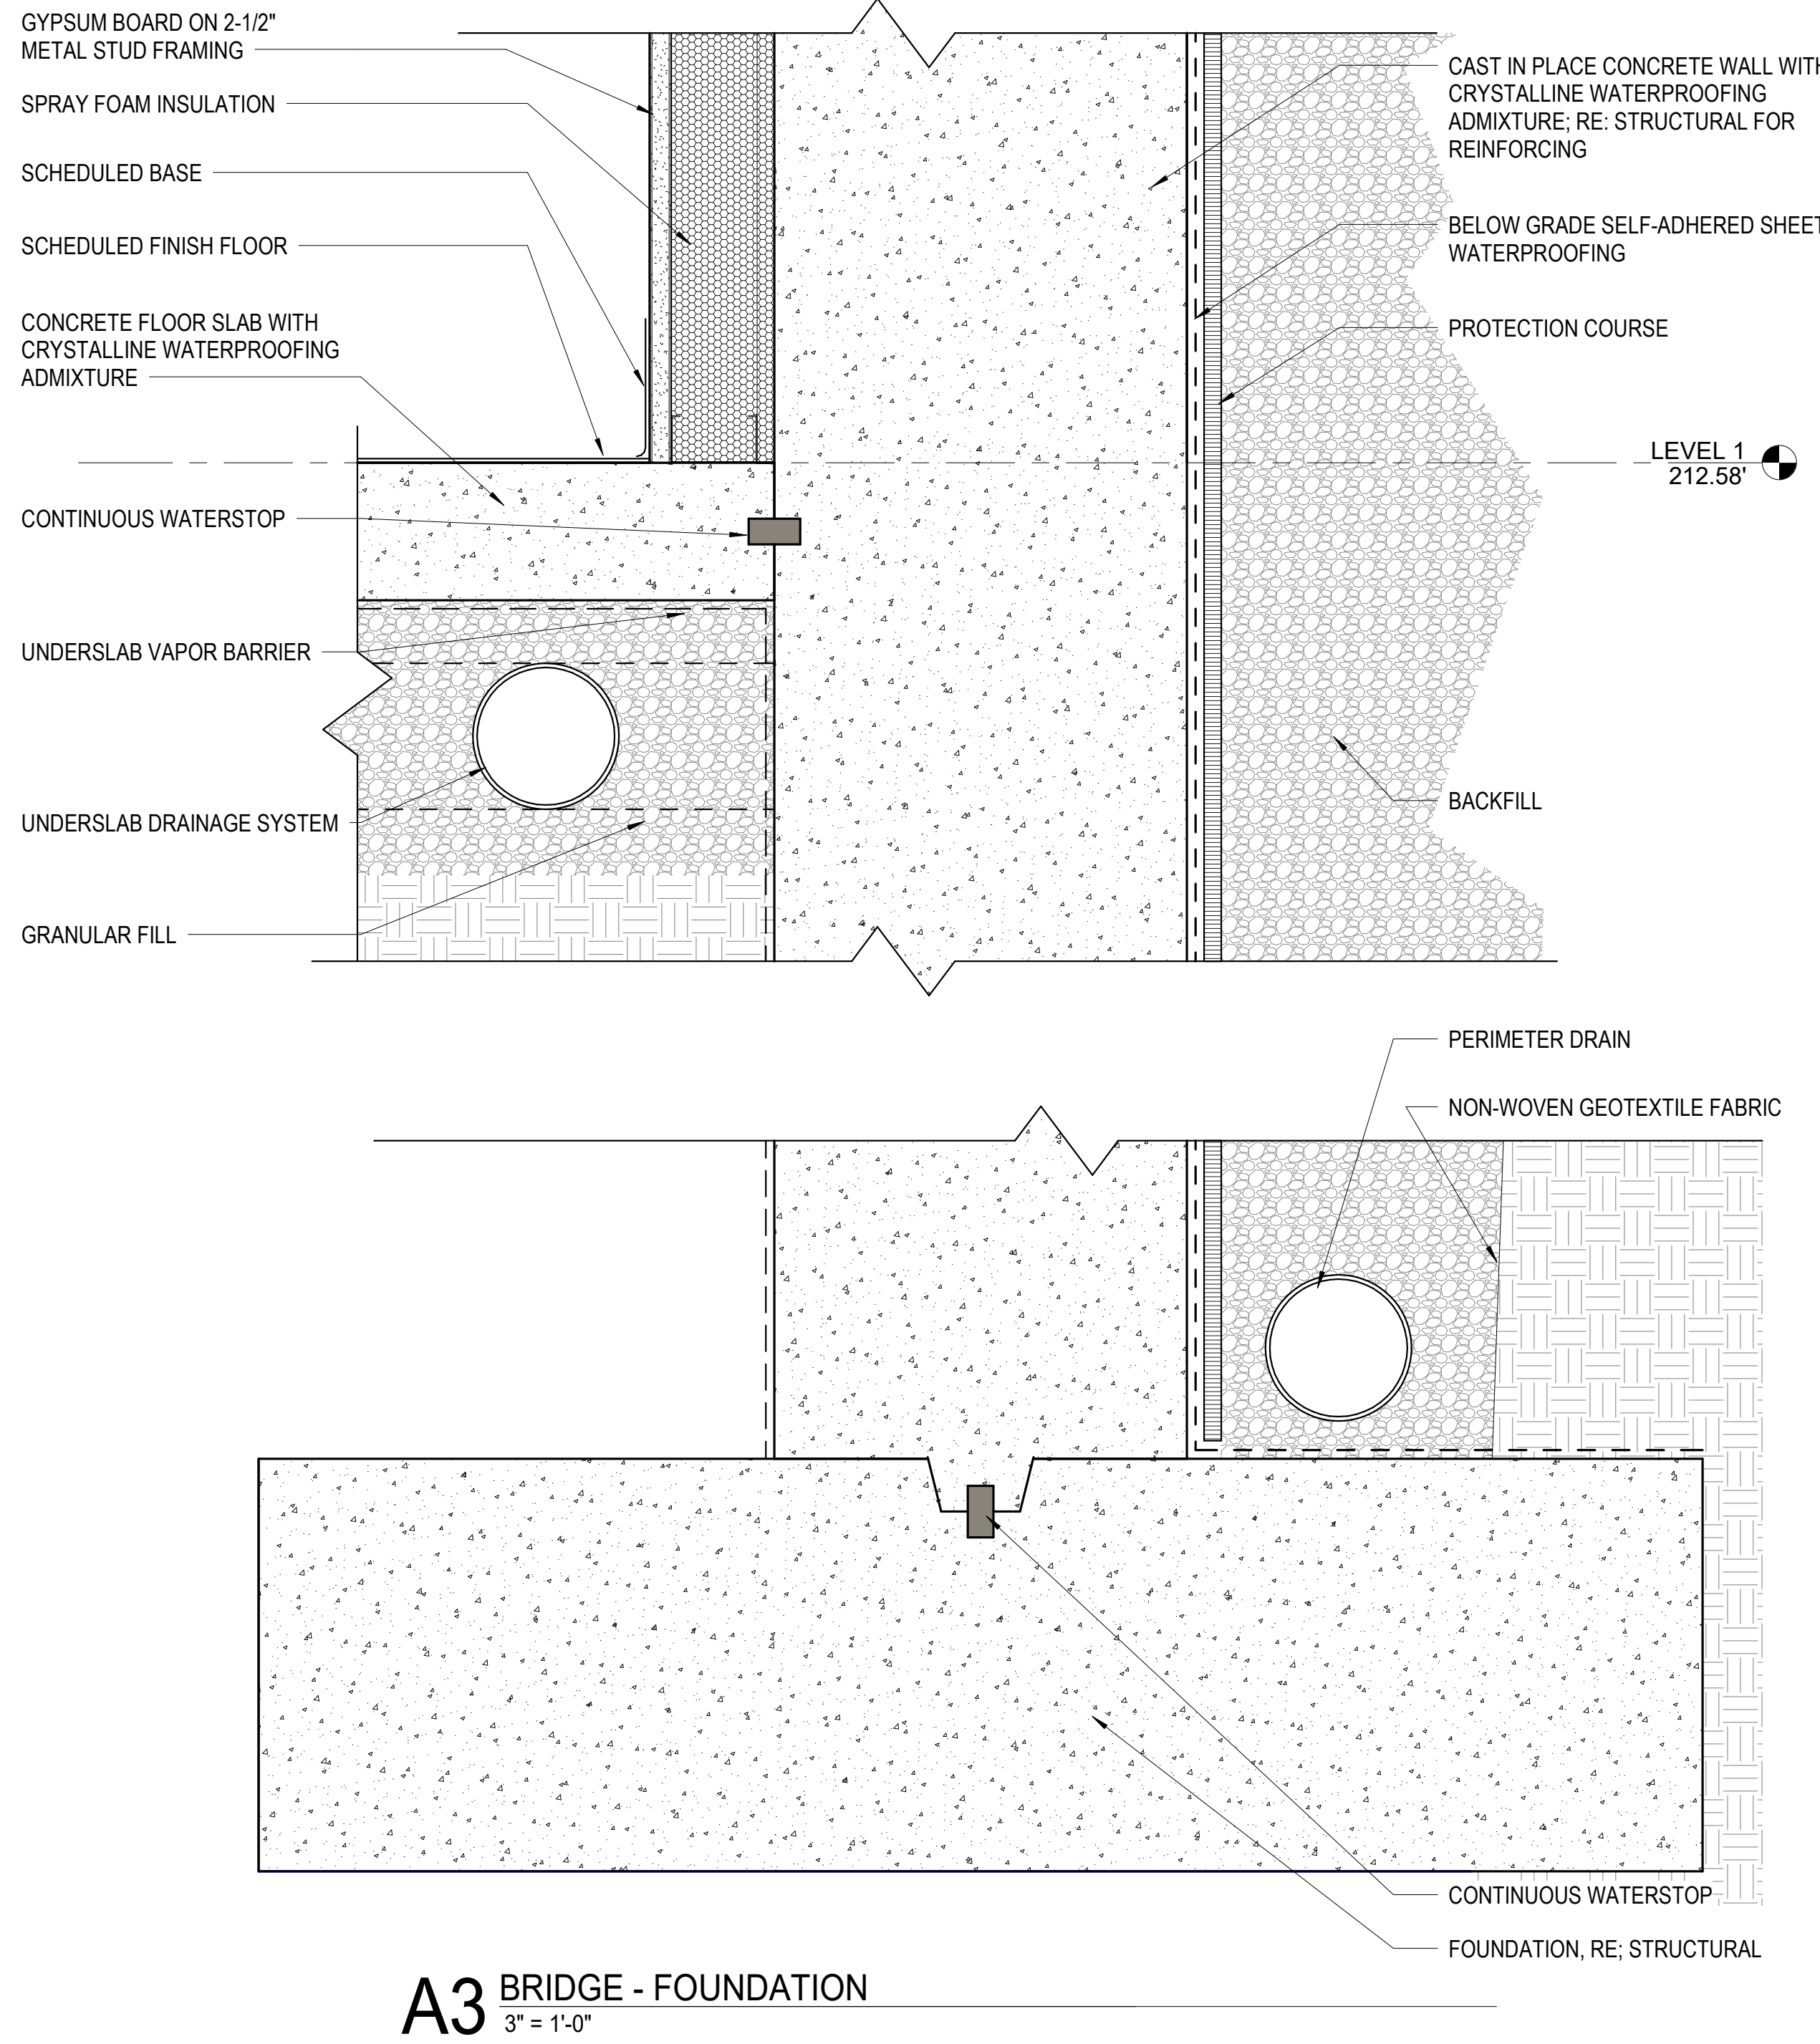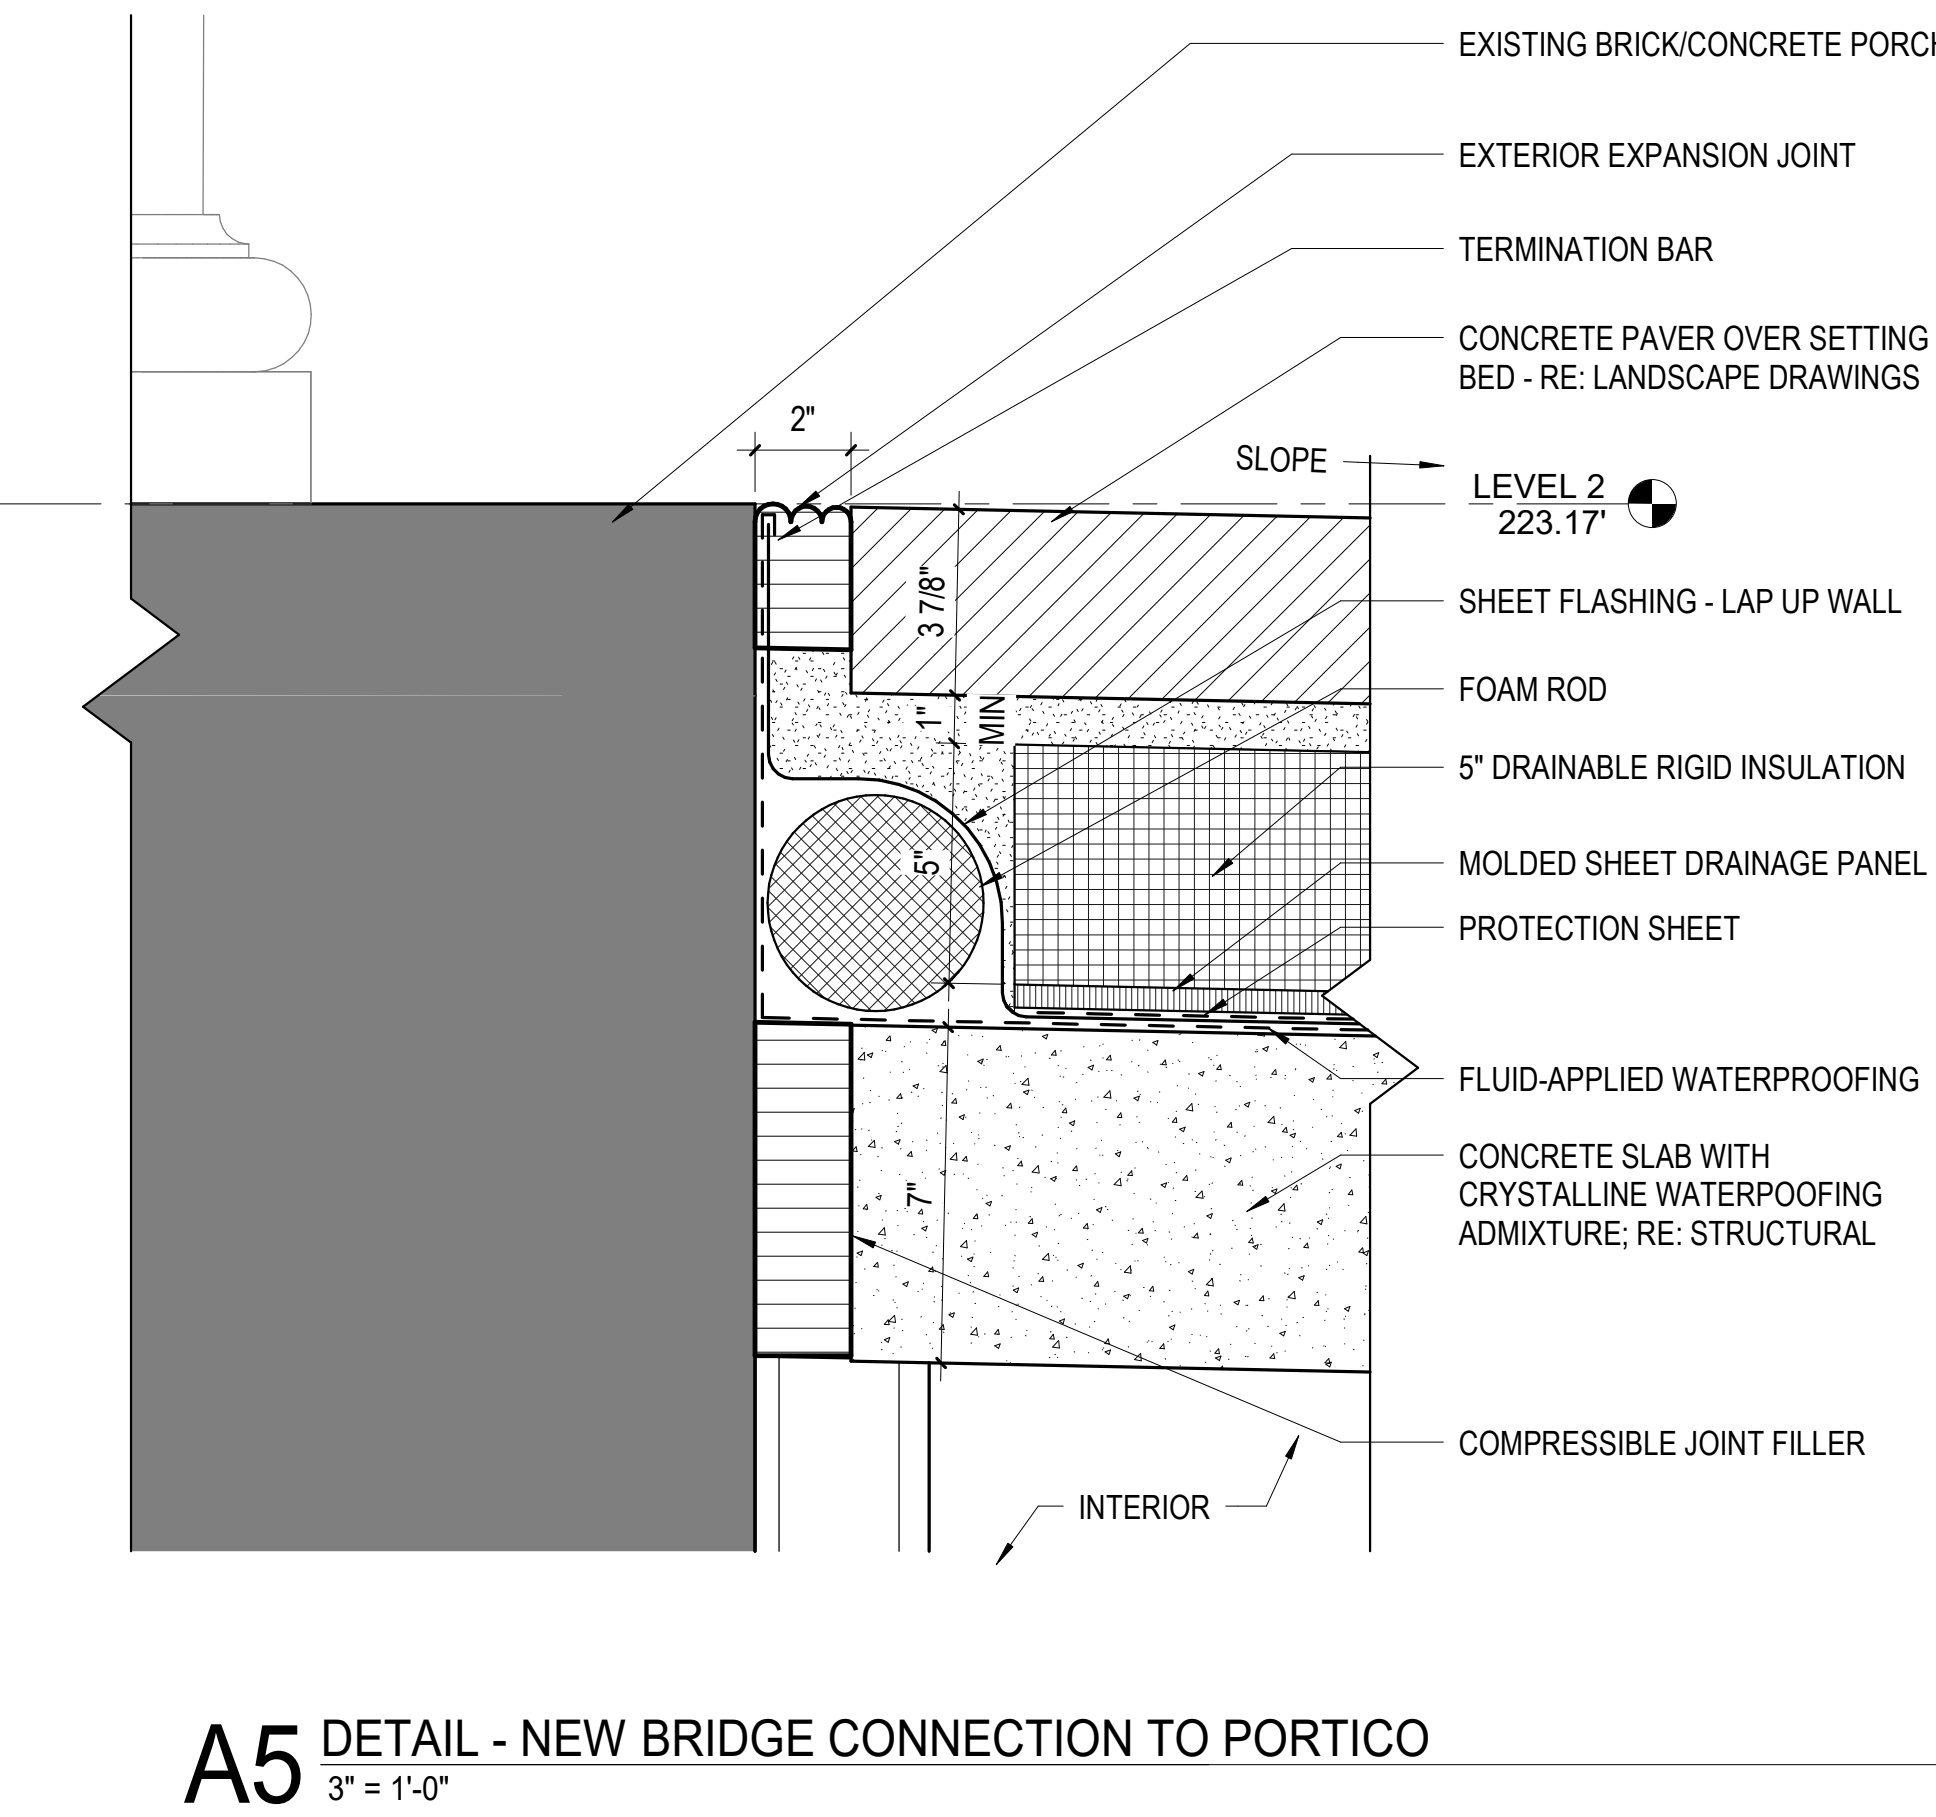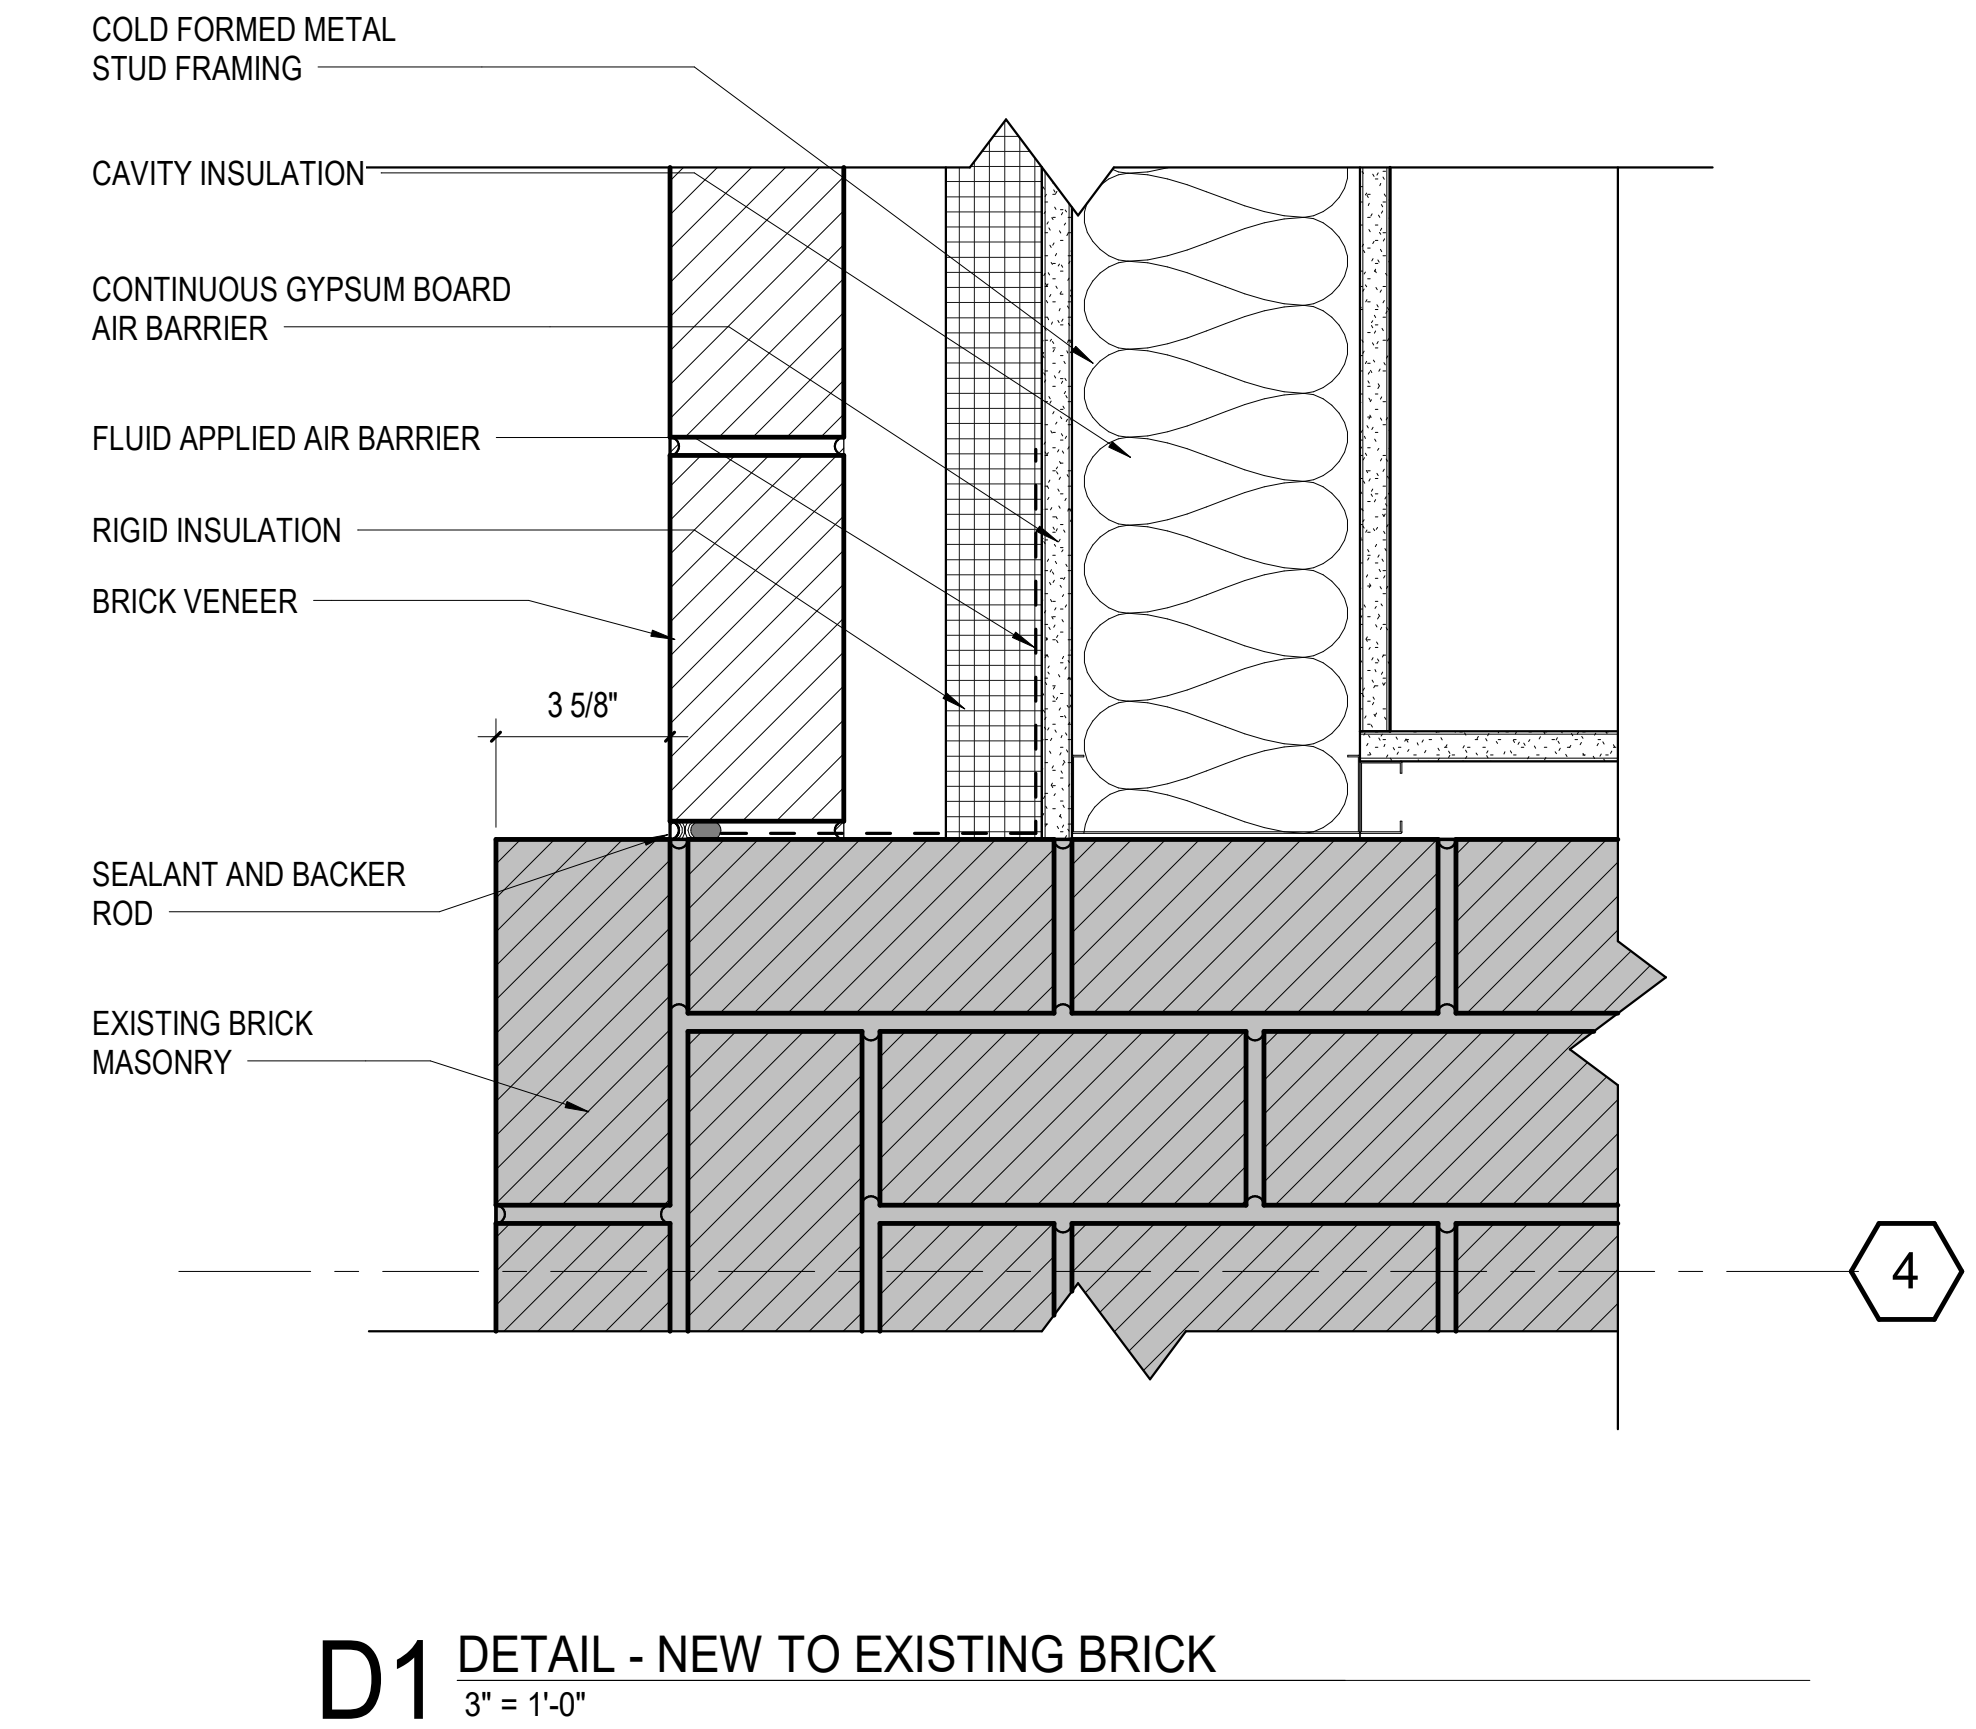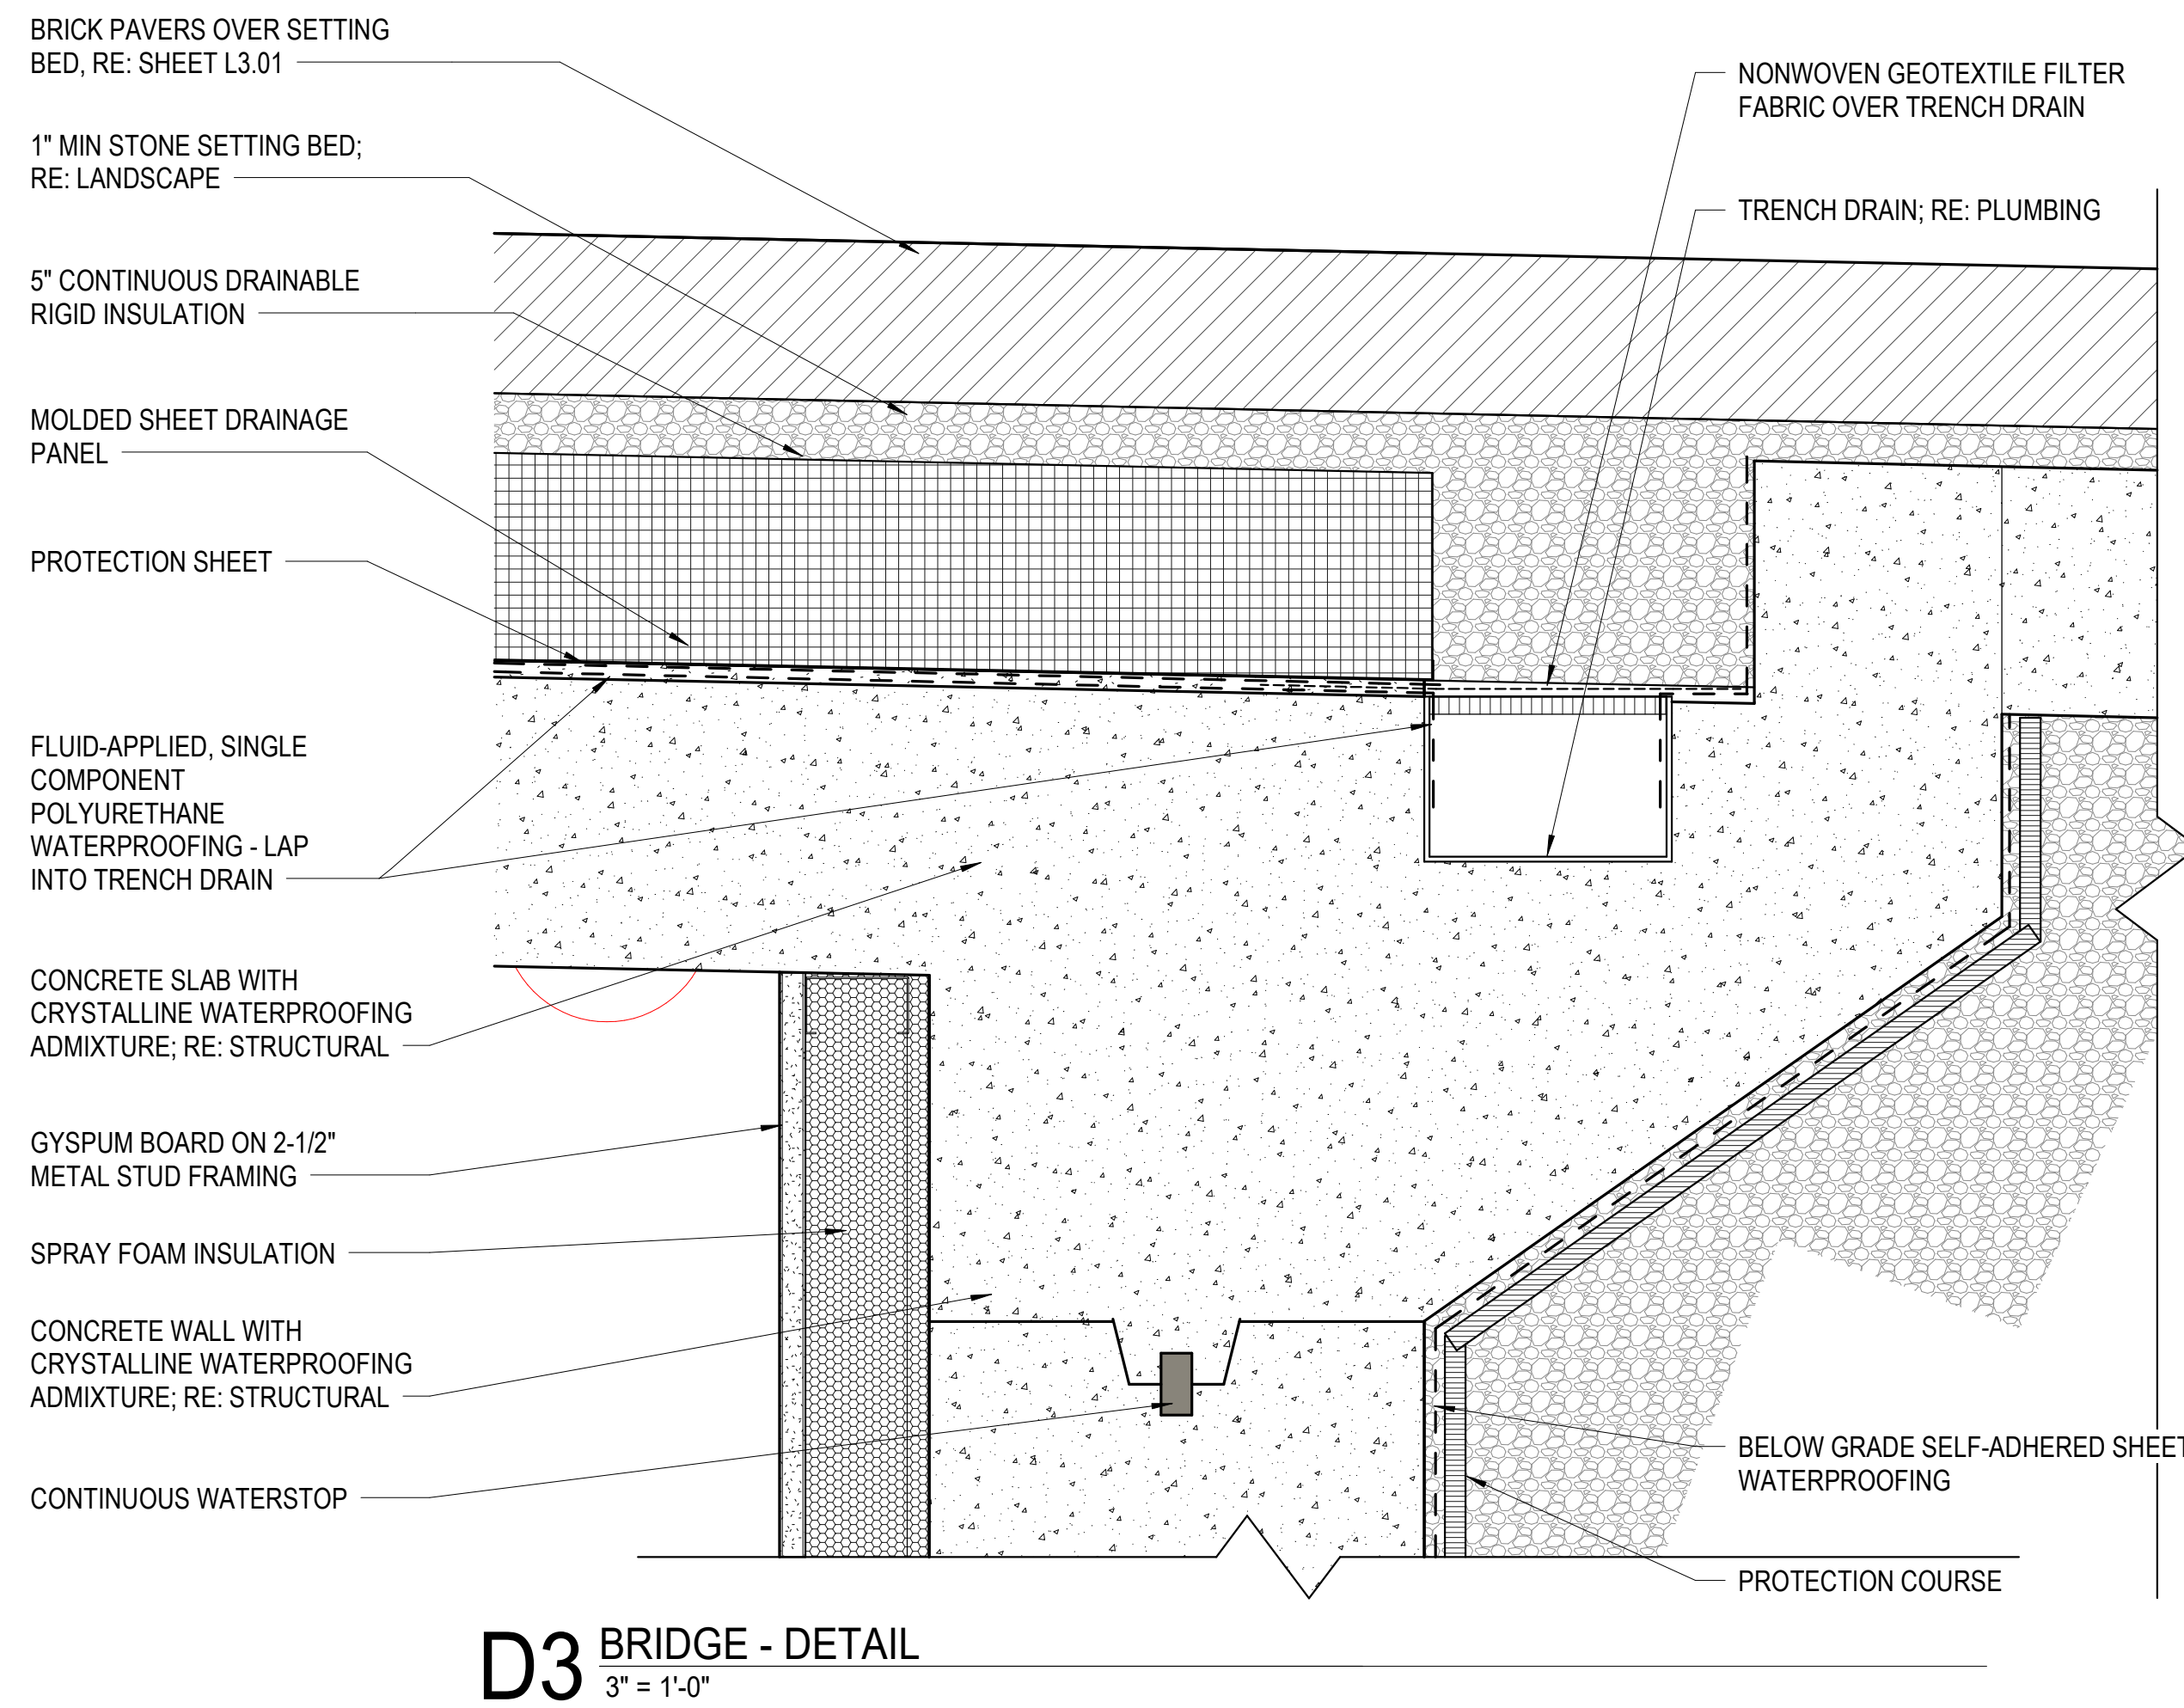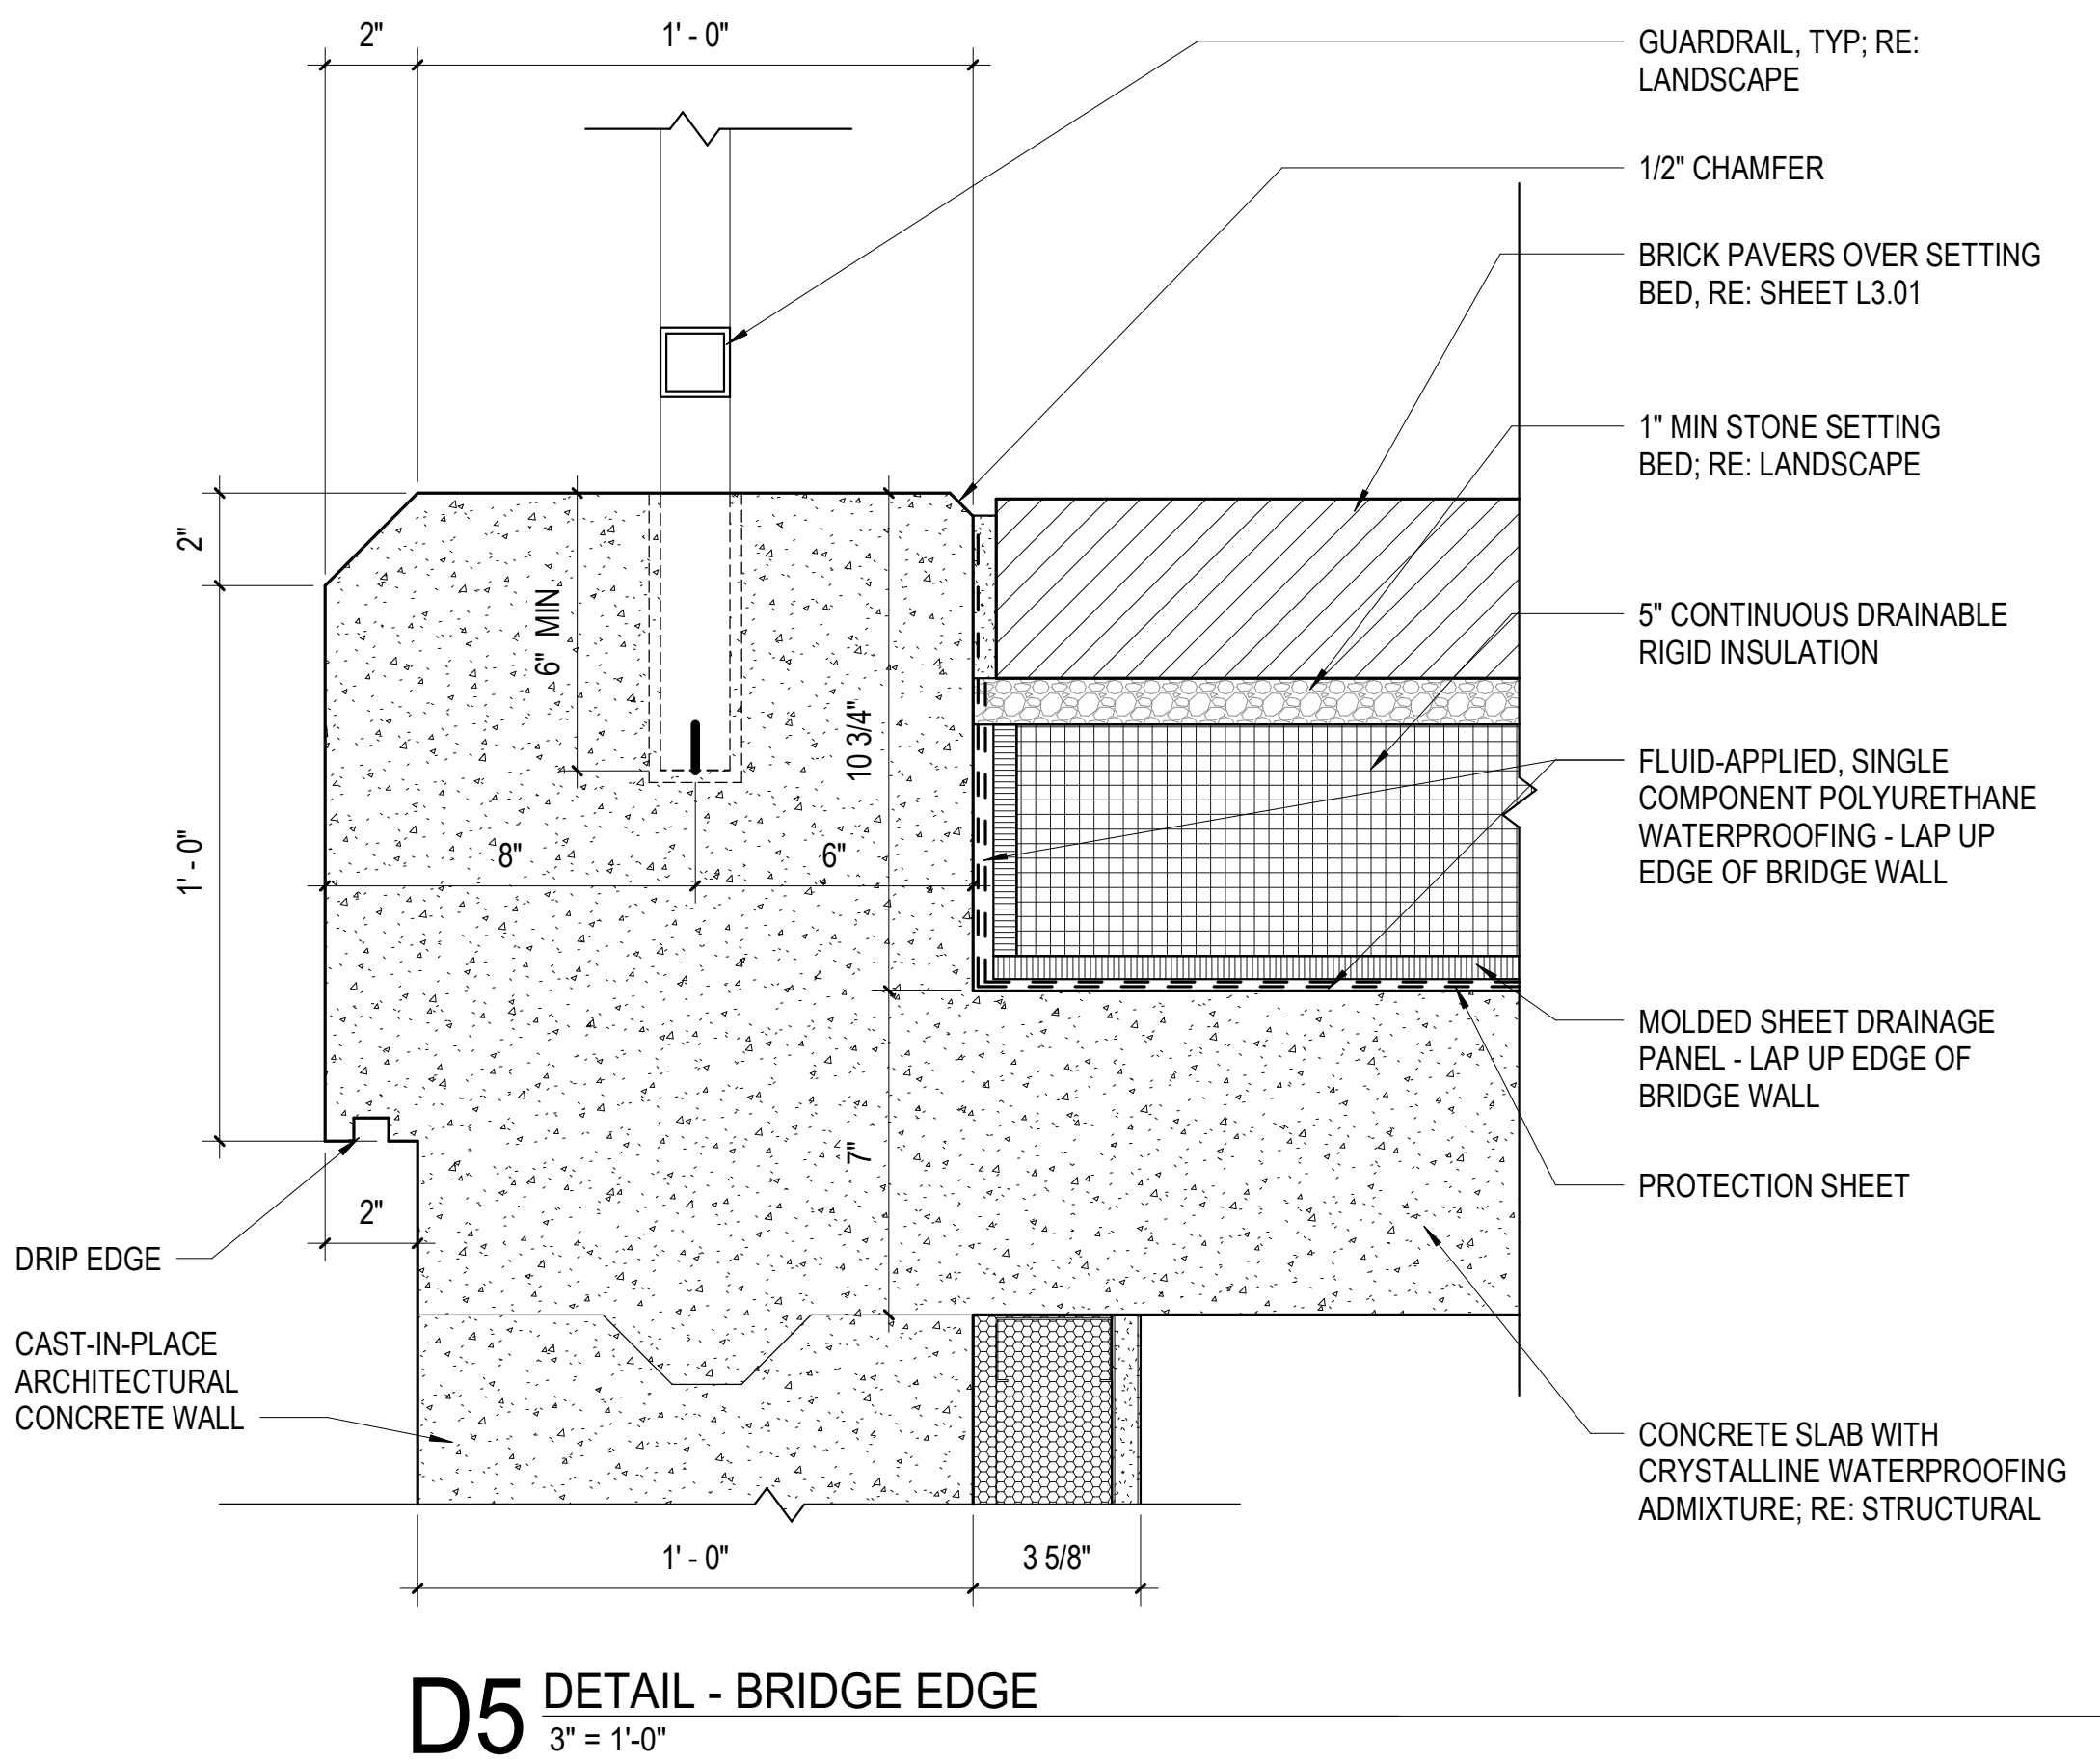

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.


STATE OF ALABAMA
DONALD C. SIMPSON
3531
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOING 202483
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401


PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24
REVISIONS
No. Description Date
DRAWING TITLE
DETAILS - EXTERIOR
DRAWN BY: Author
CHECKED BY: Checker
PROJECT NUMBER
236002-02
DRAWING NO.
A5.41

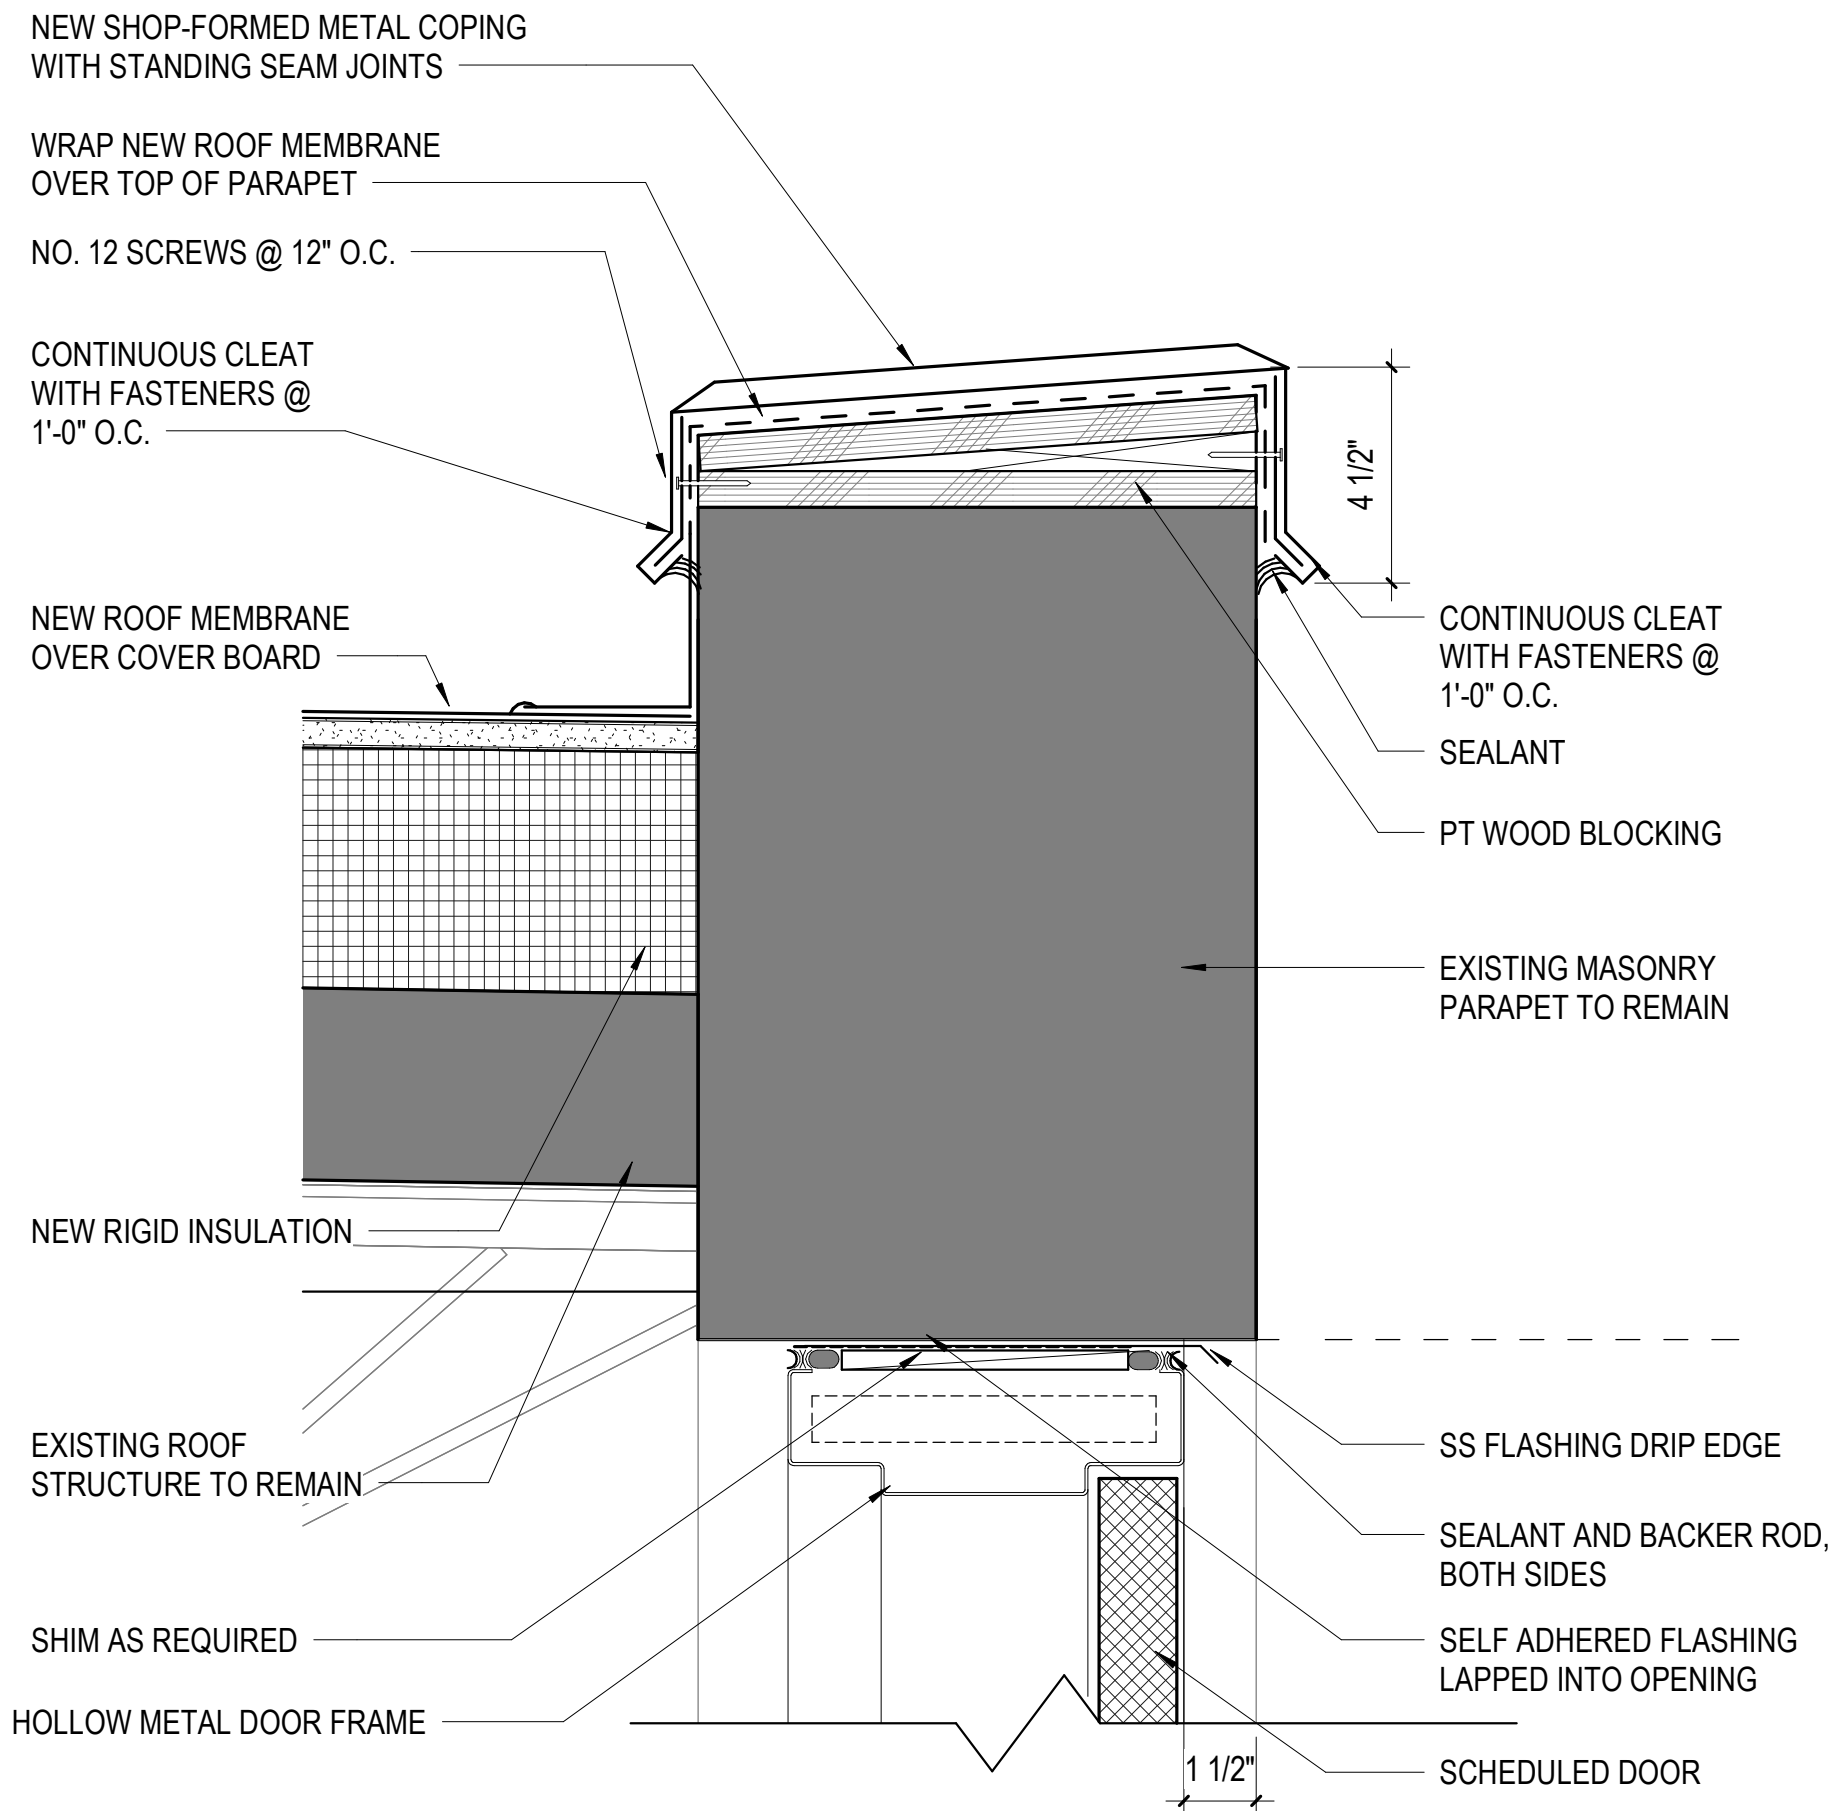

D1 DETAIL - HM DOOR HEAD EXISTING WALL
3" = 1'-0"

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

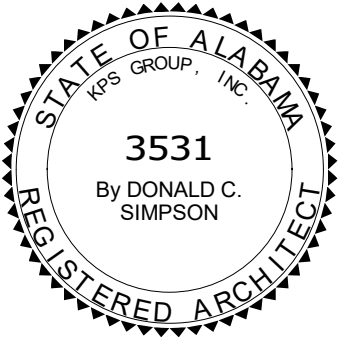


McLURE LIBRARY ADDITION AND RENOVATION


PACKAGE 'D' - ADDITION AND RENOVATION
OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
DOMING 202483
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DETAILS - EXTERIOR		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A5.42		

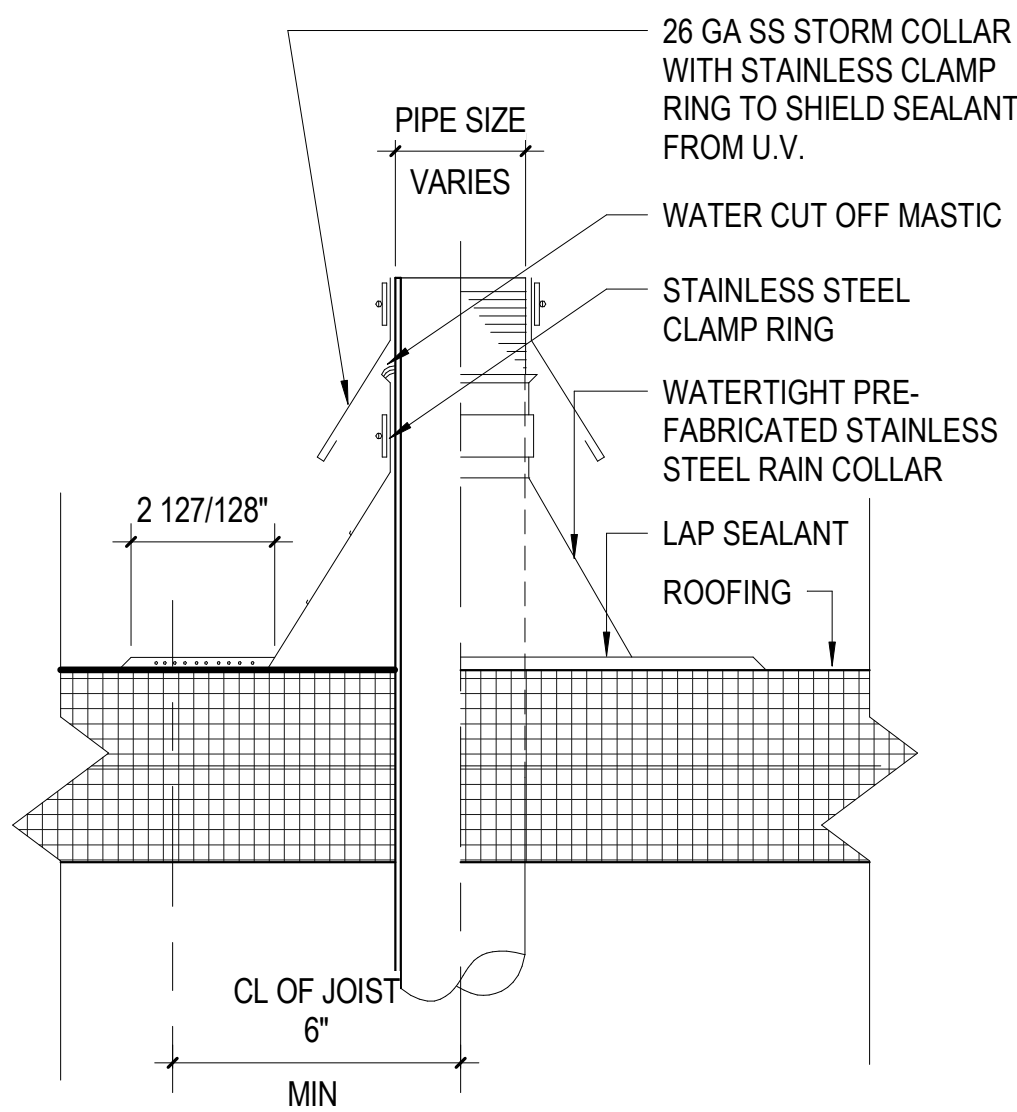


E6 TYPICAL ROOF - THRU-ROOF PIPE FLASHING
3" = 1'-0"

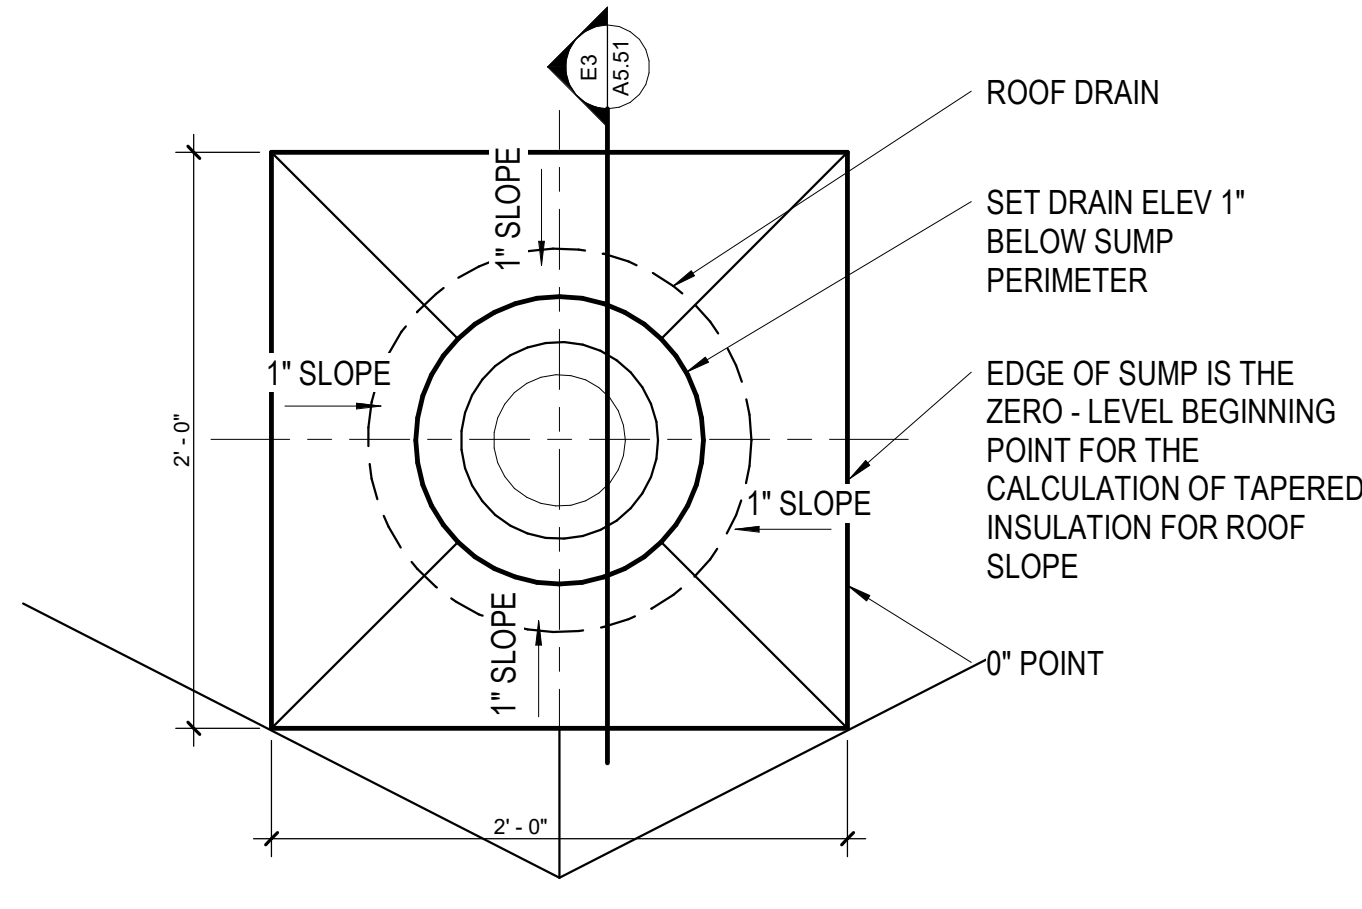



E5 ROOF DRAIN SUMP PLAN - MW
1 1/2" = 1'-0"

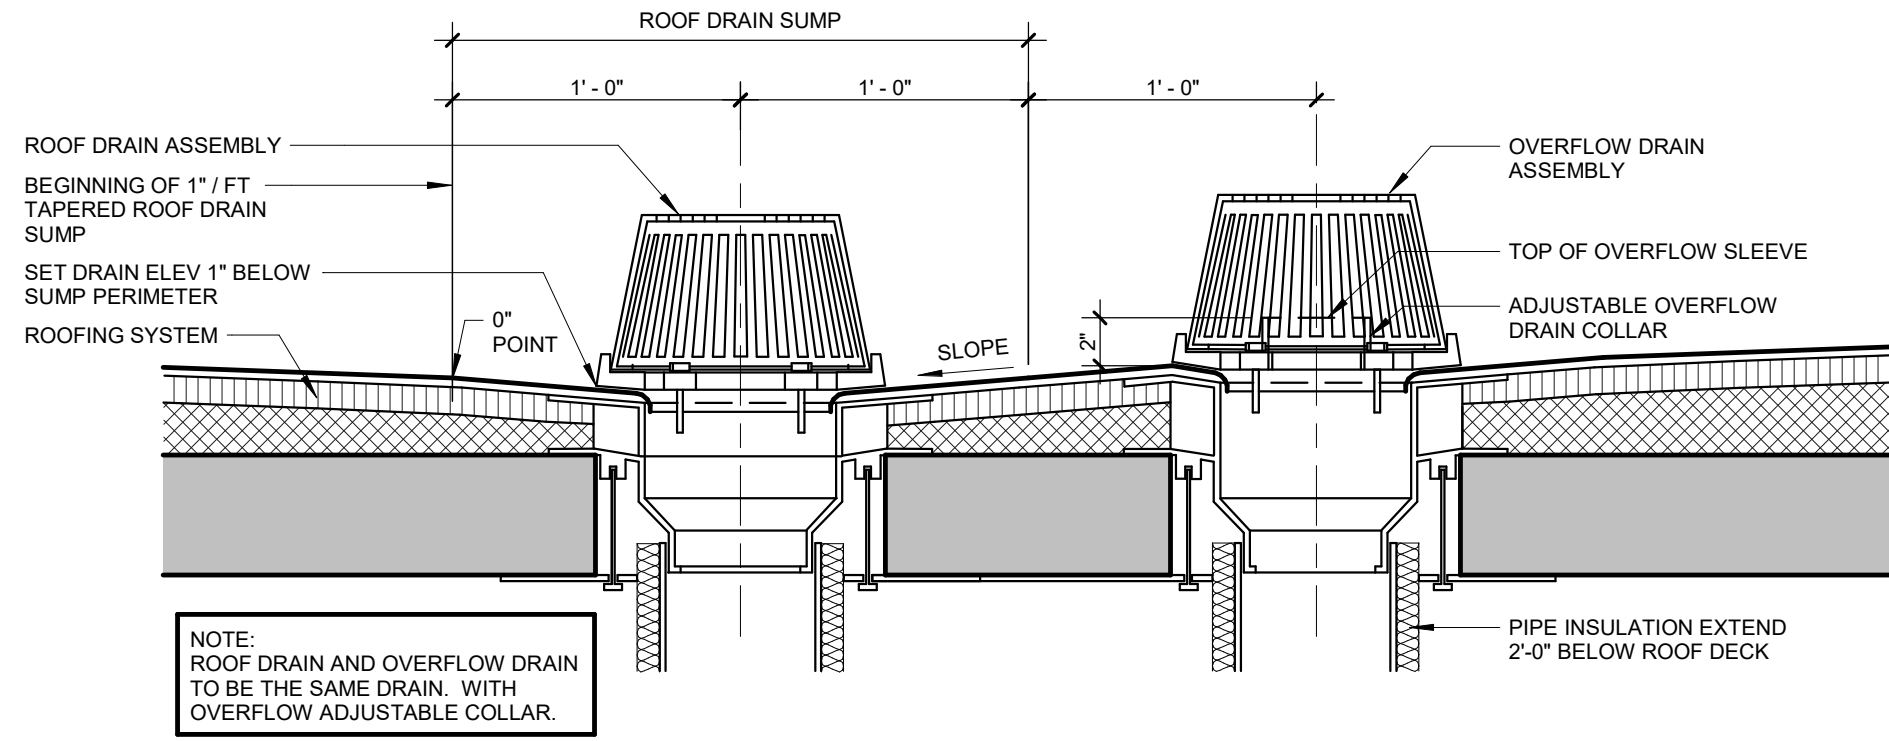


E3 ROOF DRAIN - OVERFLOW DRAIN / SUMP SECTION
1 1/2" = 1'-0"

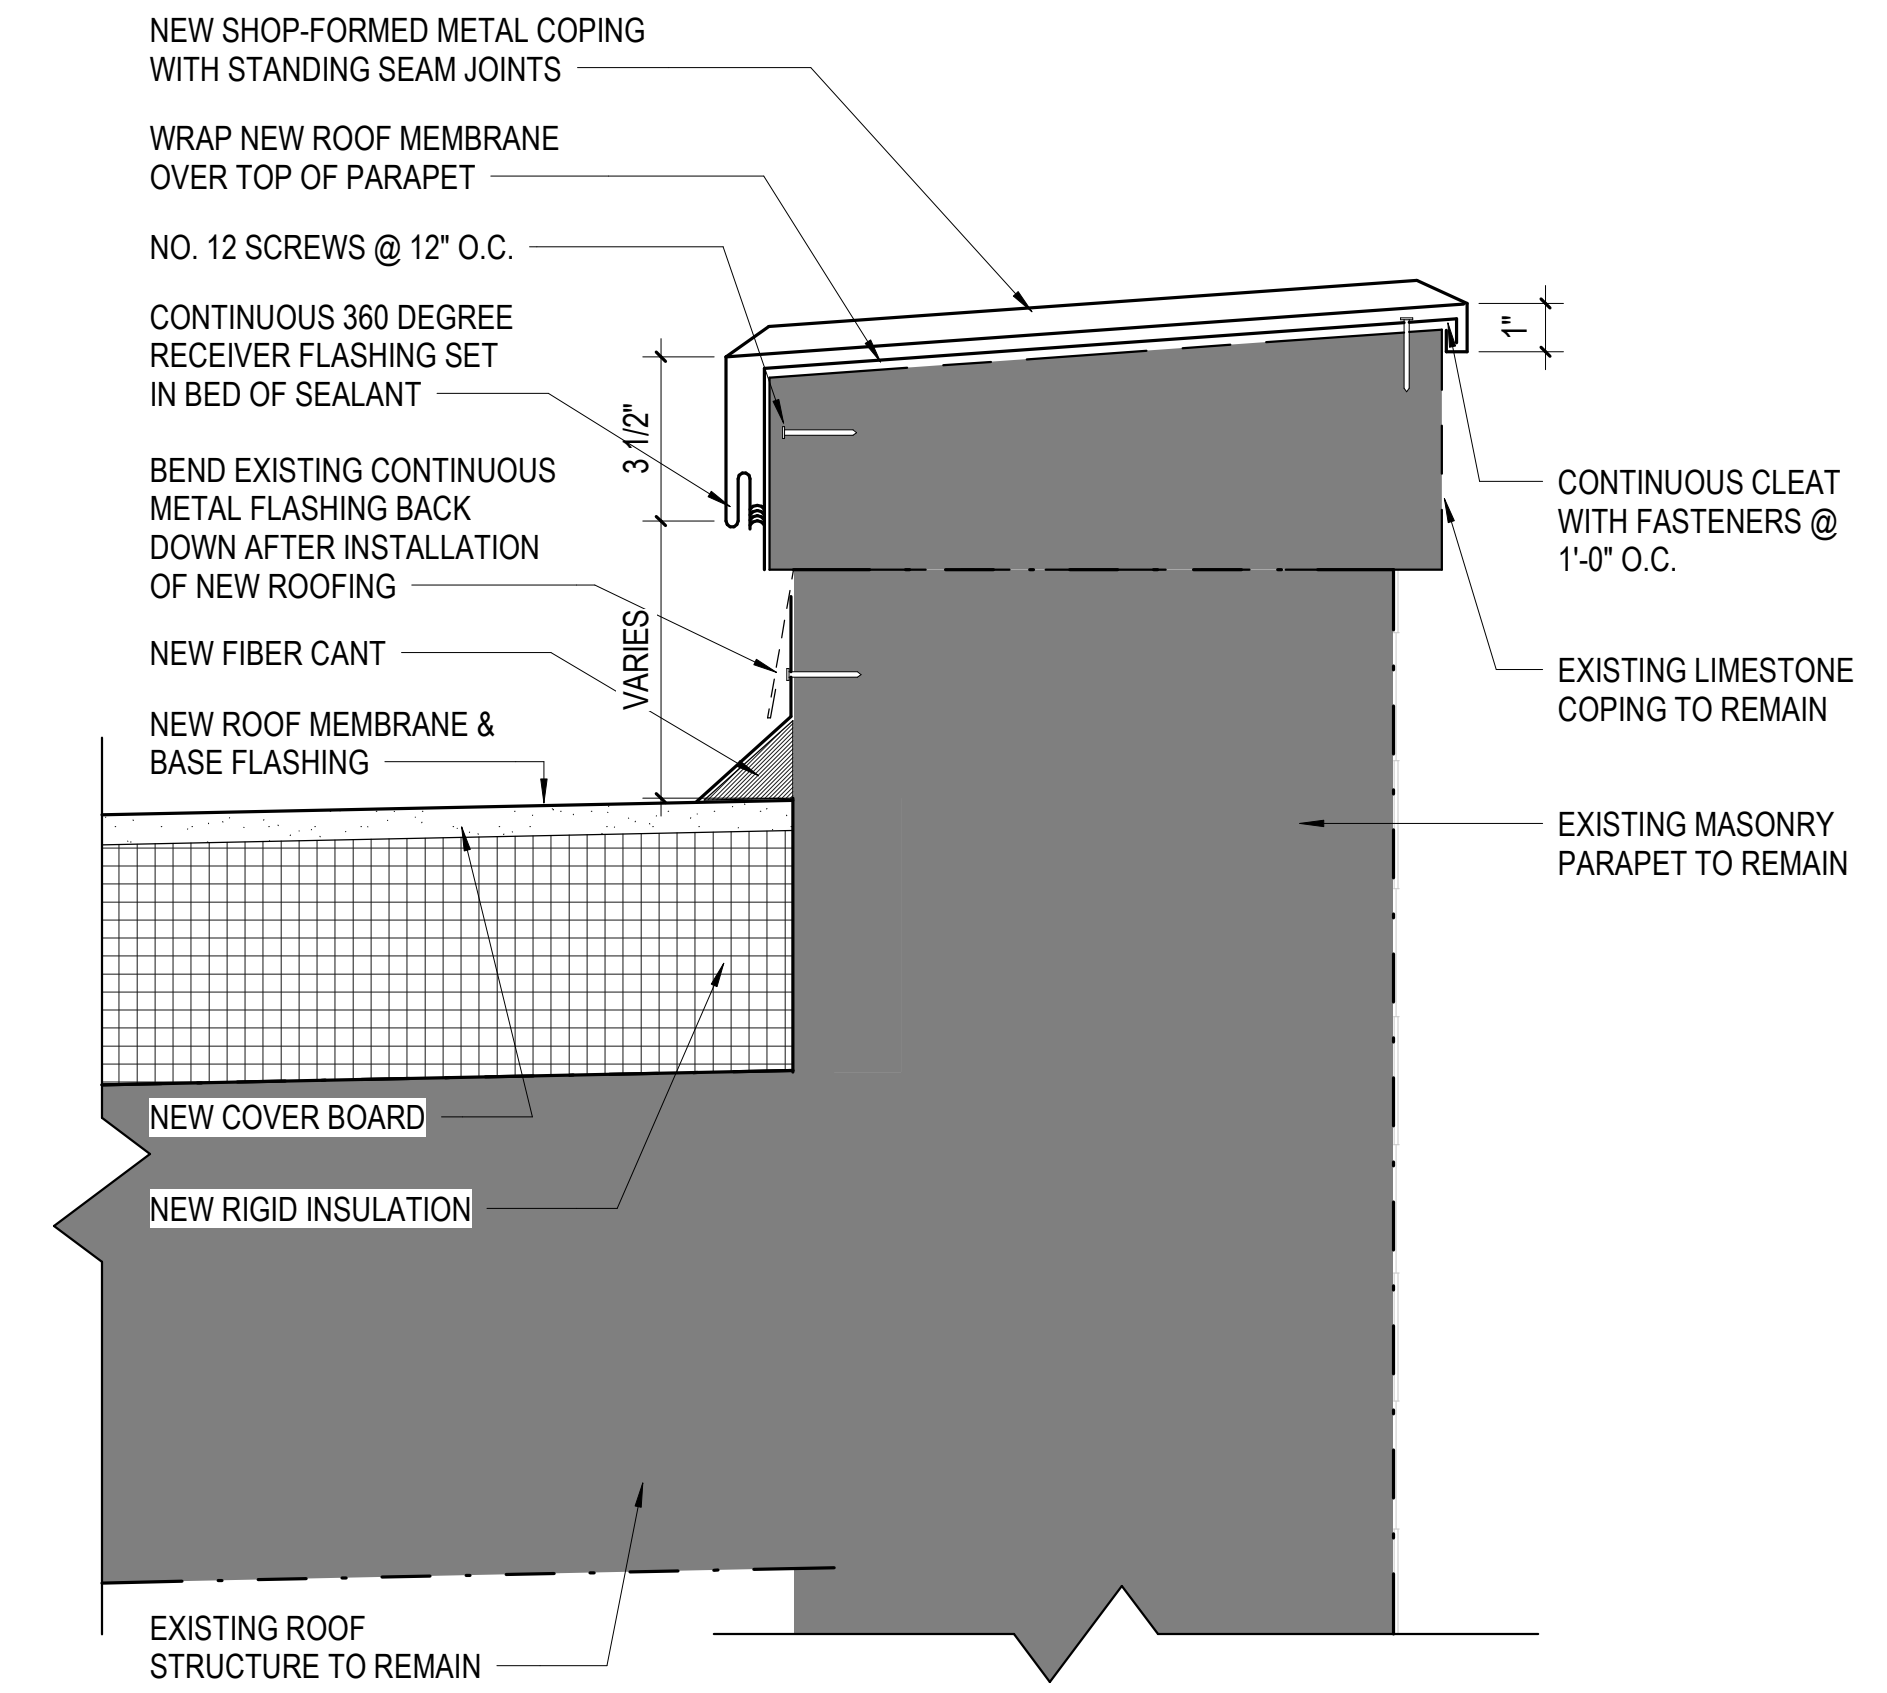


D2 ROOF DETAIL - LOW EXISTING PARAPET
3" = 1'-0"

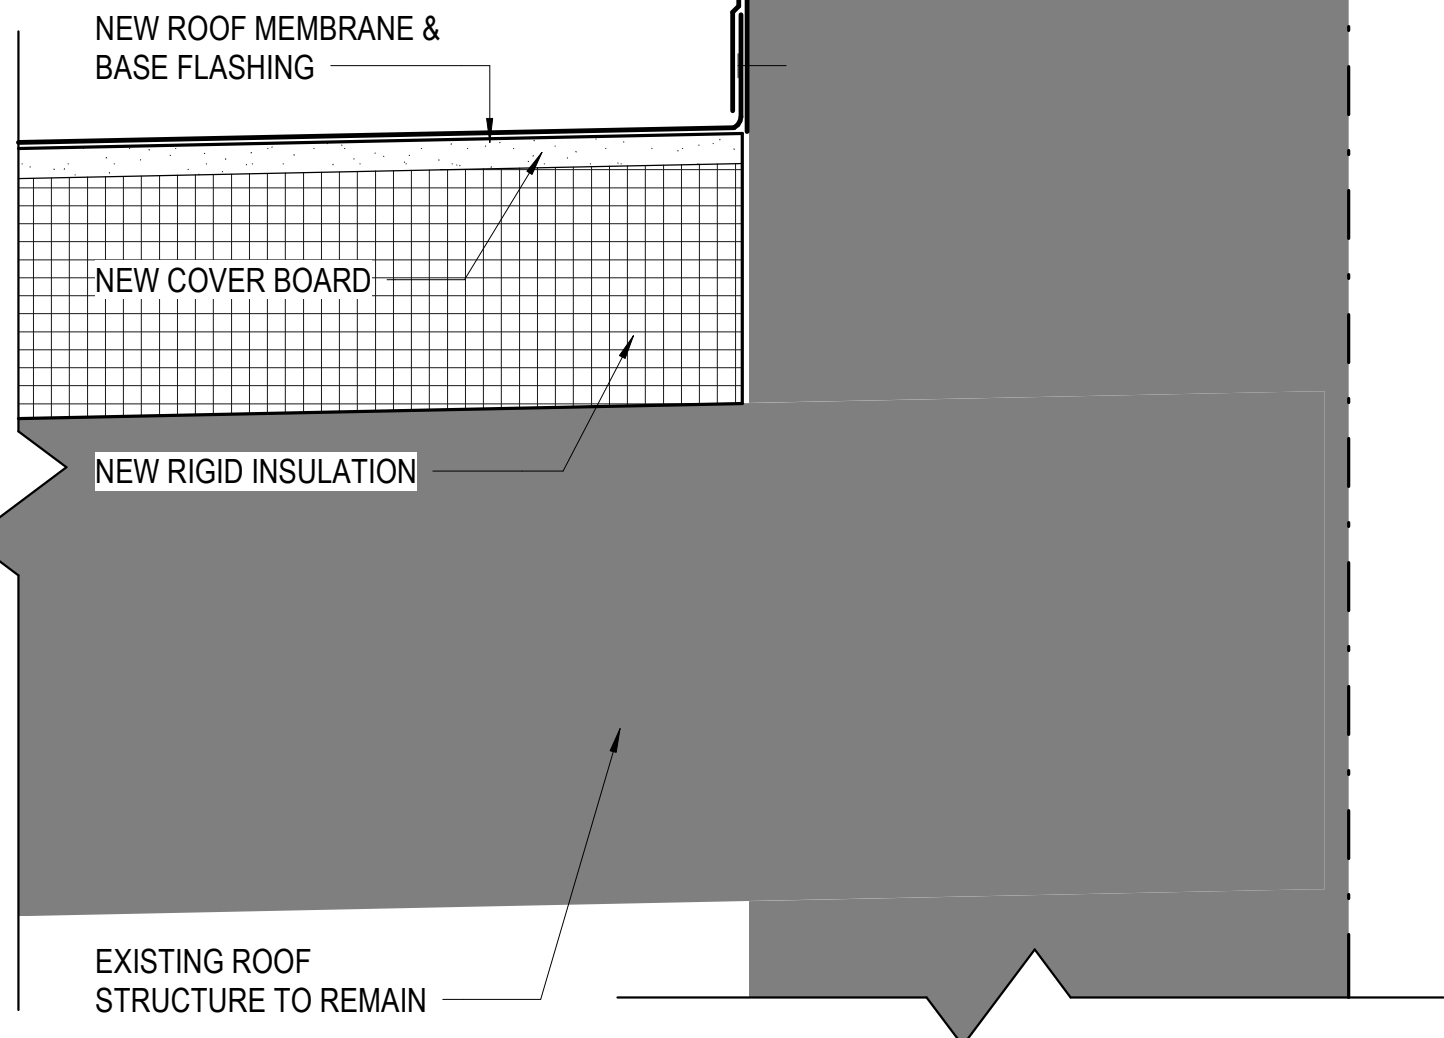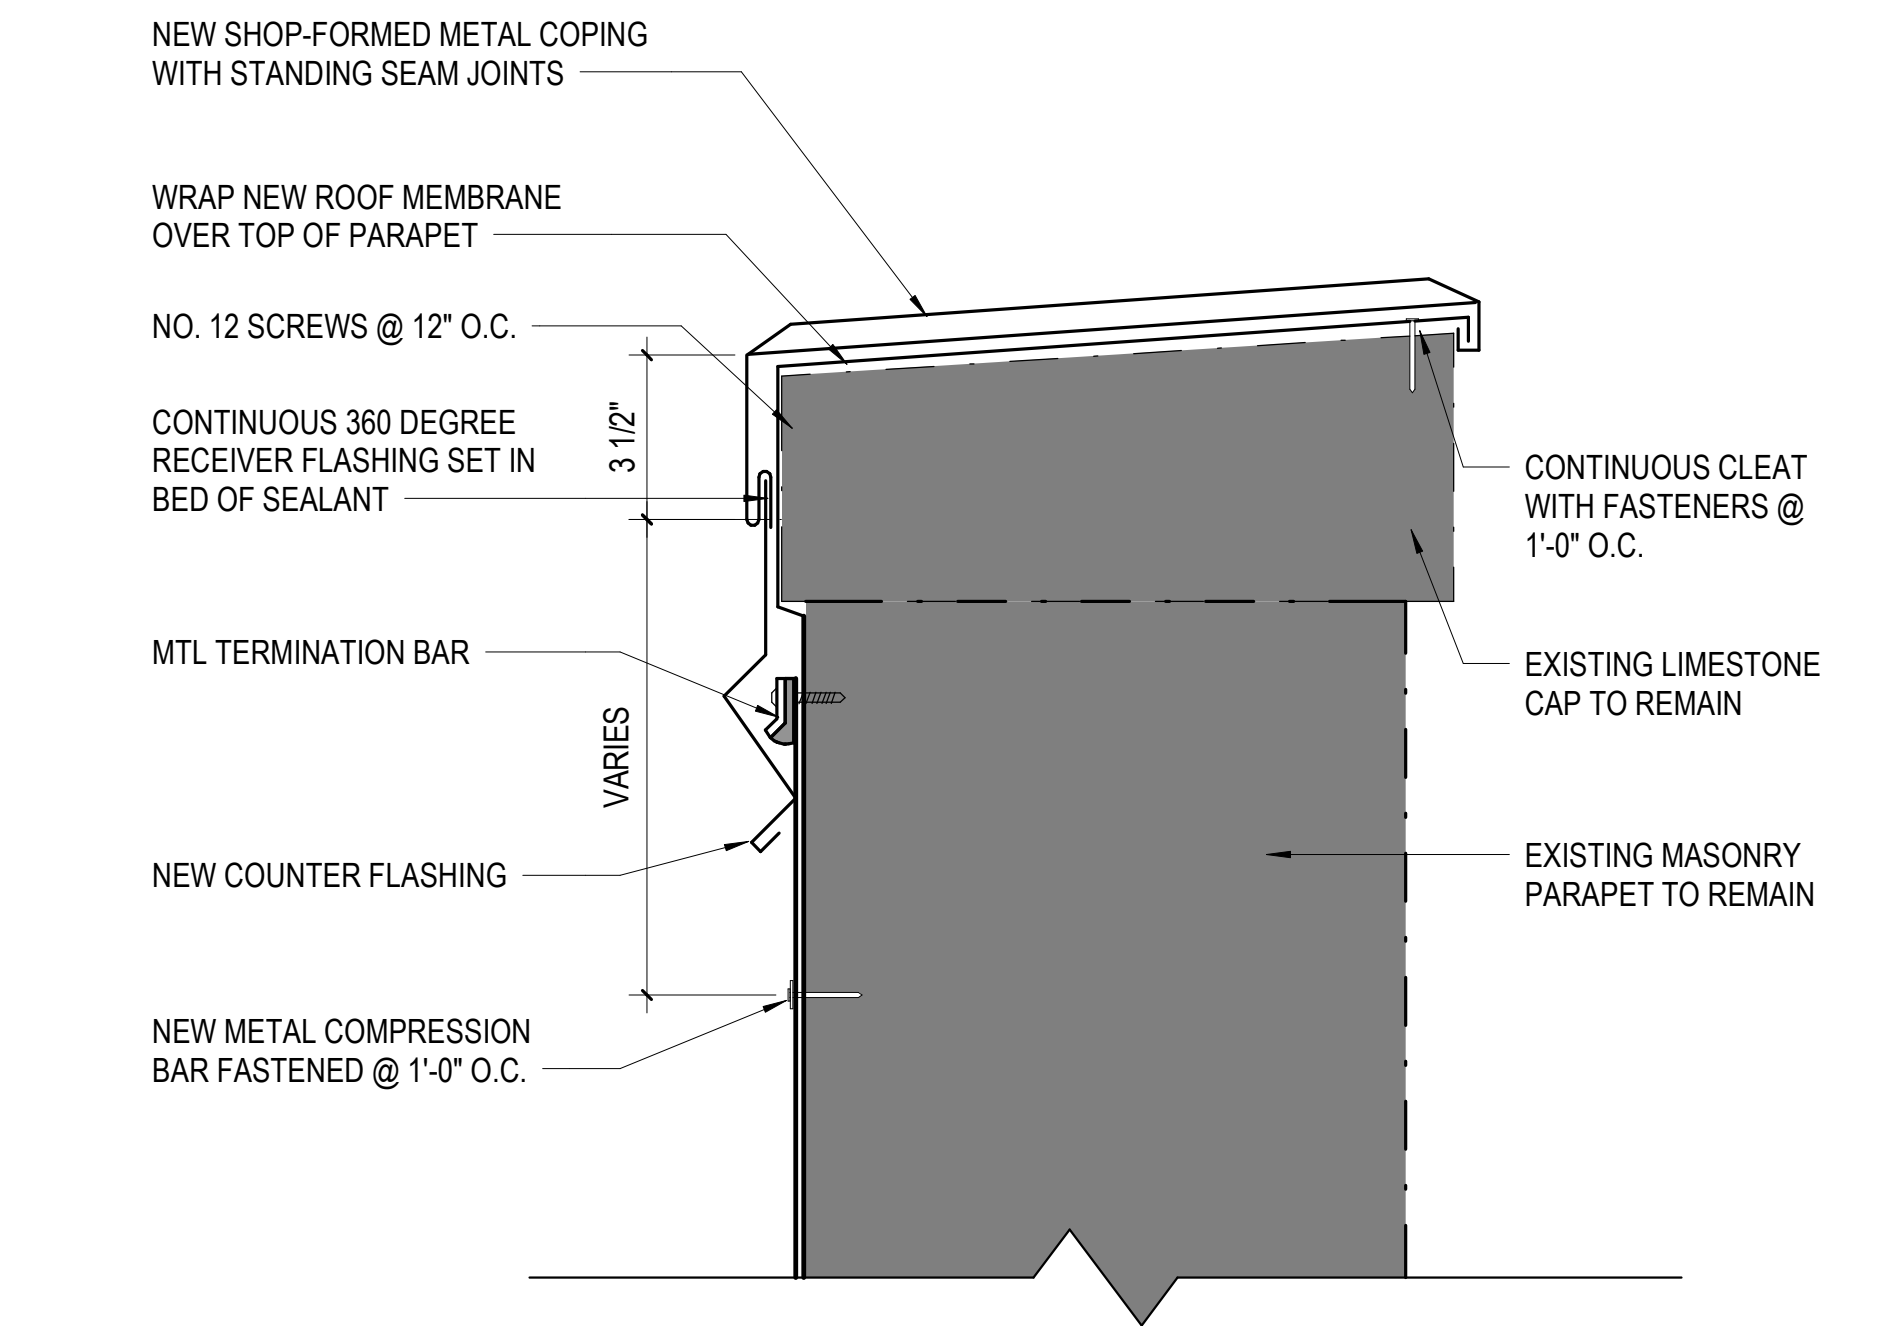

A6 ROOF DETAIL AT EXISTING UPPER FACADE
3" = 1'-0"

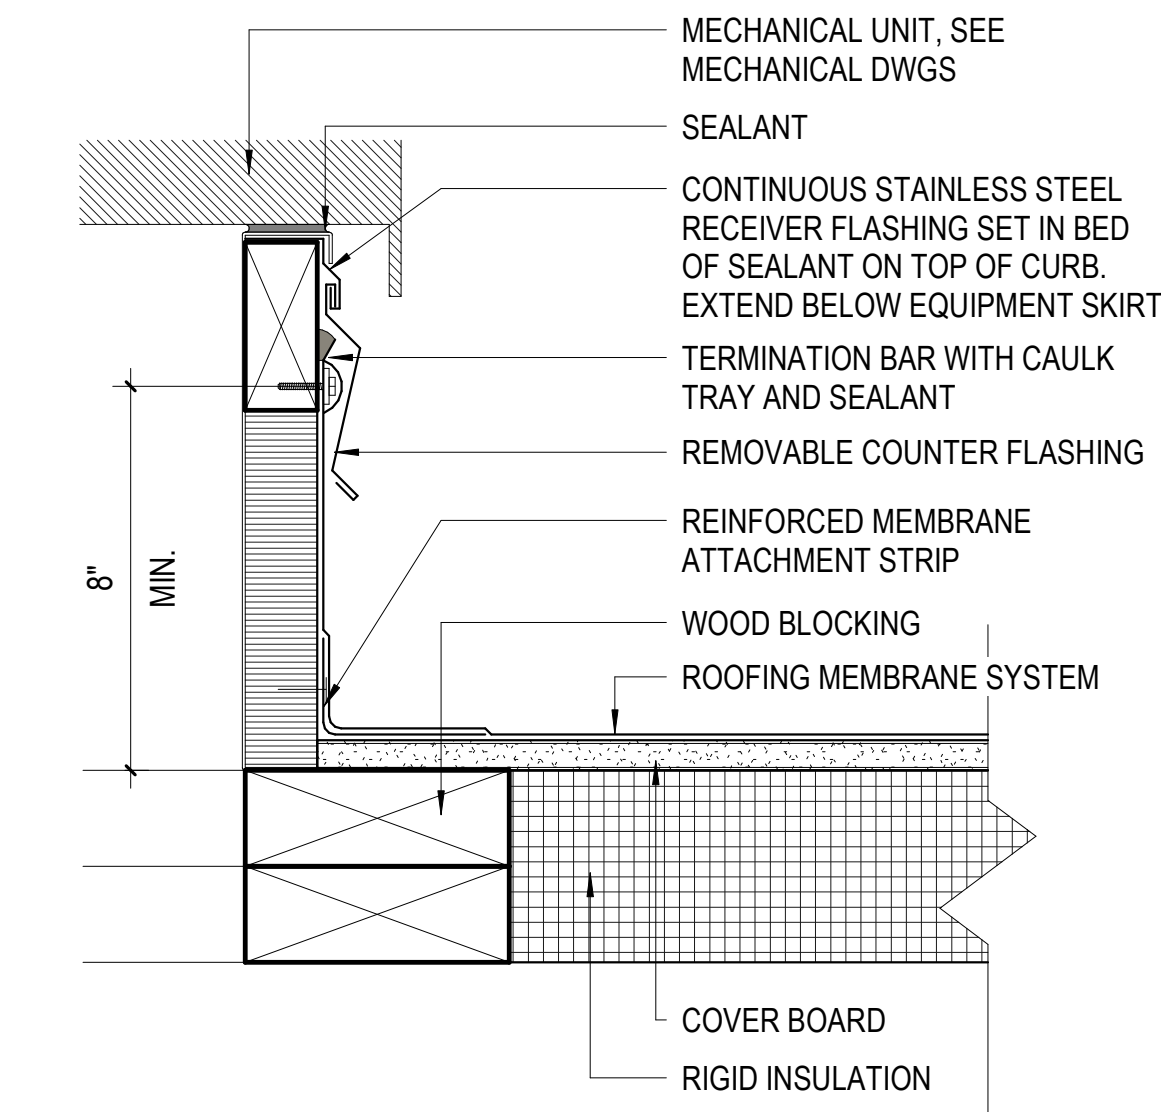


C5 TYPICAL ROOF - PREFABRICATED CURB
3" = 1'-0"



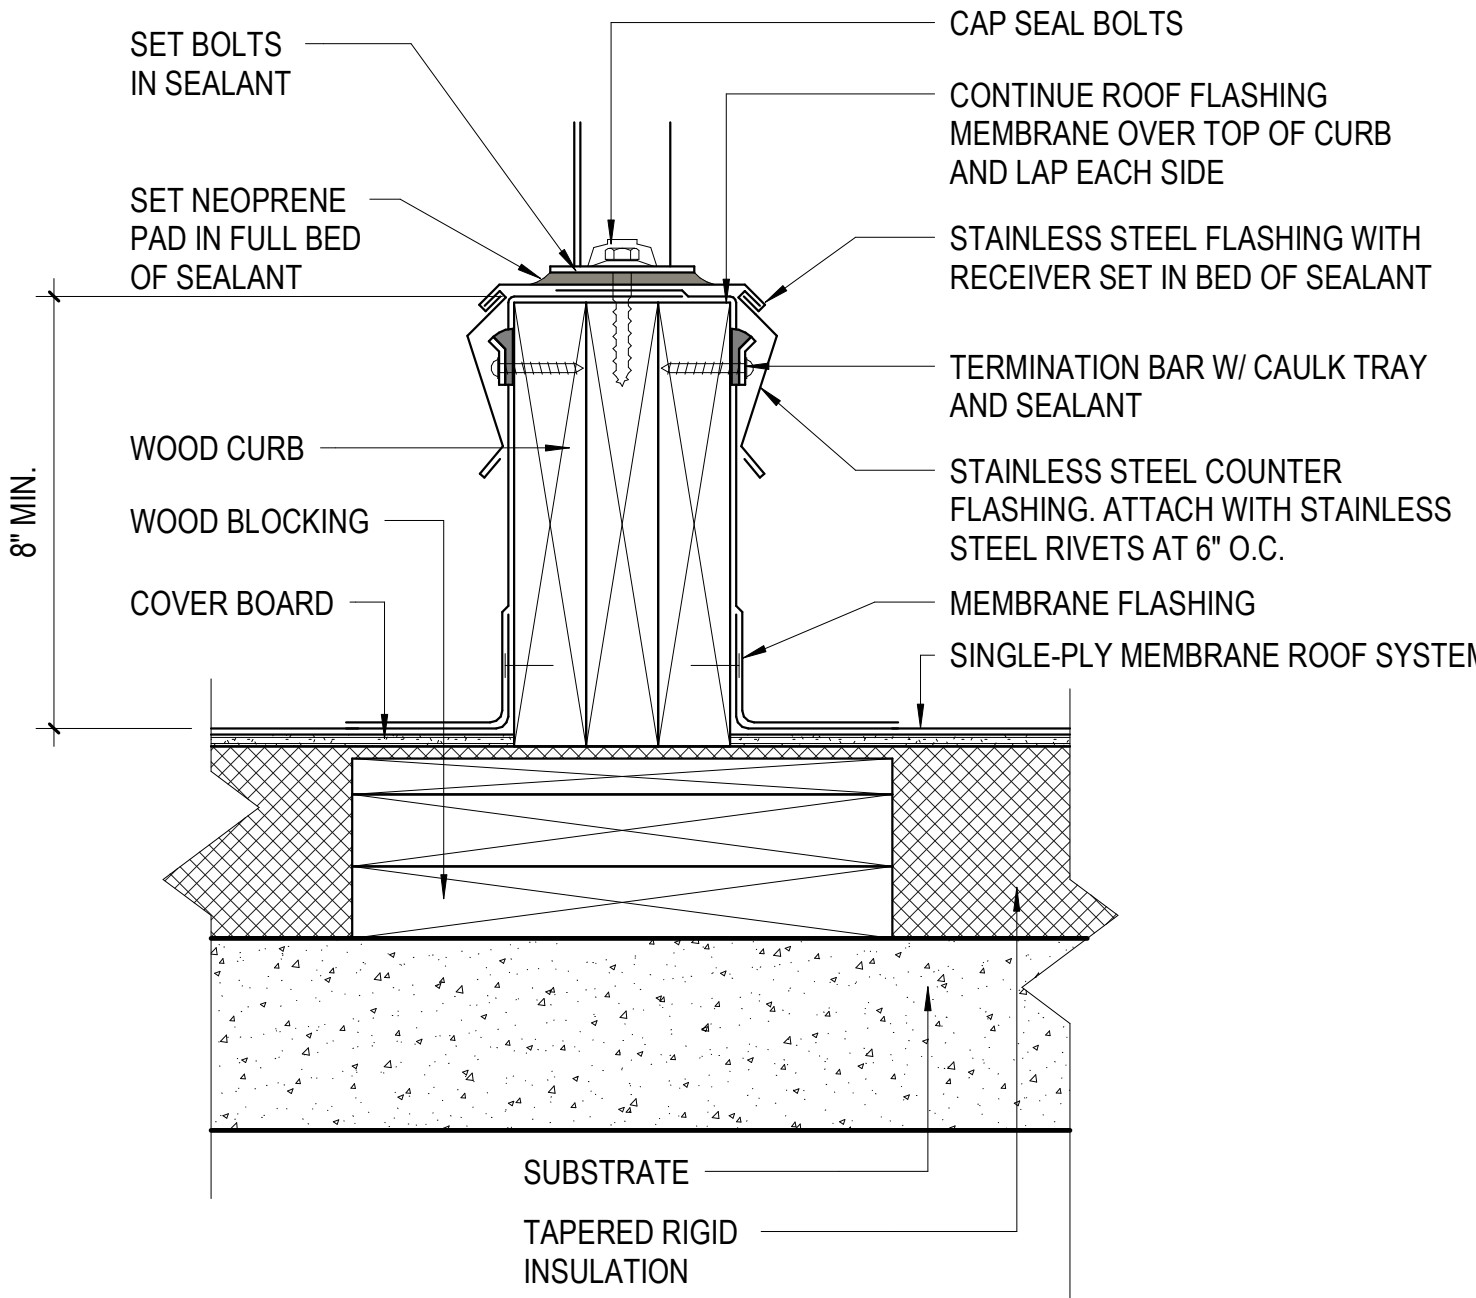



C3 TYPICAL ROOF EQUIPMENT SUPPORT
3" = 1'-0"

NOTE: INSULATION NOT SHOWN FOR CLARITY

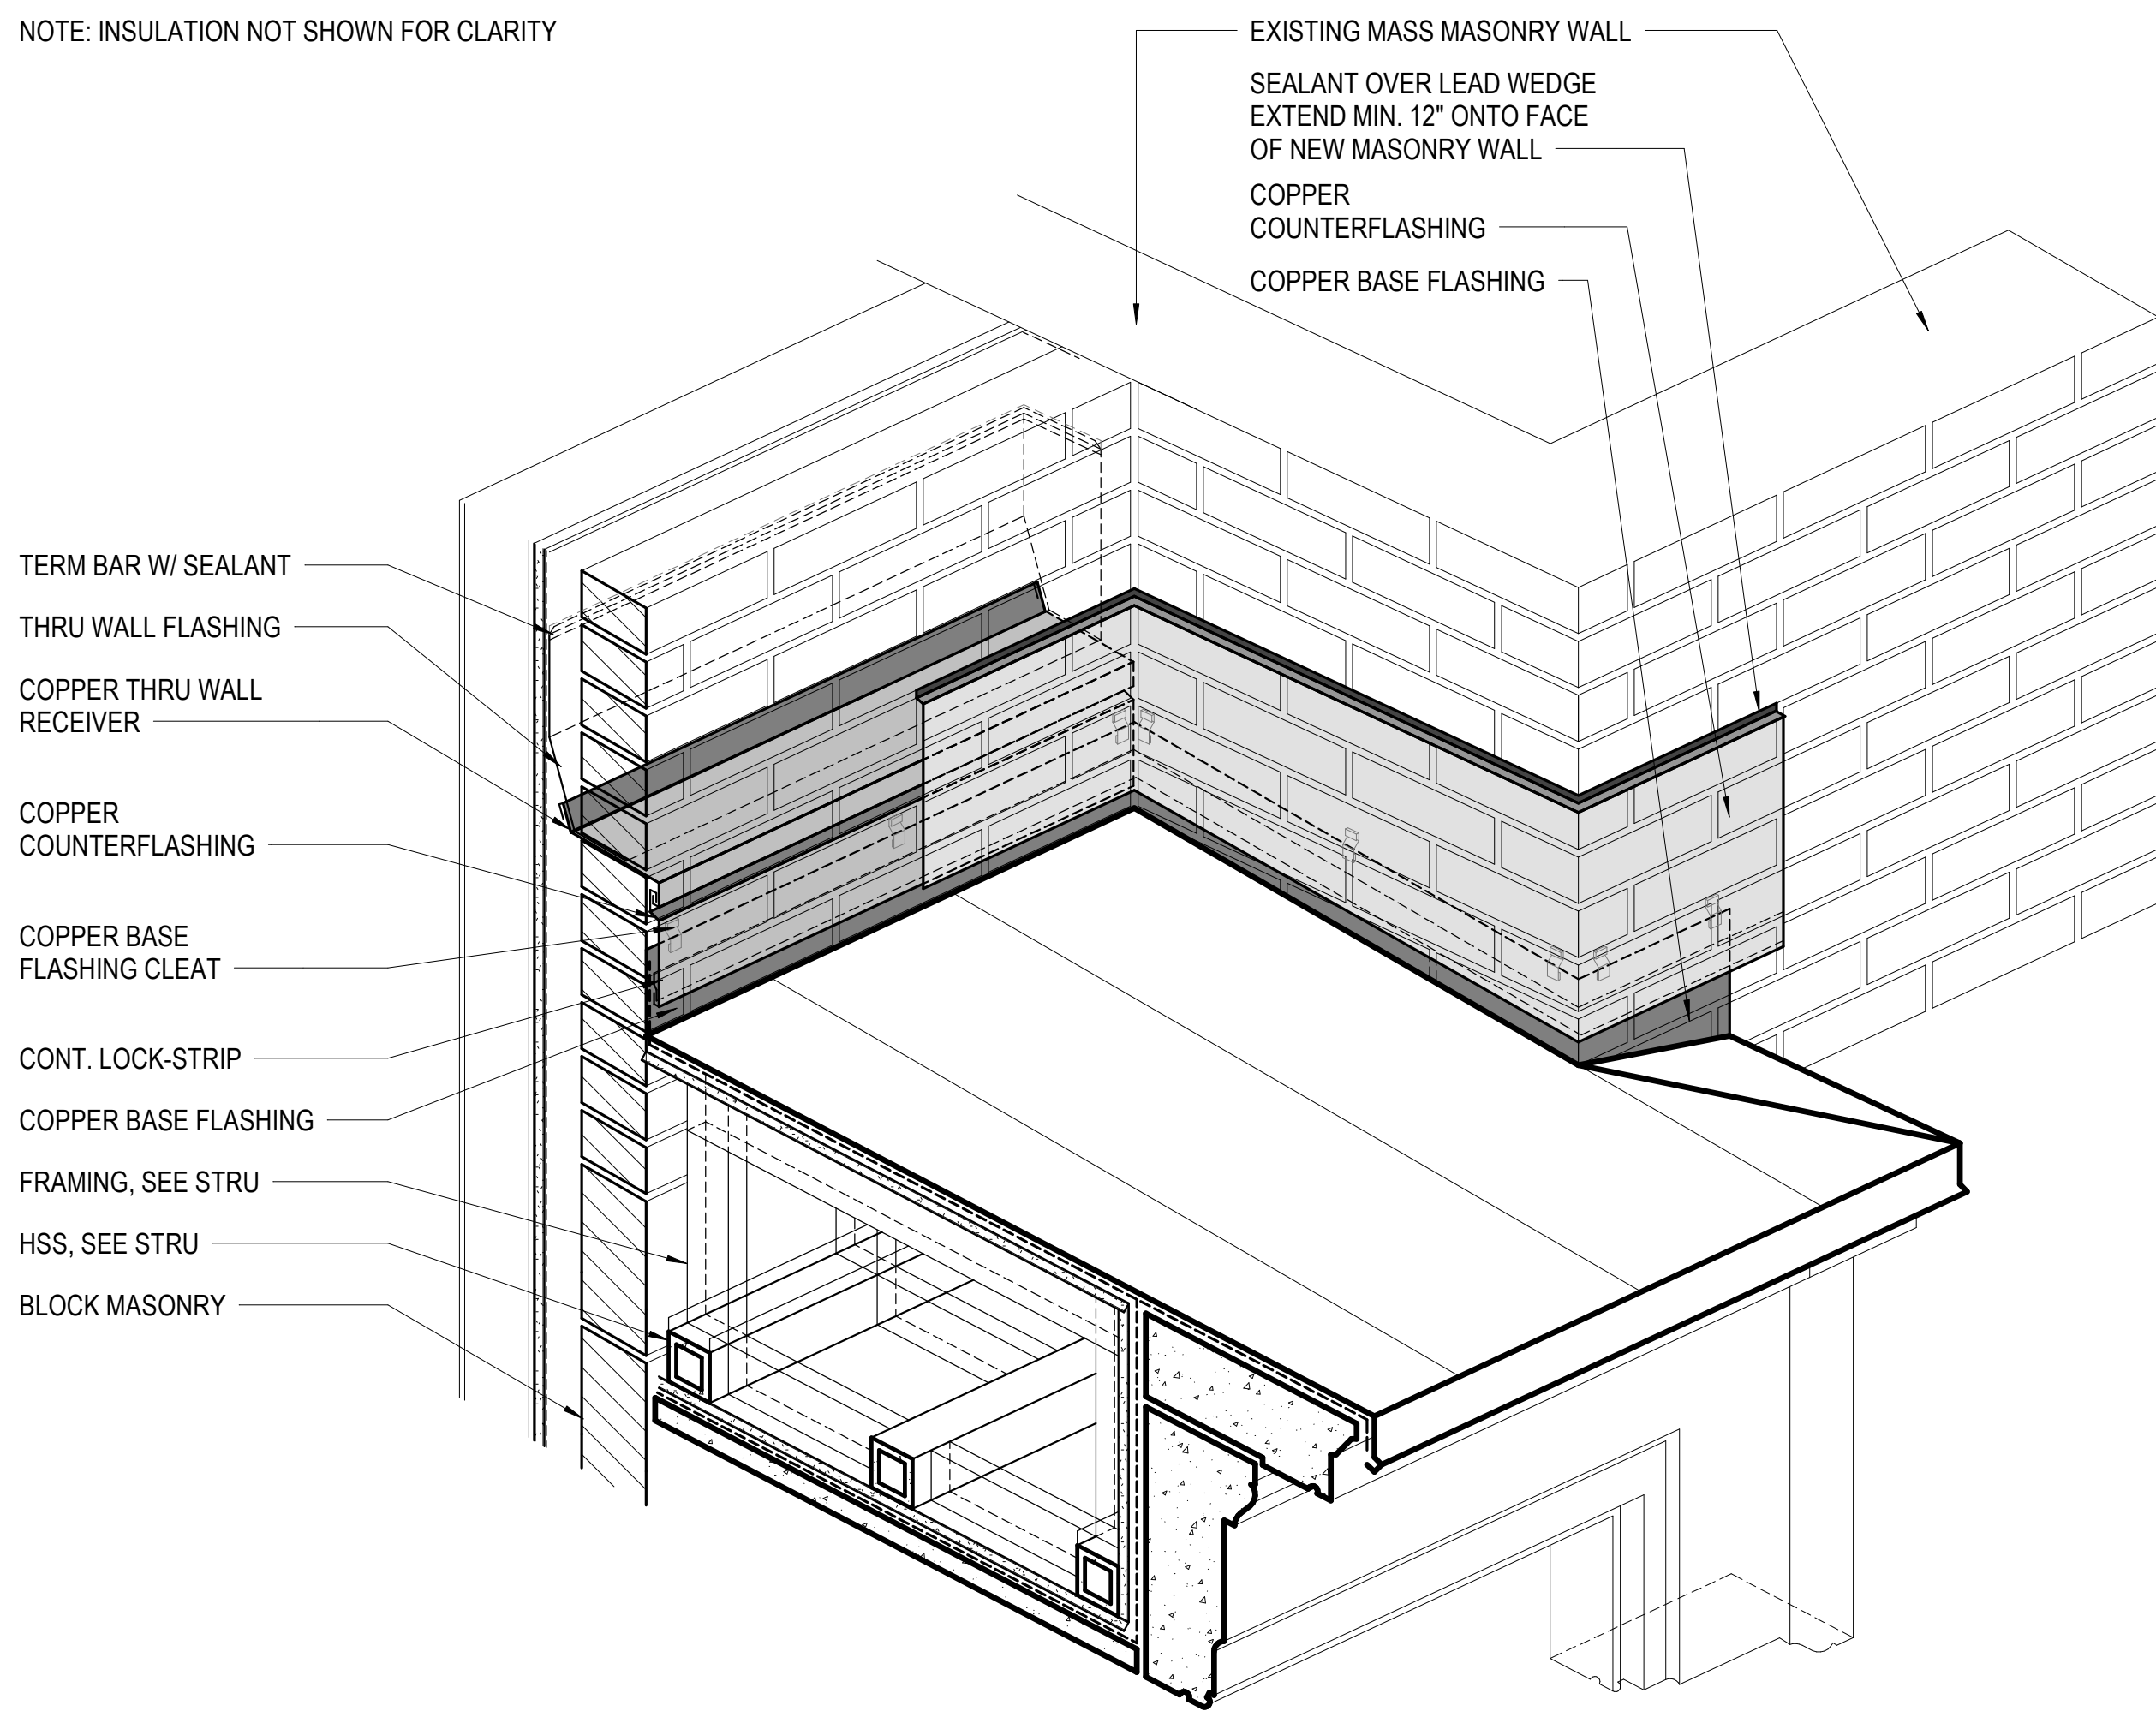


A4 WEST ENTRY AXON
1 1/2" = 1'-0"




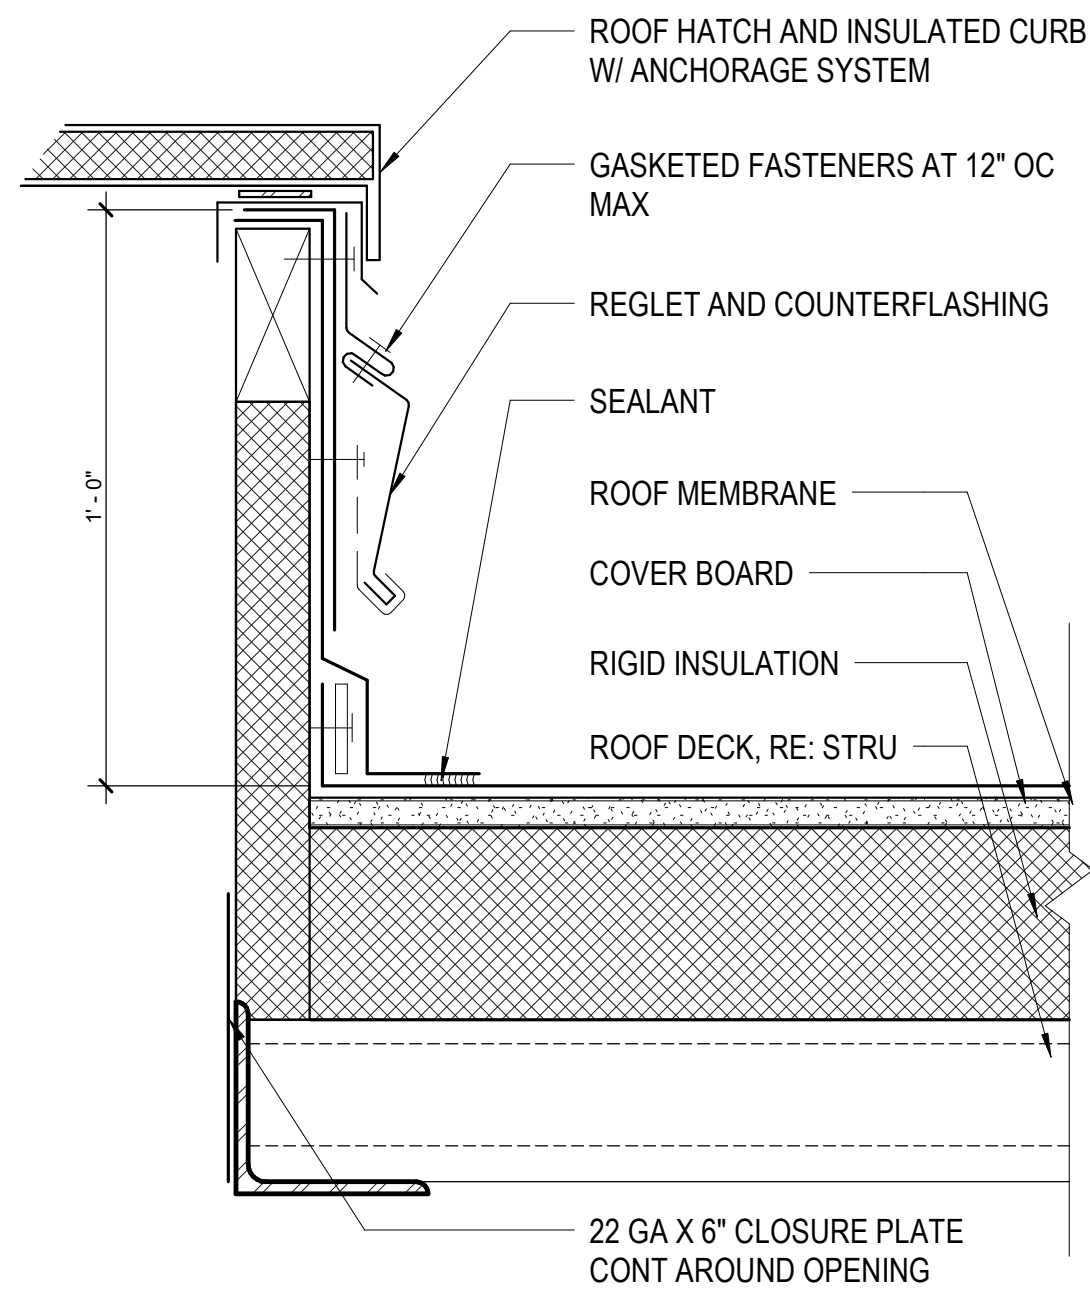


E6 ROOF HATCH CURB
3\"/>

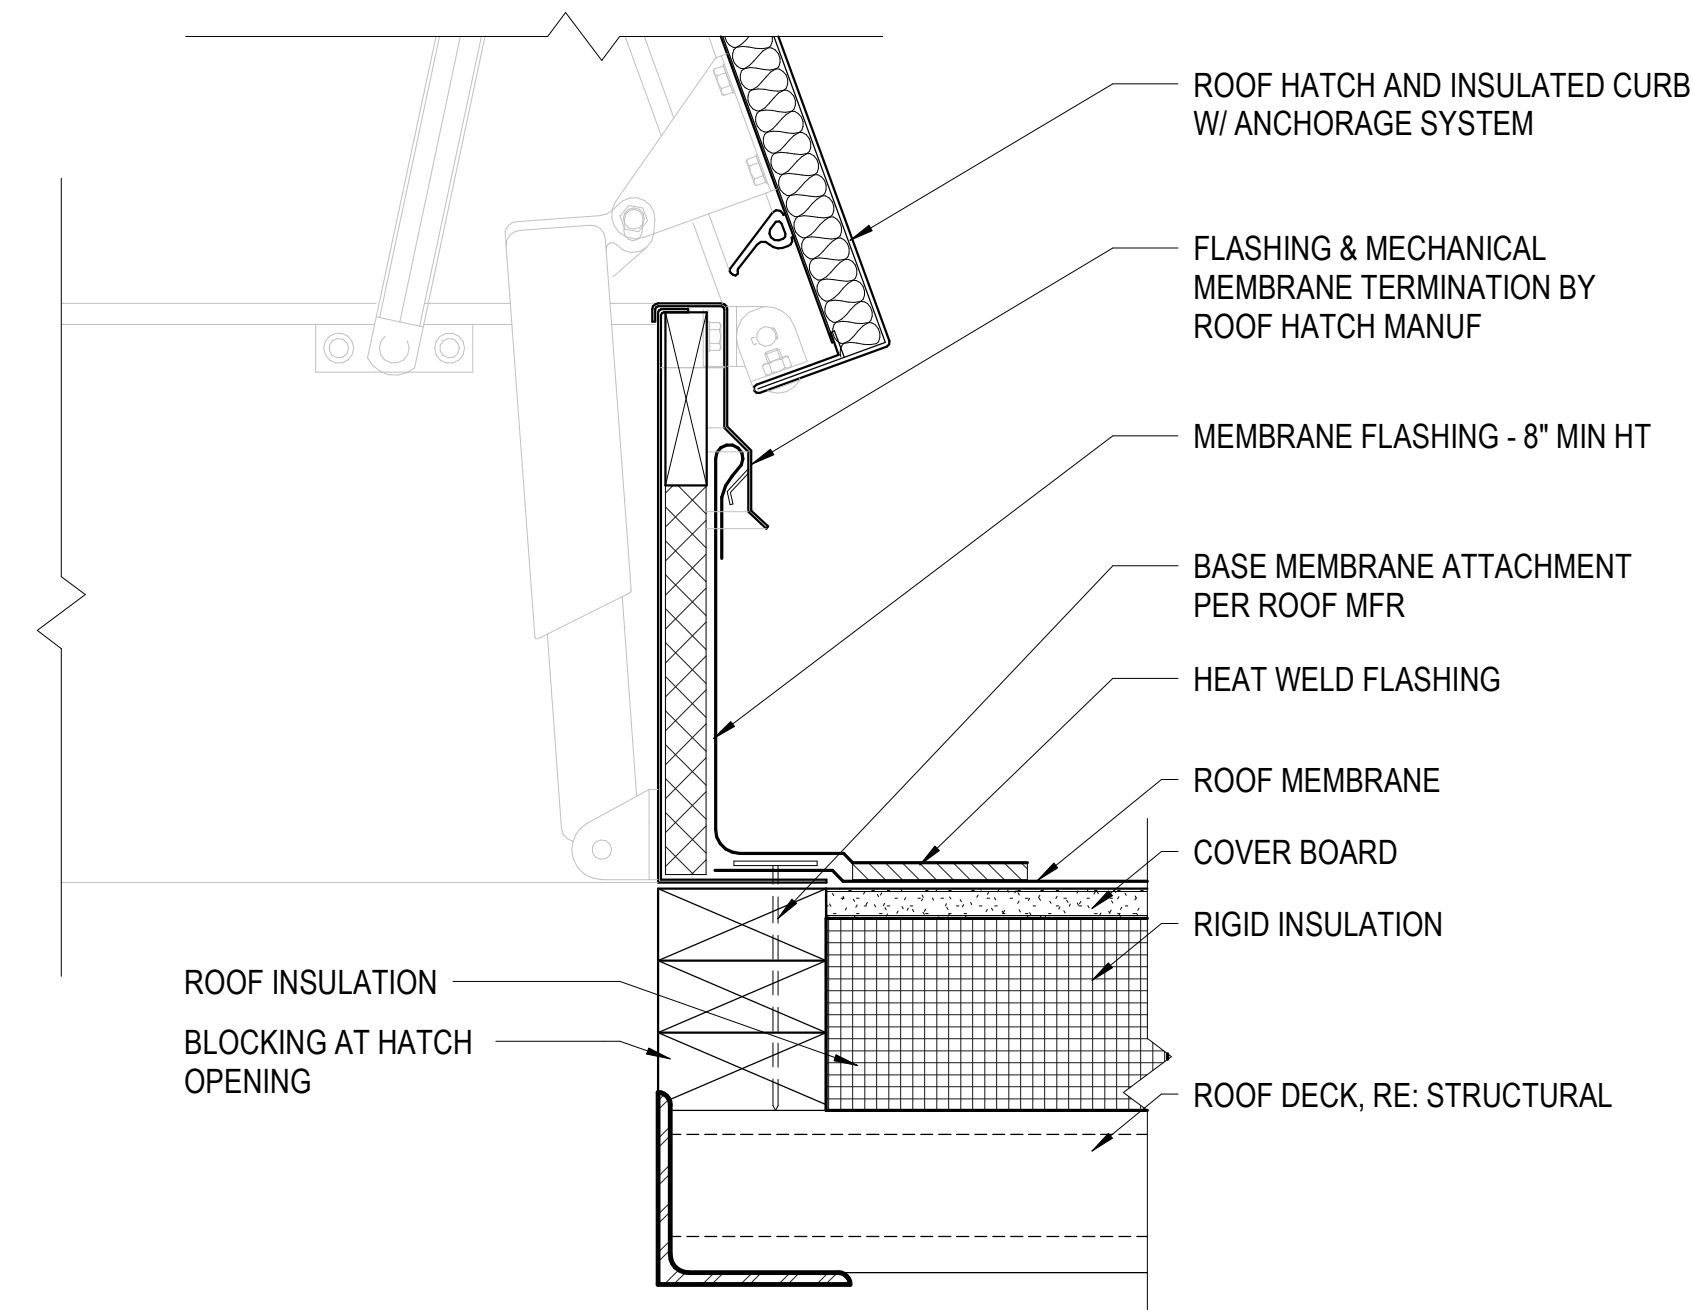


E4 ROOF HATCH DETAIL
3\"/>

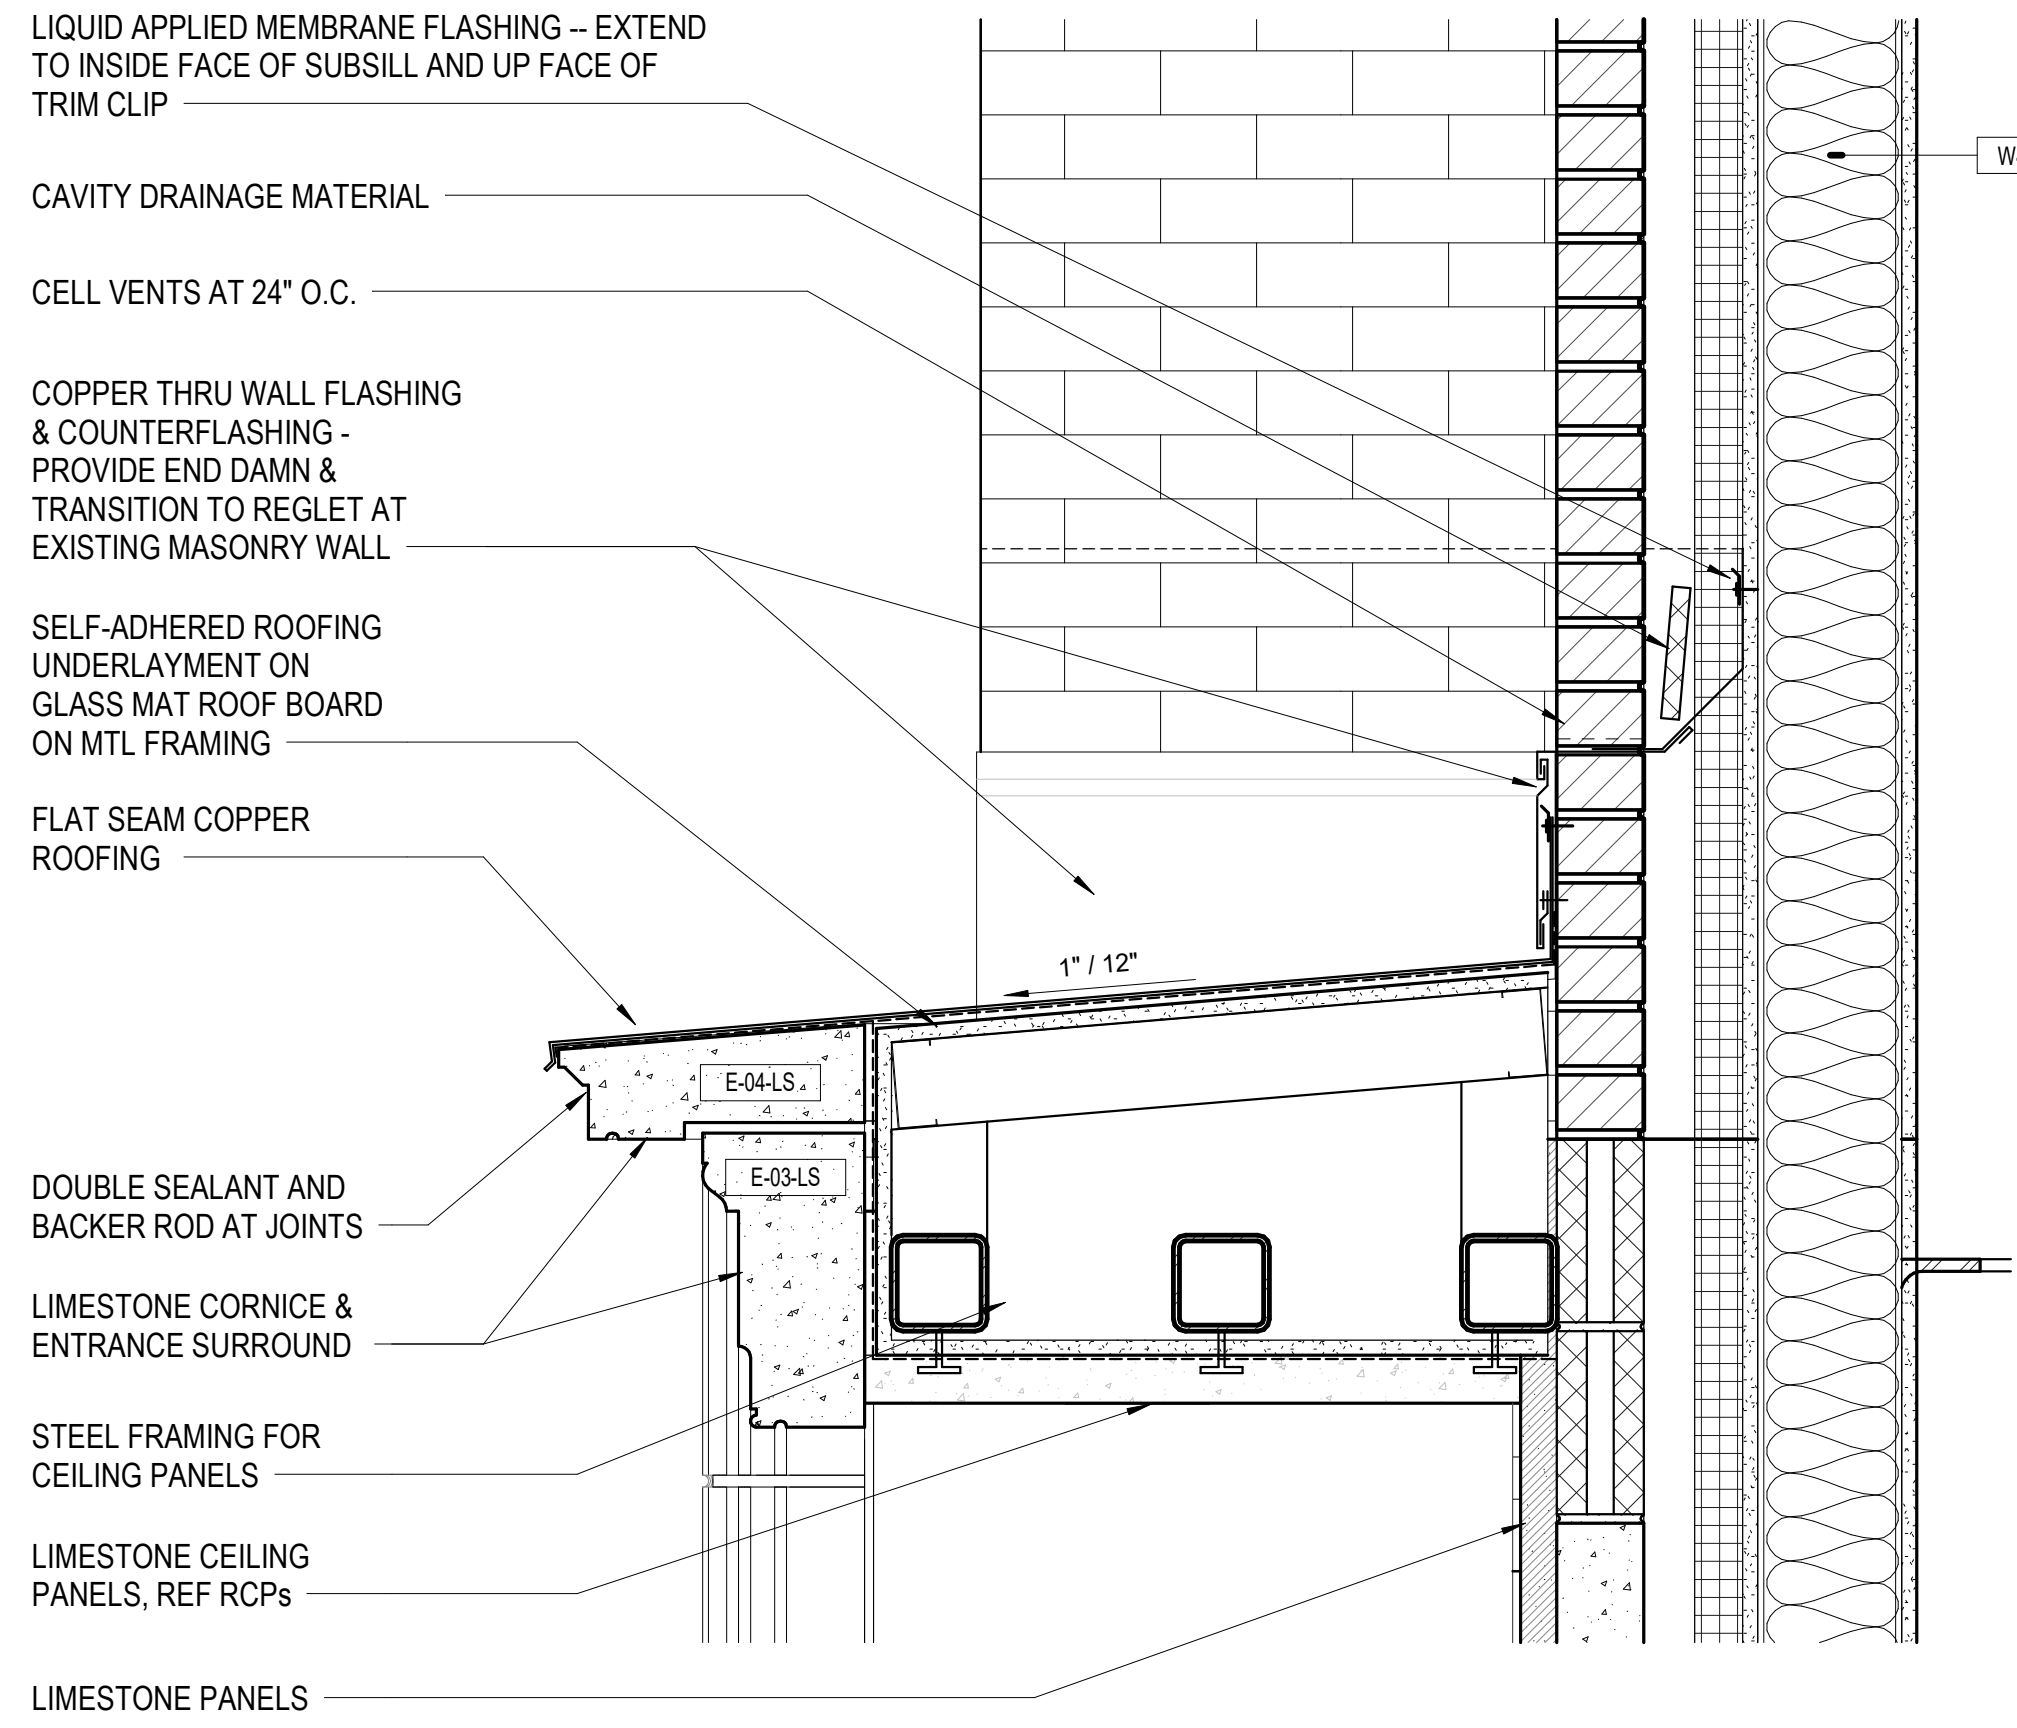


C5 DETAIL - ENTRY CANOPY
1 1/2\"/>

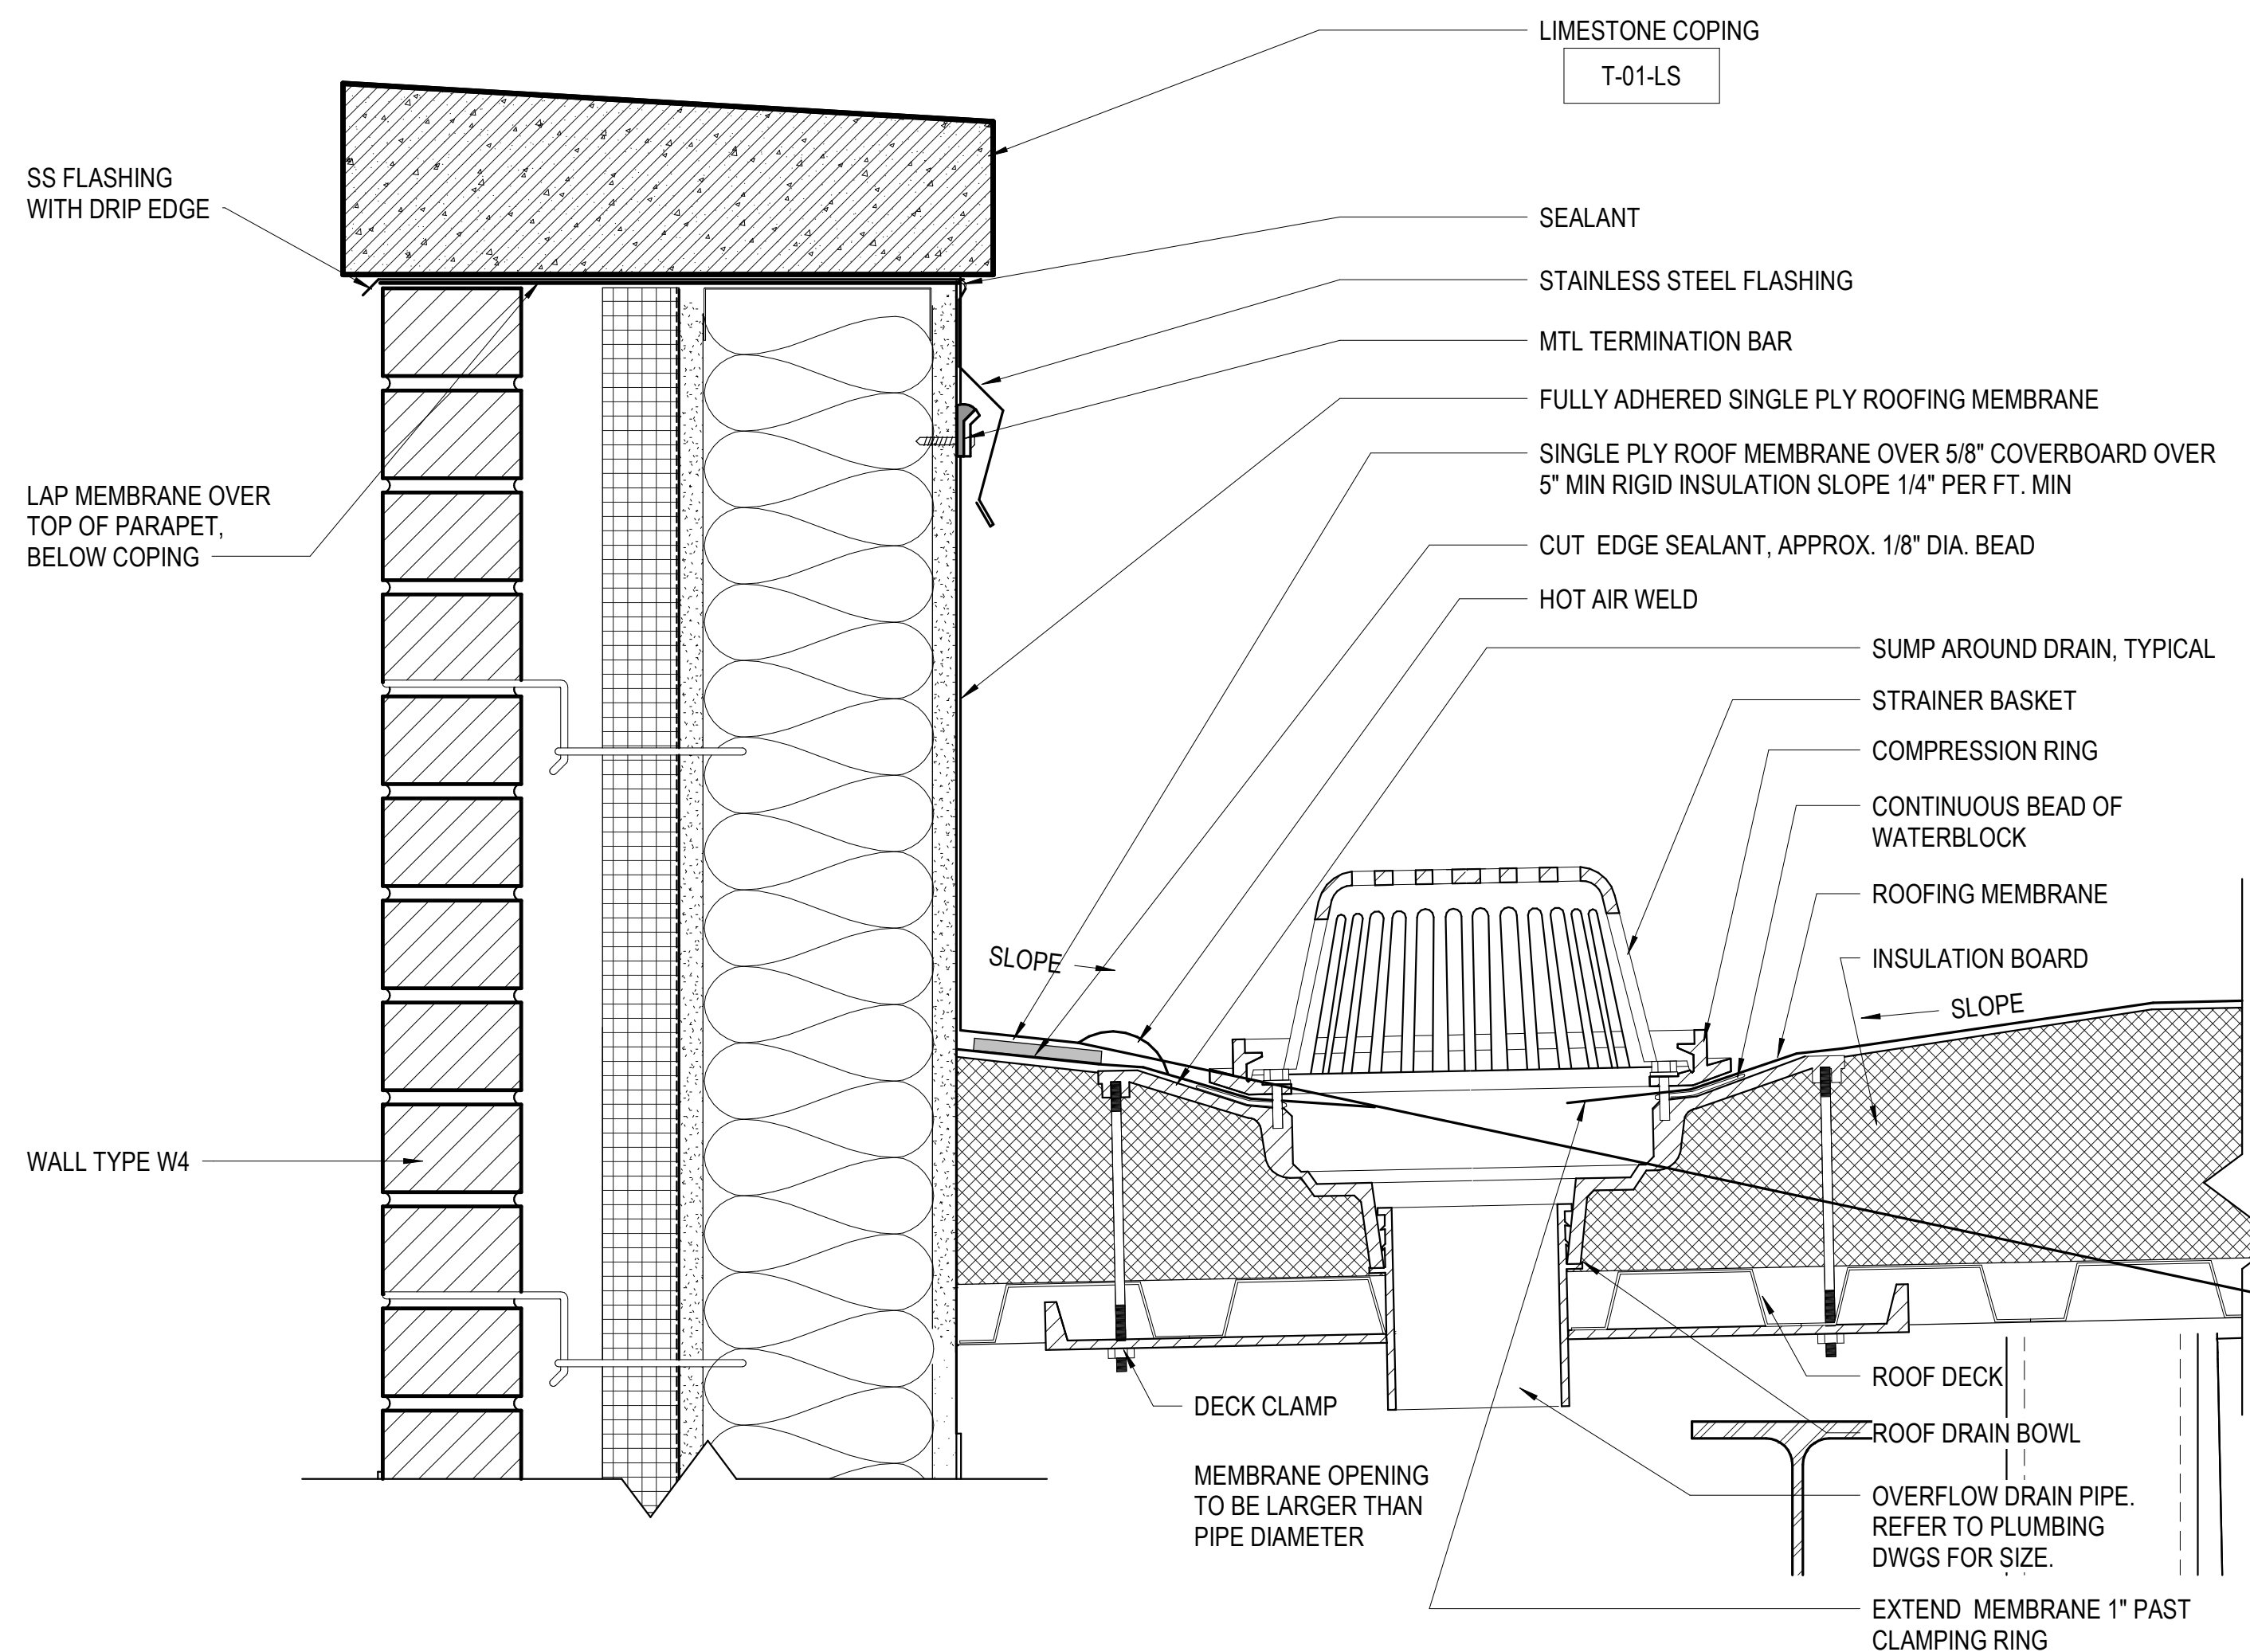


A5 DETAIL - ROOF DRAIN AT PARAPET
3\"/>

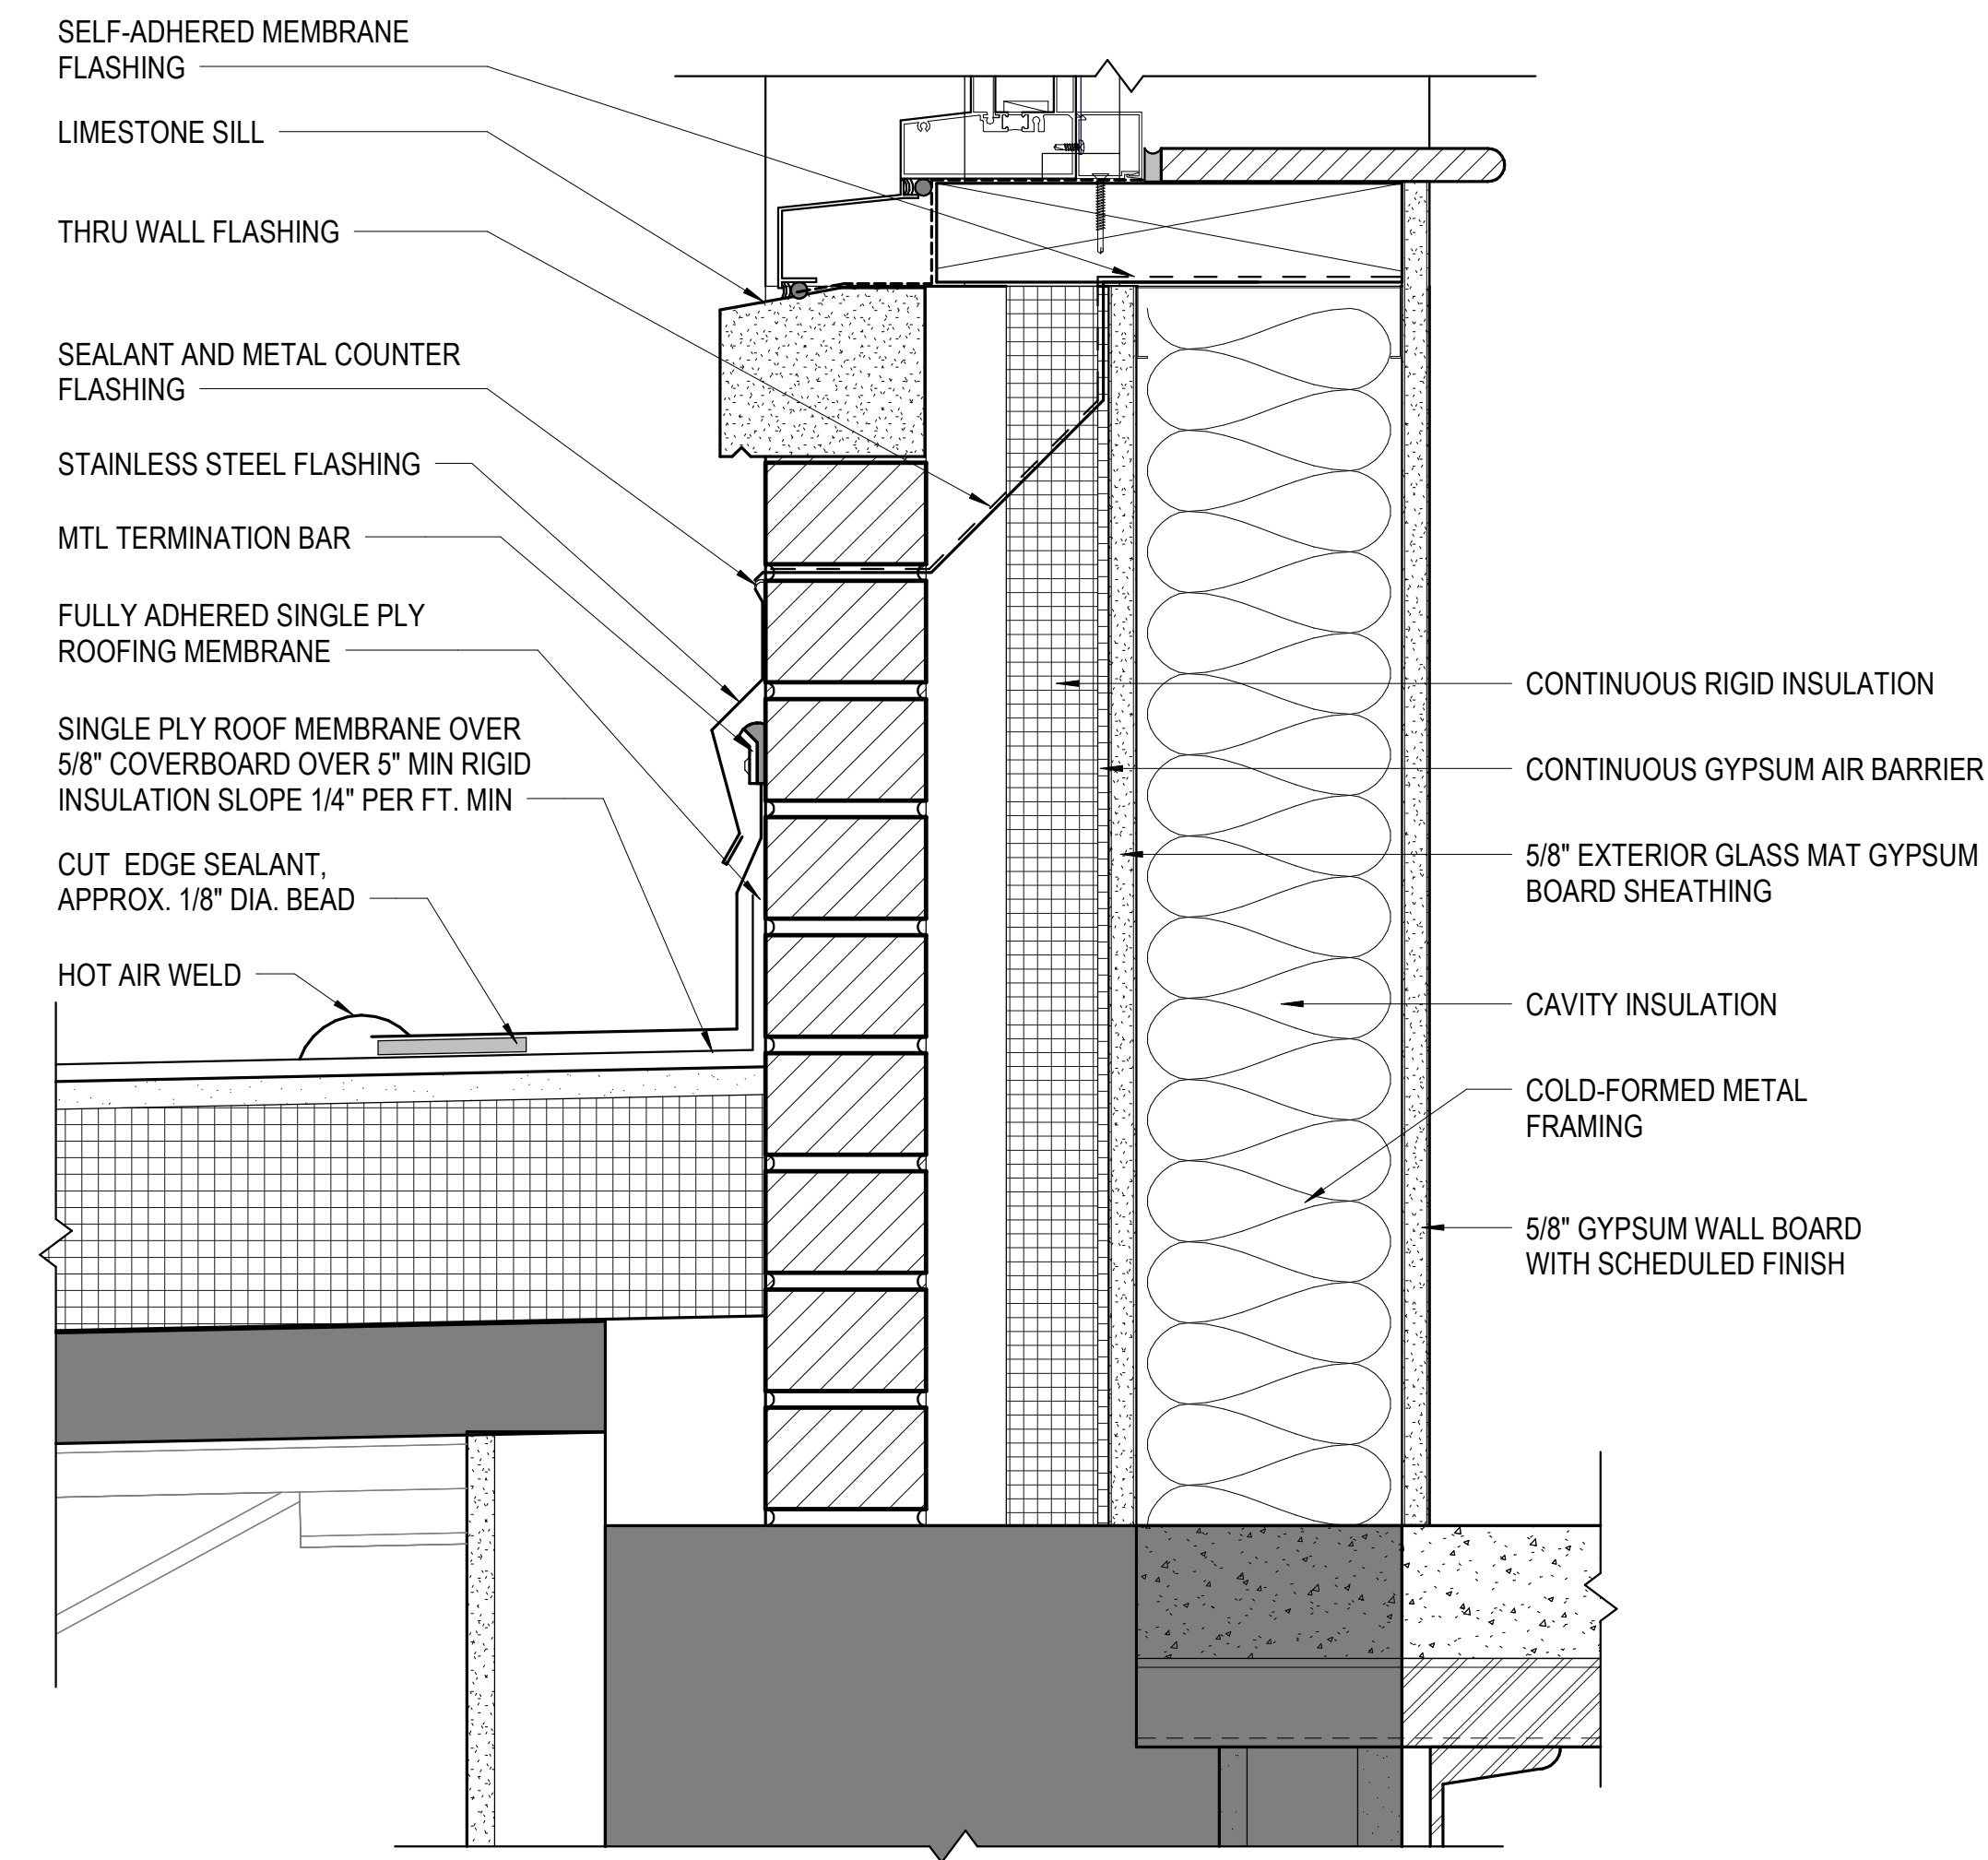


C2 ROOF DETAIL AT NEW WALL OVER EXISTING
3\"/>

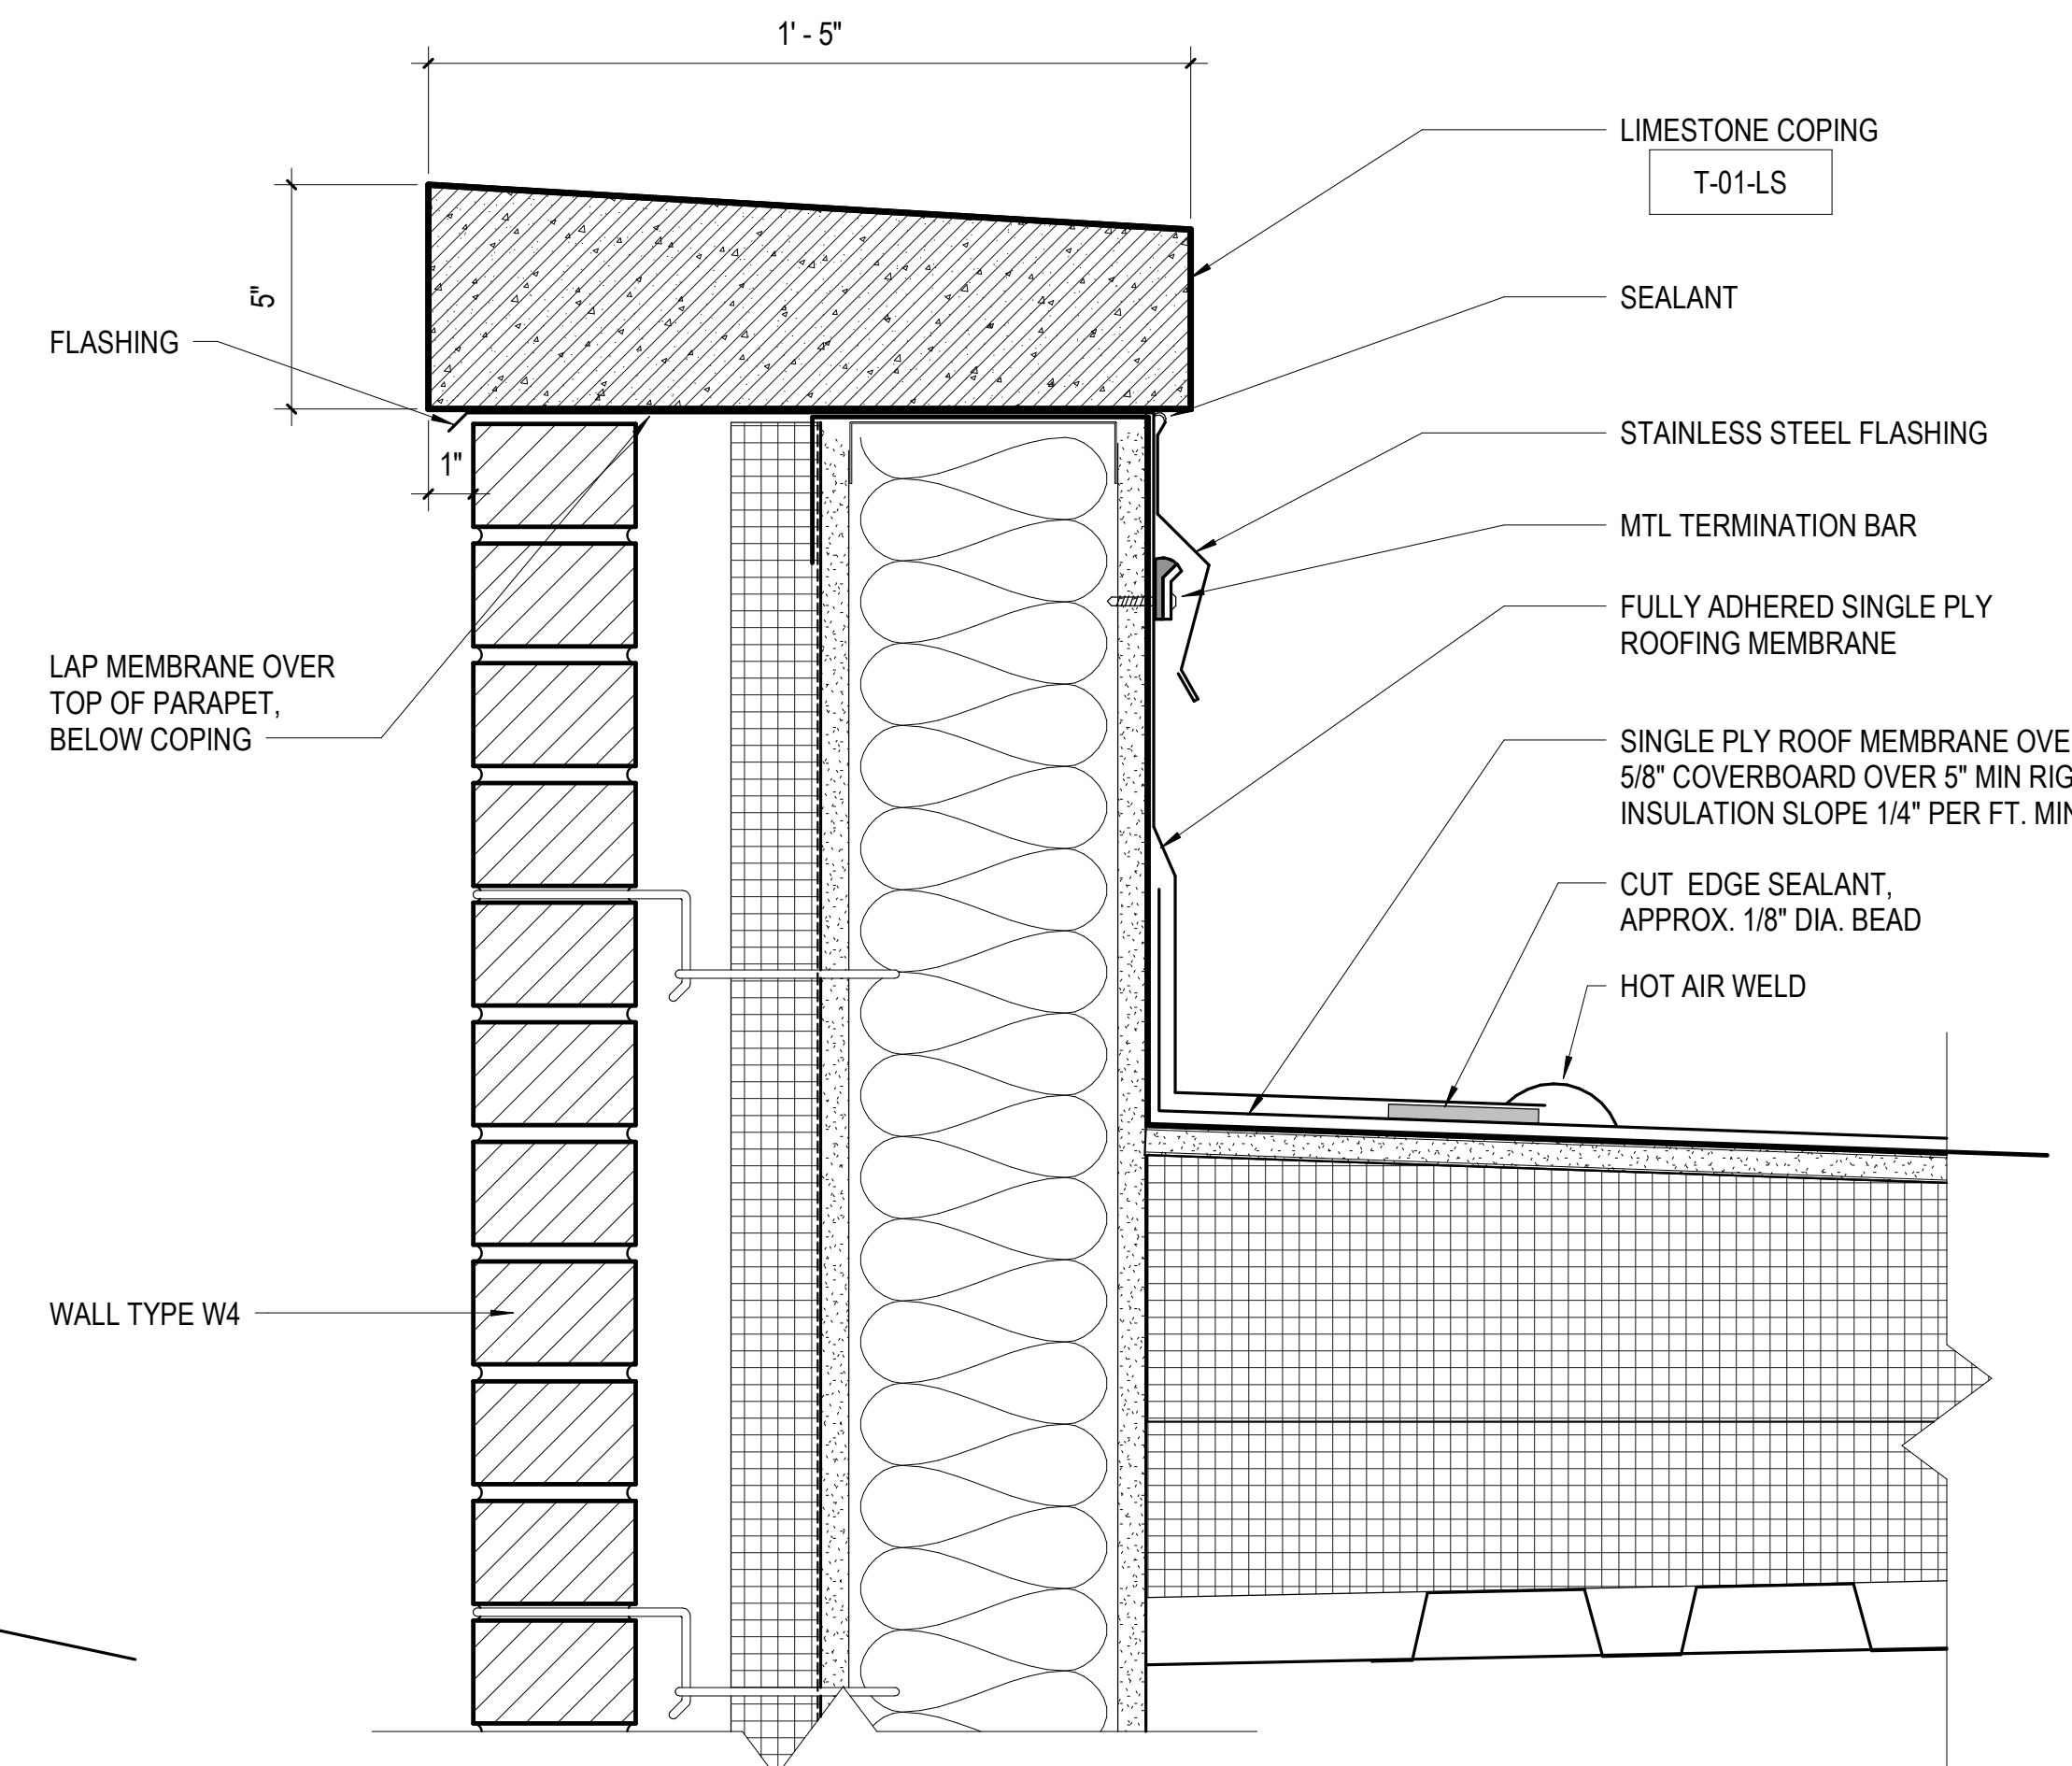

A2 TYP PARAPET DETAIL @ ADDITION
3\"/>

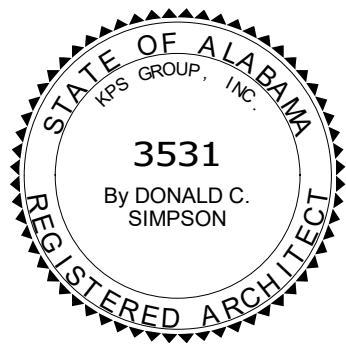


TYPE 'A' - ACOUSTICAL PARTITION

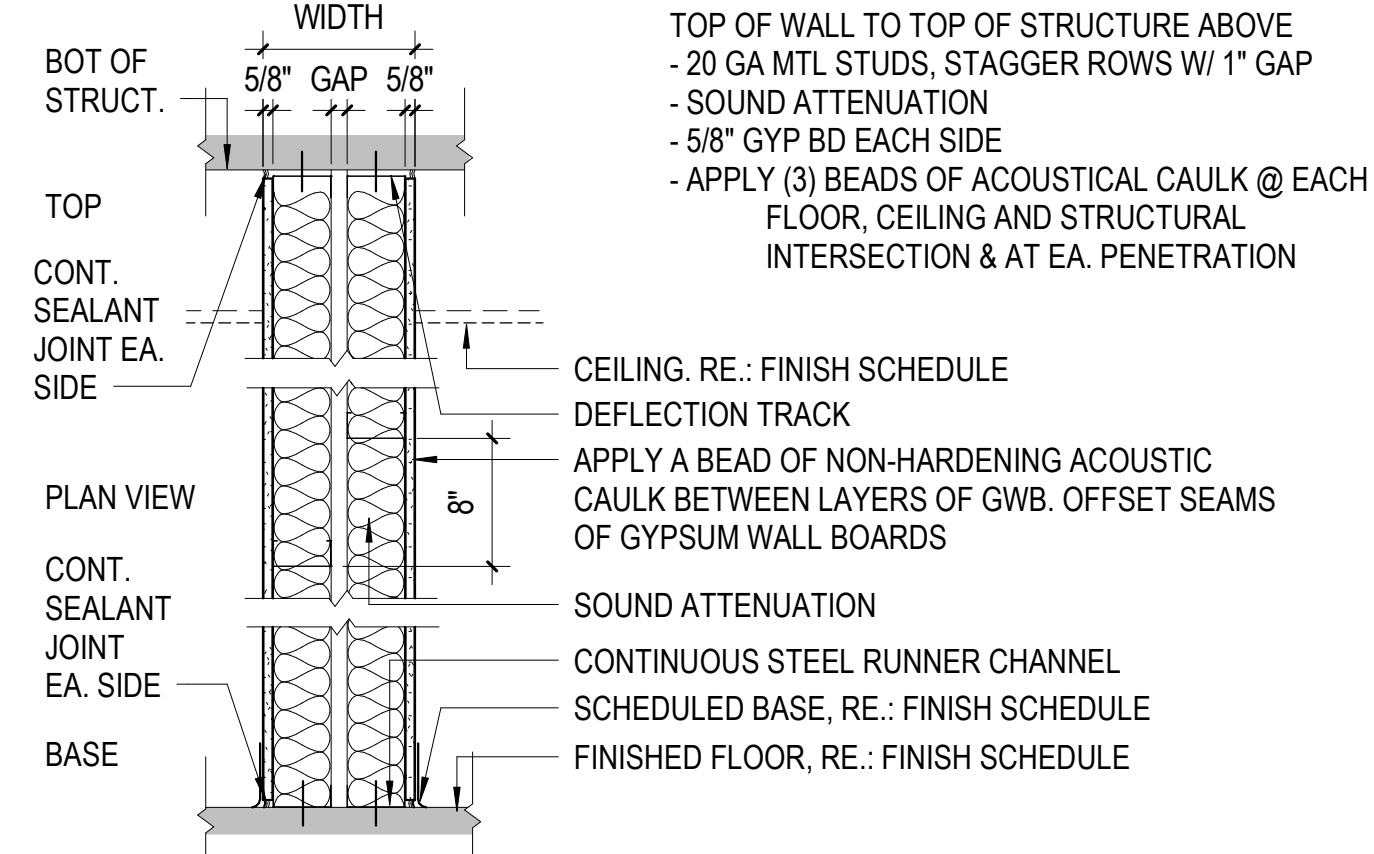


MARK	WIDTH	DESCRIPTION	SUFFIX
A2	7 1/4"	2 1/2" MTL STUDS W/ 1" GAP	g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
A3	9 1/2"	3 5/8" MTL STUDS W/ 1" GAP	
A4	10 1/4"	4" MTL STUDS W/ 1" GAP	
A6	1'-2 1/4"	6" MTL STUDS W/ 1" GAP	

TYPE 'F' - WALL FURRING

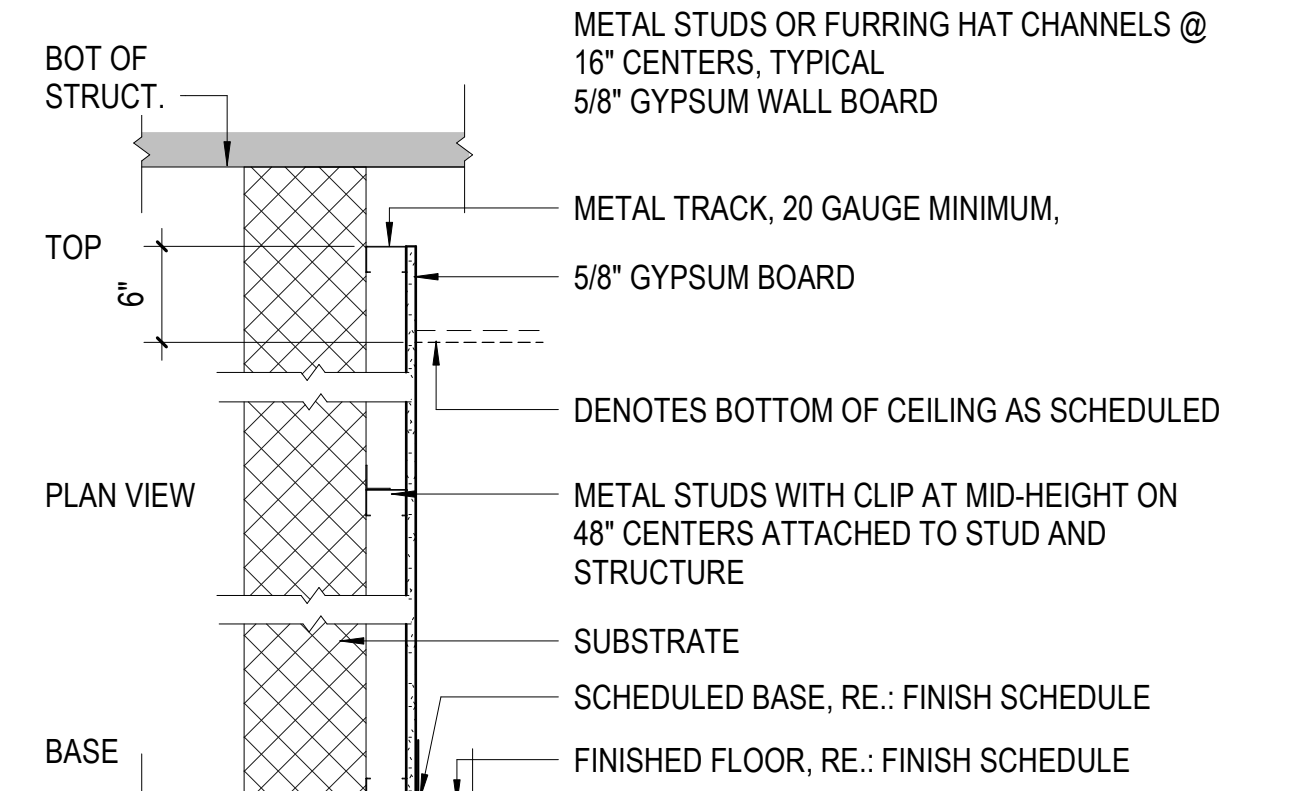


MARK	WIDTH	DESCRIPTION	SUFFIX
F1	2 1/4"	1 5/8" MTL STUDS	g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
F2	3 1/8"	2 1/2" MTL STUDS	
F3	4 1/4"	3 5/8" MTL STUDS	
FH	1 1/2"	7/8" MTL HAT CHANNELS	

TYPE 'S' - STEEL STUDS, NON-BEARING GWB

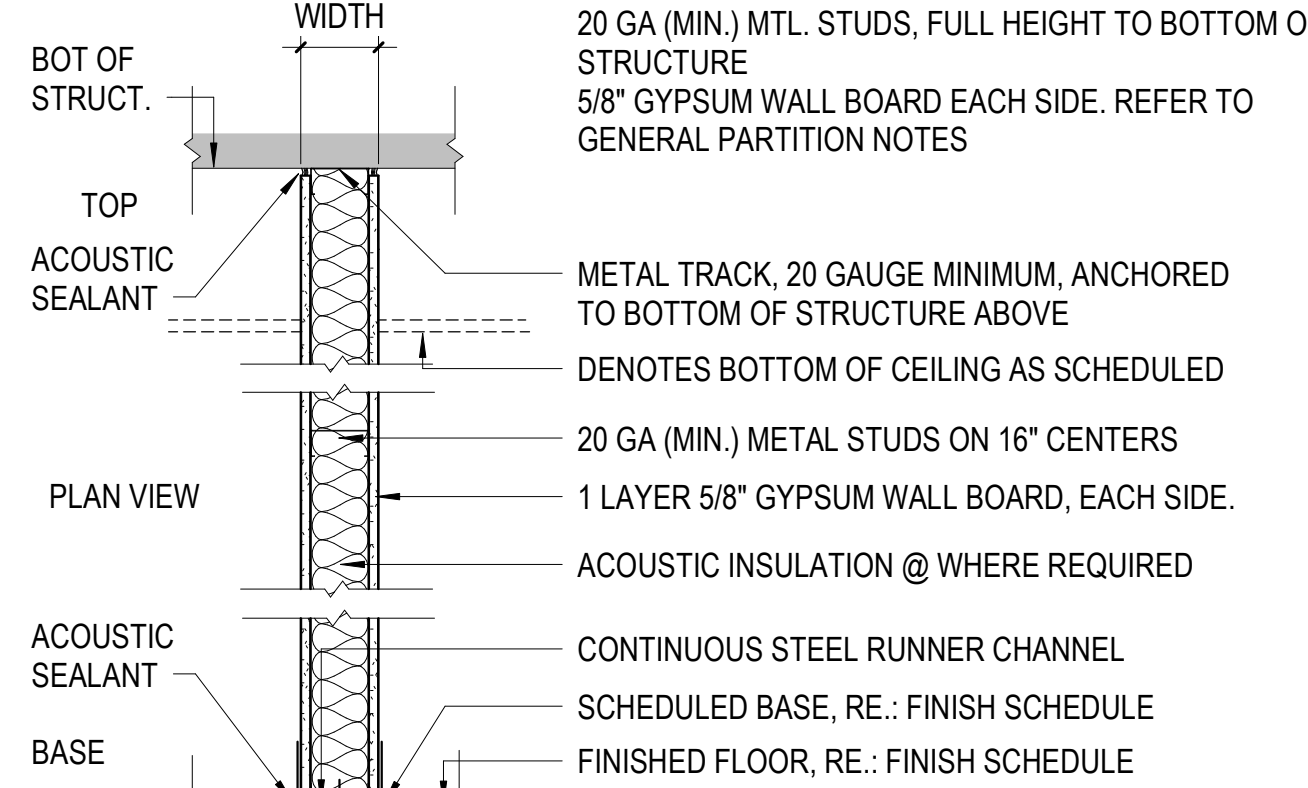

MARK	WIDTH	DESCRIPTION	SUFFIX
S2	3 1/4"	2-1/2" MTL STUDS	a - SOUND g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT s - SMOKE BARRIER
S3	4 7/8"	3-5/8" MTL STUDS	
S6	7 1/4"	6" MTL STUDS	
S8	9 1/4"	8" MTL STUDS	


TYPE 'F(X)' - FURRING, FIRE-RATED

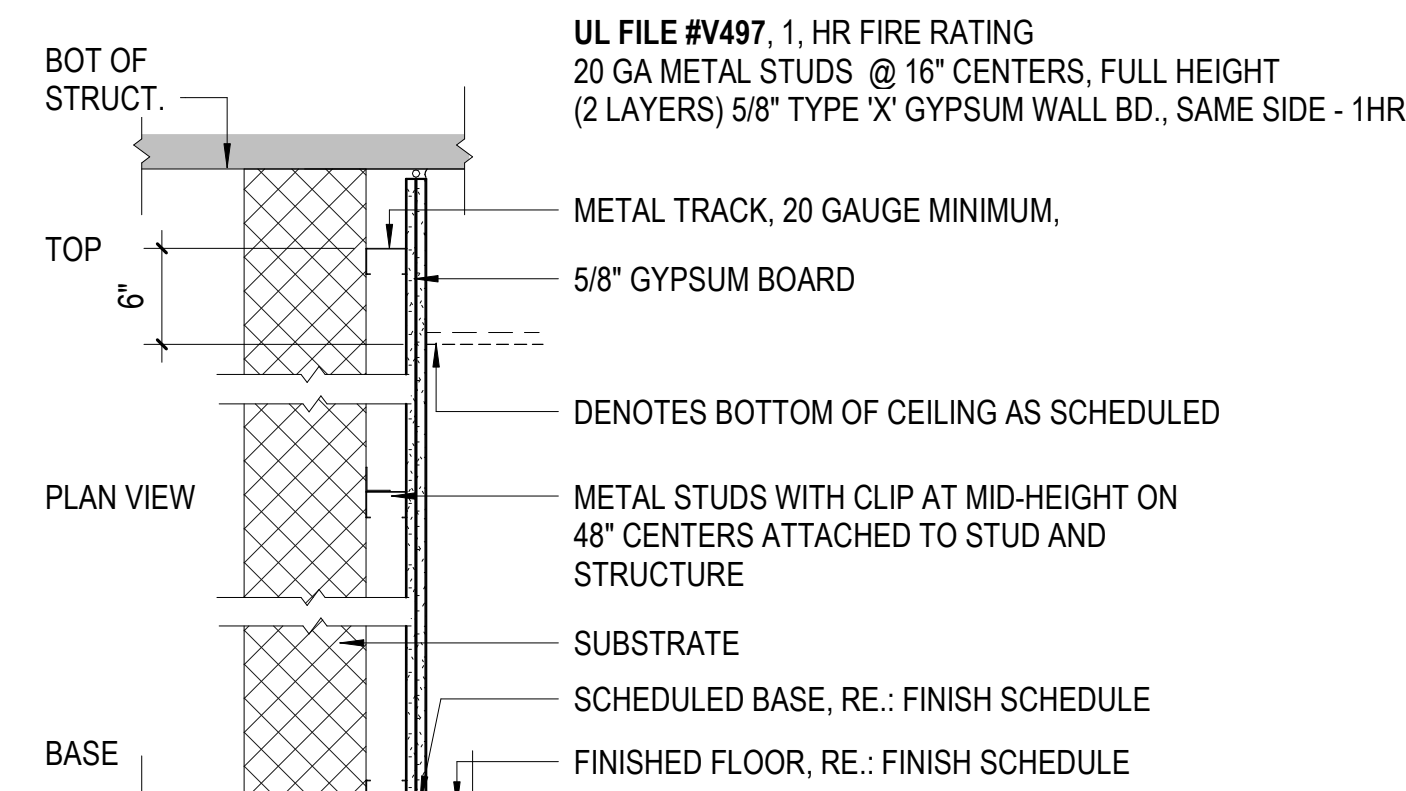

MARK	WIDTH	DESCRIPTION	SUFFIX
FX1	2 1/4"	3 5/8" MTL STUDS	


NOTE:
NOT ALL WALL TYPES SHOWN MAY BE USED.

TYPE 'AF' - FIRE-RATED ACOUSTICAL PARTITION

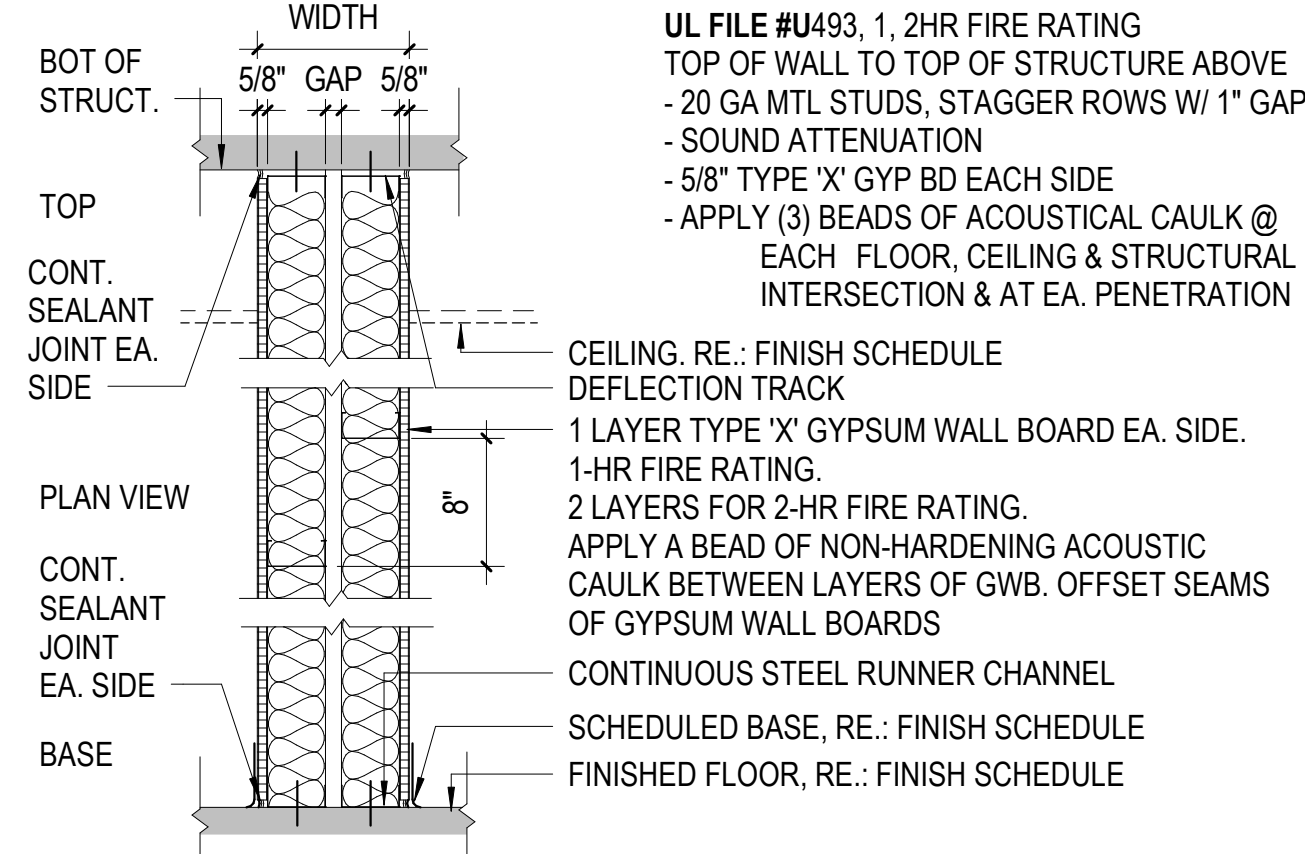


MARK	WIDTH	DESCRIPTION	SUFFIX
AF2	7 1/4"	2 1/2" MTL STUDS W/ 1" GAP	g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
AF3	9 1/2"	3 5/8" MTL STUDS W/ 1" GAP	
AF4	10 1/4"	4" MTL STUDS W/ 1" GAP	
AF6	1'-2 1/4"	6" MTL STUDS W/ 1" GAP	

TYPE 'H' - PARTIAL HEIGHT STEEL STUD PARTITION

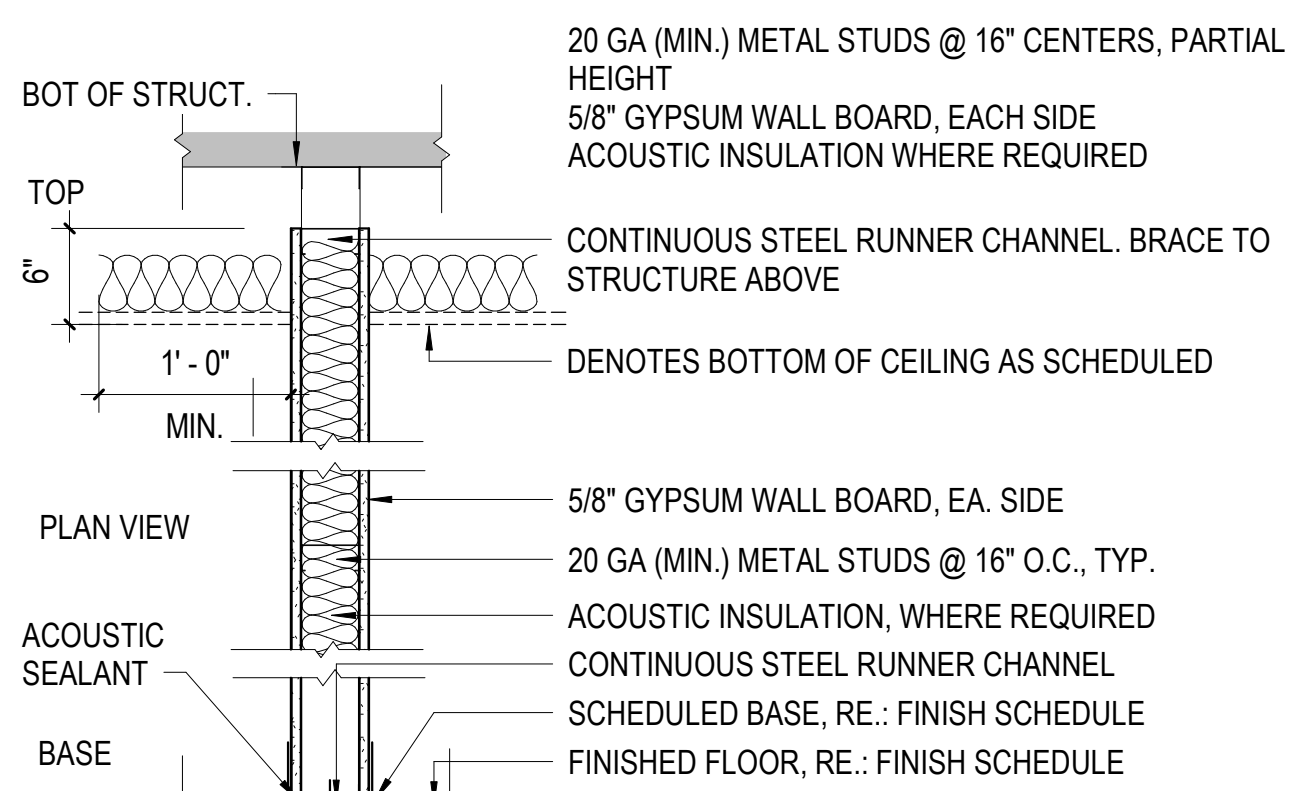


MARK	WIDTH	DESCRIPTION	SUFFIX
H2	3 1/4"	2-1/2" MTL STUDS	a - SOUND g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
H3	4 7/8"	3-5/8" MTL STUDS	
H6	7 1/4"	6" MTL STUDS	
H8	9 1/4"	8" MTL STUDS	

TYPE 'SH' - FIRE RATED SHAFT (CHASE) WALL

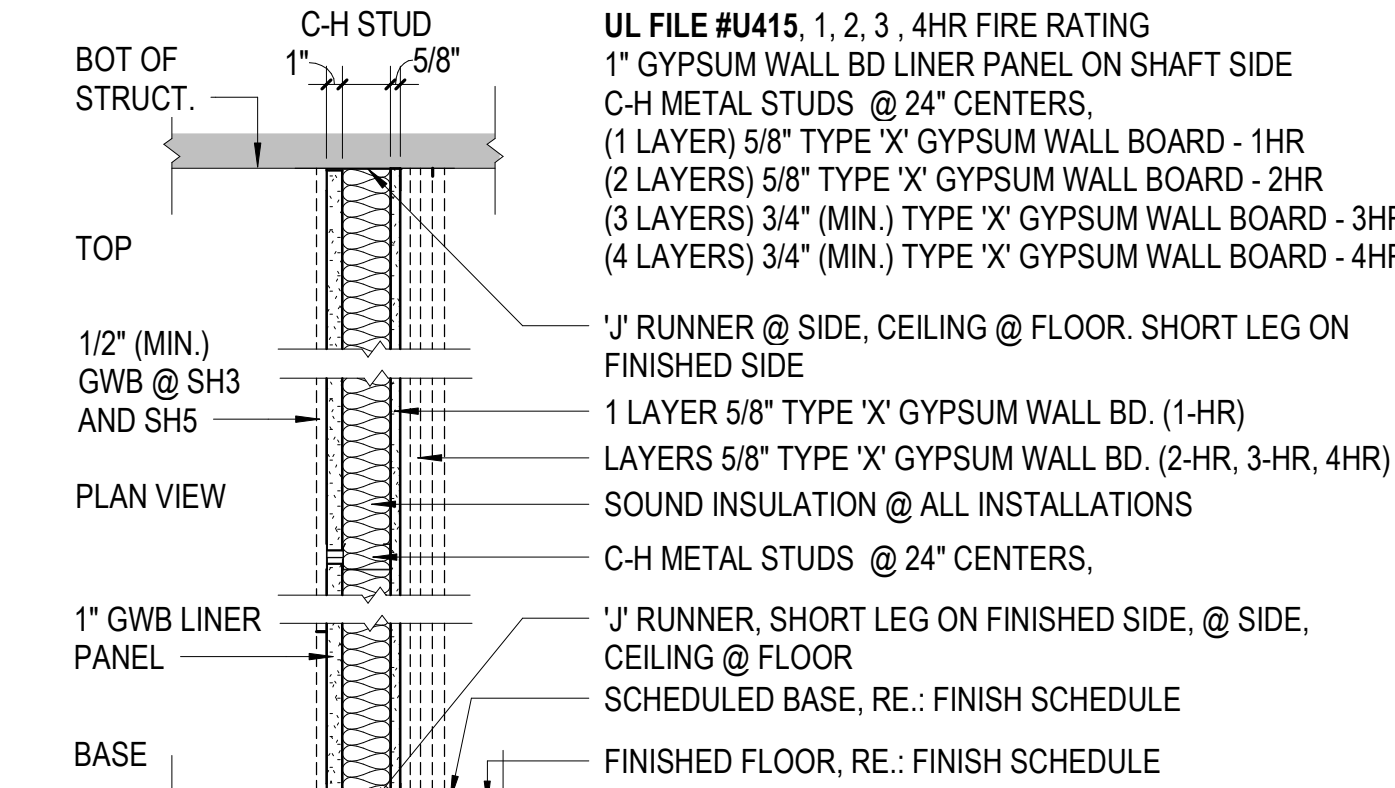


MARK	WIDTH	DESCRIPTION	SUFFIX
SH2/	2 1/2"	MTL C-H STUDS, TYPE 'X' GWB FINISHED SIDE	g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
SH4/	4"	MTL C-H STUDS, TYPE 'X' GWB FINISHED SIDE	
SH3/	2 1/2"	MTL C-H STUDS, TYPE 'X' GWB EA. SIDE	
SH5/	4"	MTL C-H STUDS, TYPE 'X' GWB EA. SIDE	
SH6/	6"	MTL C-H STUDS, TYPE 'X' GWB EA. FINISHED SIDE	

TYPE 'C' - PLUMBING CHASE

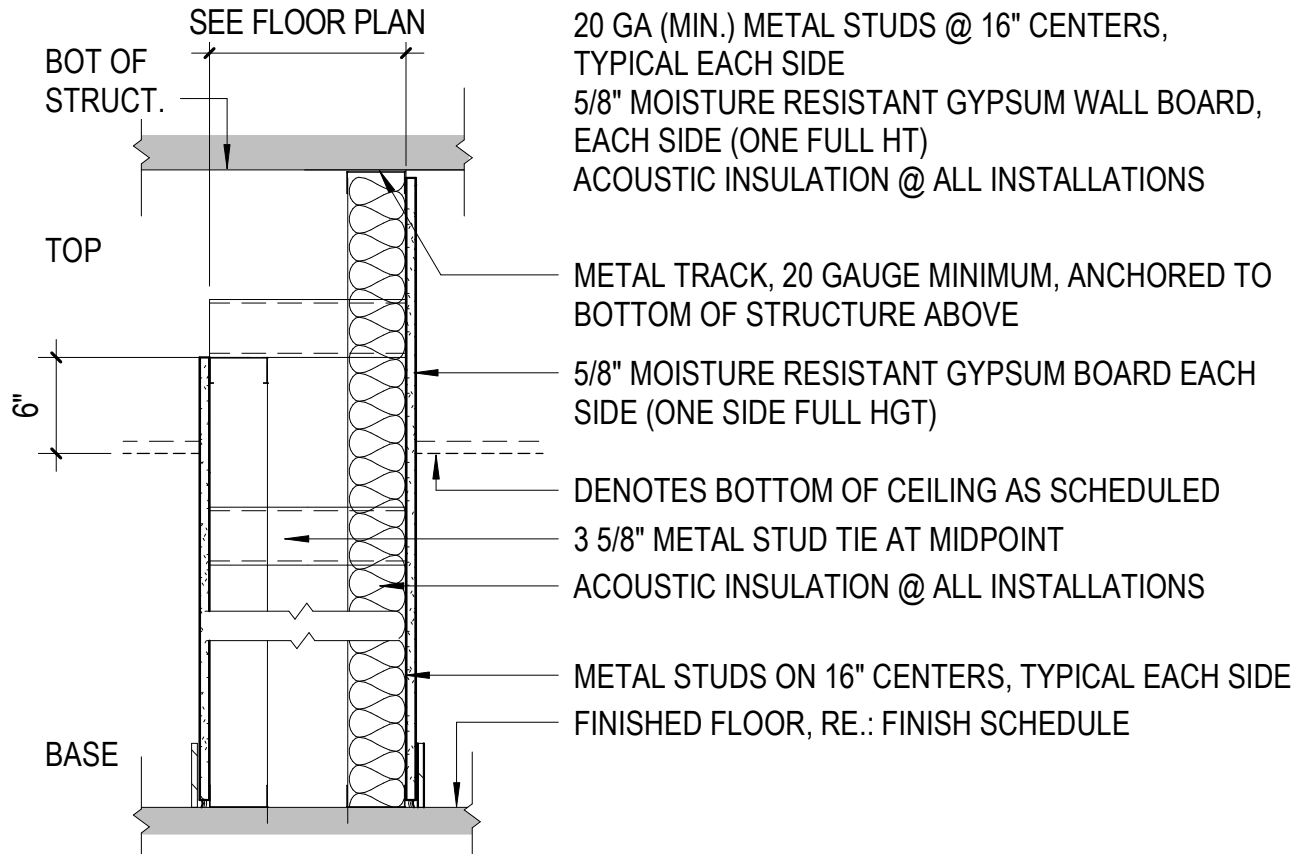


MARK	WIDTH	DESCRIPTION	SUFFIX
C3	3 5/8"	MTL STUDS	g - GLASS-MATT l - LEAD LINED
C4	4"	MTL STUDS	
C6	6"	MTL STUDS	
C8	8"	MTL STUDS	

TYPE 'MF' - FIRE-RATED CONCRETE MASONRY

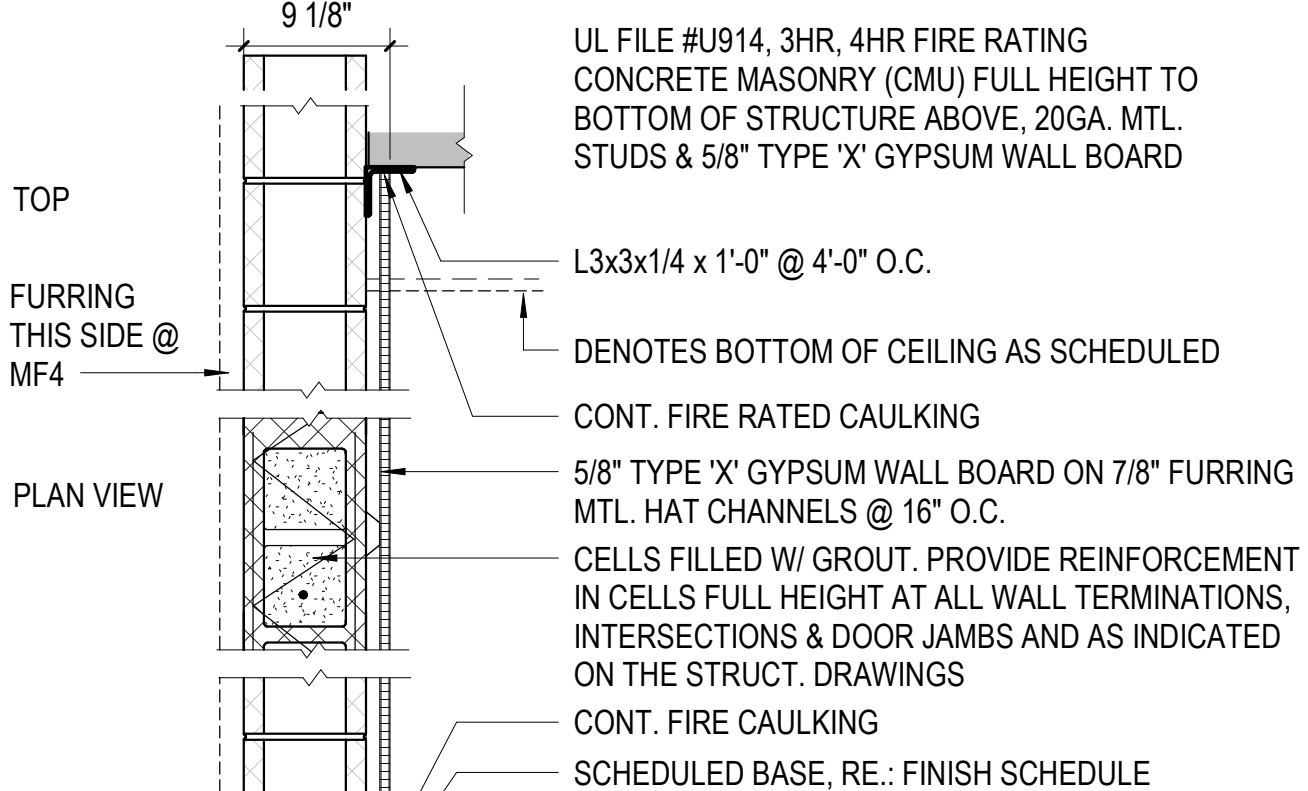

MARK	WIDTH	DESCRIPTION	SUFFIX
MF3	9 1/8"	3HR RATED, FURRING ONE SIDE ONLY	
MF4	10 1/2"	4HR RATED, FURRING EA. SIDE, UL FILE #U910	

TYPE 'U' - FIRE RATED STEEL STUD PARTITION

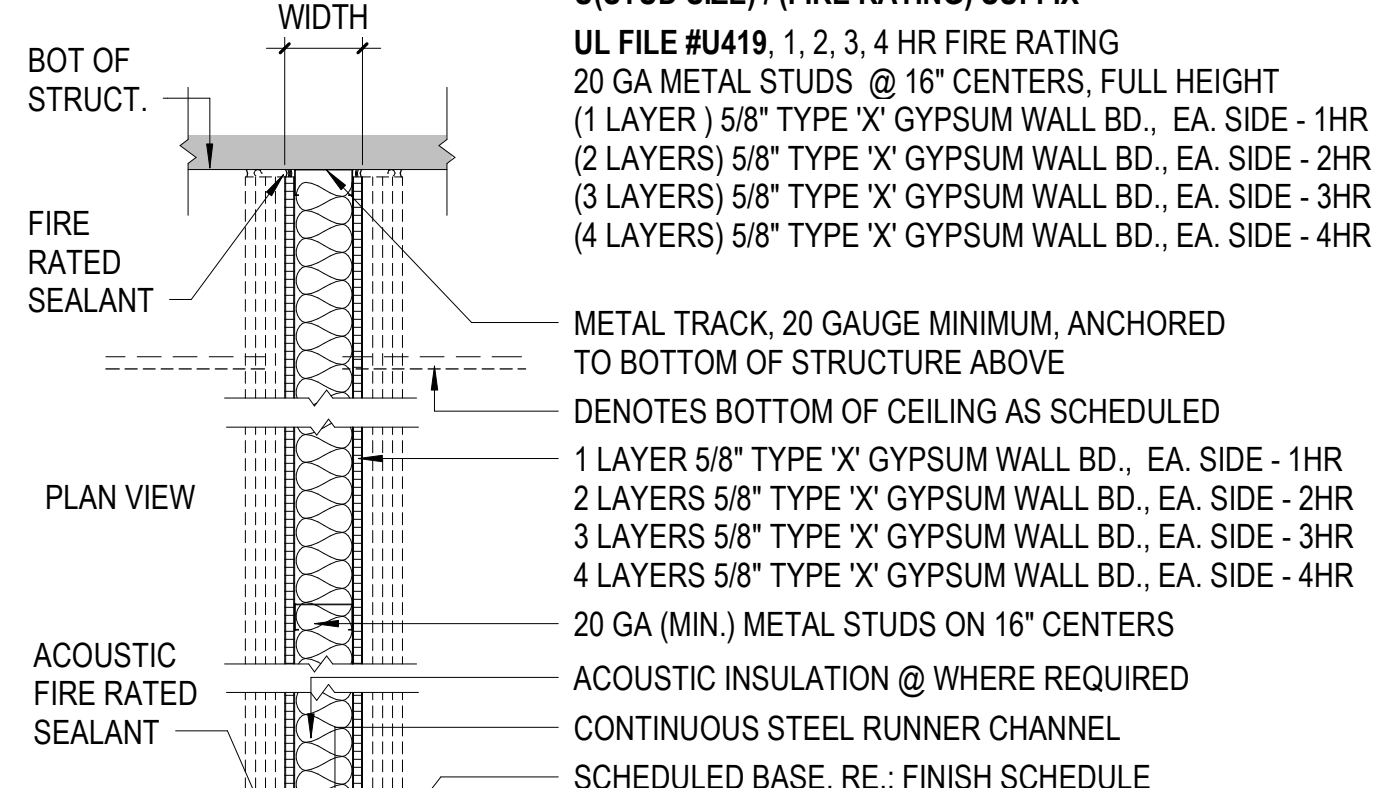

MARK	WIDTH	DESCRIPTION	SUFFIX
U1/	1 5/8"	MTL STUDS - U1/1, U1/2, U1/3, U1/4	a - SOUND g - GLASS-MATT l - LEAD LINED w - WATER-RESISTANT
U2/	2 1/2"	MTL STUDS - U2/1, U2/2, U2/3, U2/4	
U3/	3 5/8"	MTL STUDS - U3/1, U3/2, U3/3, U3/4	
U6/	6"	MTL STUDS - U4/1, U4/2, U4/3, U4/4	
U8/	8"	MTL STUDS	

GENERAL MTL. STUD REQUIREMENTS:

REQUIREMENTS FOR GAUGES OF METAL STUDS EVEN WHEN STUD GAUGES ARE NOTED, THESE GAUGES SHALL BE CONSIDERED MINIMUM. THE CONTRACTOR SHALL PROVIDE AND INSTALL STUDS OF GAUGES AND CONFIGURATIONS AS RECOMMENDED BY THE STUD MANUFACTURER (EXCEPT WHERE REQUIREMENTS EXCEEDING THESE REQUIREMENTS ARE LISTED BELOW) TO MEET CONDITIONS INDICATED IN THESE DRAWINGS.

DEPTHS OF STUDS SHALL NOT BE CHANGED FROM THAT INDICATED ON THE DRAWINGS.

BRACING SHALL BE INSTALLED USING MATERIALS AND AT LOCATIONS AS RECOMMENDED BY THE STUD MANUFACTURER TO COMPLY WITH THE INDICATED CONDITIONS, BUT IN NO CASE SHALL THIS BRACING:

1. BE LOCATED SO AS TO INTERFERE WITH ANY OTHER CONSTRUCTION.
2. PROJECT BEYOND THE FINISH PLANES OF THE SPECIFIC CONSTRUCTION.

GAUGES OF EXTERIOR STUDS SHALL PROVIDE ASSEMBLIES WHICH DO NOT EXCEED THE FOLLOWING DEFLECTION CRITERIA:

1. BRICK OR CMU VENEER: L/600
2. EIFS: L/360

GAUGES OF INTERIOR STUDS SHALL PROVIDE ASSEMBLIES THAT DO NOT EXCEED THE DEFLECTION CRITERIA OF L/240.

GENERAL PARTITION NOTES:

1. FOR EXTERIOR WALLS SEE BUILDING AND WALL SECTIONS FOR CONSTRUCTION REQUIREMENTS.
2. PARTITIONS SCHEDULED TO RECEIVE STONE VENEER ARE TO HAVE 16 GA. MIN. STUDS.
3. ROOF DECK DEFLECTION: ALL PARTITIONS TERMINATING AT ROOF DECKS SHALL NOT BE ATTACHED TO ROOF DECKING AND SHOULD ACCOMMODATE 1/2" MINIMUM MOVEMENTS OF ROOF SYSTEM. SEE PARTITION DETAIL SHEET FOR TYPE OF JOINTS.
4. PROVIDE MINIMUM TWO STUDS AT ALL DOOR AND WINDOW JAMBS FULL HEIGHT OF WALL AT ALL INTERIOR STUD PARTITIONS. REFER TO TYP. DETAILS ON THIS SHEET.
5. TYPICAL IN PARTITION CAVITIES AT ALL WALL MOUNTED MILLWORK, CASEWORK, EQUIPMENT, GRAB BARS, ACCESSORIES ETC. PROVIDE FIRE RETARDANT WOOD BLOCKING AS REQUIRED TO SUIT THE INSTALLATION OF THE ITEM ANCHORED TO METAL STUDS ON 24 INCH CENTERS MAXIMUM. PROVIDE BLOCKING FULL WIDTH PLUS 12 INCHES PAST EACH END OF CASEWORK OR EQUIPMENT THAT IS TO BE WALL MOUNTED OR ANCHORED TO WALL. PROVIDE ONE STUD AT EACH END OF THE BLOCKING TO SECURE ITEM TO THE PARTITION. COORDINATE EXACT LOCATIONS OF WALL MOUNTED EQUIPMENT WITH OWNER OR EQUIPMENT PROVIDER.
6. PARTITIONS SCHEDULED TO HAVE INSULATION ARE TO HAVE FULL ACOUSTICAL BATTS AND ARE TO BE SEALED WITH ACOUSTICAL SEALANT AT TOP, BOTTOM, AND AT PENETRATIONS. SEE PARTITION SCHEDULE.
7. ALL INSULATION EXPOSED TO HVAC RETURN AIR PLENUMS SHALL COMPLY WITH BUILDING CODE FLAME SPREAD REQUIREMENTS.
8. ALL WALLS REQUIRED TO BE FIRE RATED SHALL HAVE THE APPROPRIATE FIRE RATED GYPSUM BOARD INSTALLED IN ACCORDANCE WITH THE UL RATING CONSTRUCTION OF FIRE RATED WALLS SHALL BE IN STRICT ACCORDANCE WITH UL OR OTHER TEST LAB REQUIREMENTS.
9. FIRE RATED DETAILS AND OTHER WALL RELATED DETAILS SHOWN ON THESE DOCUMENTS FOR THROUGH WALL PENETRATIONS IN FIRE RATED ASSEMBLIES PROVIDE BASIC REQUIREMENTS FOR VARIOUS PENETRATIONS. OBTAIN COMPLETE DETAIL INFORMATION FROM THE PRODUCT MANUFACTURER AND/OR THE LATEST EDITION OF THE UL DIRECTORY.
10. PROVIDE 'MOISTURE RESISTANT' GYPSUM BOARD AT ALL LOCATIONS SUBJECT TO MOISTURE SUCH AS TOILETS, JANITOR CLOSETS, LOCKER ROOMS, ETC. SHOWER AREAS SHALL HAVE GLASS MATT WATER RESISTANT BACKING BOARD IN LIEU OF MOISTURE RESISTANT GYPSUM BOARD.
11. PARTITIONS SCHEDULED TO RECEIVE TILE OR STONE FINISHES ARE TO HAVE CEMENTITIOUS BACKERBOARD IN LIEU OF GYPSUM WALL BOARD.
12. INSTALL GYPSUM WALLBOARD 1/2" MINIMUM ABOVE FINISHED FLOOR.
13. CONTROL JOINTS SHALL BE PROVIDED IN ALL GYPSUM WALL BOARD PARTITIONS AND SHALL NOT EXCEED 30" CENTERS. CEILING JOINTS SHALL ALSO NOT EXCEED 30" CENTERS AND NO MORE THAN 900 SQUARE FEET IN AREA.
14. SEAL AROUND PERIMETER OF ALL FIRE AND SOUND RATED WALLS AND PARTITIONS IN ACCORDANCE WITH ALL FIRE AND STC RATINGS AND AS REQUIRED BY ALL APPLICABLE BUILDING CODES.
15. REFER TO ROOM FINISH SCHEDULE FOR WALL FINISHES.

PARTITION CLASSIFICATIONS & KEYS


NOTES - PARTITION CLASSIFICATION	PARTITION TYPE CLASSIFICATION
A ACOUSTICAL PARTITION	S2@a
C PLUMBING (CHASE) WALL	
F FURRED	PARTITION KEY
M MASONRY	
S STEEL FRAMED	
SH SHAFT (CHASE)	
W WOOD	

WALL TYPES SUFFIX KEY

a	ADD SOUND ATTENUATION BLANKET OR AS OTHERWISE NOTED
f	FIRE RATED
g	SUBSTITUTE GLASS-MATT WATER RESISTANT BACKING BOARD (EACH SIDE) ON MINIMUM 20 GAUGE STEEL STUDS 16" OC
i	LINED WITH LEAD (EACH SIDE)
w	SUBSTITUTE WATER RESISTANT GYPSUM BACKING BOARD (EACH SIDE) ON MINIMUM 20 GAUGE STEEL STUDS AT 16" OC

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

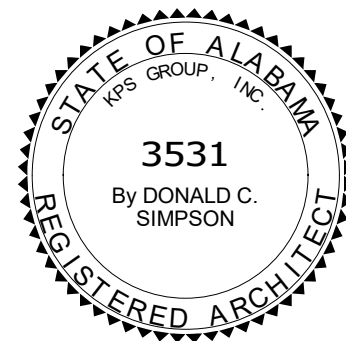


McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: COMMUNICATIONS AND INFORMATION SCIENCES
COLLEGE OF EDUCATION & COLLEGE OF
DEPT. OF COMMUNICATIONS AND INFORMATION SCIENCES
BUILDING 2024B3
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401




PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
INTERIOR PARTITIONS - TYPES, NOTES & DETAILS		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A6.01		


TYPICAL GYPSUM BOARD PARTITION CONTROL JOINT DETAILS

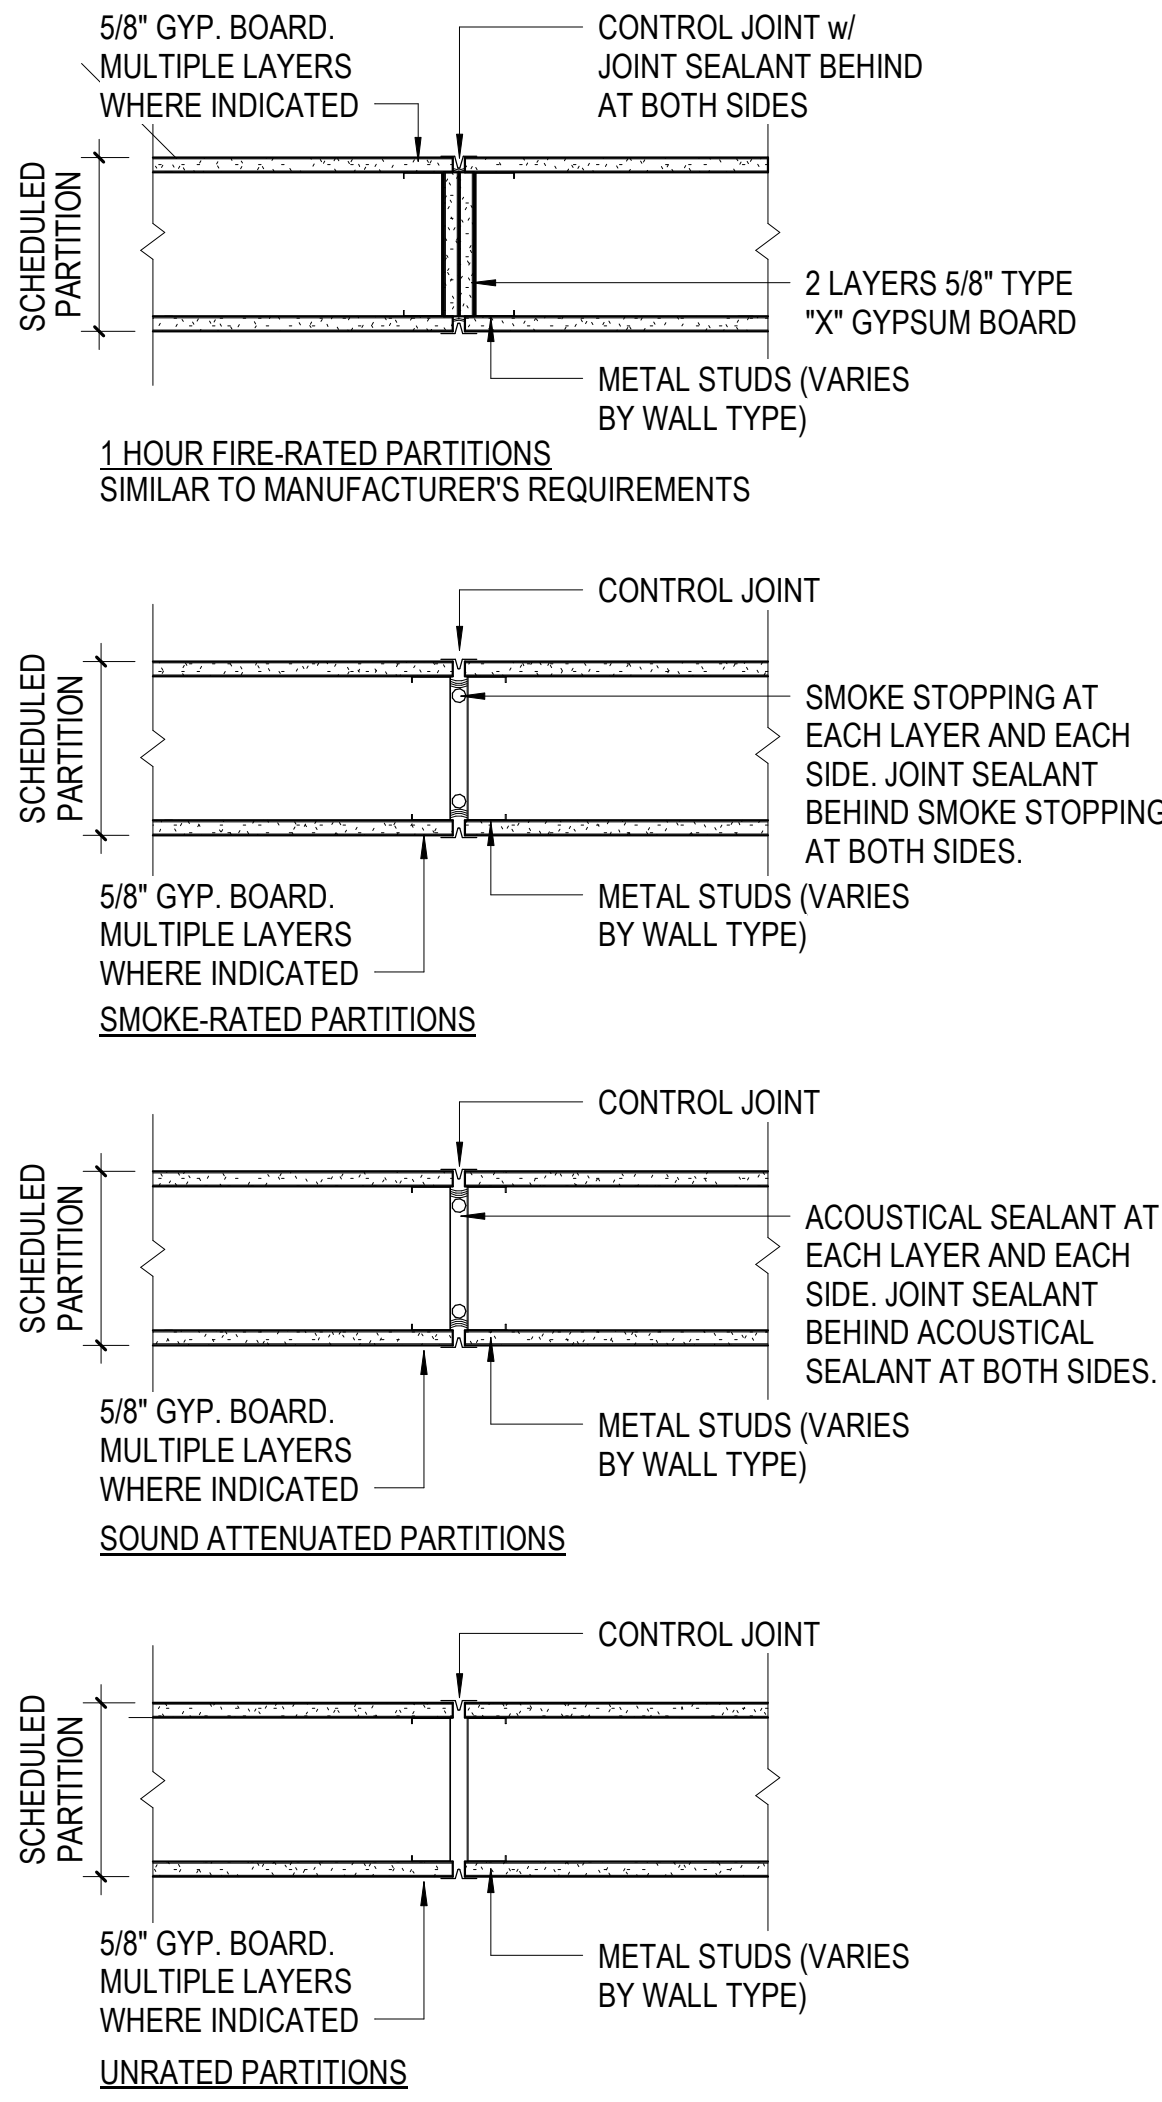


WALL EXPANSION JOINT (NTS)

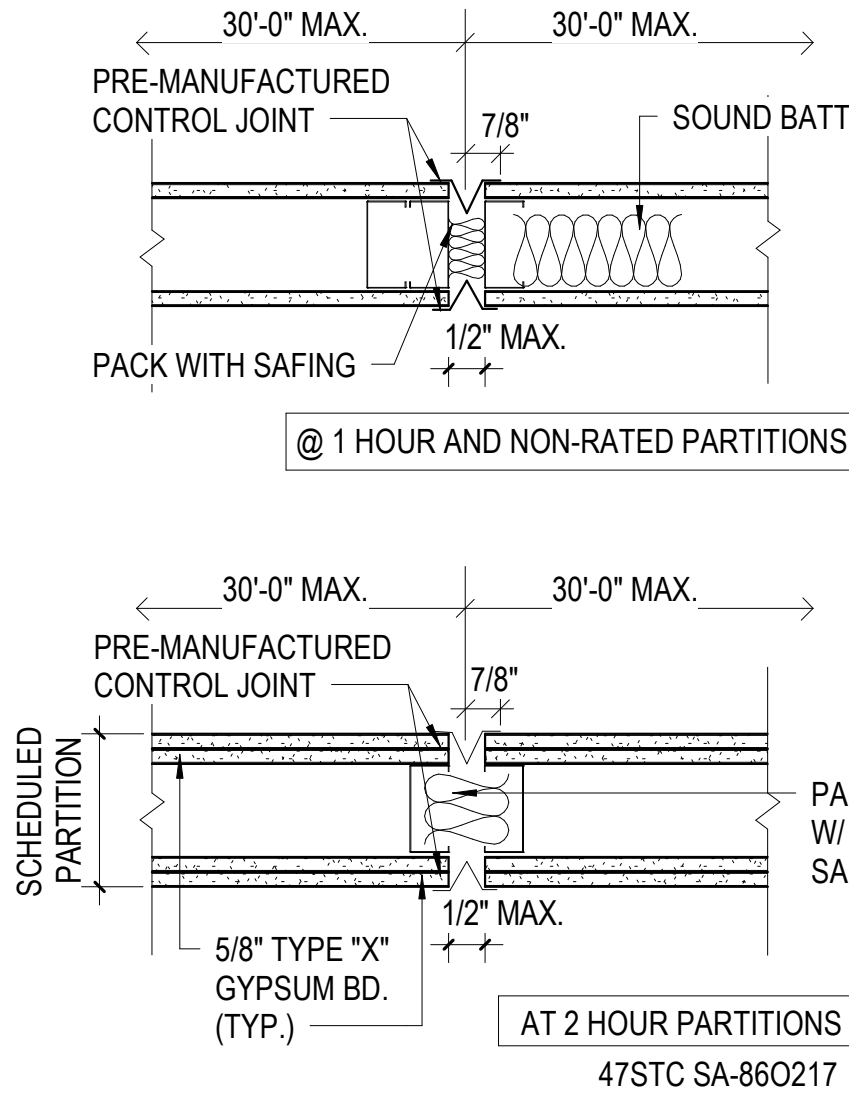


GYPSUM WALL BD. @ DISSIMILAR WALL

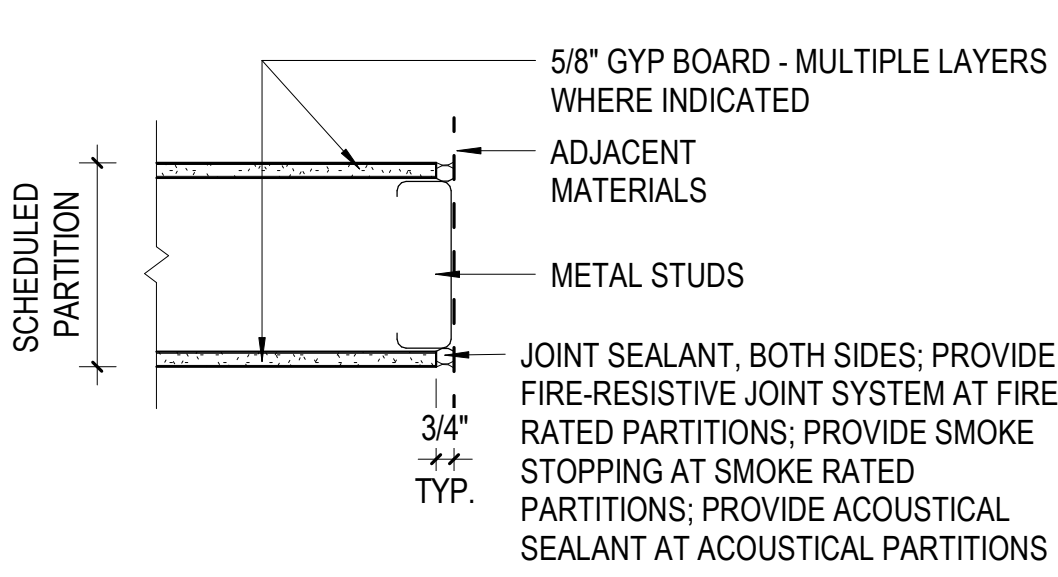

GYPSUM WALL BD. @ GLAZING MULLION

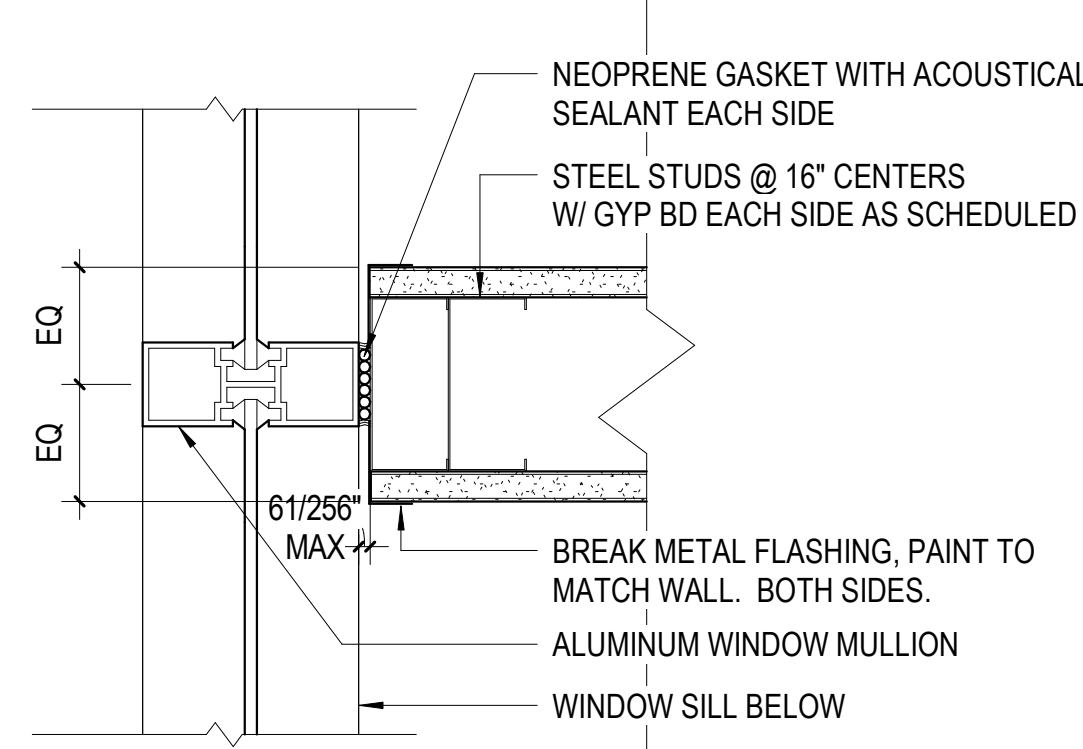


WALL PRIORITY DIAGRAM (NTS)

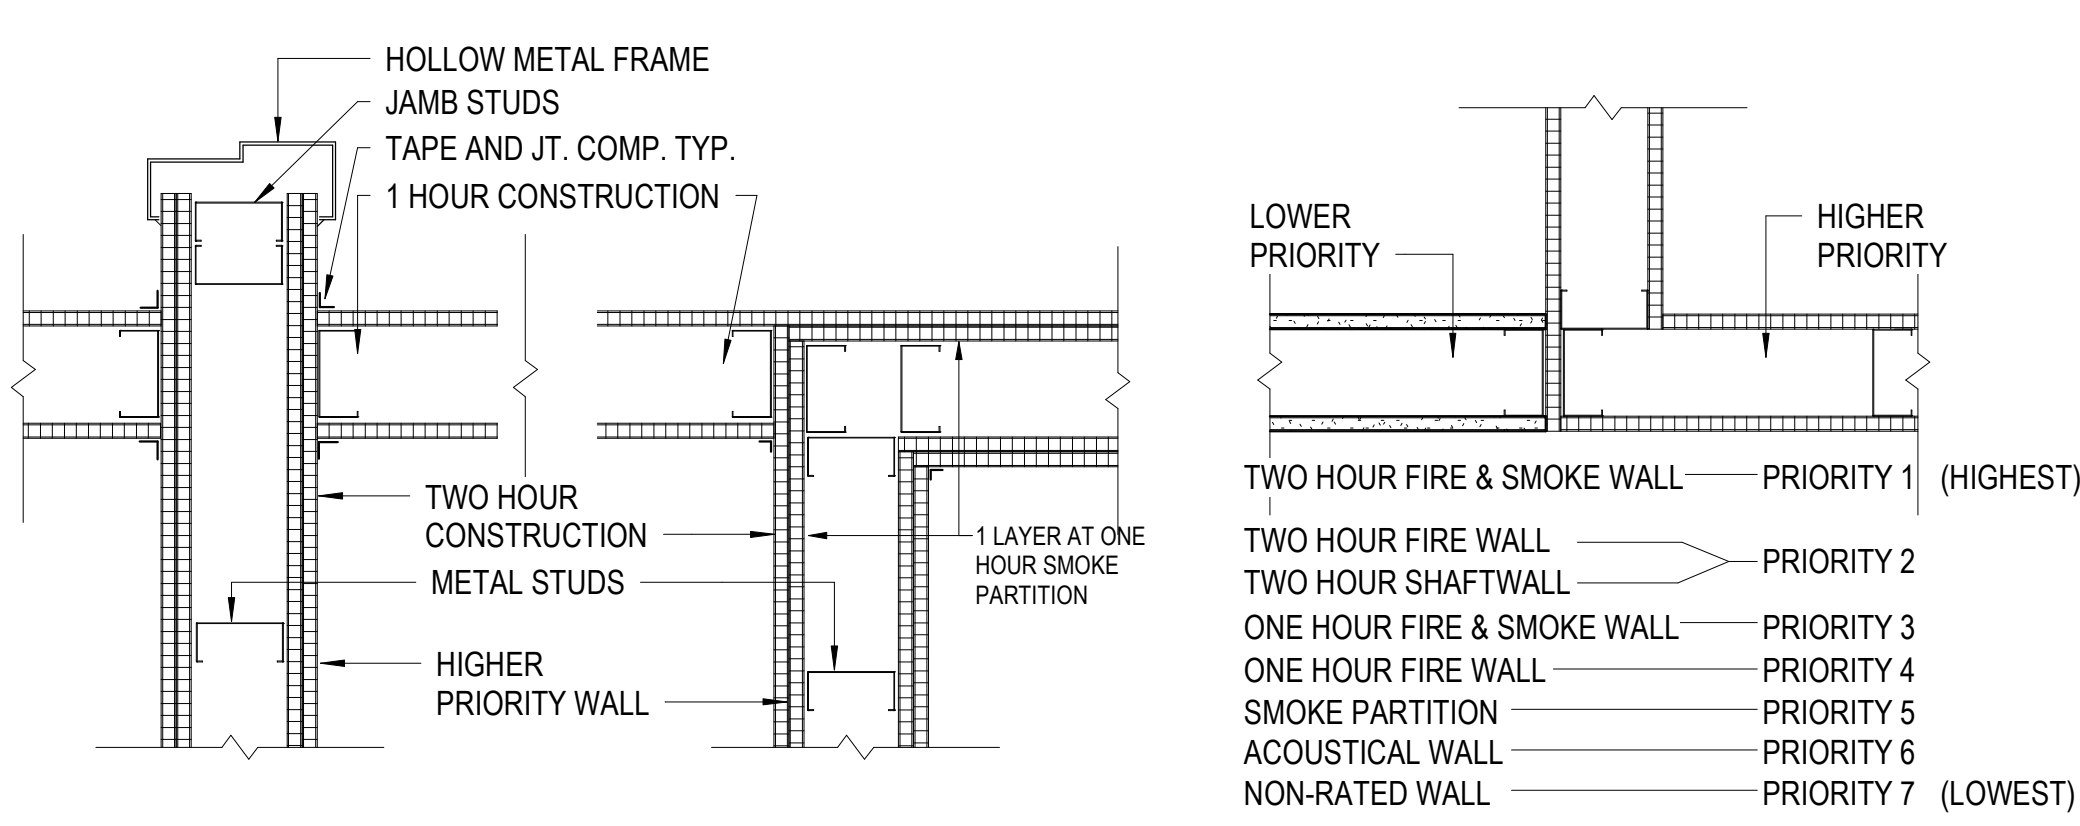


TYPICAL BLOCKING DIAGRAM

- REINFORCING NOTES
1. REINFORCING SHALL BE MIN. 20 GA. 6\"/>


TYPICAL TERMINATION @ RATED PARTITIONS

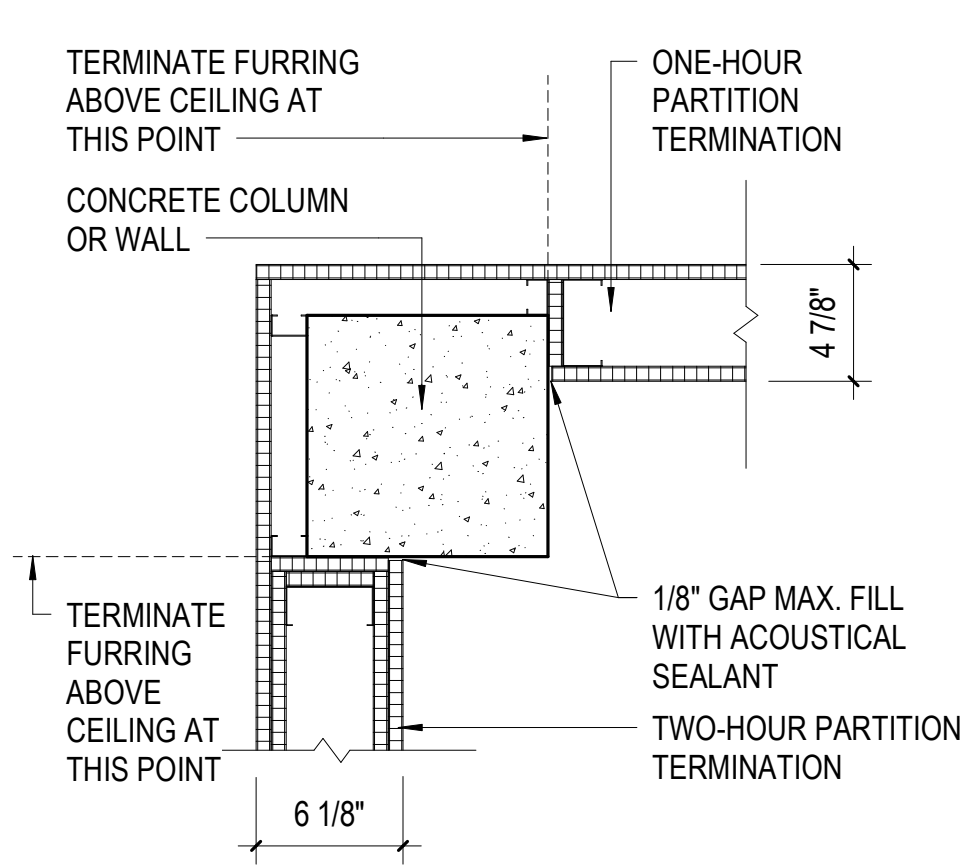

RATED PARTITION AT EXTERIOR WALL

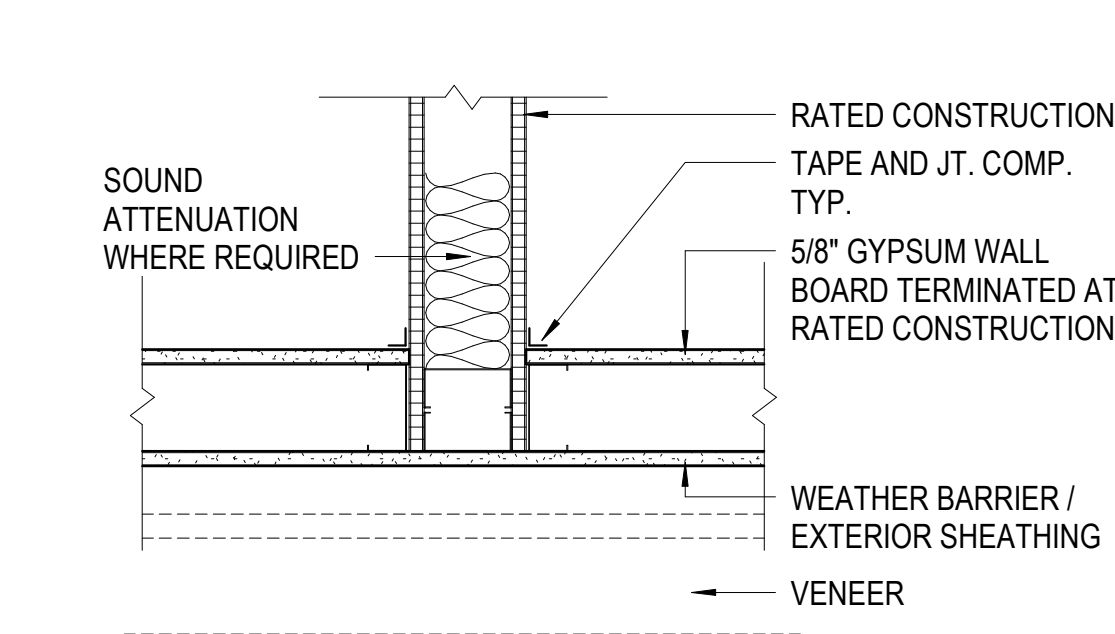


TYPICAL GYP. BOARD @ RECESSED WALL CABINETS / PANELS

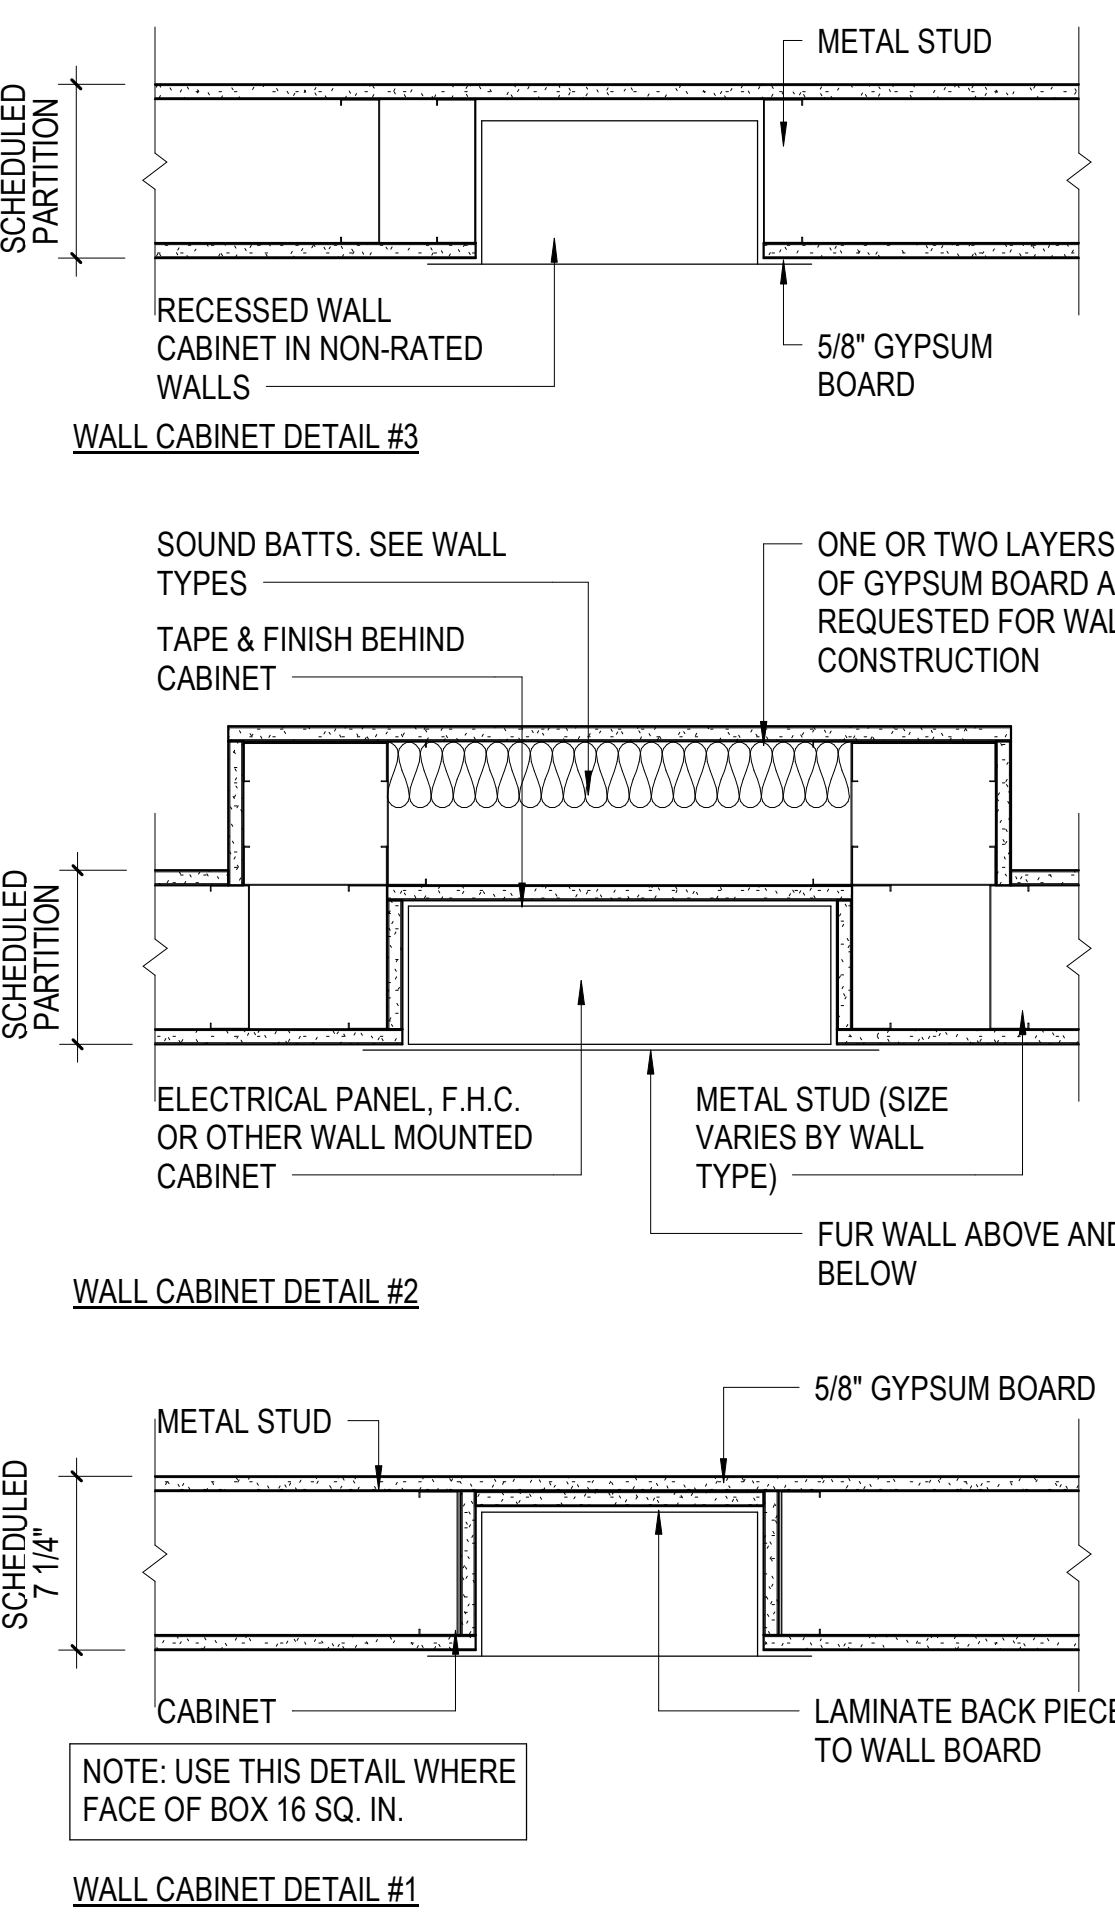


SHEET NOTES:

1. NOT ALL DETAILS ON THIS SHEET ILLUSTRATE CONDITIONS IN THE PROJECT.
2. DO NOT SCALE DRAWINGS. DIMENSIONS ARE NOT ADJUSTABLE WITHOUT ARCHITECT'S APPROVAL, UNLESS NOTED OTHERWISE. REFER TO ARCHITECTURAL DRAFTING CONVENTIONS NOTES ON SHEET A0.01 FOR ADDITIONAL CLARIFICATIONS.
3. IF ANY ITEM OF WORK CANNOT BE LOCATED, DO NOT PROCEED WITH THE WORK BEFORE CLARIFYING WITH ARCHITECT.
4. REFER TO SHEET A0.04 FOR TYPICAL STUD, SHEATHING AND GENERAL PARTITION REQUIREMENTS AND WALL TYPES.


ADJACENT ELECTRICAL BOXES IN RATED WALLS

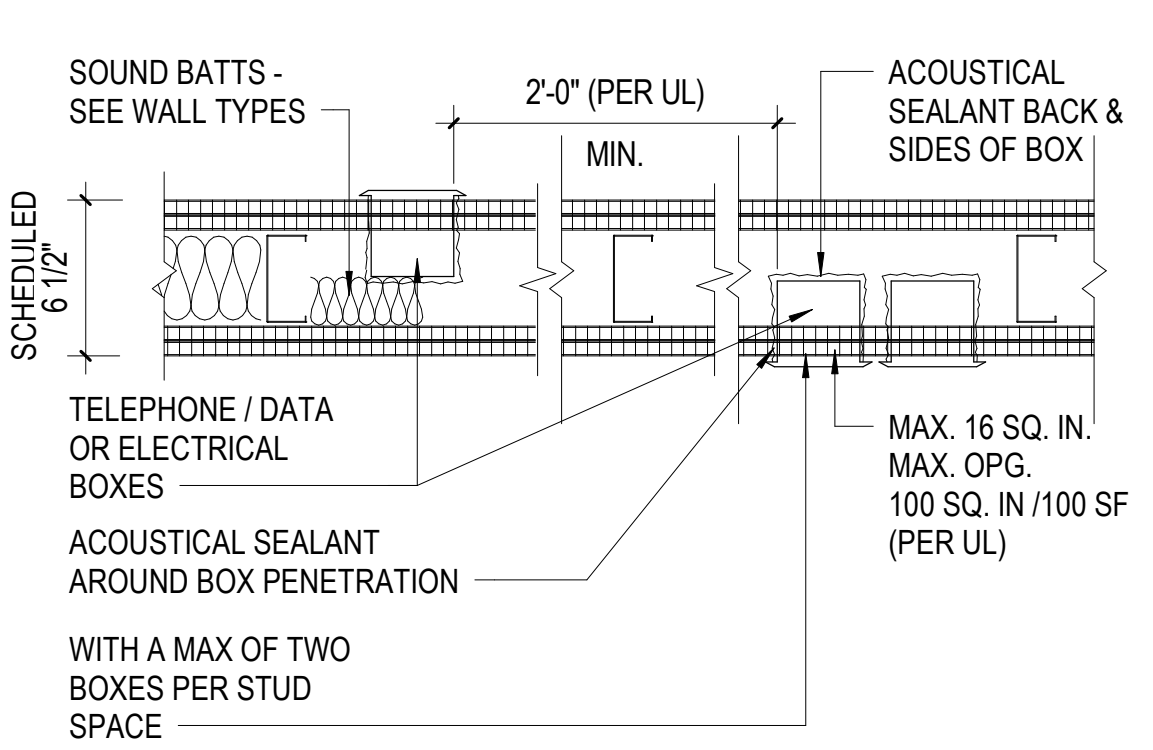


TYPICAL DETAILS @ CORNERS OF INTERIOR CONCRETE MASONRY PARTITIONS

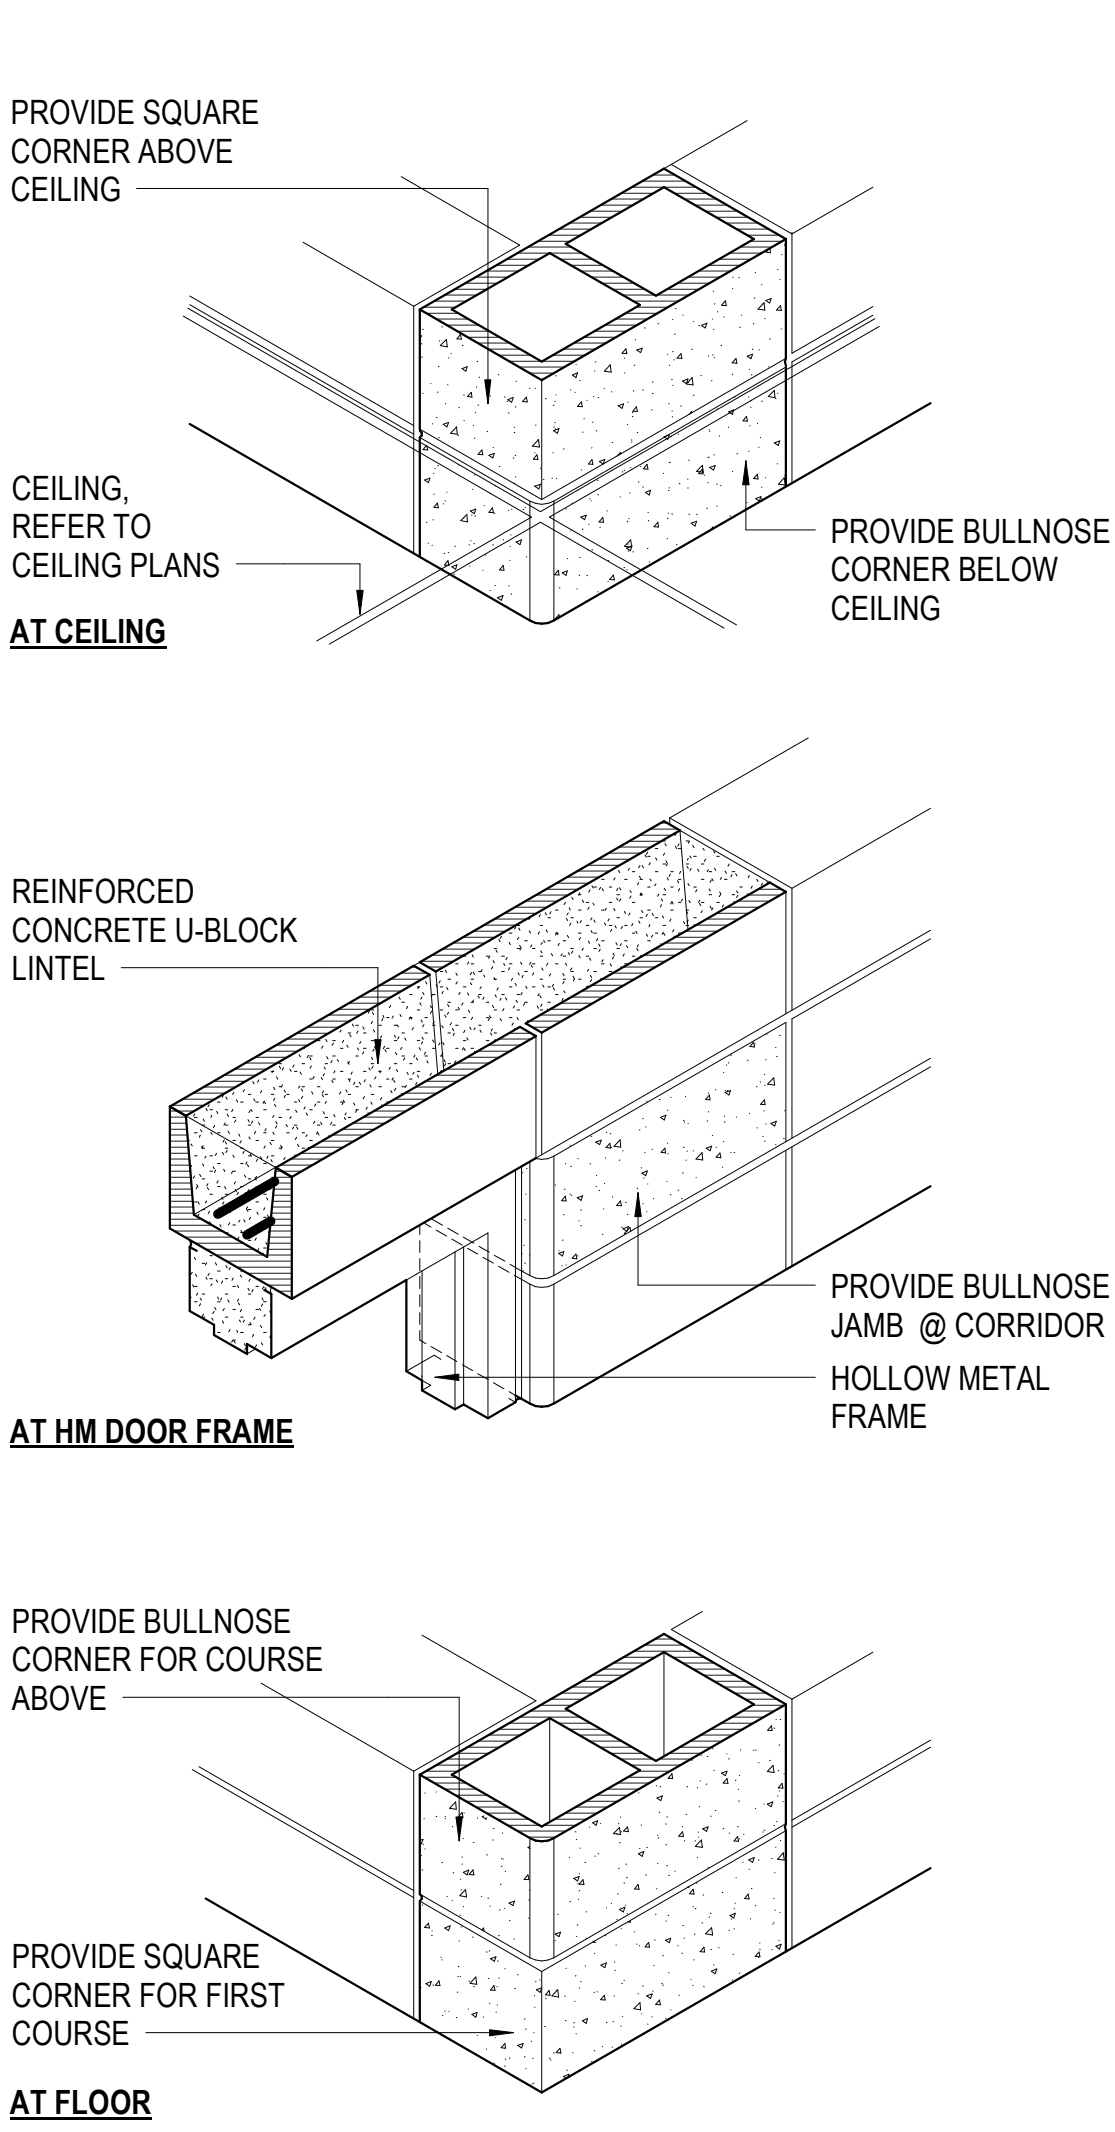


HEAD OF WALL TERMINATION @ COMPOSITE DECK / ROOF, TYPICAL

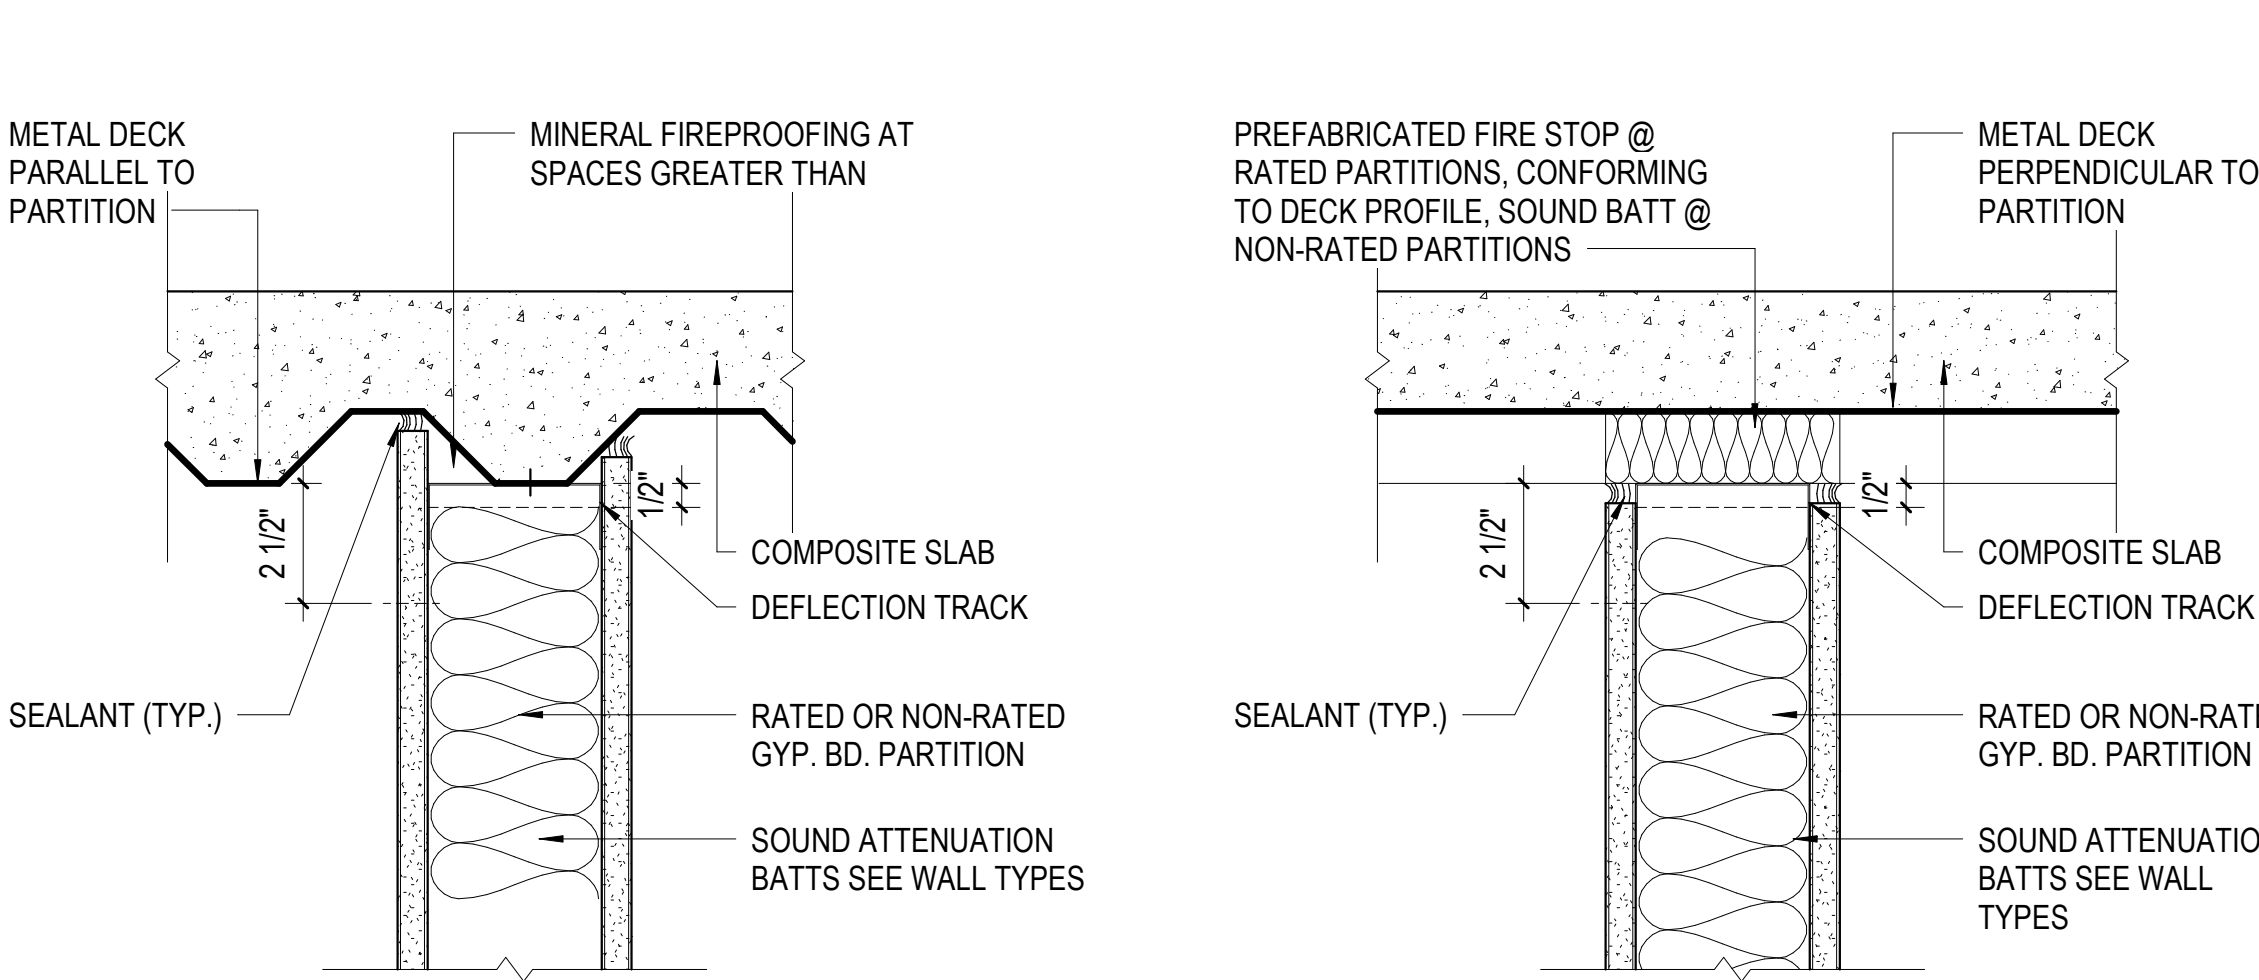



HEAD OF PARTITION @ HORIZONTAL MEMBRANE

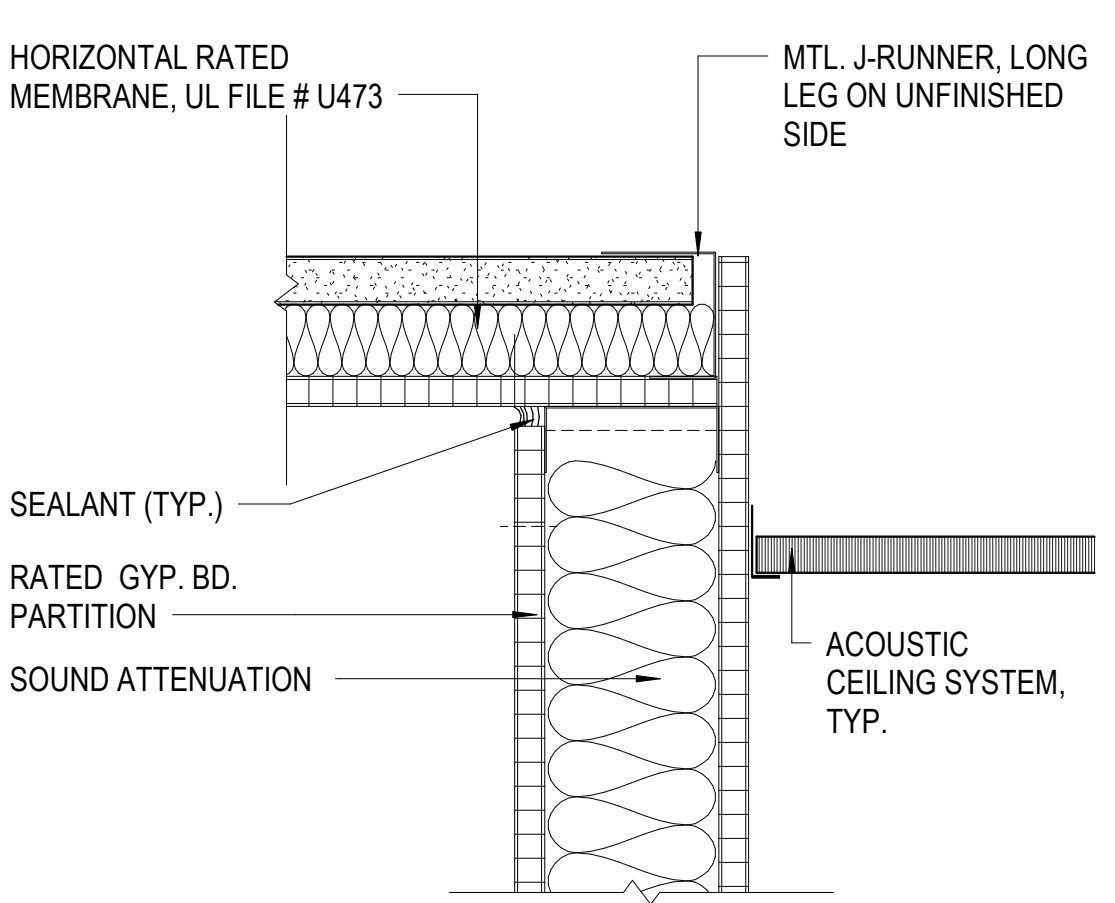


PARTITION BRACING @ HEAD OF INTERIOR STOREFRONT

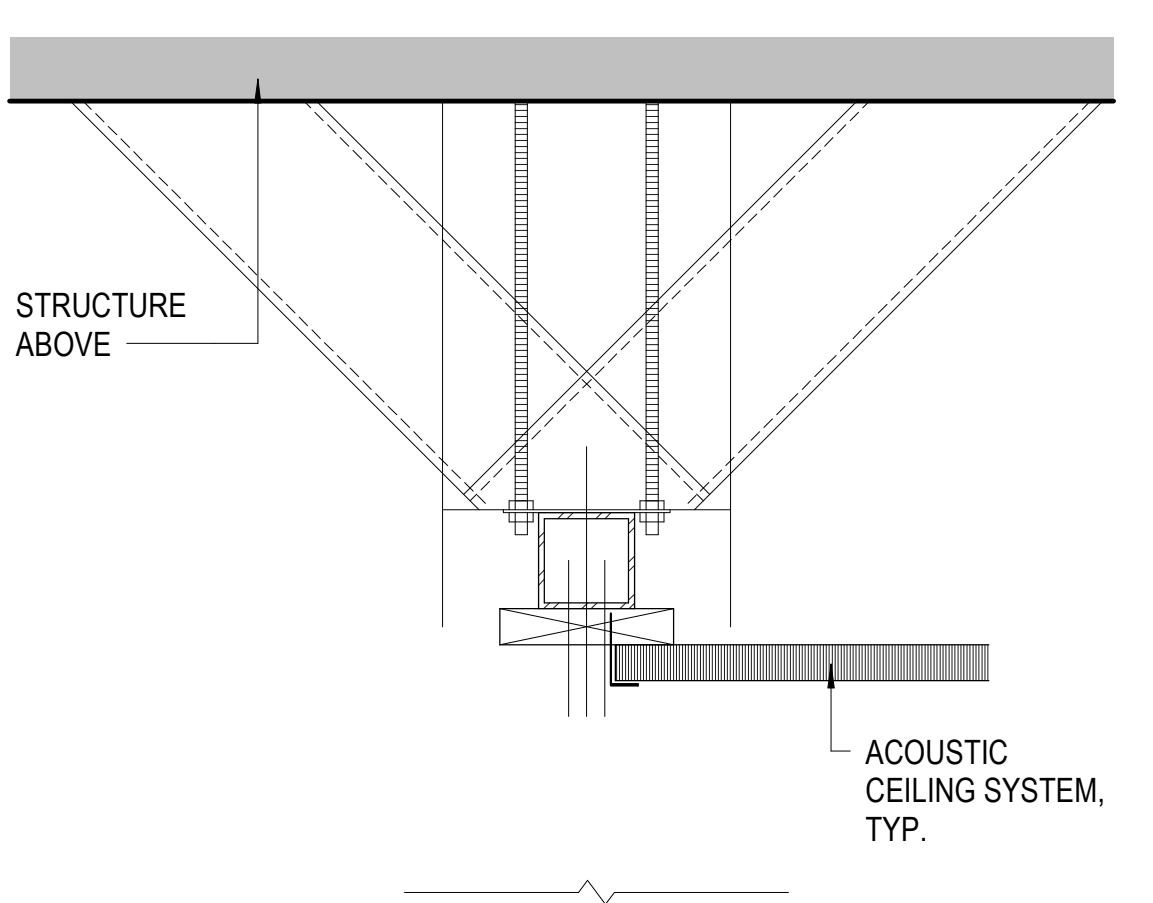

TYPICAL WALL PENETRATION

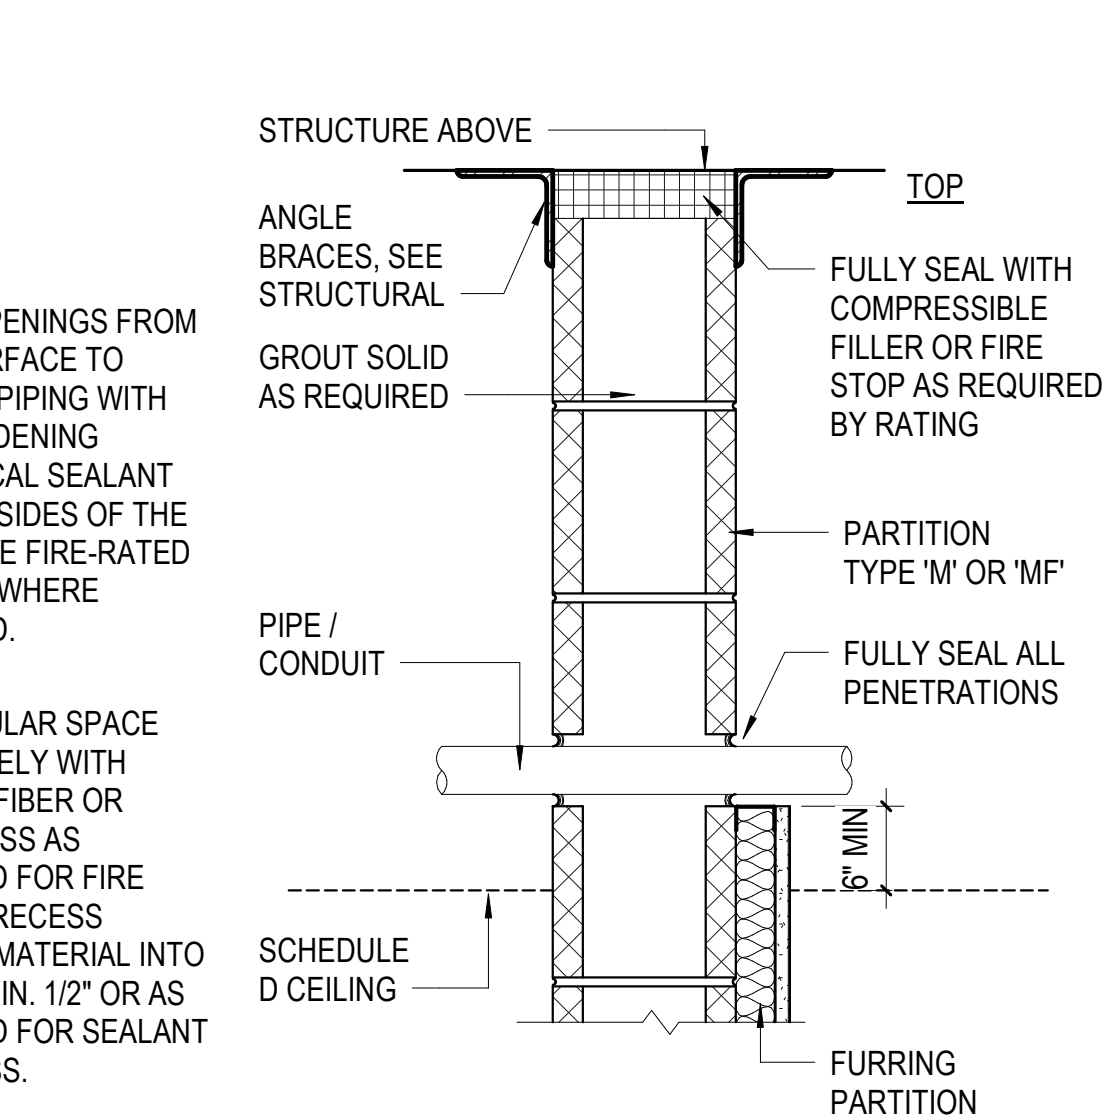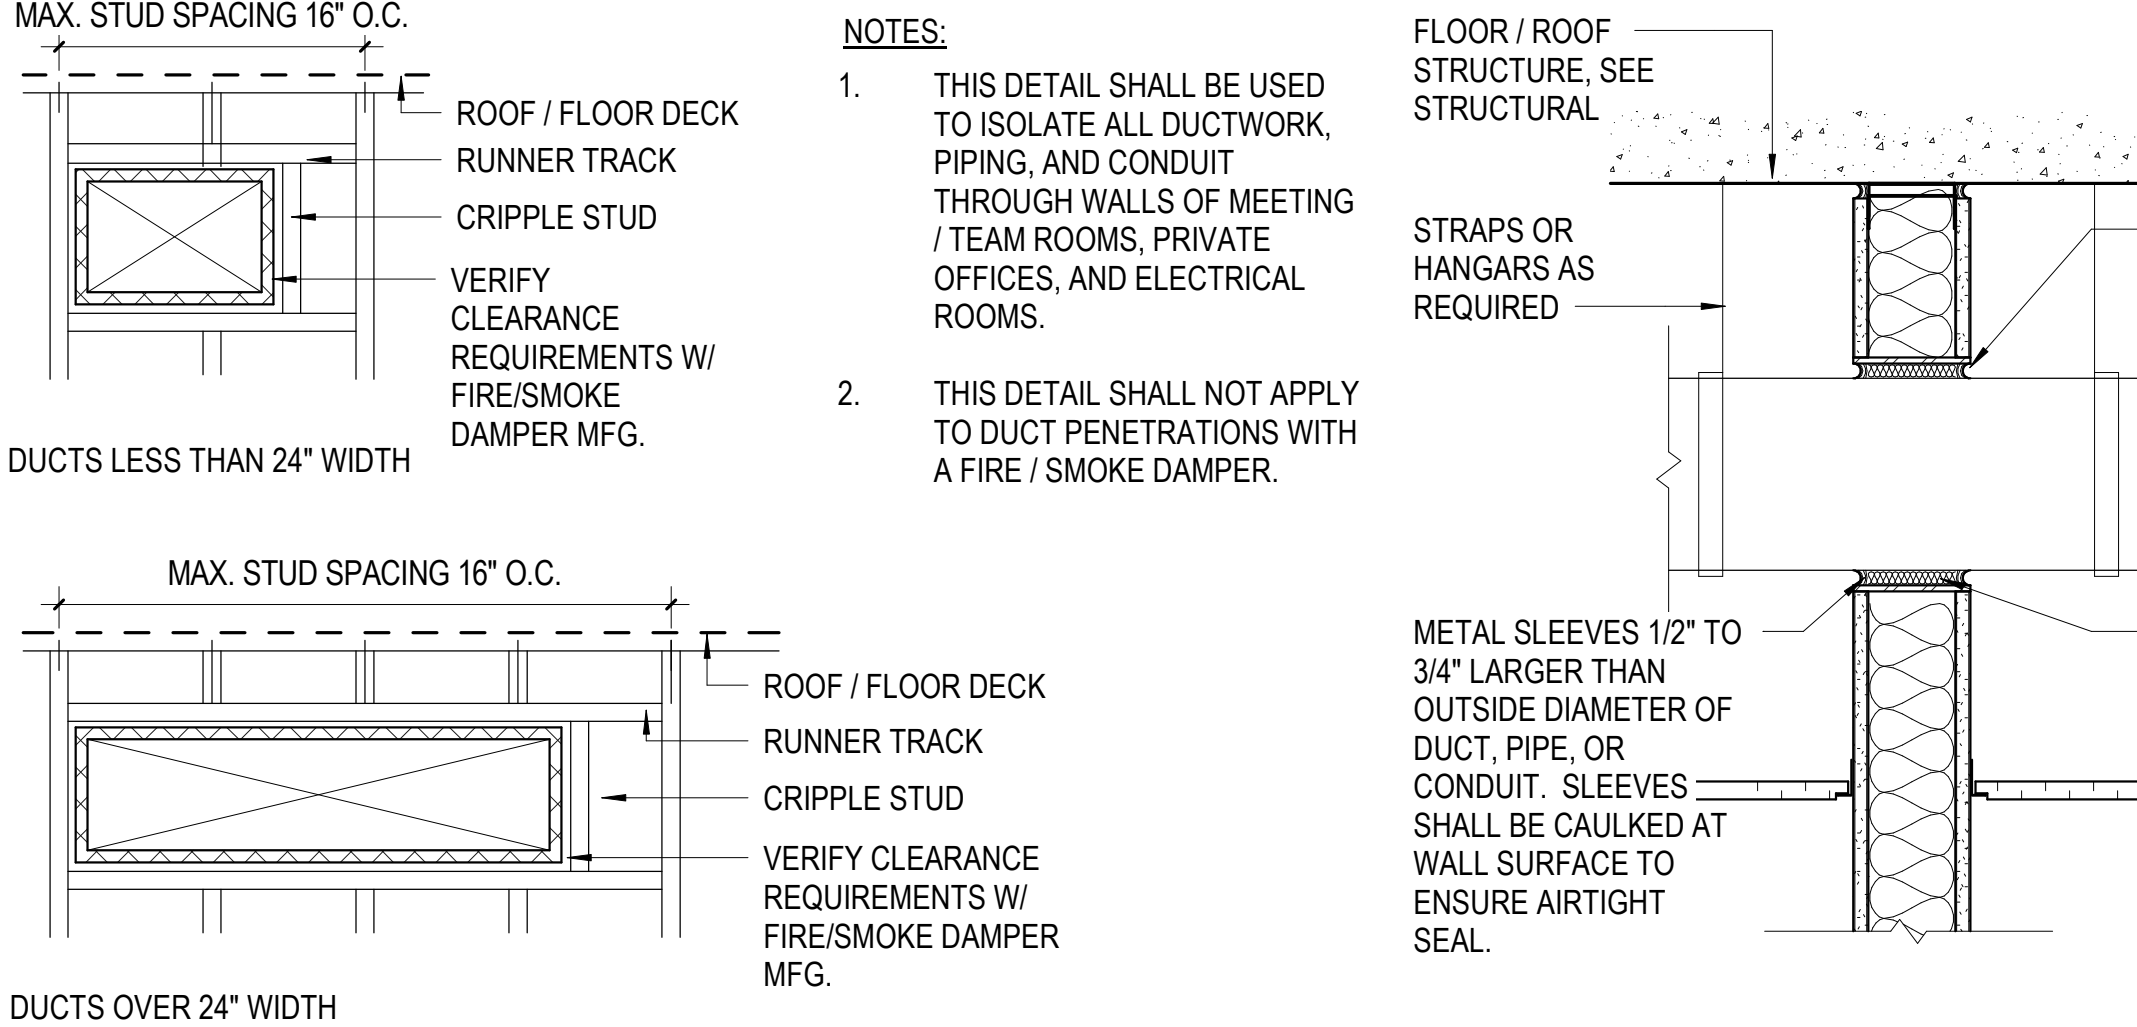

PARTITION BRACING @ DOOR HEAD, TYP.

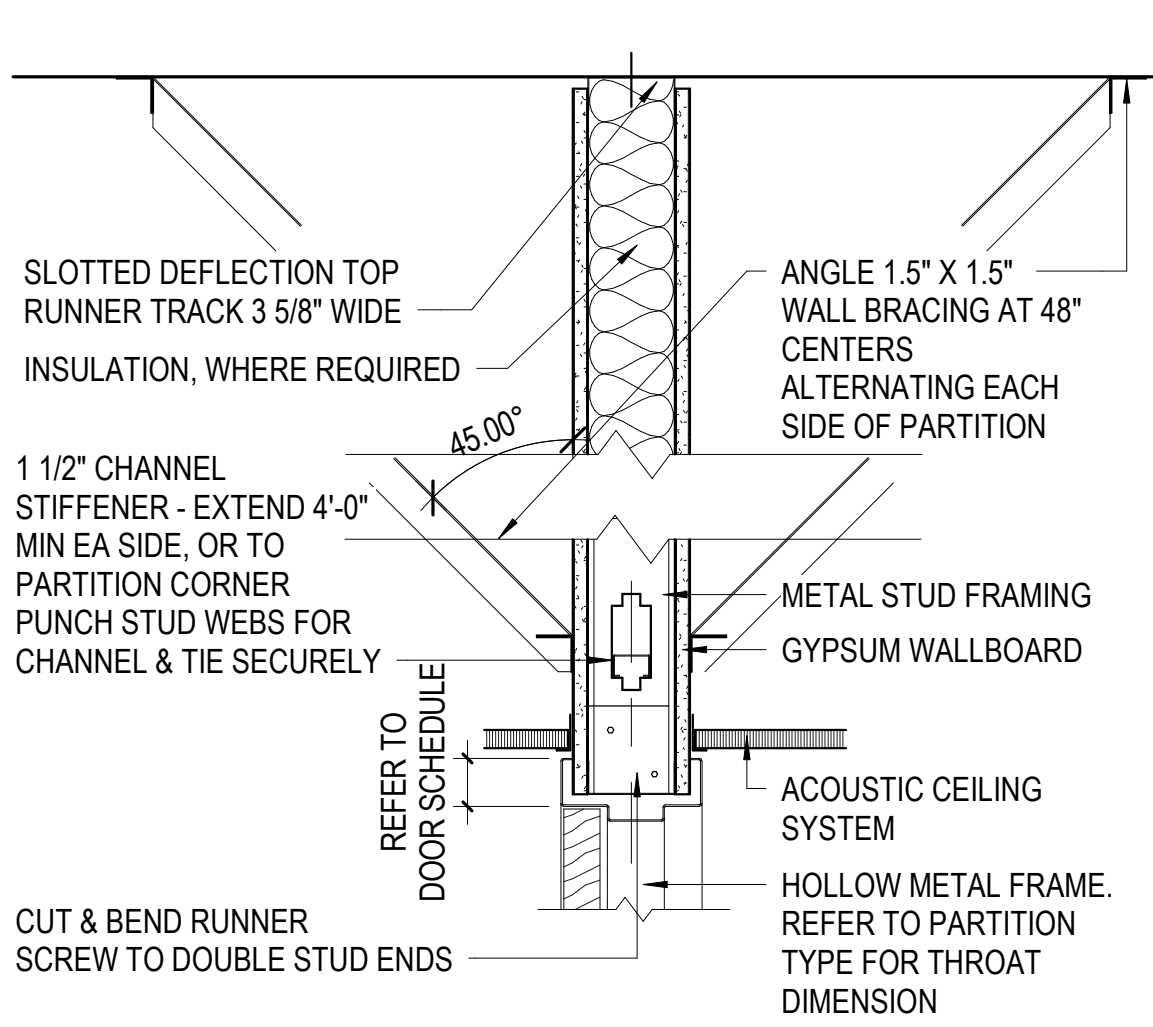

SCHEDULE - DOORS																	
VVVV	@ ROOM	DOOR						FRAME		DETAIL			FIRE RTNG	HW SET#	CARD READER	OPERATOR	COMMENTS
		TYPE	WIDTH	HEIGHT	THK	MTRL	FINISH	TYPE	FINISH	JAMB	HEAD	SILL					
LEVEL 1																	
1001	CORRIDOR	F	3'-6"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11			15.0	Yes	No	
1002	MULTIGENDER RR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	16.0	No	No	3
1003	STORAGE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
1004	CORRIDOR	F	4'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11			15.0	Yes	No	
1005	WOMEN	FL	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	18.0	No	No	
1006	ELEV MACHINE ROOM	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B1 / A6.11	C1 / A6.11		45 MIN	13.0	No	No	4
1007	CUSTODIAL	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	14.0	No	No	3
1008	MEN	FL	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	18.0	No	No	
1009	CORRIDOR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	13.0	Yes	No	
1010.1	PAPER MILL	F	3'-6"	7'-0"	1 3/4"	HM	PT	HM-1	PT	B2 / A6.11	C2 / A6.11		-	15.0	Yes	No	
1010.2	PAPER MILL	F	3'-6"	8'-5"	1 3/4"	HM	P1	HM-1	PT	B1 / A6.21	D1 / A6.21	A1/A6.21	-	5.0	Yes	No	
1011	PAPER MILL	F	3'-6"	7'-0"	1 3/4"	HM	PT	HM-1	PT	B2 / A6.11	C2 / A6.11		-	21.0	No	No	
1012	PAPER MILL	DF	6'-0"	7'-0"	1 3/4"	HM	PT	DHM-1	PT	B2 / A6.11	C2 / A6.11		-	21.0	No	No	
1013	FIRE SPRINKLER RISER	F	3'-0"	8'-5"	1 3/4"	HM	P1	HM-1	PT	B1/A6.21	D1 / A6.21	A1/A6.21	-	7.0	Yes	No	
1014	CORRIDOR	F	3'-6"	7'-0"	1 3/4"	HM	PT	HM-1	PT	B2 / A6.11	C2 / A6.11		-	11.0	No	No	
1015	BINDERY	F	3'-6"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	15.0	Yes	No	
1016	BINDERY STORAGE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
1017.1	MECHANICAL	DF	6'-0"	7'-0"	1 3/4"	HM	PT	DHM-2	PT		D1 / A5.43		-	4.0	No	No	
1017.2	MECHANICAL PUMP ROOM	F	3'-0"	7'-0"	1 3/4"	HM	P1	HM-2	PT	D2 / A6.11			-		No	No	
1018	MECHANICAL PUMP ROOM	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	13.0	No	No	
1019	MATERIALS LAB	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	15.0	No	No	
1020	STORAGE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
1021	OFFICE 1	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
1022	OFFICE 2	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
1023	OFFICE 3	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
1024.1	FLAT FILE & BA STORAGE	F	3'-6"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
1024.2	FLAT FILE & BA STORAGE	AL-1	3'-0"	6'-8"	1 3/4"	AL / GL	PREFIN	AL	PREFIN				-	3.0	No	No	5
1024.3	FLAT FILE & BA STORAGE	F	2'-6"	7'-0"	1 3/4"	HM	PT	HM-1	PT				-	19.0	No	No	
1025	FLAT FILE & BA STORAGE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
1026	CLASSROOM SEMINAR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	22.0	Yes	No	
C101.1	STAIR 1	F	3'-0"	6'-8"	1 3/4"	HM	PT	HM-1	PT	D2 / A6.11			45 MIN	8.0	No	No	EXIT DEVICE
C101.2	STAIR 1	AL-1	3'-0"	6'-8"	1 3/4"	AL / GL	PREFIN	AL	PREFIN	C3 / A6.21	D3 / A6.21	A3 / A6.21	-	3.0	Yes	No	5, EXIT DEVICE
C102.1	STAIR 2	F	3'-0"	7'-0"	1 3/4"	HM	PT	HM-1	PT	B1 / A6.11	C1 / A6.11		45 MIN	8.0	No	No	EXIT DEVICE
C102.2	STAIR 2	AL-1	3'-0"	8'-2"	1 3/4"	AL / GL	PREFIN	AL	PREFIN				-	2.0	Yes	Yes	5, EXIT DEVICE
EX	TUNNEL (NIC)	EX	3'-0"	7'-0"	1 3/4"	HM	PT	HM-1	PT				-	-	No	No	2


DUMPSTER																	
1027		F	3'-0"	7'-0"	1 3/4"	HM	P1	HM-2					-				

LEVEL 2																	
2001	LOBBY / VESTIBULE / EXHIBITION	AL-1	4'-0"	7'-6"	1 3/4"	AL / GL	PREFIN	AL	PREFIN		E1 / A6.21			2.0	Yes	Yes	
2002	LOBBY / VESTIBULE / EXHIBITION	AL-2	6'-0"	7'-10"		AL / GL2(T)	PREFIN	AL	PREFIN	B6 / A6.21	E6 / A6.21			1.0	Yes	No	5
2003	OFFICE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2004	ACADEMIC MAKER SPACE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	22.0	No	No	
2005	COLLEGE OF EDUCATION INSTRUCTIONAL AREA	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	22.0	No	No	
2006	OFFICE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2007	STORAGE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	19.0	No	No	
2008	IMMERSIVE EDUCATION	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	22.0	No	No	
2009	OFFICE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2010	NURSING	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	21.0	No	No	
2011	CUSTODIAL	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	14.0	No	No	3
2012	RR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	16.0	No	No	3
2013	RR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	16.0	No	No	3
2014	CORRIDOR	F	3'-6"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	11.0	No	No	
2015	EBSCO DIGITAL PRESERVATION	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	15.0	Yes	No	
2016	CORRIDOR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	13.0	No	No	
2017	OFFICE 10	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2019	CLASSROOM, STANDARD	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	22.0	Yes	No	
2020	OPEN WORK	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	10.0	Yes	No	
2021	COPY	F	4'-0"	7'-0"	0"	-	-	HM-1	PT	B2 / A6.11	C2 / A6.11		-	25.0	No	No	1
2022	OFFICE 9	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2023	OFFICE 8	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2024	OFFICE 7	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2025	LOBBY / VESTIBULE / EXHIBITION	AL-2	3'-0"	7'-10"		AL / GL2(T)	PREFIN	AL	PREFIN	B6 / A6.21	E6 / A6.21						
2026	RECEPTION	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	23.0	No	No	
2027	OFFICE 6	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2028	SMALL CONFERENCE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	24.0	No	No	
2029	OFFICE 5	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2030	OFFICE 4	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
2031	EXECUTIVE OFFICE	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	20.0	No	No	
C201.1	STAIR 1	AL-1	3'-0"	7'-6"	1 3/4"	AL / GL	PREFIN	AL	PREFIN					6.0	No	No	
C201.2	STAIR 1	F	3'-0"	6'-8"	1 3/4"	HM	PT	HM-1	PT	D2 / A6.11			45 MIN	8.0	No	No	EXIT DEVICE
C202	STAIR 2	F	3'-0"	7'-0"	1 3/4"	HM	PT	HM-1	PT	B1 / A6.11	C1 / A6.11		45 MIN	8.0	No	No	EXIT DEVICE
C205	CORRIDOR	F	3'-0"	7'-0"	1 3/4"	WD	STN	HM-1	PT	B2 / A6.11	C2 / A6.11		-	12.0	No	No	


DOOR COMMENTS

- CASED OPENING, NO DOOR
- EXISTING DOOR TO REMAIN. PAINT DOOR AND FRAME.
- 3/4" UNDERCUT
- 180 DEGREE OPEN
- ALUMINUM STOREFRONT DOOR



DOORTYPES

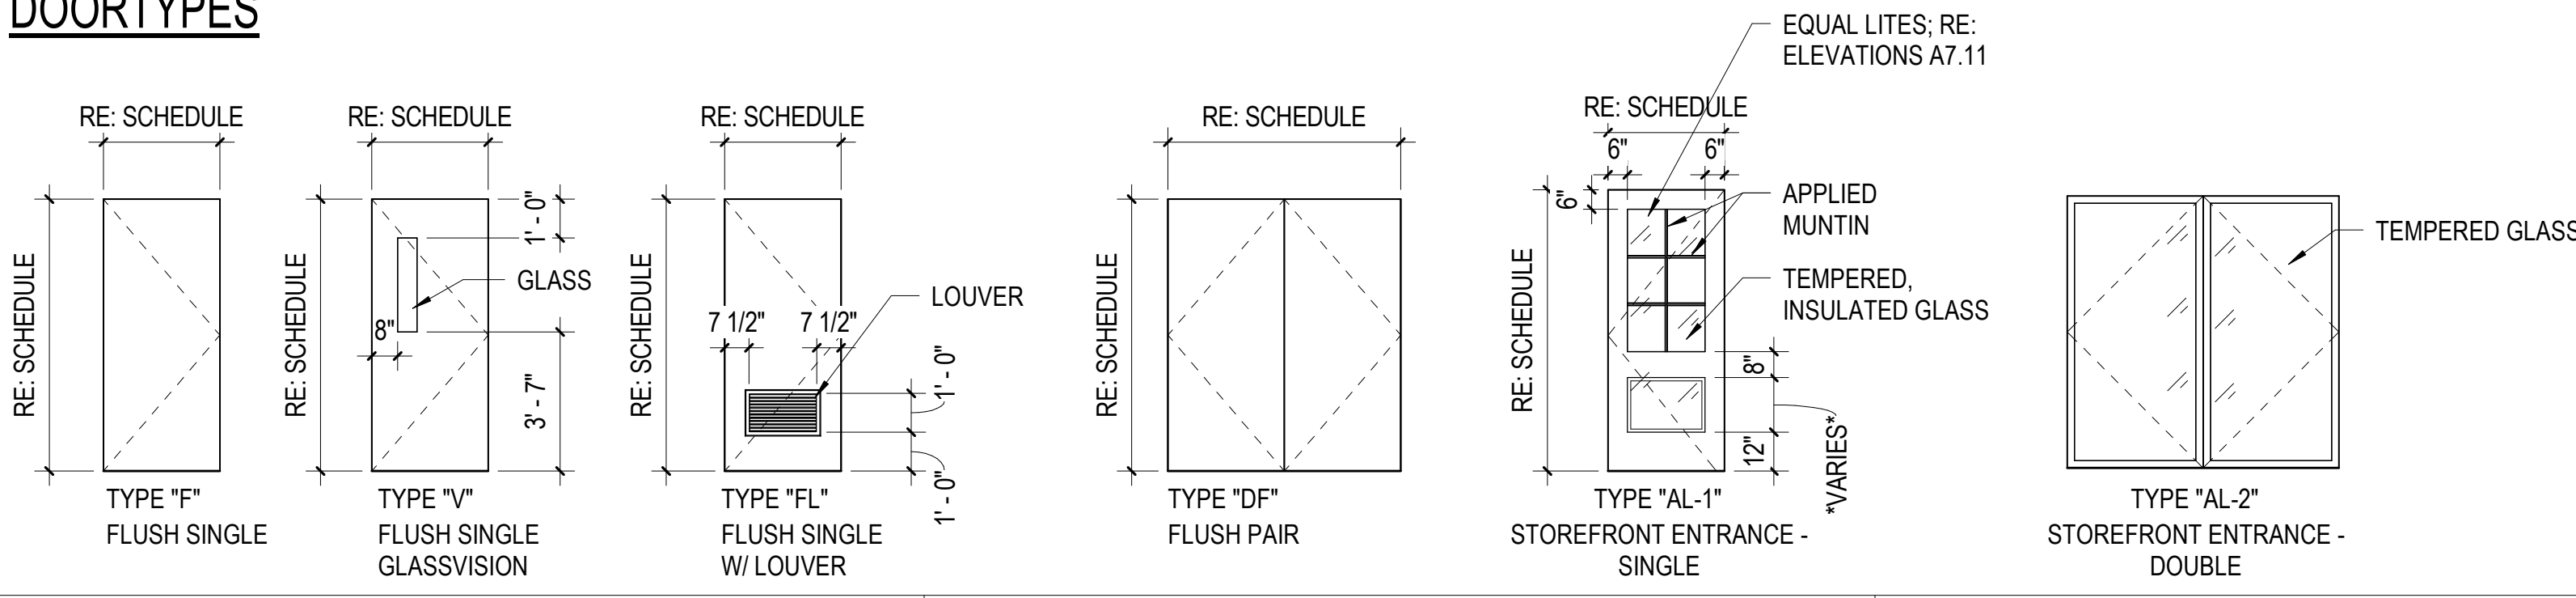


DOOR FRAME TYPES

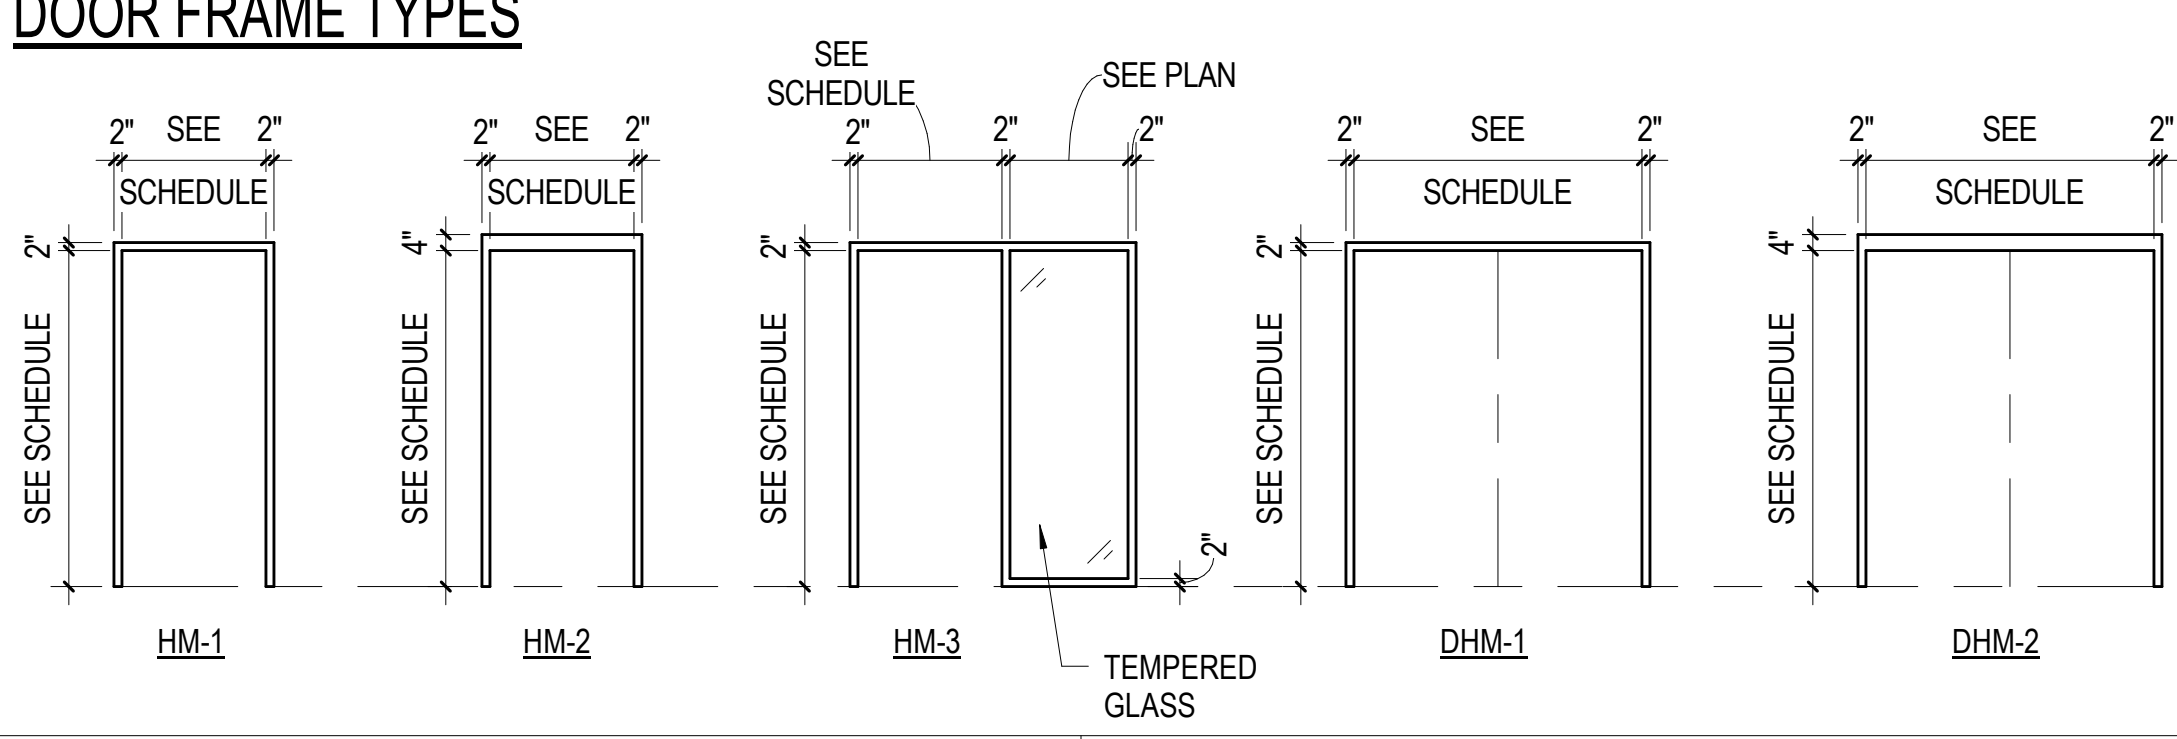


DOOR FRAMING DIAGRAM

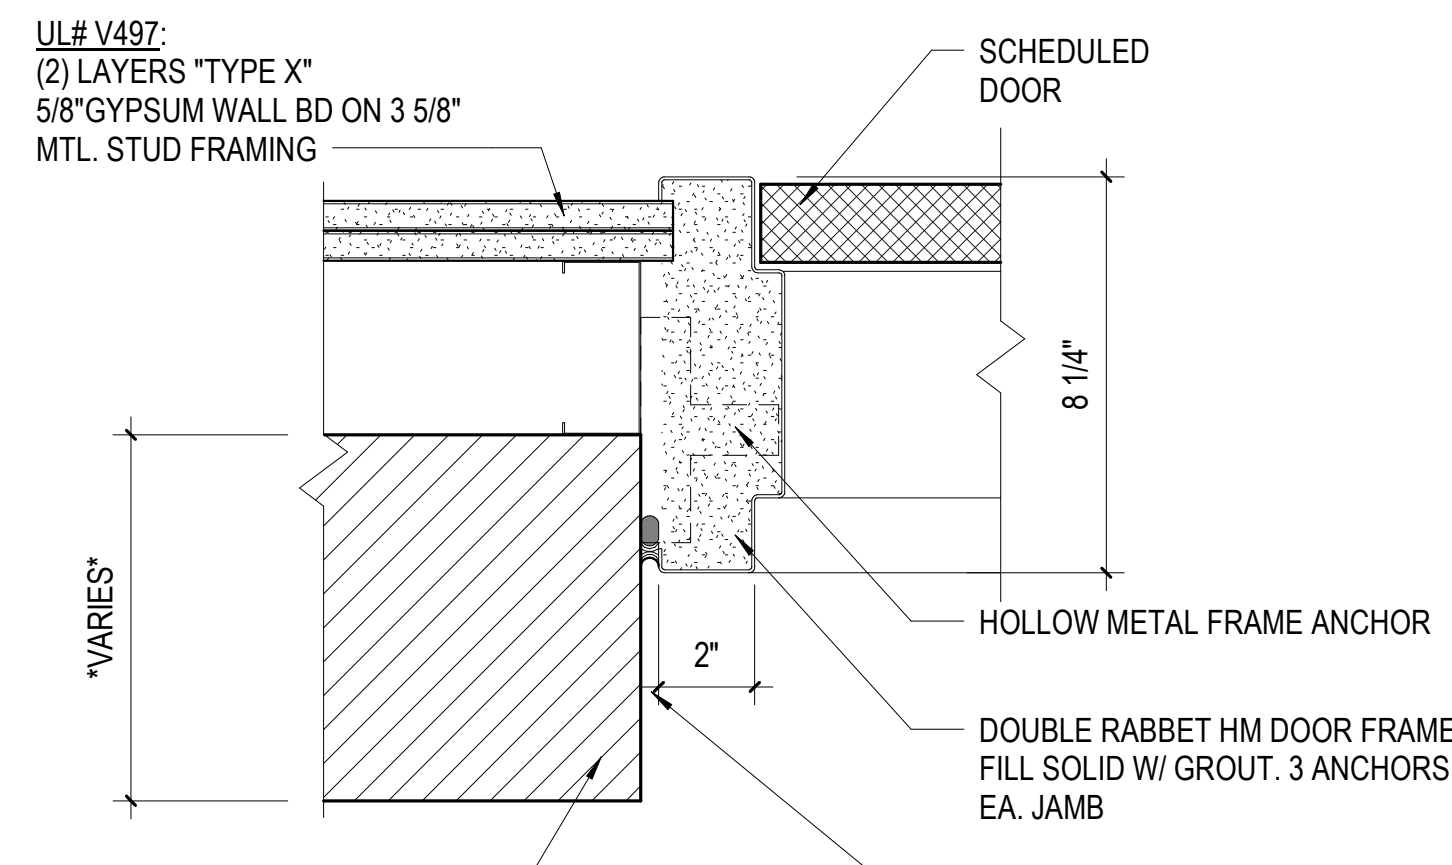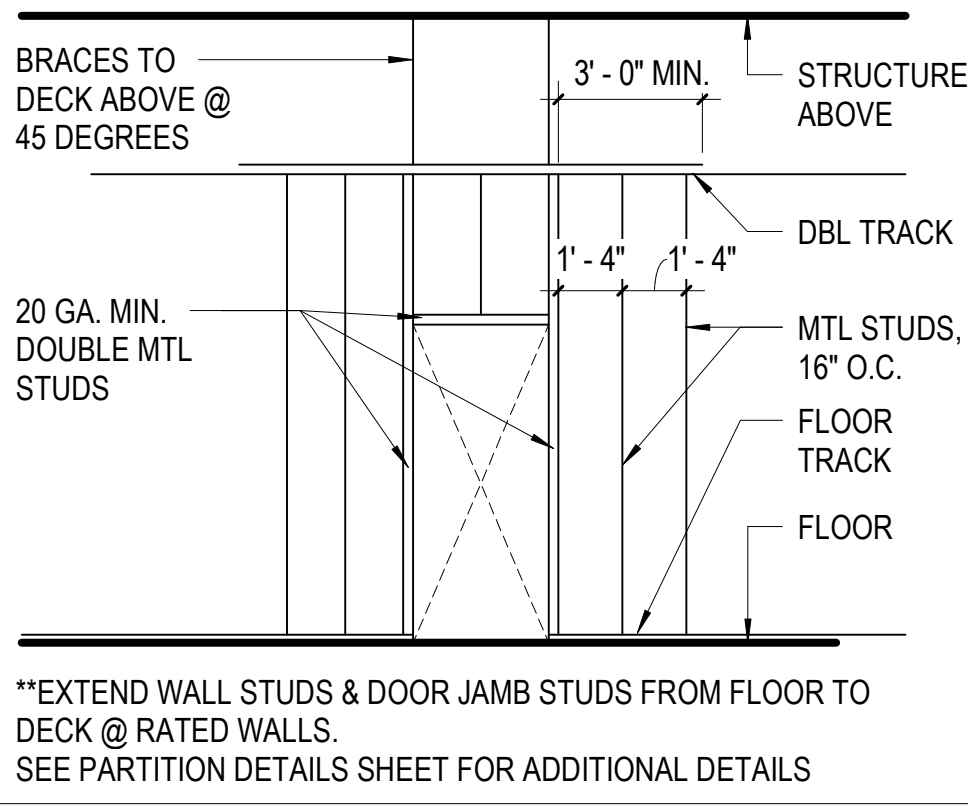


D2 DOOR JAMB - EXISTING MASONRY WALL W/ FURRING
3" = 1'-0"

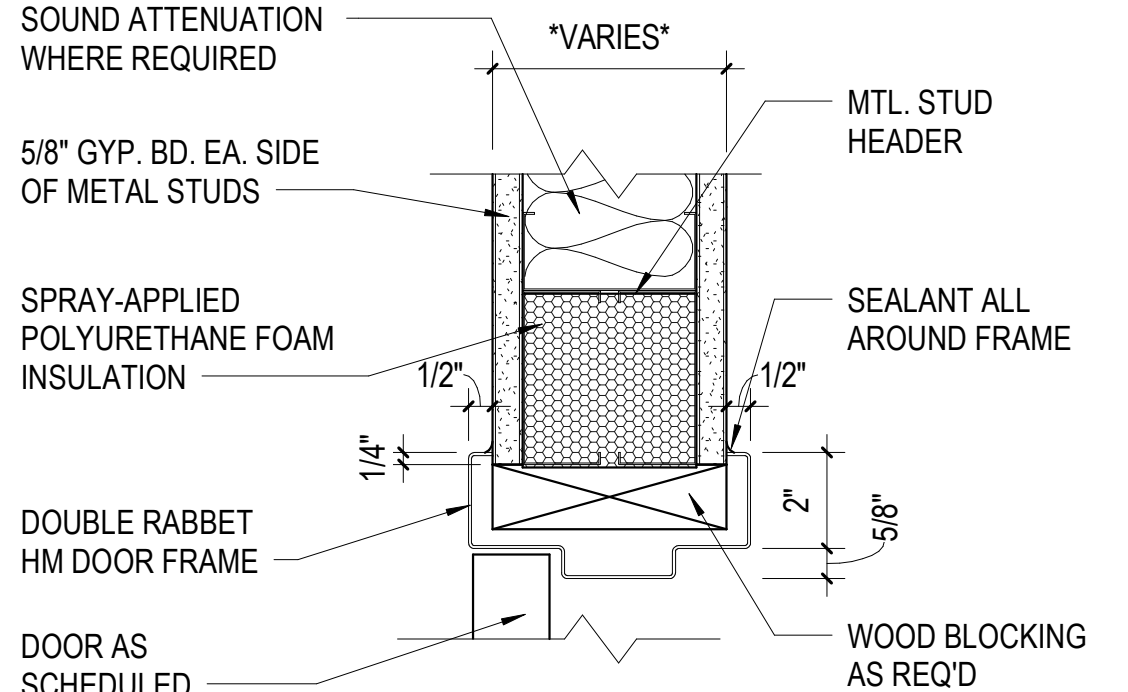


C2 DOOR HEAD - HM IN METAL STUD WALL
3" = 1'-0"

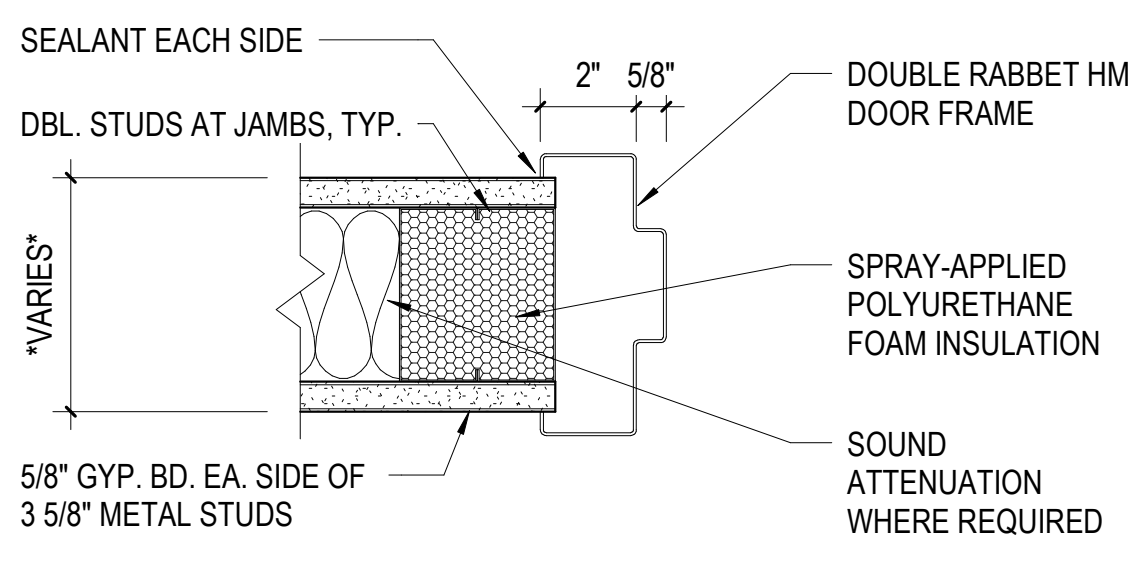

B2 DOOR JAMB - HM IN METAL STUD WALL
3" = 1'-0"

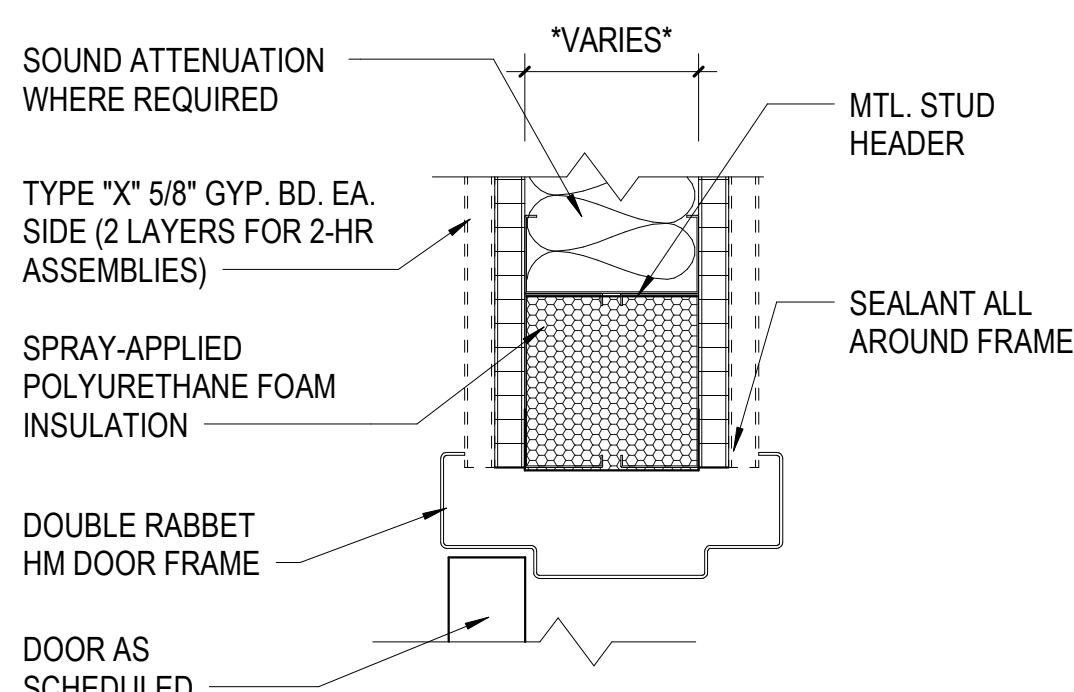


C1 DOOR HEAD - HM IN FIRE RATED STUD WALL
3" = 1'-0"

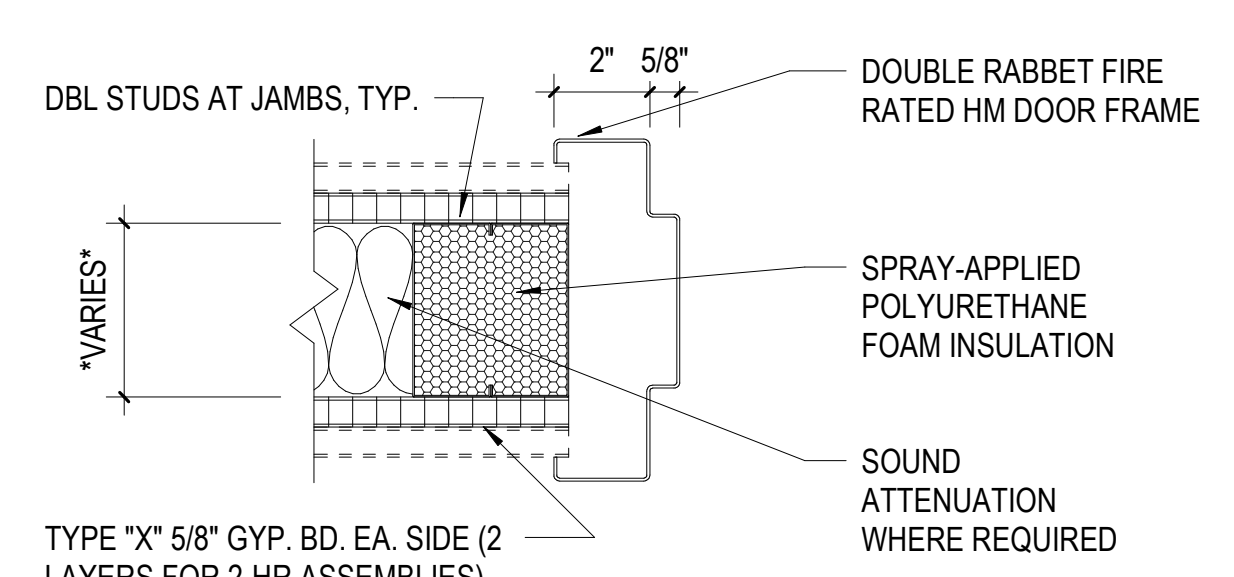


B1 DOOR JAMB - HM IN FIRE-RATED STUD WALL
3" = 1'-0"


K|P|S
GROUP
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com
This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.
The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

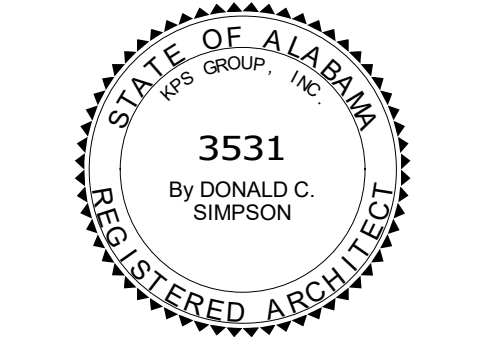


McLURE LIBRARY ADDITION AND RENOVATION
PACKAGE 'D' - ADDITION AND RENOVATION
OWNER: UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS: 918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401
PROJECT STATUS
ISSUED SET: BID SET
ISSUE DATE: 30 JAN 24
REVISIONS
No. Description Date
DRAWN BY: Author
CHECKED BY: Checker
PROJECT NUMBER: 236002-02
DRAWING NO: A6.11

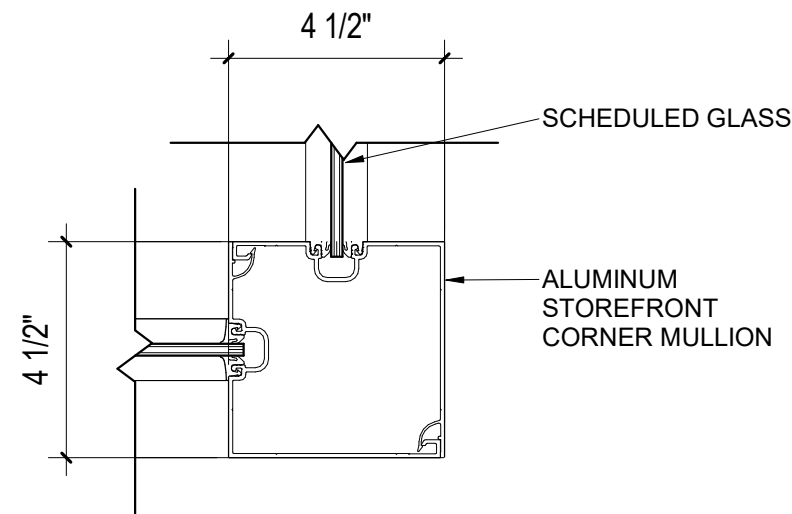


F6 STOREFRONT - 1 3/4" CORNER MULLION
3" = 1'-0"

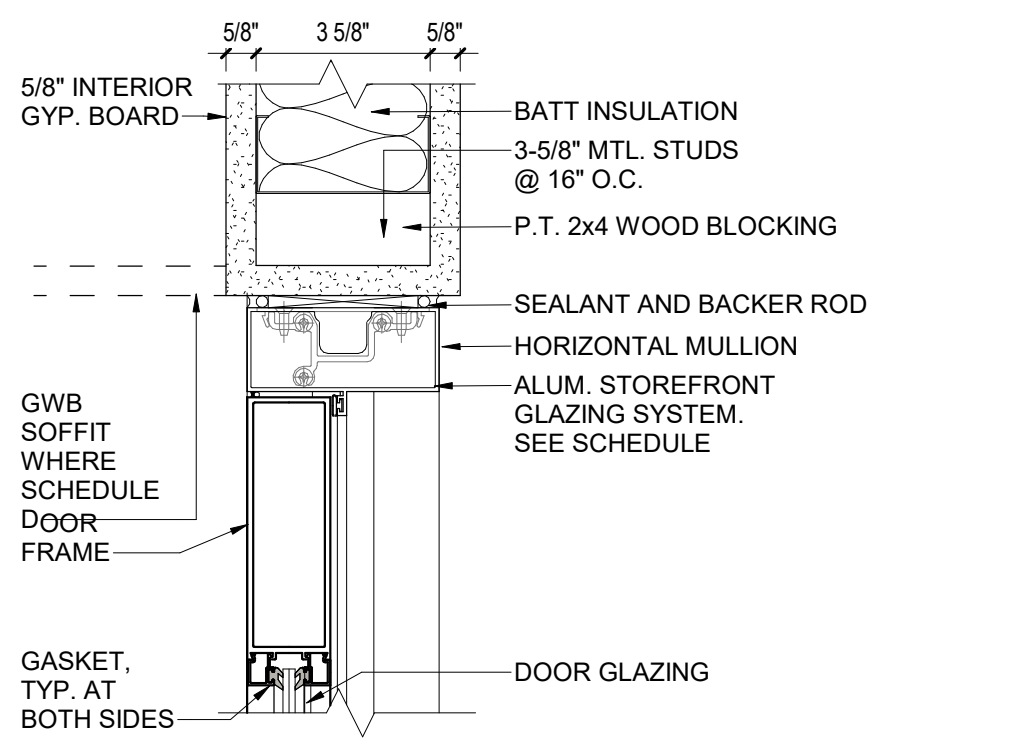


E6 STOREFRONT - 1 3/4" HEAD DETAIL, DOOR
3" = 1'-0"

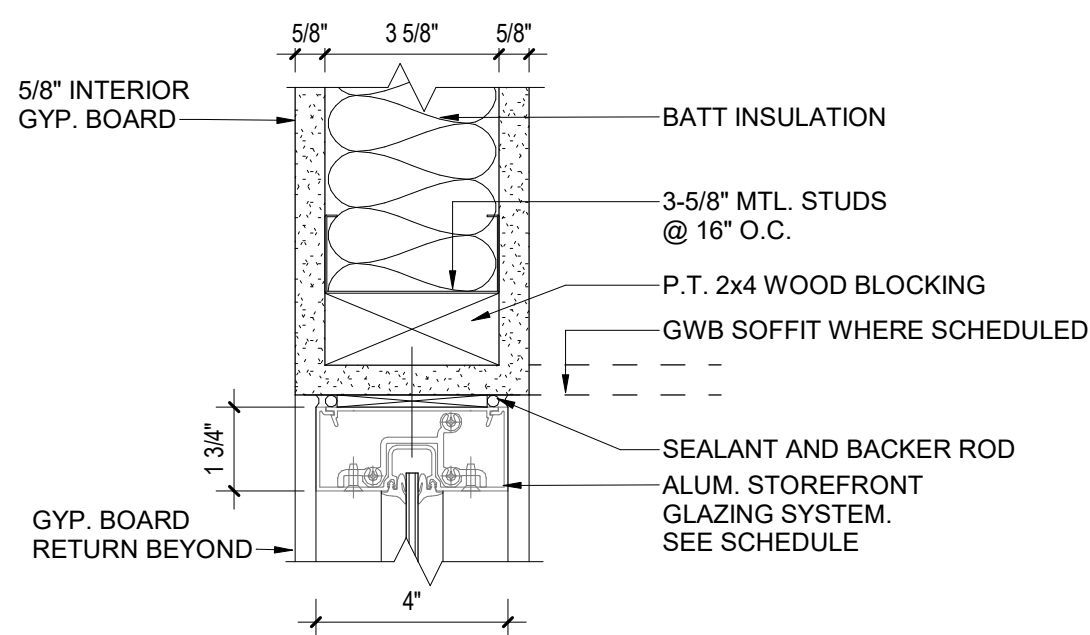


D6 STOREFRONT - 1 3/4" HEAD DETAIL
3" = 1'-0"

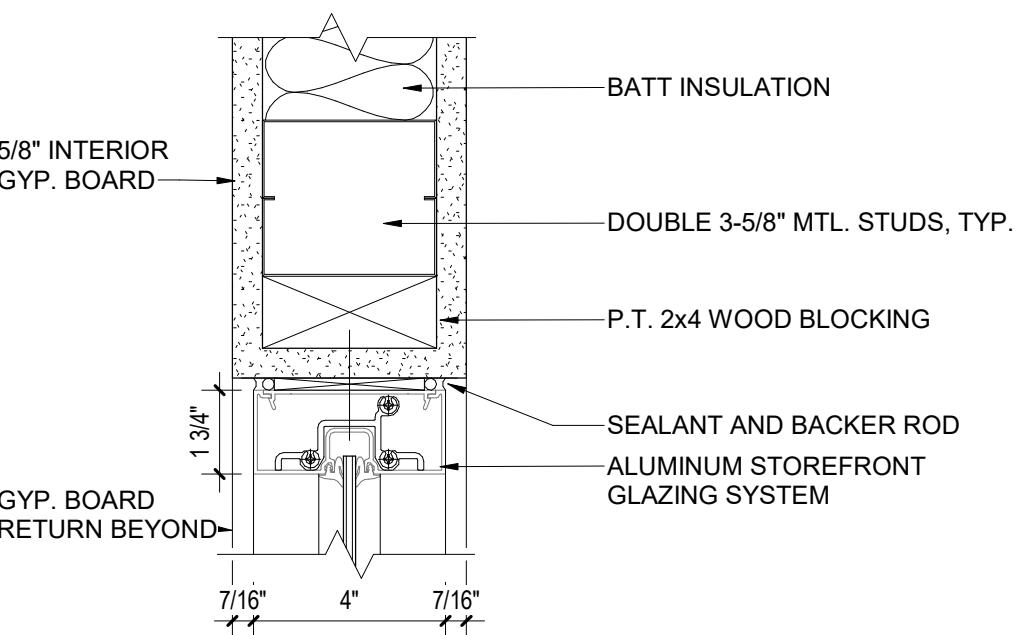


C6 STOREFRONT - 1 3/4" JAMB DETAIL
3" = 1'-0"

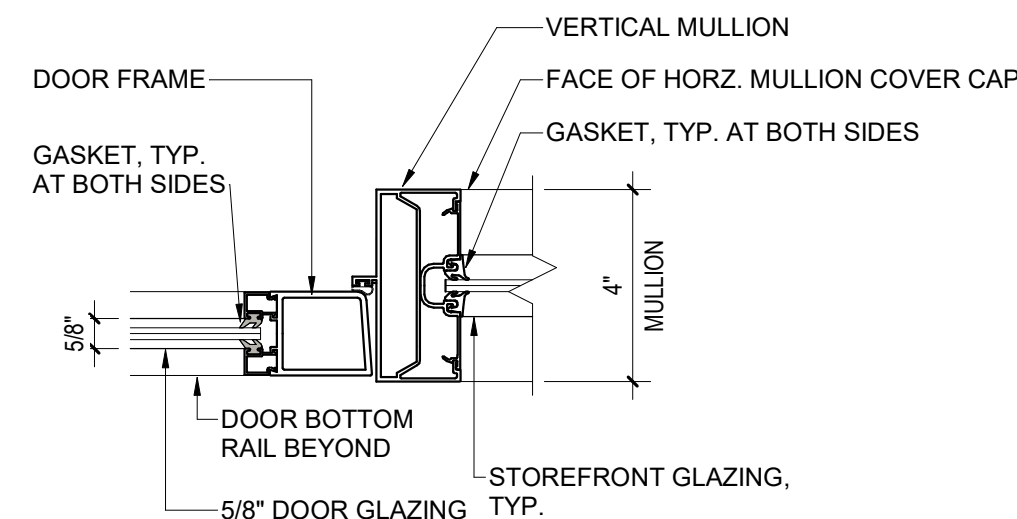


B6 STOREFRONT - DOOR JAMB TO MULLION
3" = 1'-0"

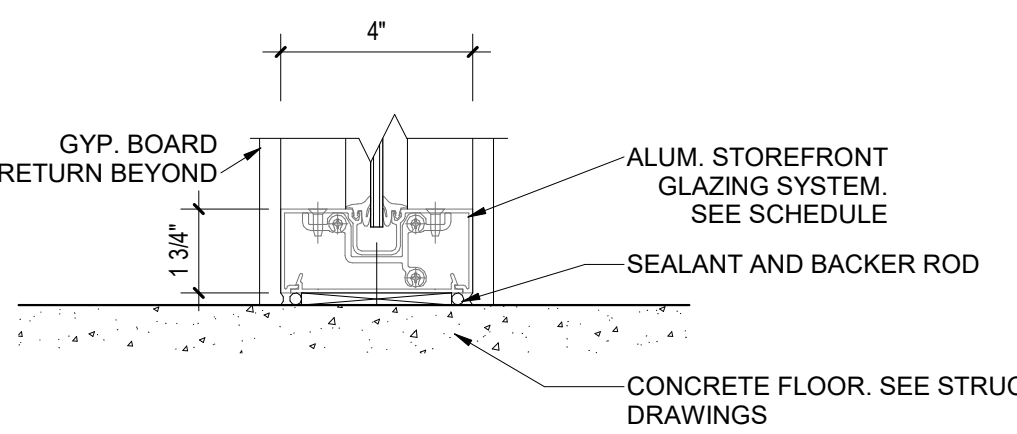


A6 STOREFRONT - 1 3/4" SILL DETAIL @ FLOOR
3" = 1'-0"

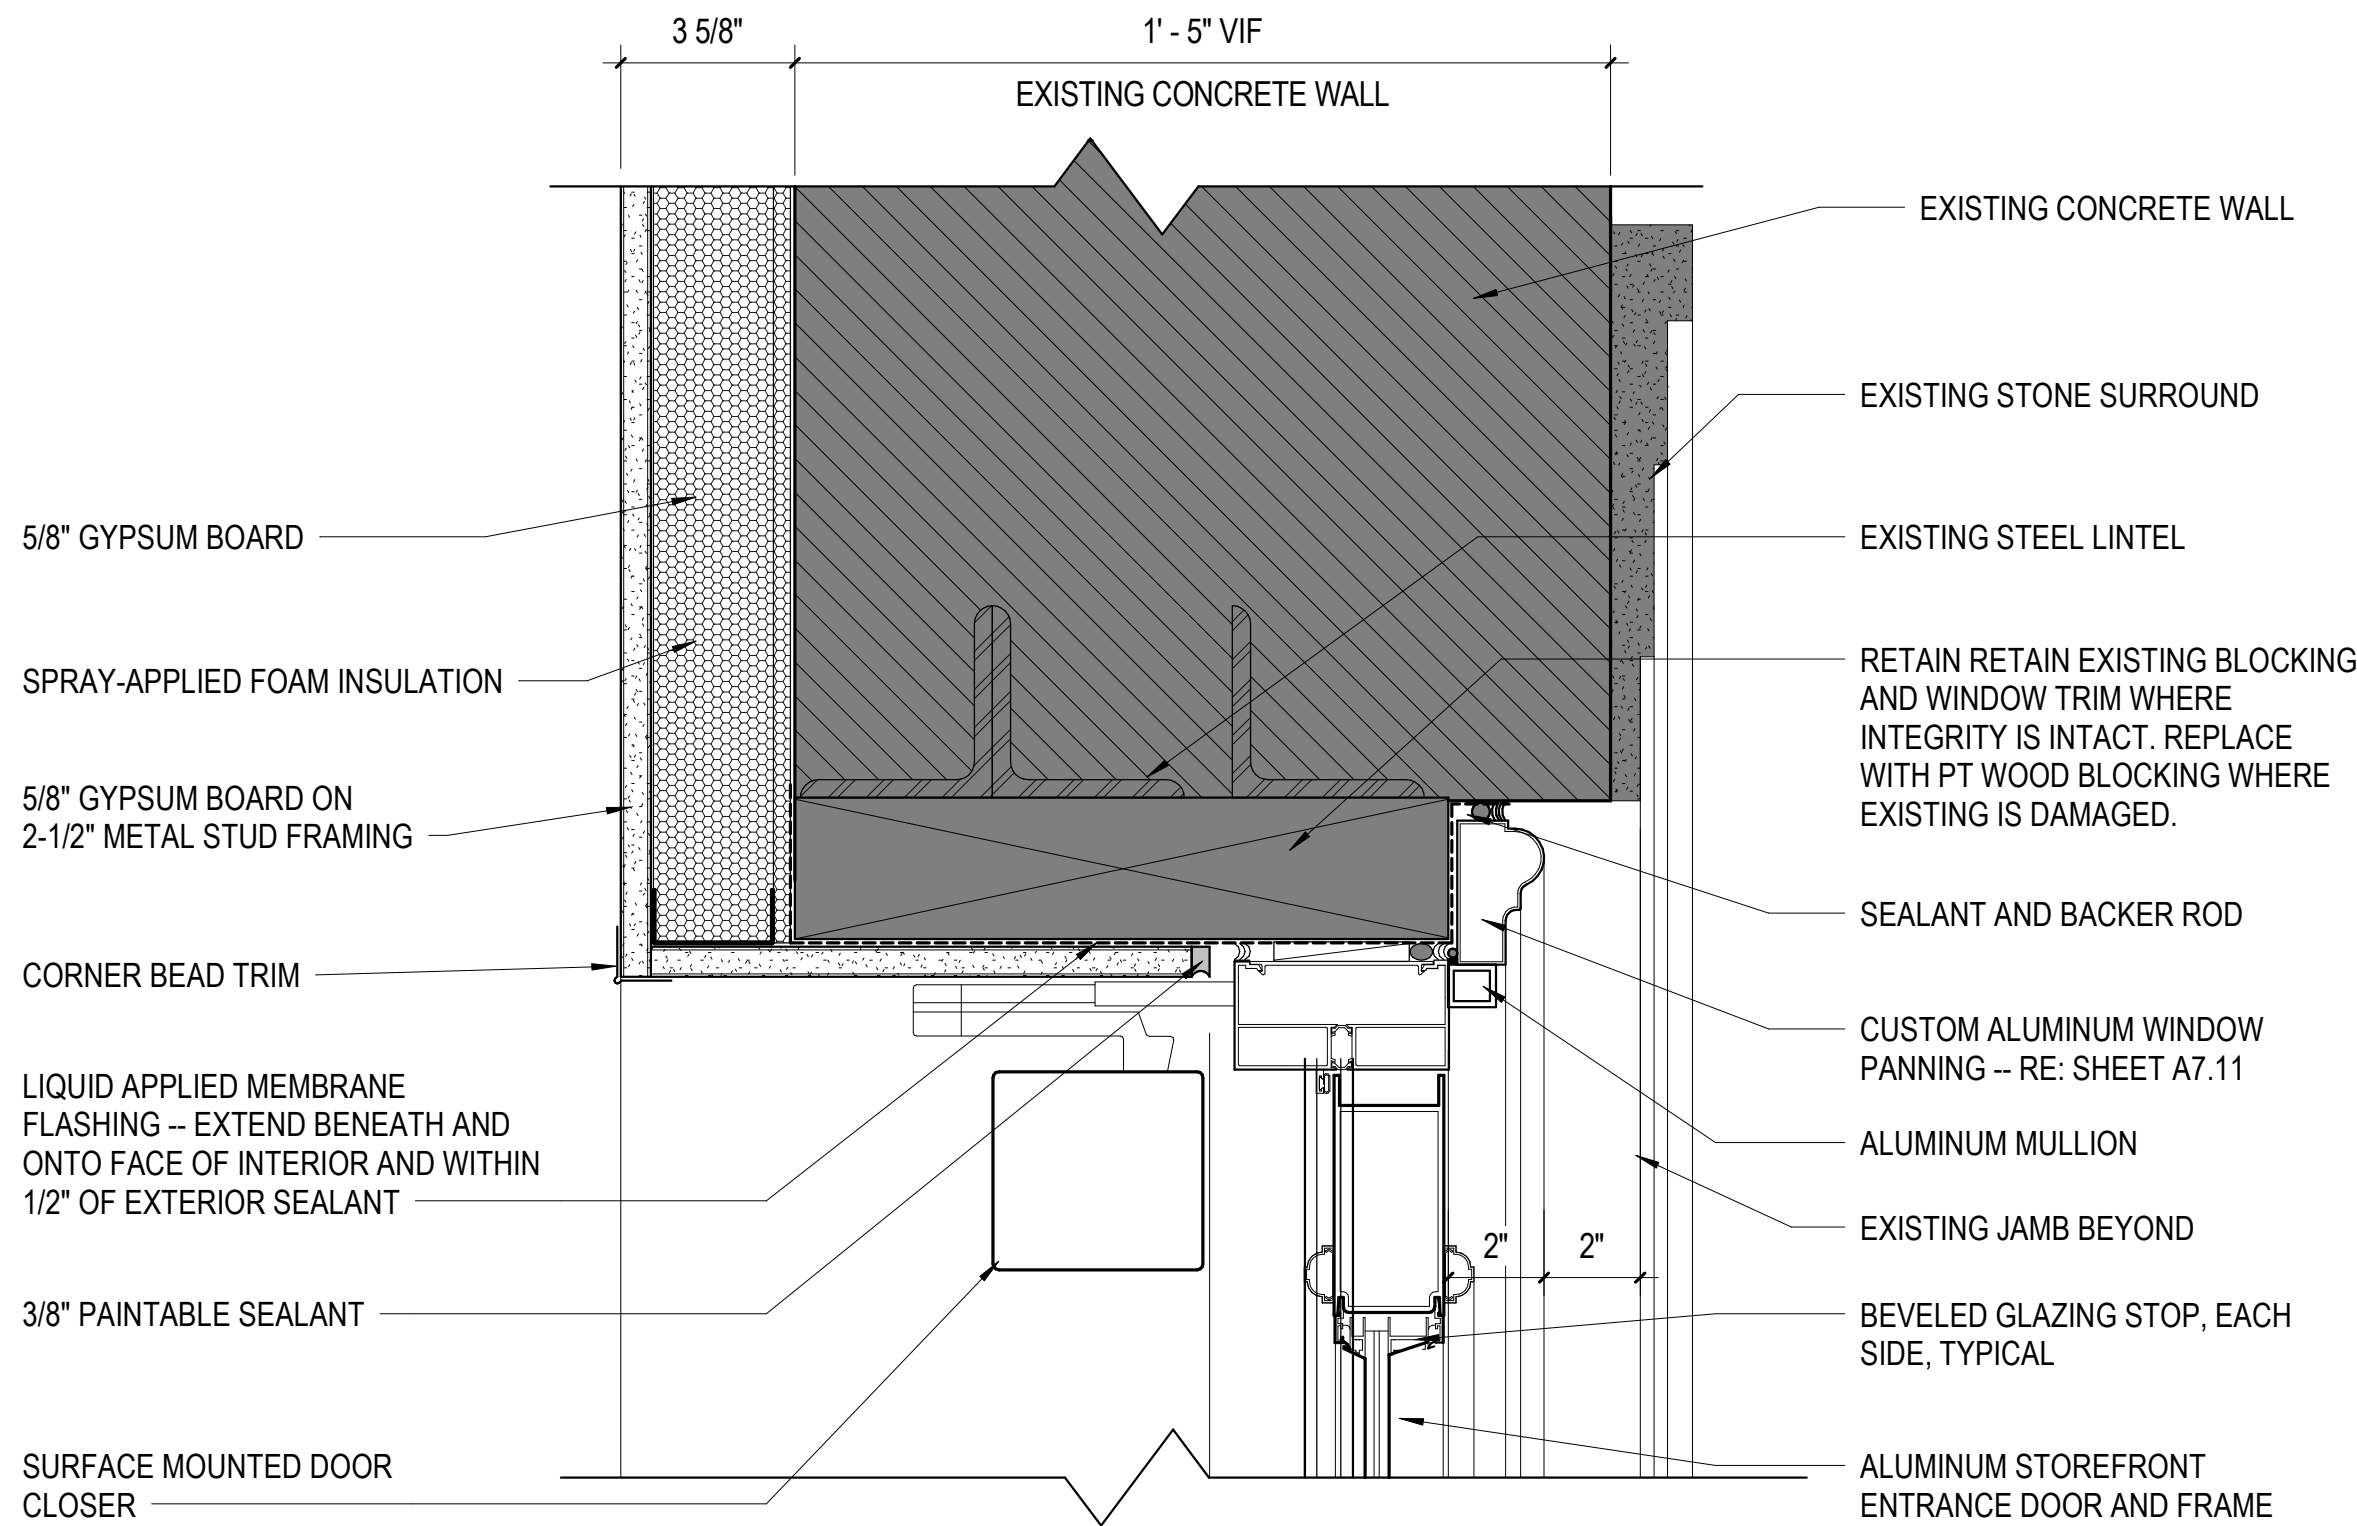


D3 DETAIL - EXTERIOR DOOR HEAD
3" = 1'-0"

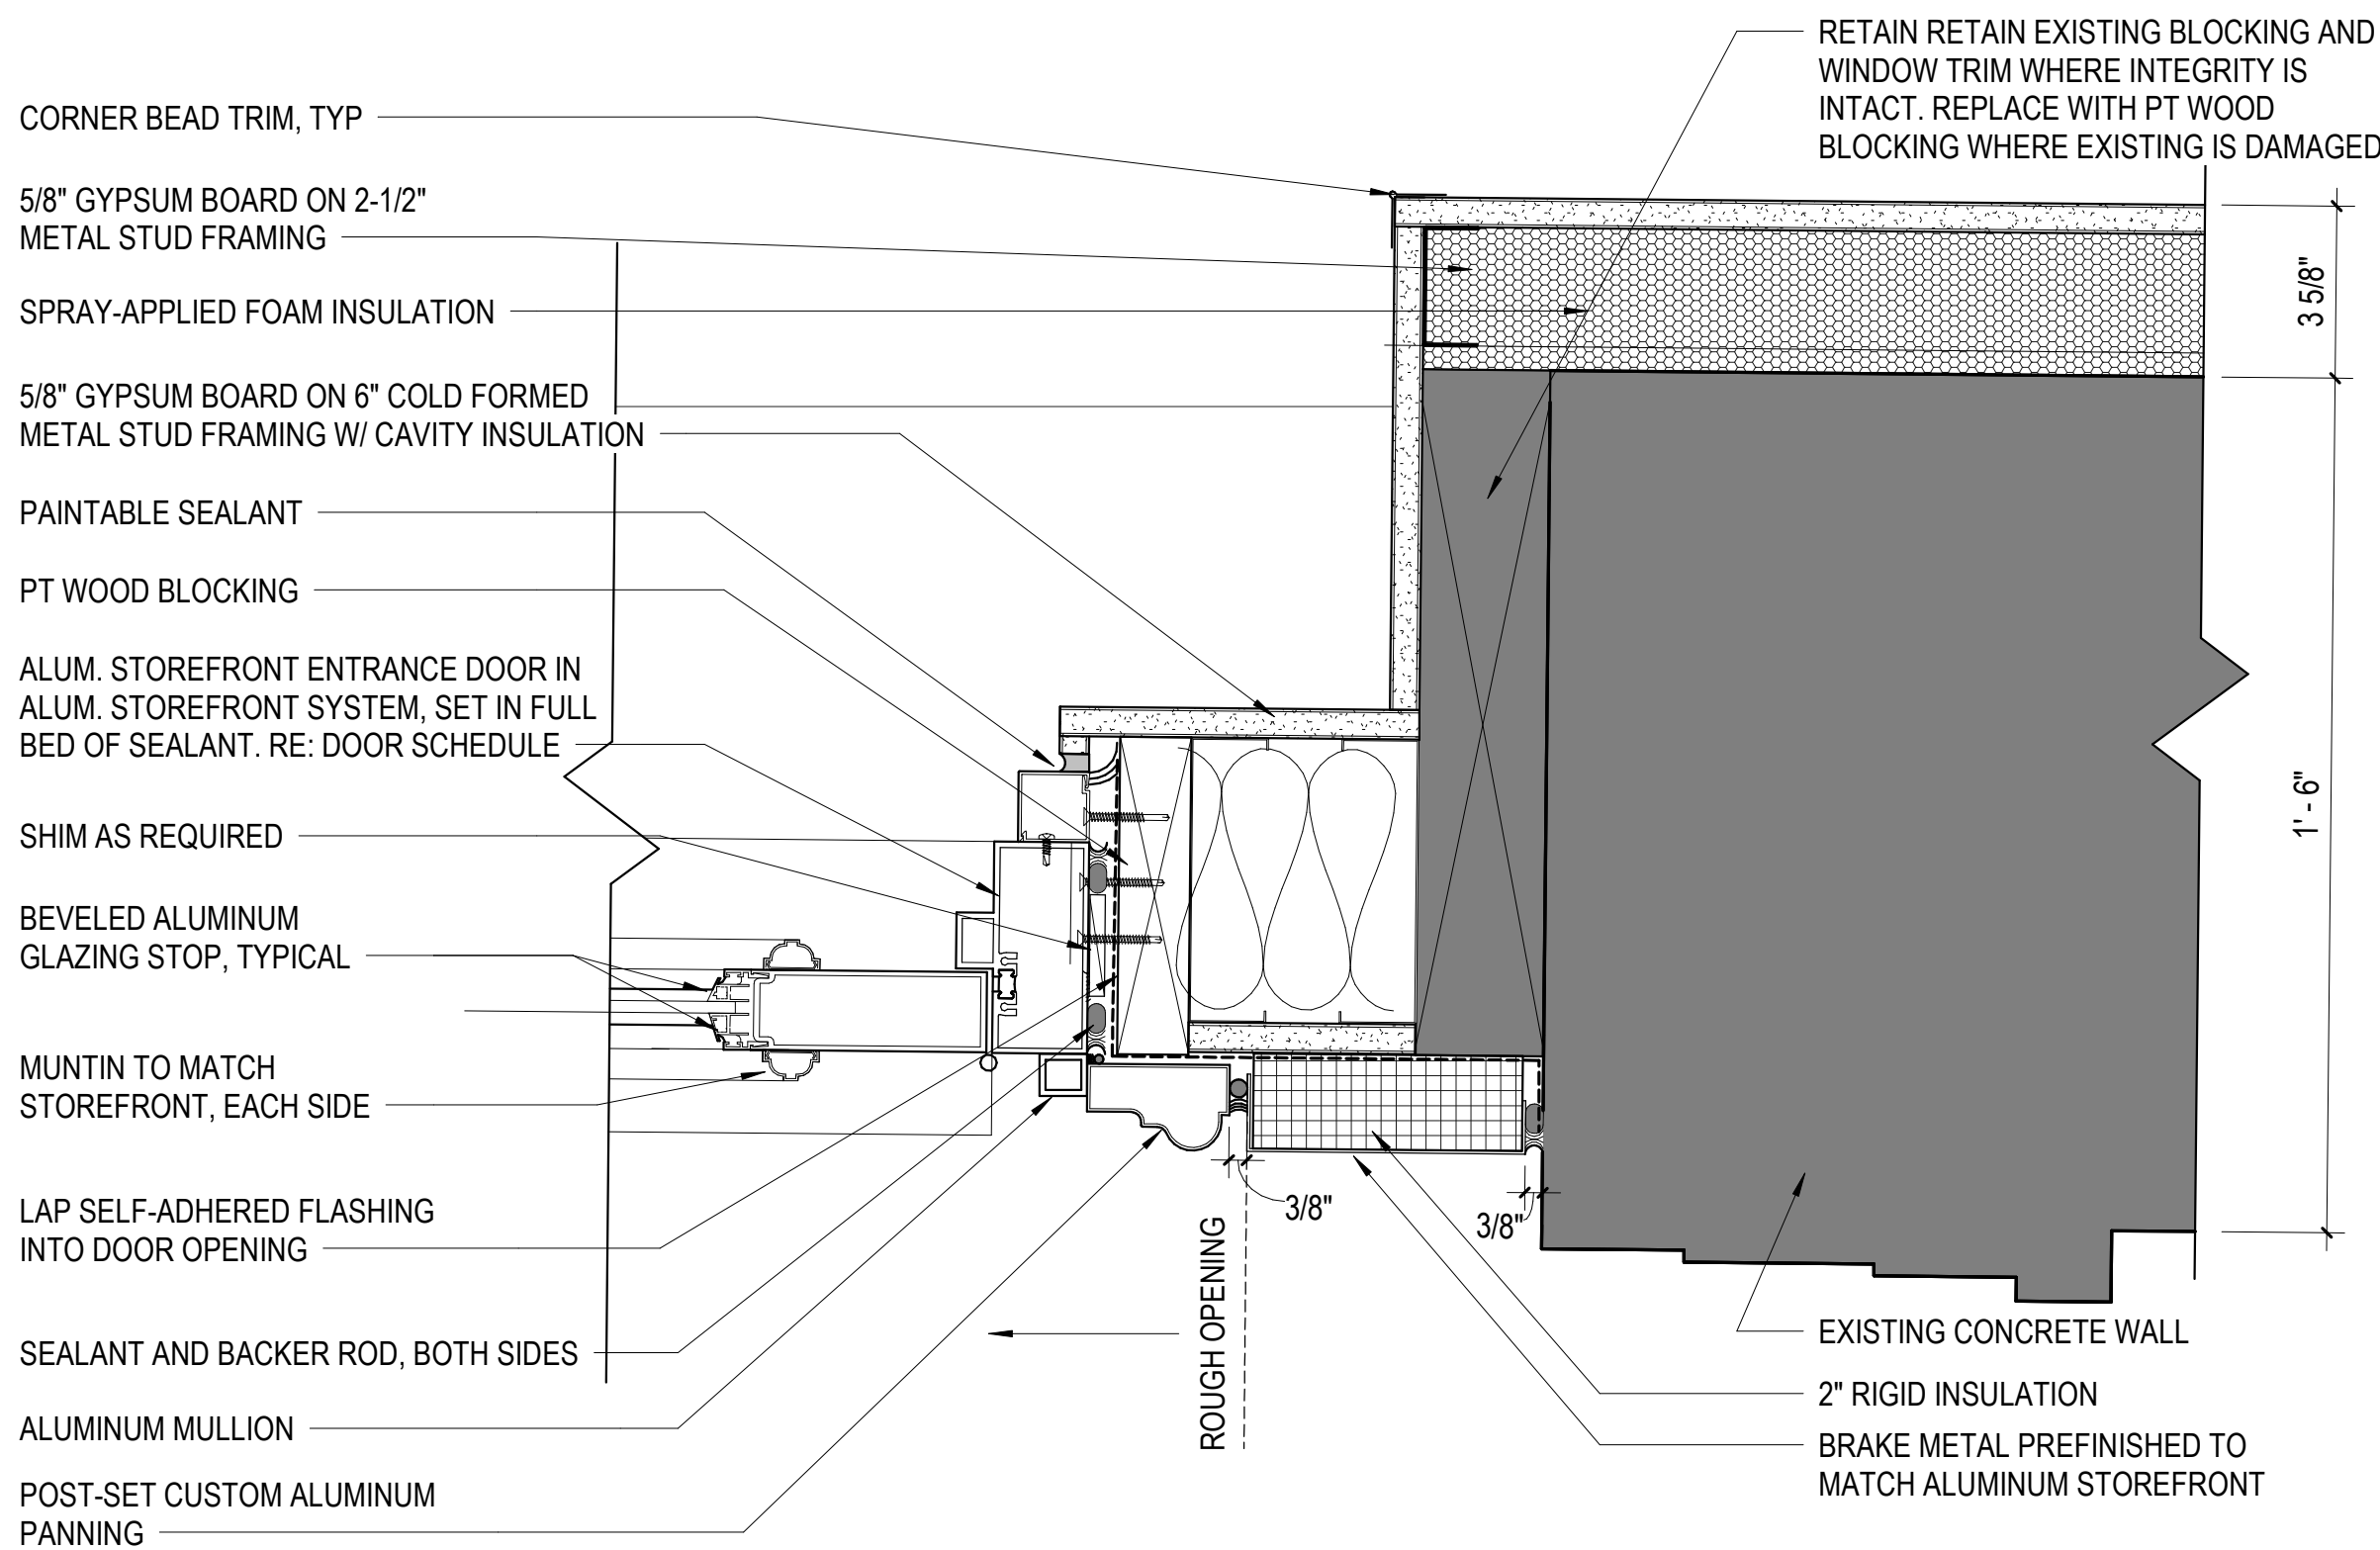


C3 DETAIL - STOREFRONT DOOR JAMB
3" = 1'-0"

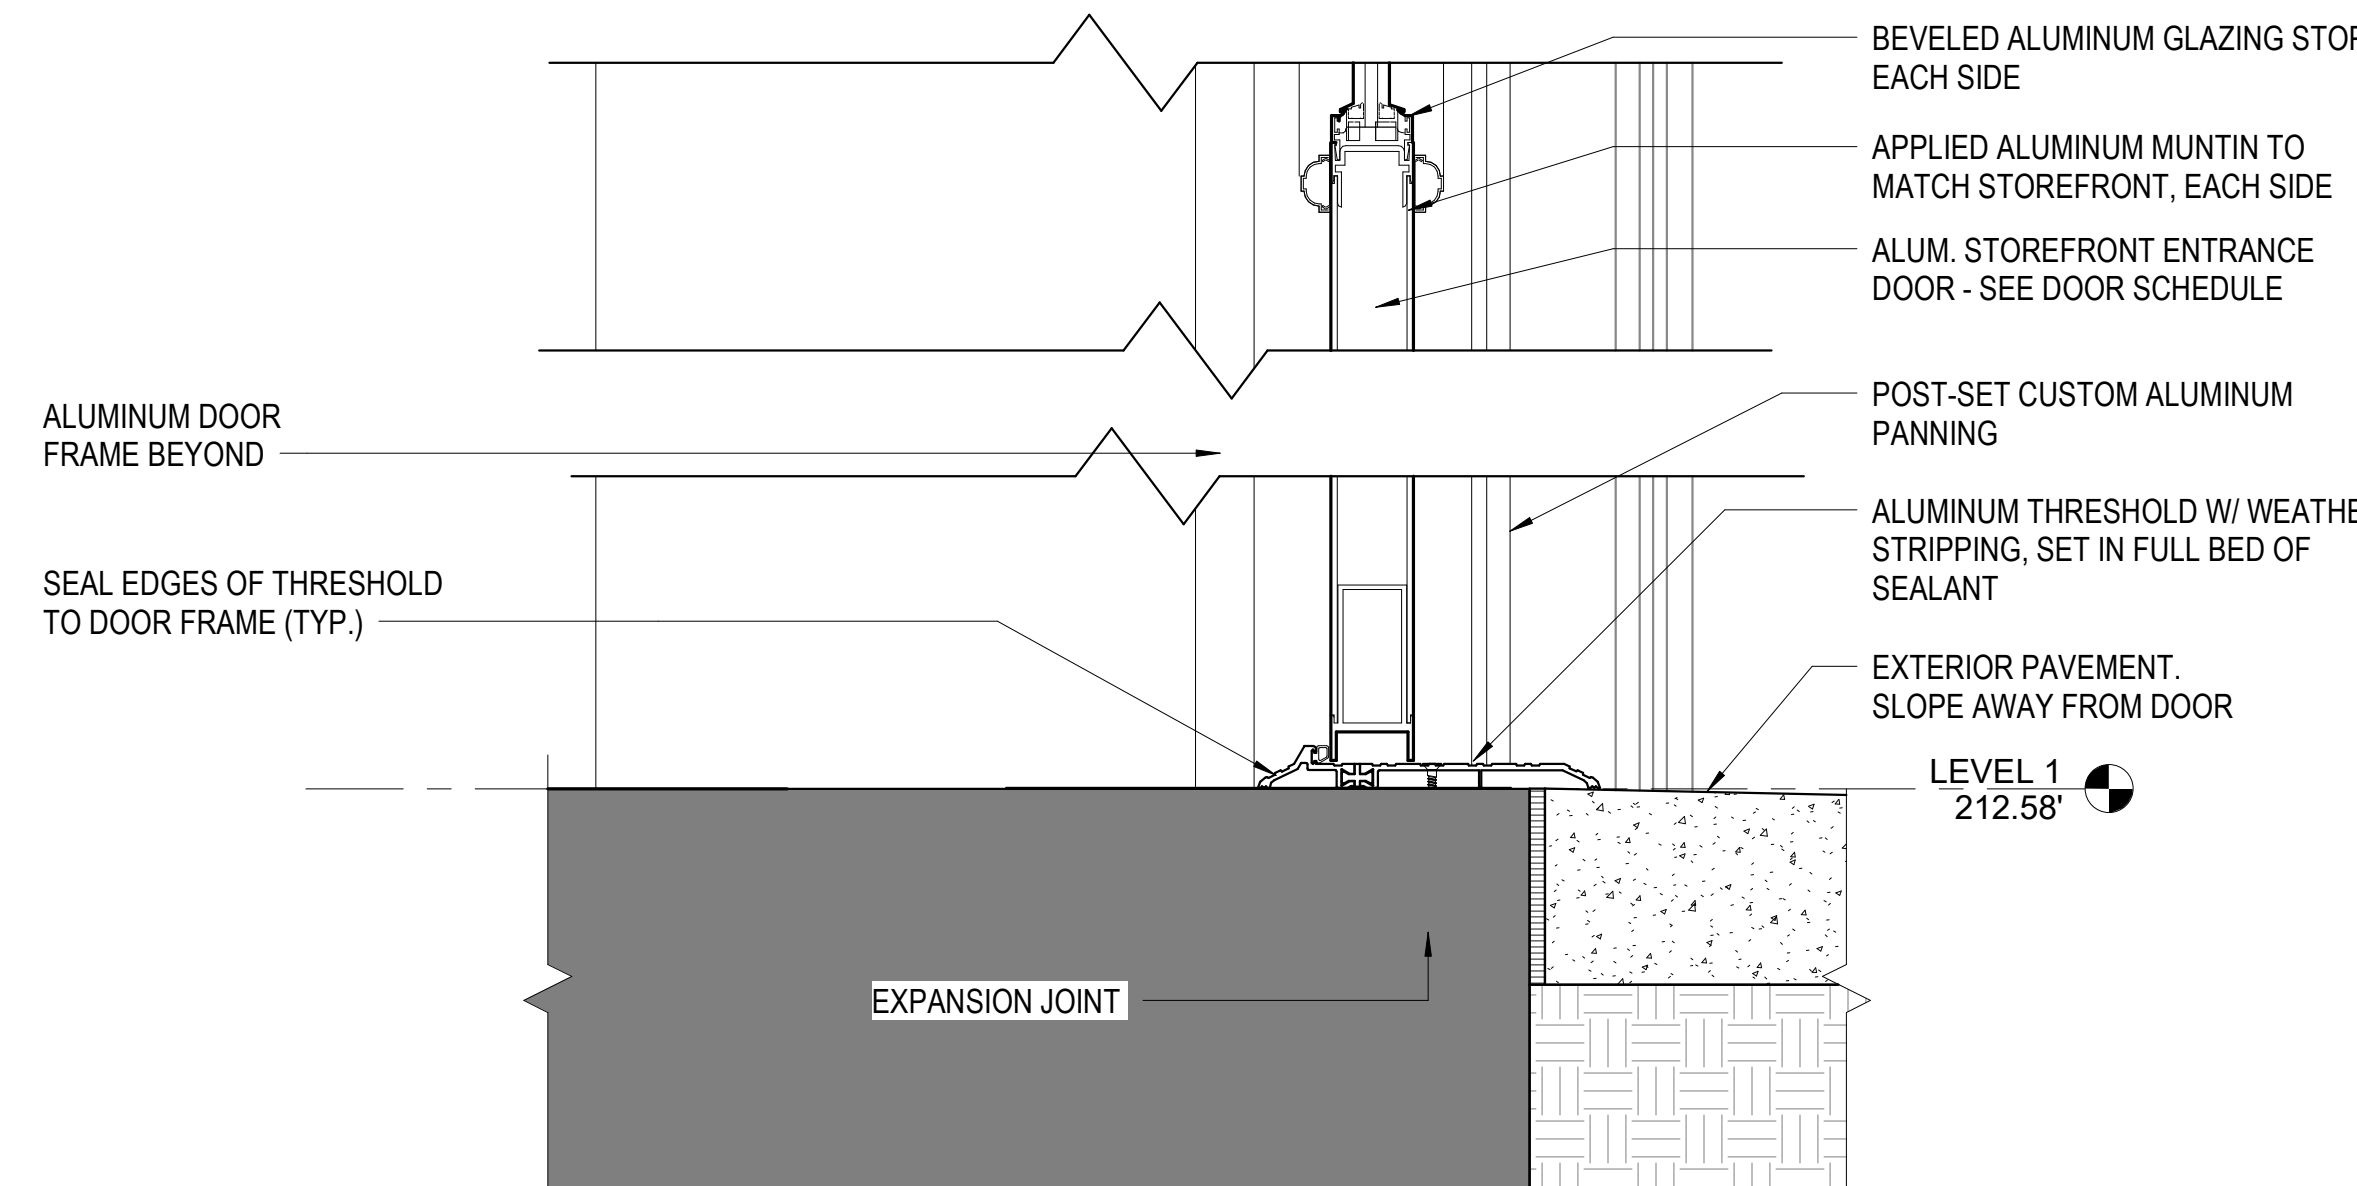


A3 DETAIL - EXTERIOR DOOR SILL
3" = 1'-0"

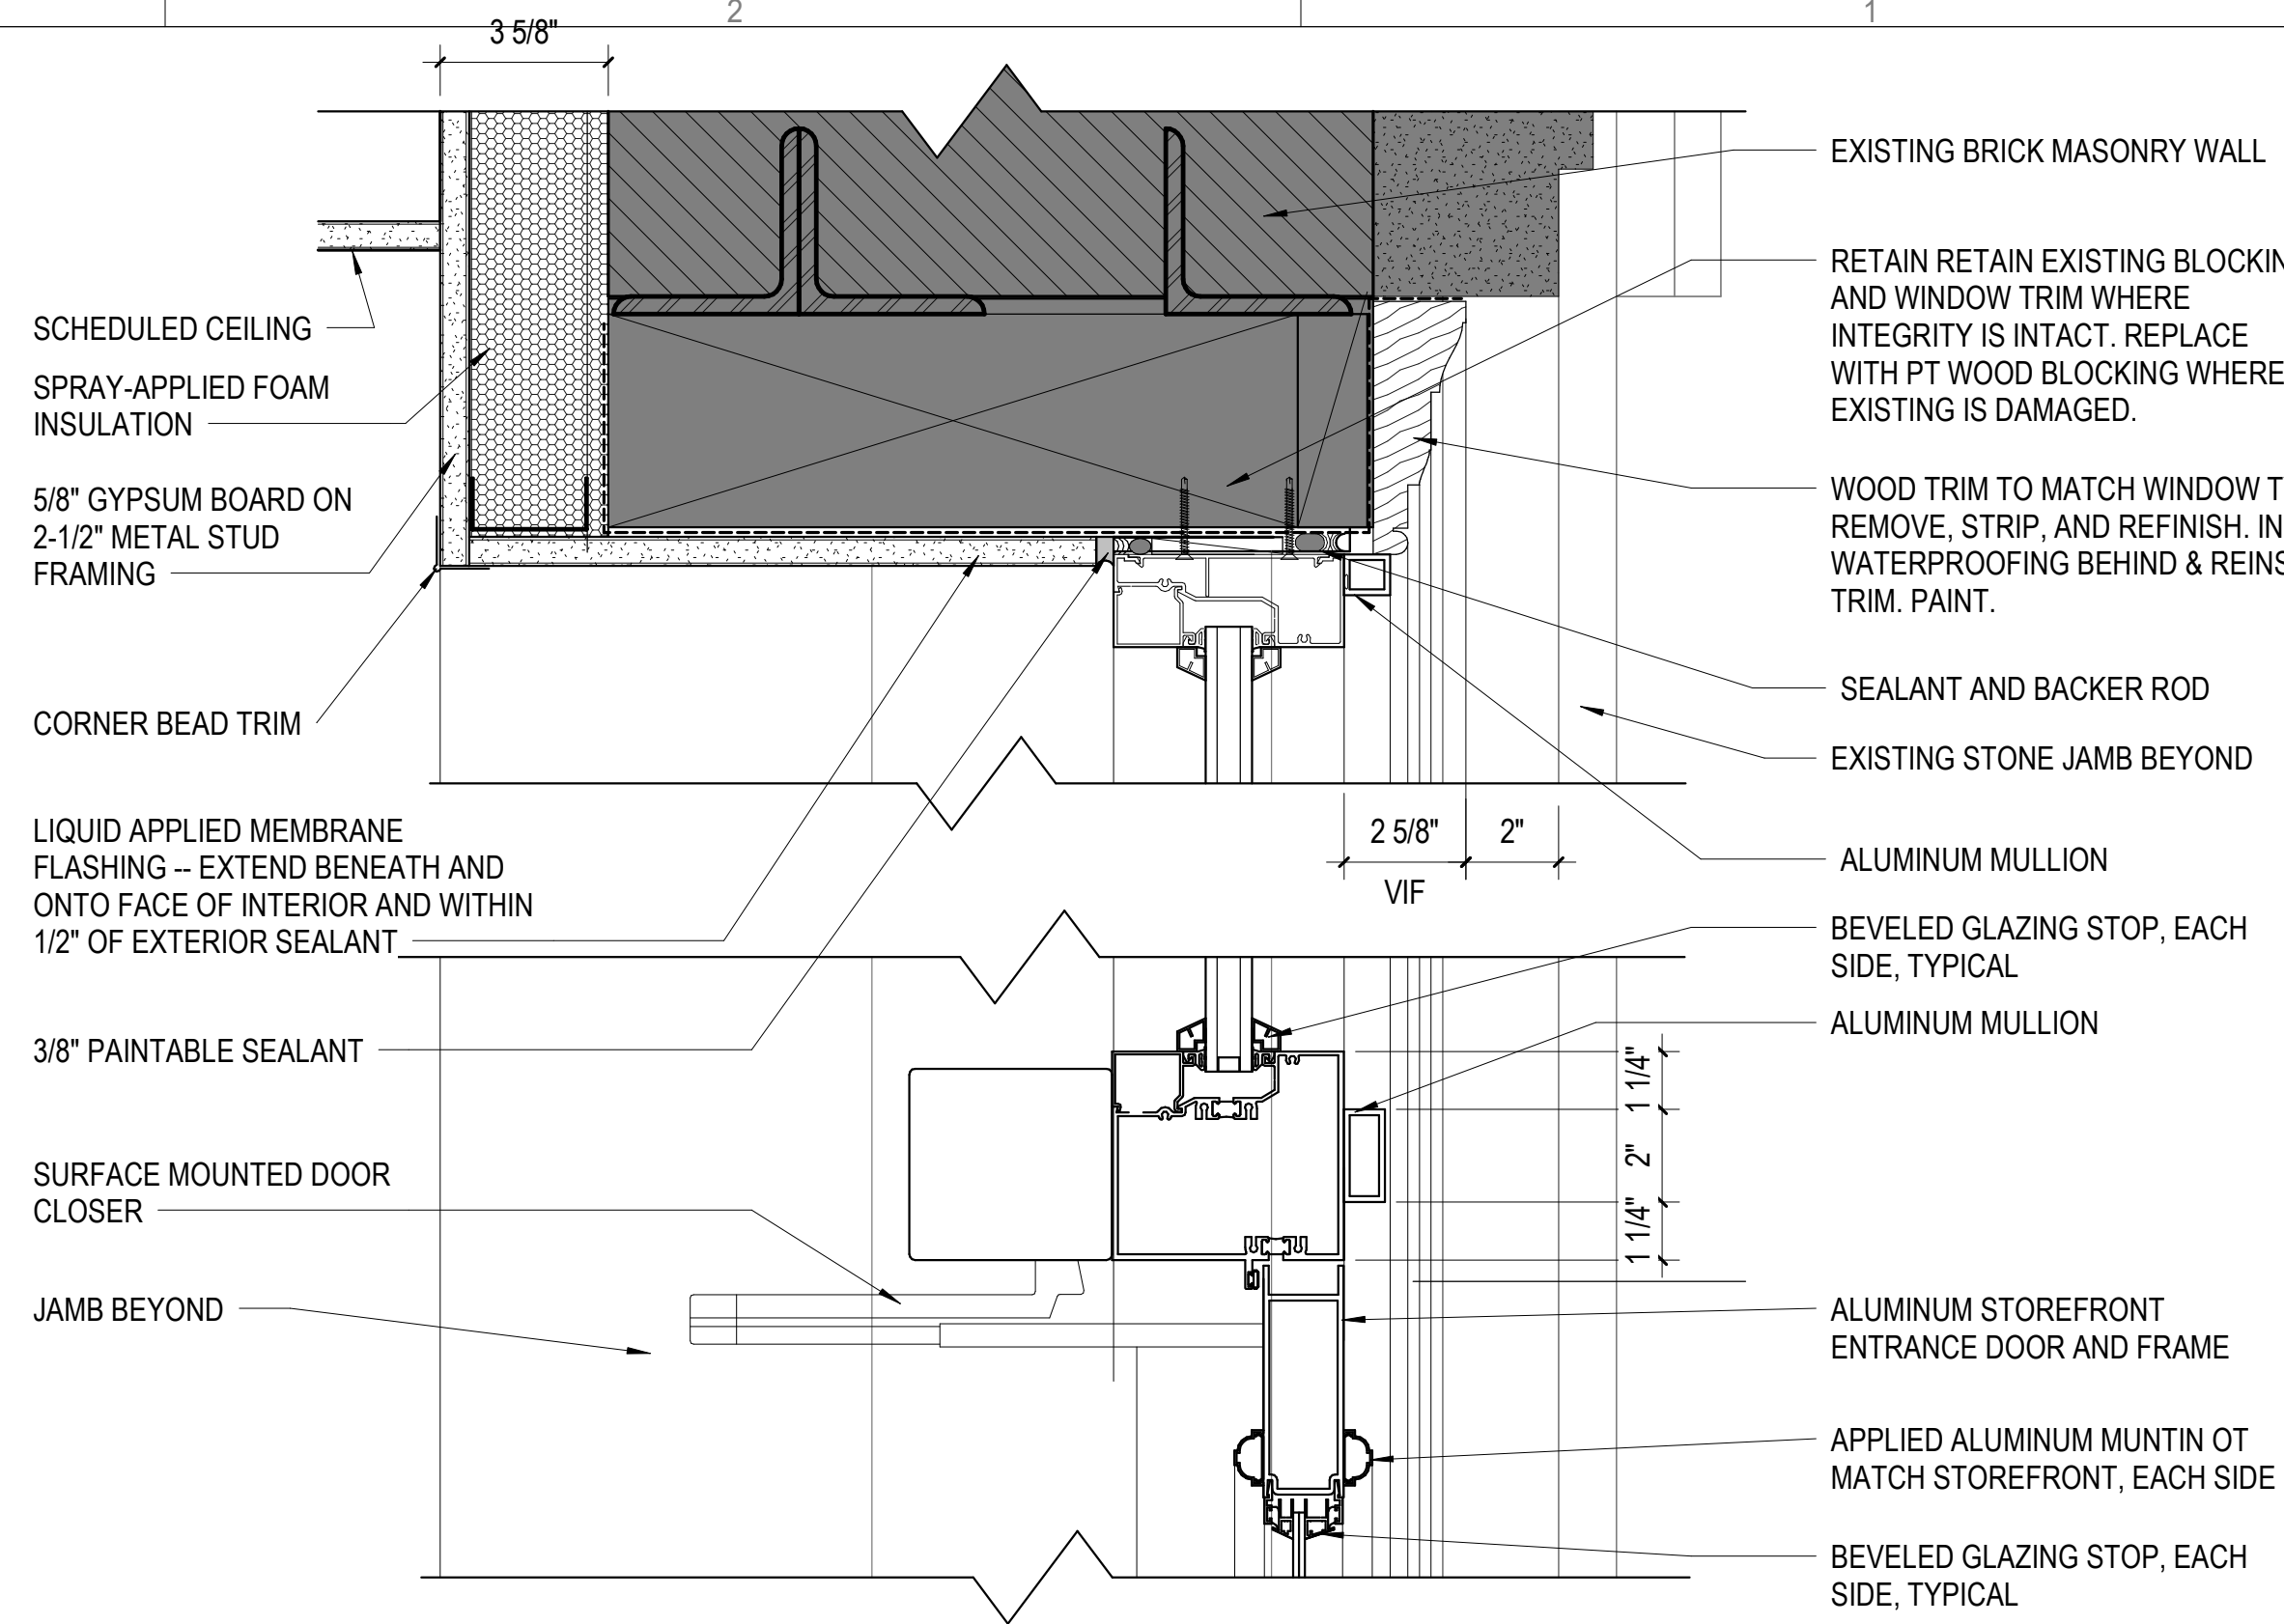


E1 DETAIL - ENTRY DOOR TRANSOM
3" = 1'-0"

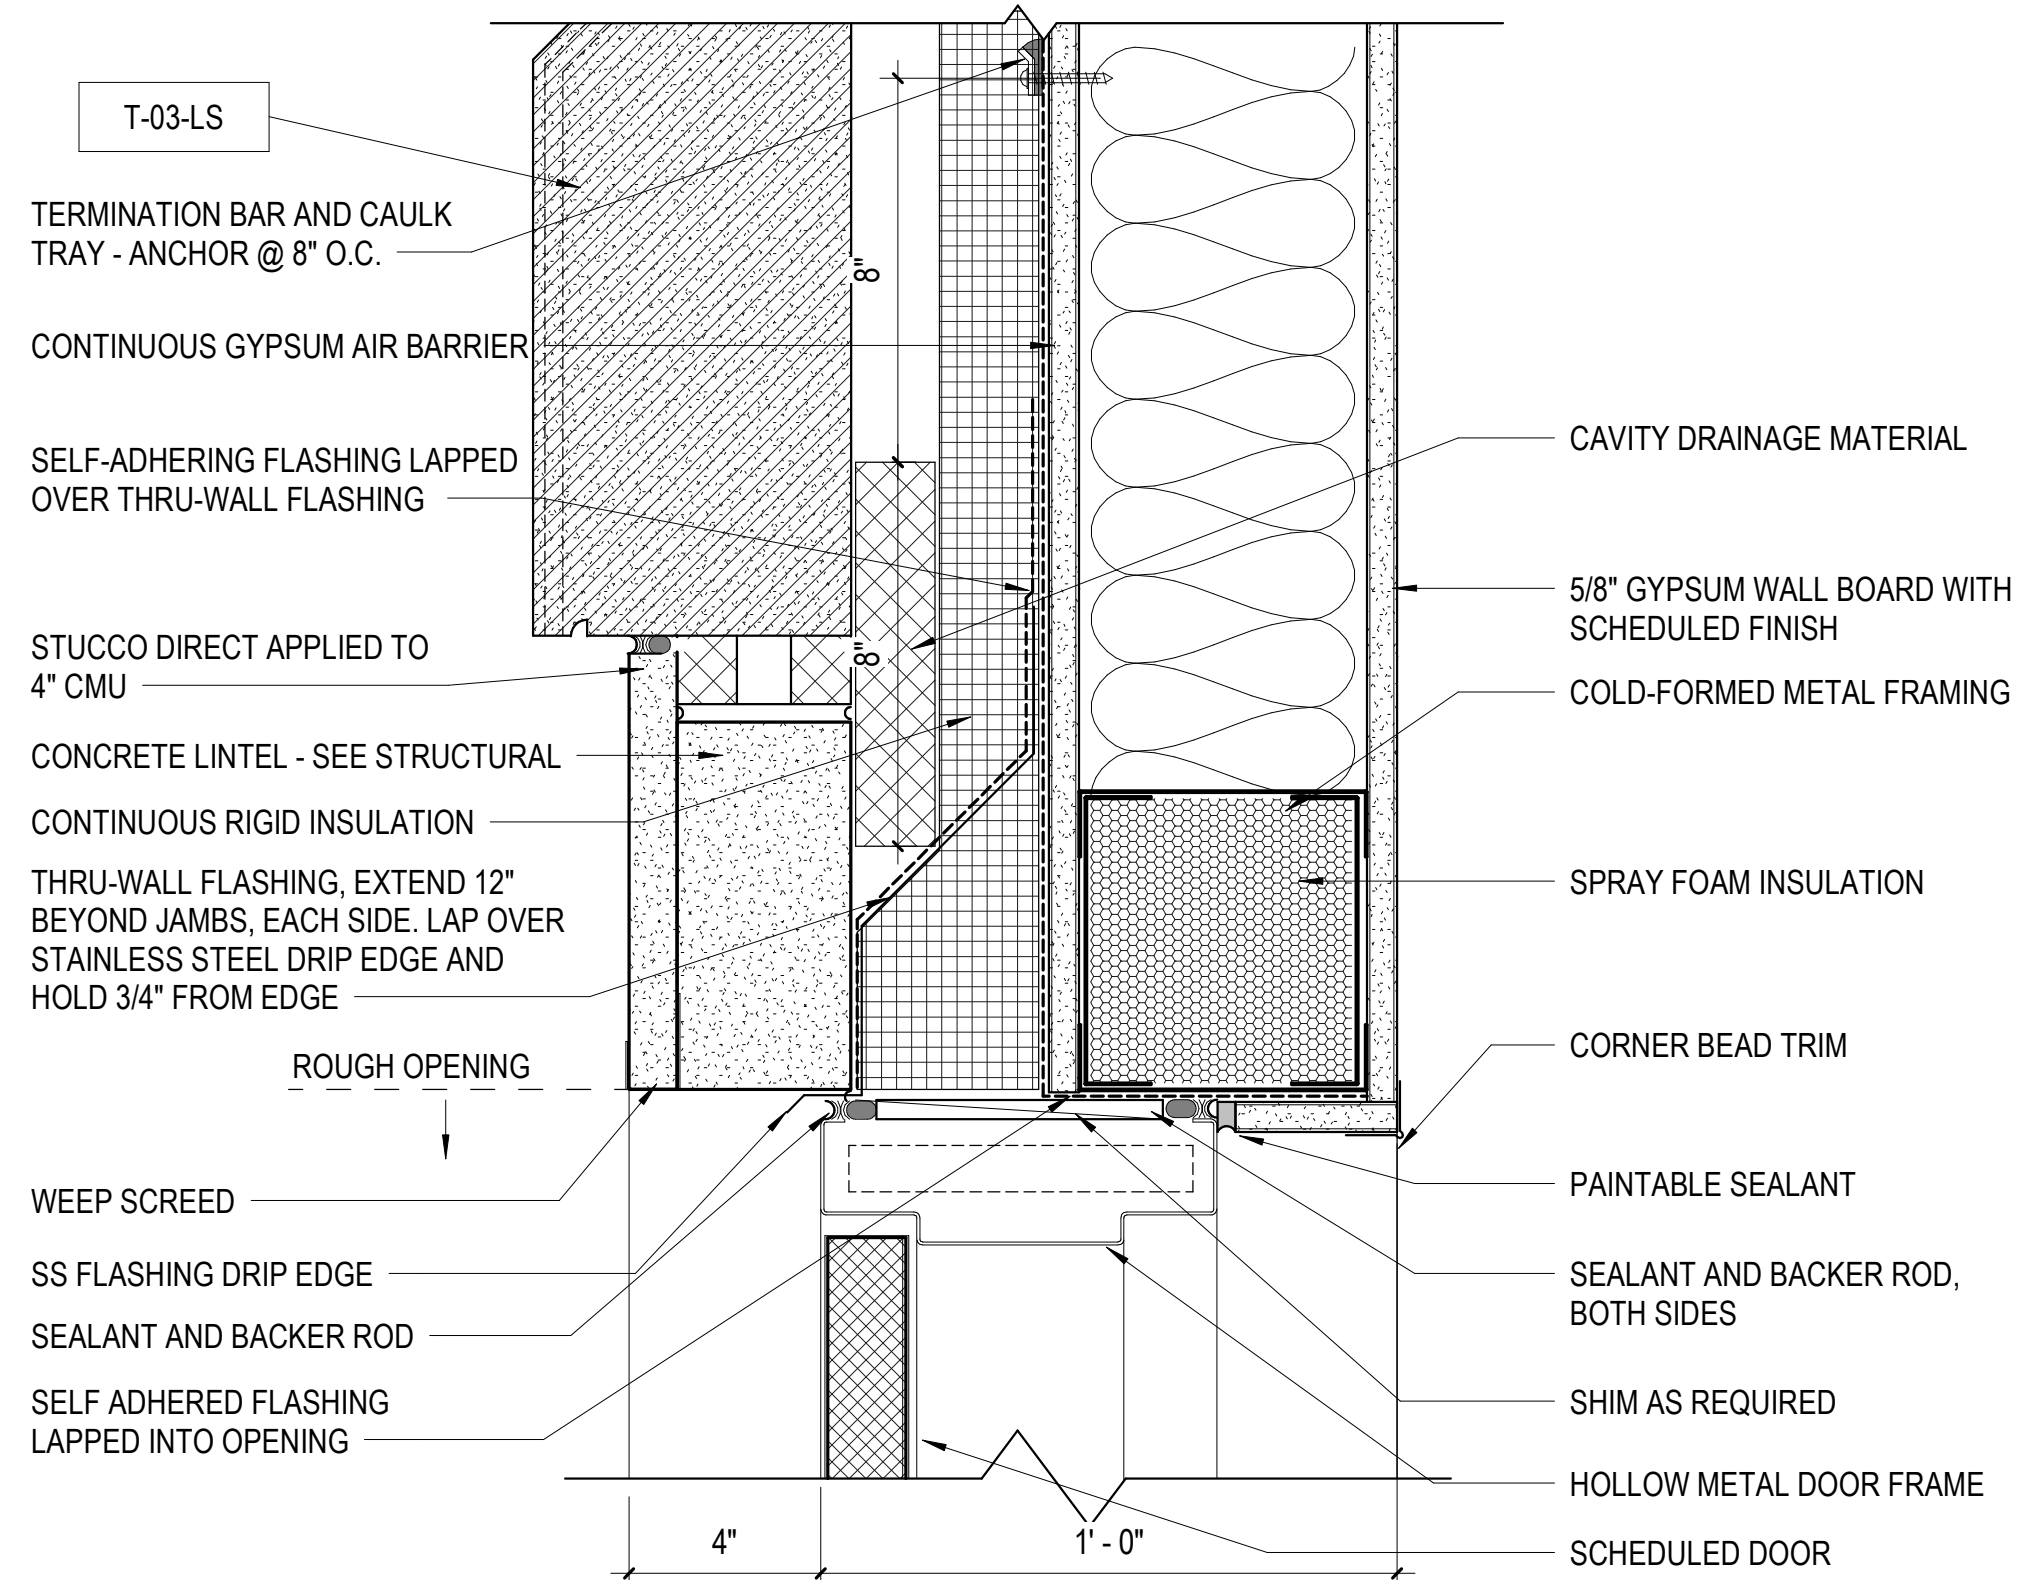

D1 DETAIL - HM DOOR HEAD AT ADDITION
3" = 1'-0"

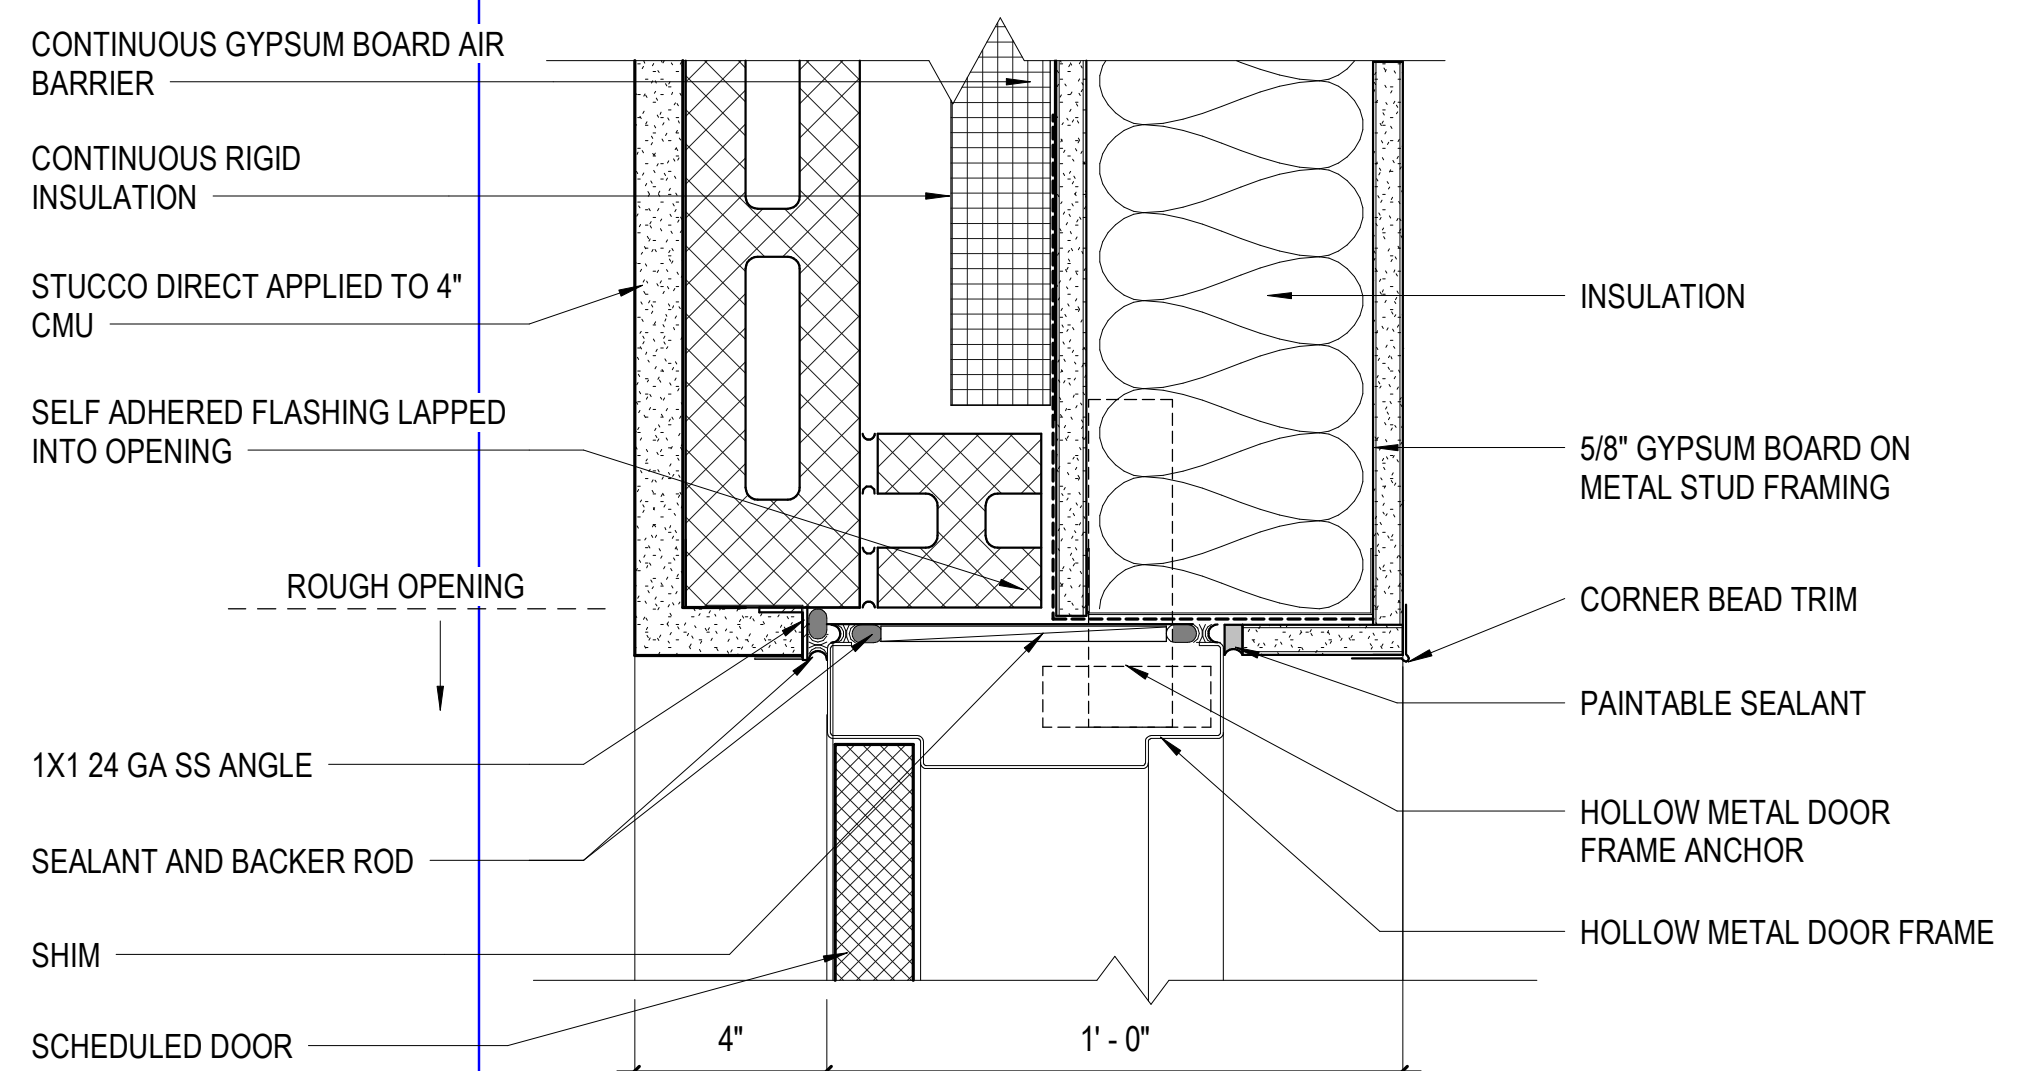

B1 DETAIL - HM DOOR JAMB AT NEW ADDITION
3" = 1'-0"

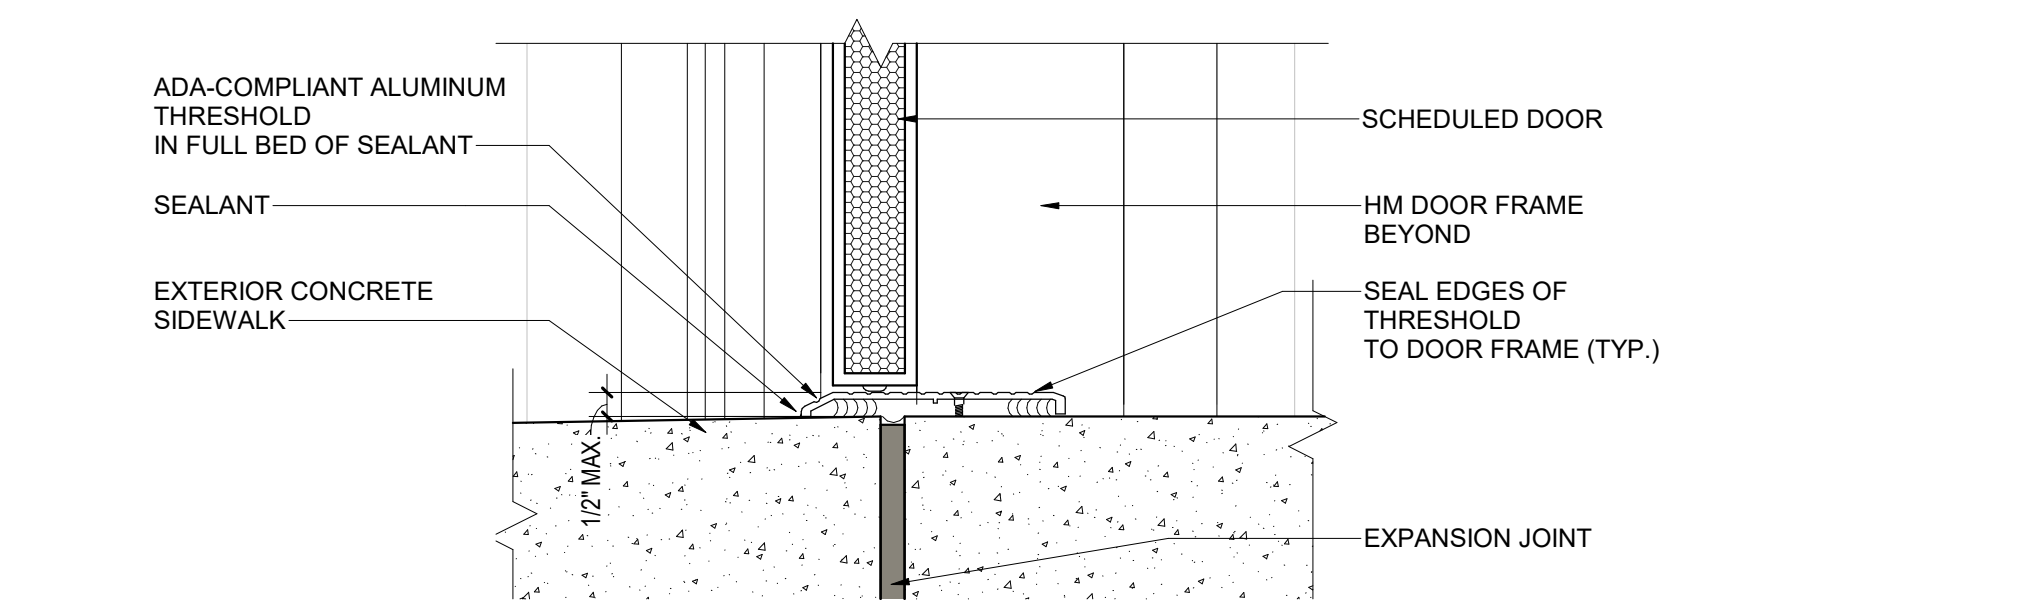


A1 DETAIL - DOOR SILL AT ADDITION
3" = 1'-0"

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
DOOR AND FRAME DETAILS		
DRAWING NO.		
A6.21		


WINDOW SCHEDULE - 1/4" = 1'-0"

ALUMINUM-FRAMED WINDOWS. EXTERIOR GLASS TO BE GL2. TYPICAL, UNLESS NOTED OTHERWISE. TEMPERED WHERE REQUIRED BY CODE.


F5 WINDOW PANNING - PERIMETER @ TYP. WINDOW 6" = 1'-0"

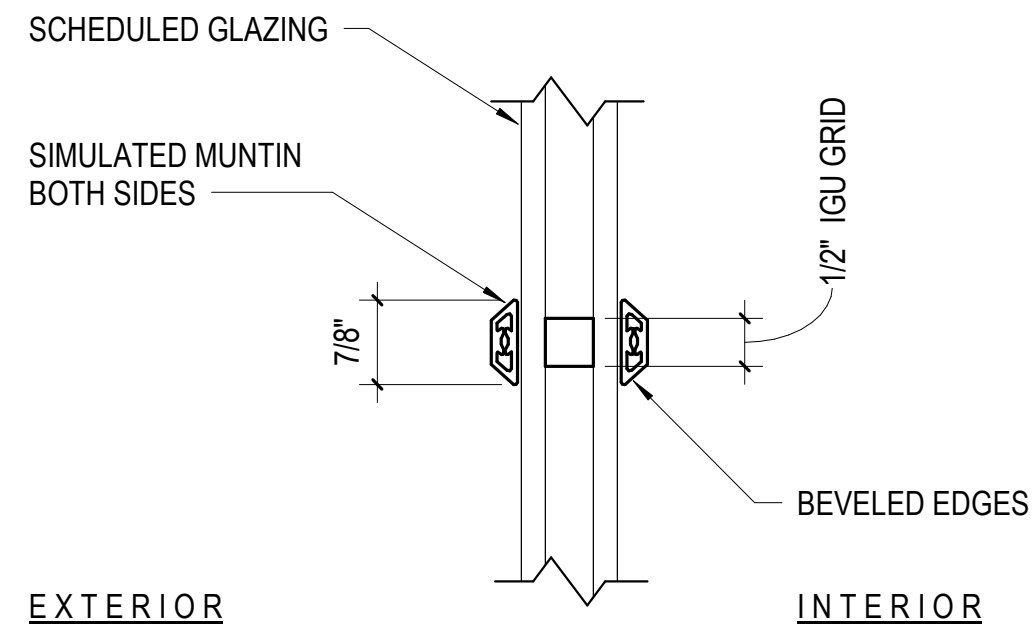


E5 SIMULATED MUNTIN GRIDS 6" = 1'-0"

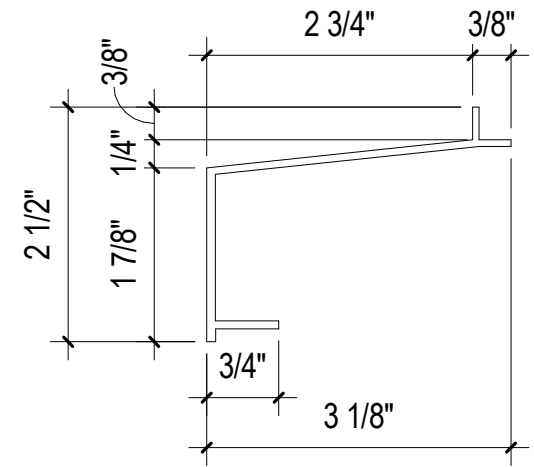

C5 WINDOW PANNING - SILL @ TYP. WINDOW 1 6" = 1'-0"

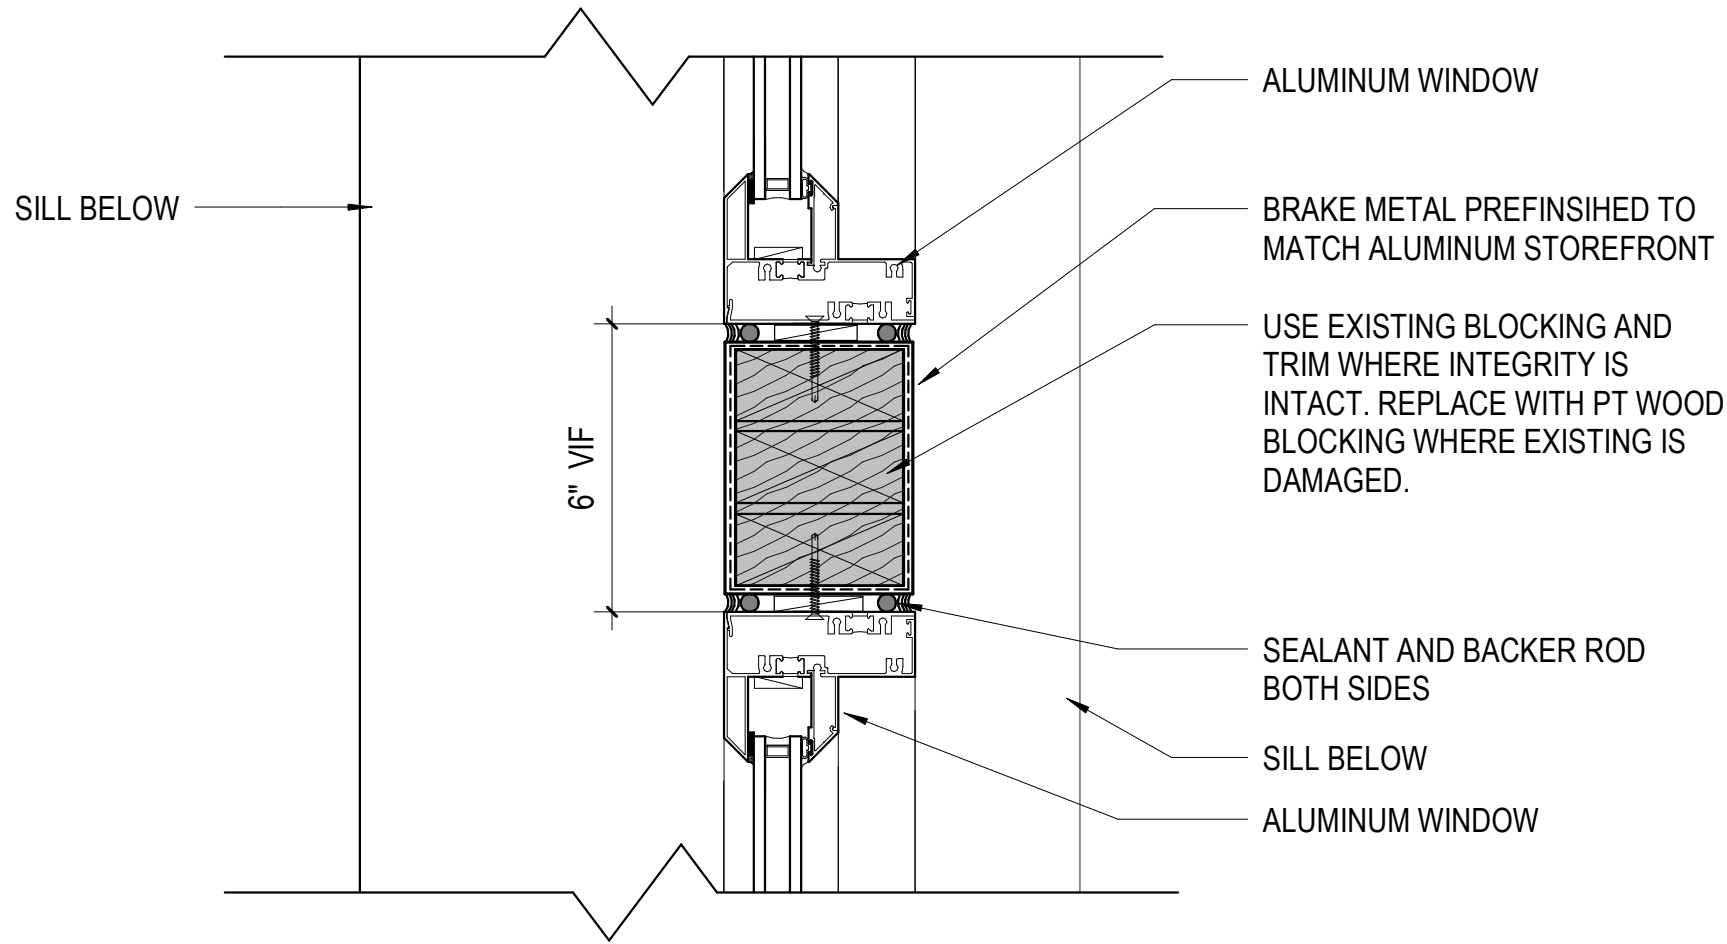

B5 DETAIL - TYPICAL CENTER MULLION 3" = 1'-0"

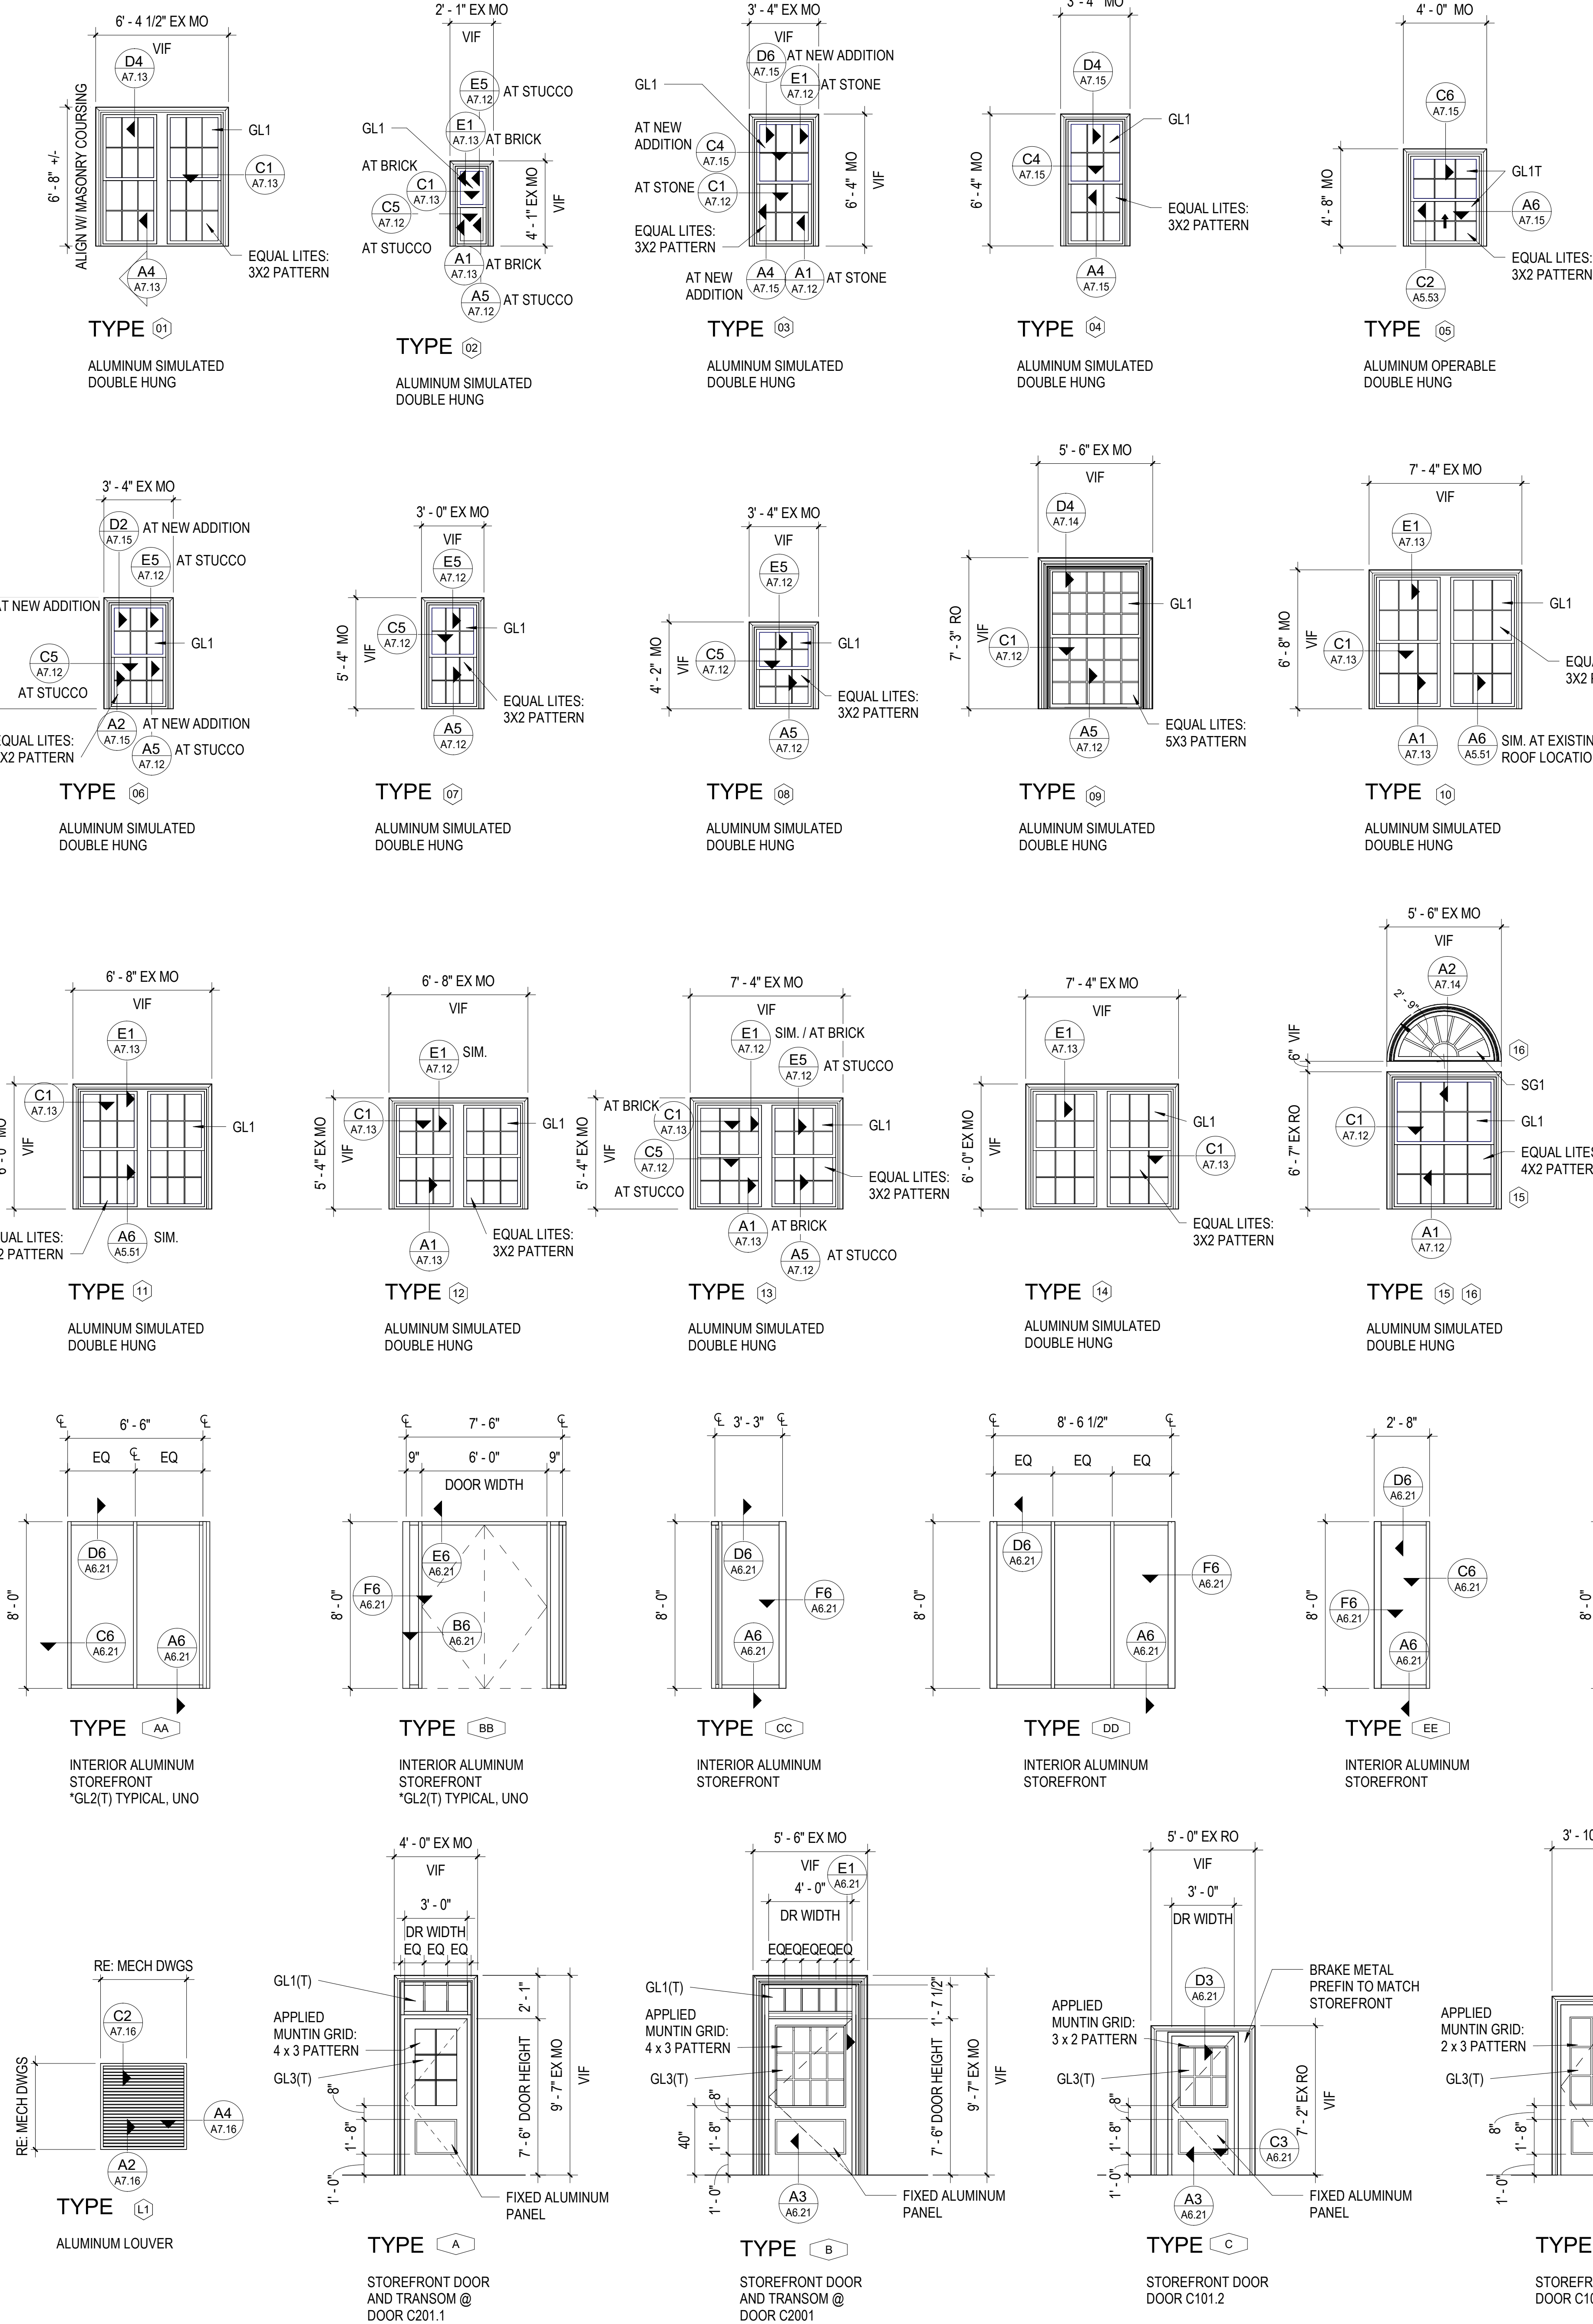


GLAZING GENERAL NOTES

- FIELD VERIFY OPENINGS PRIOR TO MAKING GLASS AND FABRICATING FRAMES.
- WINDOW AND DOOR DIMENSIONS SHOWN ARE NOMINAL. ACTUAL DIMENSIONS SHALL BE BASED ON REQUIREMENTS OF THE HEAD, JAMB, AND SILL DETAILS AND FIELD VERIFICATION OF BUILT ROUGH OPENINGS.
- REFER TO DOOR SCHEDULE ON A6.11 FOR DOOR TYPES AND GLAZING IN DOORS SHOWN WITH SIDE LITES.
- REFER TO PLANS A1.11-A1.13 AND ELEVATIONS A2.01-A2.02 FOR WINDOW LOCATIONS.
- REFERENCE DOOR SCHEDULE FOR ADDITIONAL FRAME REFERENCES AT DOOR OPENINGS.
- REFERENCE WALL SECTIONS AND RELATED DETAILS FOR ADDITIONAL FRAME DETAILS.
- REFER TO PARTITION TYPE THAT WINDOW IS LOCATED IN FOR HOLLOW METAL FRAME FIRE RATING UNLESS OTHERWISE SHOWN ON THESE WINDOW ELEVATIONS.
- ALL INTERIOR GLASS DOOR LITES, GLASS SIDE LITES, AND GLAZING GREATER THAN 9 SF, WITH THE TOP EDGE GREATER THAN 36" ABOVE FINISHED FLOOR AND THE BOTTOM EDGE LESS THAN 18" BELOW FINISHED FLOOR, ETC. SHALL BE TEMPERED GLASS PER 2021 IBC SECTION 2406.4 HAZARDOUS LOCATIONS.

GLASS SCHEDULE

TYPE MARK	DESCRIPTION
T(T)	TEMPERED GLASS
GL1	1" INSULATED LOW-E GLASS
GL2	1/4" MONOLITHIC CLEAR GLASS
GL3	3/4" INSULATED LOW-E GLASS (AT EXTERIOR DOORS, TYPICAL)
SG1	1" INSULATED SPANDREL GLASS (MATCH GL1)

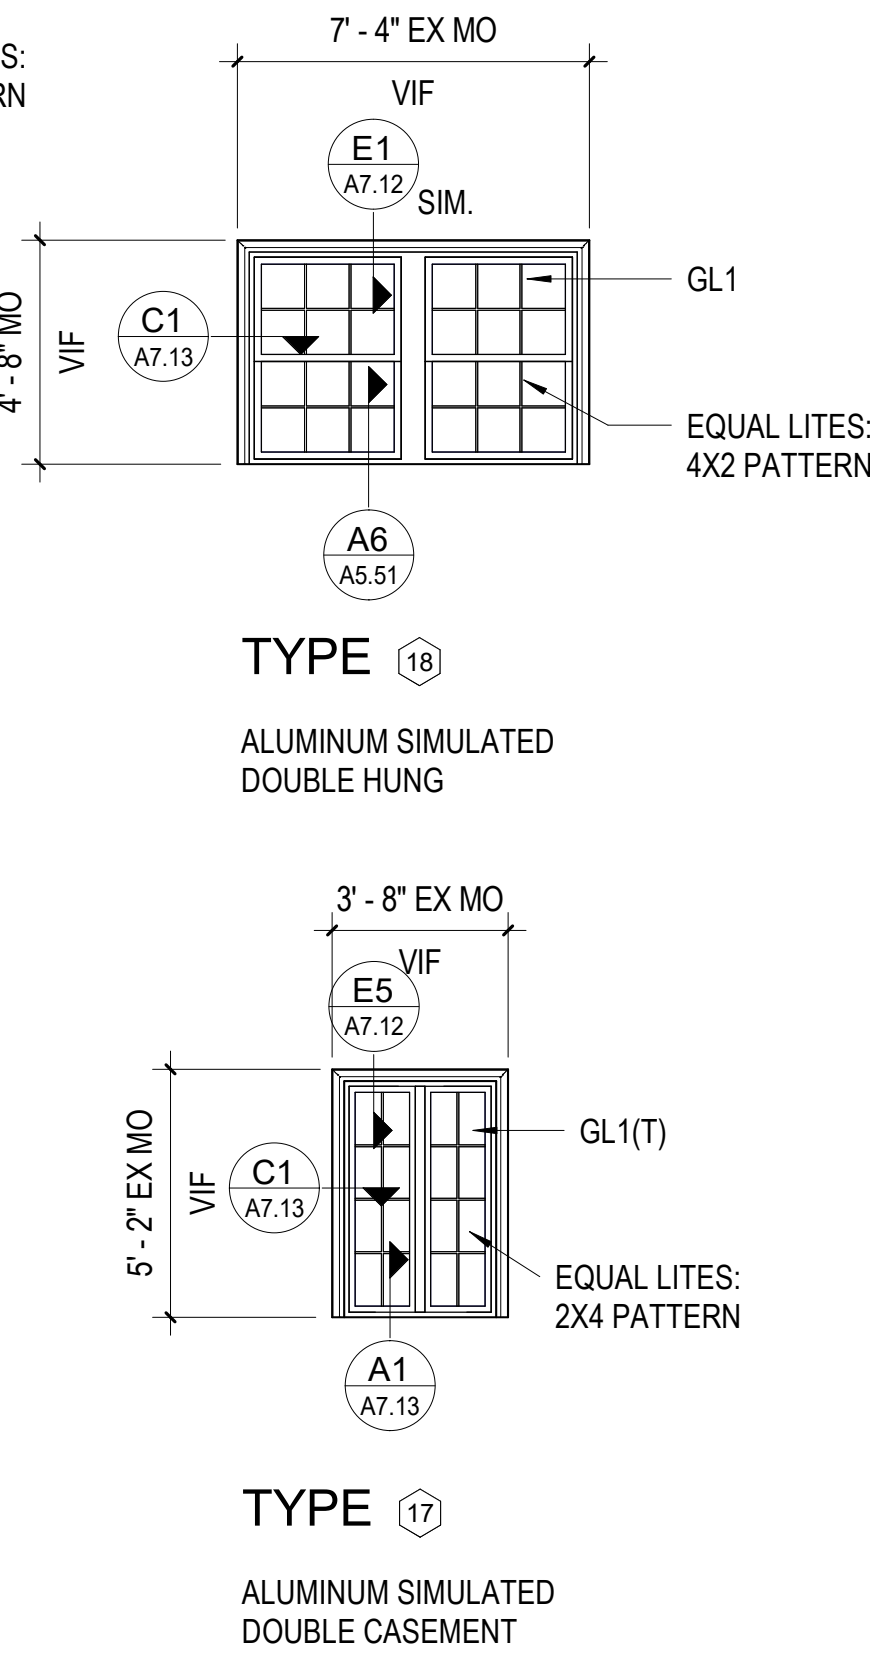

K|P|S

GROUP

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER:
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS:
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

Table with 3 columns: No., Description, Date

DRAWING TITLE

SCHEDULE - WINDOWS / LOUVERS / STOREFRONT

DRAWN BY: Author


CHECKED BY: Checker

PROJECT NUMBER


236002-02

DRAWING NO


A7.11

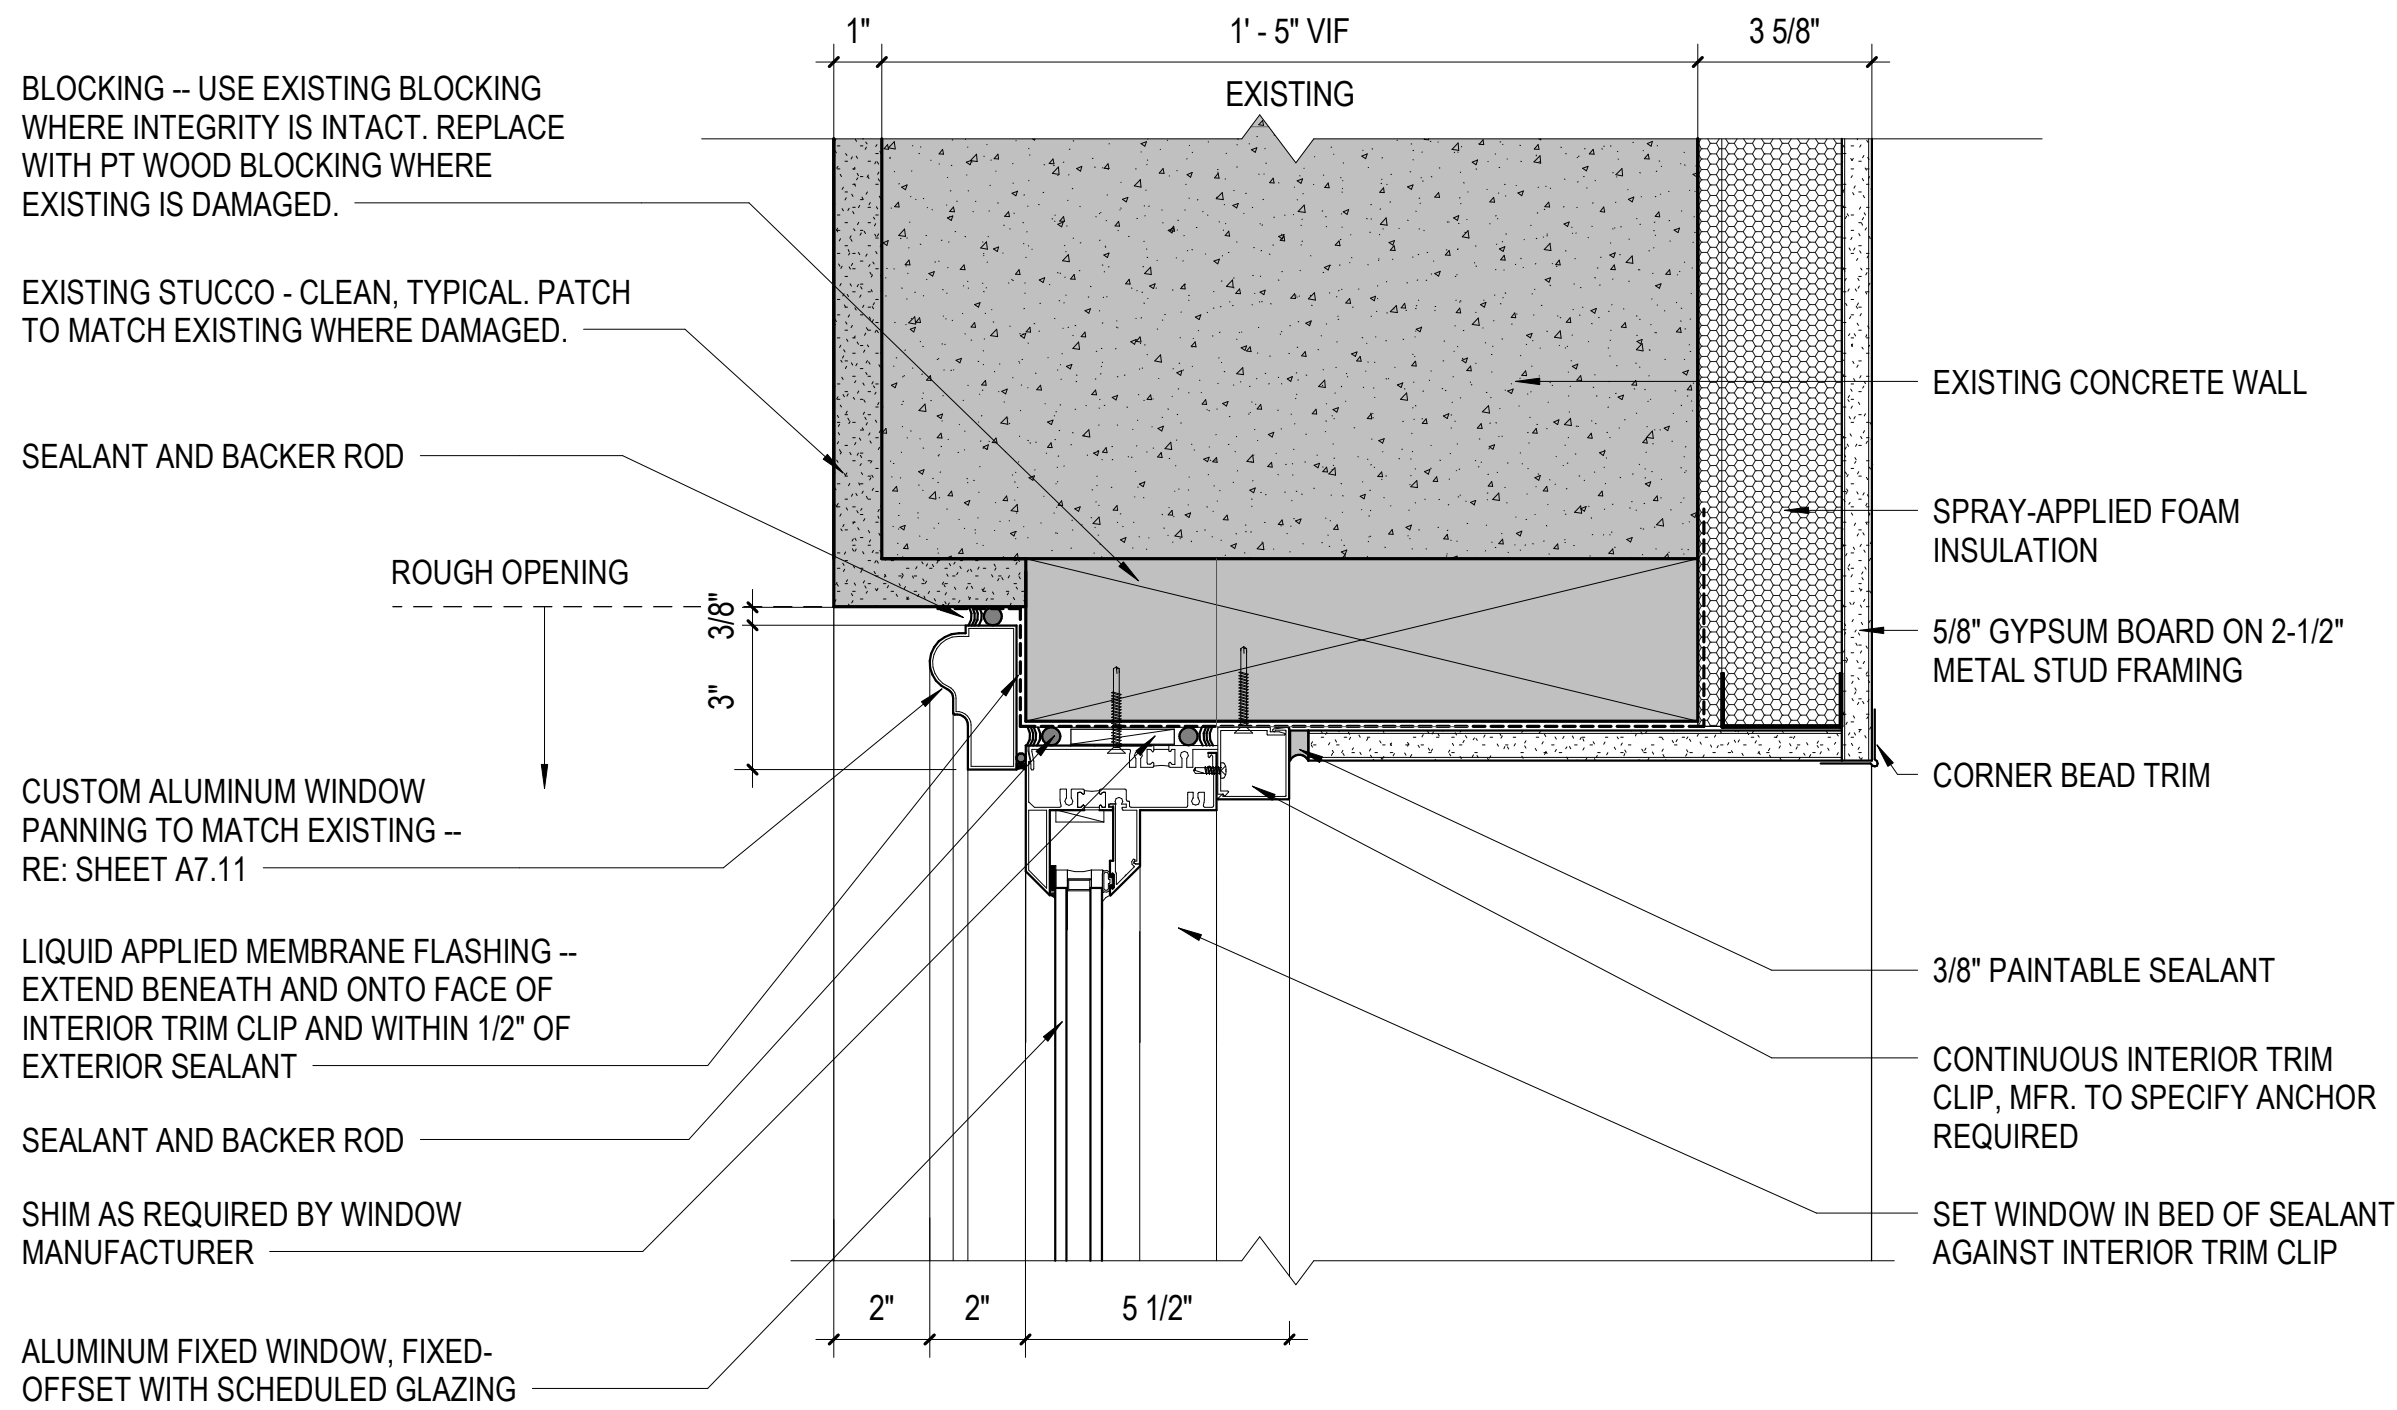


E5 DETAIL - HEAD AT EXISTING STUCCO
3" = 1'-0"

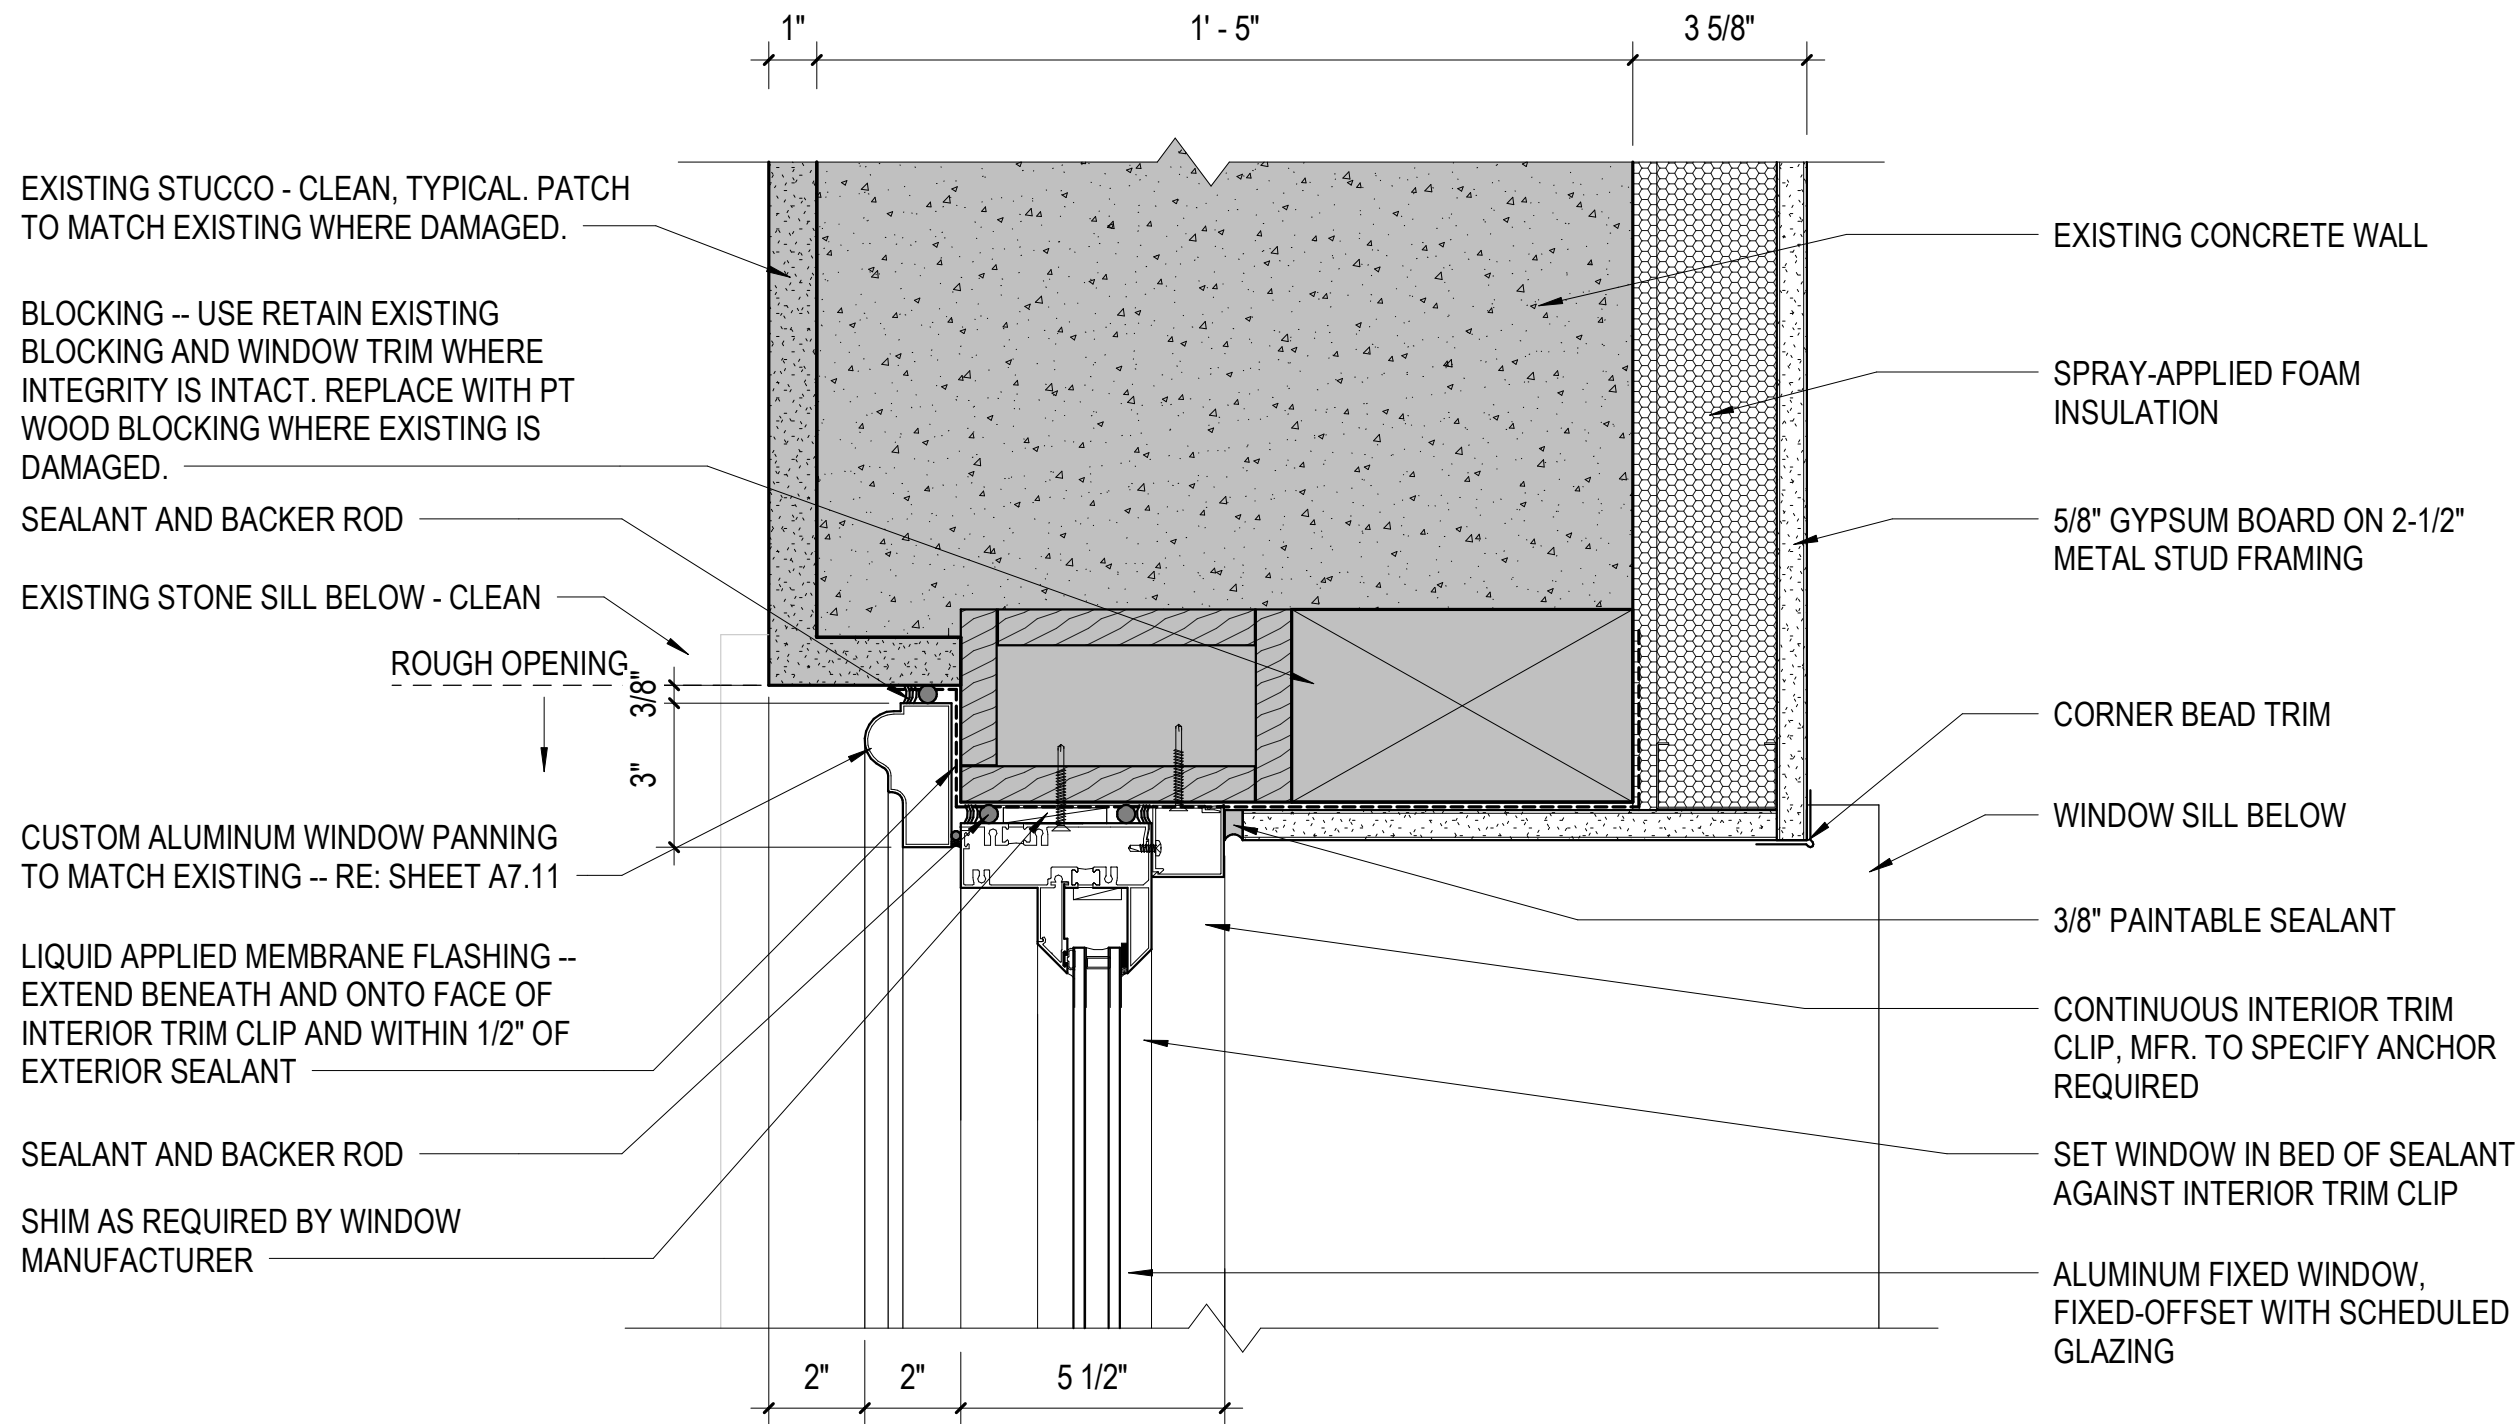


C5 DETAIL - JAMB AT EXISTING STUCCO
3" = 1'-0"

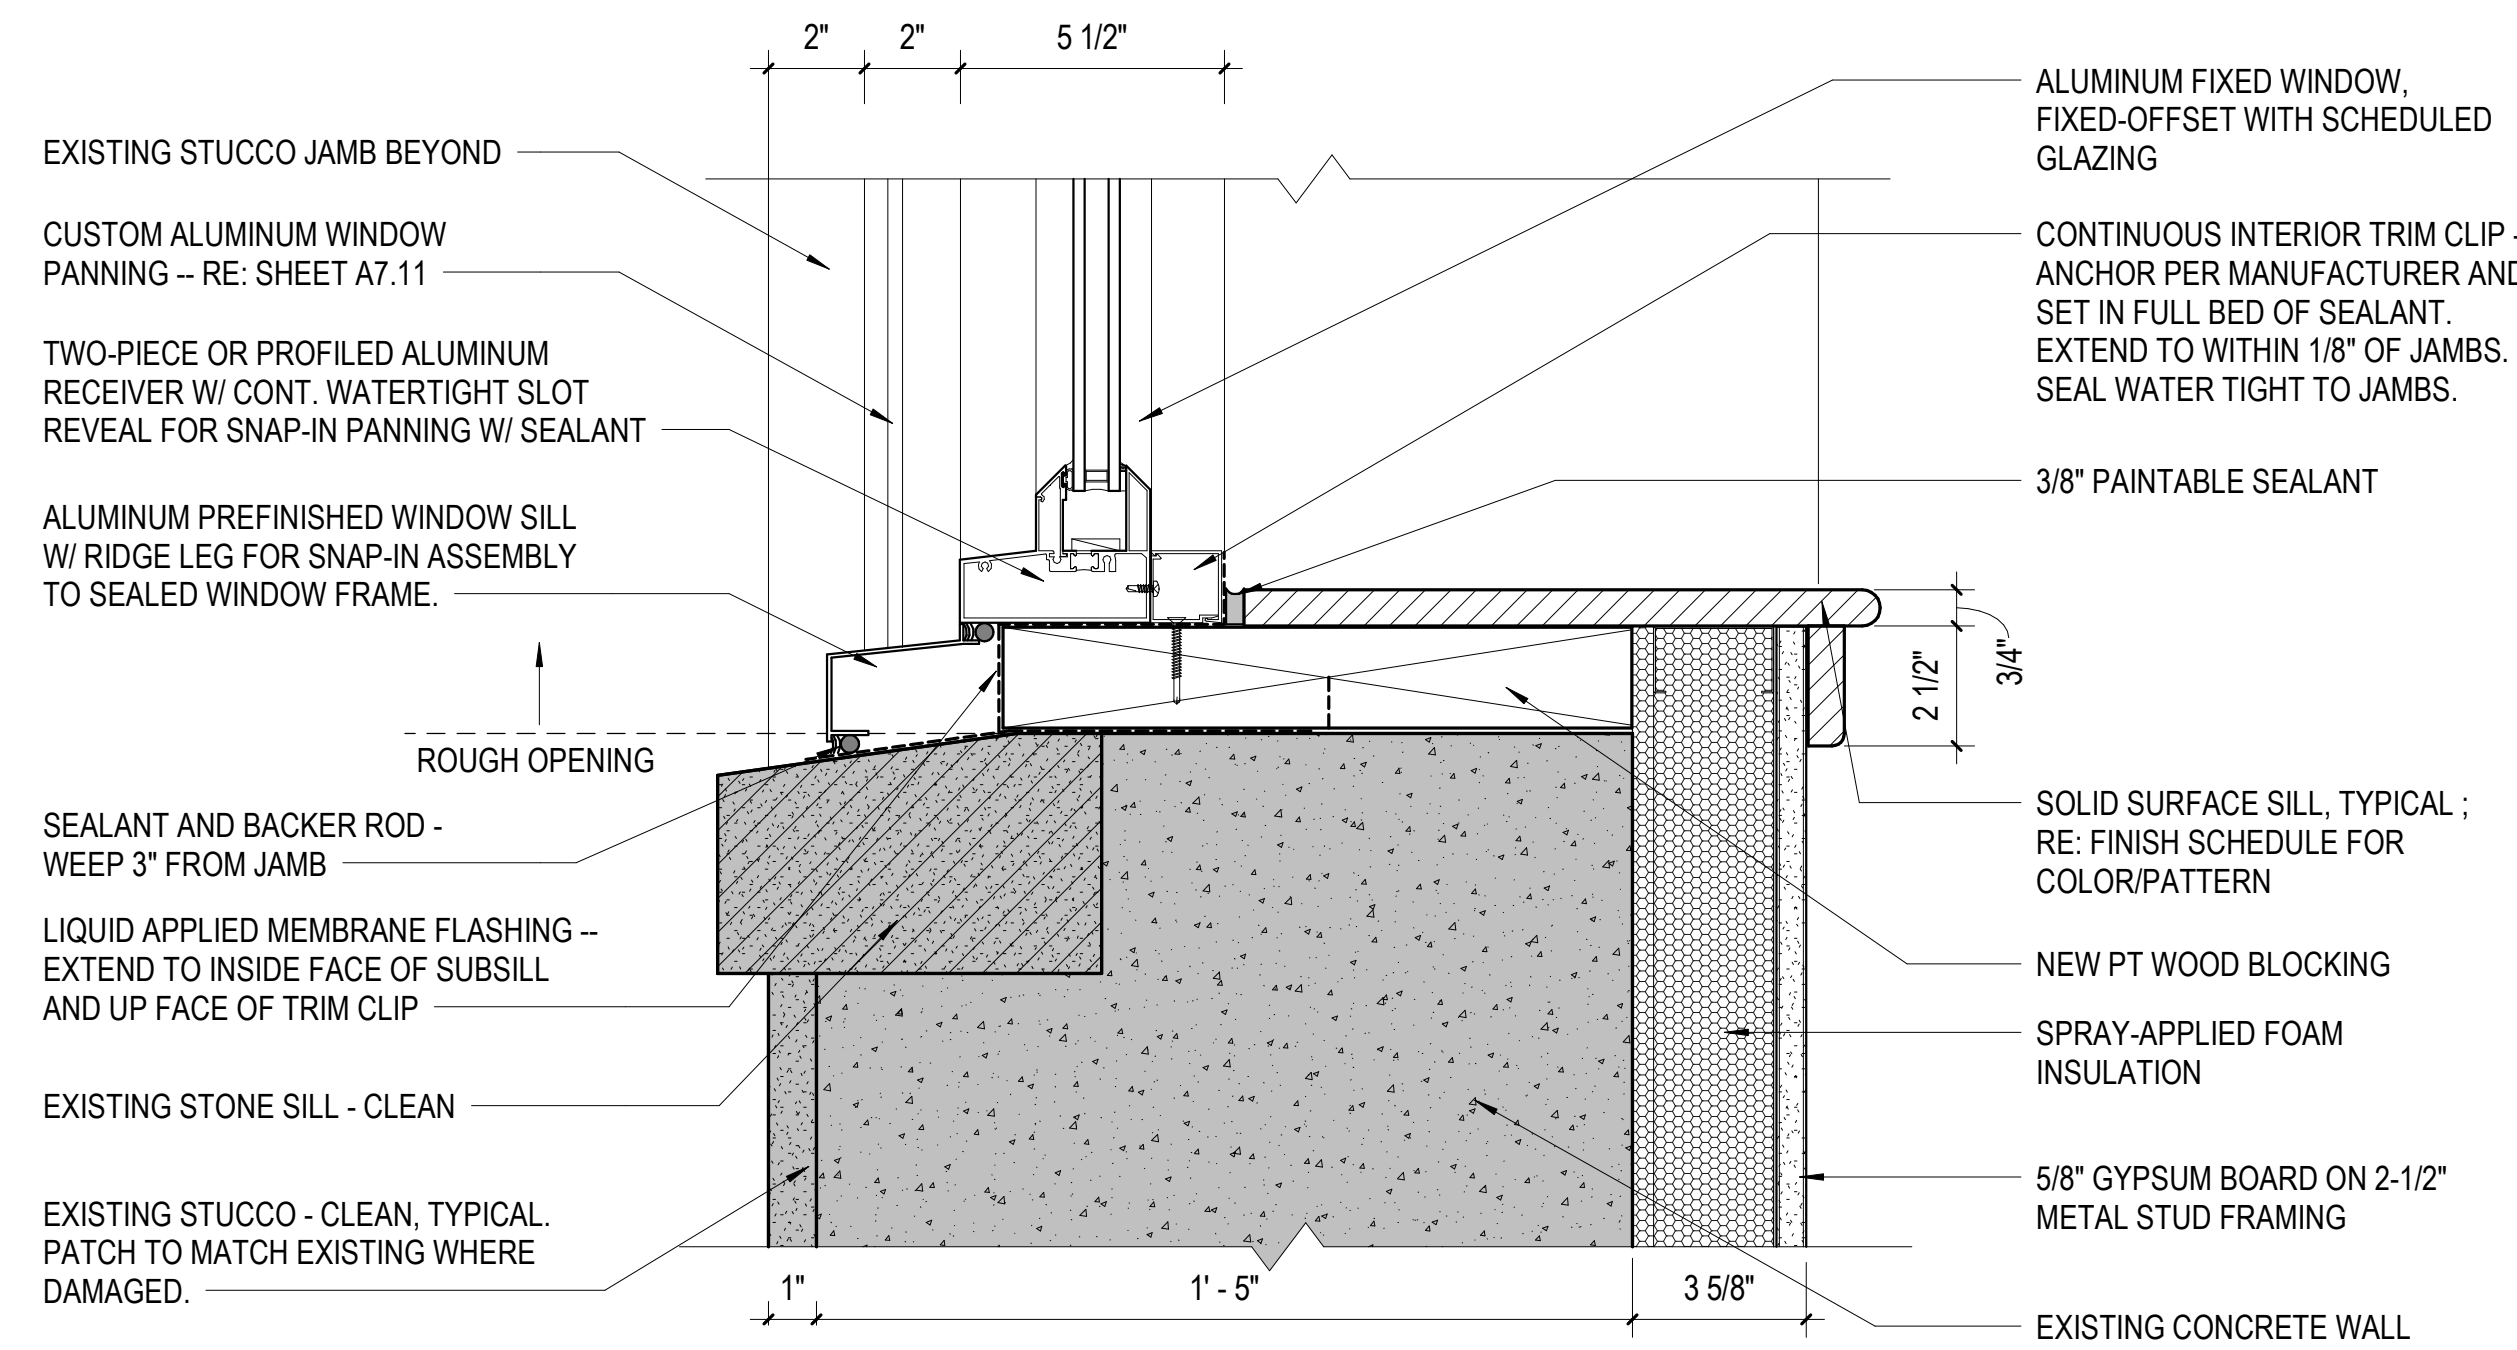


A5 DETAIL - SILL AT EXISTING STUCCO
3" = 1'-0"

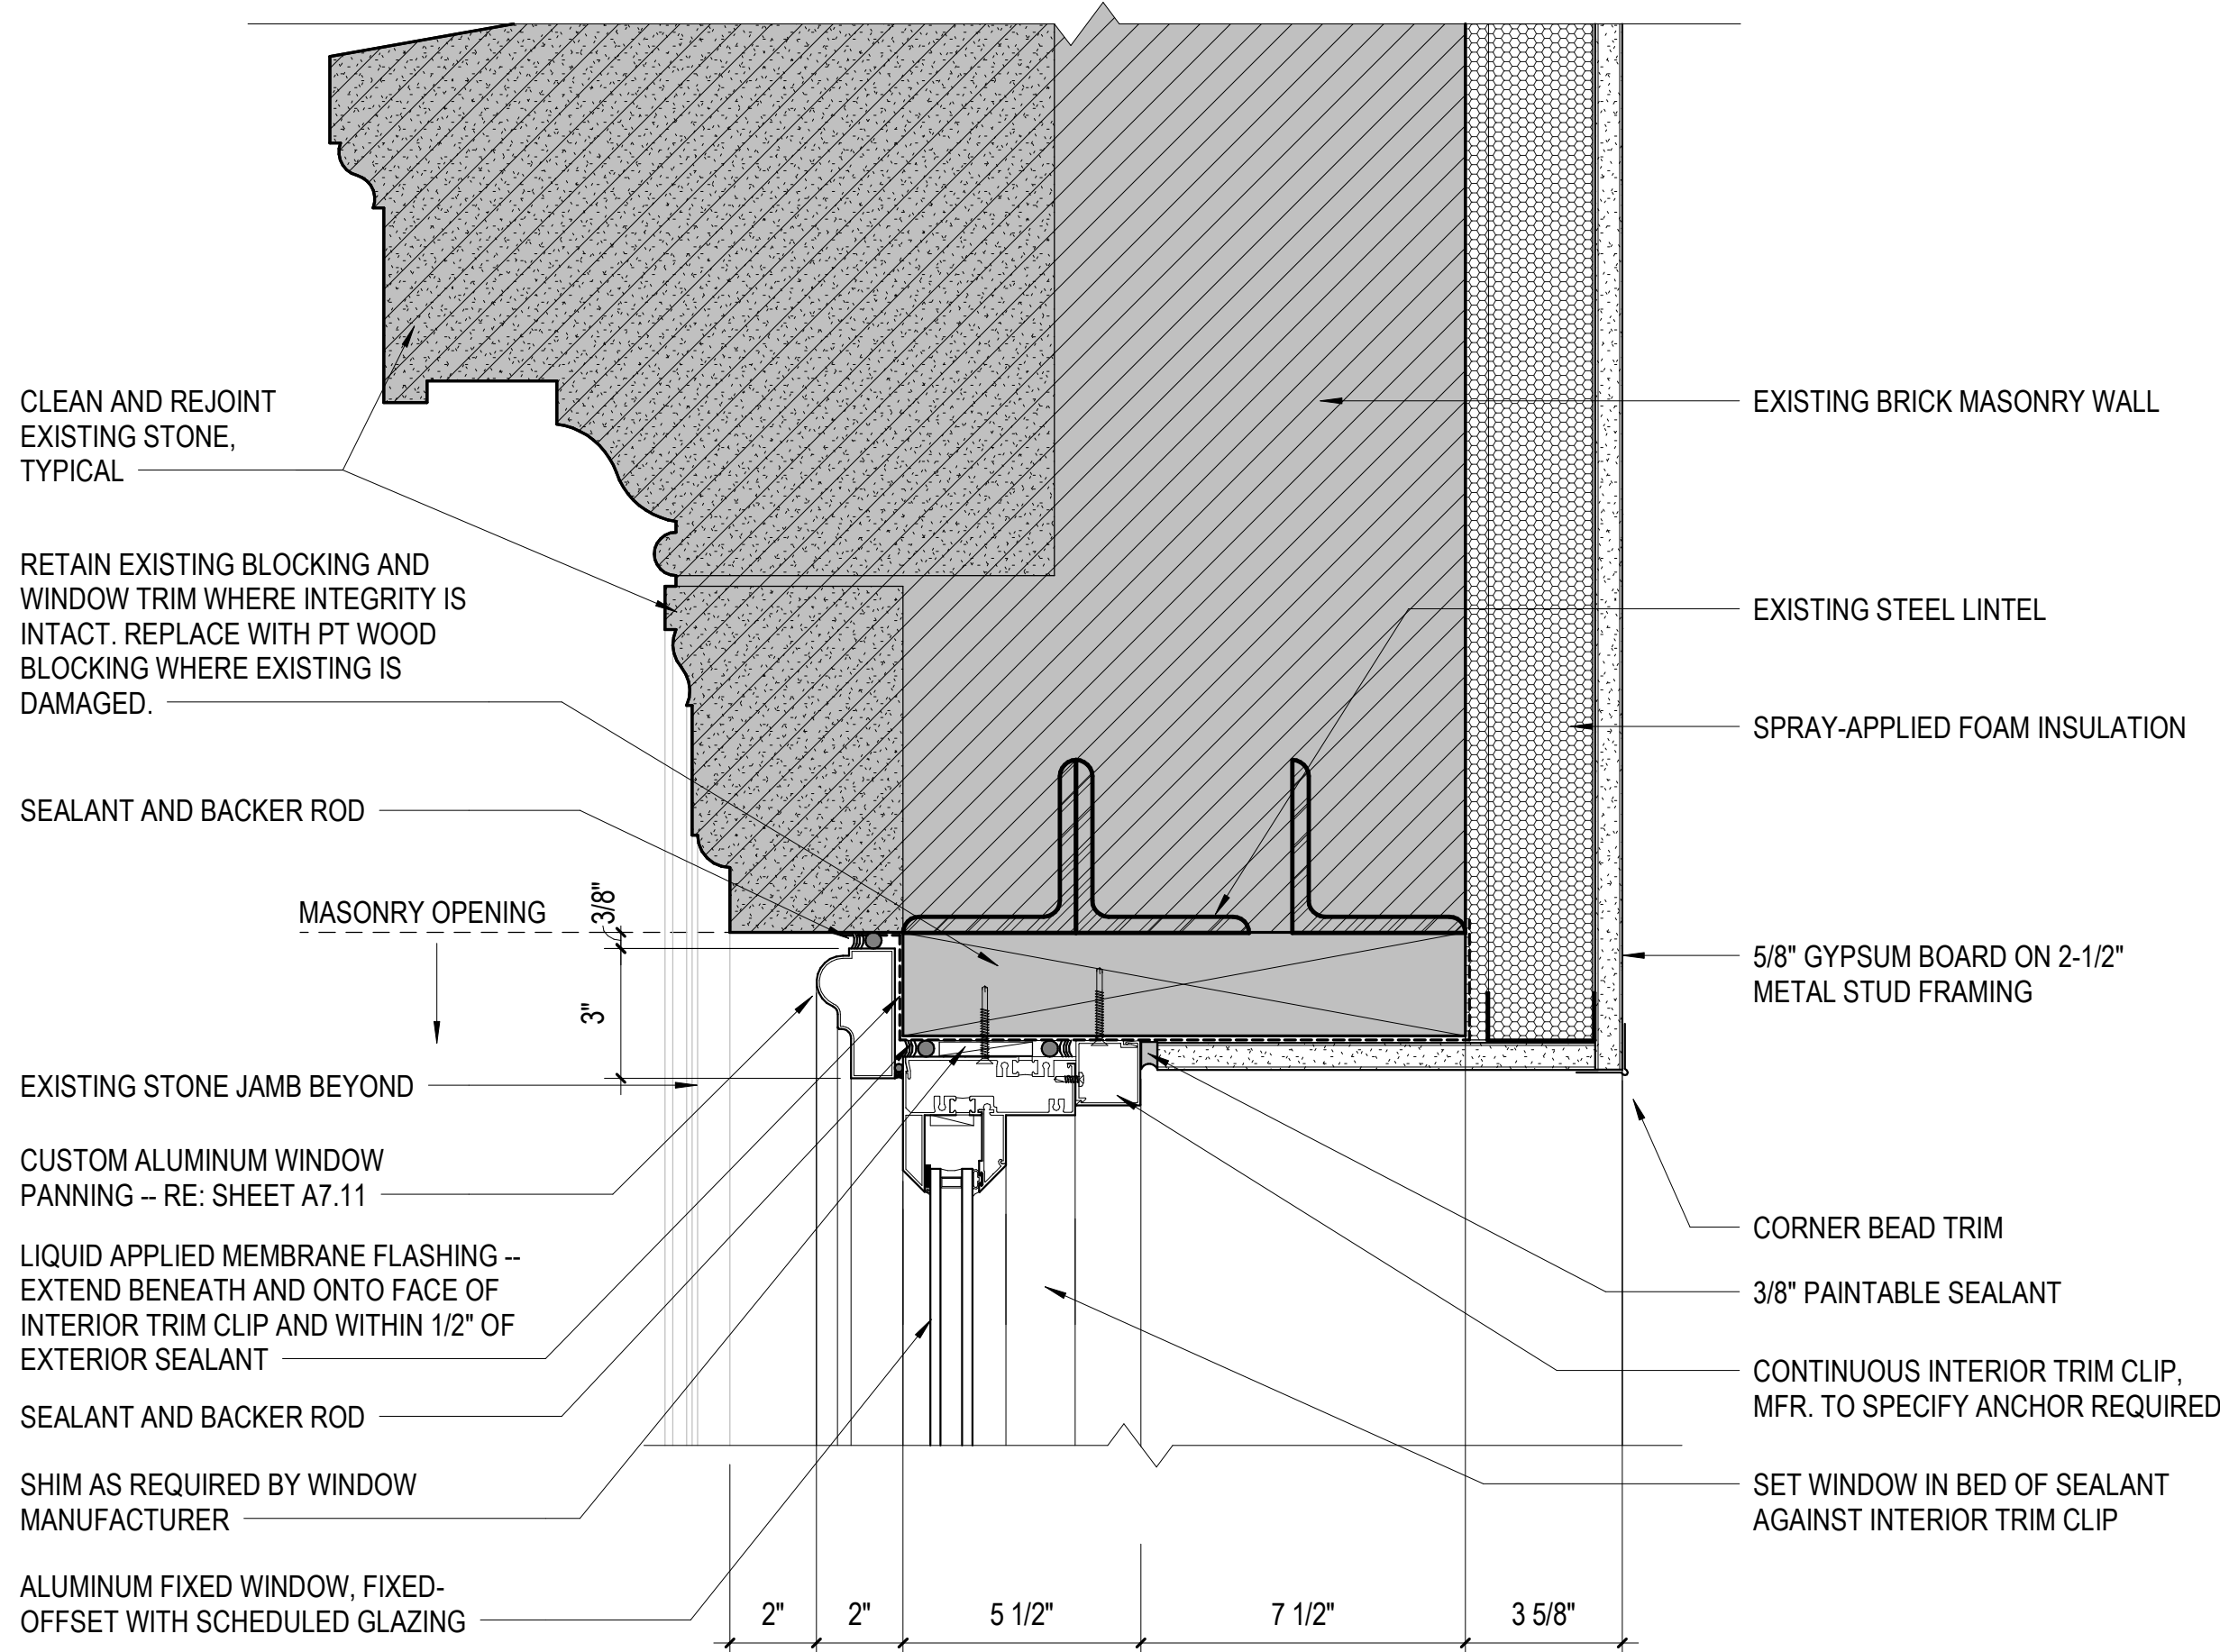

E1 DETAIL - HEAD AT EXISTING STONE
3" = 1'-0"

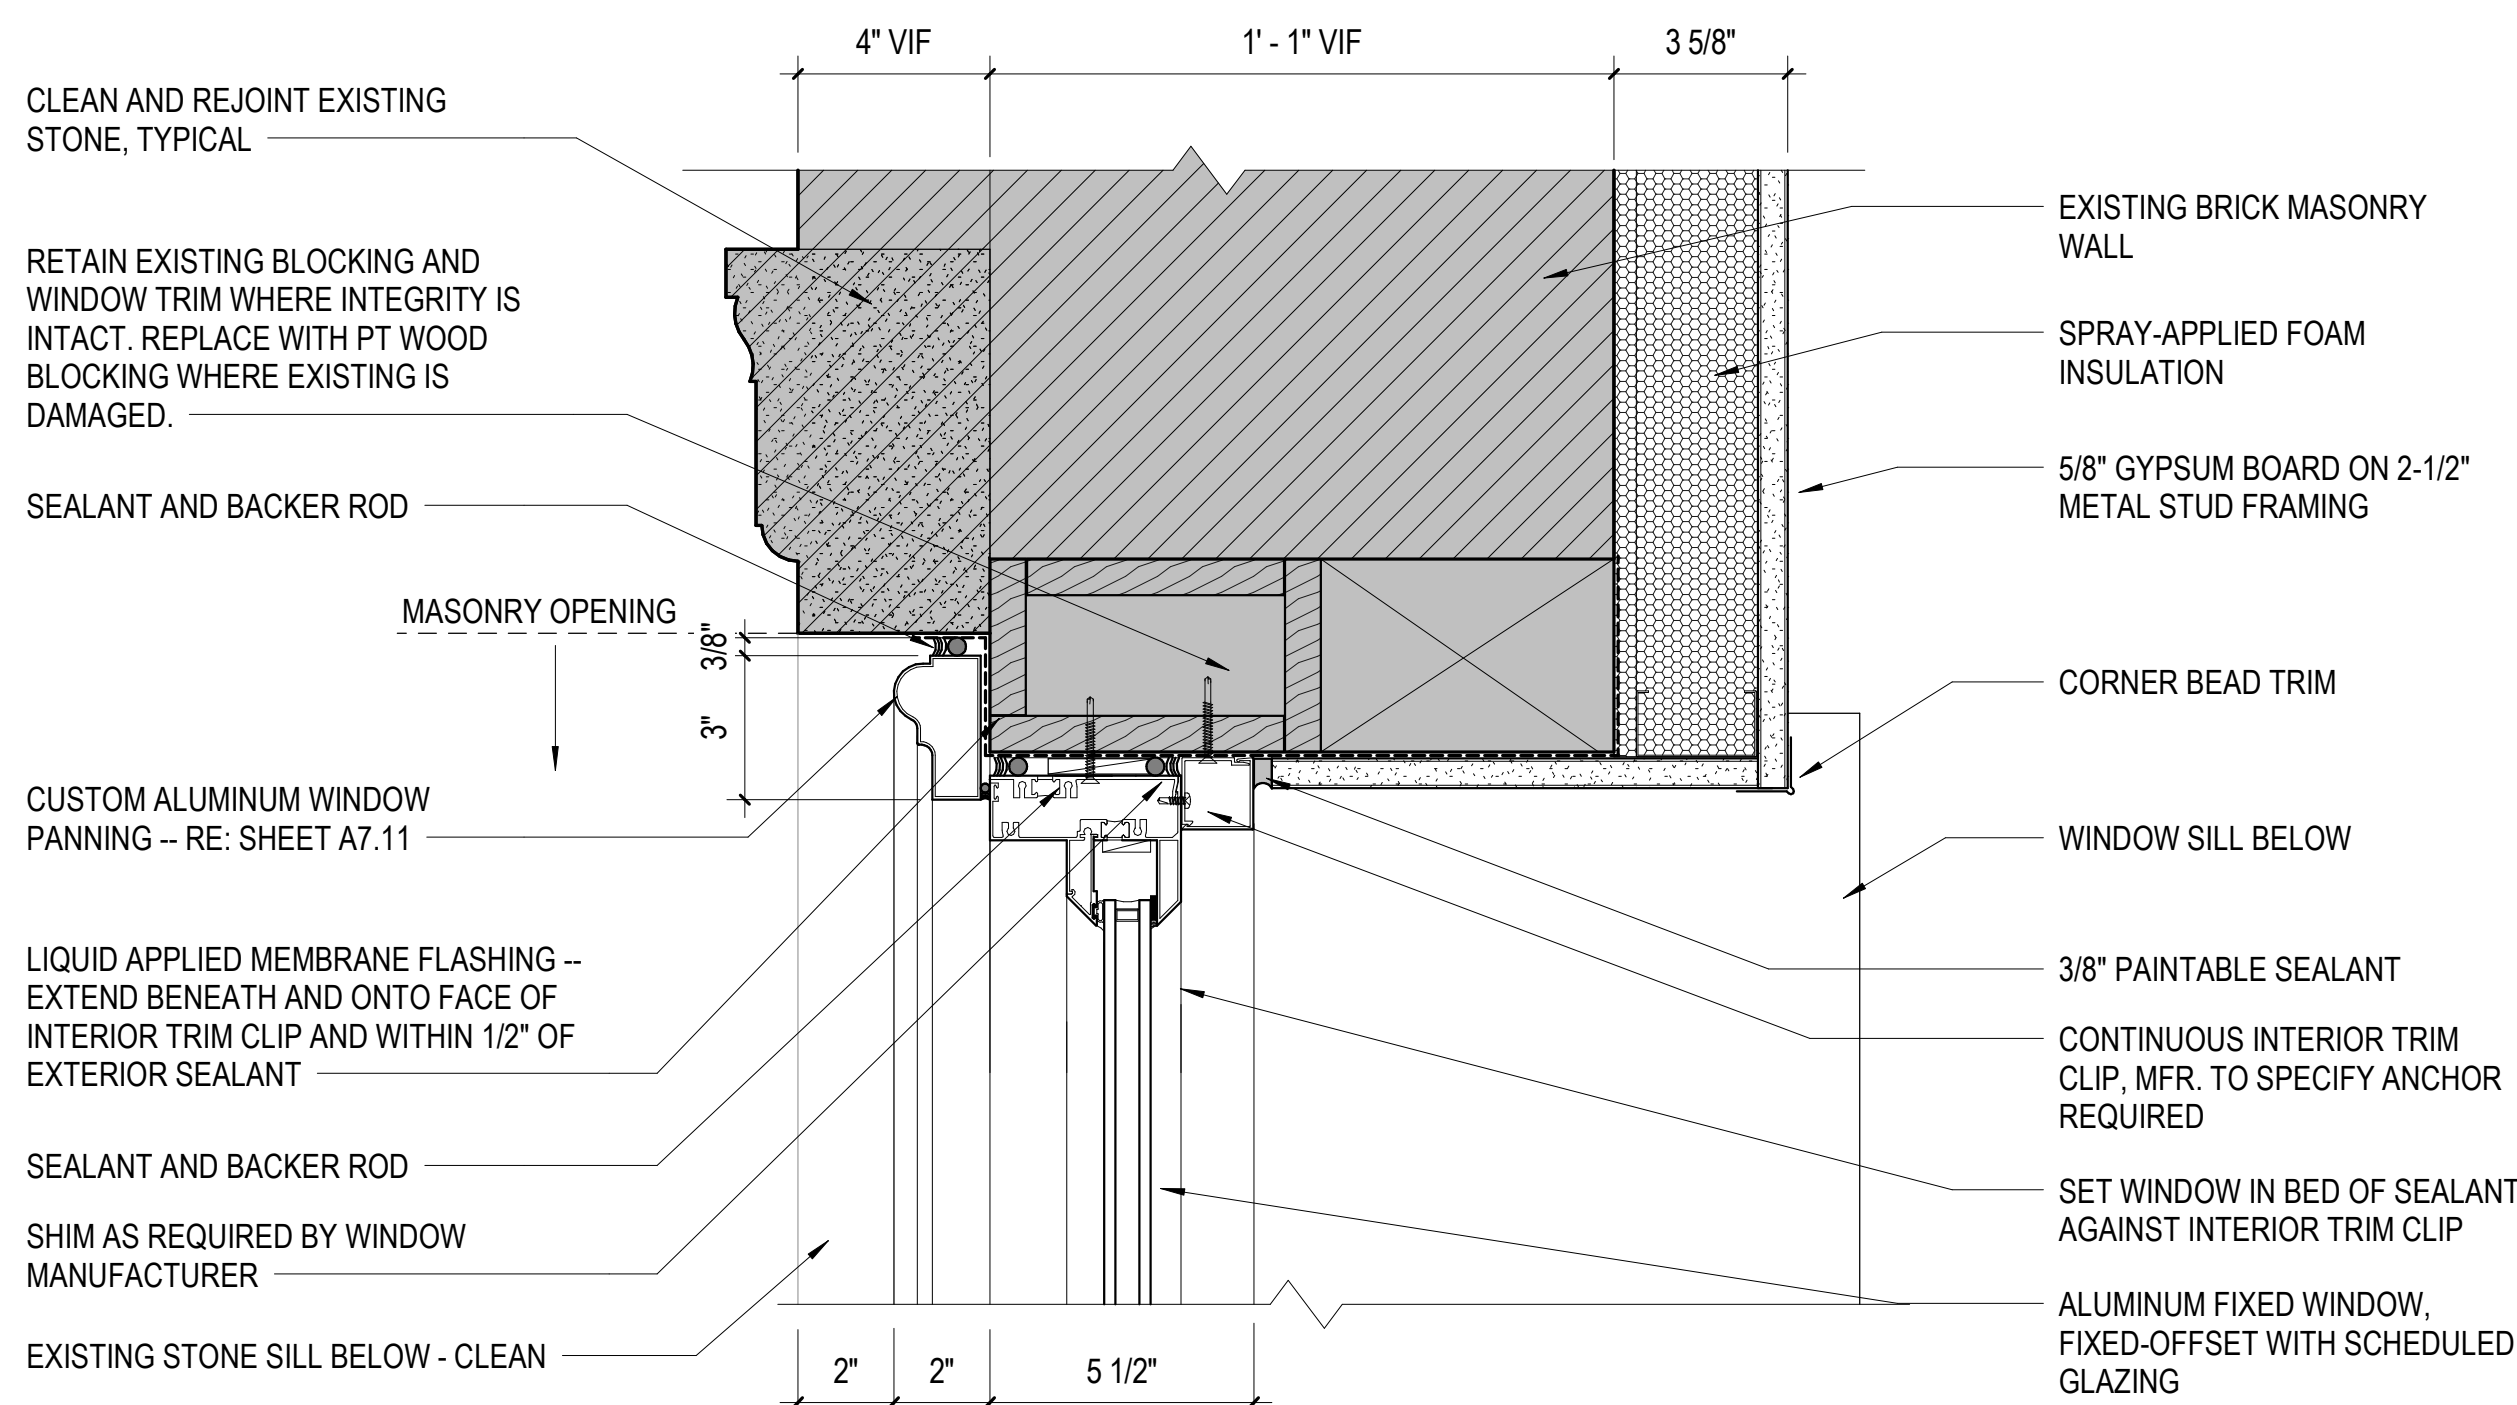


C1 DETAIL - JAMB AT EXISTING STONE
3" = 1'-0"

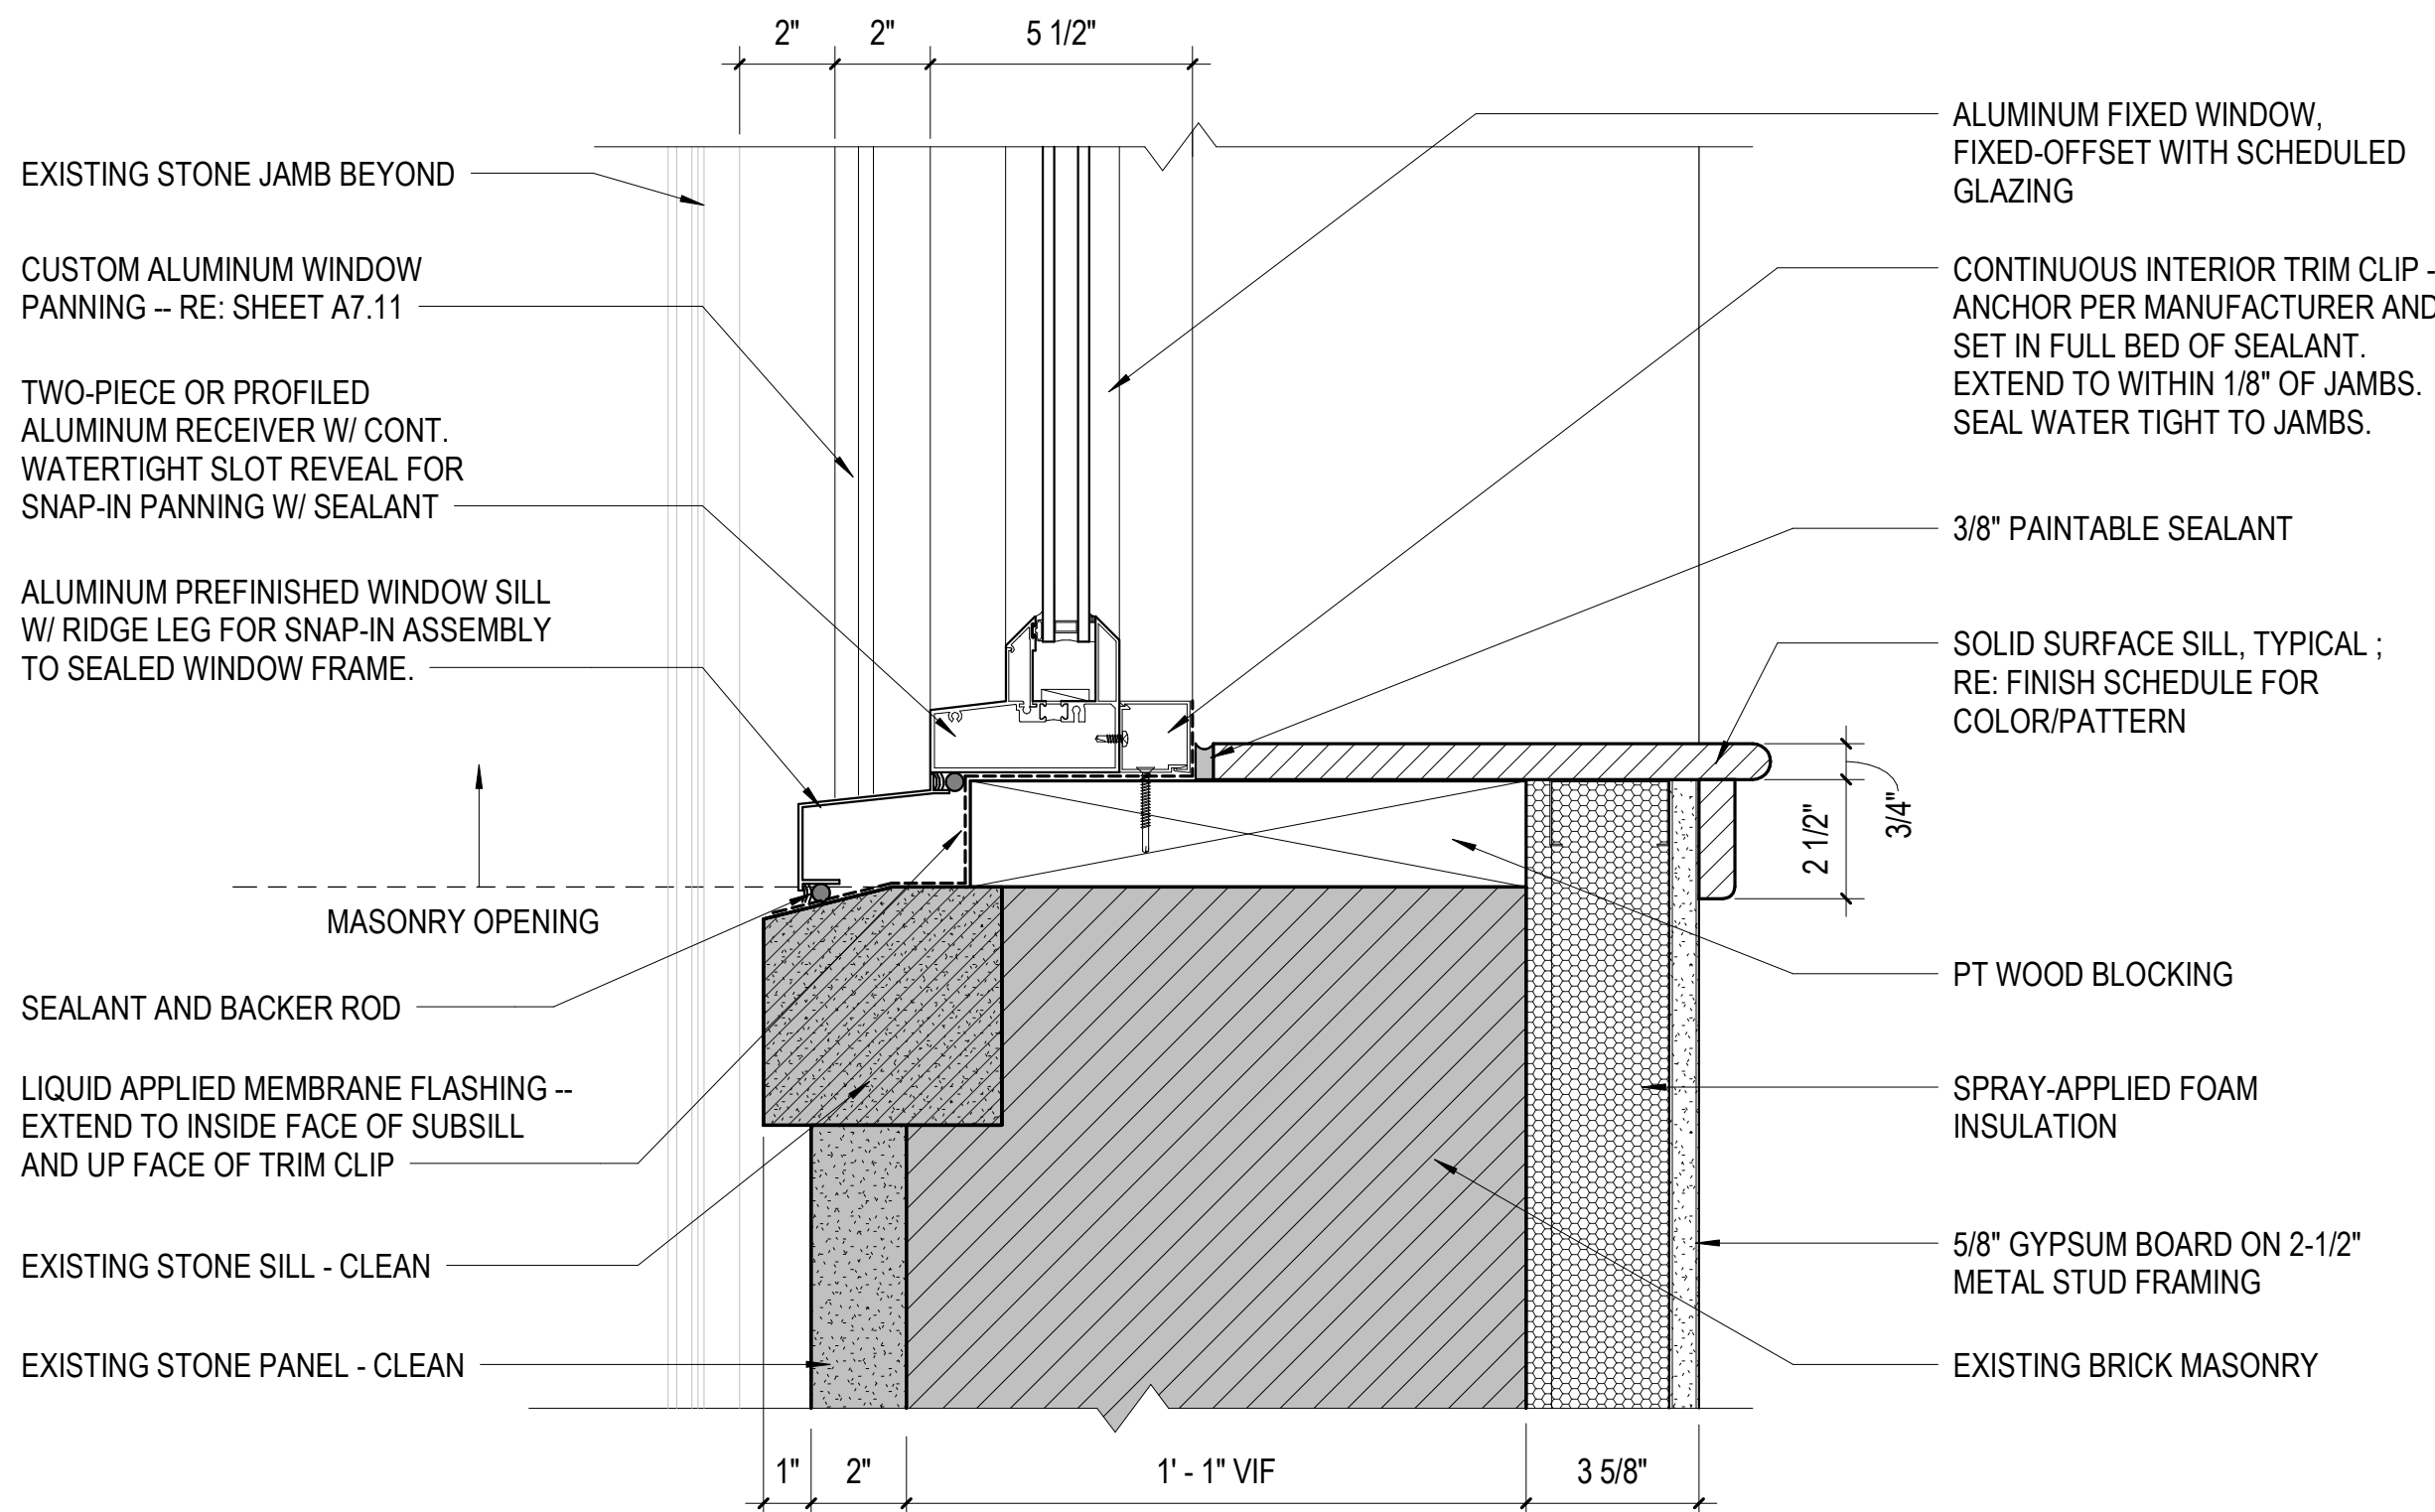


A1 DETAIL - SILL AT EXISTING STONE
3" = 1'-0"


PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date
DRAWING TITLE		
WINDOW DETAILS		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A7.12		

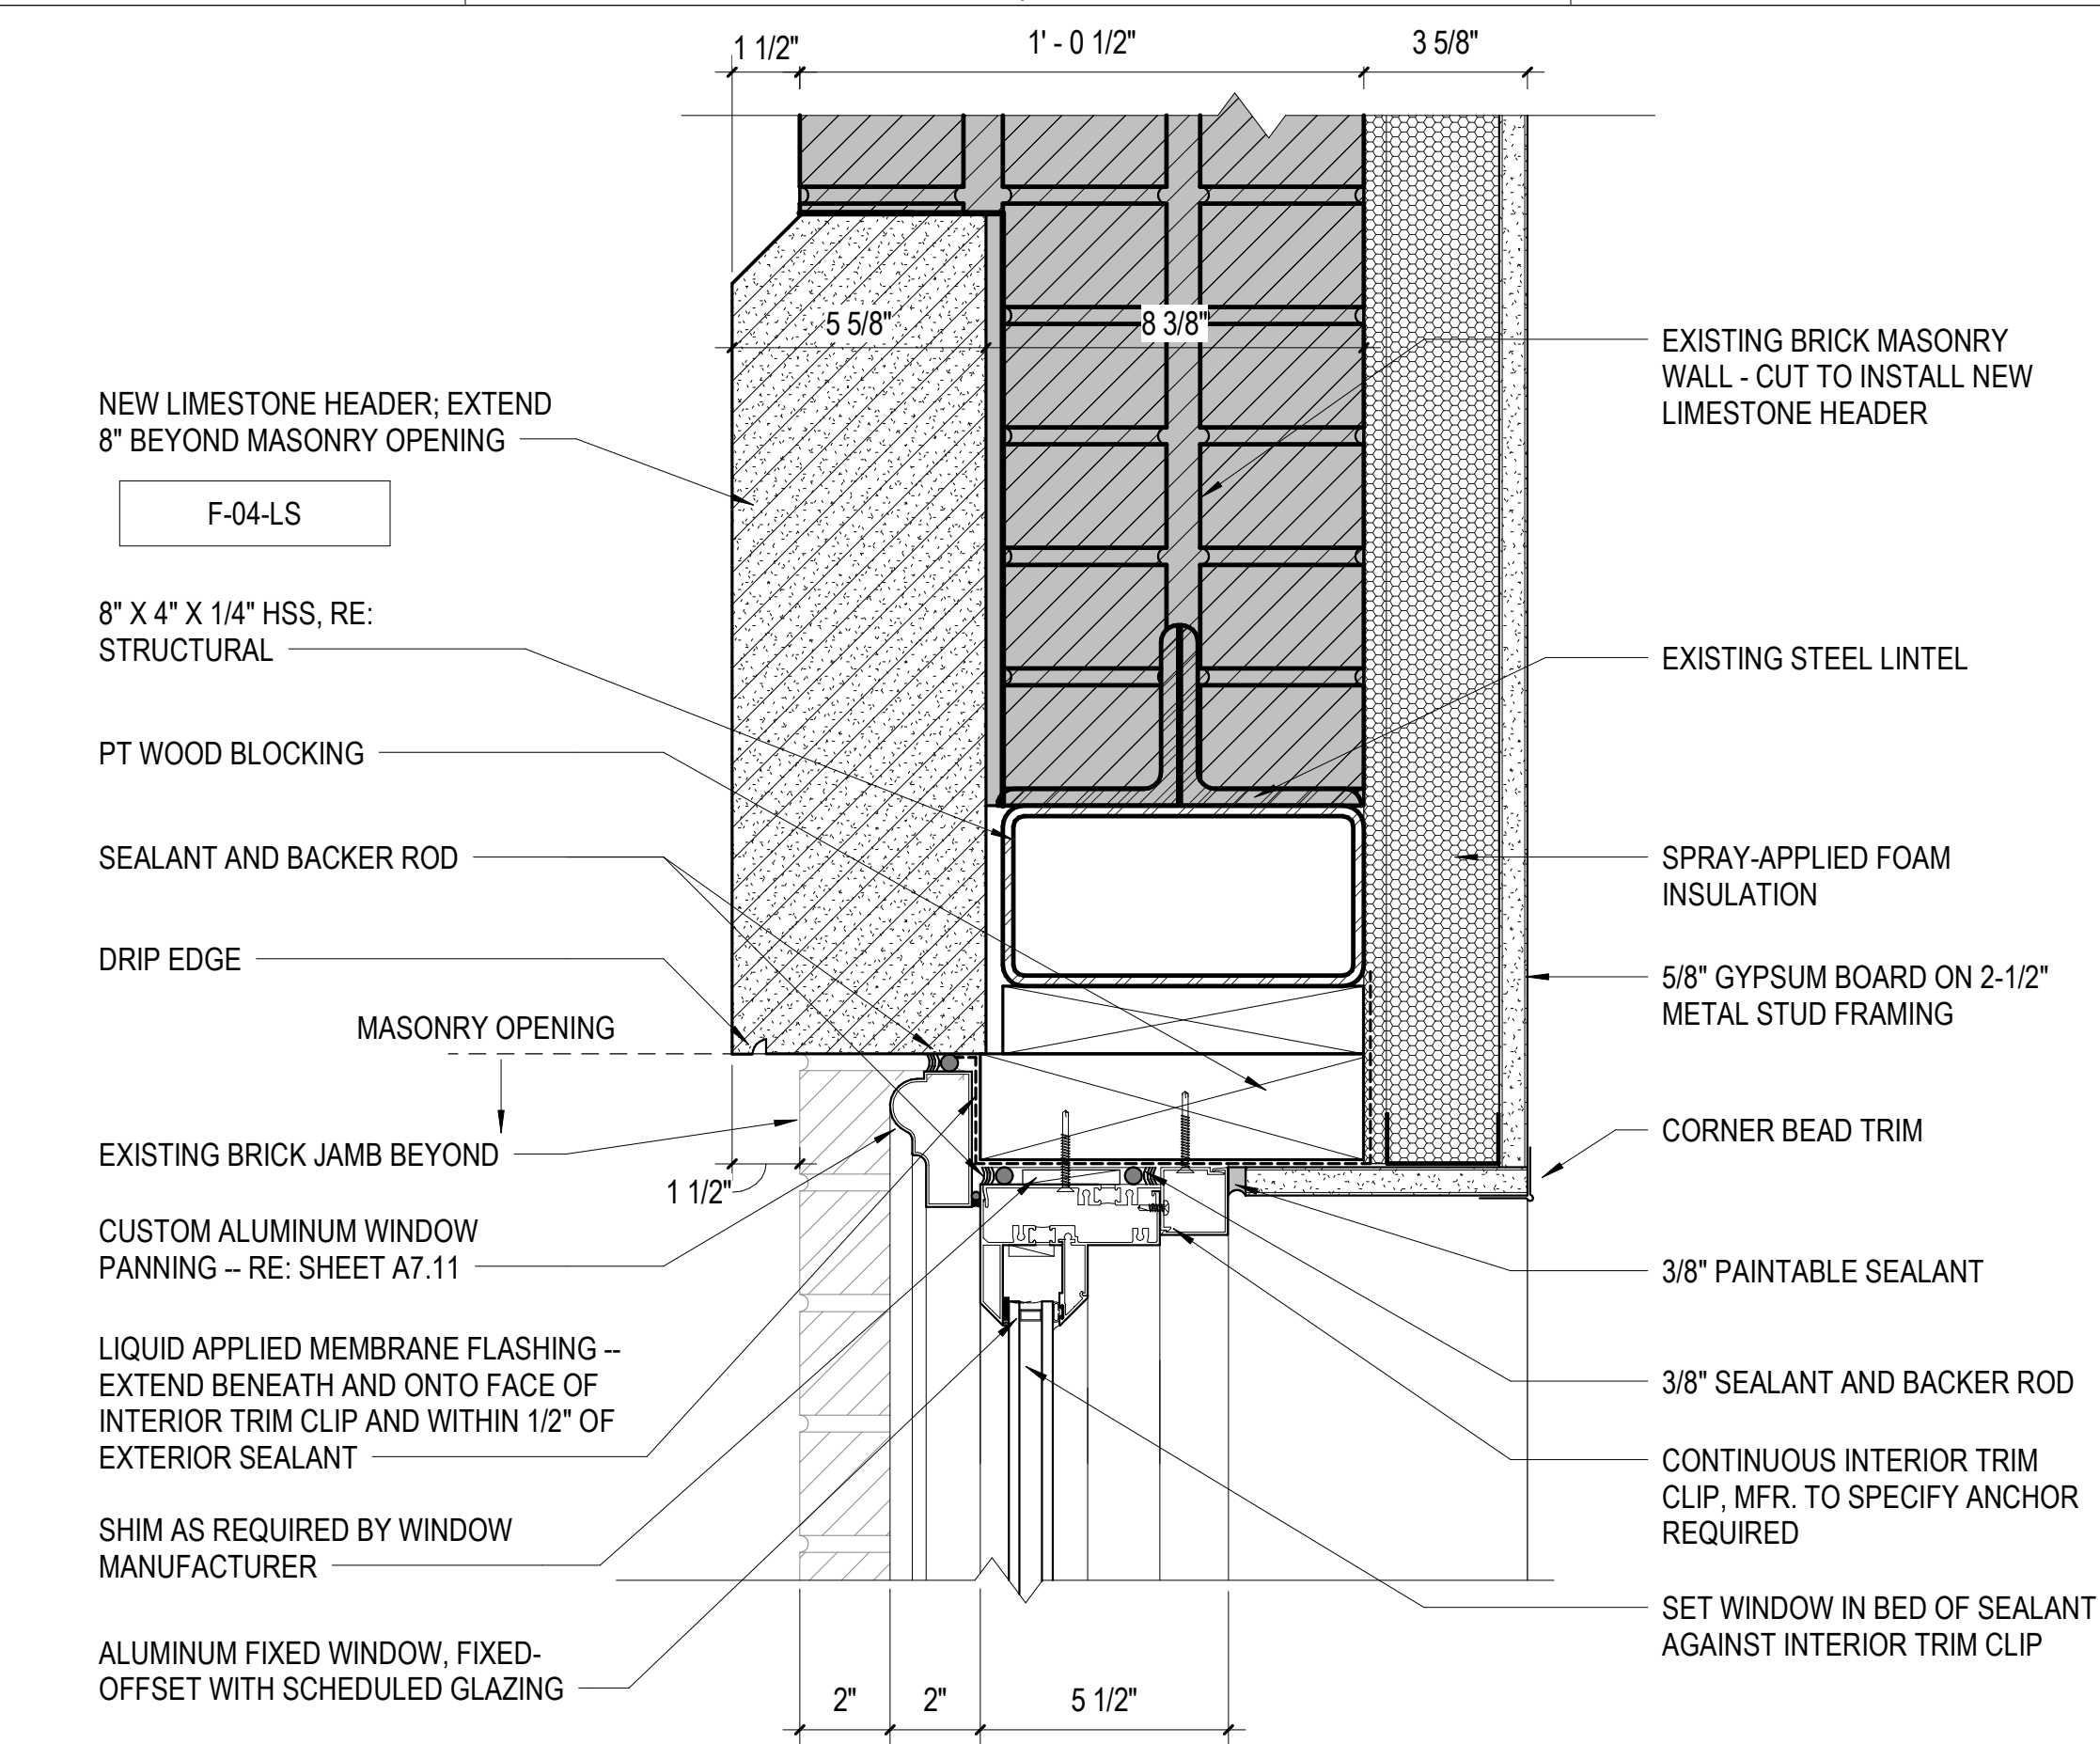


D4 DETAIL - WINDOW TYPE 01 HEAD
3" = 1'-0"

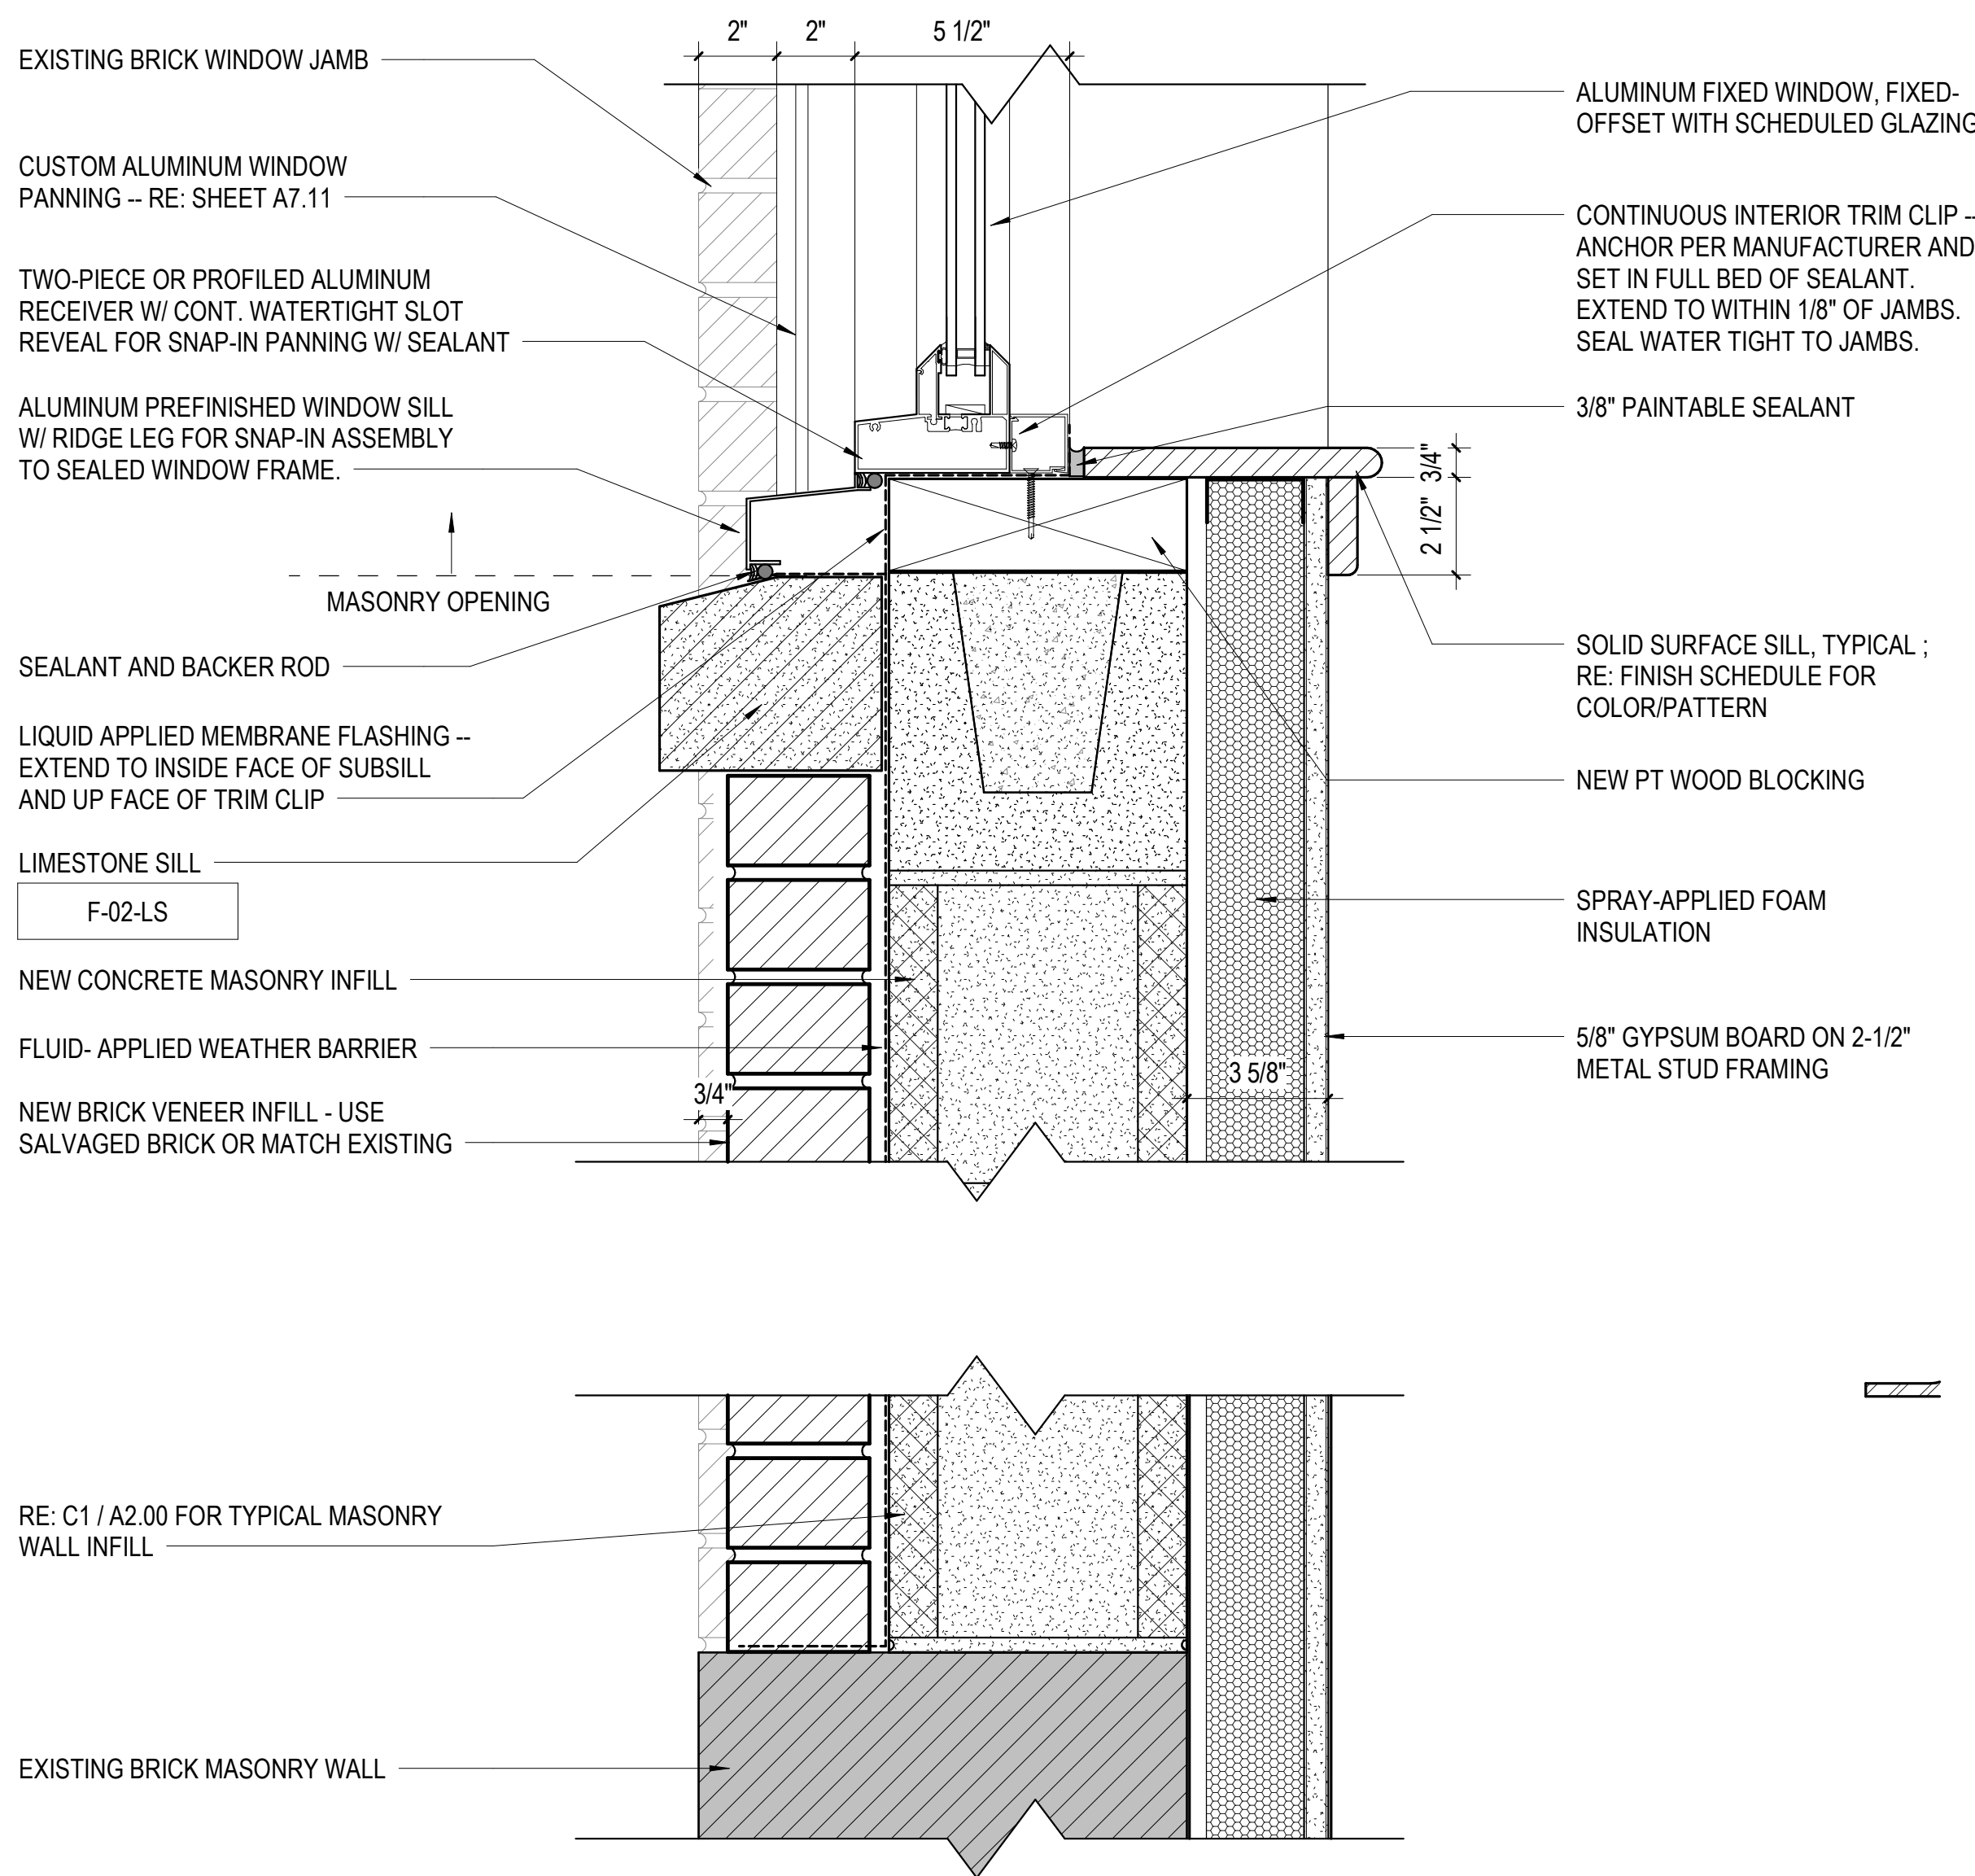


A4 DETAIL - WINDOW TYPE 01 SILL
3" = 1'-0"

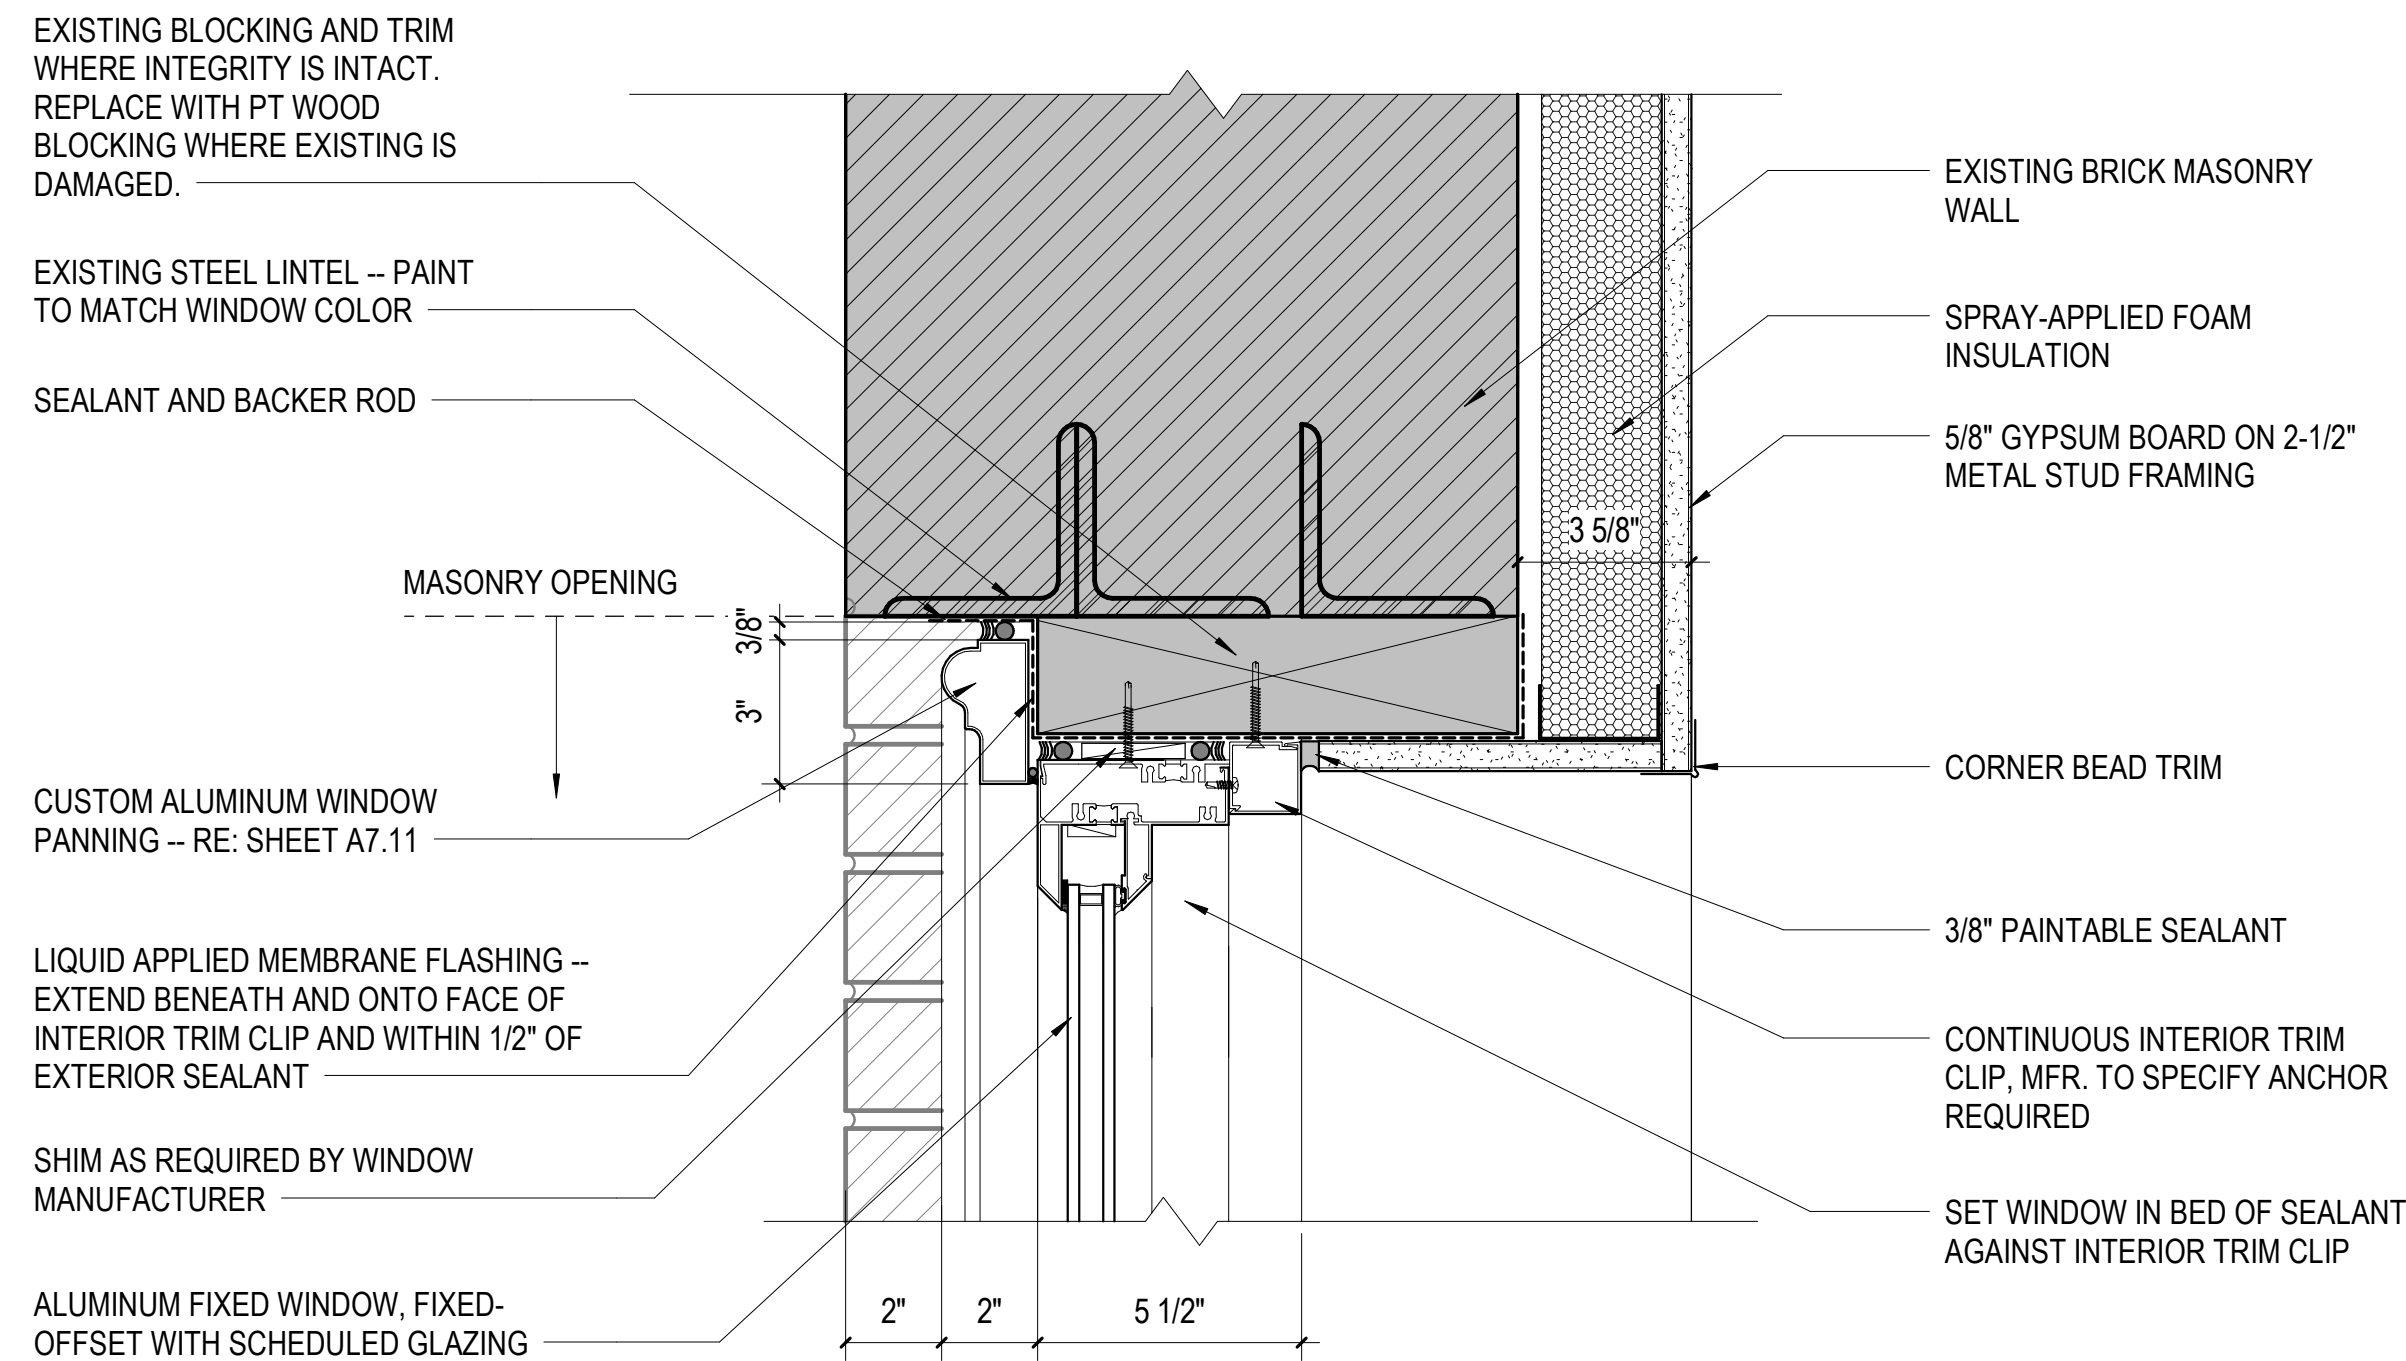


E1 DETAIL - WINDOW HEAD AT EXISTING BRICK WALL
3" = 1'-0"

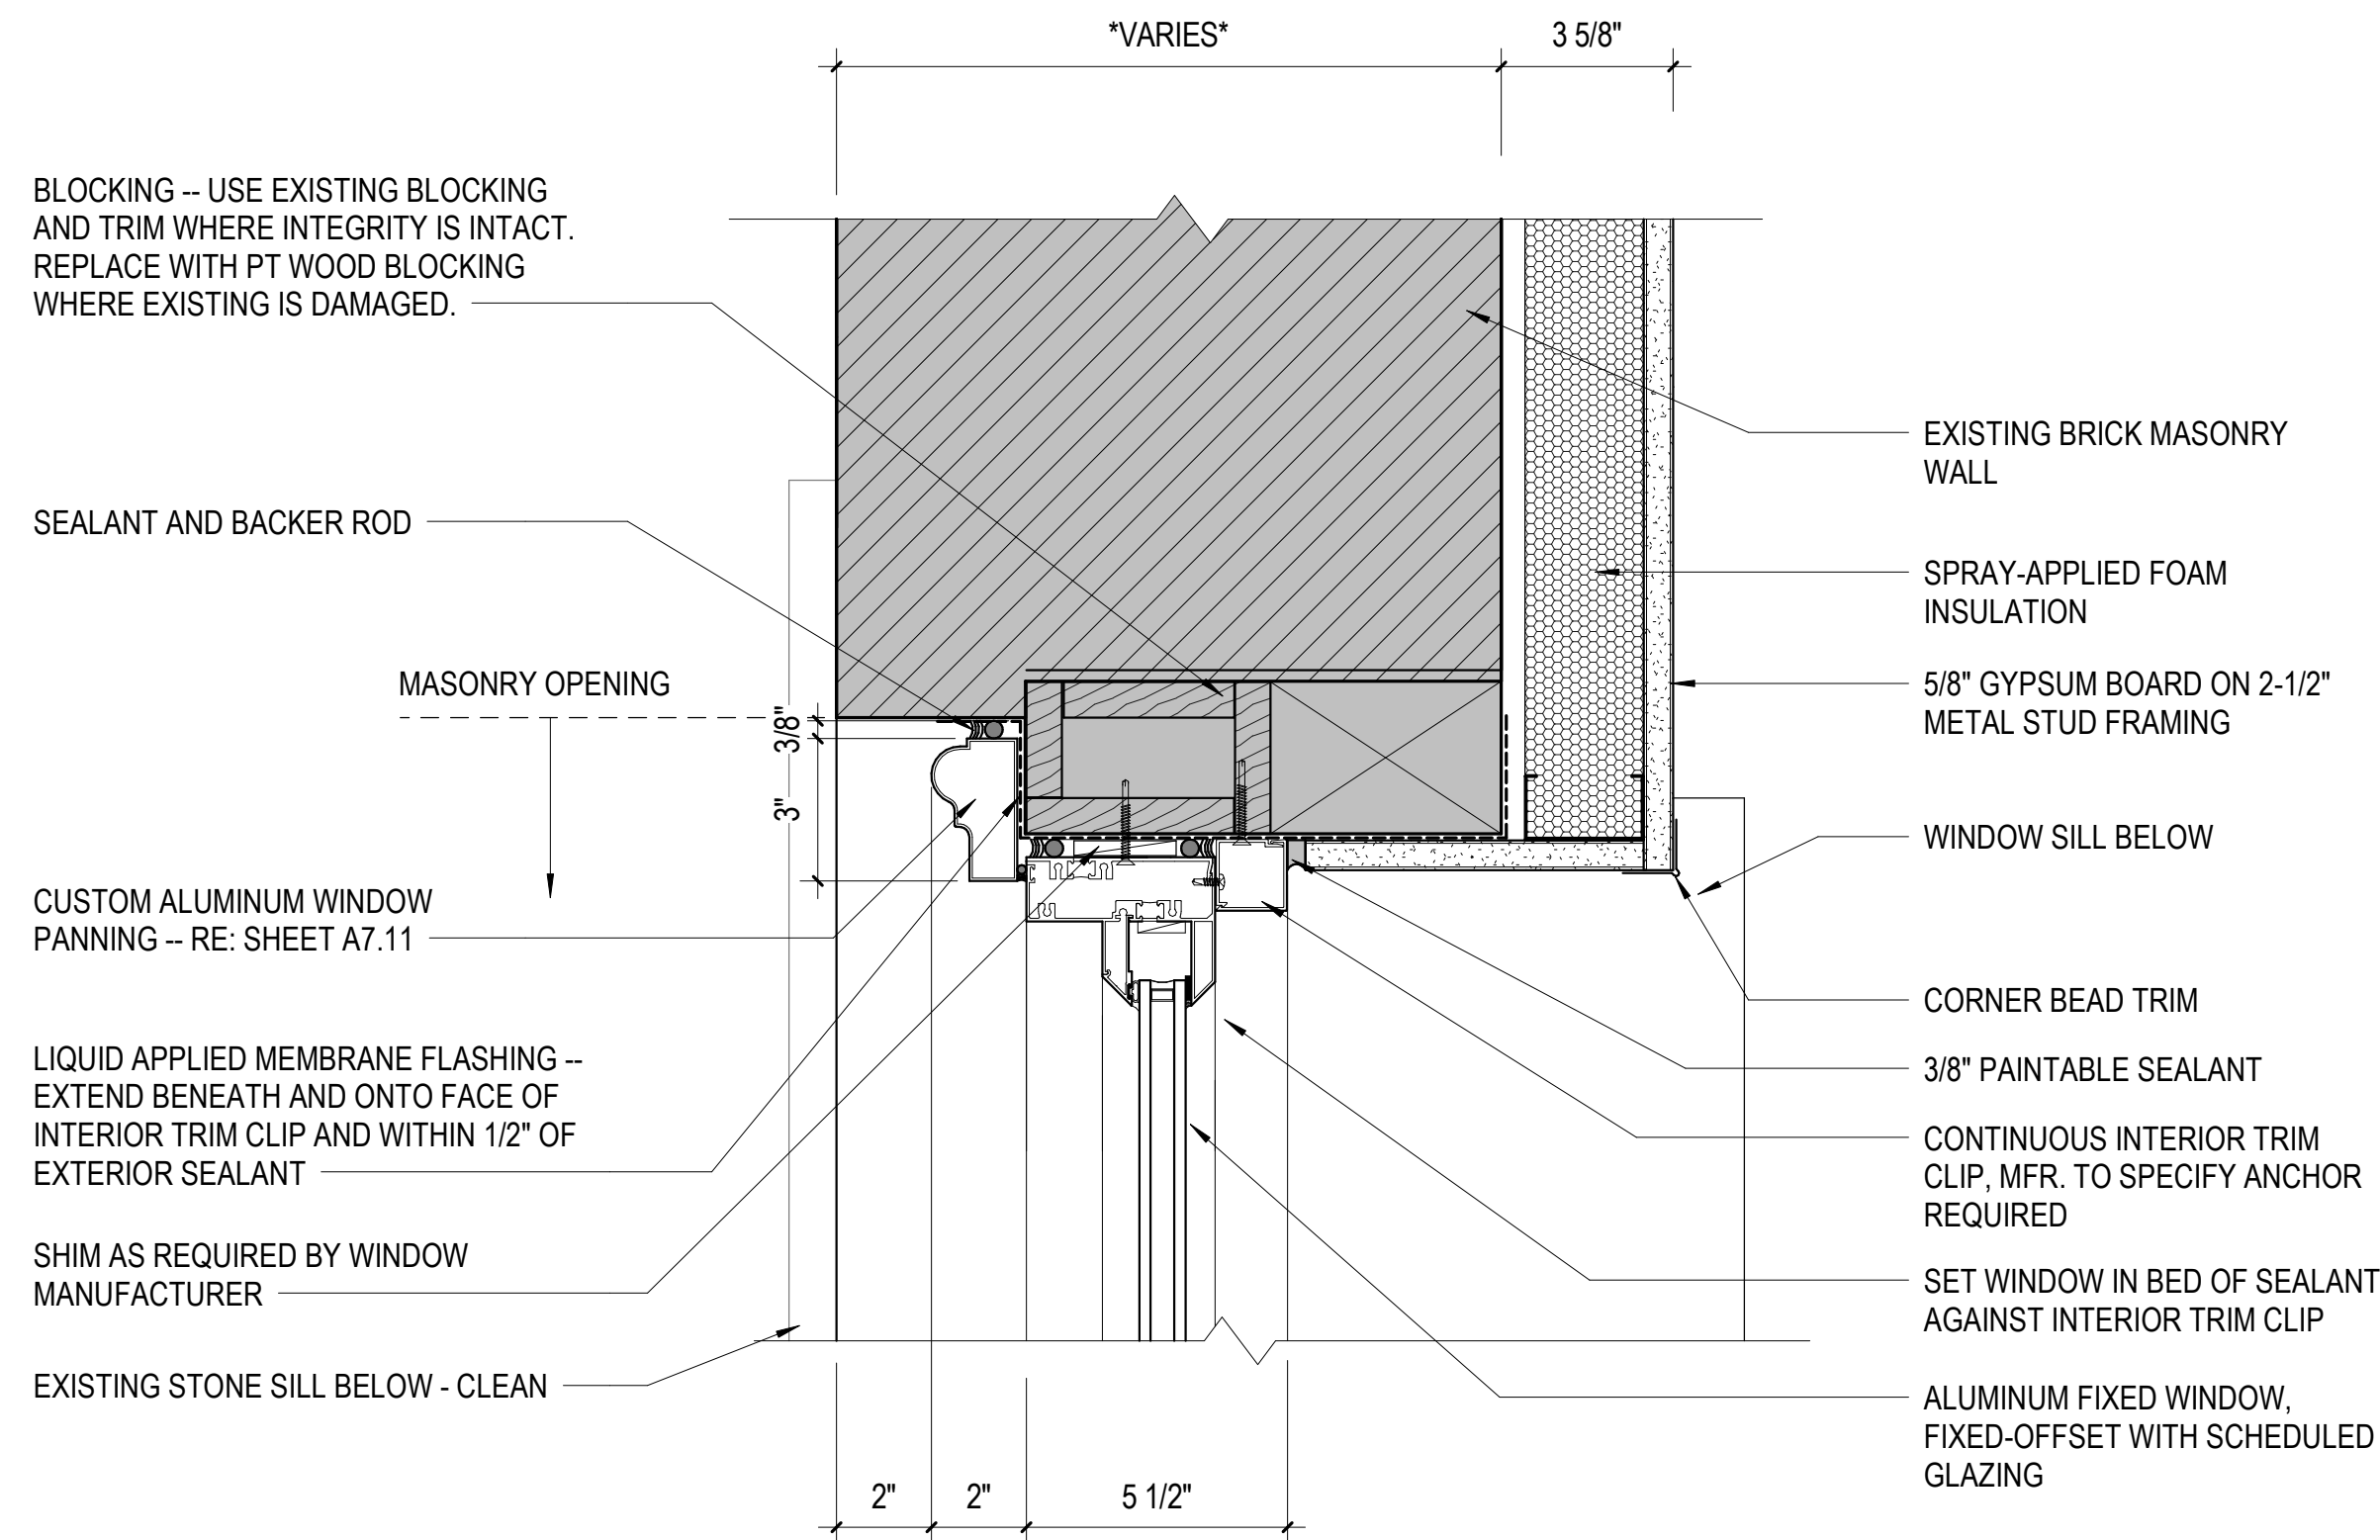



C1 DETAIL - WINDOW JAMB AT EXISTING BRICK WALL
3" = 1'-0"

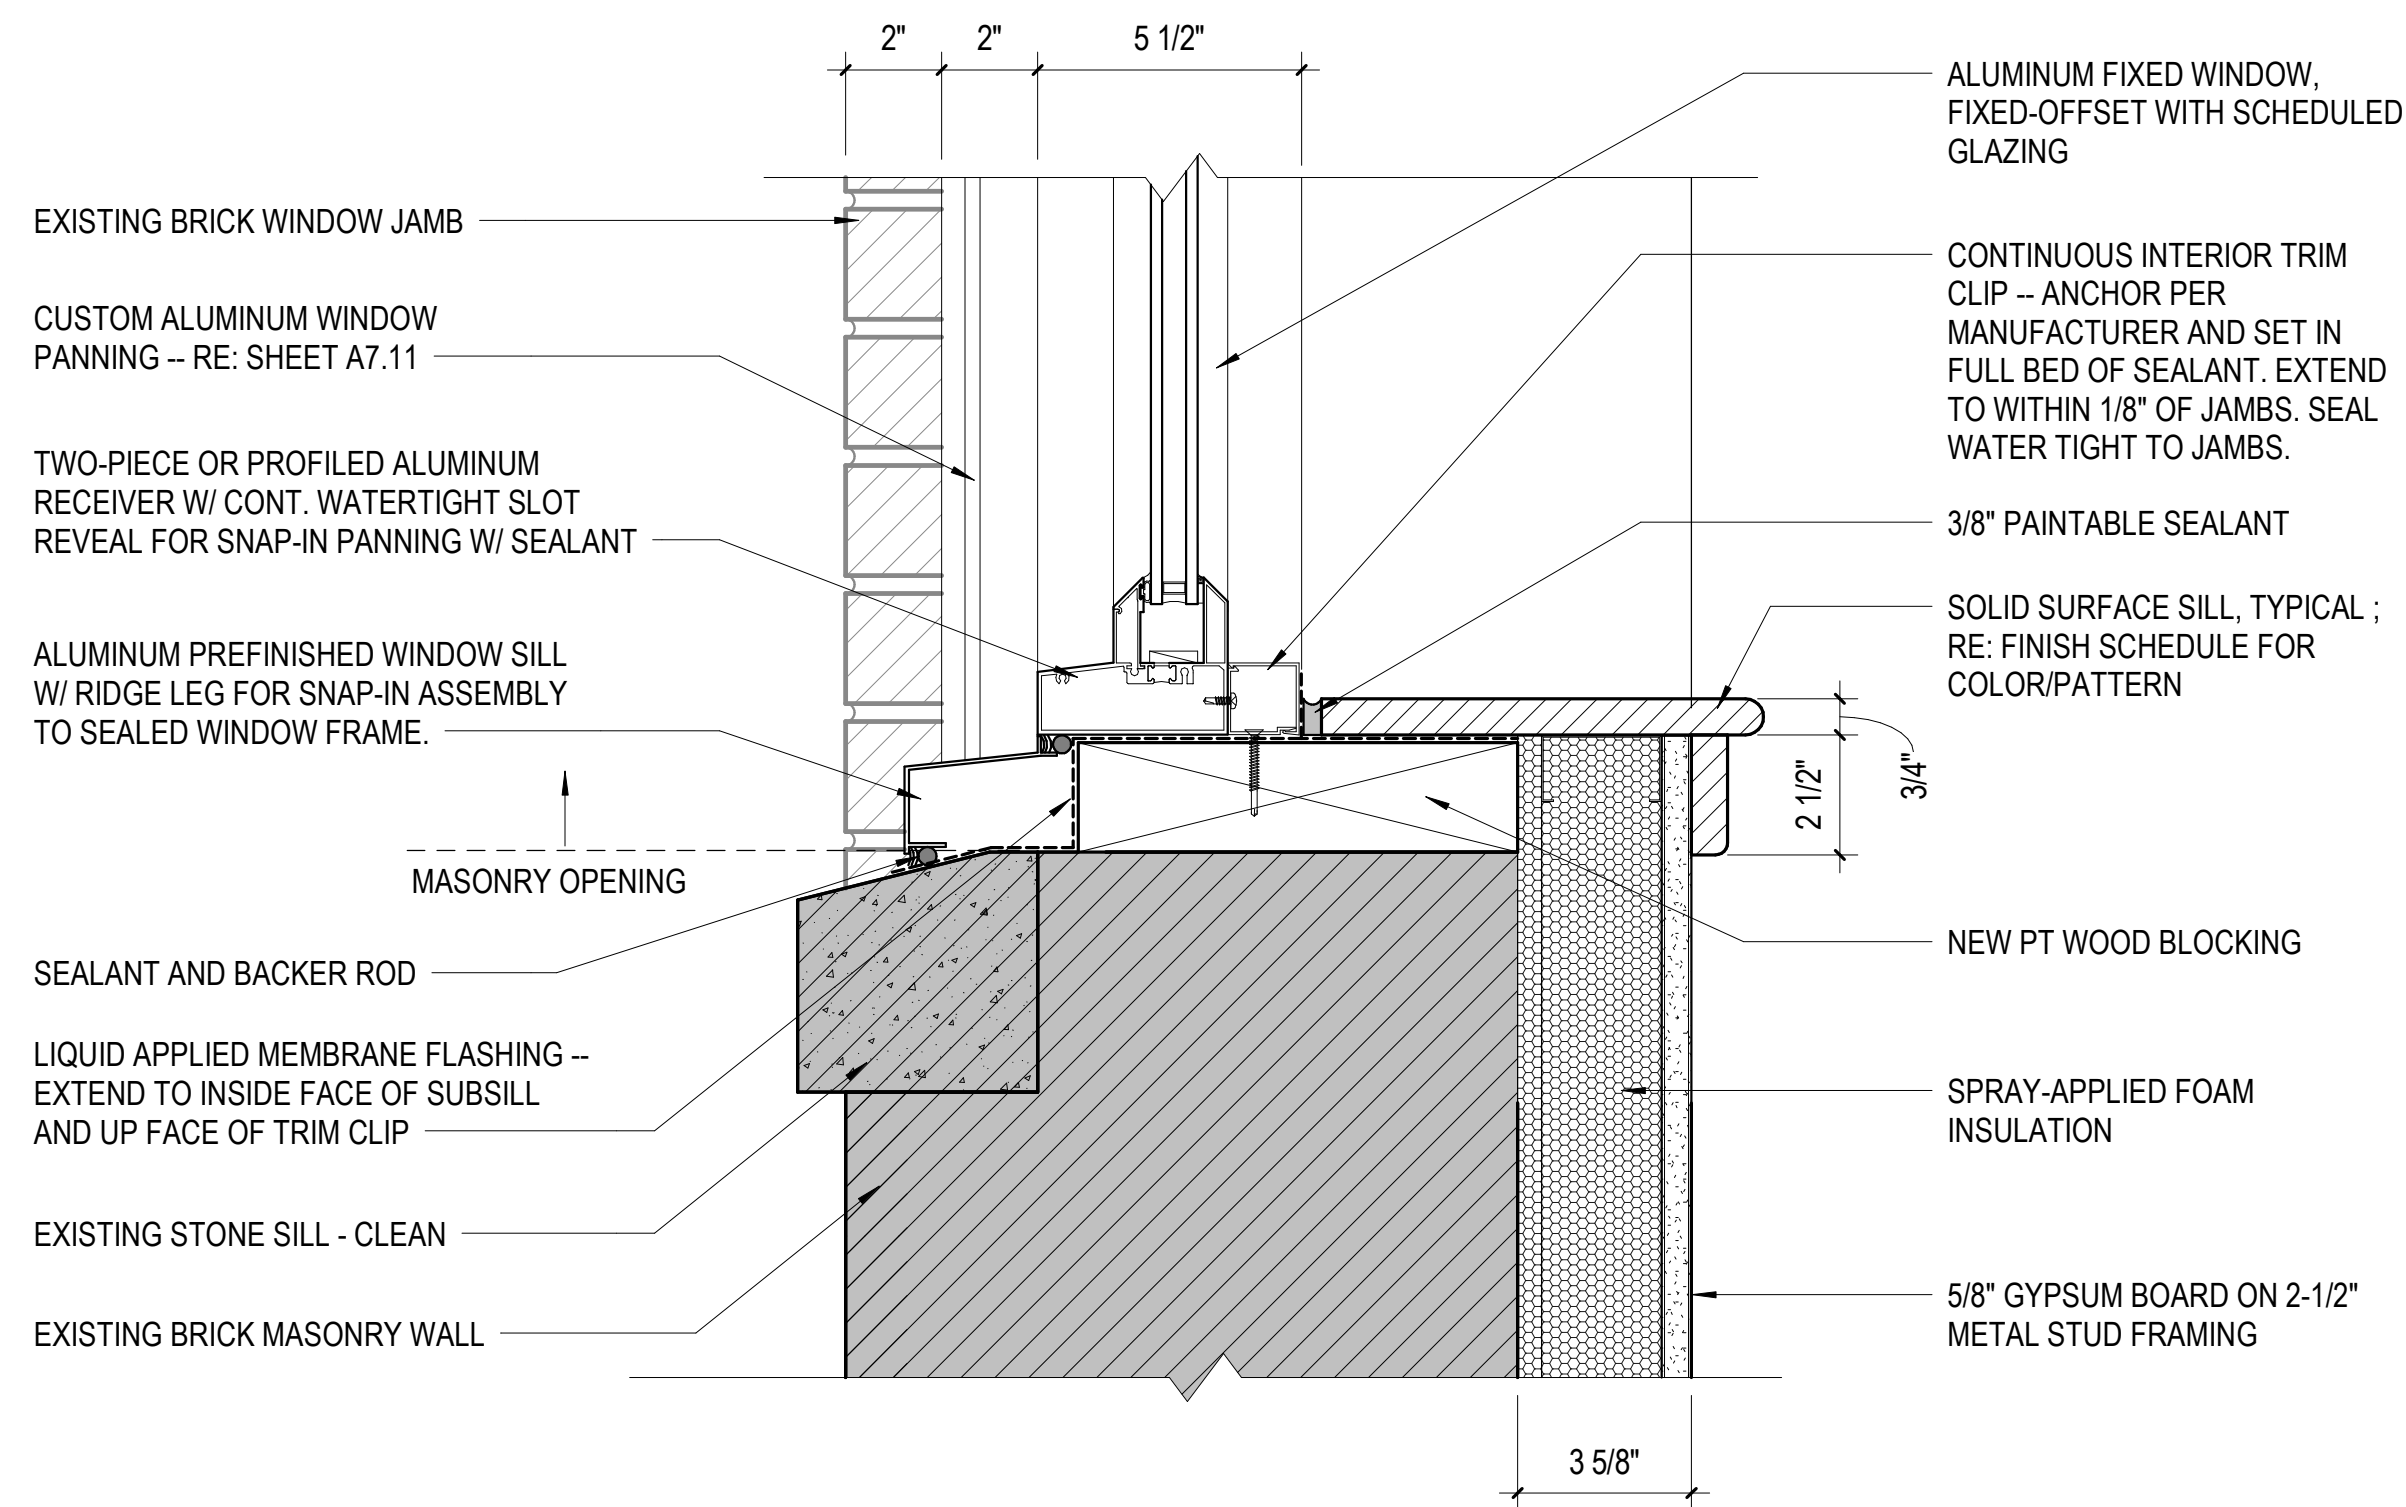


A1 DETAIL - WINDOW SILL AT EXISTING BRICK WALL
3" = 1'-0"

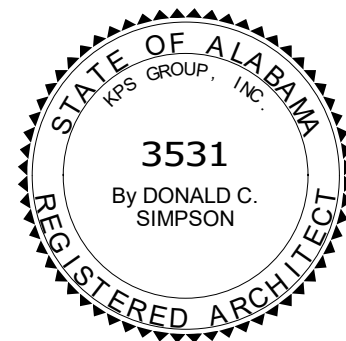


PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
WINDOW DETAILS		
DRAWN BY: Author		
CHECKED BY: Checker		
PROJECT NUMBER		
236002-02		
DRAWING NO.		
A7.13		

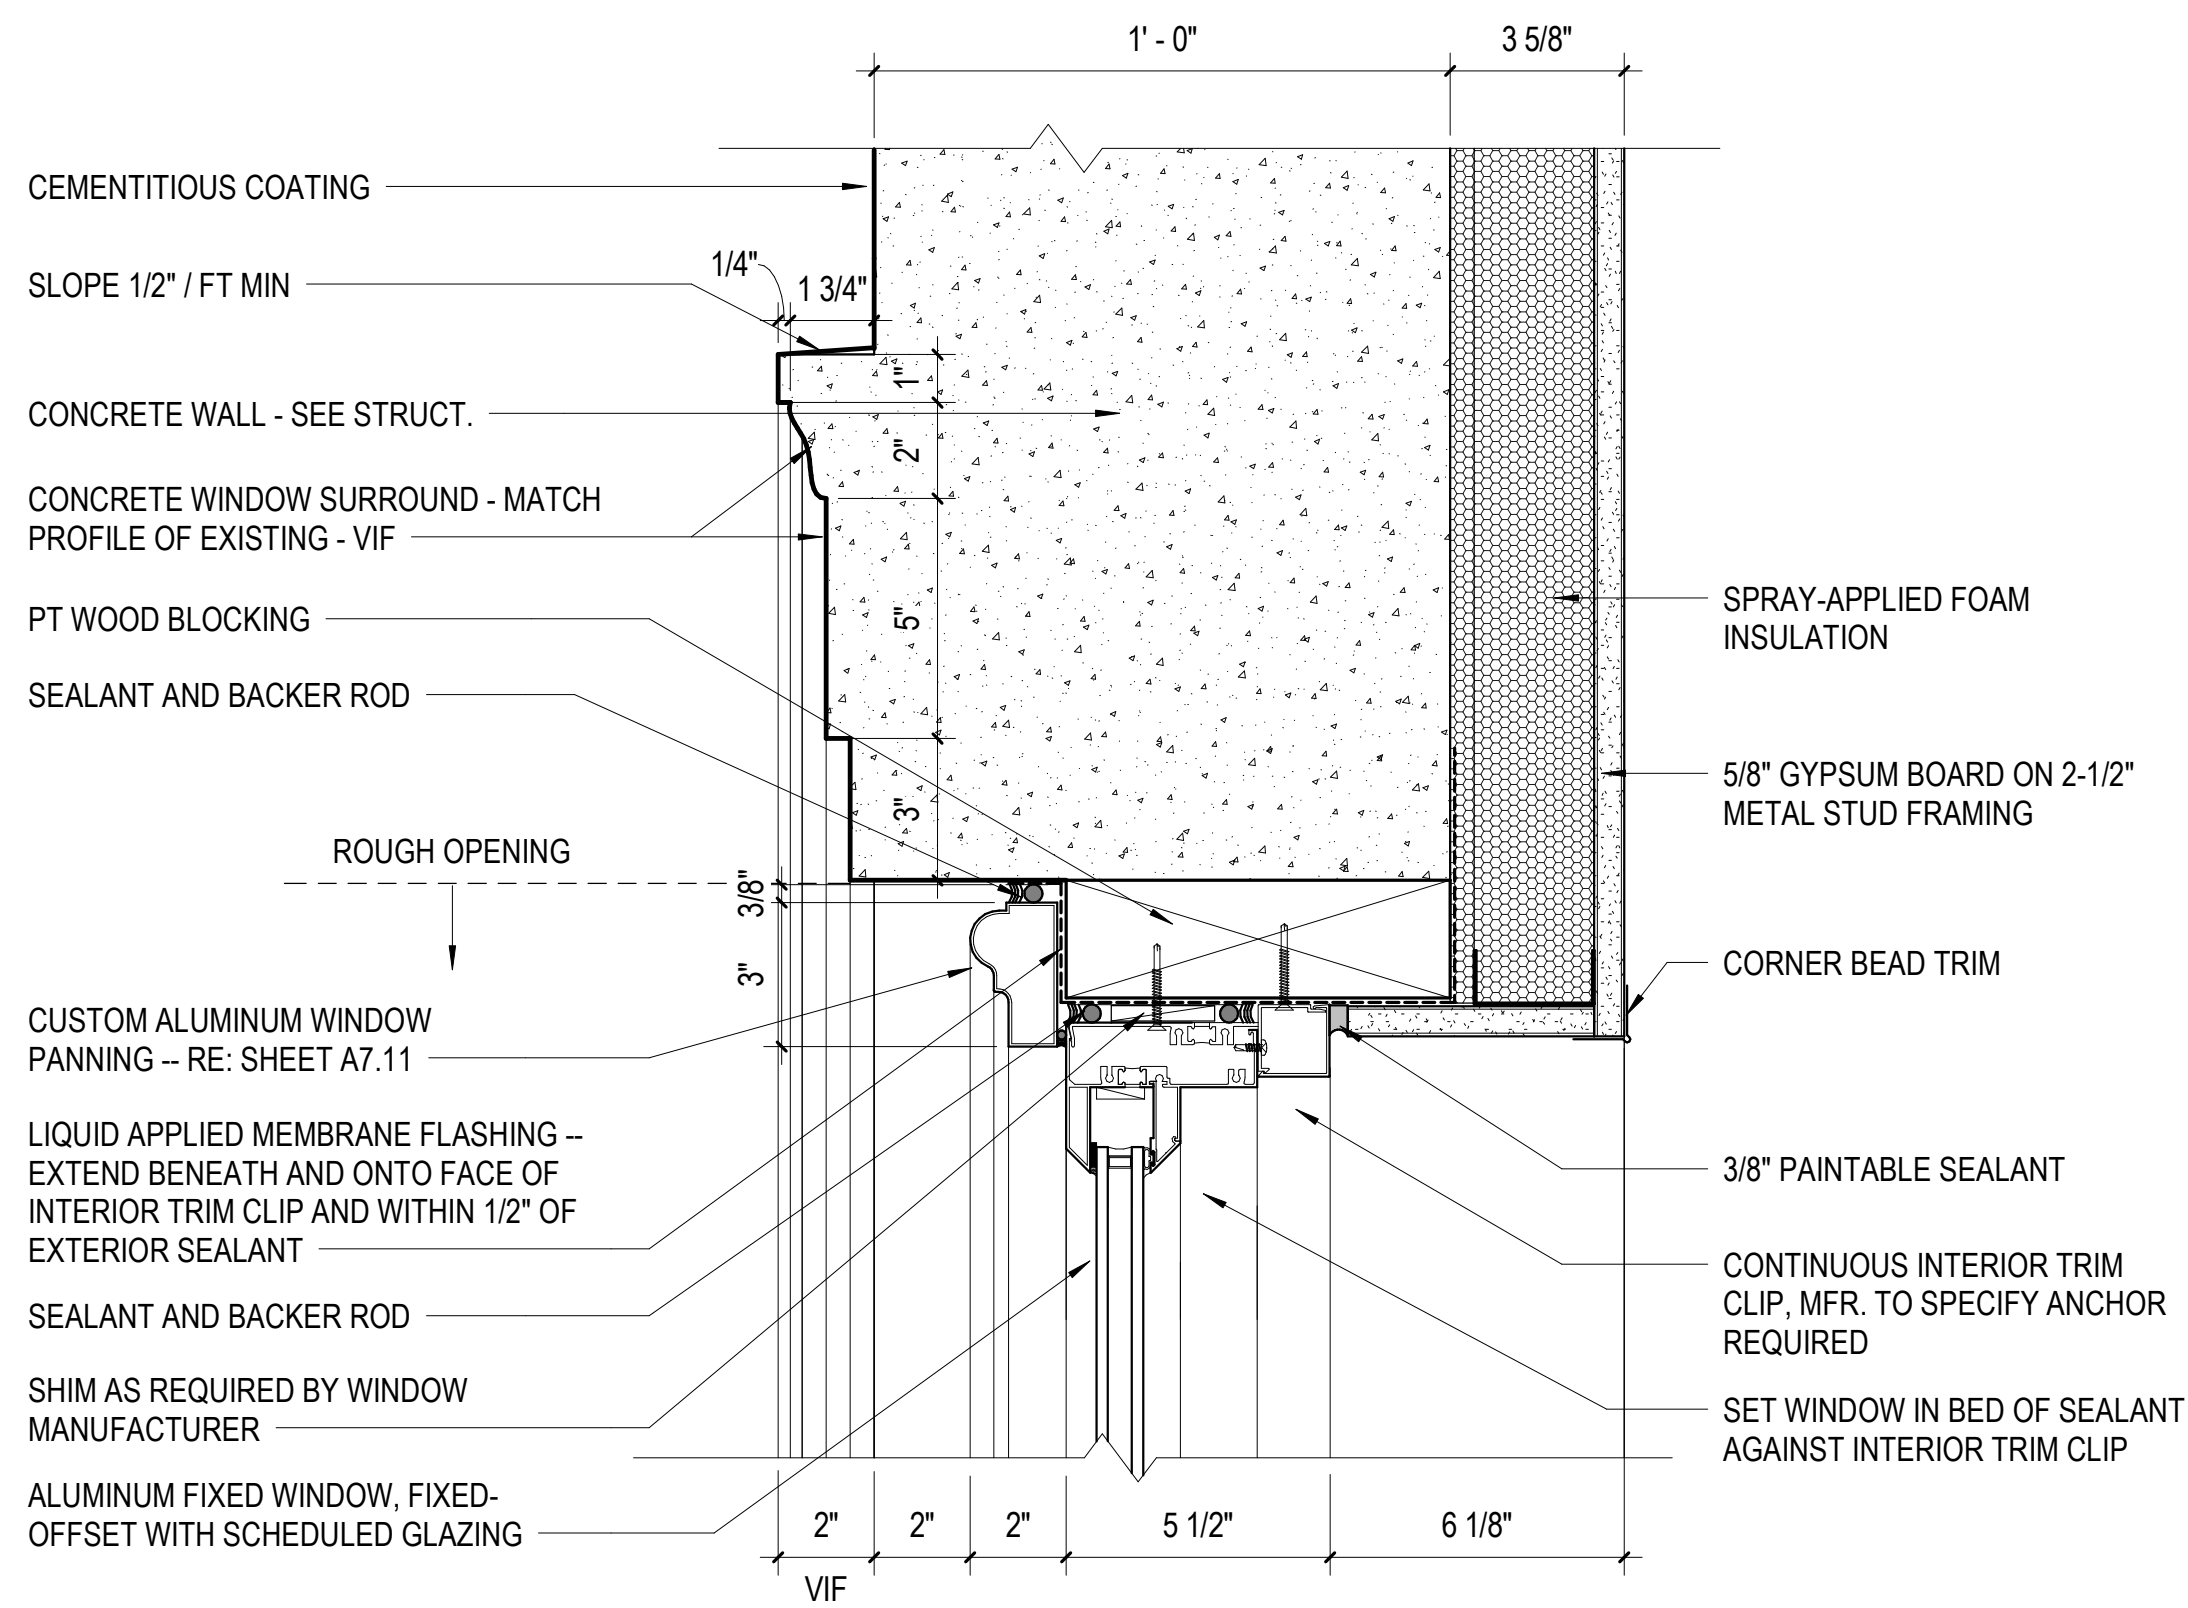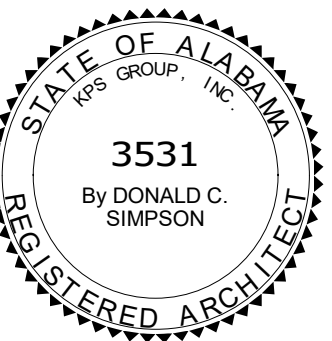


D6 DETAIL - WINDOW HEAD 08 @ CONCRETE
3" = 1'-0"

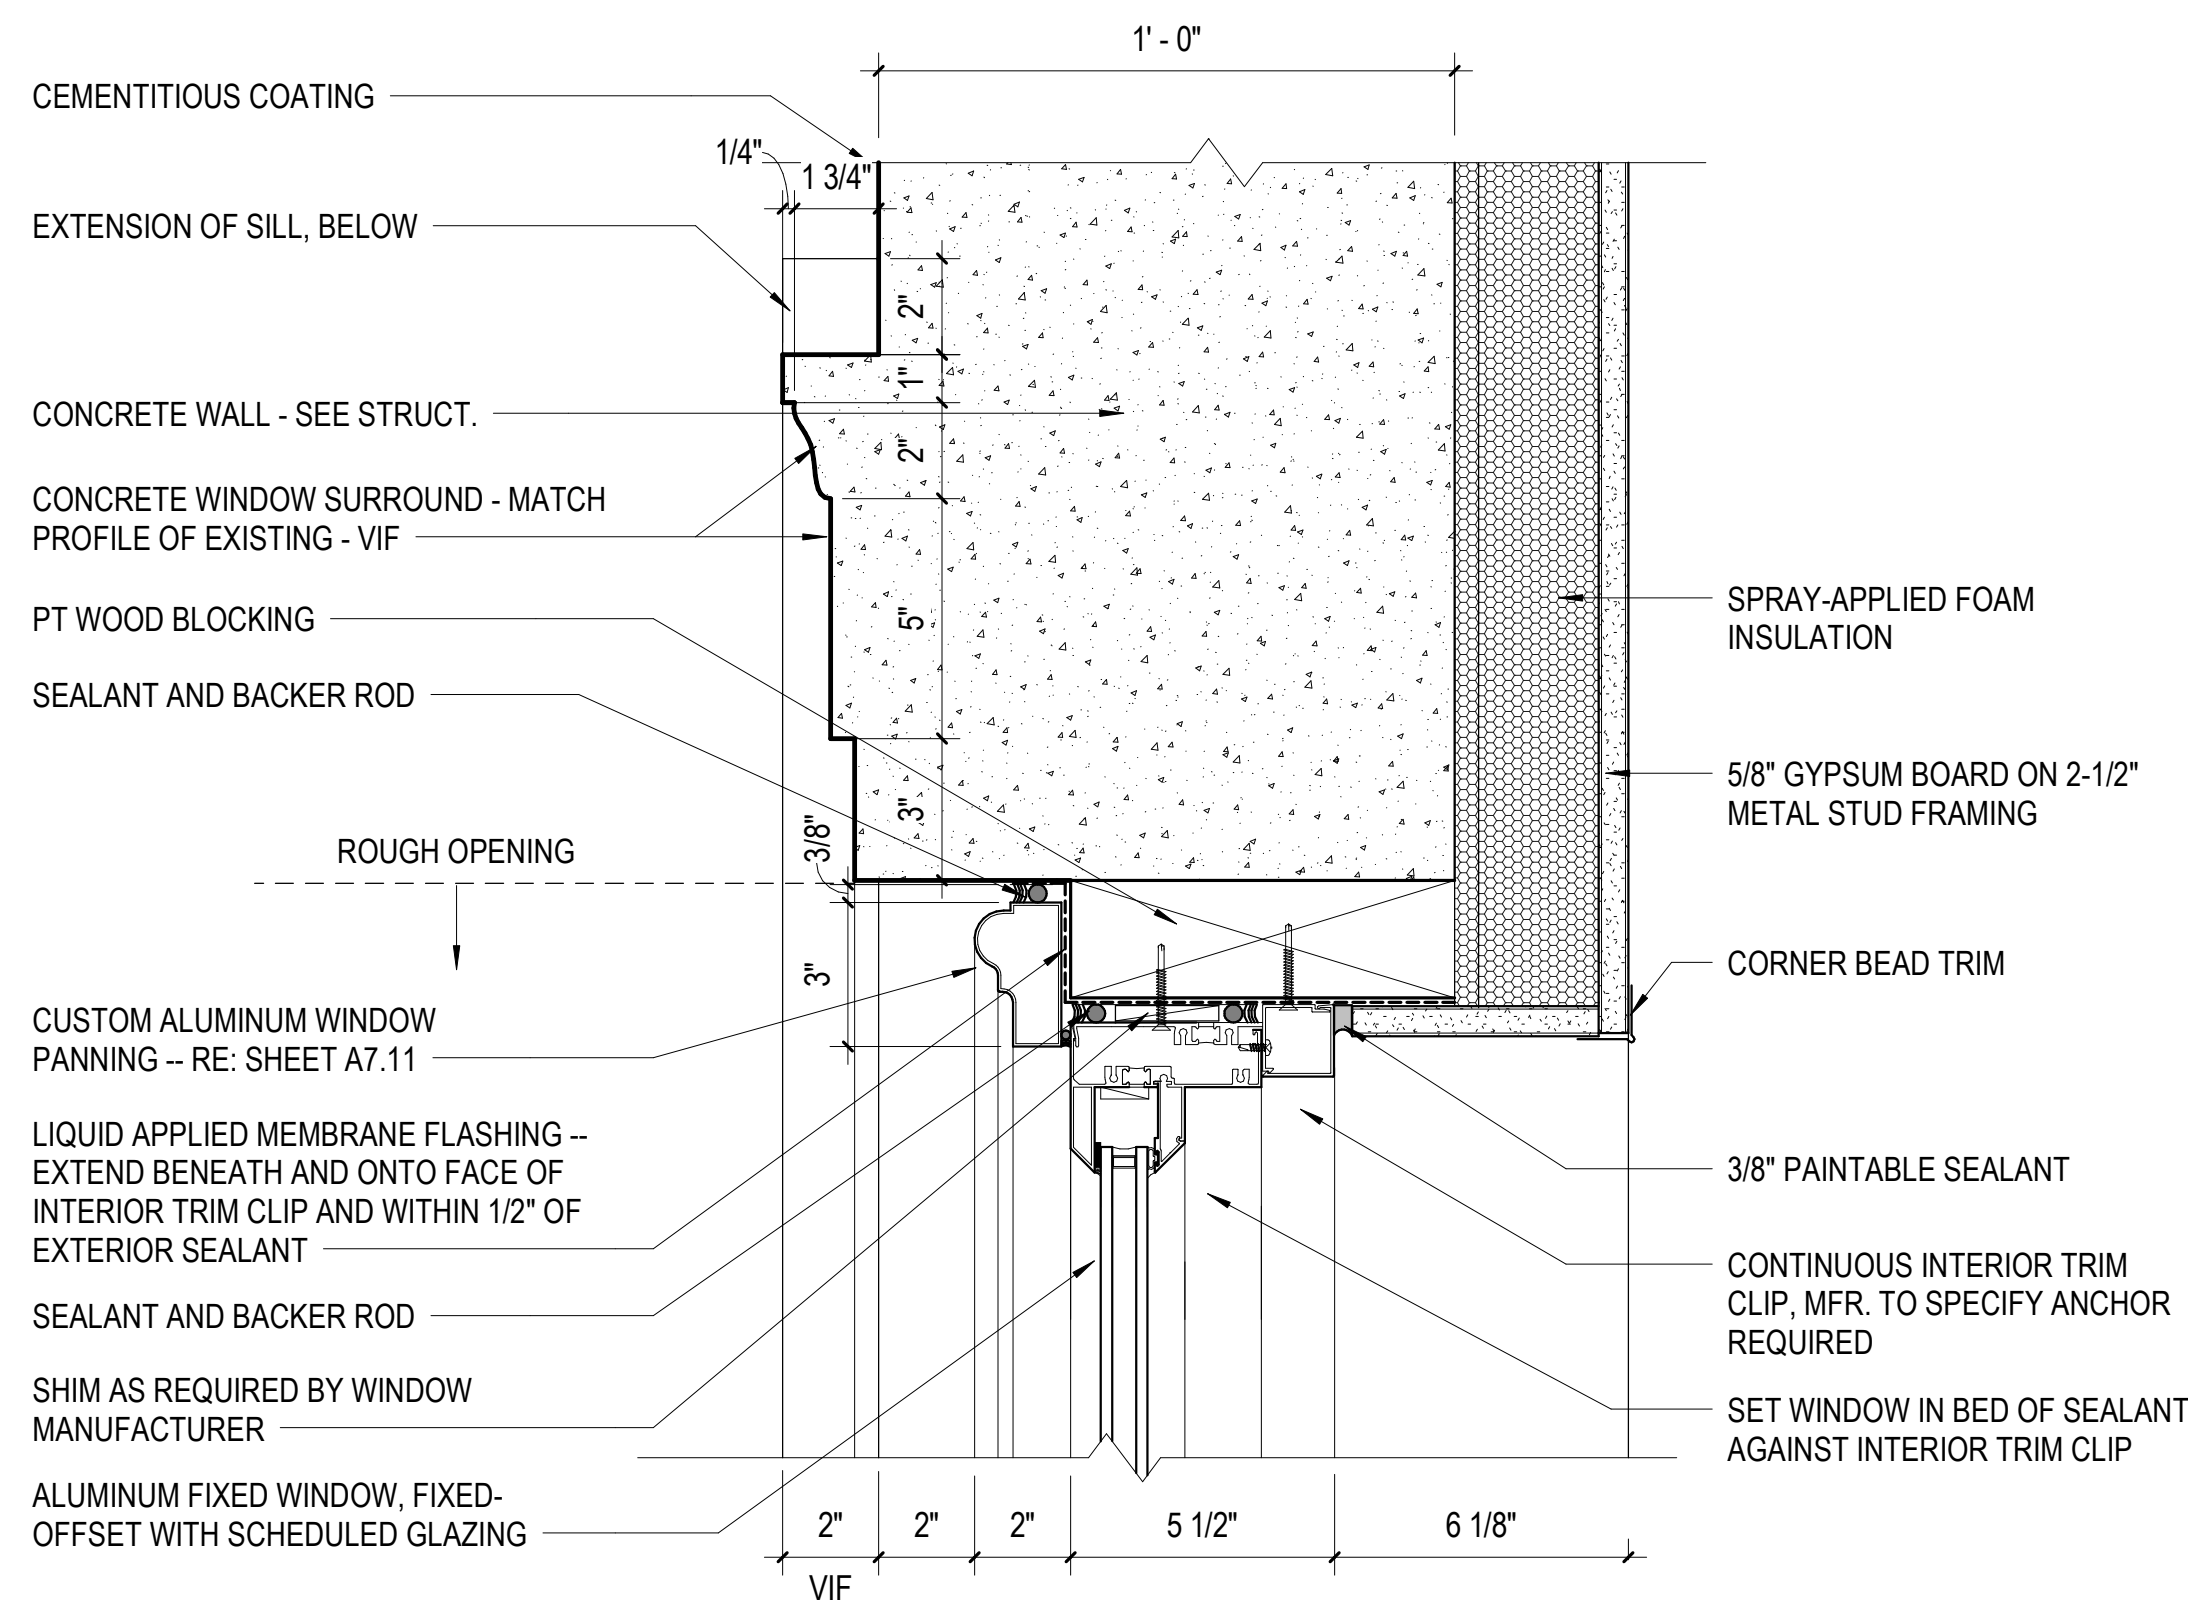


C6 DETAIL - WINDOW JAMB @ CONCRETE BRIDGE
3" = 1'-0"

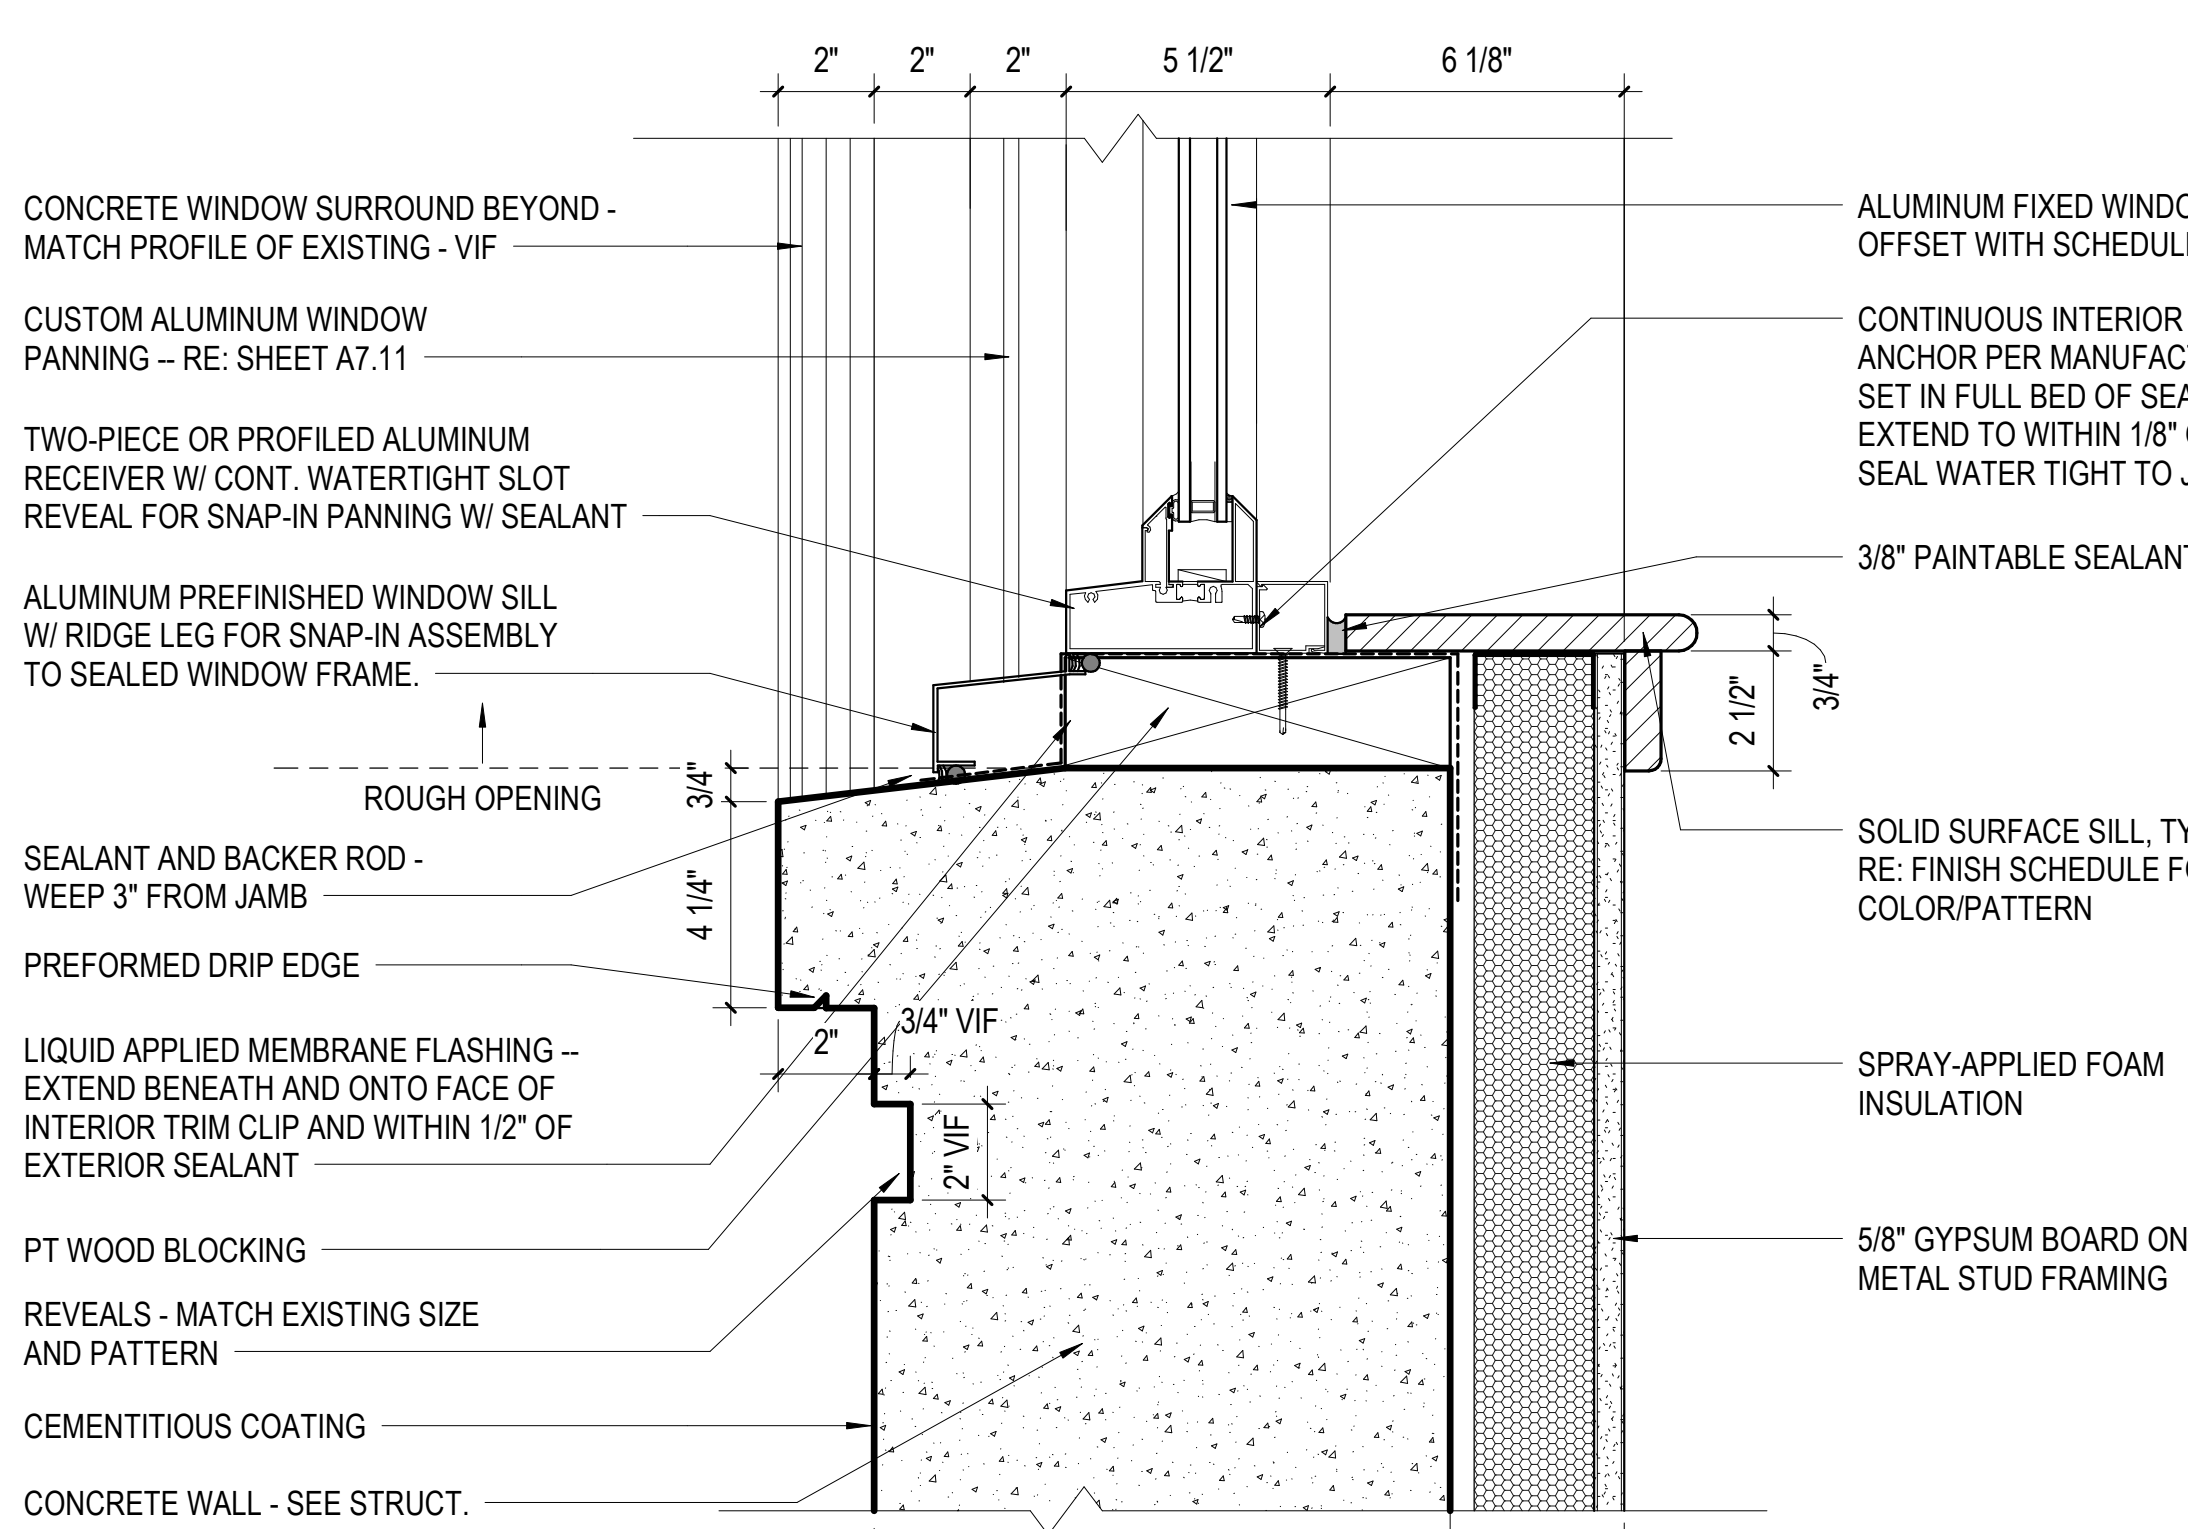


A6 DETAIL - WINDOW SILL
3" = 1'-0"

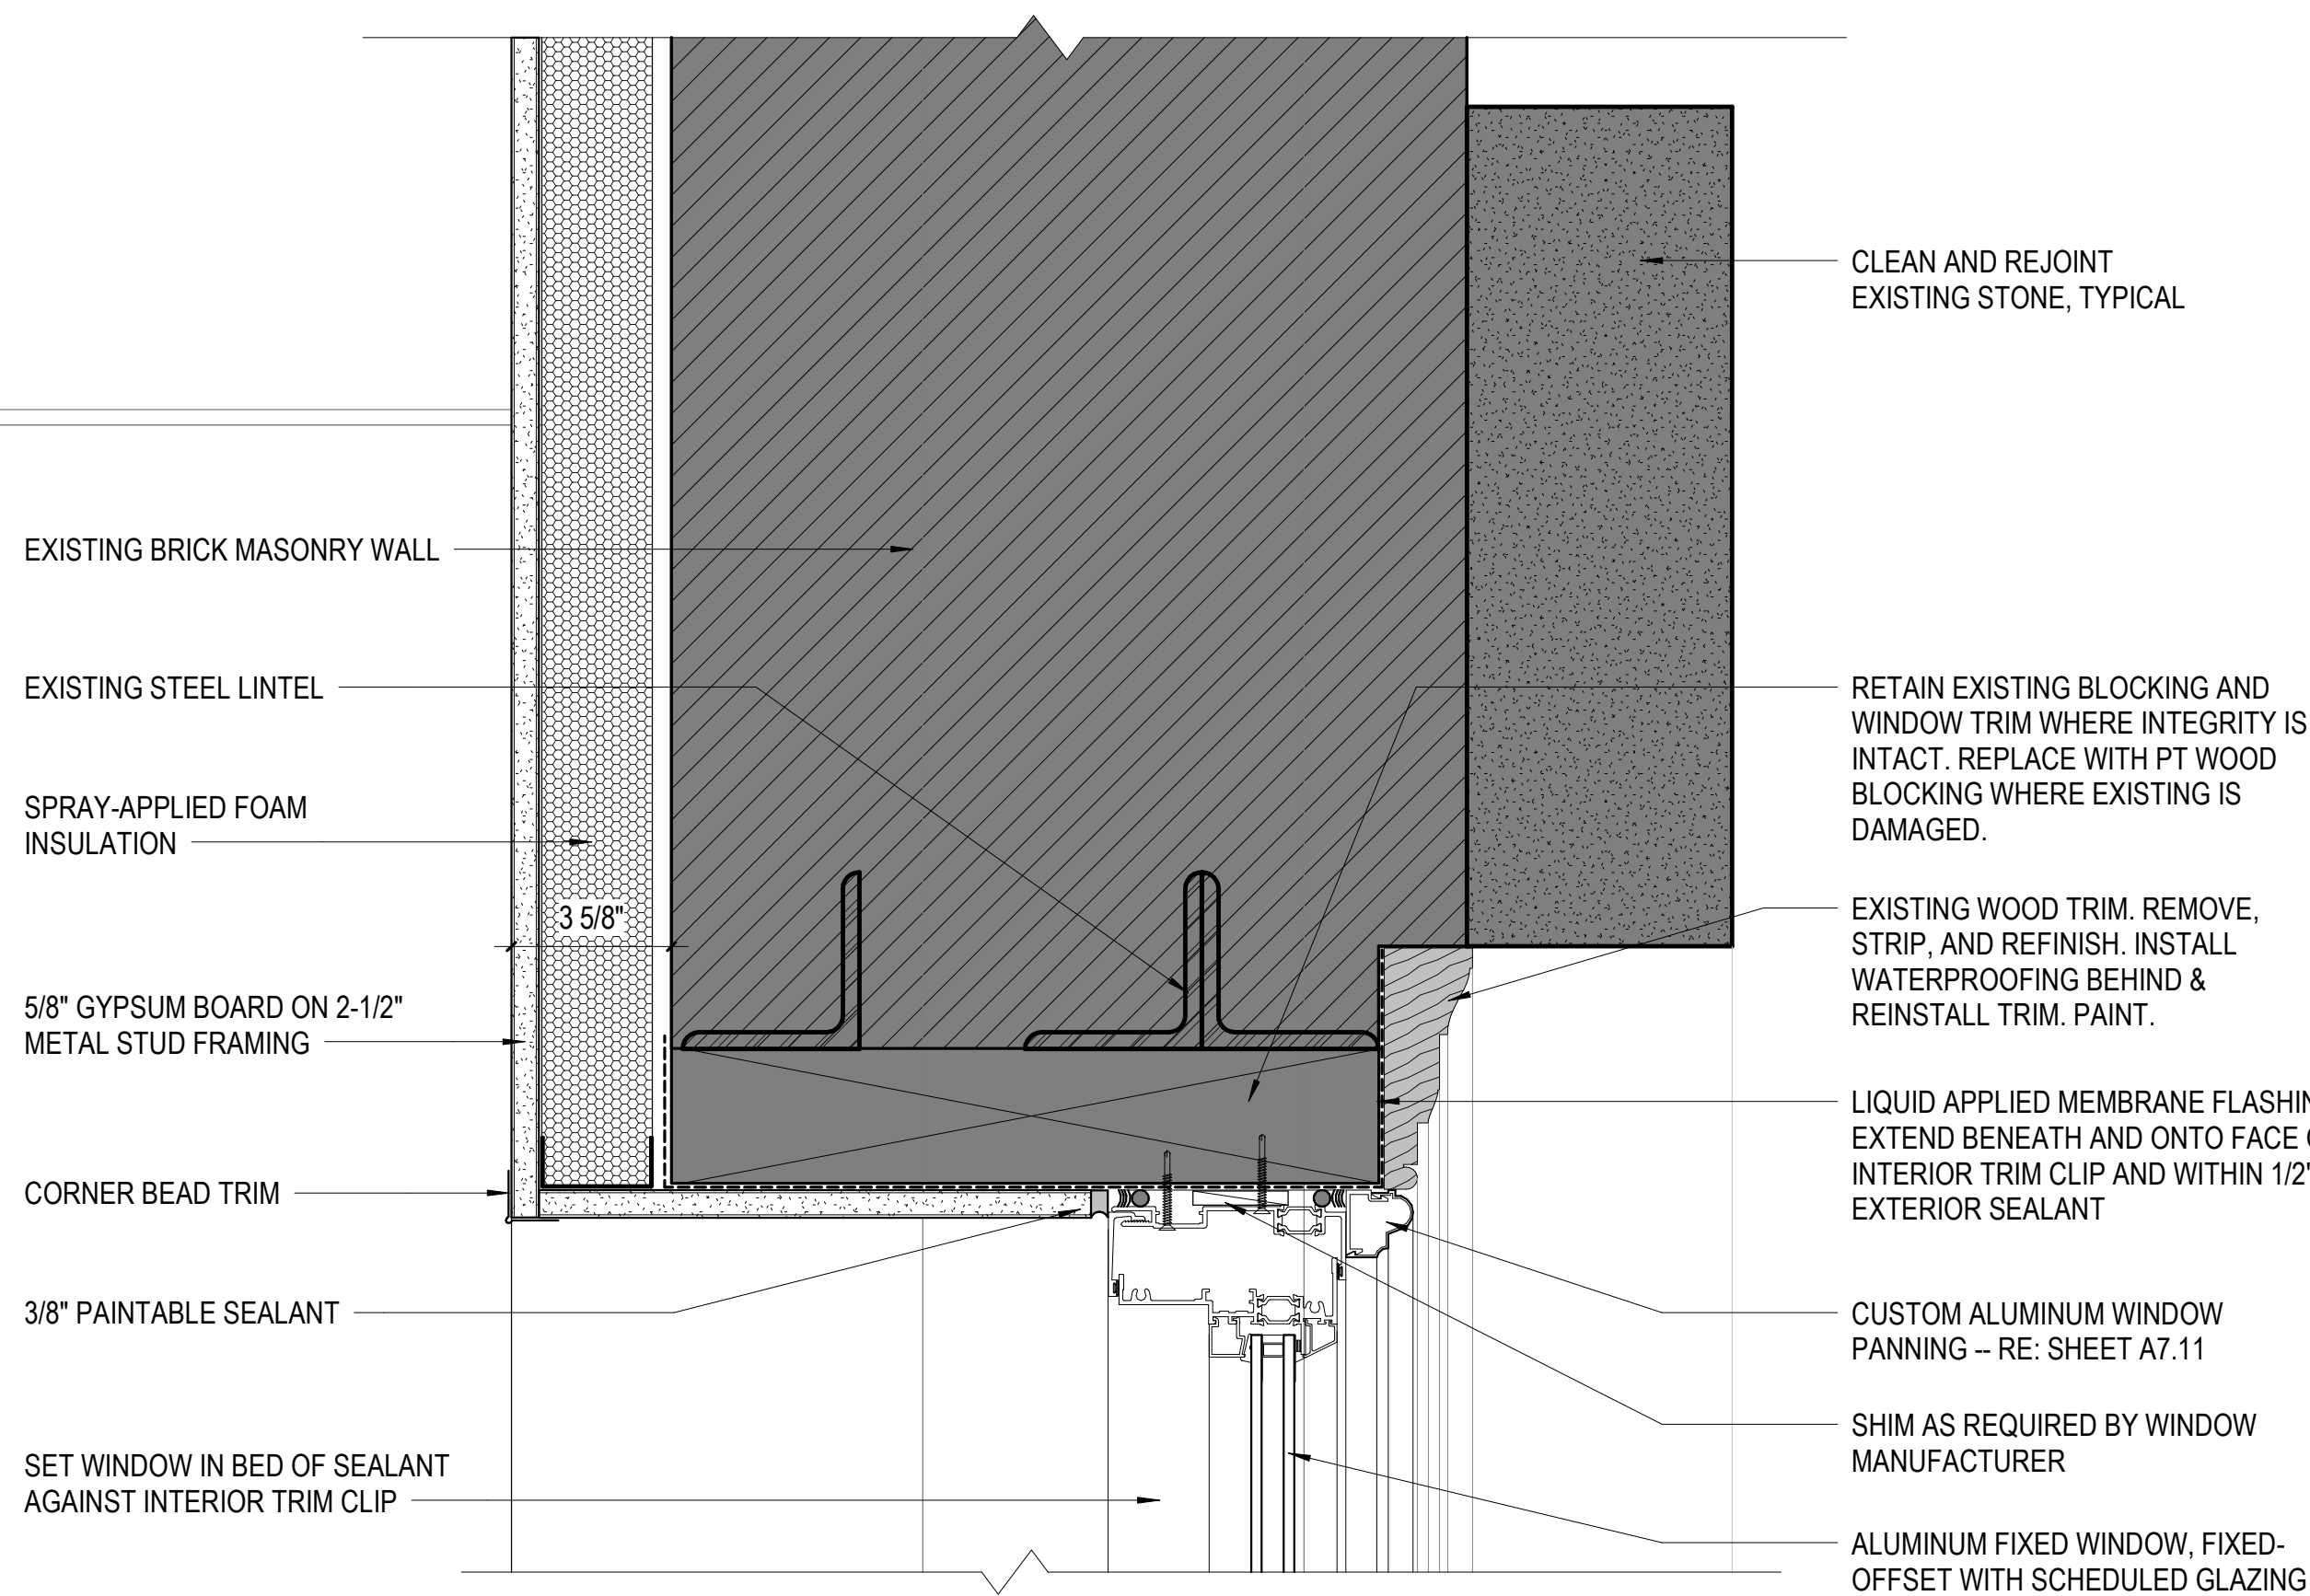


D4 DETAIL - HEAD AT WINDOW 09
3" = 1'-0"

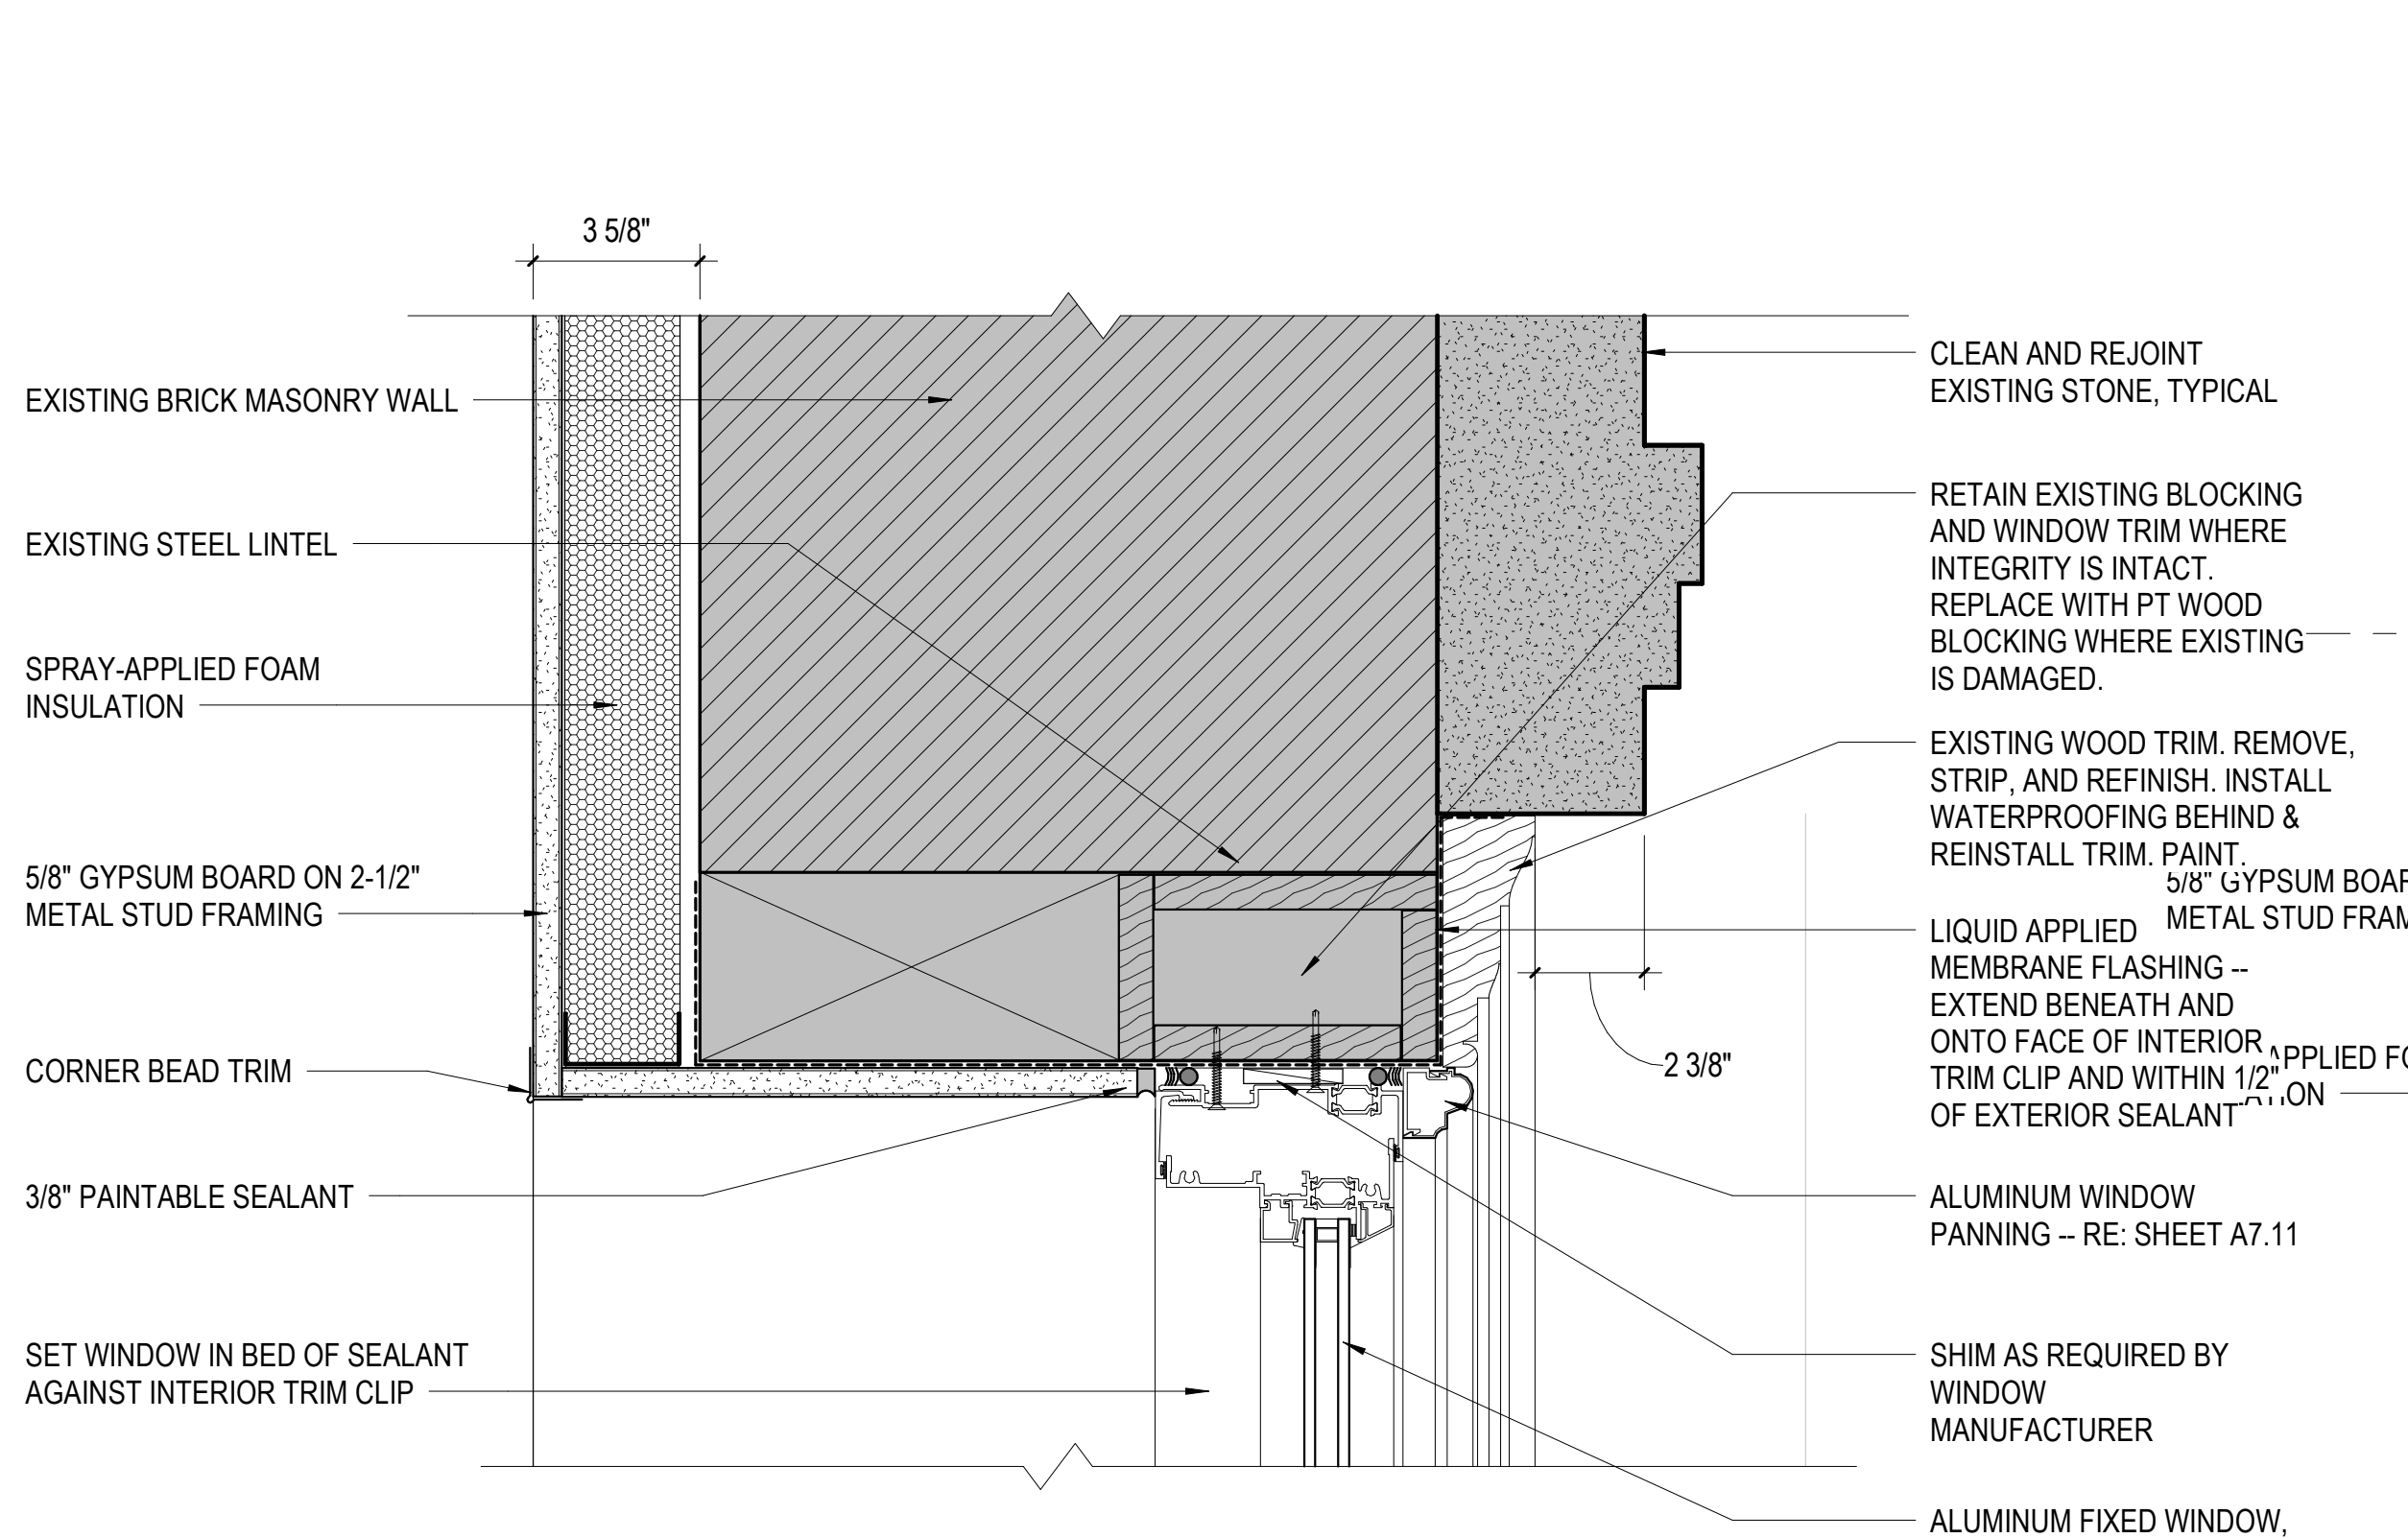


C4 DETAIL - JAMB AT WINDOW 09
3" = 1'-0"

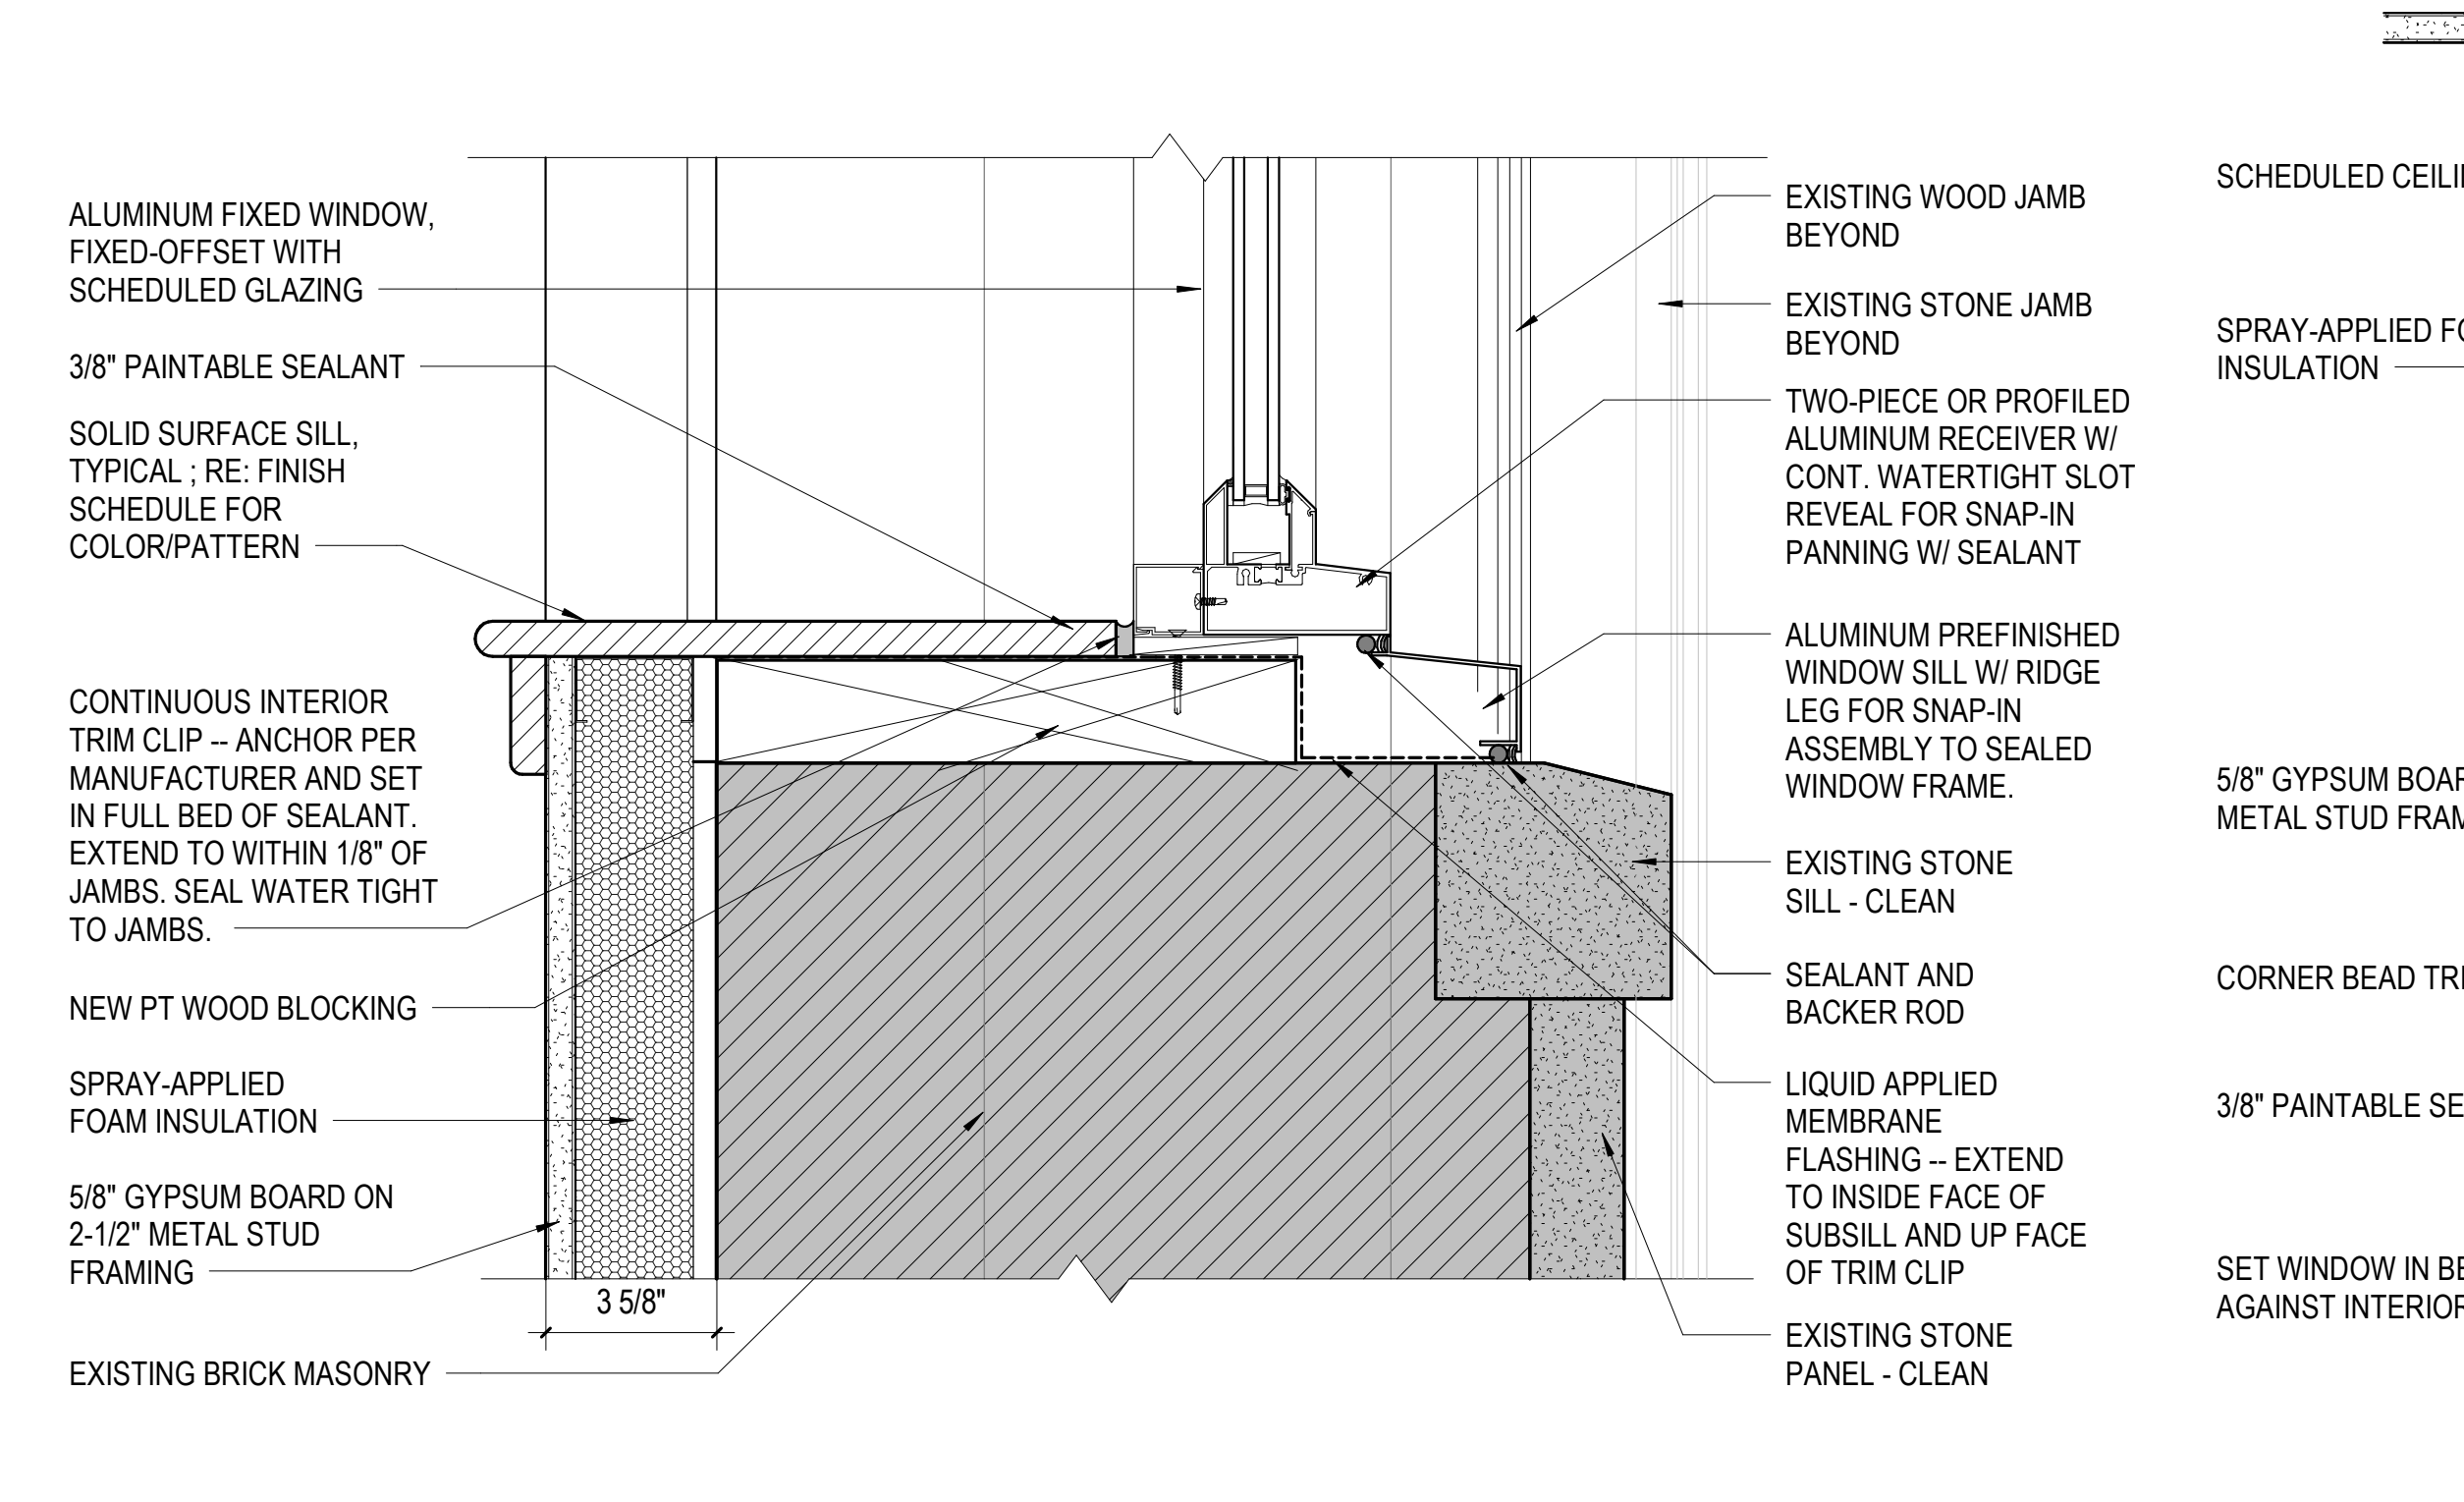


A4 DETAIL - WINDOW 09 SILL
3" = 1'-0"

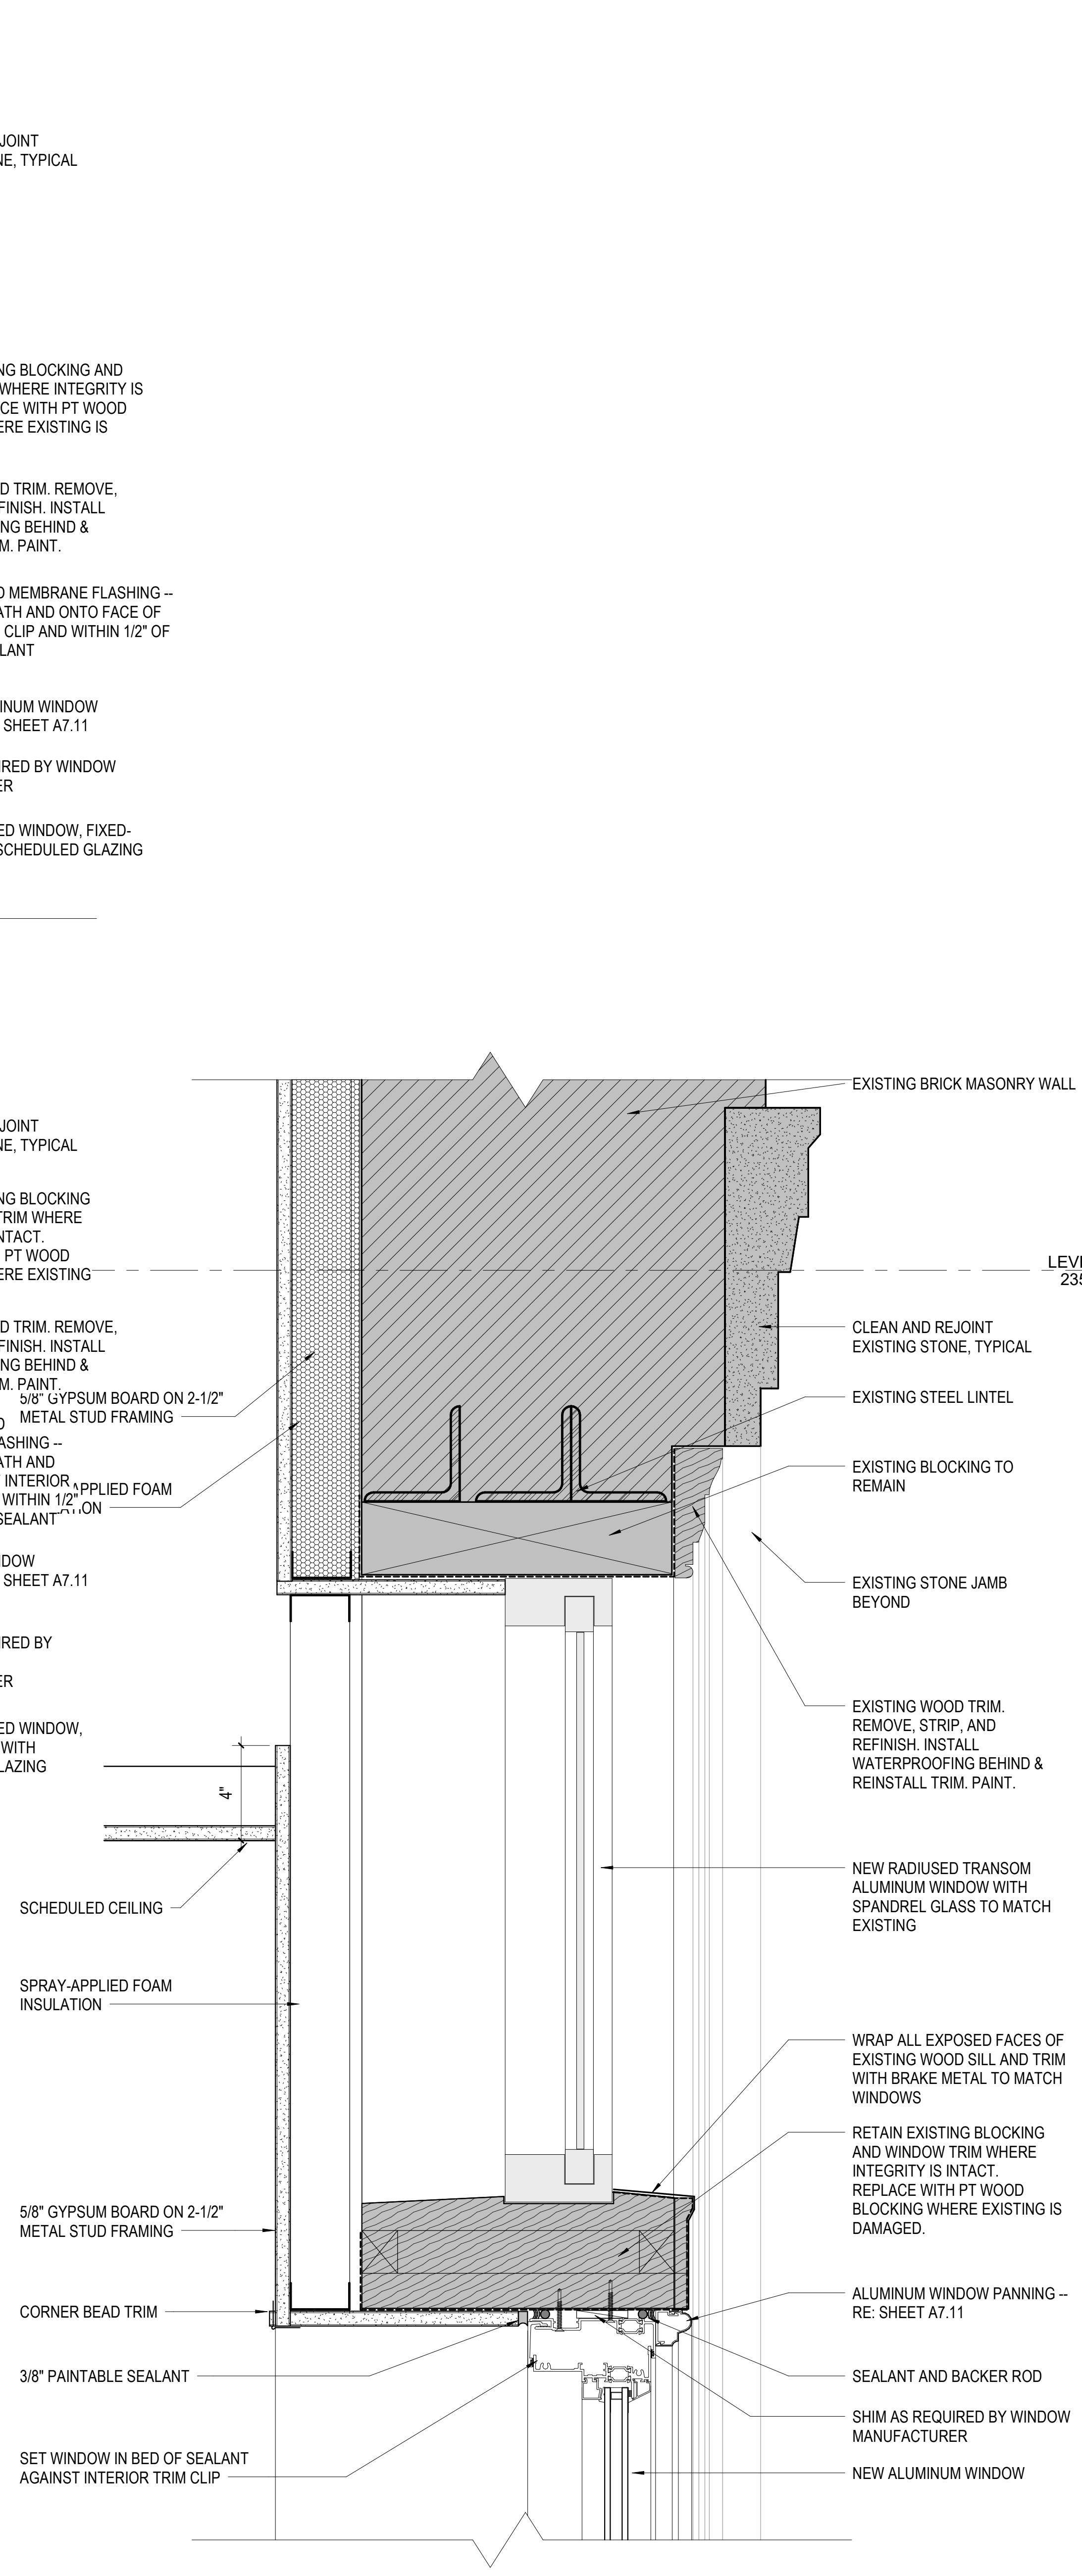


A2 DETAIL - WINDOW 15 AND 16
3" = 1'-0"

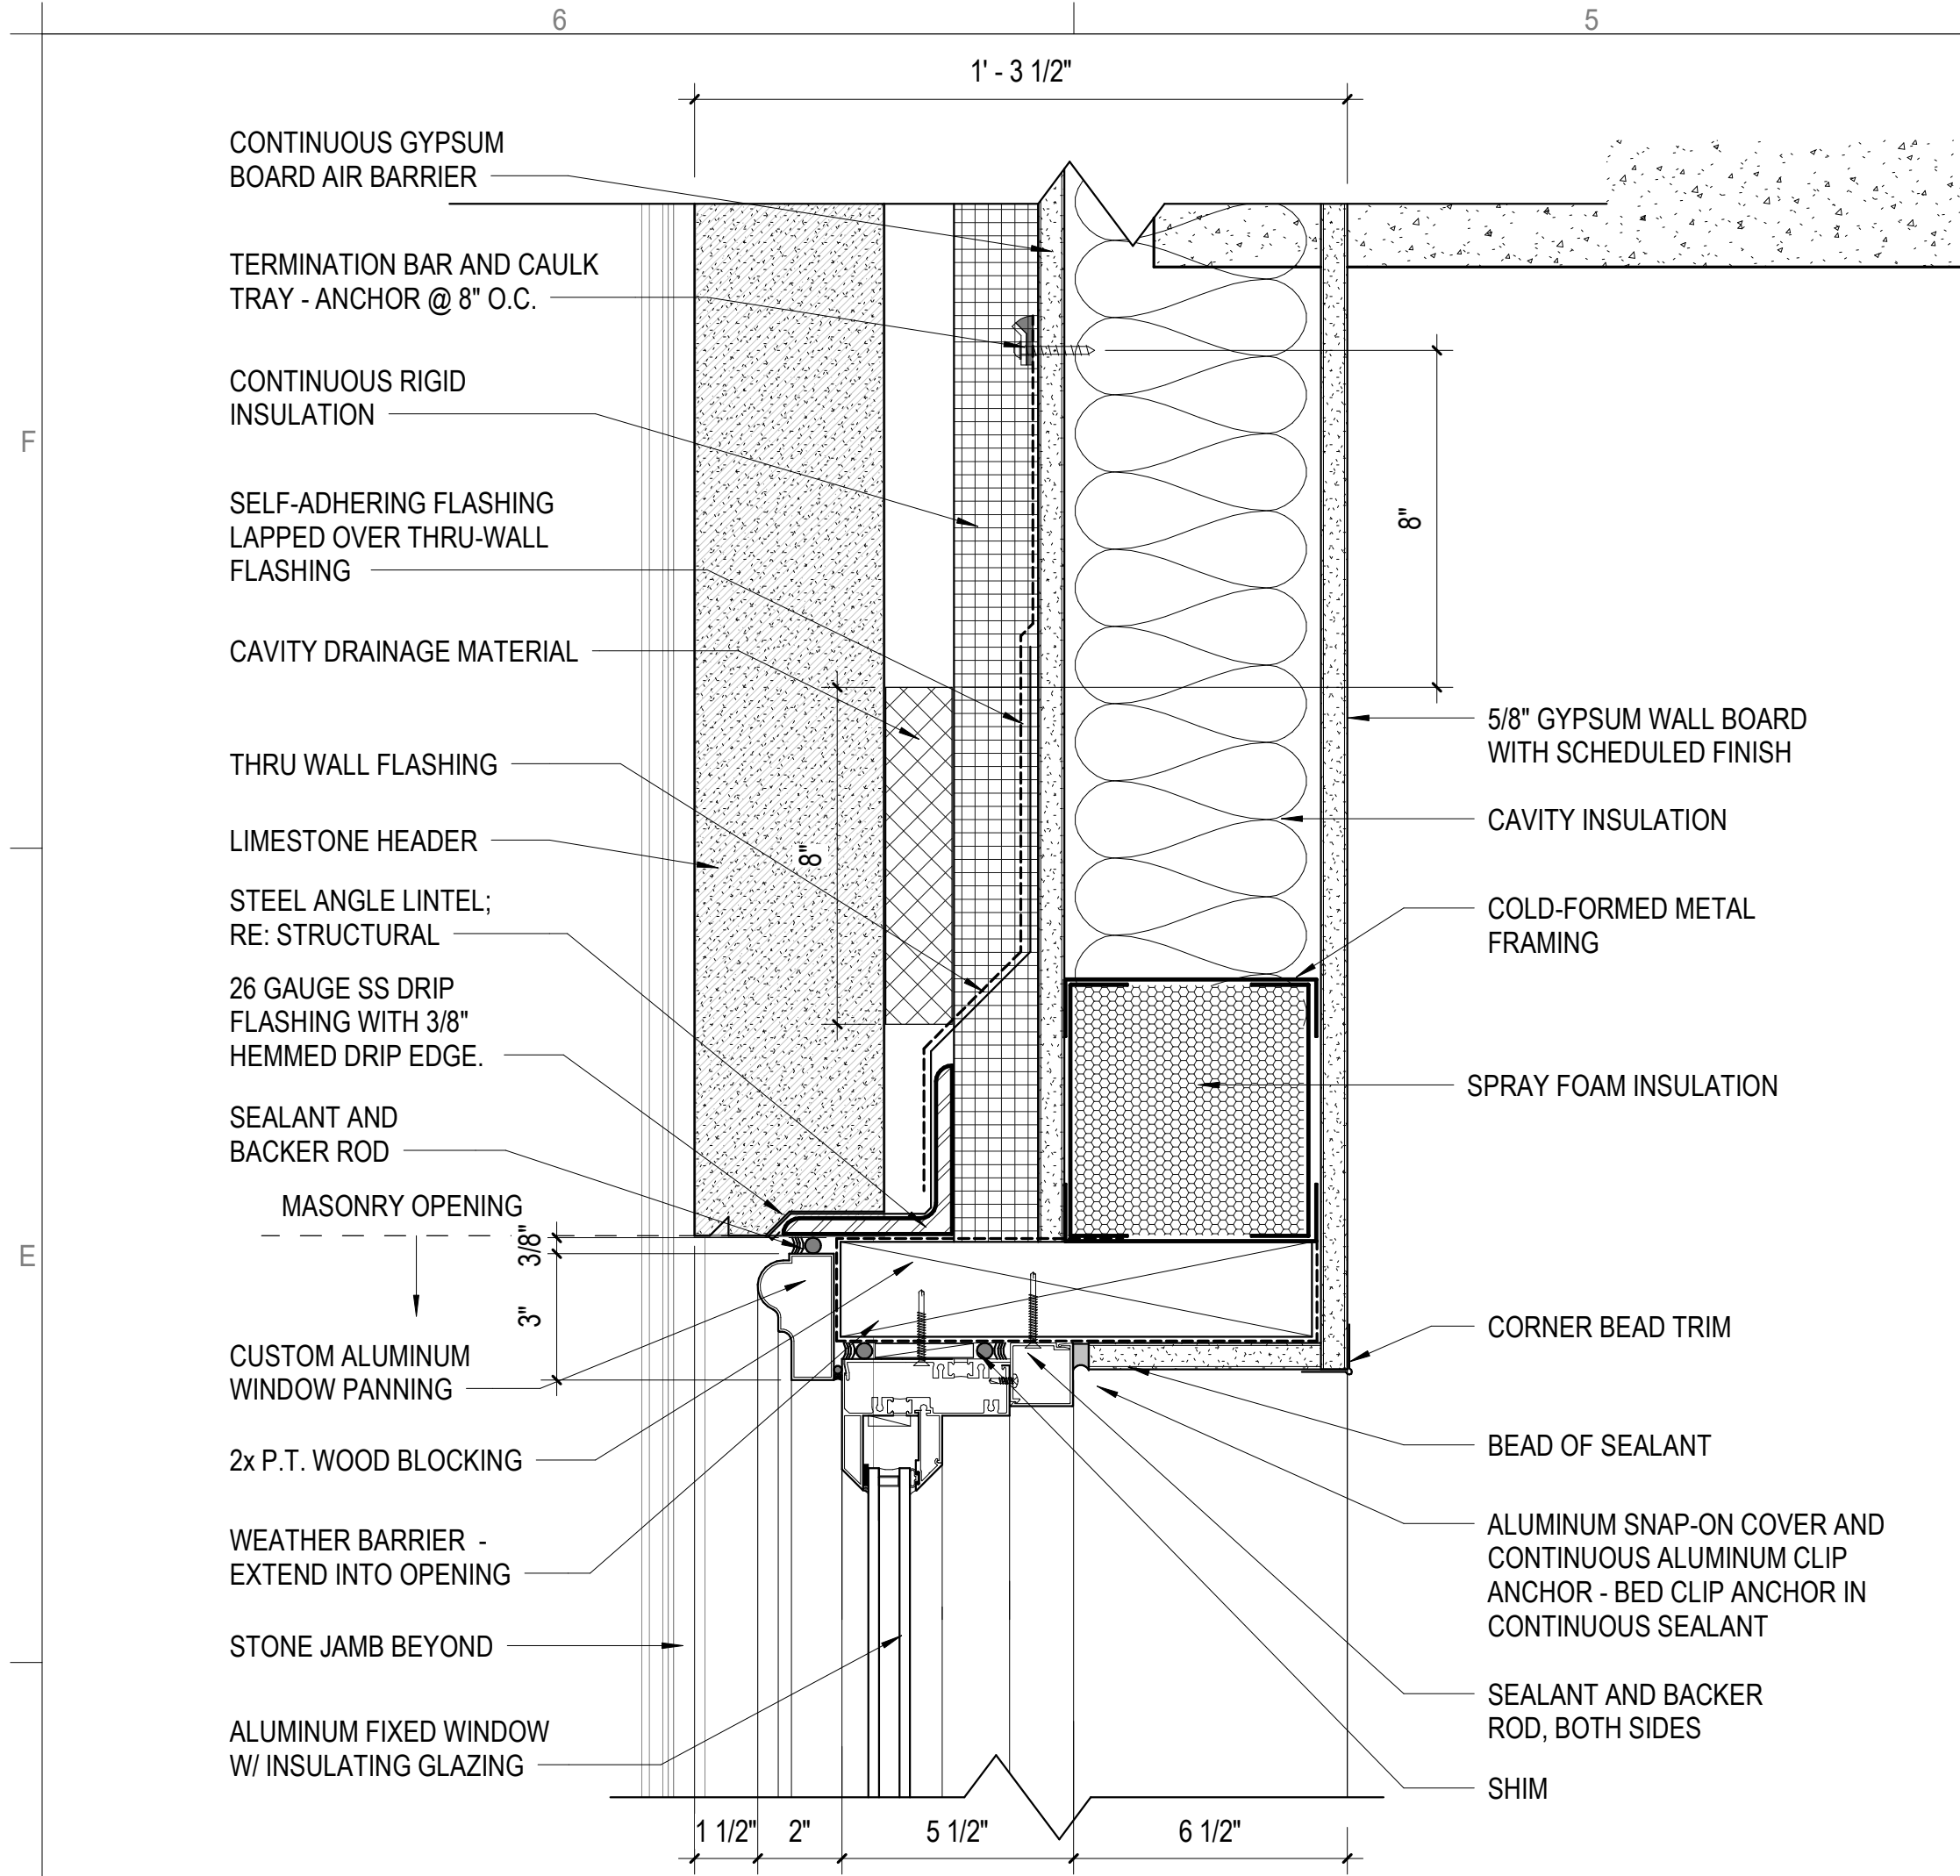


D6 DETAIL - WINDOW TYPE 03 HEAD
3" = 1'-0"

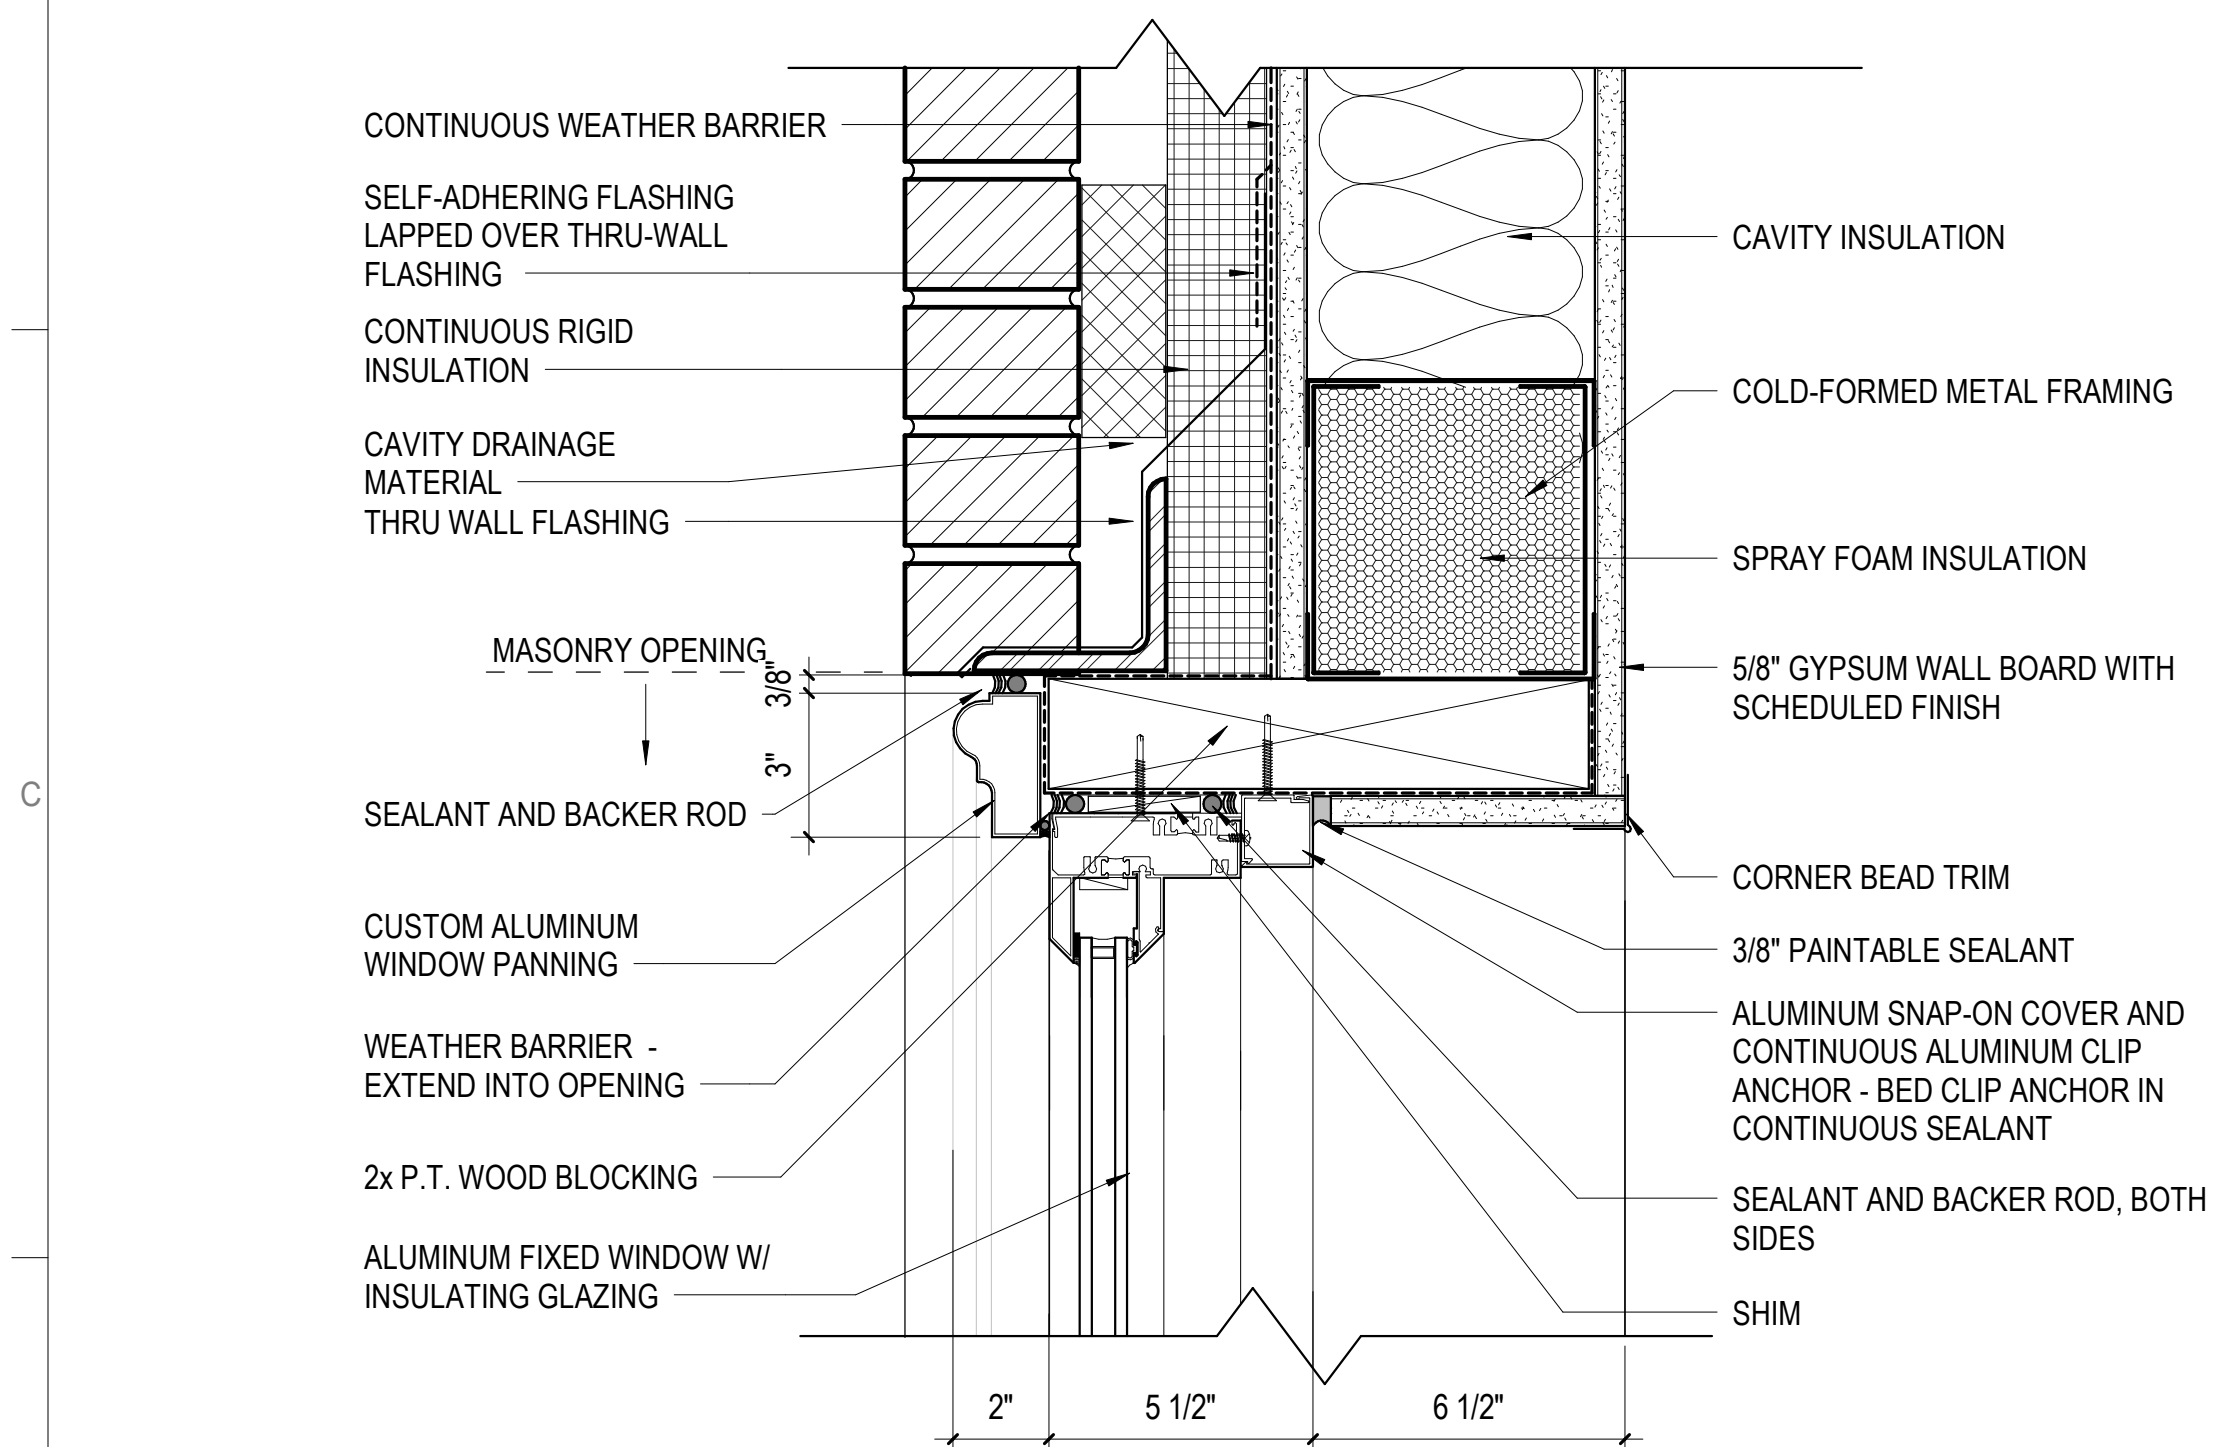


C6 DETAIL - WINDOW TYPE 05 HEAD
3" = 1'-0"

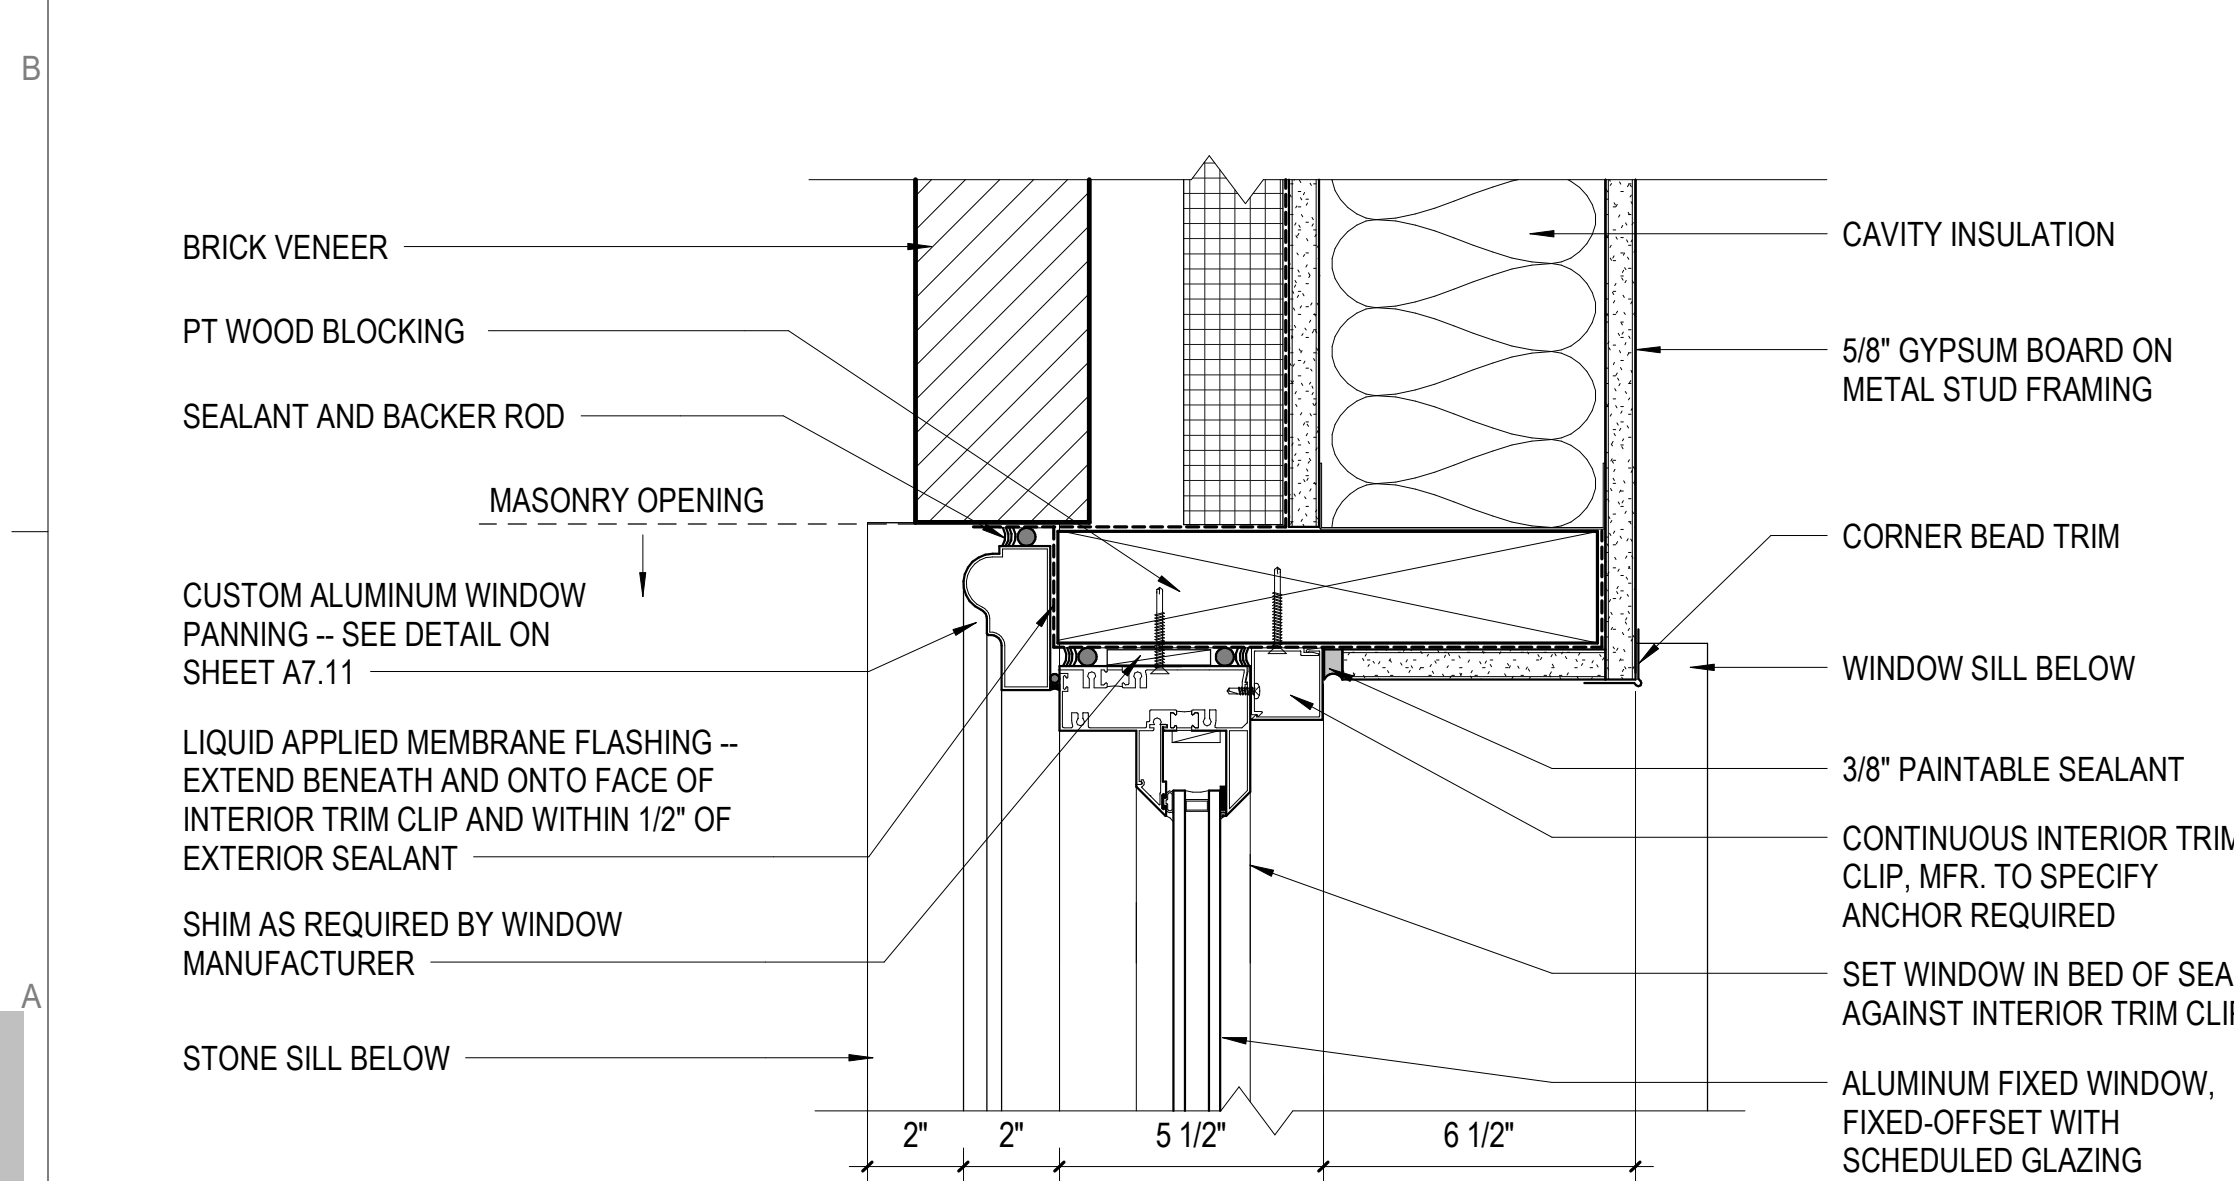


A6 DETAIL - WINDOW 05 JAMB
3" = 1'-0"

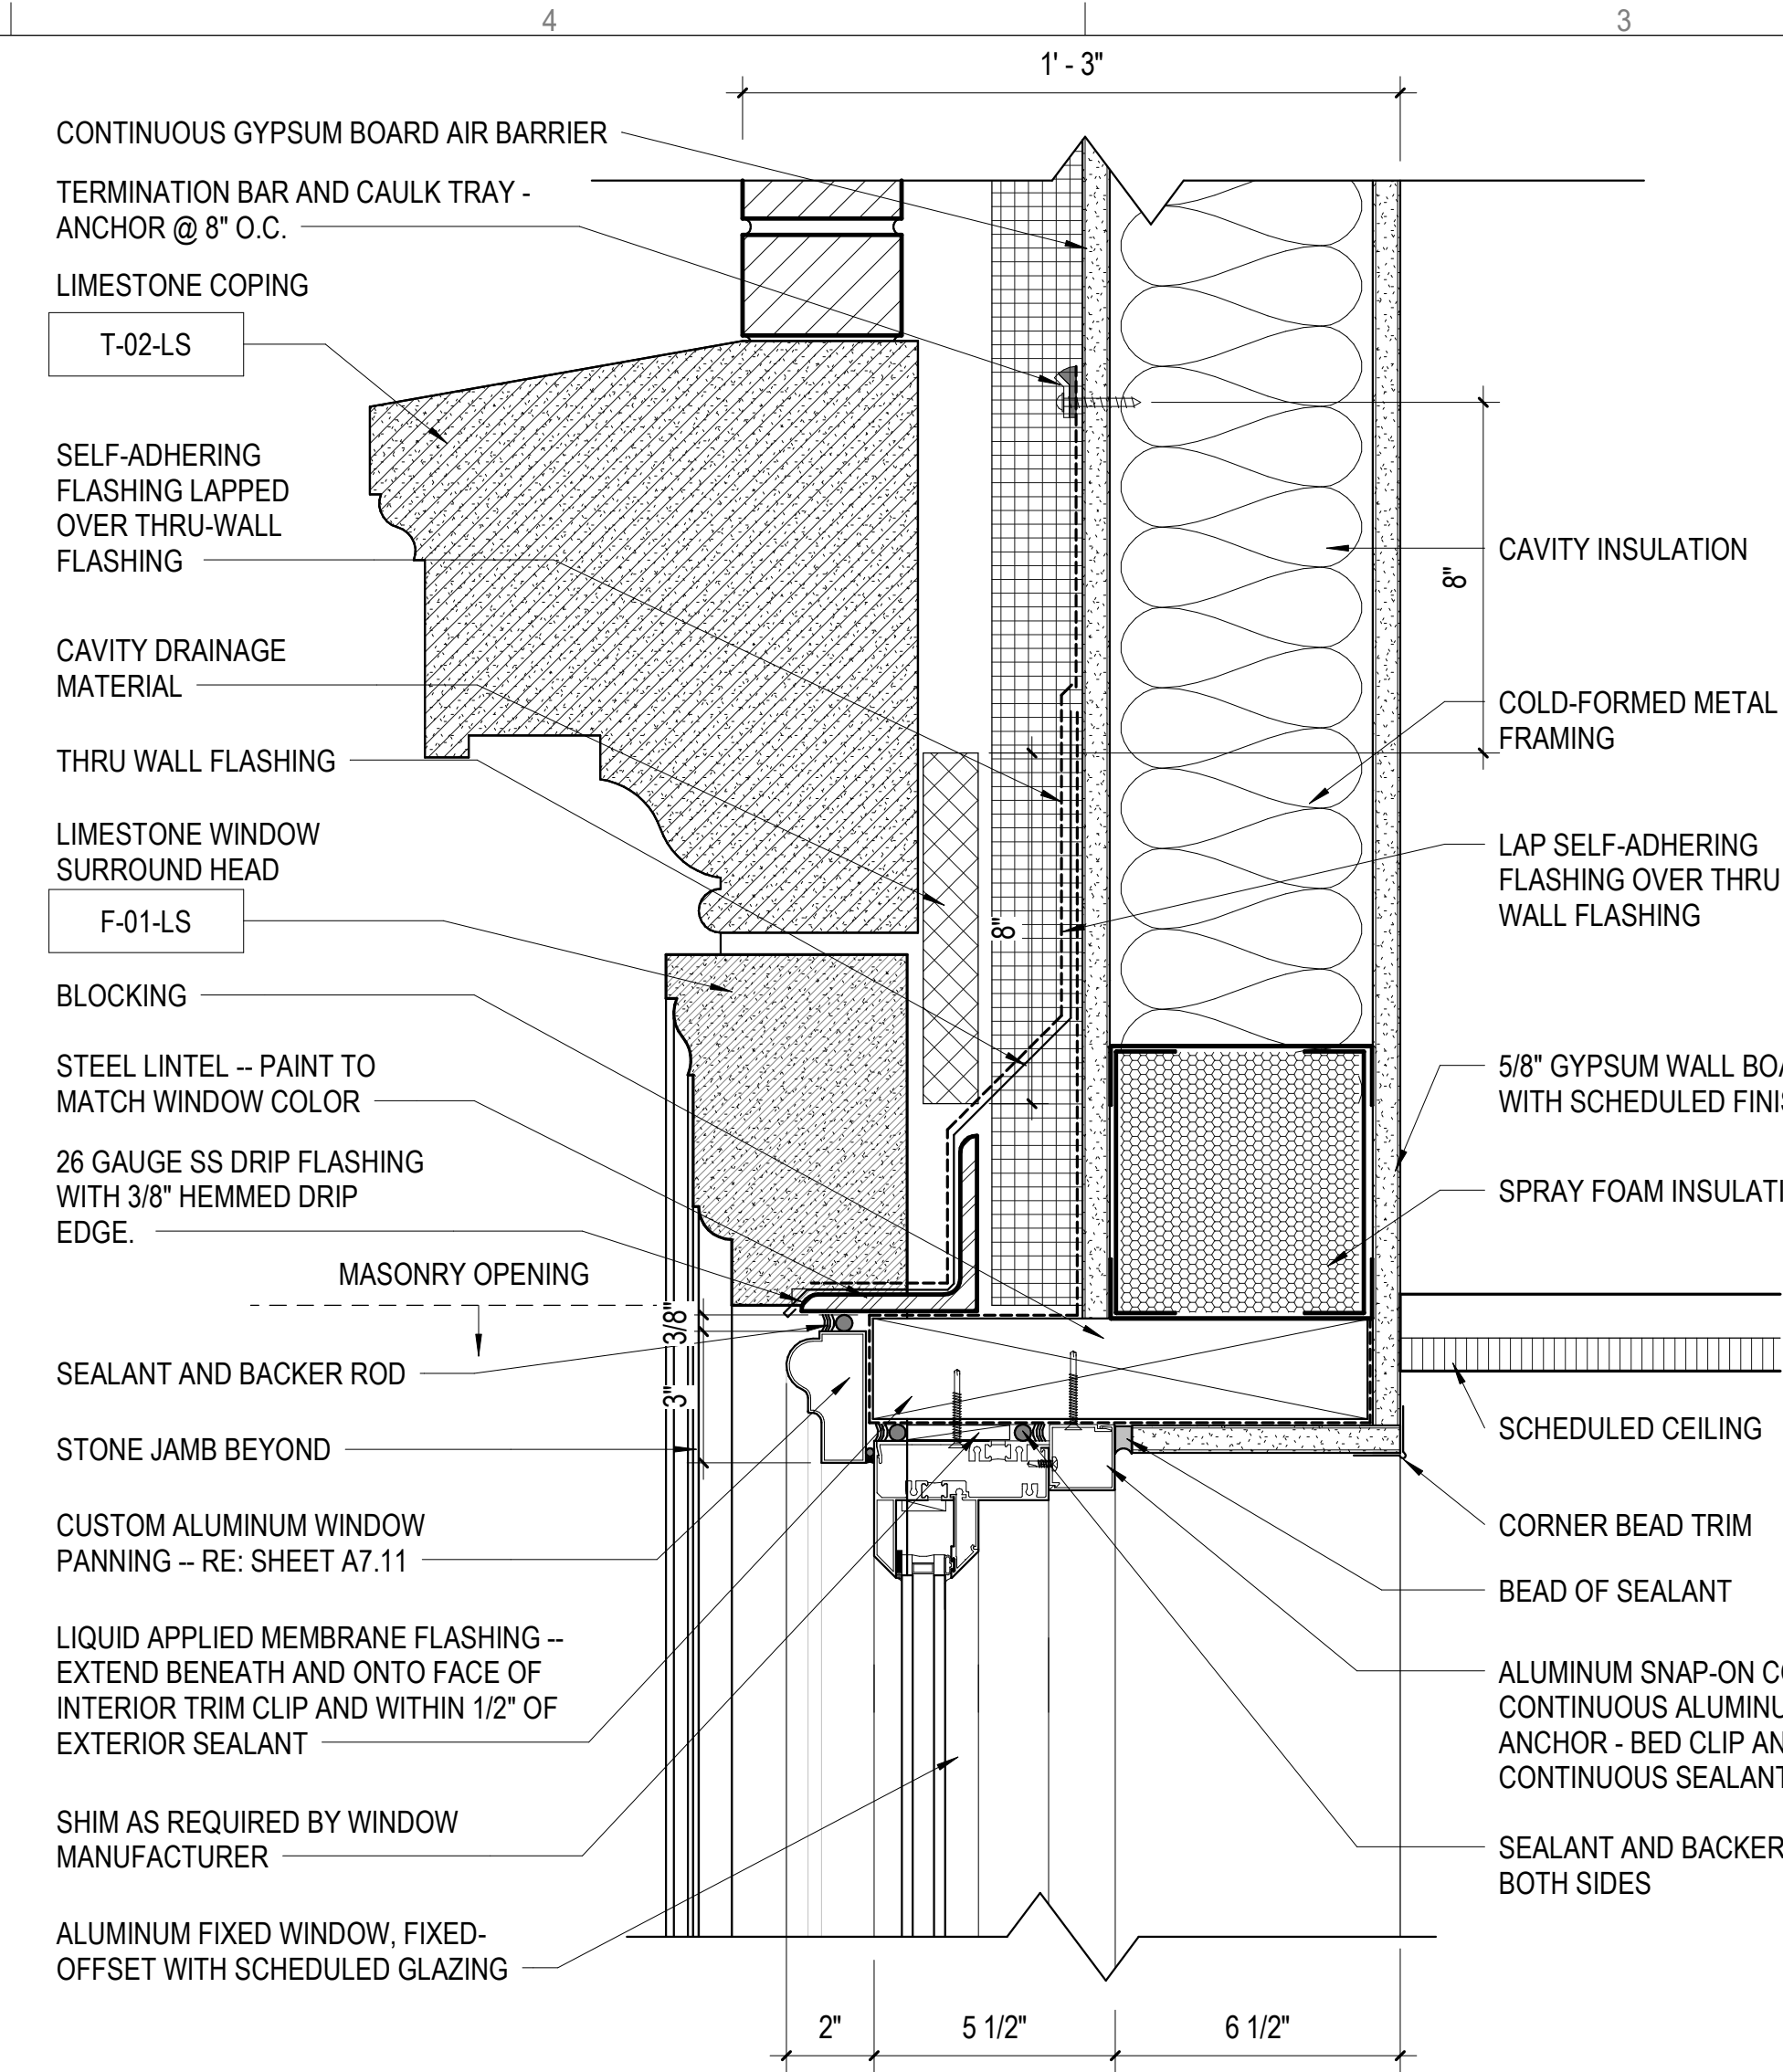


D4 DETAIL - WINDOW TYPE 04 HEAD
3" = 1'-0"

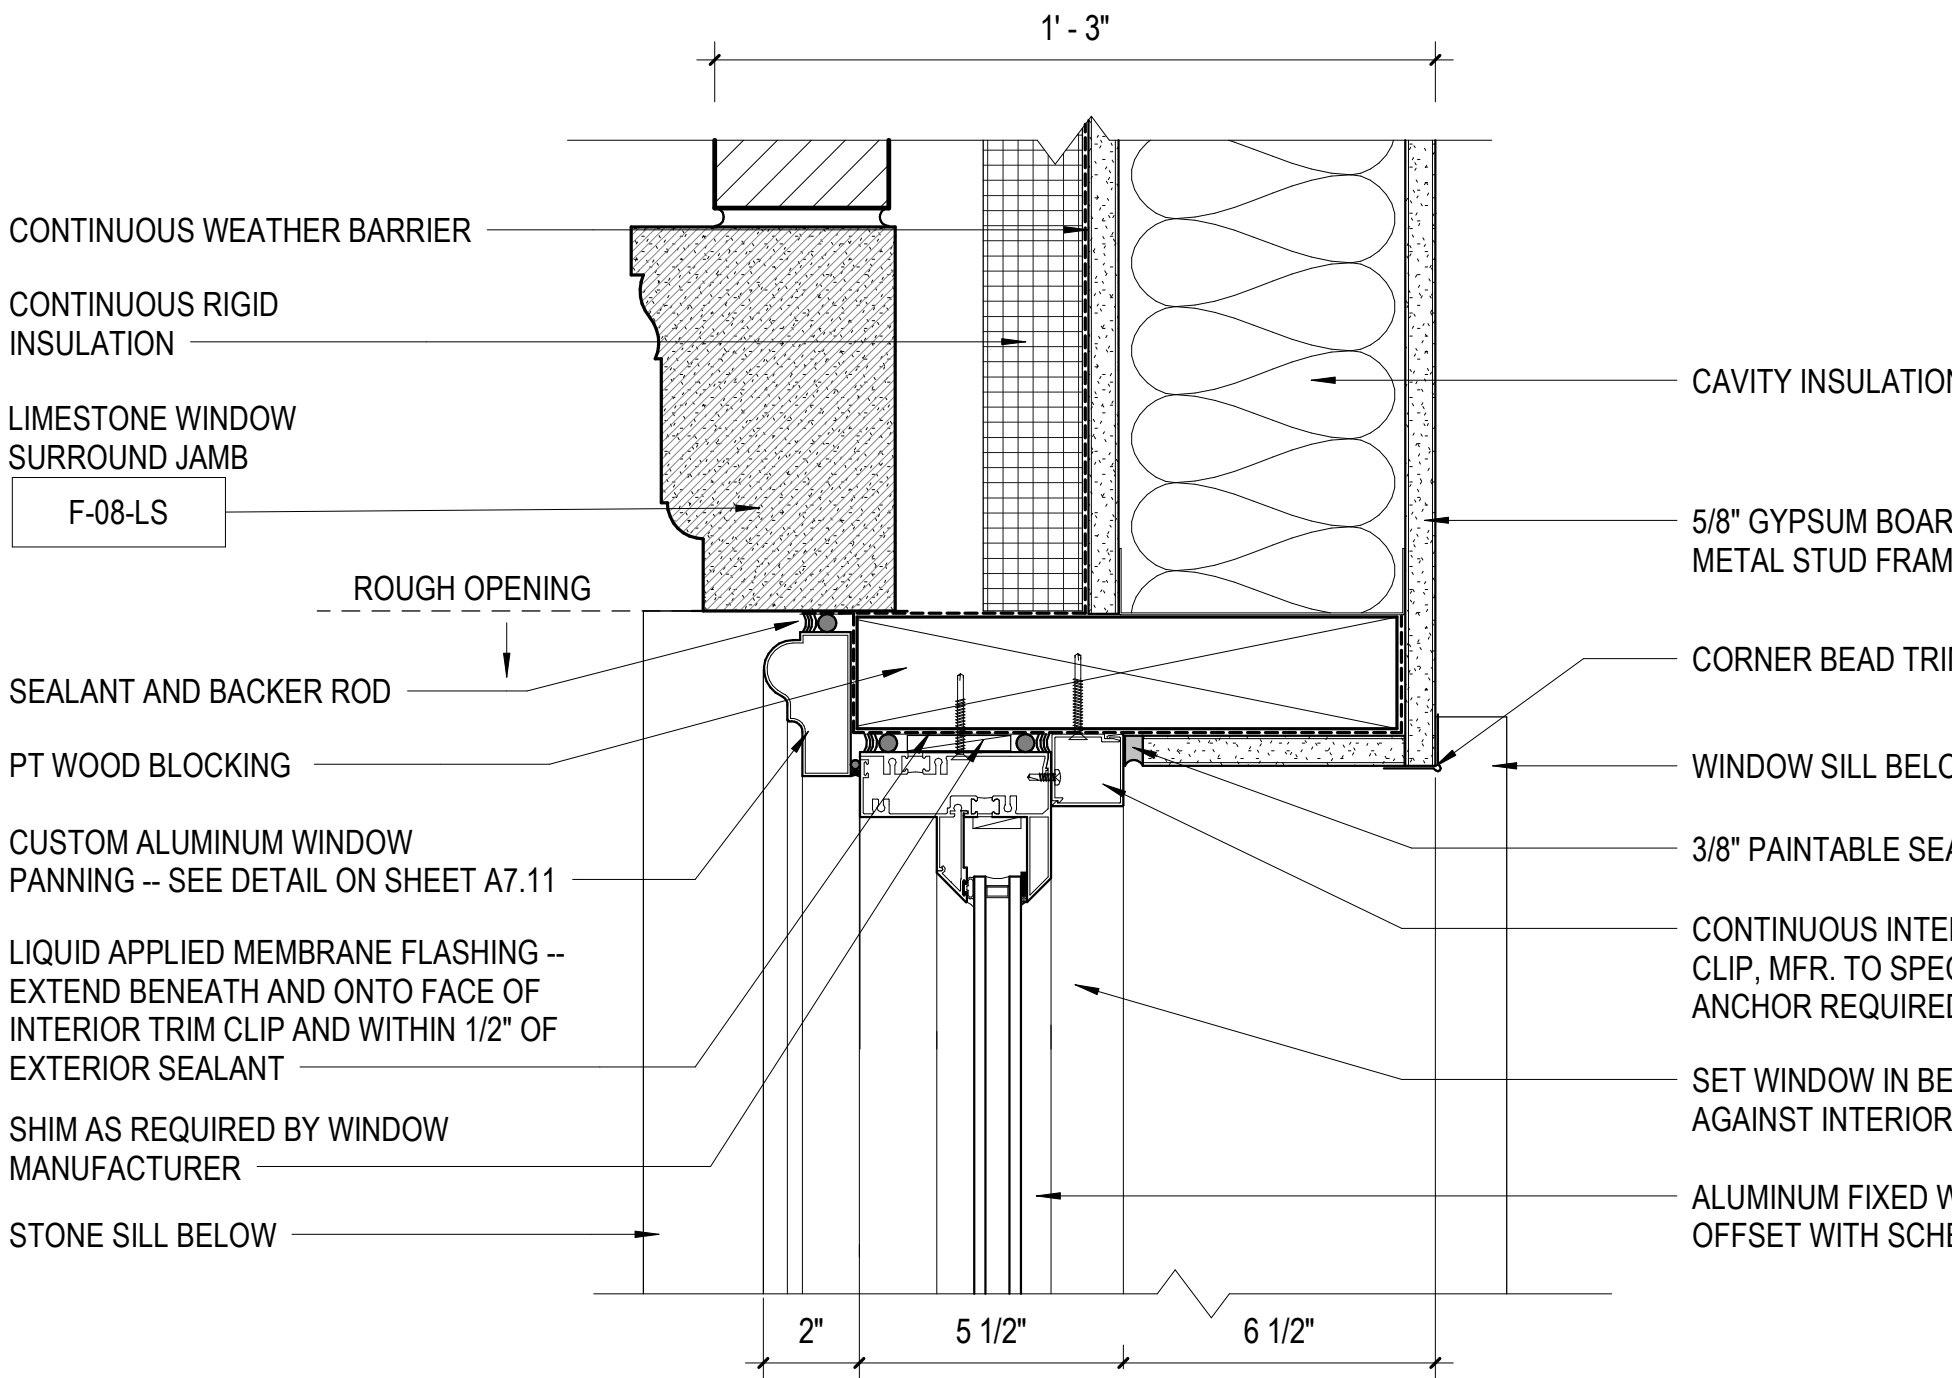


C4 DETAIL - WINDOW TYPE 03 AND 04 JAMB
3" = 1'-0"

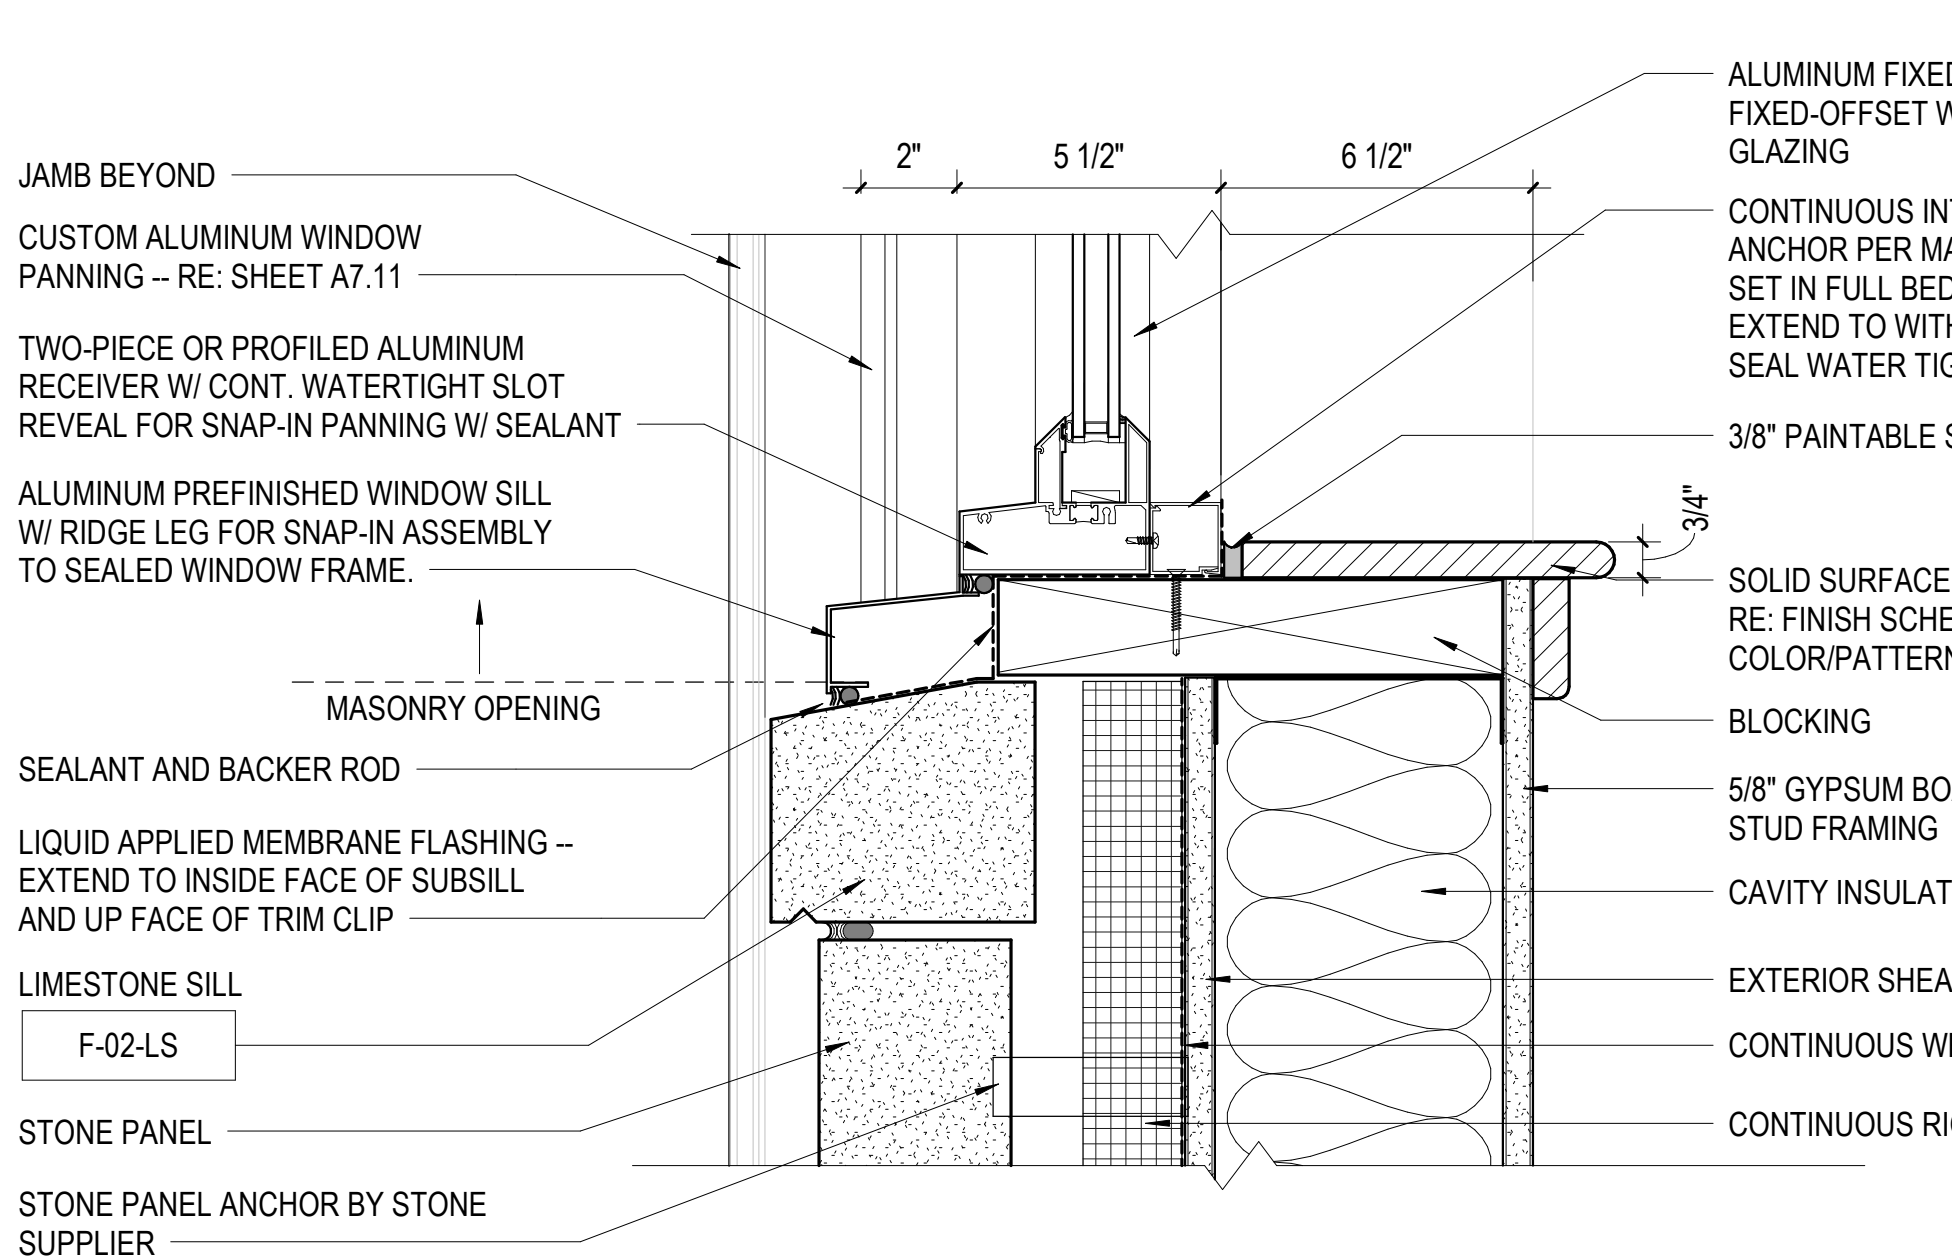


A4 DETAIL - WINDOW TYPE 03 AND 04 SILL
3" = 1'-0"

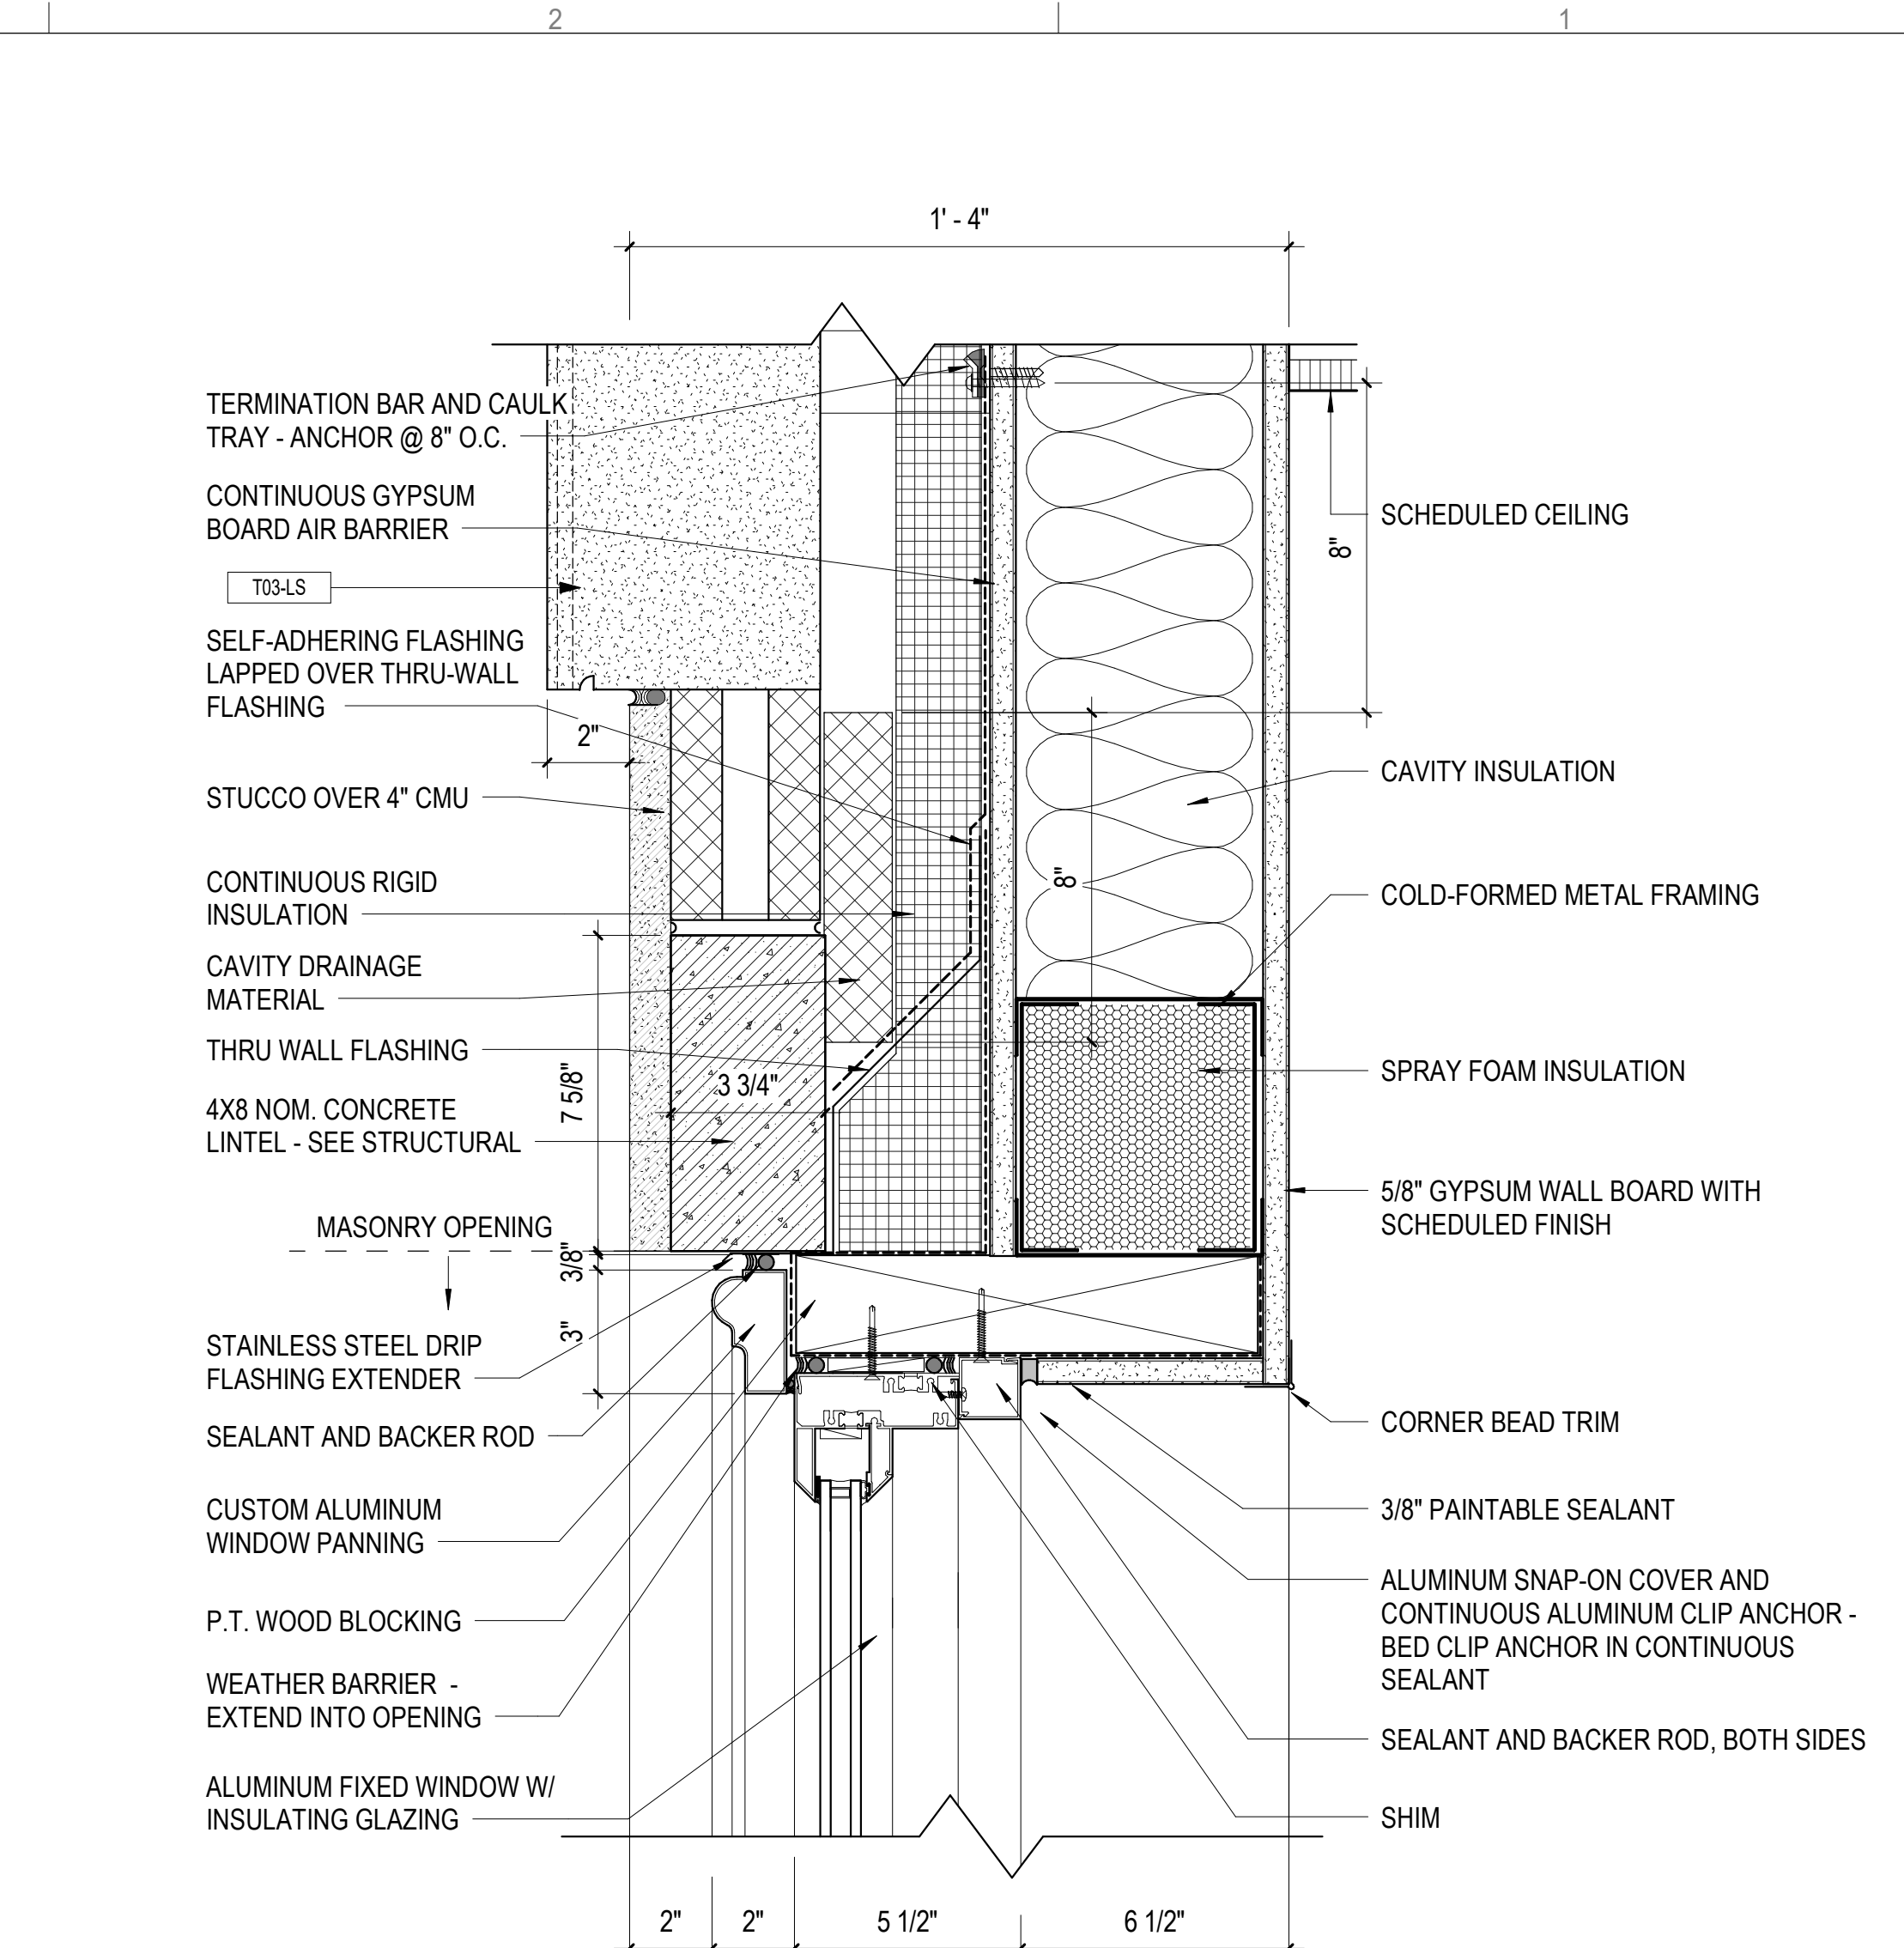


D2 DETAIL - WINDOW TYPE 06 HEAD
3" = 1'-0"

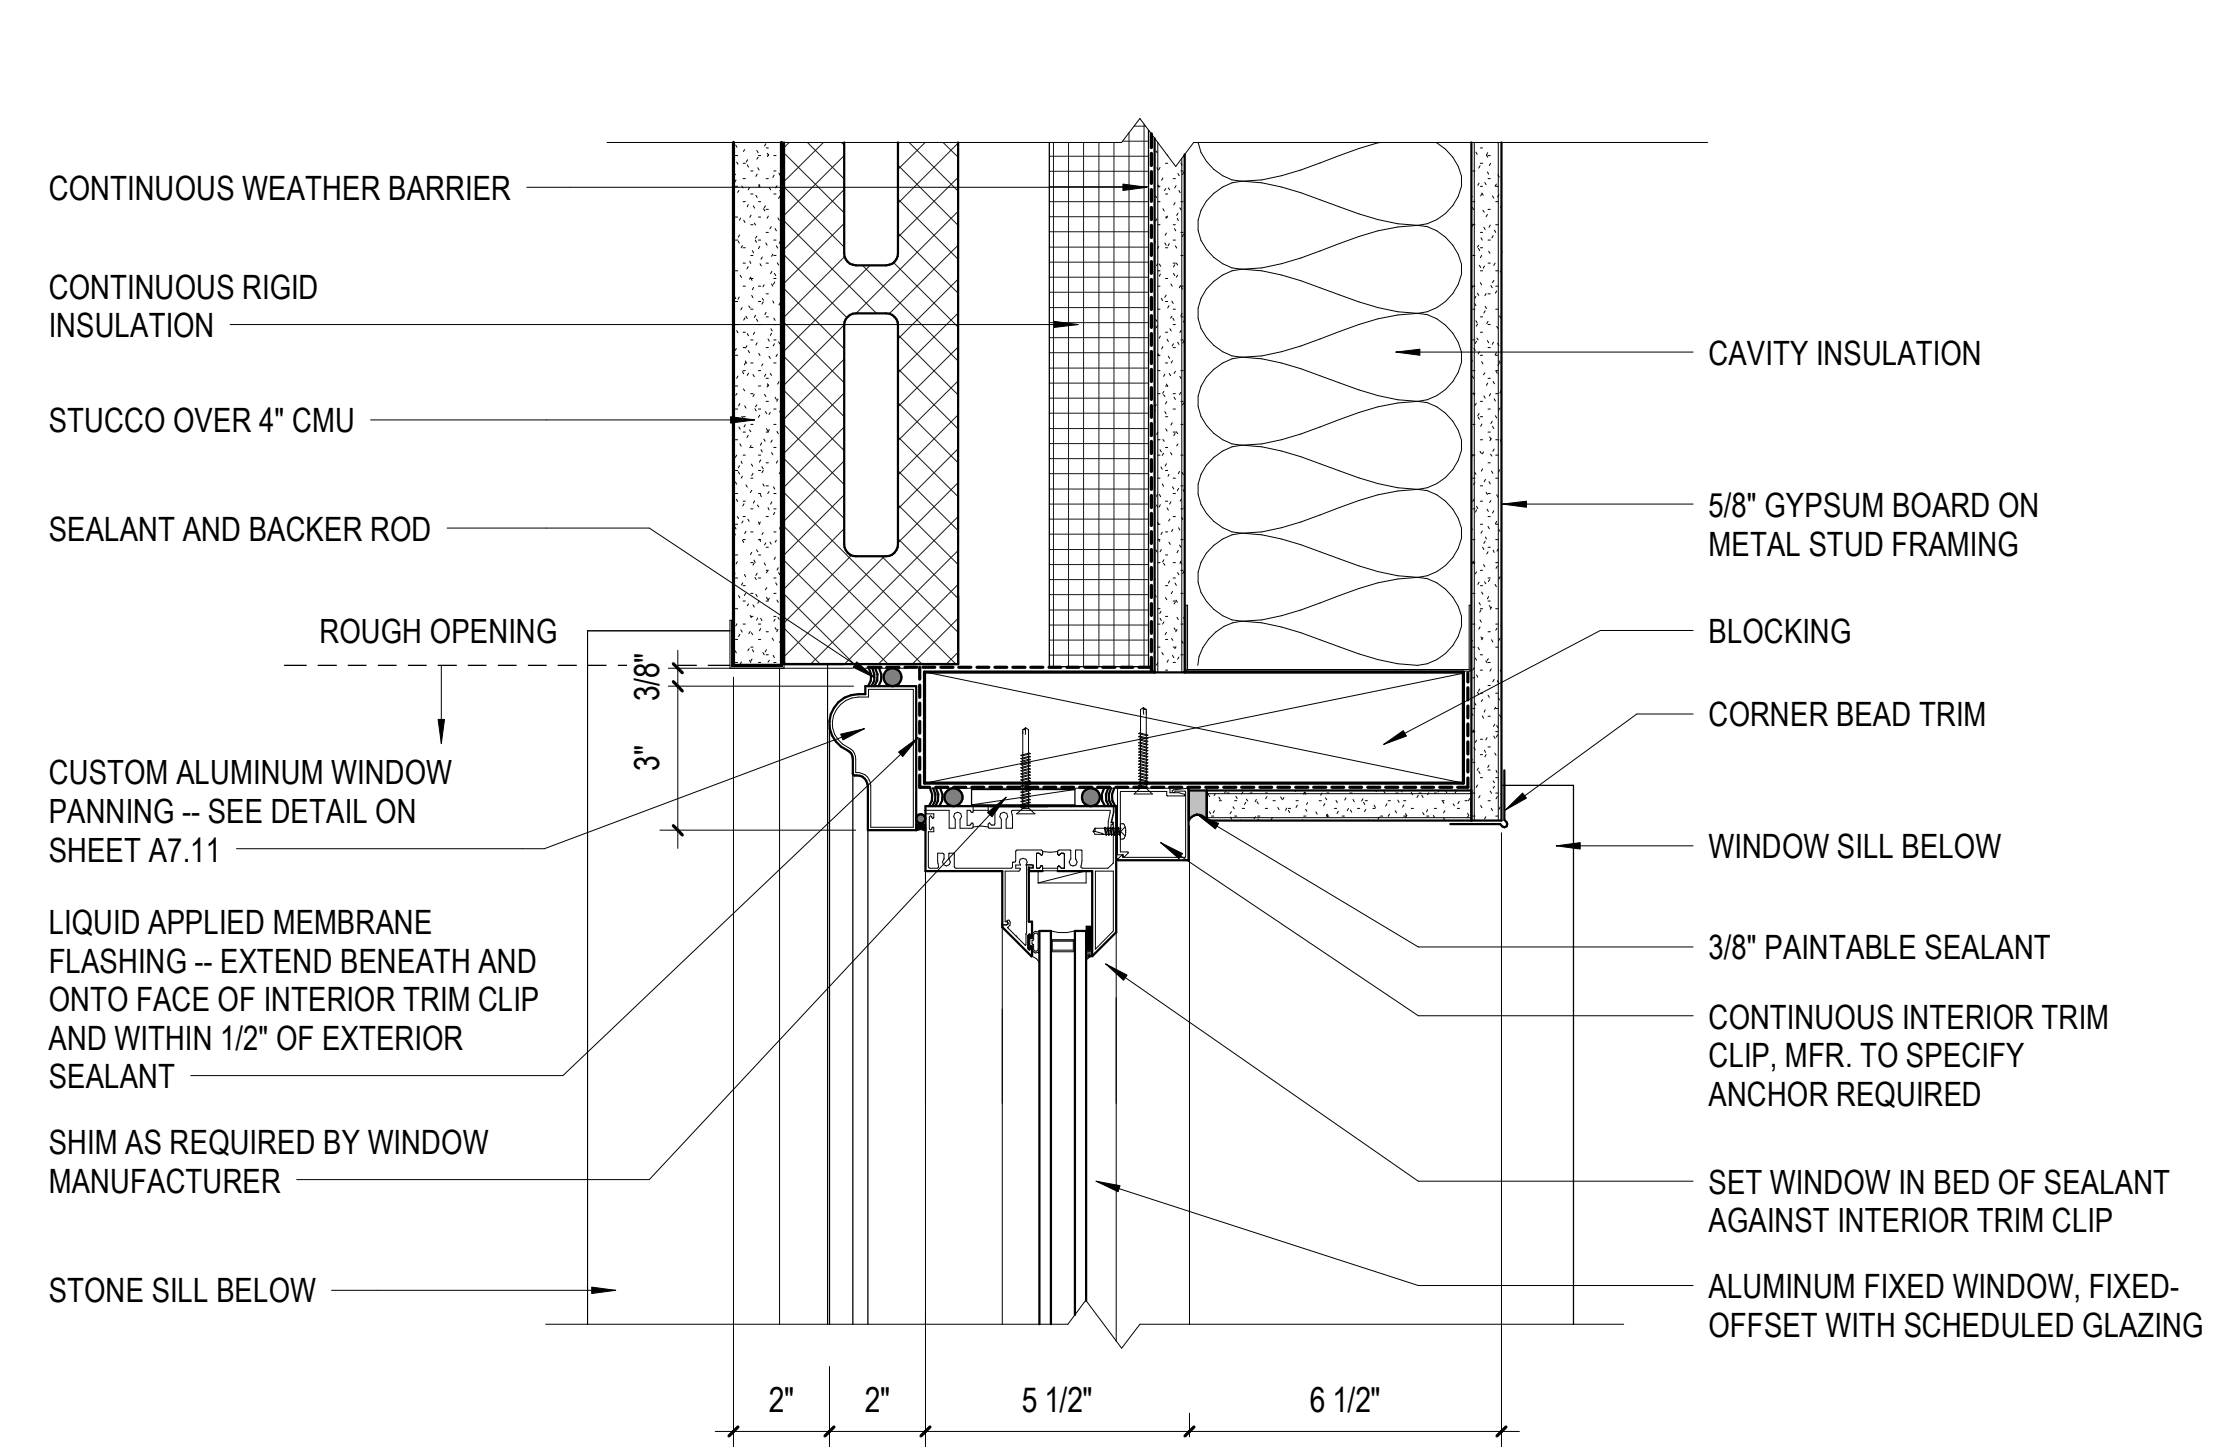


C2 DETAIL - WINDOW TYPE 06 JAMB1
3" = 1'-0"

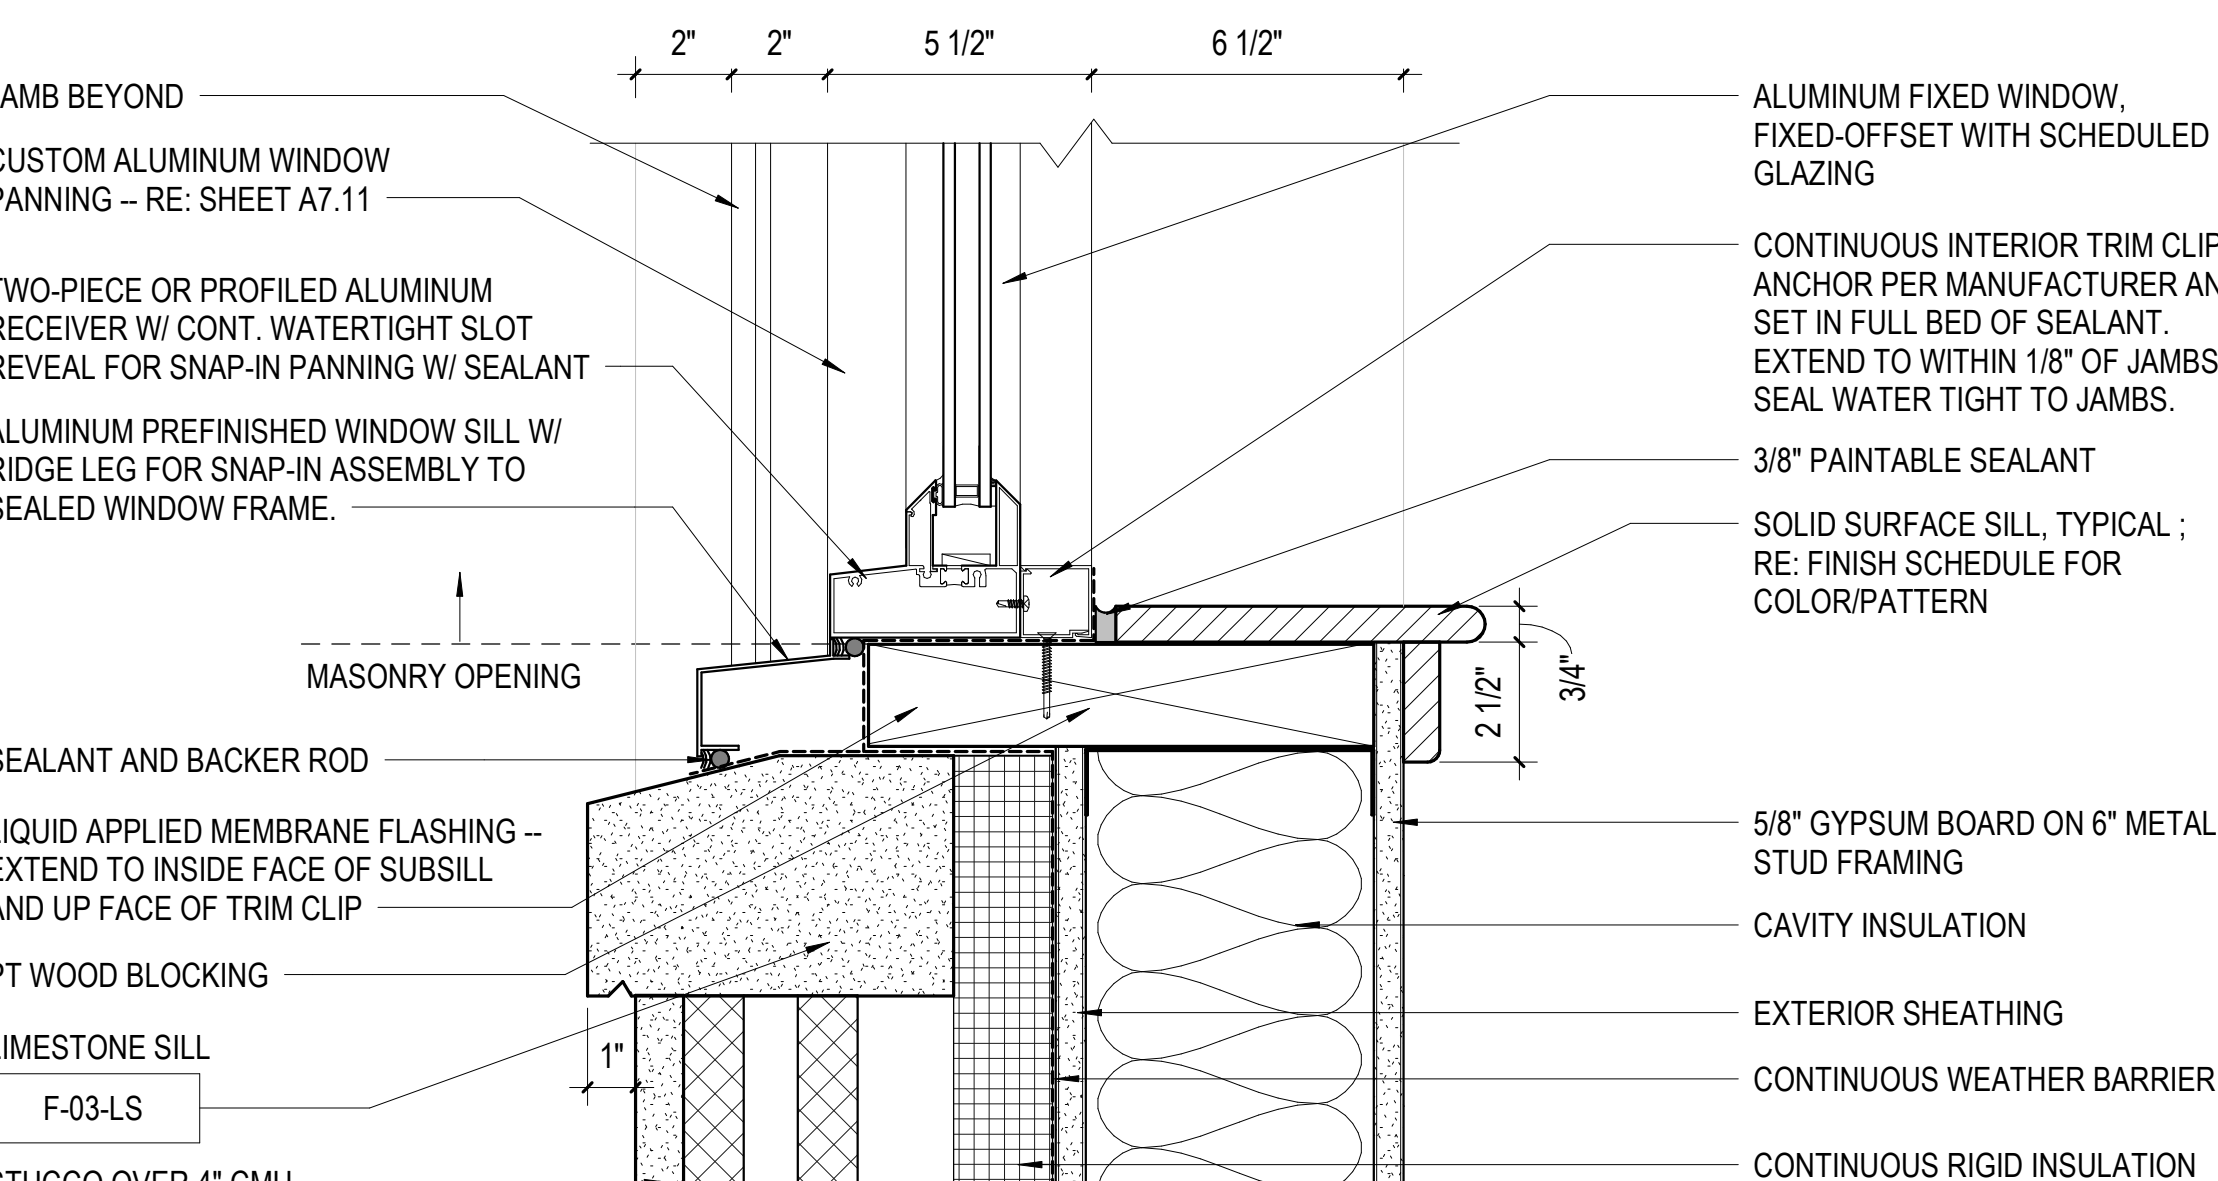


A2 DETAIL - WINDOW TYPE 06 SILL
3" = 1'-0"

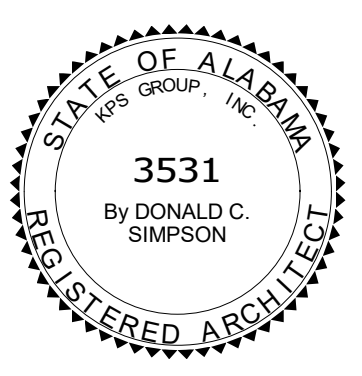


A4 LOUVER JAMB
6" = 1'-0"

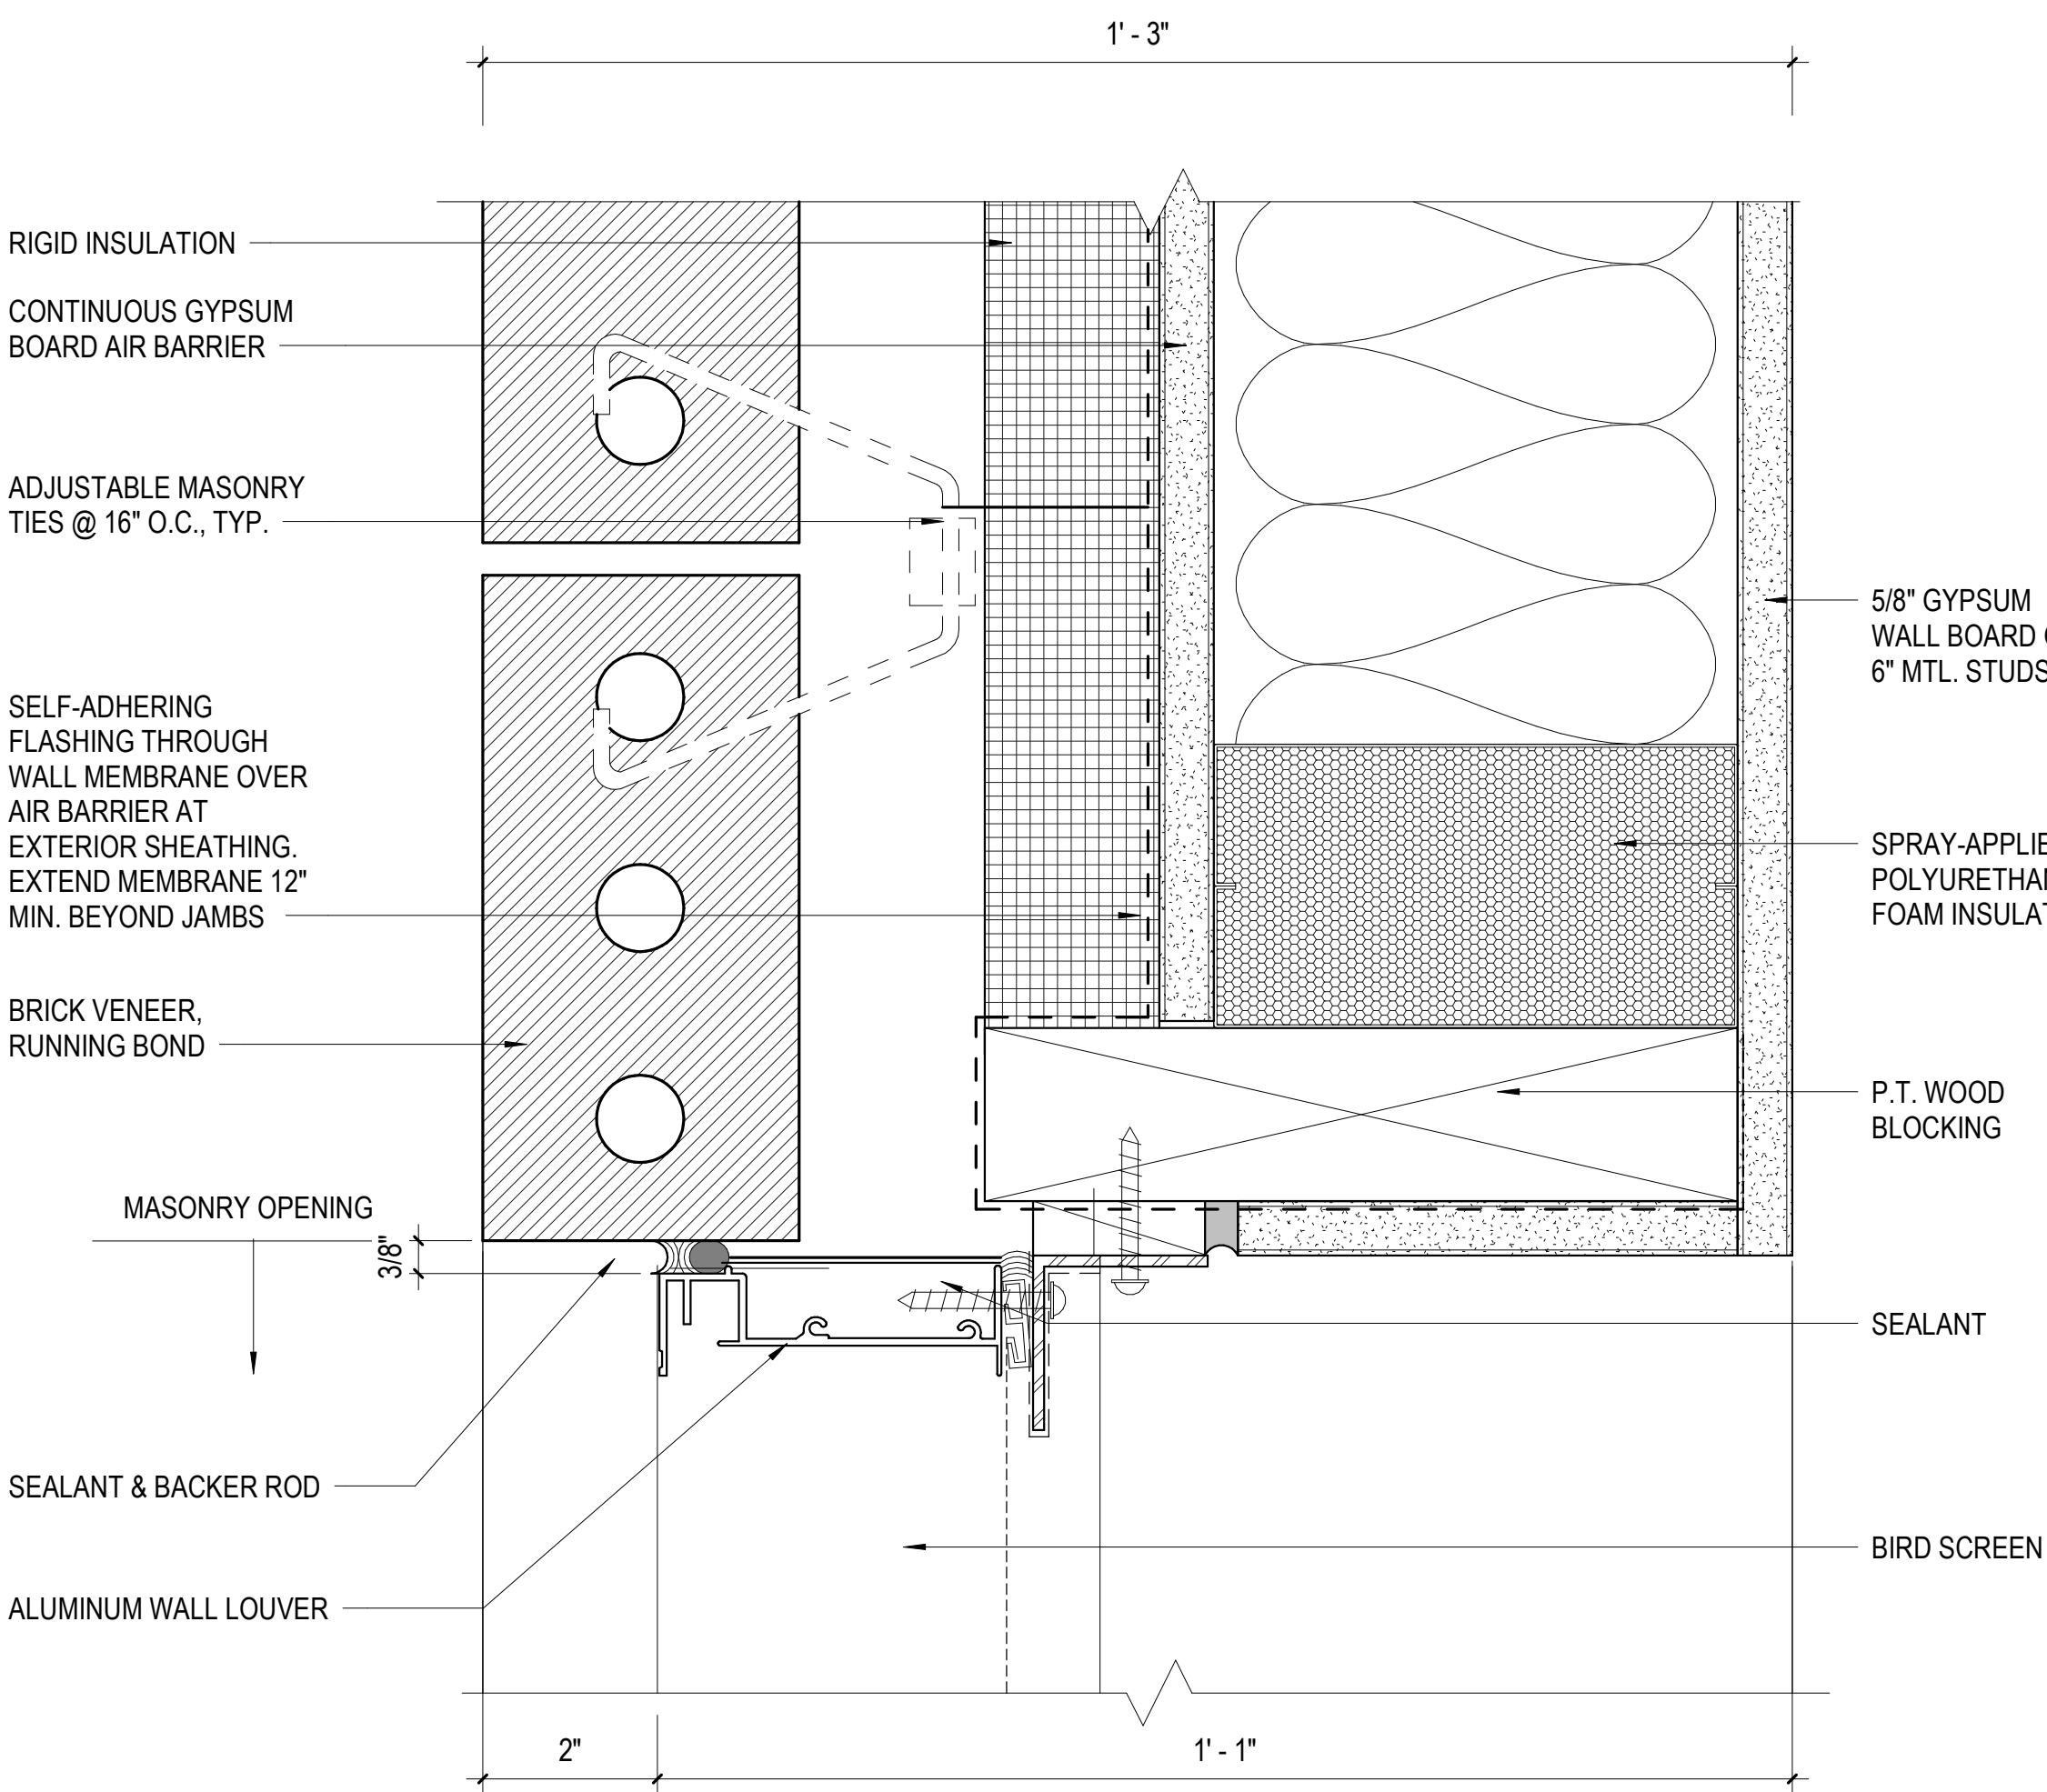



A2 DETAIL - LOUVER SILL
3" = 1'-0"

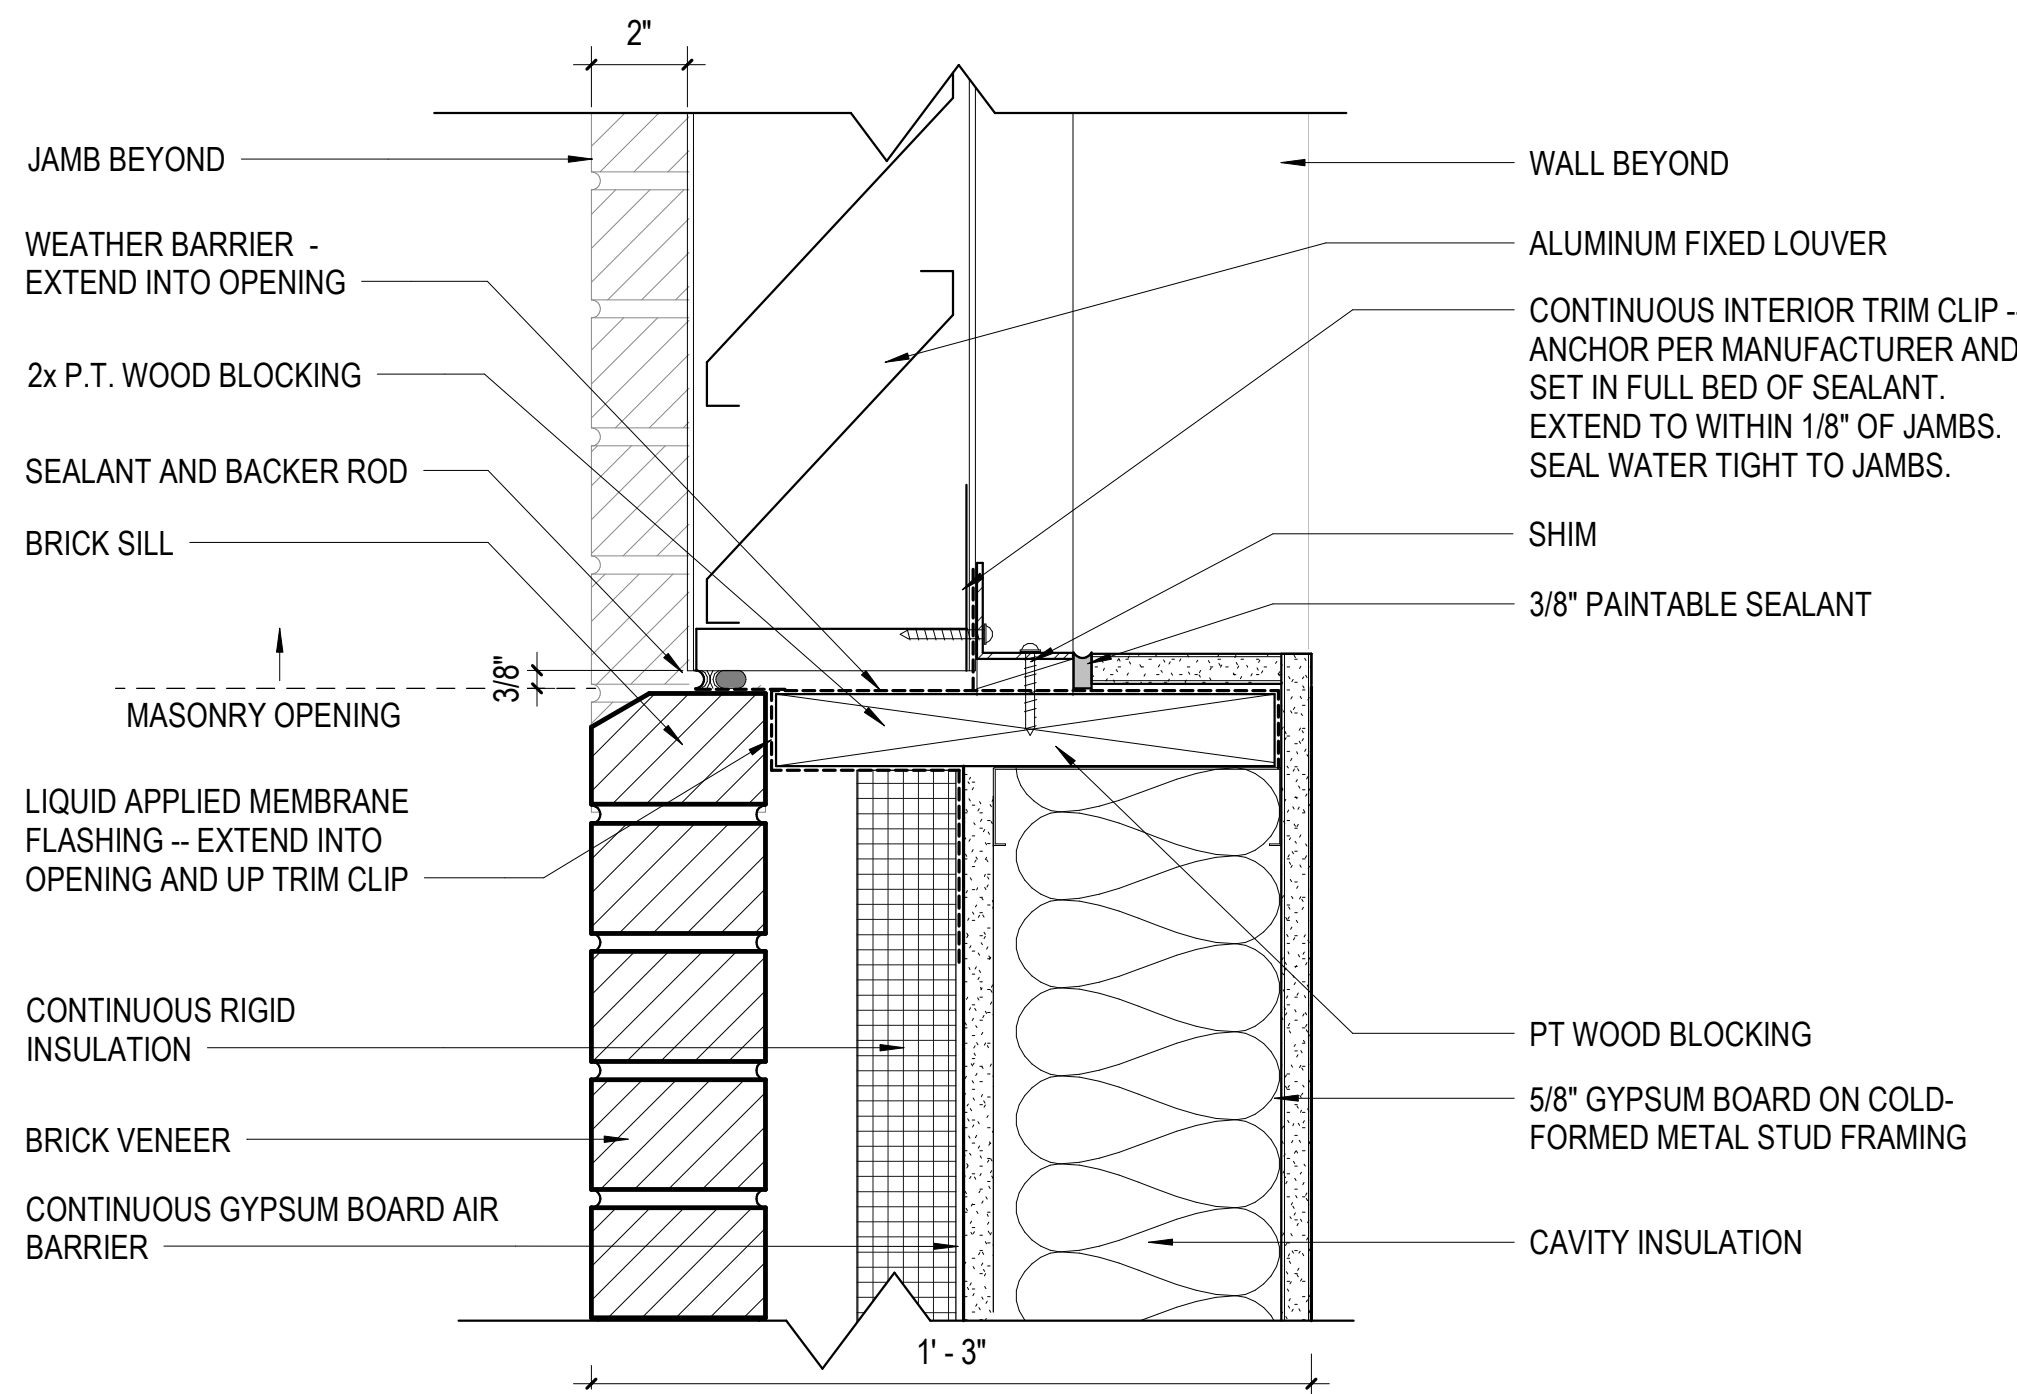

C2 DETAIL - LOUVER HEAD
3" = 1'-0"

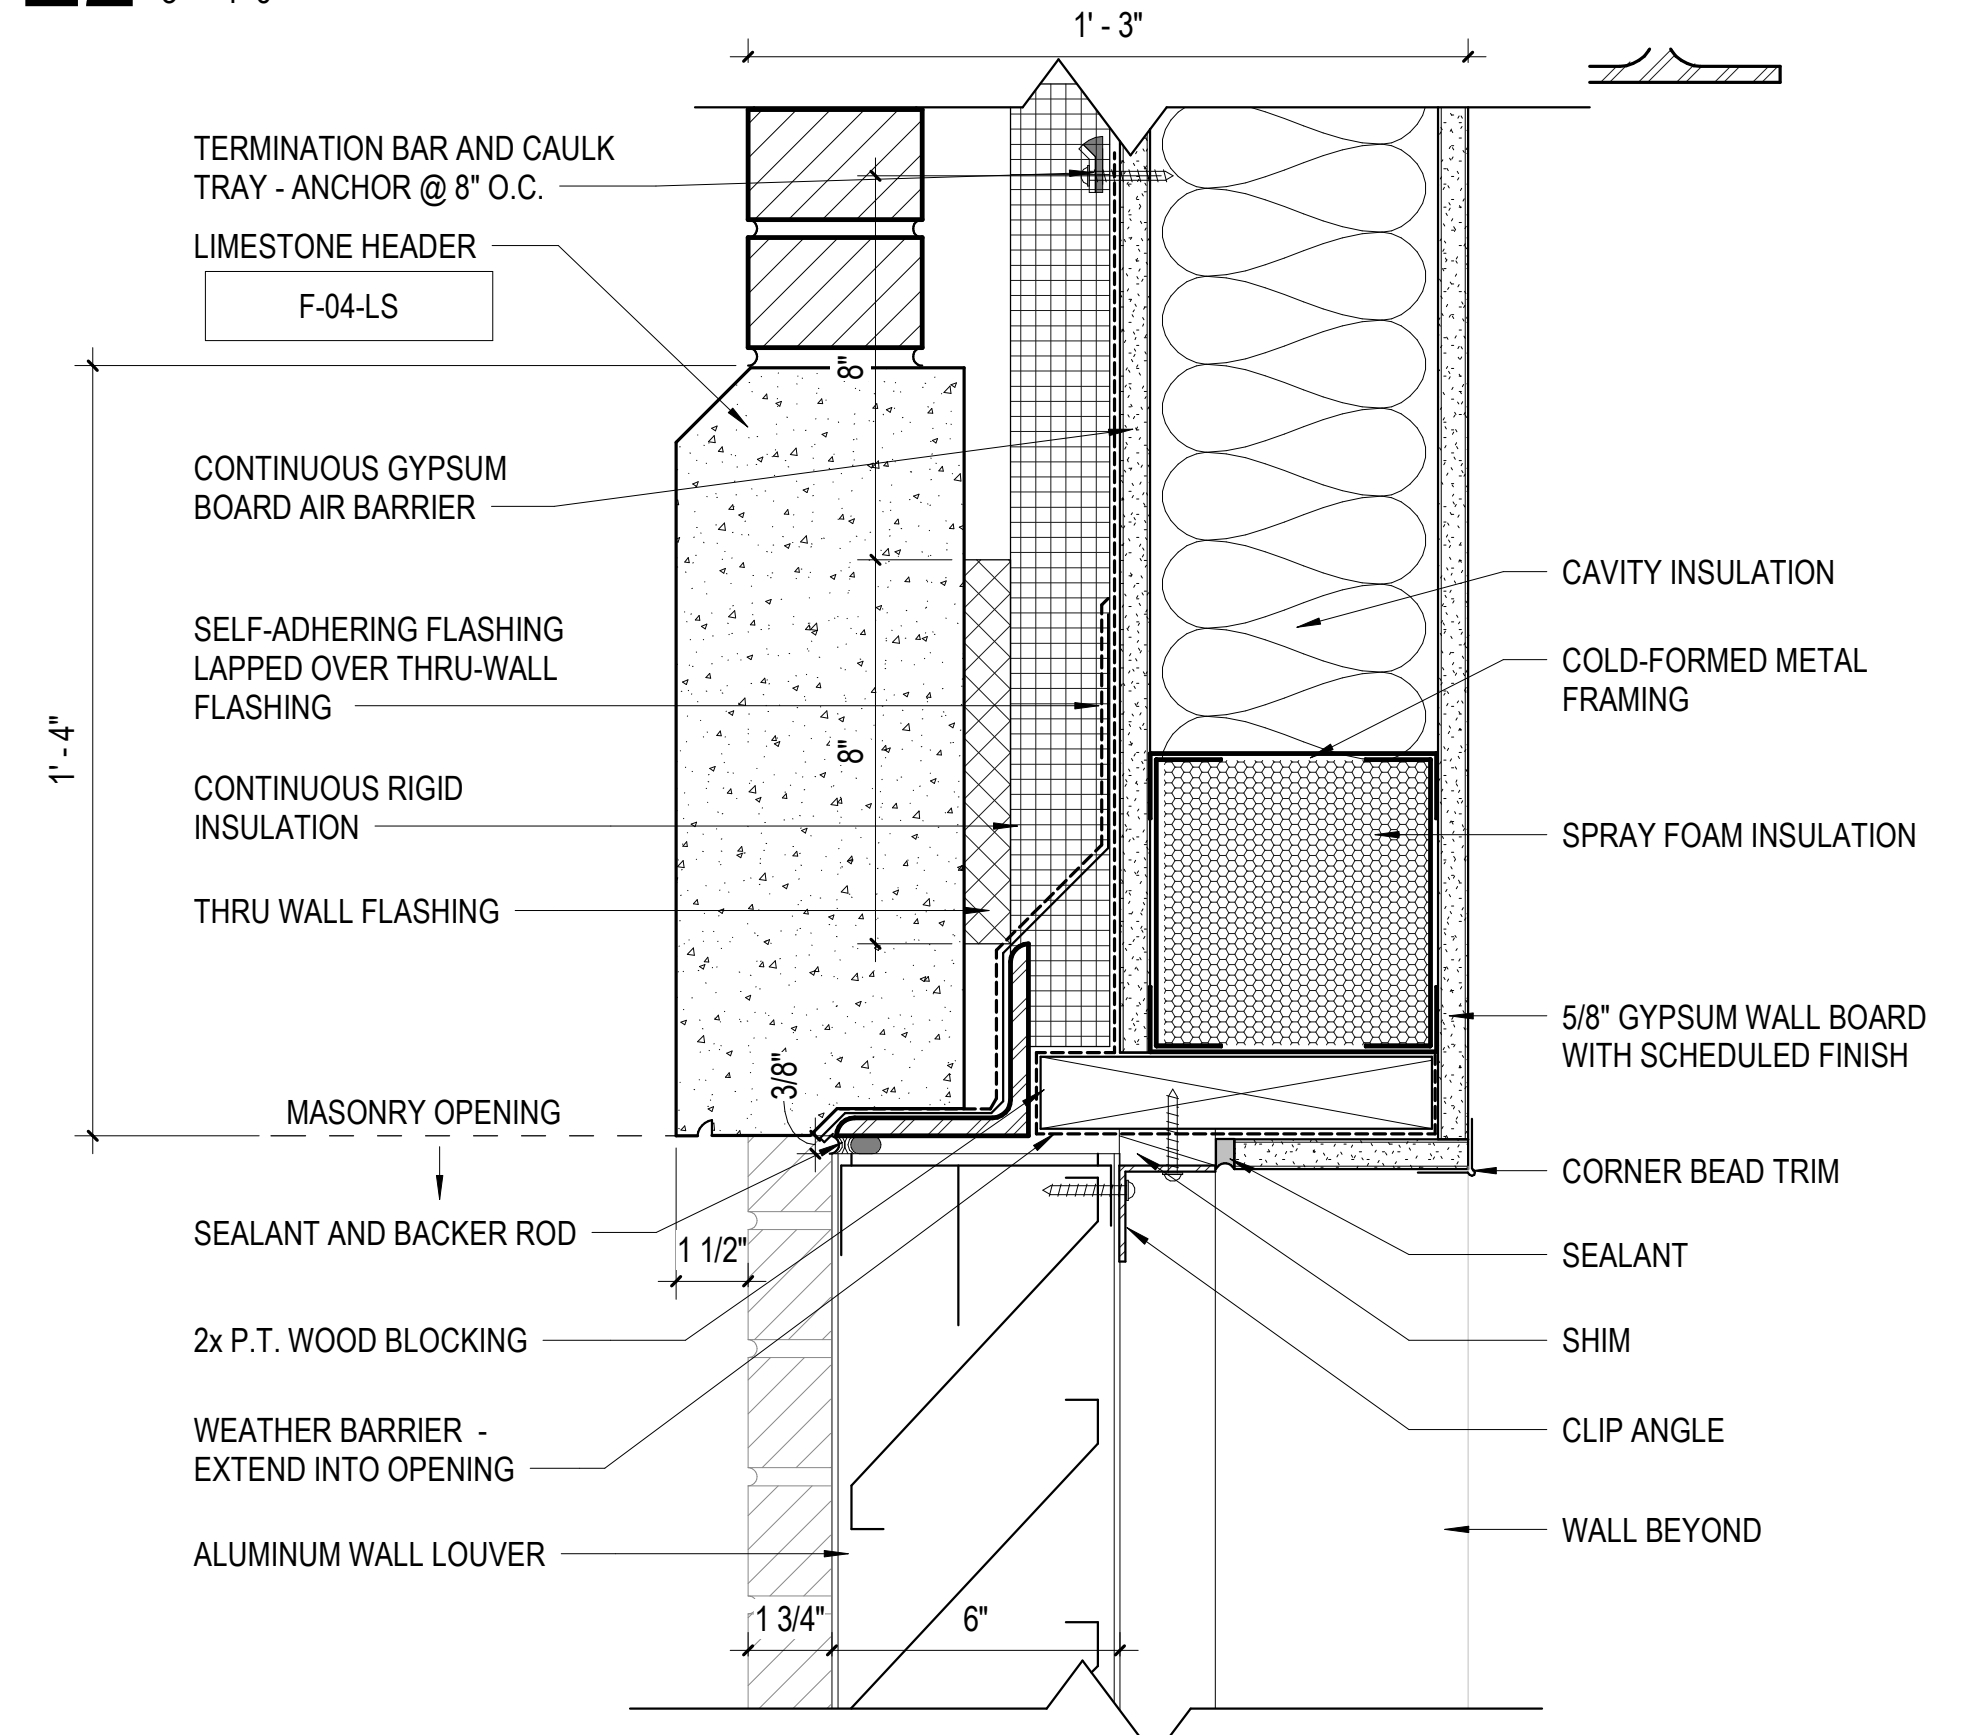

E2 DETAIL - LOUVER HEAD AT STONE
3" = 1'-0"

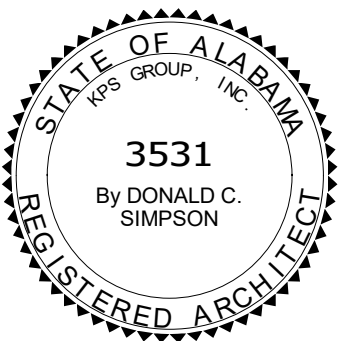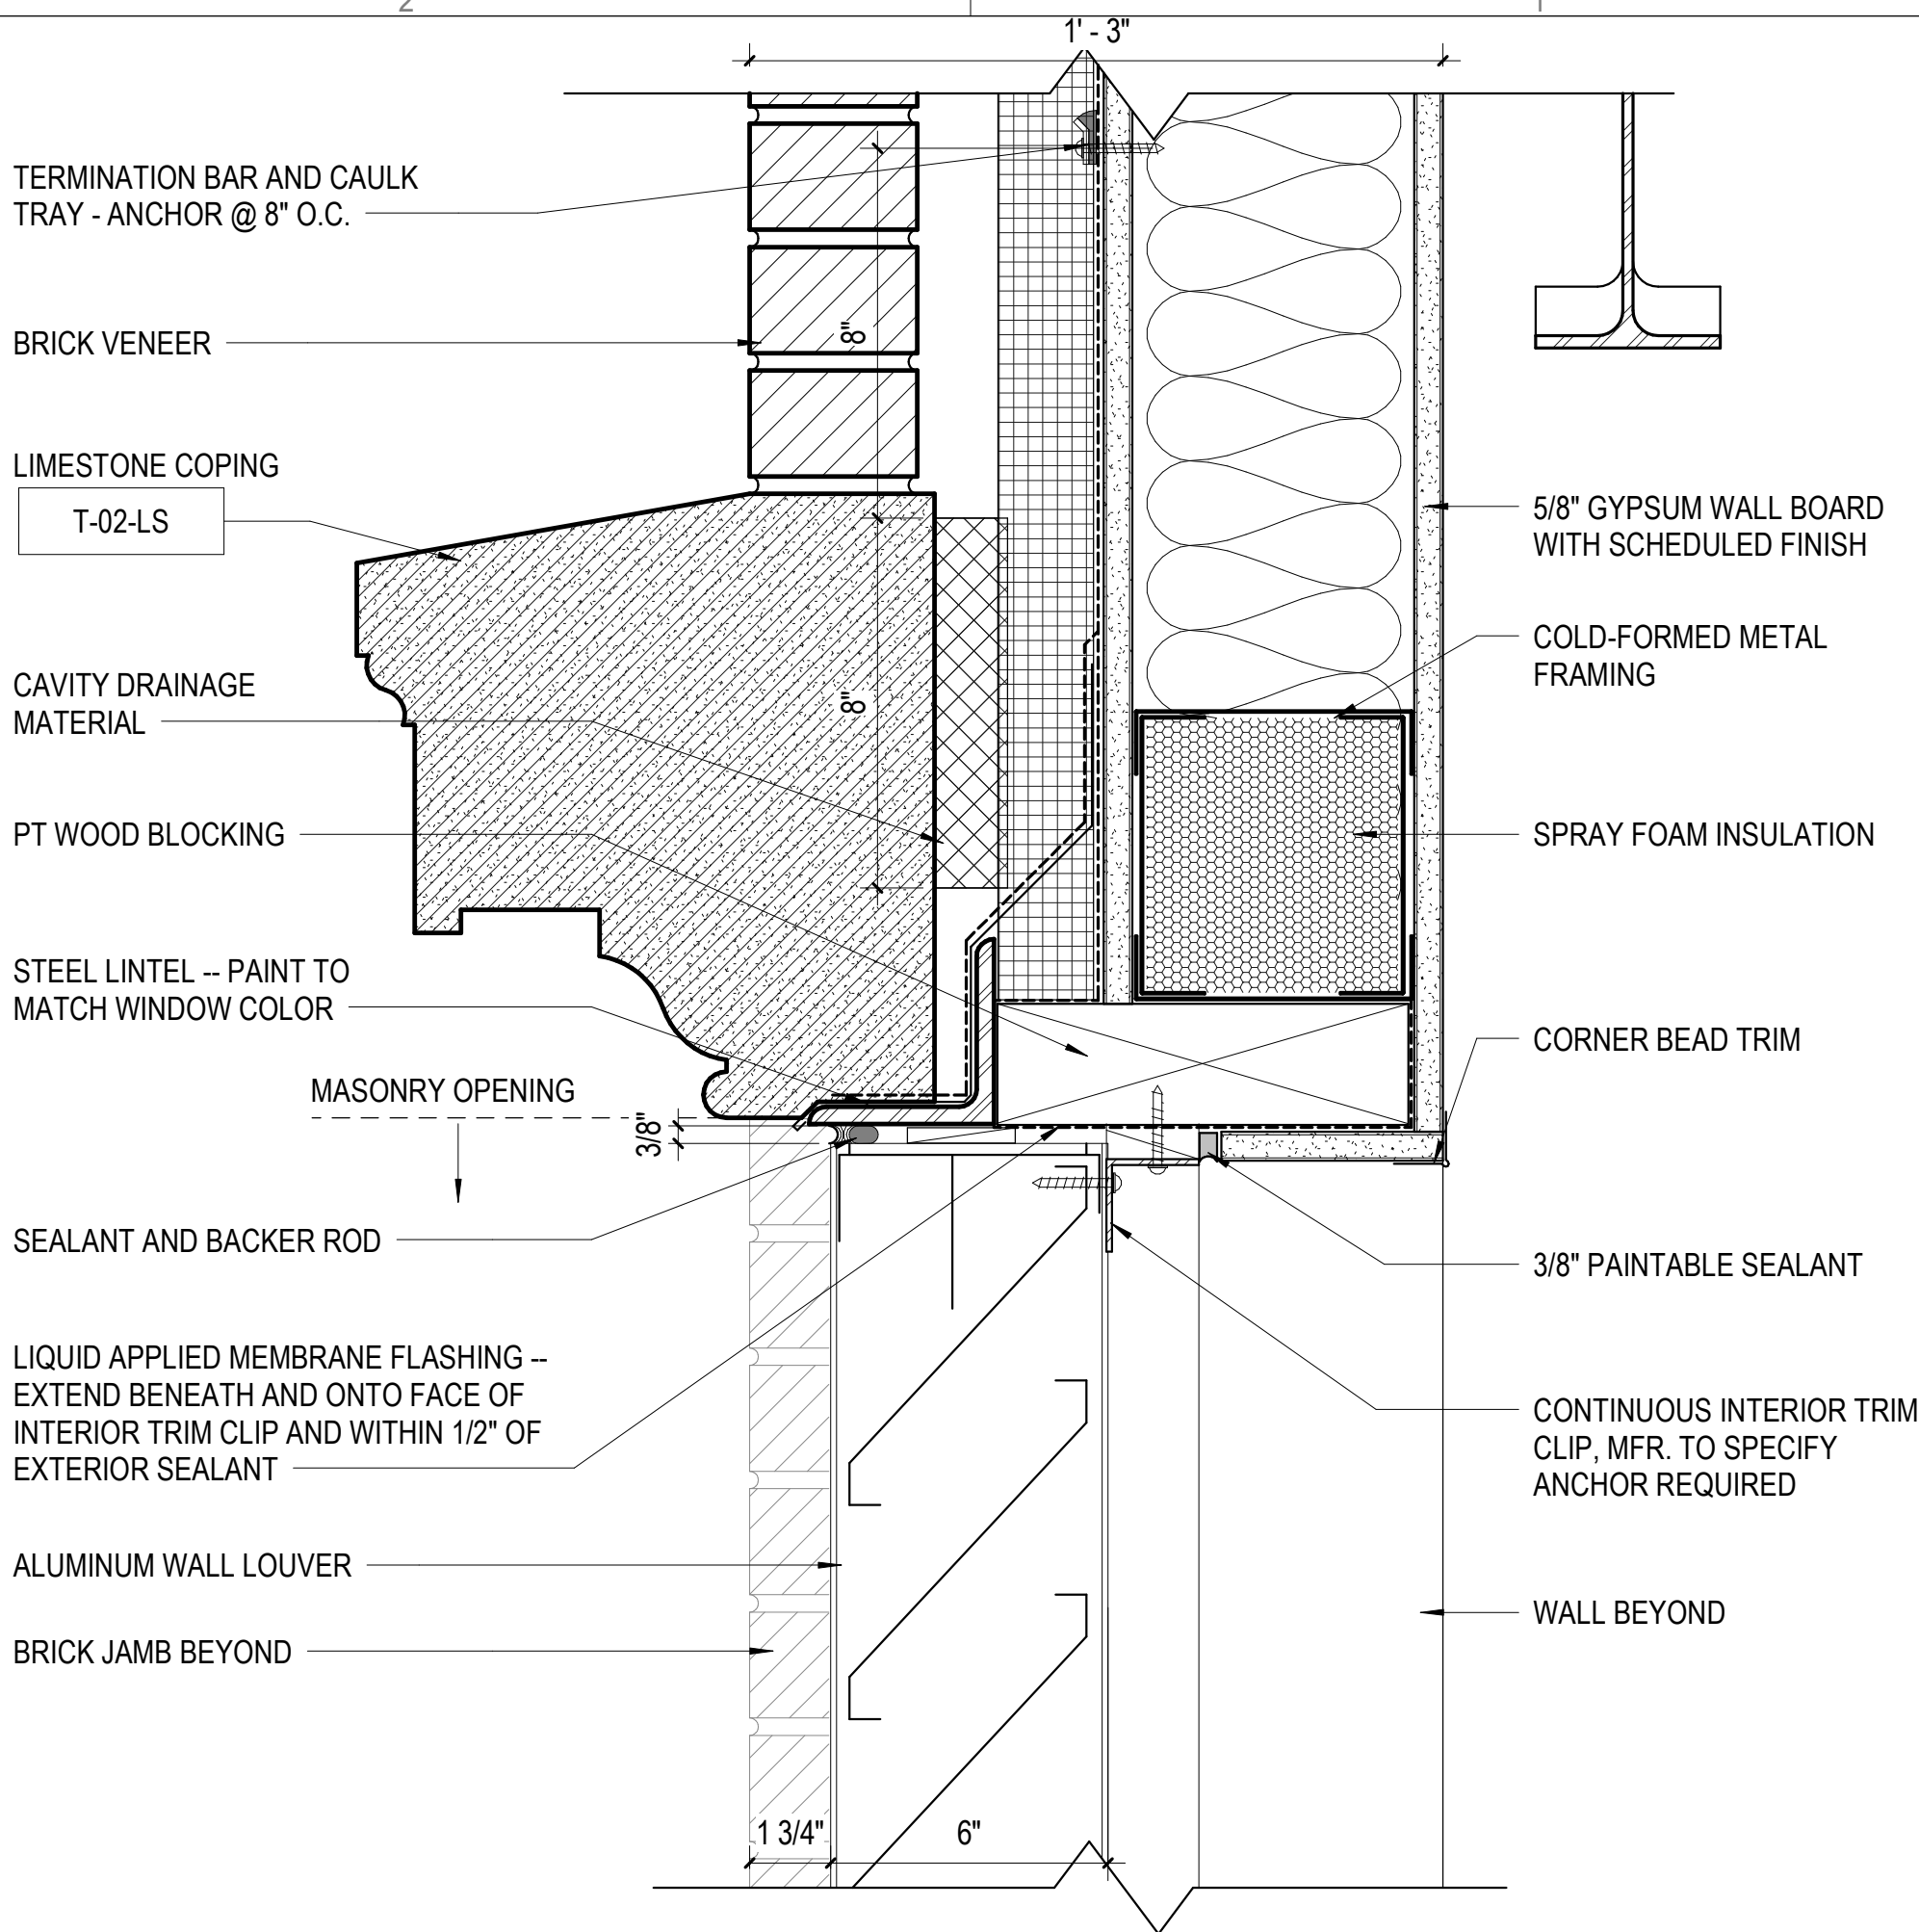

PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	

REVISIONS	No.	Description	Date
-----------	-----	-------------	------

DRAWING TITLE
LOUVER DETAILS

DRAWN BY: Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
A7.16

FINISH MATERIAL LEGEND

FLOORS

CPT-1	MANUFACTURER: BENTLEY MILLS PRODUCT: MODERN CURATOR STYLE: CAMERA READY 6CR120 COLOR: HERESAY 400056 SIZE: 18" X 36" BACKING: LUXFELT CUSHION INSTALLATION: ASHLAR CONTACT: DAWN COX PHONE / EMAIL: 205.919.7978 / DAWN.COX@BENTLEYMILLS.COM
	NOTES: OFFICES
CPT-2	MANUFACTURER: BENTLEY MILLS PRODUCT: DRAWING ROOM STYLE: REACTED BRP23 COLOR: DOCUMENT 601532 SIZE: 18" X 36" BACKING: LUXFELT CUSHION INSTALLATION: ASHLAR CONTACT: DAWN COX PHONE / EMAIL: 205.919.7978 / DAWN.COX@BENTLEYMILLS.COM
	NOTES: CONFERENCE
CPT-3	MANUFACTURER: BENTLEY MILLS PRODUCT: DRAWING ROOM STYLE: DUST JACKET RD023 COLOR: WAIT LIST 800111 SIZE: 18" X 36" BACKING: LUXFELT CUSHION INSTALLATION: ASHLAR CONTACT: DAWN COX PHONE / EMAIL: 205.919.7978 / DAWN.COX@BENTLEYMILLS.COM
	NOTES: READING
WM	MANUFACTURER: BENTLEY MILLS PRODUCT: WALK OFF TILE STYLE: ROUGH IDEA SHEAR BRN24 COLOR: DRAFT 800115 SIZE: 24" X 24" BACKING: AFIRMA HARDBACK II INSTALLATION: MONOLITHIC CONTACT: DAWN COX PHONE / EMAIL: 205.919.7978 / DAWN.COX@BENTLEYMILLS.COM
	NOTES:
LVT-1	MANUFACTURER: MANNINGTON PRODUCT: AMTICO COLOR / FINISH: TEMPUS EMBRACE AROSTE30 SIZE / GAUGE: 18" X 18" INSTALLATION: BRIDGETTE RANEY CONTACT: BRIDGETTE RANEY PHONE / EMAIL: 678.519.8238 / BRIDGETTE.PILKINGTON@MANNINGTON.COM
	NOTES: LIGHT
LVT-2	MANUFACTURER: MANNINGTON PRODUCT: AMTICO COLOR / FINISH: TEMPUS RESTORE AROSTE29 SIZE / GAUGE: 18" X 18" INSTALLATION: BRIDGETTE RANEY CONTACT: BRIDGETTE RANEY PHONE / EMAIL: 678.519.8238 / BRIDGETTE.PILKINGTON@MANNINGTON.COM
	NOTES: MOTONE
LVT-3	MANUFACTURER: MANNINGTON PRODUCT: AMTICO COLOR / FINISH: TEMPUS ECHO AROSTE13 SIZE / GAUGE: 18" X 18" INSTALLATION: BRIDGETTE RANEY CONTACT: BRIDGETTE RANEY PHONE / EMAIL: 678.519.8238 / BRIDGETTE.PILKINGTON@MANNINGTON.COM
	NOTES: DARK
LVT-P	MANUFACTURER: MANNINGTON PRODUCT: AMTICO COLOR / FINISH: VARIES SIZE / GAUGE: 18" X 18" INSTALLATION: BRIDGETTE RANEY CONTACT: BRIDGETTE RANEY PHONE / EMAIL: 678.519.8238 / BRIDGETTE.PILKINGTON@MANNINGTON.COM
	NOTES: LVT PATTERN OF LVT-1, LVT-2, AND LVT-3. REFERENCE FINISH PLANS
PFT-1	MANUFACTURER: SOUTH CYPRESS PRODUCT: CASTLE COLOR / FINISH: ROYAL MATTE SIZE: 2'X2' MOSAIC INSTALLATION: MESH BACK GROUT MFR: CUSTOM BUILDING PRODUCTS EPOXY GROUT GROUT COLOR: #335 WINTER GRAY CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: RESTROOMS AS INDICATE ON FINISH PLAN. INTENT IS TO USE MOSAIC AROUND DRAINS.
PFT-2	MANUFACTURER: SOUTH CYPRESS PRODUCT: CASTLE COLOR / FINISH: ROYAL MATTE SIZE: 12" X 24" JOINT SIZE: 1/8" INSTALLATION: STACKED GROUT MFR: CUSTOM BUILDING PRODUCTS EPOXY GROUT GROUT COLOR: #335 WINTER GRAY CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: RESTROOMS
UCF-1	MANUFACTURER: RES-TEK PRODUCT: PUR-GUARD URETHANE CEMENT HD-SL COLOR / FINISH: P-22 DARK GREY /SL BROADCAST WITH #0 SAND SIZE / GAUGE: 3/16" INSTALLATION: POURED CONTACT: WYNSTON GULLY PHONE / EMAIL: 205.572.9445 / WYNSTON.GULLY@RES-TEK.NET
	NOTES: PAPER MILL
UCF-2	MANUFACTURER: RES-TEK PRODUCT: EPO-GUARD EPOXY 103 TOPCOAT WITH SAND COLOR / FINISH: PEARL GRAY SIZE / GAUGE: 30 MIL INSTALLATION: POURED CONTACT: WYNSTON GULLY PHONE / EMAIL: 205.572.9445 / WYNSTON.GULLY@RES-TEK.NET
	NOTES: STUDIOS. SEE FINISH PLAN
SC-1	MANUFACTURER: SEALED CONCRETE PRODUCT: SEALED CONCRETE COLOR / FINISH: SEALED CONCRETE CONTACT: BRAD HEDGES PHONE / EMAIL: 770.325.0725 / BRAD@SCSIGA.COM
	NOTES: REFER TO SPECIFICATIONS
RT-1	MANUFACTURER: FLEXCO PRODUCT: HEAVY DUTY HAMMERED ONE-PIECE TREAD WITH RISER COLOR / FINISH: #38 OUTER BANKS CONTACT: DAVID REEVES PHONE / EMAIL: 205.936.7610 / DREEVES@JHAINES.COM
	NOTES: RT-1 AT STAIR TREADS. LANDINGS TO BE LVT-2
TZ-1	MANUFACTURER: TERRAZO & MARBLE PRODUCT: EPOXY TERRAZO BASE COLOR: ROCKPORT GREY AGGREGATE 1: CLASSIC MOTHER OF PEARL #3, 10% AGGREGATE 2: ALL SIDED MIRROR #1, 5% AGGREGATE 3: CLEAR PLATE GLASS #0 (DEX CLEAR GLASS), 40% AGGREGATE 4: CLEAR PLATE GLASS #1 (DEX CLEAR GLASS), 45% INSTALLATION: POURED CONTACT: BRAD HEDGES PHONE / EMAIL: 770.325.0725 / BRAD@SCSIGA.COM
	NOTES: TM223-2872
TZ-2	MANUFACTURER: TERRAZO & MARBLE PRODUCT: EPOXY TERRAZO BASE COLOR: SNOWBOUND AGGREGATE 1: CLASSIC MOTHER OF PEARL #3, 30% AGGREGATE 2: ITALIAN BOTTICINO OR PERSIAN CREME #1, 40% AGGREGATE 3: EXTREME WHITE #1, 40% AGGREGATE 4: POURED INSTALLATION: POURED CONTACT: BRAD HEDGES PHONE / EMAIL: 770.325.0725 / BRAD@SCSIGA.COM
	NOTES: TM223-2869

PAINTS

P1EG	MANUFACTURER: SHERWIN WILLIAMS PRODUCT: MODERN CURATOR COLOR: COLONNADE GRAY SW7641 FINISH: EGGSHELL NOTES: GENERAL PAINT
	P1FL MANUFACTURER: SHERWIN WILLIAMS PRODUCT: LATEX ENAMEL COLOR: COLONNADE GRAY SW7641 FINISH: FLAT
P2SG	MANUFACTURER: PPG PRODUCT: OIL ALKYLID COLOR: GRANITE 1022-6 FINISH: SEMI-GLOSS NOTES: DOORS, TRIM, HANDRAILS, STAIRS, PAINTED METAL
	P3FL MANUFACTURER: SHERWIN WILLIAMS PRODUCT: LATEX ENAMEL COLOR: GLOSSAMER VEIL SW9165 FINISH: FLAT
P4EG	MANUFACTURER: SHERWIN WILLIAMS PRODUCT: DUST JACKET RD023 COLOR: WAIT LIST 800111 FINISH: EGGSHELL NOTES: ACCENT FOR CARPETED SPACES
	P5EG MANUFACTURER: SHERWIN WILLIAMS PRODUCT: LATEX ENAMEL COLOR: PAVESTONE SW7642 FINISH: EGGSHELL
P6EG	MANUFACTURER: PPG PRODUCT: LATEX ENAMEL COLOR: ORIENT EXPRESS 1403-0500G, EX1Y15 1/2, HX8Y25, WX2Y10 FINISH: EGGSHELL NOTES: CRIMSON, WALLS MUST HAVE LEVEL 5 FINISH.
	GRAPHICS MANUFACTURER: --- PRODUCT: LATEX ENAMEL COLOR: REFER TO FINISH PLAN FINISH: EGGSHELL NOTES: WALLS MUST HAVE LEVEL 5 FINISH.
PTW-1	MANUFACTURER: SOUTH CYPRESS PRODUCT: EXPRESSIVE COLOR / FINISH: CLASSICAL/MATTE SIZE: 12" X 24" JOINT SIZE: 1/8" INSTALLATION: STACKED GROUT MFR: CUSTOM BUILDING PRODUCTS EPOXY GROUT GROUT COLOR: #335 WINTER GRAY CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: RESTROOMS. UTILIZE SCHLUTER SCHIENE TRANSITION STRIP AT ALL OUTSIDE CORNER OR WHERE WALL-TILE TRANSITIONS TO PAINT ON SAME WALL. SCHIENE IN SATIN NICKEL FINISH.
PTW-2	MANUFACTURER: DALTILE PRODUCT: REVALLA REMIX COLOR / FINISH: RIVOLI CREAM RV06 CONTACT: BRANDON WHITE JOINT SIZE: 1/8" INSTALLATION: 33% OFFSET GROUT MFR: CUSTOM BUILDING PRODUCTS EPOXY GROUT GROUT COLOR: #335 WINTER GRAY PHONE / EMAIL: 205.792.6449 / ELIZABETH.MELANCON@DALTILE.COM
	NOTES: WATERCOOLERS
RB-1	MANUFACTURER: FLEXCO PRODUCT: #38 OUTER BANKS COLOR / FINISH: #38 OUTER BANKS SIZE: 4" STYLE: CONTINUOUS ROLL CONTACT: DAVID REEVES PHONE / EMAIL: 205.936.7610 / DREEVES@JHAINES.COM
	PTB-1 MANUFACTURER: SOUTH CYPRESS PRODUCT: CASTLE COLOR / FINISH: ROYAL MATTE SIZE: 6" H X 12" STYLE: CONTINUOUS ROLL CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
TZB-1	MANUFACTURER: TERRAZZO OR EQUAL PRODUCT: MATCH TZ-1 COLOR / FINISH: MATCH TZ-1 SIZE: 6" STYLE: CONTINUOUS ROLL CONTACT: BRAD HEDGES PHONE / EMAIL: 770.325.0725 / BRAD@SCSIGA.COM
	UCB-1 MANUFACTURER: RES-TEK PRODUCT: PUR-GUARD URETHANE CEMENT HD-SL COLOR / FINISH: P-22 DARK GREY /SL BROADCAST WITH #0 SAND SIZE / GAUGE: 3/16" INSTALLATION: POURED CONTACT: WYNSTON GULLY PHONE / EMAIL: 205.572.9445 / WYNSTON.GULLY@RES-TEK.NET
	NOTES: INTEGRAL BASE TO UCF
PL-1	MANUFACTURER: FORMICA PRODUCT: PLASTIC LAMINATE COLOR / FINISH: THERMAL WALNUT 6402-43 /ARTISAN FINISH INSTALLATION: VERTICAL CONTACT: LESLIE GAUFIANAKIS PHONE / EMAIL: LESLIE.GAUFIANAKIS@FORMICA.COM
	NOTES: MATCHING 3mm PVC EDGED
SS-1	MANUFACTURER: CORIAN PRODUCT: BISQUE COLOR / FINISH: BISQUE SIZE: 3/4" X 4" H, 5 BLADES INSTALLATION: CONTACT: STEPHANIE CALDARELLO PHONE / EMAIL: 205.377.2285 / SCALDARELLO@OLDENKAMP.COM
	NOTES: COUNTERS & WINDOW SILLS
ST-1	MANUFACTURER: SPECIES PRODUCT: WALNUT COLOR / FINISH: CLEAR SIZE: 1/2" X 1/2" X 1/2" PROFILE: 1/2" X 1/2" X 1/2" CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	NOTES: DOORS. PROVIDE 12"X12" SAMPLE PRIOR TO FABRICATION ON ACTUAL SPECIES FOR FINAL APPROVAL

MILLWORK

WALL PROTECTION

CG1	MANUFACTURER: CS ACRYVYN PRODUCT: SS80-20N COLOR / FINISH: 314 OZARK /SUEDE TEXTURE SIZE: WING, 2" FULL HEIGHT CONTACT: WING, 2" FULL HEIGHT NOTES: TOP OF BASE TO CEILING
	FRP MANUFACTURER: MARLITE PRODUCT: FIBER REINFORCED PANEL TEXTURE: PEBBLED COLOR / FINISH: CLASSIC WHITE P100 SIZE: 48" HIGH TRIM: J CAP INSTALLATION: CONTACT: J CAP PHONE / EMAIL: J CAP
HWC-1	MANUFACTURER: CS ACRYVYN PRODUCT: SHEET WALL GOODS TEXTURE: PEBBLED COLOR / FINISH: 314 OZARK SIZE: FULL HEIGHT TRIM: J CAP INSTALLATION: CONTACT: J CAP PHONE / EMAIL: J CAP
	NOTES: PAPER MILL. BUTT JOINT AND CAULK WITH COLOR MATCHING CAULK.
HWC-2	MANUFACTURER: CS ACRYVYN PRODUCT: SHEET WALL GOODS TEXTURE: PEBBLED COLOR / FINISH: 314 OZARK SIZE: PARTIAL HEIGHT - SEE ELEVATION TRIM: WAINSCOT TRIM BY ACRYVYN - COLOR TO MATCH HWC-2 INSTALLATION: PER MANUFACTURER'S RECOMMENDATION CONTACT: PAUL BATES PHONE / EMAIL: 770.880.2945 / PBATES@INPROCORP.COM
	NOTES: PAPER MILL. BUTT JOINT AND CAULK WITH COLOR MATCHING CAULK.
STS	MANUFACTURER: INFRO PRODUCT: STAINLESS STEEL WALL CLADDING TEXTURE: STAINLESS STEEL, BRUSHED #4 COLOR / FINISH: 16 GAUGE - 4" X 8" CUT TO SIZE - SEE ELEVATION TRIM: STANDARD EDGE TRIMS INSTALLATION: PER MANUFACTURER'S RECOMMENDATION CONTACT: PAUL BATES PHONE / EMAIL: 770.880.2945 / PBATES@INPROCORP.COM
	NOTES: PAPER MILL
ACT-1	MANUFACTURER: ARMSTRONG CEILINGS PRODUCT: CORTESGA 79A TEGULAR COLOR: WHITE SIZE: 24" X 24" X 5/8" THICK GRID TYPE: PRELUDE XL GRID SIZE: 15/16" GRID COLOR: WHITE CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: GENERAL
ACT-2	MANUFACTURER: ARMSTRONG CEILINGS PRODUCT: CLEAN ROOM VL 869 SQUARE LAY-IN, PERFORATED COLOR: WHITE SIZE: 24" X 24" X 5/8" THICK GRID TYPE: PRELUDE XL GRID SIZE: 15/16" GRID COLOR: WHITE CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: RESTROOM
ACT-3	MANUFACTURER: ARMSTRONG CEILING PRODUCT: CALLA COLOR: WHITE SIZE: 24" X 60" X 1" THICK GRID TYPE: SUPRAFINE GRID SIZE: 15/16" GRID COLOR: WHITE CONTACT: BRANDON WHITE PHONE / EMAIL: 205.832.1816 / BRANDON.WHITE@SOUTHCYPRESS.COM
	NOTES: RESTROOM
ACT-4	MANUFACTURER: ARMSTRONG CEILINGS PRODUCT: TECTUM DIRECT APPLIED BETWEEN BEAMS AND BAR JOISTS COLOR: WHITE SIZE: 23-3/4" X 96" X 1" THICK GRID TYPE: PRELUDE XL HEAVY DUTY GRID SIZE: 15/16" GRID COLOR: WHITE CONTACT: RICH LAWS PHONE / EMAIL: RICH.LAWS@ARMSTRONG.COM
	NOTES: CLASSROOMS WITH EXPOSED STRUCTURE
ACT-5	MANUFACTURER: ARMSTRONG PRODUCT: WOODWORKS GRILLE - FORTÉ COLOR: SOLID WOOD NATURAL WALNUT (GWN) ON POPLAR SIZE: 3/4" X 4" H, 5 BLADES GRID TYPE: PRELUDE XL HEAVY DUTY GRID SIZE: 15/16" GRID COLOR: WHITE CONTACT: RICH LAWS PHONE / EMAIL: RICH.LAWS@ARMSTRONG.COM
	NOTES: LOBBY
EXP-1	DESCRIPTION: DRYFALL PAINT PRODUCT: SHERWIN WILLIAMS ALKYLID DRY FALL FLAT COLOR: MATCH P1 FINISH: FLAT
	GB-1 DESCRIPTION: GYPSUM BOARD CEILING PRODUCT: PAINT - SEE "PAINTS" THIS SCHEDULE COLOR: FLAT

ELEVATORS

PL-1	MANUFACTURER: FORMICA PRODUCT: THERMAL WALNUT 6402-43 COLOR / FINISH: ARTISAN FINISH INSTALLATION: VERTICAL CONTACT: LESLIE GAUFIANAKIS PHONE / EMAIL: LESLIE.GAUFIANAKIS@FORMICA.COM
	NOTES: ELEVATOR CAB PANELS
ETR	EXISTING FINISH TO REMAIN
	TP-1 MANUFACTURER: BOBRICK PRODUCT: TRADITIONAL SIERRASERIES SCRC COLOR / FINISH: FOREST GREEN SC24 SIZE: CEILING HUNG INSTALLATION: CONTACT: CEILING HUNG PHONE / EMAIL: CEILING HUNG
PW-1	MANUFACTURER: HOMASOTE PRODUCT: DESIGN WALL 550 COLOR / FINISH: SUBMIT SAMPLES TO DESIGNER FOR FINISH SELECTION SIZE: 4" X 10" INSTALLATION: PER MANUFACTURER'S RECOMMENDATION CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	NOTES: PAPER MILL

WINDOW COVERINGS

SL-1	MANUFACTURER: LEGRAND PRODUCT: SOLAR EFFECTIVE COLOR / FINISH: CLEAR ANODIZED SIZE: 2" HARDWARE: BALANCE OPERATIONS: WHITE/BONE P04 FABRIC CODE: NA OPENNESS: 2% INSTALLATION: MOUNTED ON INTERIOR SIDE OF WINDOW OVER BLINDS CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	NOTES: PROVIDE AT INSTRUCTIONAL SPACES IN ADDITION TO LB-1. SOLAR SHADES TO BE MOUNTED INSIDE.
LB-1	MANUFACTURER: GRABER PRODUCT: SOLAR EFFECTIVE COLOR / FINISH: MILKYWAY 5058 SIZE: 2" HARDWARE: BALANCE OPERATIONS: WHITE/BONE P04 FABRIC CODE: NA OPENNESS: 2% INSTALLATION: MOUNTED SO VIEWABLE FROM EXTERIOR, INSIDE MOUNT CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	NOTES: PROVIDE AT ALL WINDOWS

FLOOR TRANSITIONS

FT-1	MANUFACTURER: TERRAZZO PROVIDER PRODUCT: 1/8" SCHLUTER COLOR / FINISH: 1/8" SCHLUTER SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: TERRAZZO TO CARPET CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	FT-2 MANUFACTURER: FLEXCO PRODUCT: #156 COLOR / FINISH: #38 OUTER BANKS SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: LVT TO CARPET CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
FT-3	MANUFACTURER: SCHLUTER PRODUCT: RENO-V, REDUCER STRIP COLOR / FINISH: BRUSHED SILVER SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: LVT TO PORCELAIN TILE, CARPET TO PORCELAIN TILE CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	FT-4 MANUFACTURER: FLEXCO PRODUCT: #156 COLOR / FINISH: #38 OUTER BANKS SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: LVT TO SEALED CONCRETE CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
FT-5	MANUFACTURER: FLEXCO PRODUCT: #163 COLOR / FINISH: #38 OUTER BANKS SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: CARPET TO CARPET CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM
	FT-6 MANUFACTURER: FLEXCO PRODUCT: #163 COLOR / FINISH: #38 OUTER BANKS SIZE / EDGE: 1/8" SCHLUTER INSTALLATION: CARPET TO CARPET CONTACT: PHILIP PHONE / EMAIL: PHILIP@SPECIES.COM

MATERIAL NOTES - PAINT AND WALLCOVERING GENERAL FINISH NOTES

- PRIOR TO THE APPLICATION OF PAINT AND WALL COVERING, THE CONTRACTOR SHALL REPAIR NEW SURFACES BY PATCHING, SMOOTHING, AND SANDING AS NEEDED TO ACHIEVE A SURFACE ACCEPTABLE FOR THE APPLICATION OF NEW FINISH. PREPARE DOOR FRAMES OR METAL SURFACES BY SANDING CHIPS/BURRS, FILLING DENTS AND CAULKING CRACKS AT CORNERS AS REQUIRED.
- UNLESS OTHERWISE STATED IN THE SPECIFICATIONS, ALL PAINTED SURFACES ARE TO BE GIVEN ONE COAT AND A MINIMUM OF TWO FINISH COATS. PRIME ALL SURFACES ACCORDING TO MANUFACTURERS' SPECIFICATIONS PRIOR TO APPLICATION OF PAINT. THE NUMBER OF COATS SPECIFIED IS THE MINIMUM NUMBER REQUIRED. APPLY ADDITIONAL COATS WHEN UNDERCOATS, STAINS, OR OTHER CONDITIONS SHOW THROUGH FINAL COAT OF PAINT AND UNTIL PAINT FILM IS OF UNIFORM FINISH, COLOR, AND APPEARANCE.
- CAULK ALL DOOR FRAMES, MILLWORK AND VIEW WINDOW FRAMES AFTER WALLCOVERING INSTALLATION IS COMPLETE. COLOR OF CAULK TO MATCH ADJACENT FINISH, UNLESS OTHERWISE NOTED.
- MISCELLANEOUS METAL (RETURN AND AIR SUPPLY GRILLES, EXPANSION JOINTS, ETC.) LOCATED ON WALL SURFACES IS TO BE PAINTED TO MATCH ADJACENT WALL COLOR.
- ALL EXISTING GYPSUM BOARD SOFFITS AND BULKHEADS WITHIN SCOPE OF WORK SHALL BE PAINTED CEILING WHITE UNLESS OTHERWISE NOTED.
- WHERE PAINT IS SPECIFIED, GYPSUM BOARD SOFFITS ABOVE WALL CABINETS SHALL BE PAINTED THE SAME COLOR AS THE ADJACENT WALL UNLESS OTHERWISE NOTED.
- WHEN WALL COVERING IS SPECIFIED, PROVIDE A MINIMUM OF 1 COAT OF WALL COVERING PRIMER AS RECOMMENDED BY WALL COVERING MANUFACTURER TO WALL SURFACES NOT PREVIOUSLY PAINTED.
- DO NOT PAINT ITEMS REQUIRED BY CODE TO BE A CERTAIN COLOR SUCH AS FIRE ALARM PULLS, ETC.
- ALL PAINT GRADE ARCHITECTURAL MILLWORK (WOOD TRIM, ETC., IF APPLICABLE) TO BE SEMI-GLOSS FINISH. REFER TO ELEVATIONS, SECTIONS, AND DETAILS FOR COLORS.
- ALL HOLLOW METAL DOOR FRAMES AND INTERIOR HOLLOW METAL WINDOW FRAMES TO BE PAINTED AS INDICATED IN THE FINISH MATERIAL LEGEND UNLESS OTHERWISE NOTED.

MATERIAL NOTES - FLOORING

- WHEN CARPET TILES ARE SPECIFIED, ALWAYS REFER TO THE MANUFACTURERS RECOMMENDED INSTALLATION PROCEDURES BEFORE INSTALLING THE PRODUCT. INSTALL CARPET TILES WITH ADHESIVES RECOMMENDED BY THE MANUFACTURER. SNAP A CHALK LINE TO FORM FOUR QUADRANTS AT 90 DEGREE ANGLES TO INSURE THE TILES ARE LAID STRAIGHT. START INSTALLATION OF CARPET TILES AT THE CENTER OF THE ROOM AND LAY-OUT IN A MANNER SO THAT CUT TILE DIMENSIONS ARE MAXIMIZED AT THE PERIMETER UNLESS NOTED OTHERWISE.
- CARPET TILES WILL HAVE ARROWS EMBOSSED ON THE BACK SHOWING PILE DIRECTION. REFER TO FINISH MATERIAL LEGEND FOR INSTALLATION METHOD. (1/4 TURN, MONOLITHIC, ETC.)
- WHERE FLOORING AND/OR BASE IS SPECIFIED, THE SAME FLOOR COVERING AND/OR BASE SHALL EXTEND INTO ANY CLOSETS, STORAGE AREA, ETC. ADJACENT TO THE SPACE UNLESS OTHERWISE NOTED.
- REFER TO FINISH MATERIAL LEGEND AND INTERIOR DETAILS FOR TRANSITIONS BETWEEN FLOORING MATERIAL TYPES. CONTACT THE INTERIOR DESIGNER ON ANY TRANSITION NOT SPECIFIED OR INDICATED.
- WHERE SIMILAR MATERIALS (SUCH AS VCT) ARE USED IN ADJACENT SPACES, TRANSITION MATERIALS AT THE CENTERLINE OF DOOR IN CLOSED POSITION WITH A TRANSITION OR ONLY. DO NOT INSTALL FEATURE STRIPS OR OTHER TRANSITION MATERIALS AT VCT TO VCT OR OTHER (SIMILAR FLOORING MATERIAL) BETWEEN ROOMS AND SPACES UNLESS OTHERWISE NOTED.
- WHERE FLOOR PATTERNS TERMINATE AT A DOOR OPENING, EXTEND PATTERN INTO DOORWAY AND TERMINATE BELOW DOOR PANEL IN CLOSED POSITION.
- AT ALL FLOORING TRANSITIONS BETWEEN PORCELAIN/ CERAMIC TILE AND CARPET OR VINYL TILE USE "SCHEINE" EXTENDED ALUMINUM TRANSITION BY SCHLUTER SYSTEMS, UNLESS OTHERWISE NOTED. REFER TO FLOORING TRANSITION DETAILS.

TOILET ACCESSORY SCHEDULE

TAG	DESCRIPTION	MANUFACTURER	MODEL	FINISH	COMMENTS
TA-01	VERTICAL ADA GRAB BAR - 18" LONG	BOBRICK WASHROOM EQUIPMENT	B-9806x18	STAINLESS STEEL	CFCI
TA-02	HORIZONTAL ADA GRAB BAR - 36" LONG	BOBRICK WASHROOM EQUIPMENT	B-9806x36	STAINLESS STEEL	CFCI
TA-03	HORIZONTAL ADA GRAB BAR - 42" LONG	BOBRICK WASHROOM EQUIPMENT	B-9806x42	STAINLESS STEEL	CFCI
TA-04	TOILET TISSUE DISPENSER			OFIO	
TA-06	PAPER TOWEL DISPENSER			OFIO	
TA-07	SOAP DISPENSER			OFIO	
TA-08	SANITARY NAPKIN DISPOSAL	BOBRICK WASHROOM EQUIPMENT	B-254 CLASSIC SERIES	STAINLESS STEEL	CFCI
TA-09	BABY CHANGING STATION - RECESSED	KOALA KARE	KB310-SSRE	STAINLESS STEEL	CFCI
TA-10	MIRROR	BOBRICK WASHROOM EQUIPMENT	B-165 2436	STAINLESS STEEL	CFCI
TA-11	SANITARY NAPKIN DISPENSER	BOBRICK WASHROOM EQUIPMENT	B-370634 90	STAINLESS STEEL	CFCI


K|P|S

G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com





This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use or reproduction of this drawing without the written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

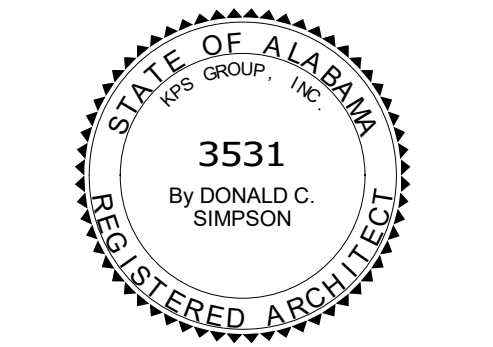

E

Autodesk Docs://McLure Library/236002-02 McLure Library - Arch.rvt
1/29/2024 7:00:23 PM

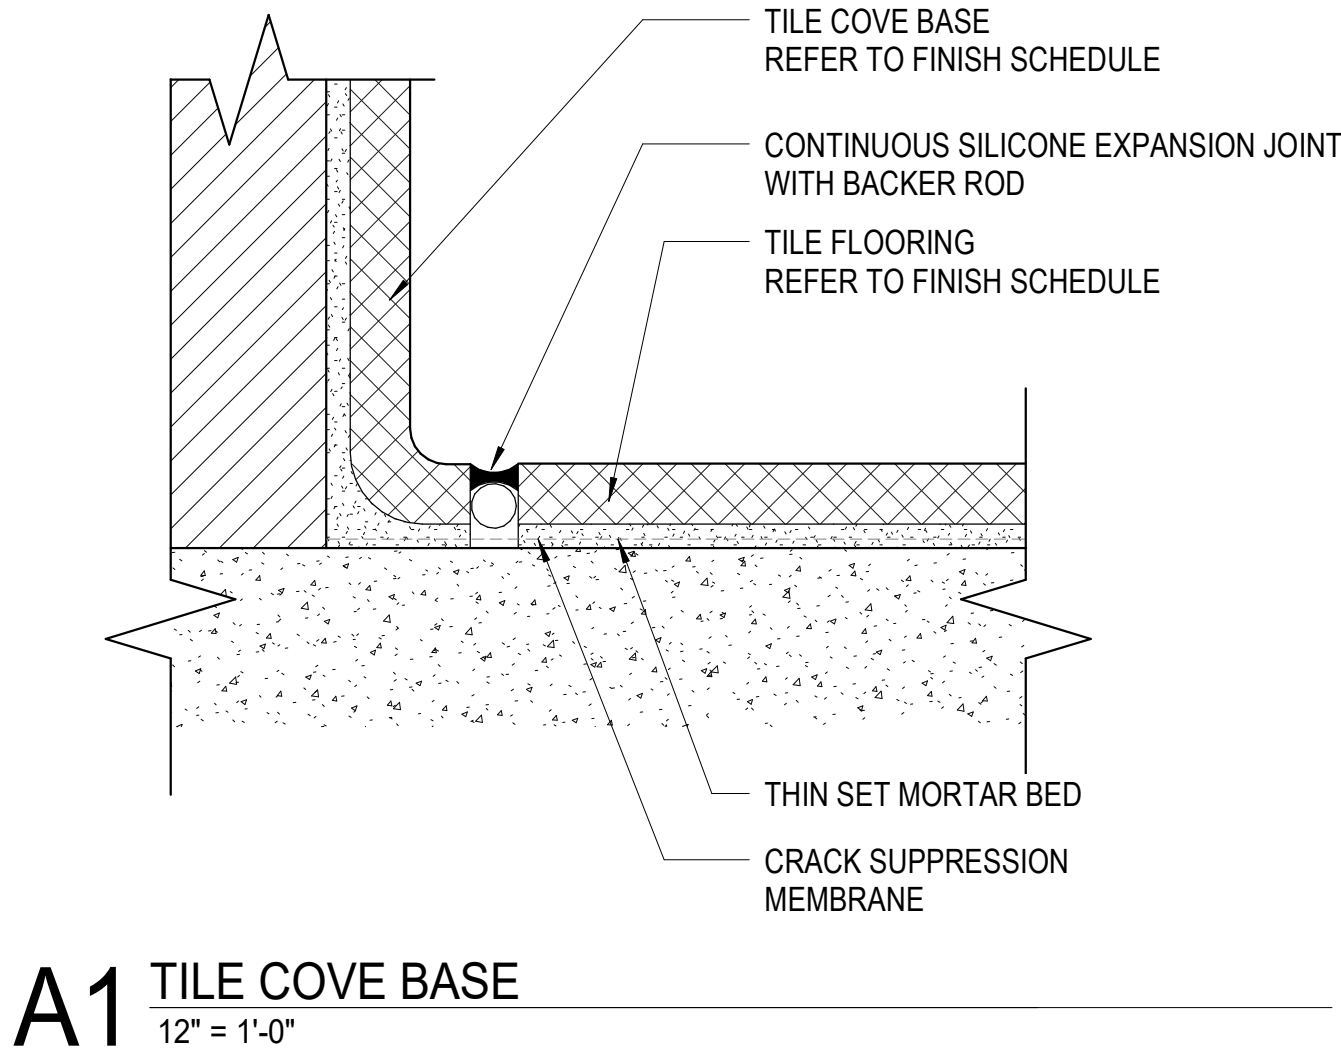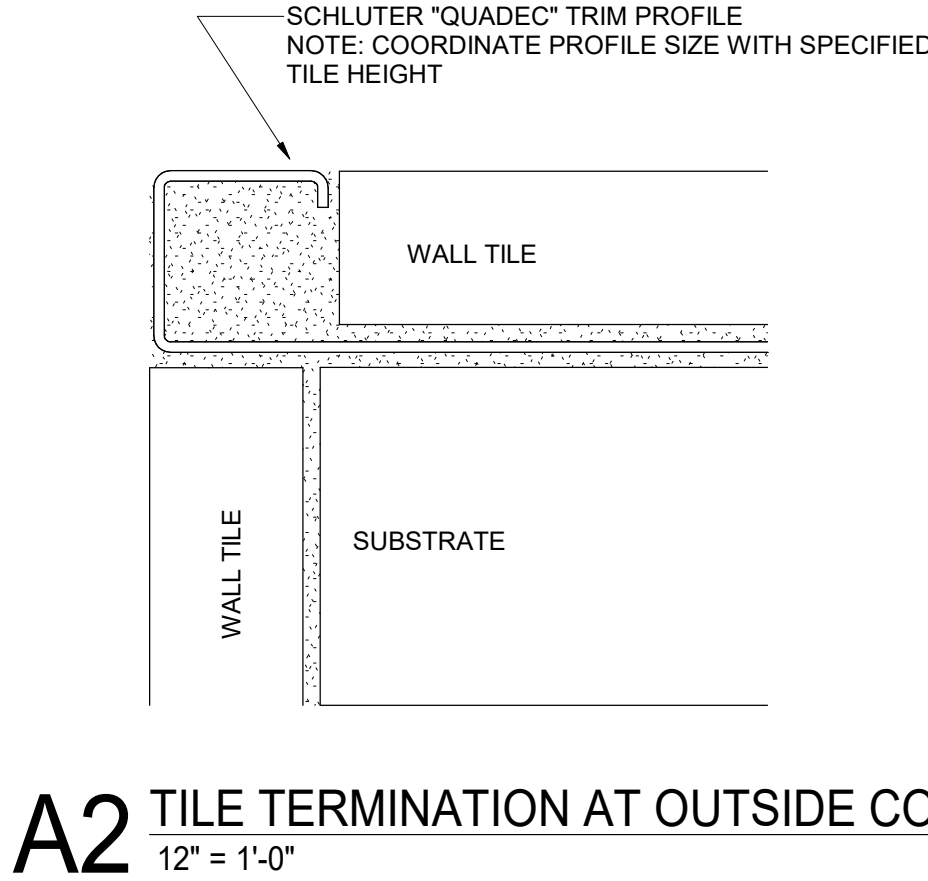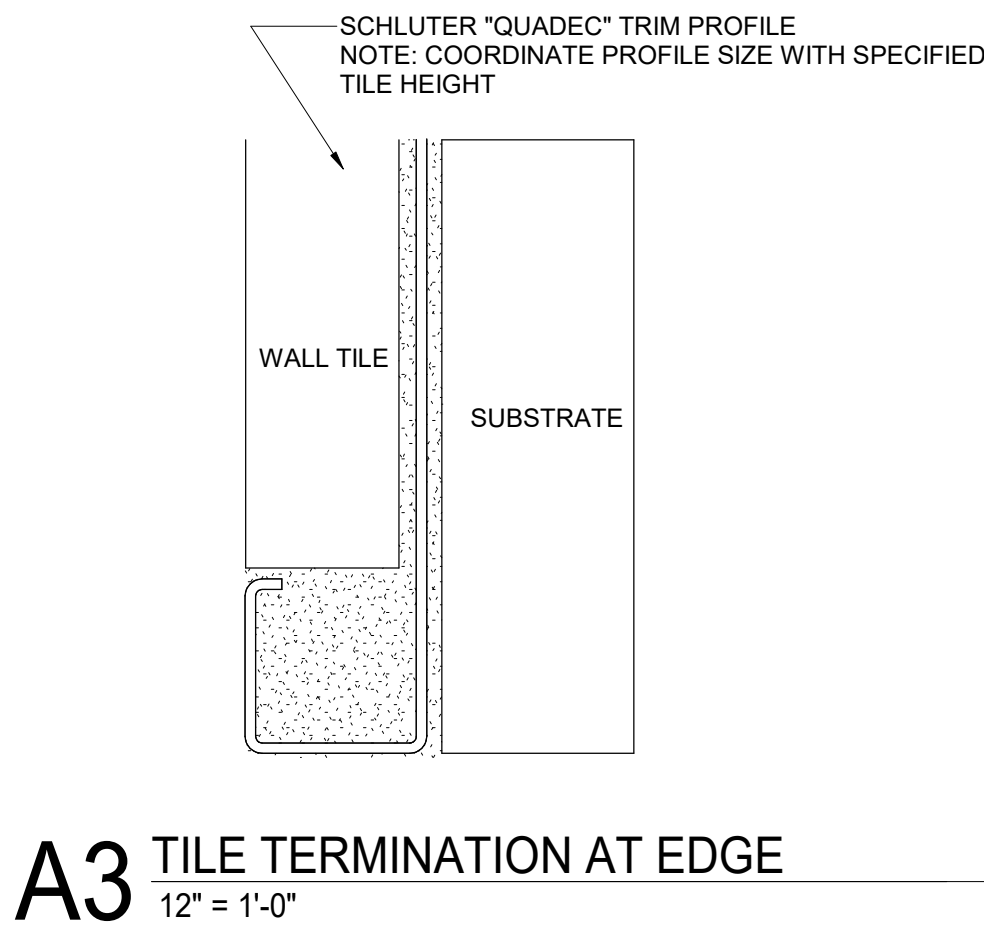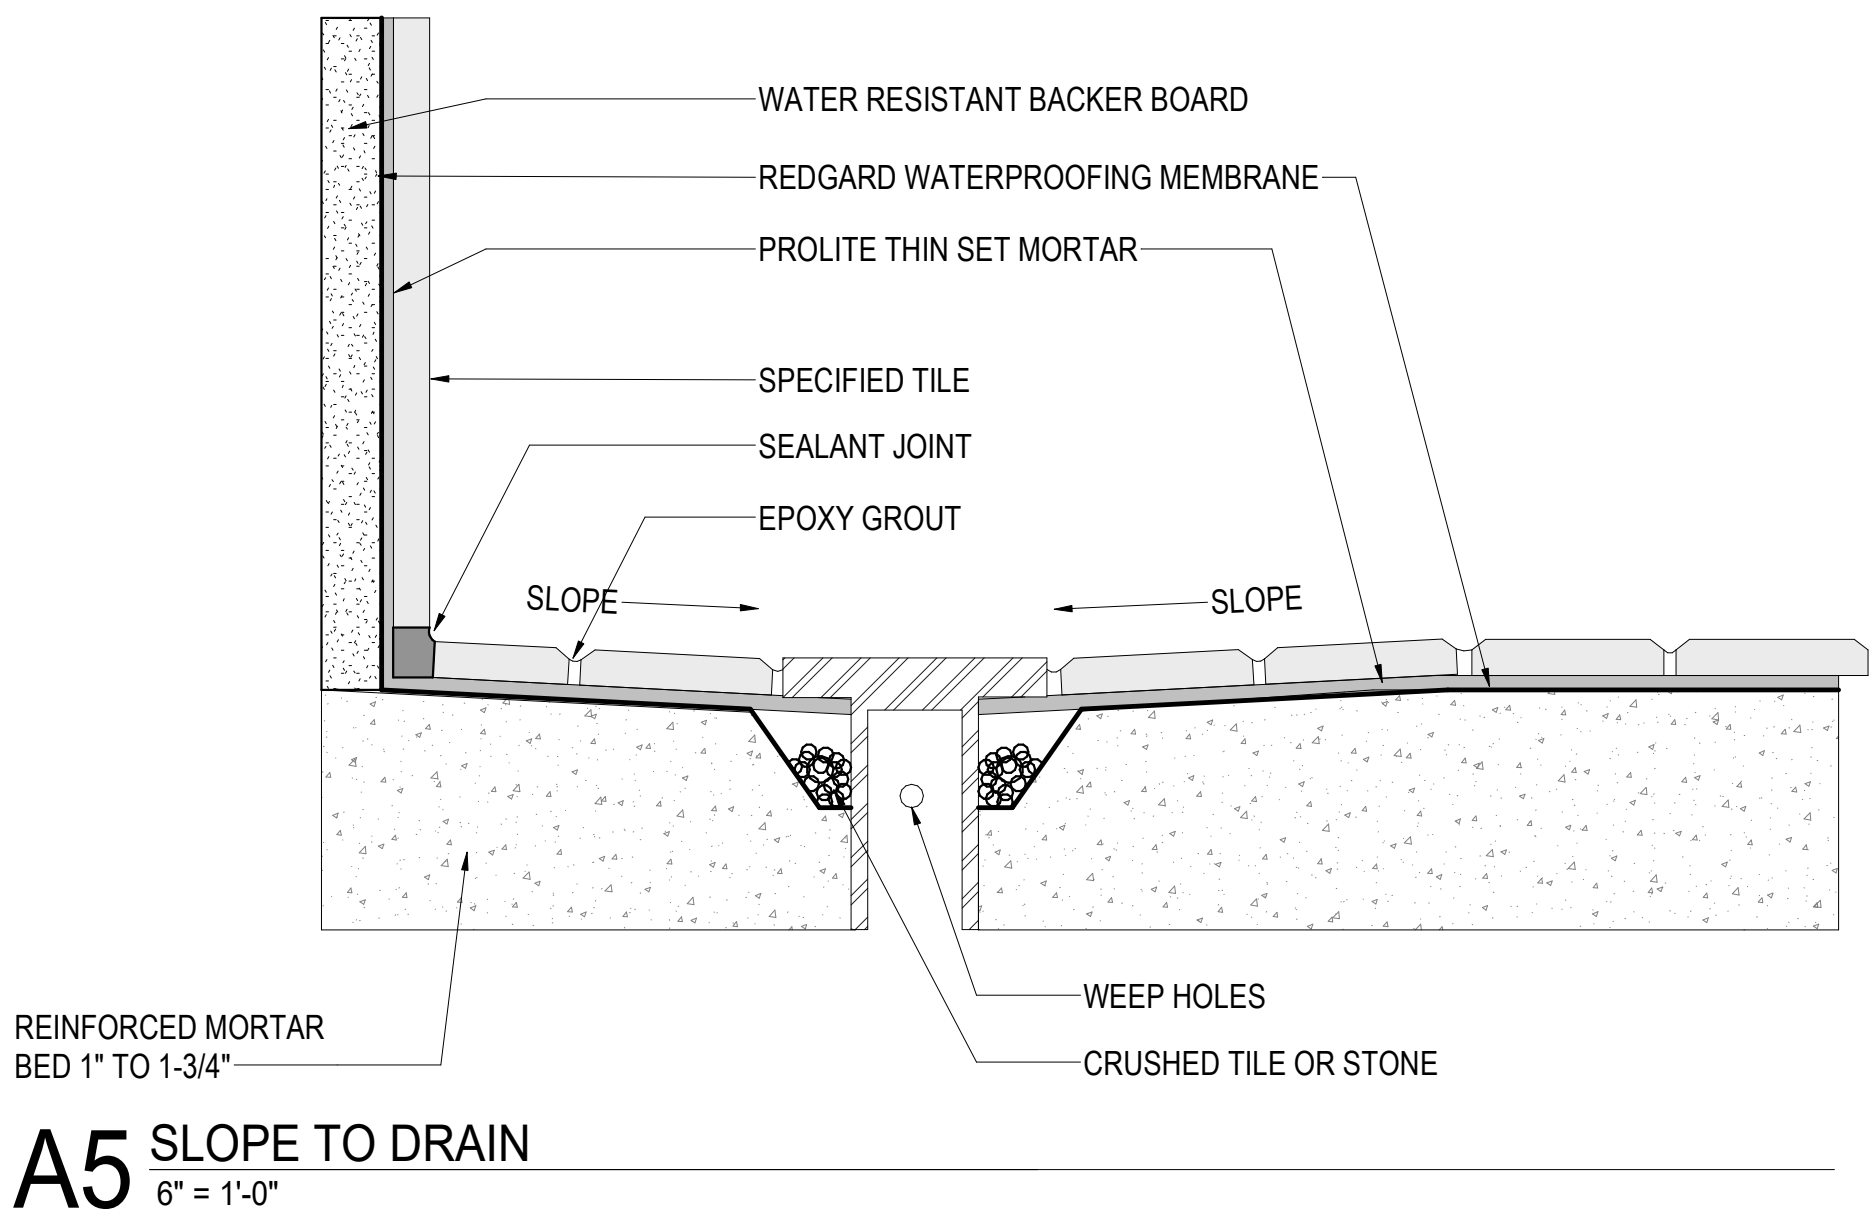

K|P|S

G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

STATE OF ALABAMA
3531
By DONALD C. SIMPSON
REGISTERED ARCHITECT

McLure Library ADDITION AND RENOVATION

PACKAGE D - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOING 202483
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE

TILE TRANSITION DETAILS

DRAWN BY:

Author

CHECKED BY:

Checker

PROJECT NUMBER

236002-02


DRAWING NO.

ID1.02

FINISH PLAN LEGEND

*NOT ALL FLOOR PATTERNS ARE SHOWN. REFER TO FINISH BLOCK.

	WM-1		TZ-1		UCF-1
	CPT		TZ-2		UCF-2
	LVT-1		SC-1		
	LVT-2		PTF-1		
	LVT-3		PTF-2		
	ACCENT				

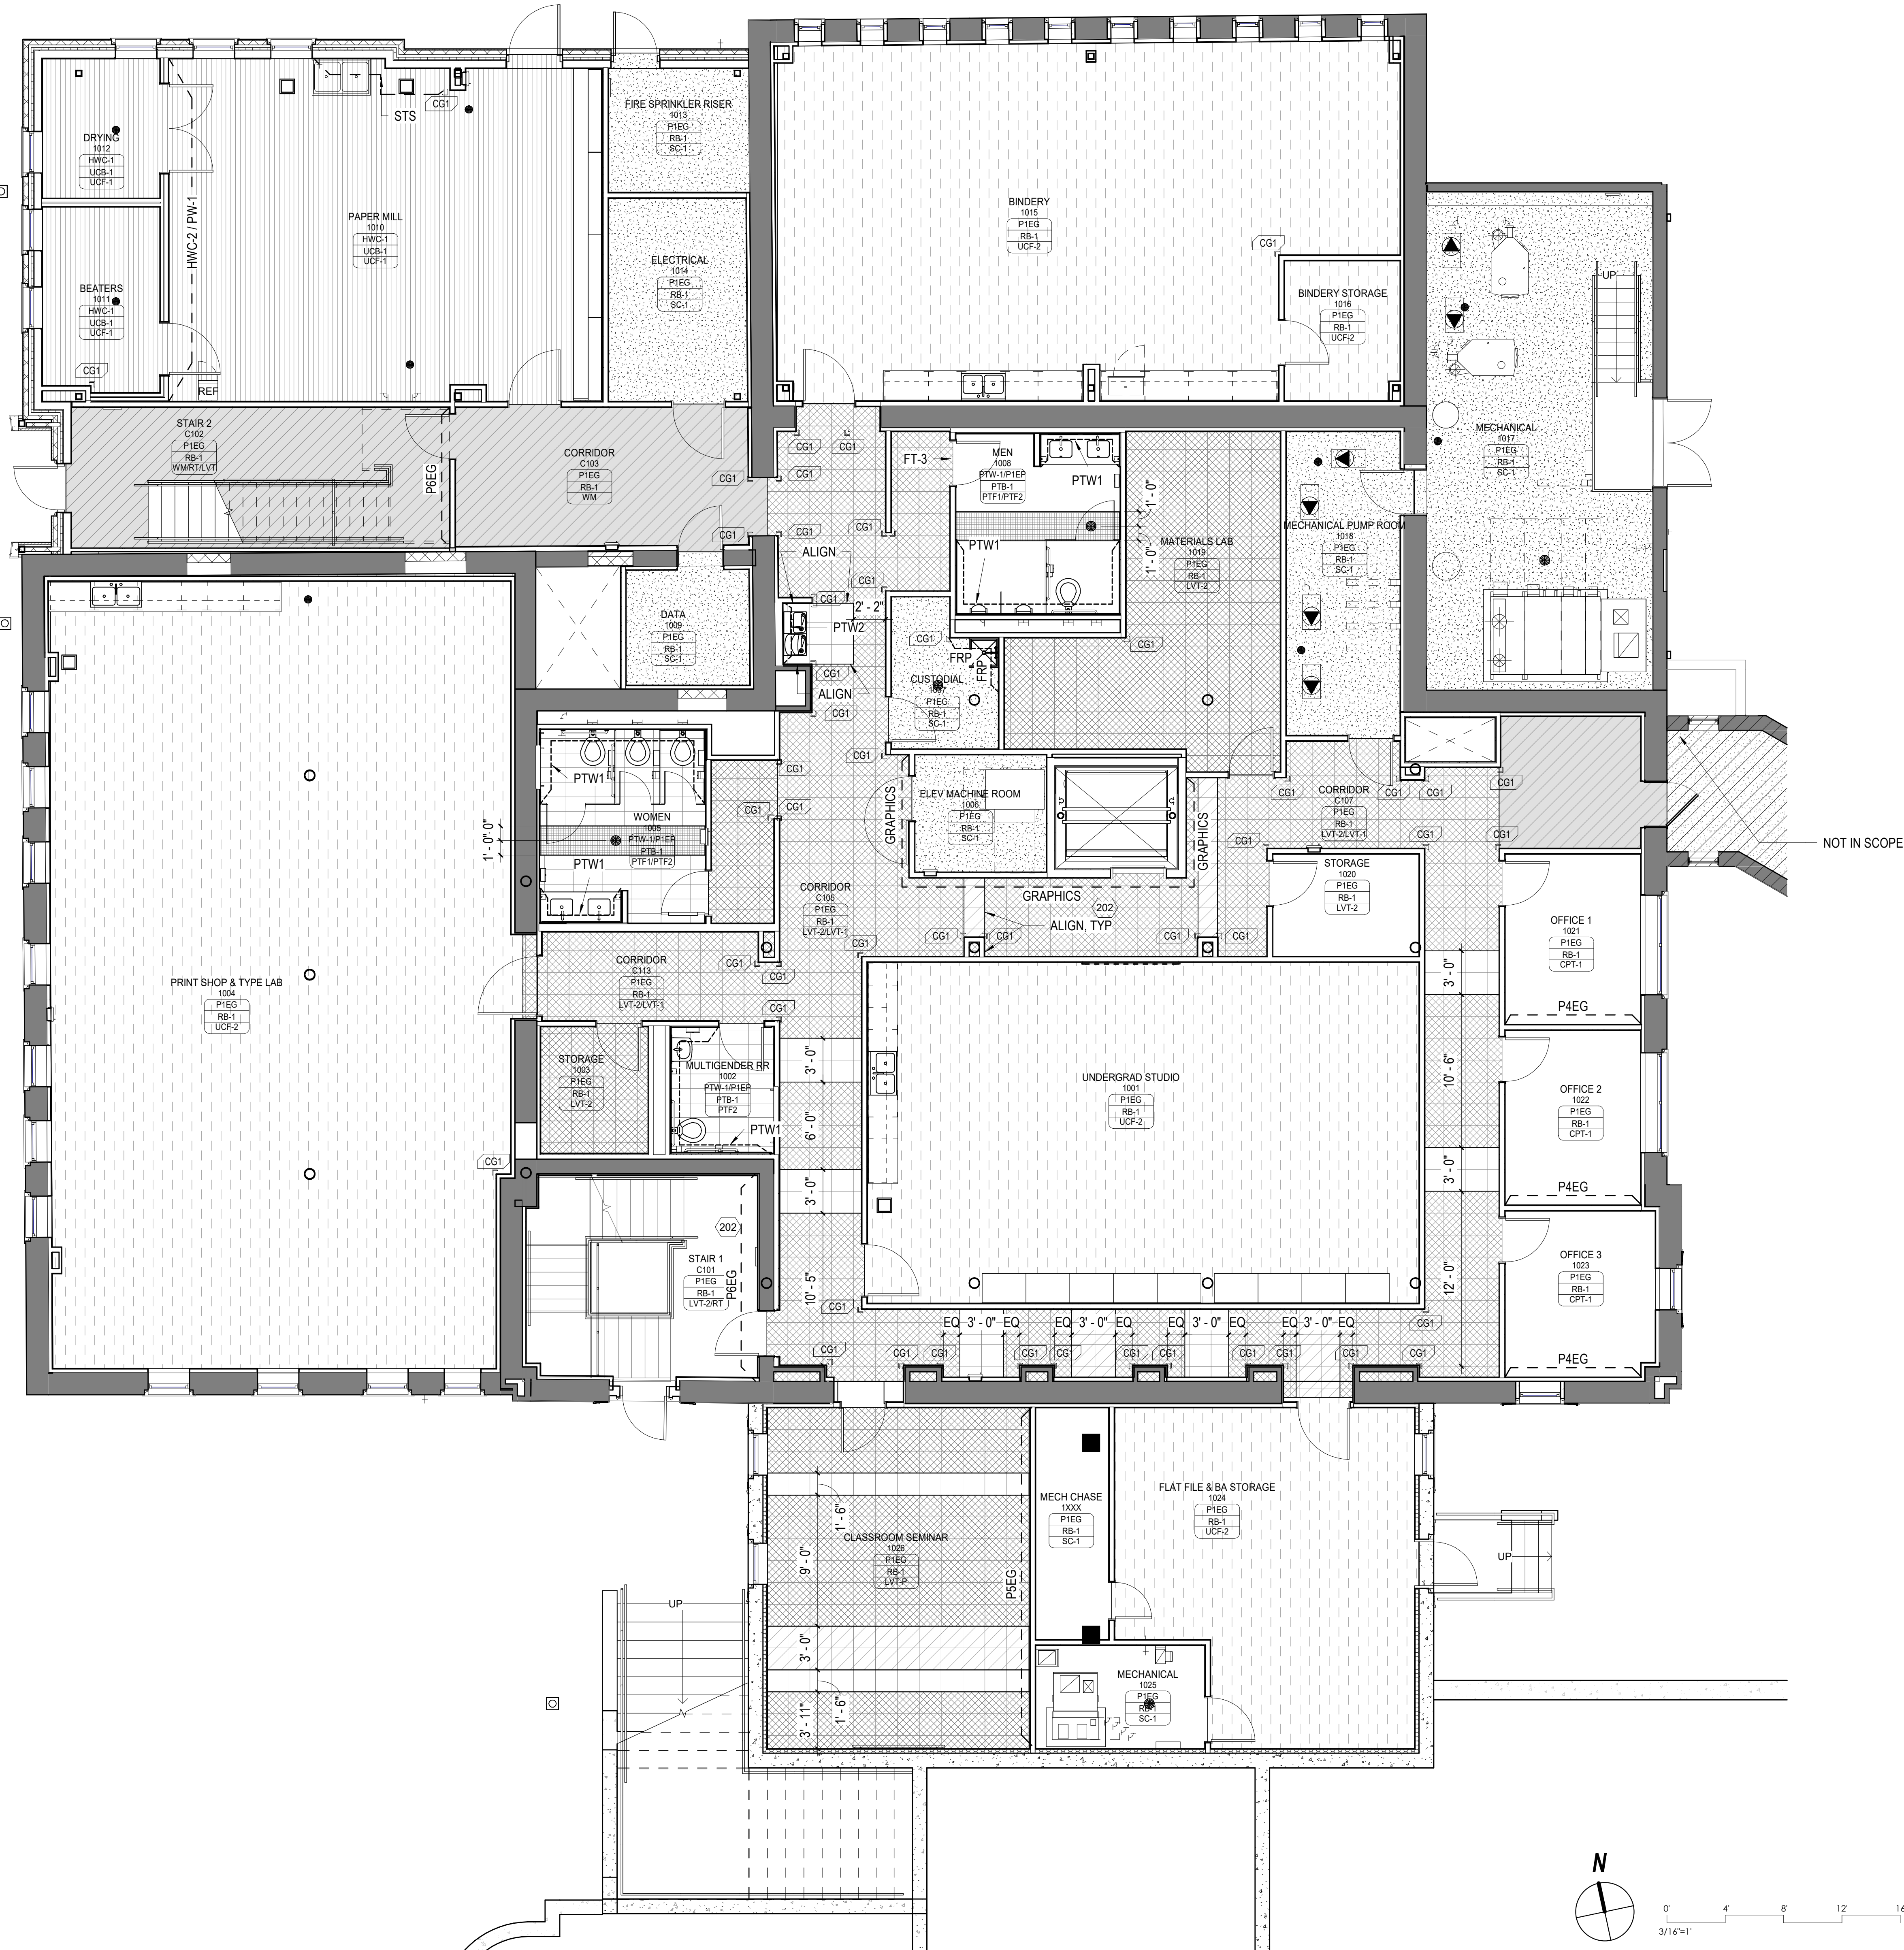


A1 FINISH PLAN - LEVEL 1
3/16" = 1'-0"

KEYNOTES

202 WALLS WHERE GRAPHICS OR PREG ACCENT PAINT OCCUR ARE TO HAVE LEVEL 5 FINISH

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

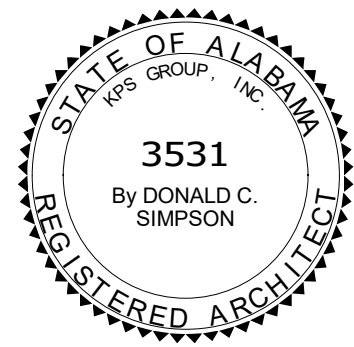

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES



PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
FINISH PLAN - LEVEL 1		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
ID1.11		

FINISH PLAN LEGEND

*NOT ALL FLOOR PATTERNS ARE SHOWN. REFER TO FINISH BLOCK.

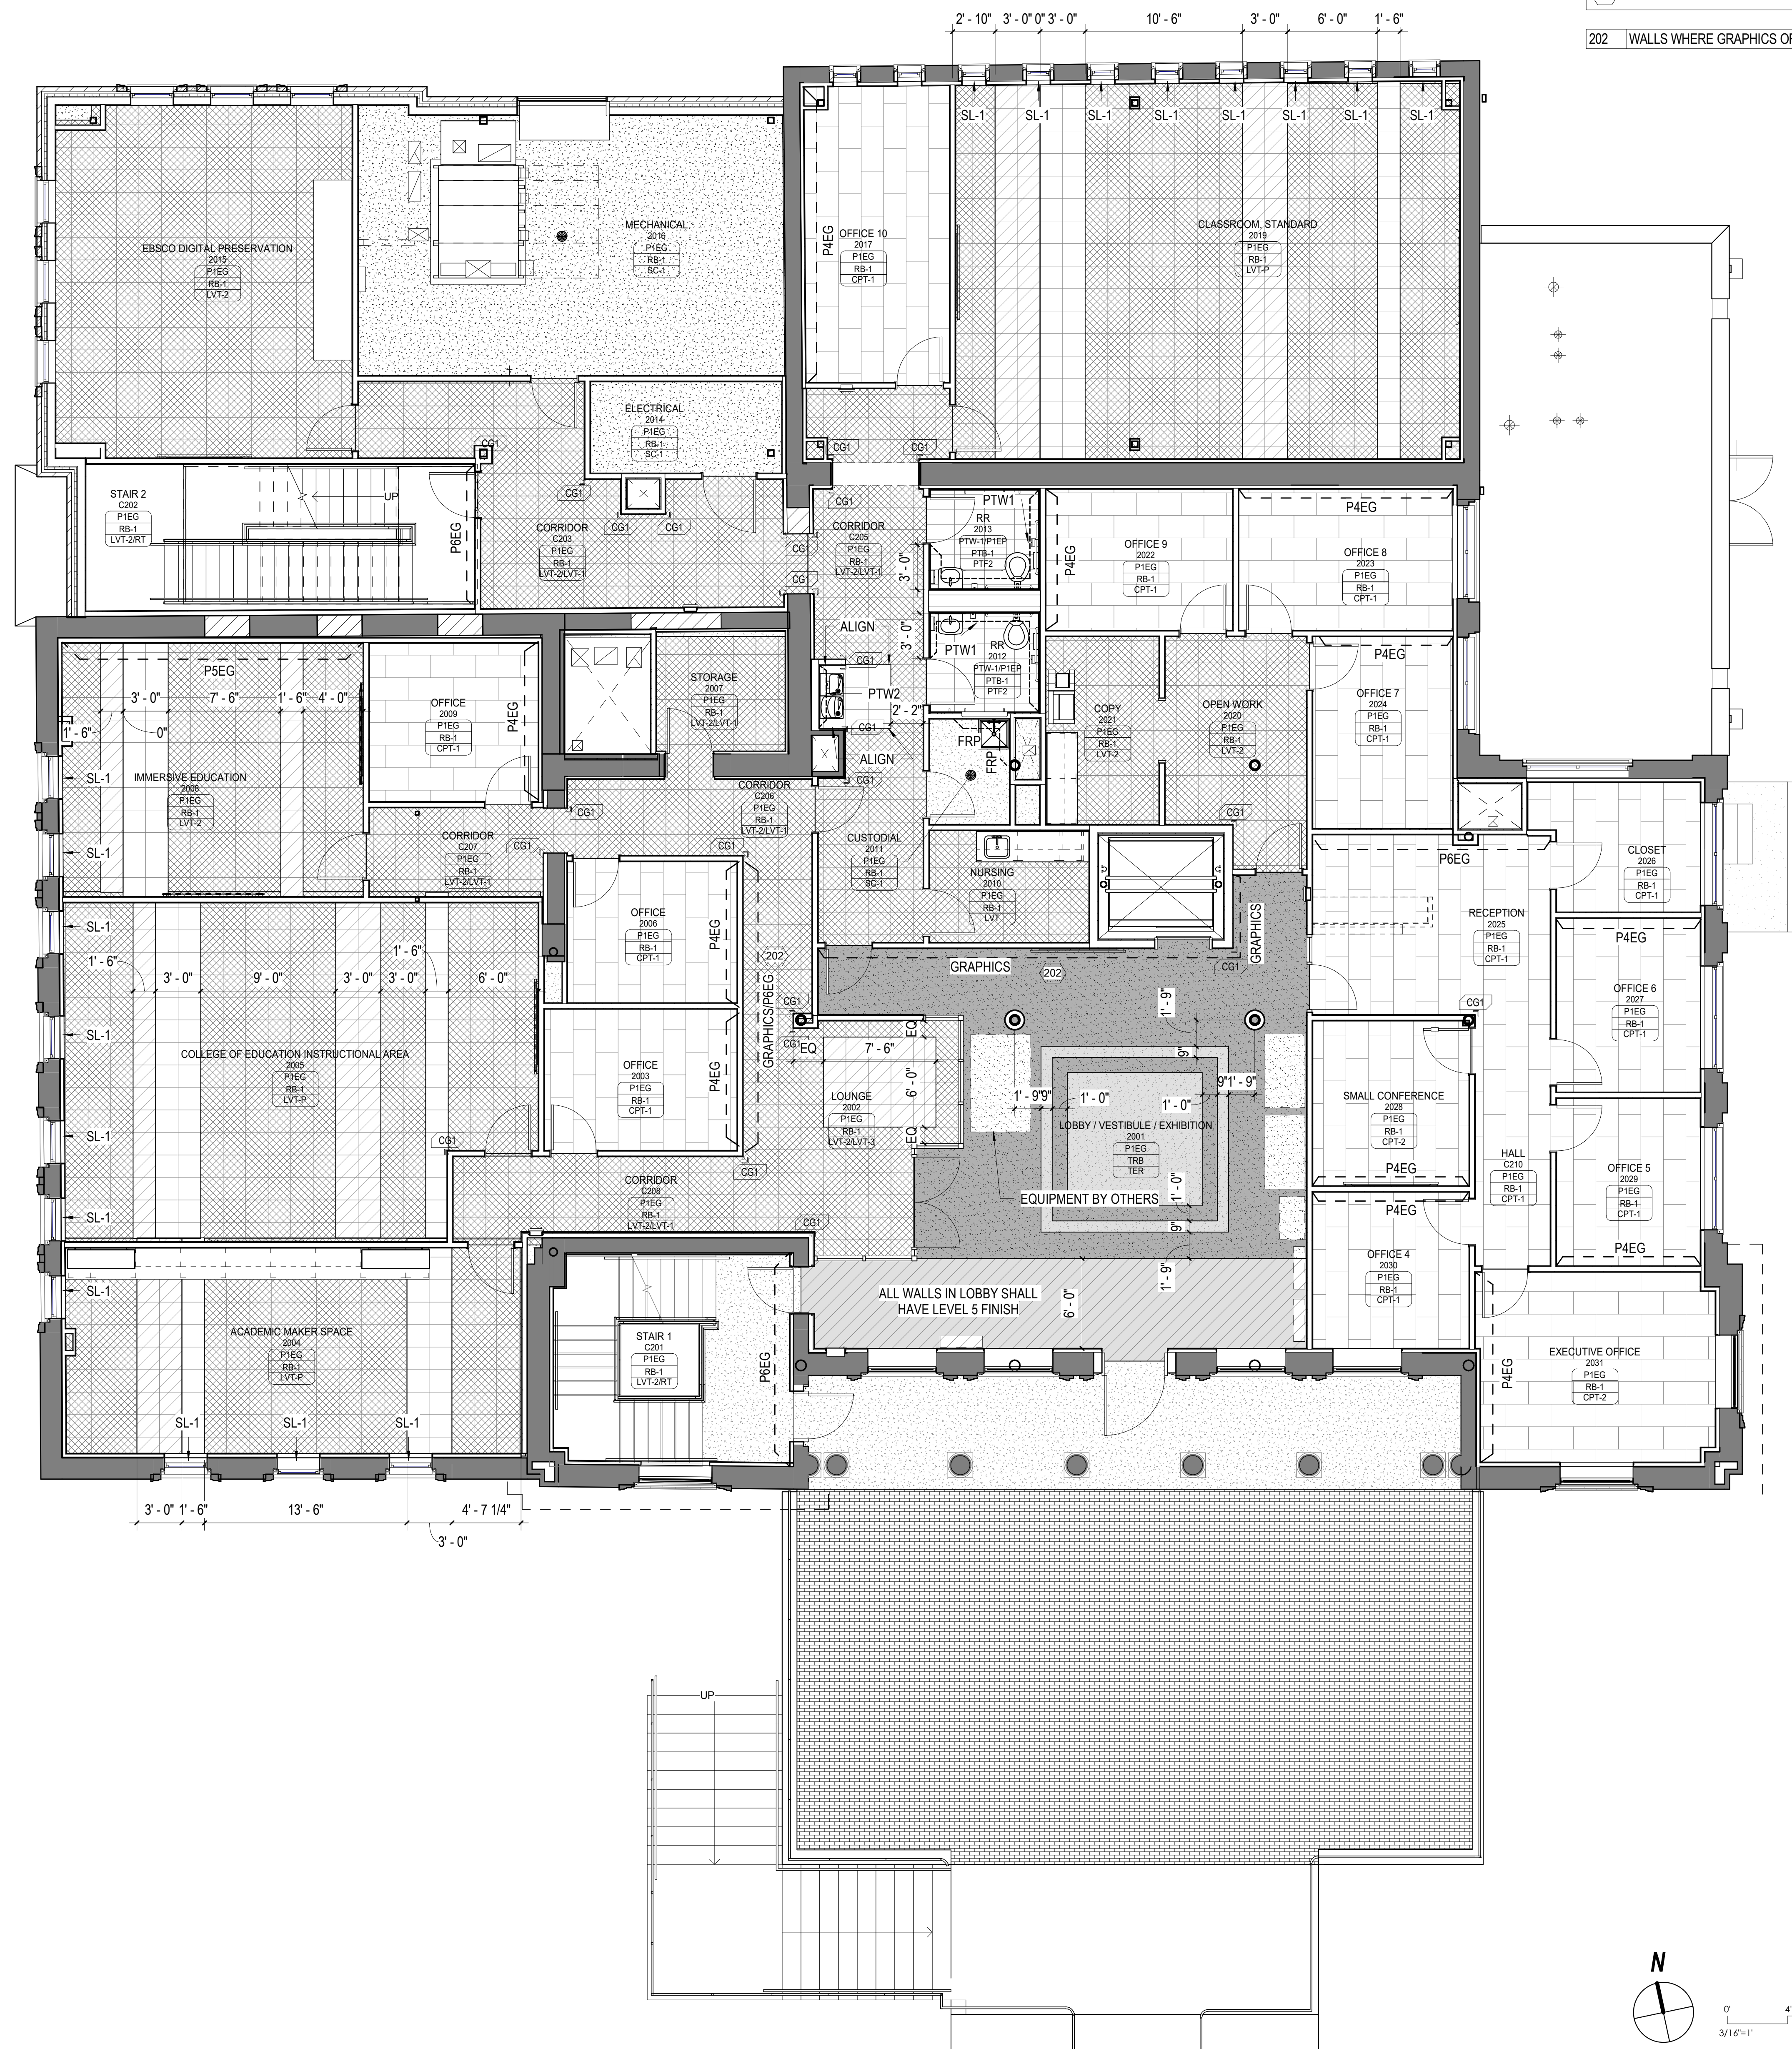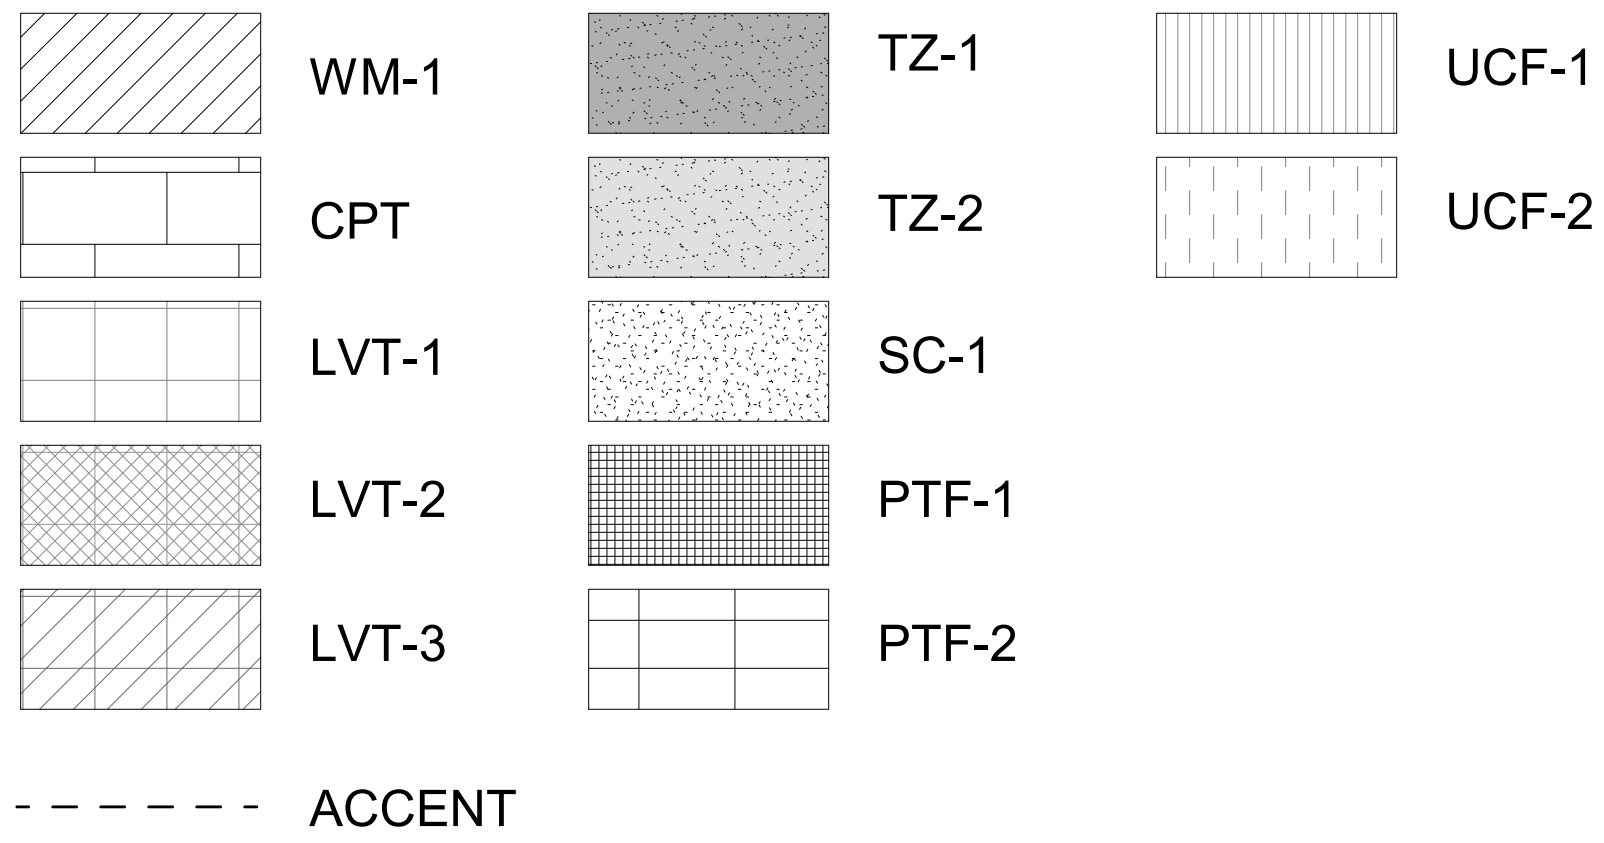

A1 FINISH PLAN - LEVEL 2
3/16" = 1'-0"


KEYNOTES

202	WALLS WHERE GRAPHICS OR P6EG ACCENT PAINT OCCUR ARE TO HAVE LEVEL 5 FINISH
-----	--

K | P | S
G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

The Architect shall not have control or charge, and shall not be responsible for construction means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, subcontractors or any other persons performing any of the Work in accordance with the Contract documents.

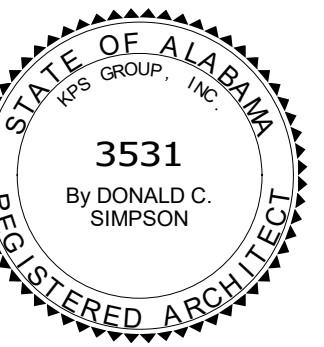

McCLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES

PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:		BID SET
ISSUE DATE:		30 JAN 24
REVISIONS		
No.	Description	Date

100

DRAWING TITLE
**FINISH PLAN -
LEVEL 2**

DRAWN BY:	Author
CHECKED BY:	Checker


PROJECT NUMBER
236002-02

DRAWING NO.
ID1.12

FINISH PLAN LEGEND

*NOT ALL FLOOR PATTERNS ARE SHOWN. REFER TO FINISH BLOCK.

	WM-1		TZ-1		UCF-1
	CPT		TZ-2		UCF-2
	LVT-1		SC-1		
	LVT-2		PTF-1		
	LVT-3		PTF-2		
	ACCENT				

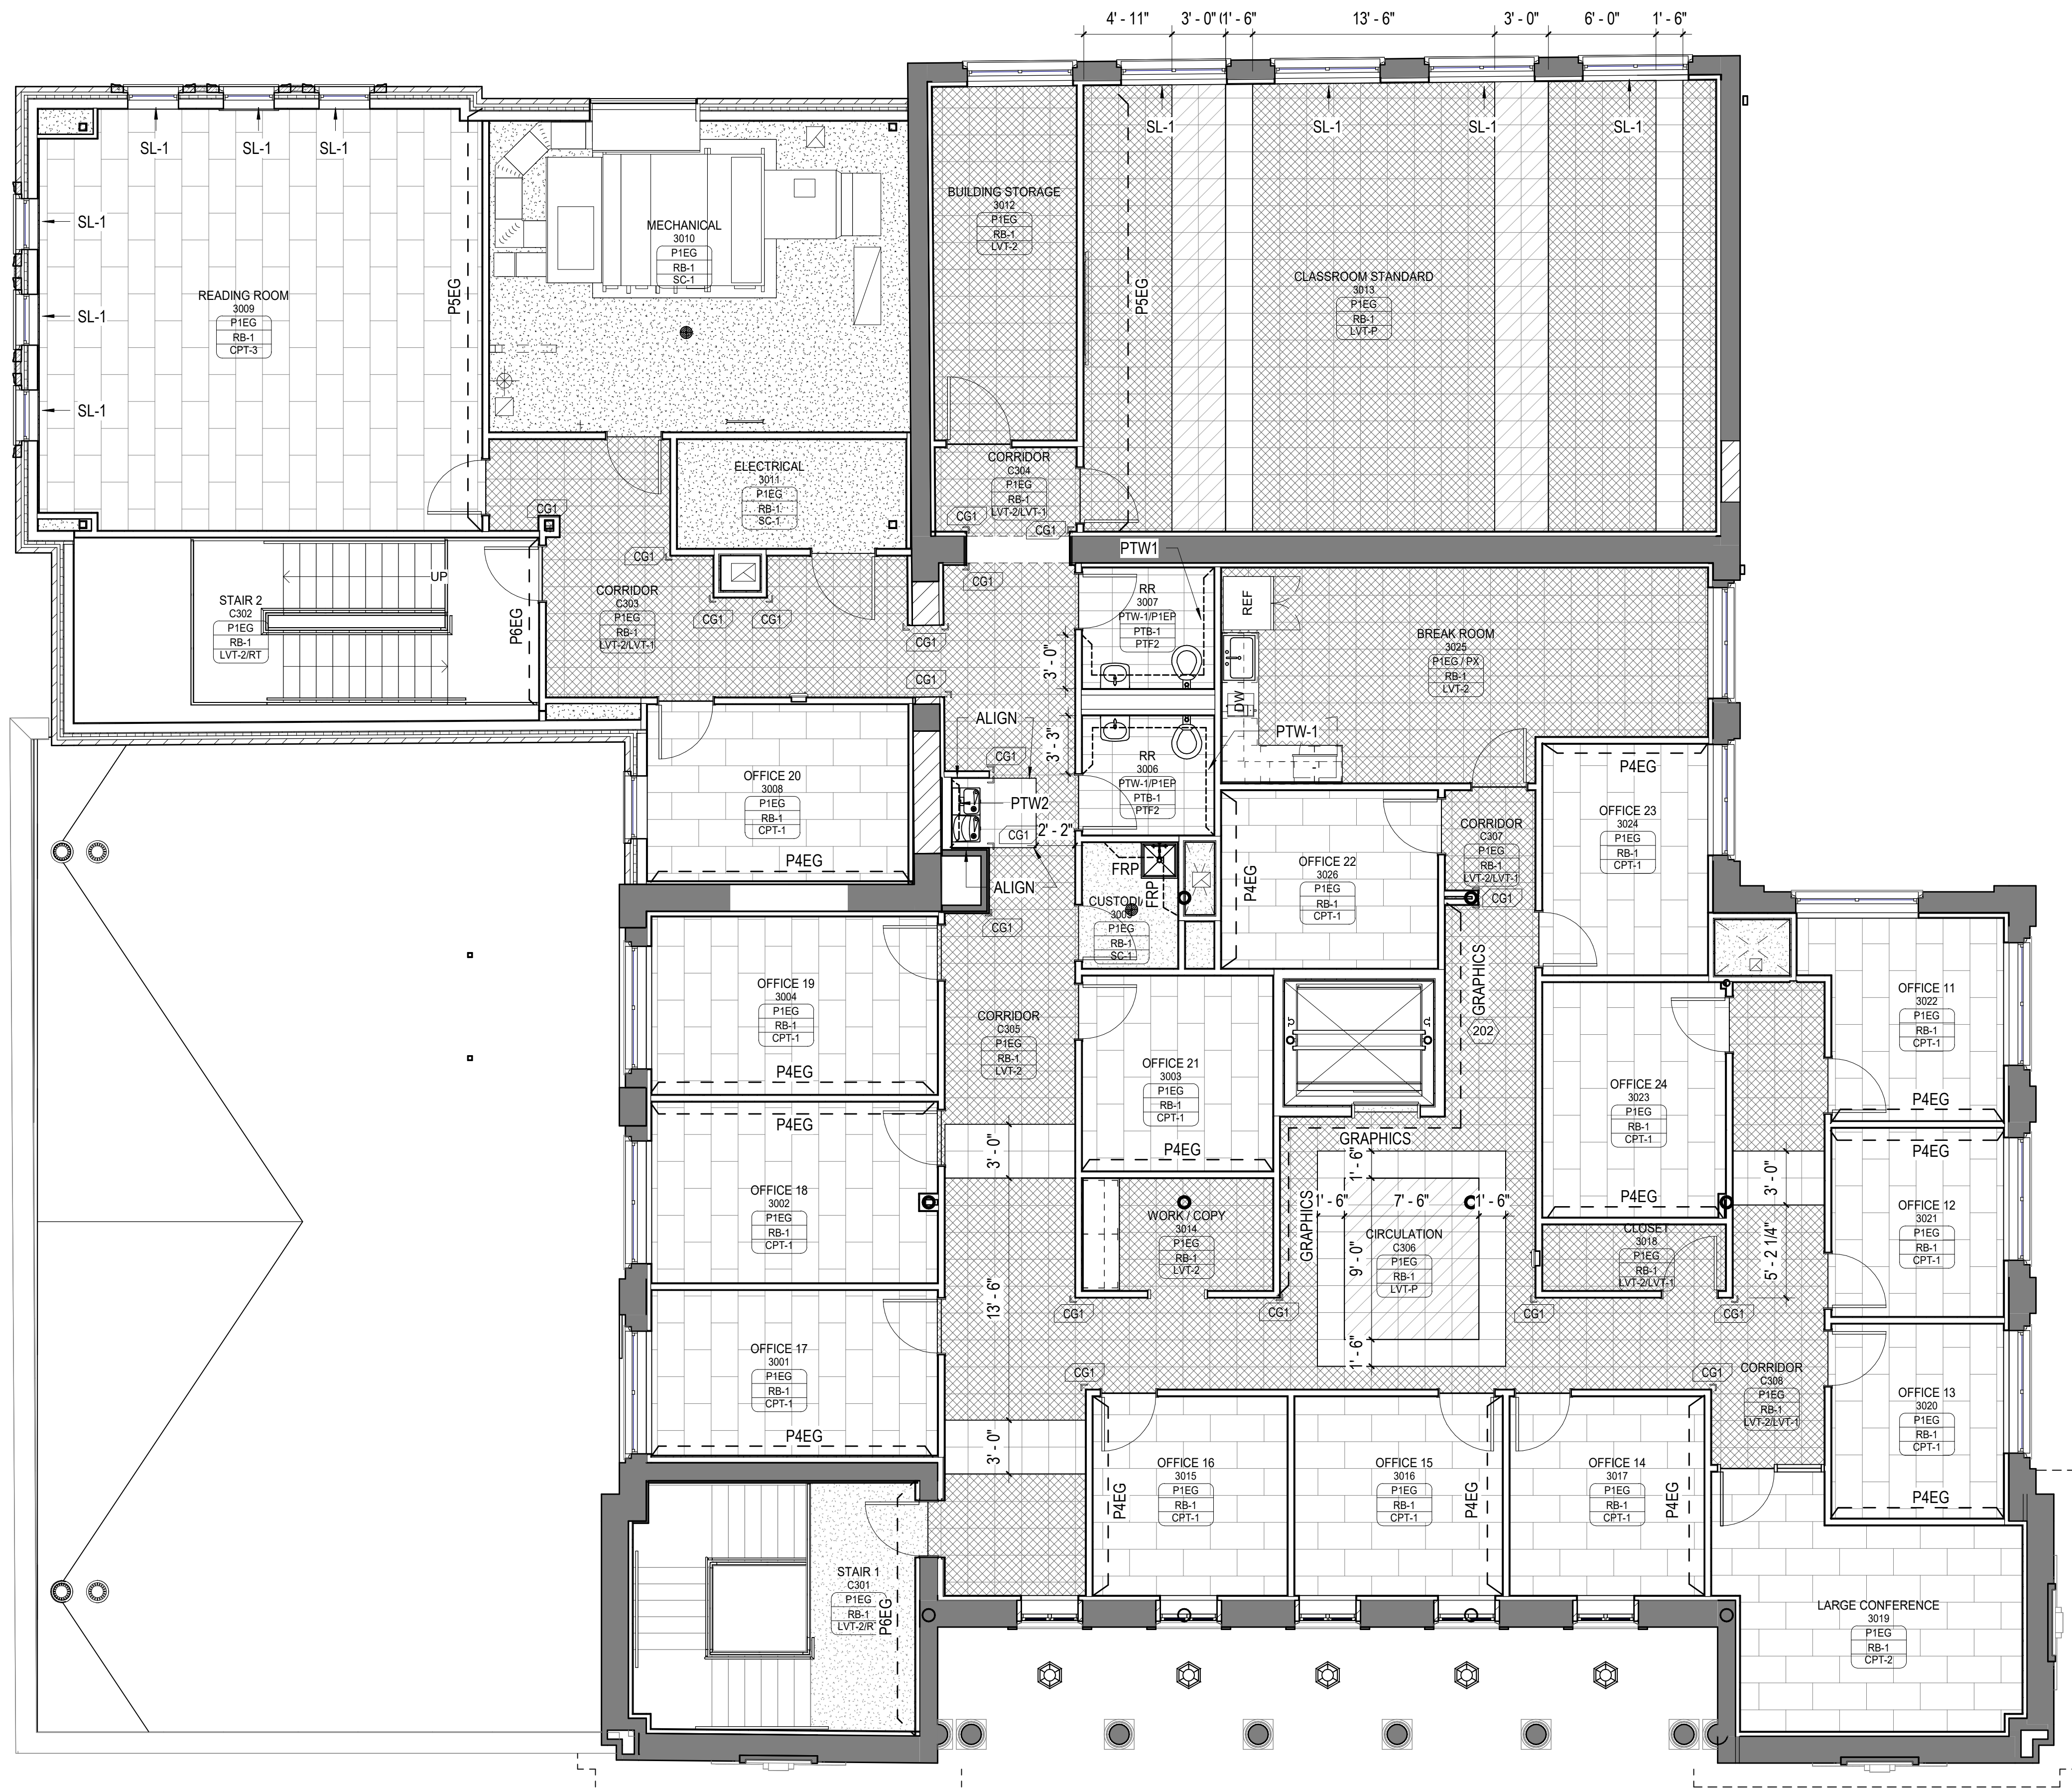

A1 FINISH PLAN - LEVEL 3
3/16" = 1'-0"


1

KEYNOTES

202 WALLS WHERE GRAPHICS OR P1EG ACCENT PAINT OCCUR ARE TO HAVE LEVEL 5 FINISH

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

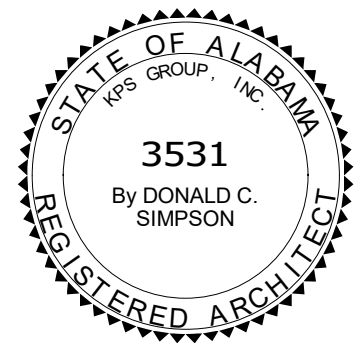

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE 'D' - ADDITION AND RENOVATION


OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF
COMMUNICATIONS AND INFORMATION SCIENCES
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS		
ISSUED SET:	BID SET	
ISSUE DATE:	30 JAN 24	
REVISIONS		
No.	Description	Date
DRAWING TITLE		
FINISH PLAN - LEVEL 3		
DRAWN BY:		Author
CHECKED BY:		Checker
PROJECT NUMBER		
236002-02		
DRAWING NO.		
ID1.13		

Autodesk Docs://McLure Library/236002-02 McLure Library - Arch.rvt

1 FURNITURE PLAN - LEVEL 1
3/16" = 1'-0"

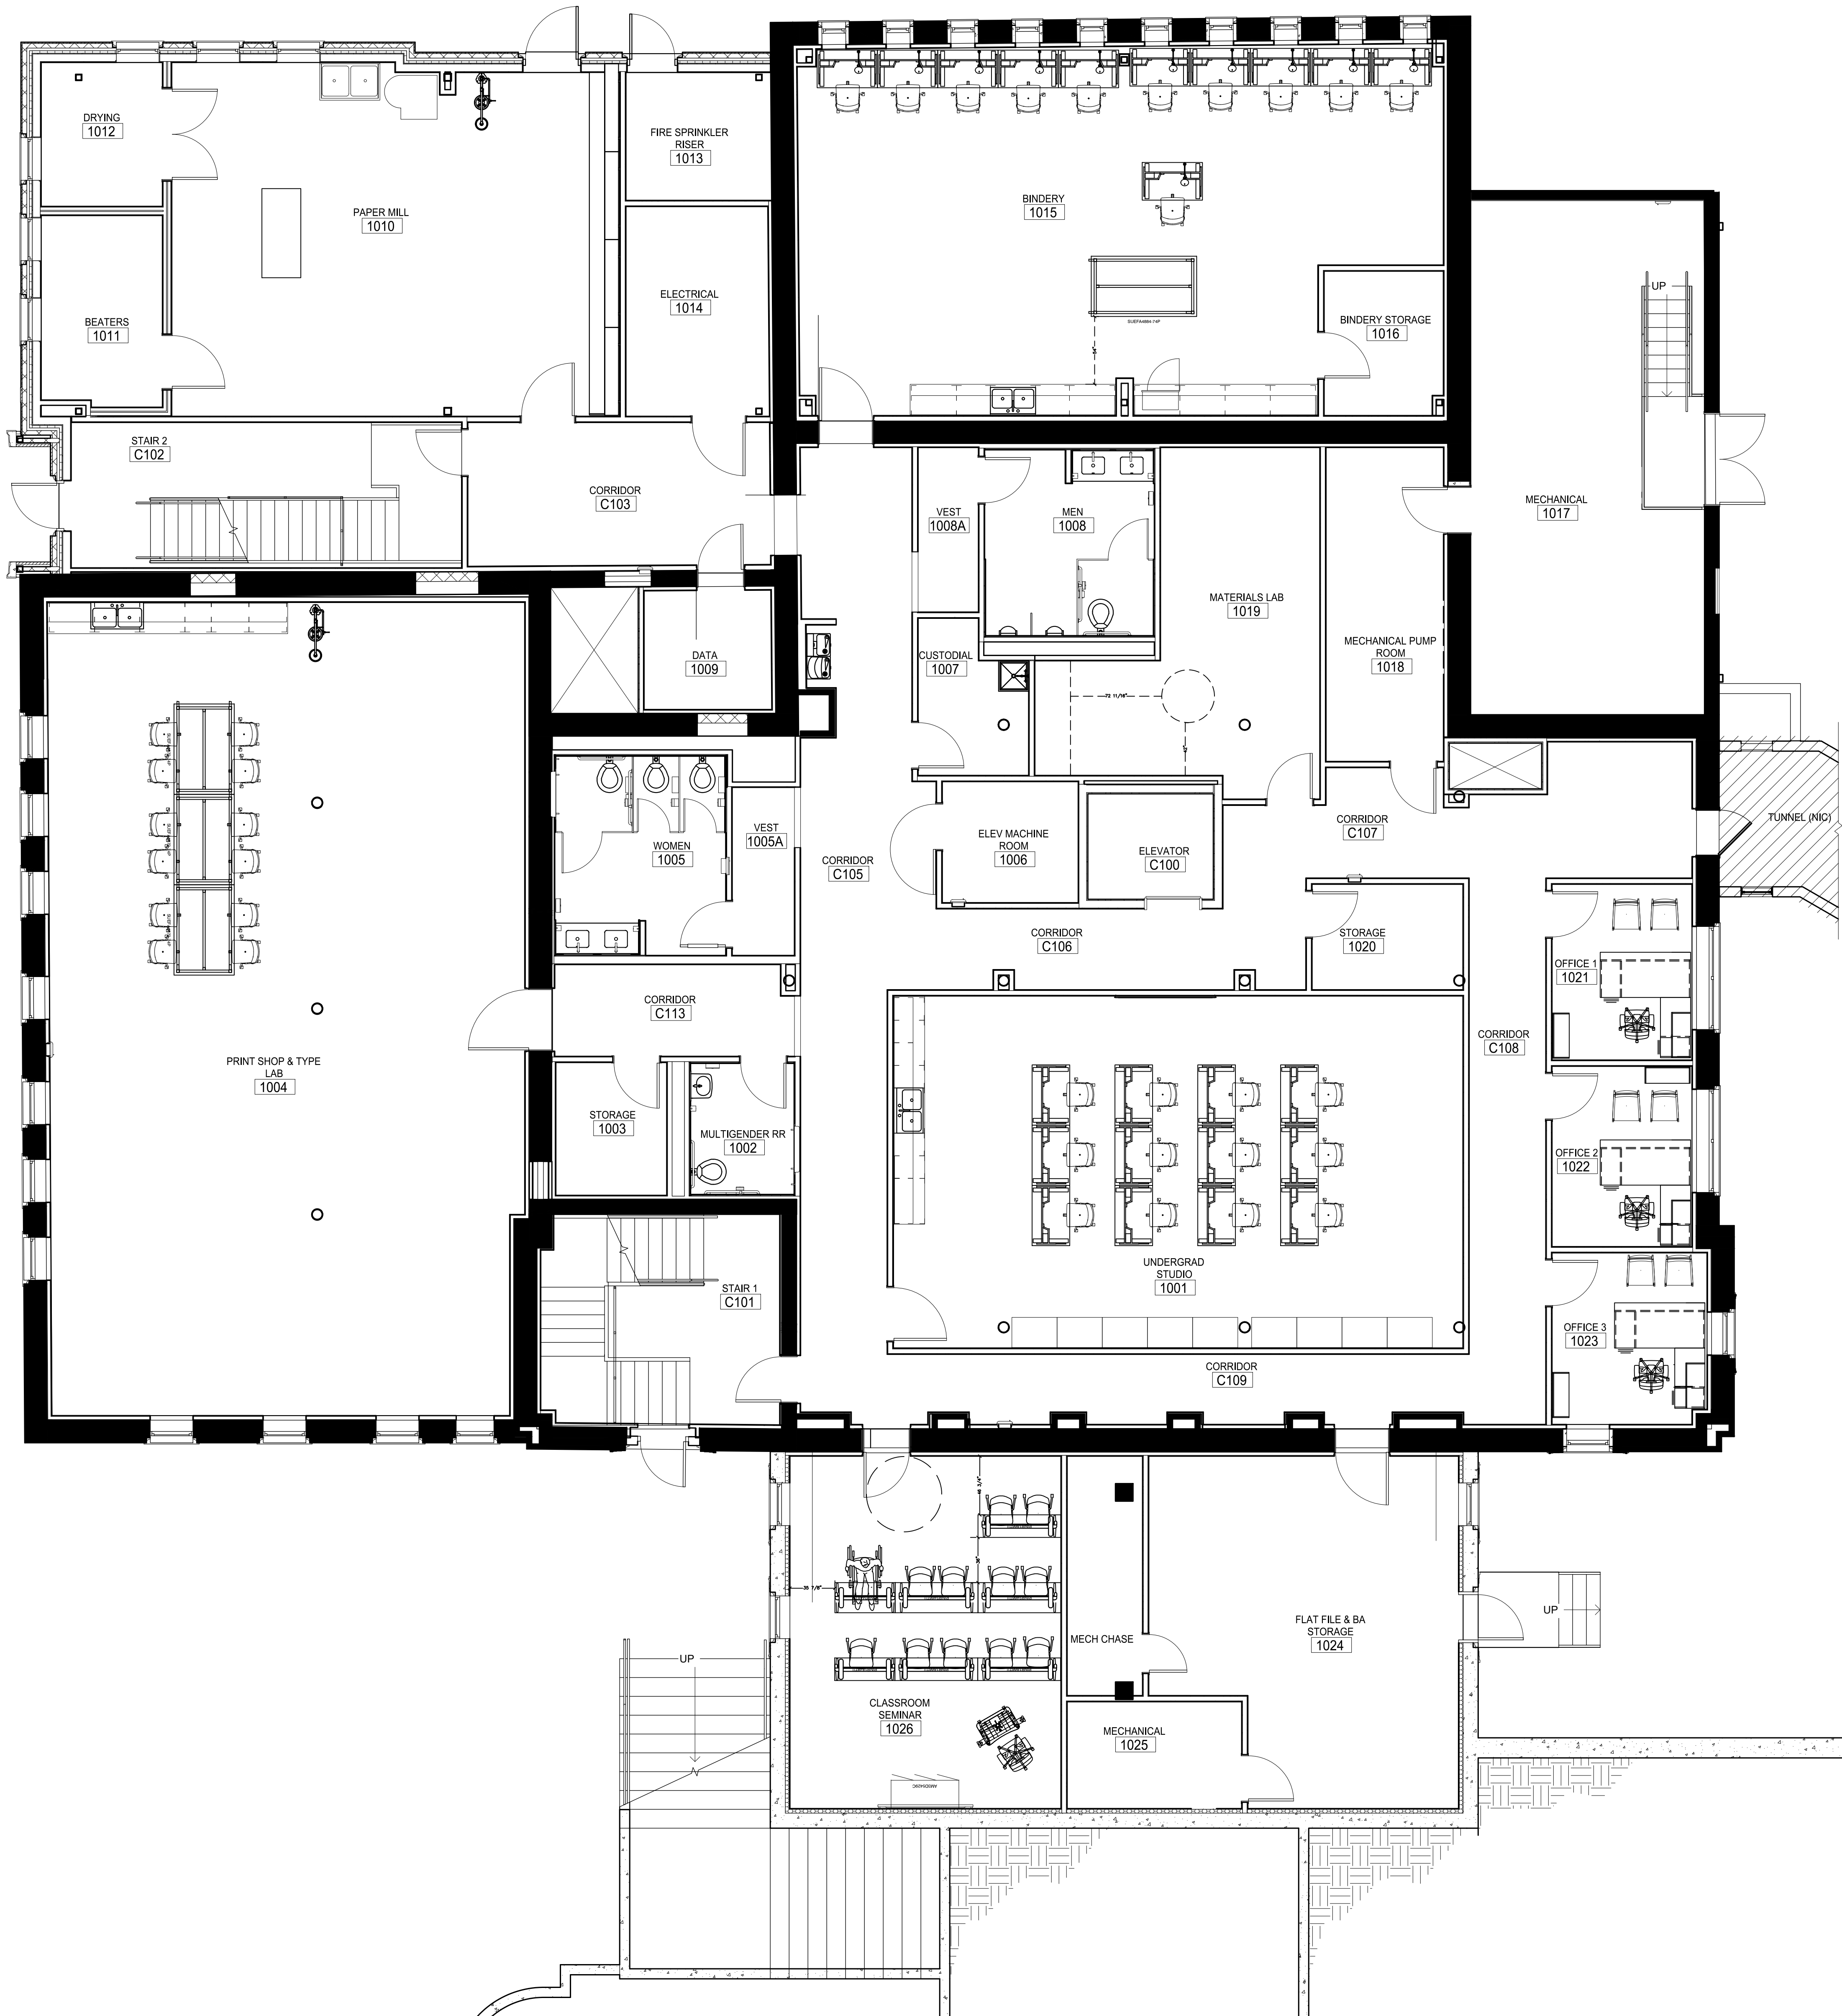

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor. Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

NOT FOR CONSTRUCTION

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE B - SELECTIVE DEMOLITION
OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOM No. 2023453
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



PROJECT STATUS
ISSUED SET: 100% CONSTRUCTION DOCUMENTS
ISSUE DATE: 15 JAN 24


REVISIONS
No. Description Date

DRAWING TITLE
FURNITURE PLAN - LEVEL 1


DRAWN BY: L.NICHOLS Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
ID1.21

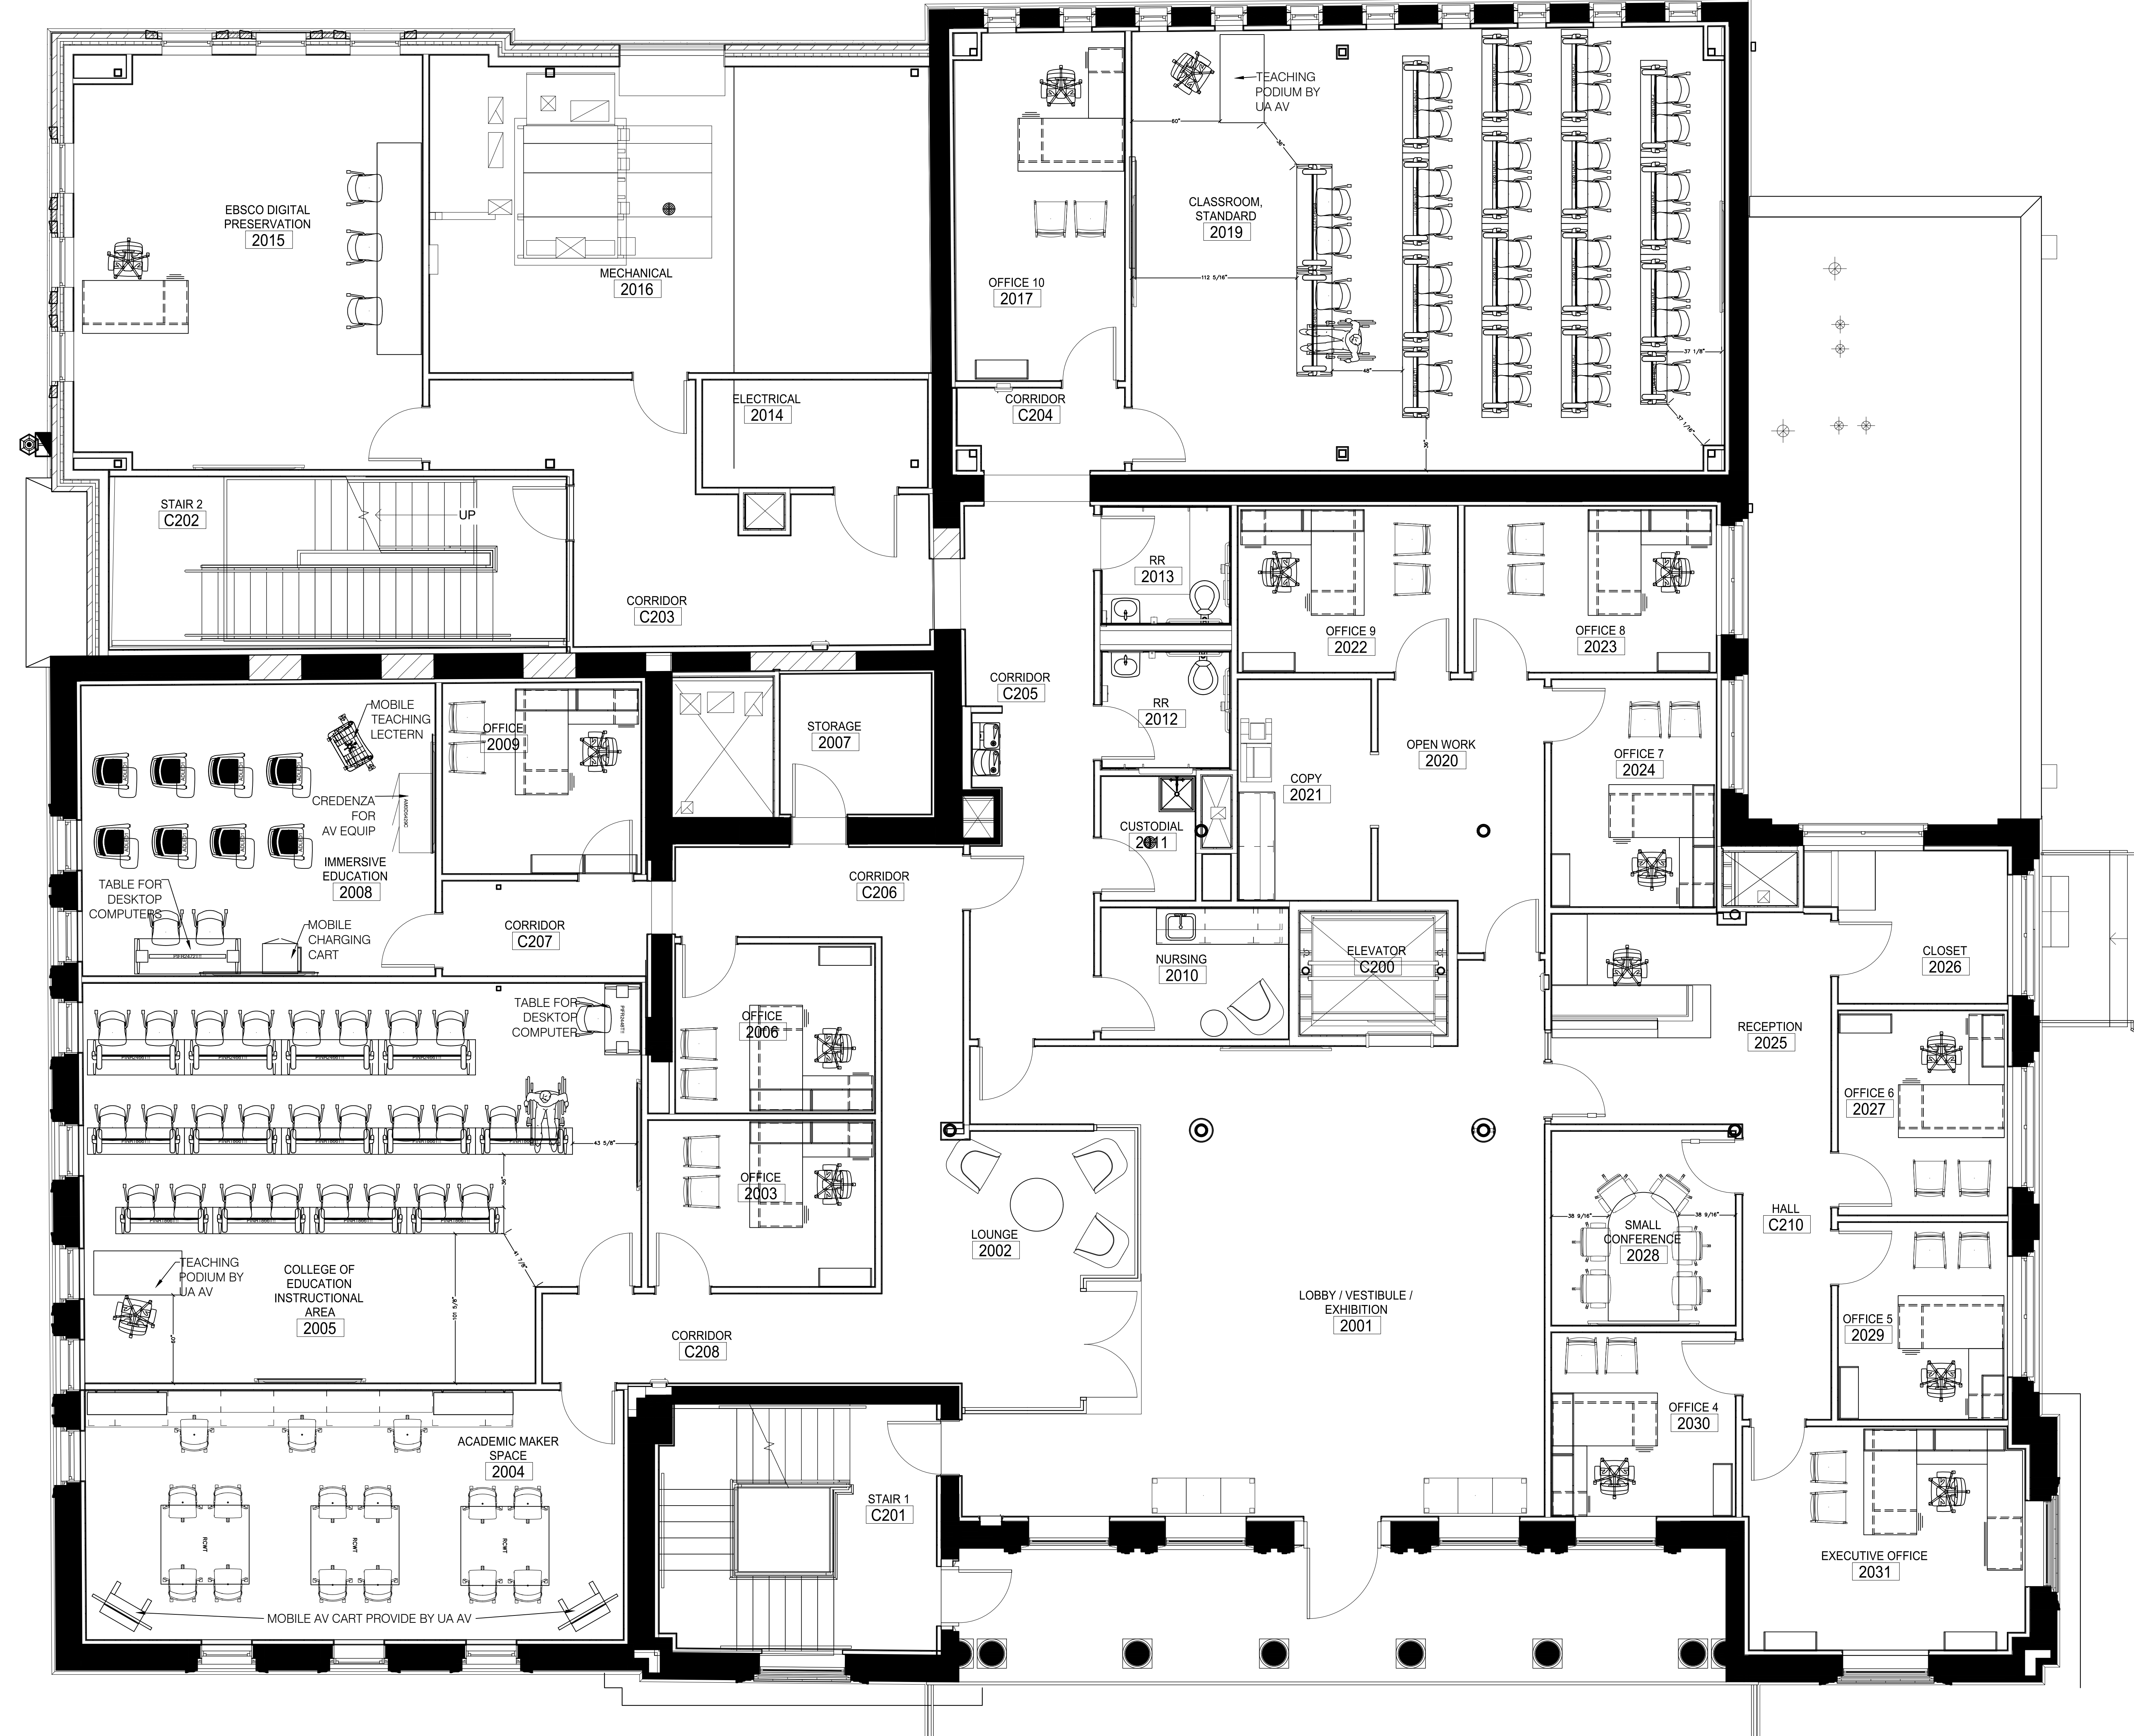

1 FURNITURE PLAN - LEVEL 2
1/4" = 1'-0"

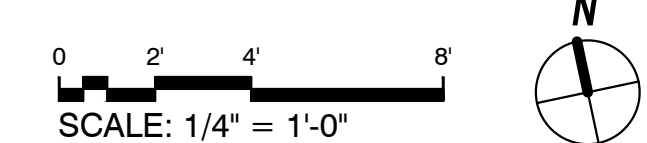

KEYNOTES

K|P|S
G R O U P
BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.

The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor. Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

NOT FOR CONSTRUCTION

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE "B" - SELECTIVE DEMOLITION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
DOM No. 2024243
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401

PROJECT STATUS
ISSUED SET: 100% CONSTRUCTION DOCUMENTS
ISSUE DATE: 15 JAN 24


REVISIONS		
No.	Description	Date



DRAWING TITLE
FURNITURE PLAN - LEVEL 2

DRAWN BY: L.NICHOLS Author
CHECKED BY: Checker

PROJECT NUMBER
236002-02

DRAWING NO.
ID1.22



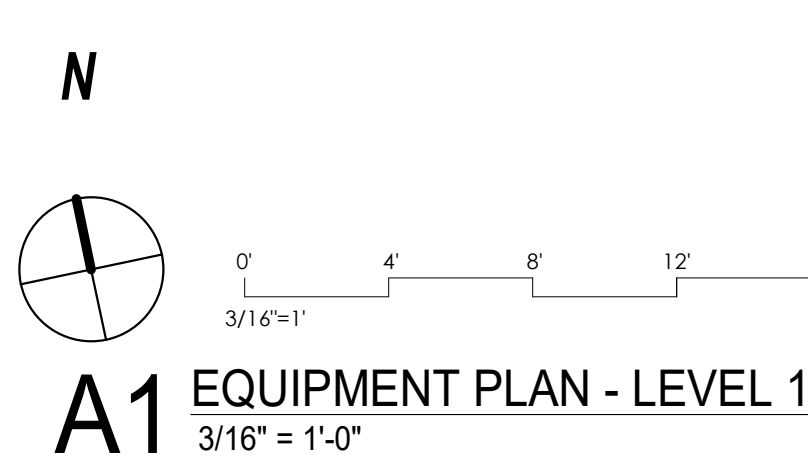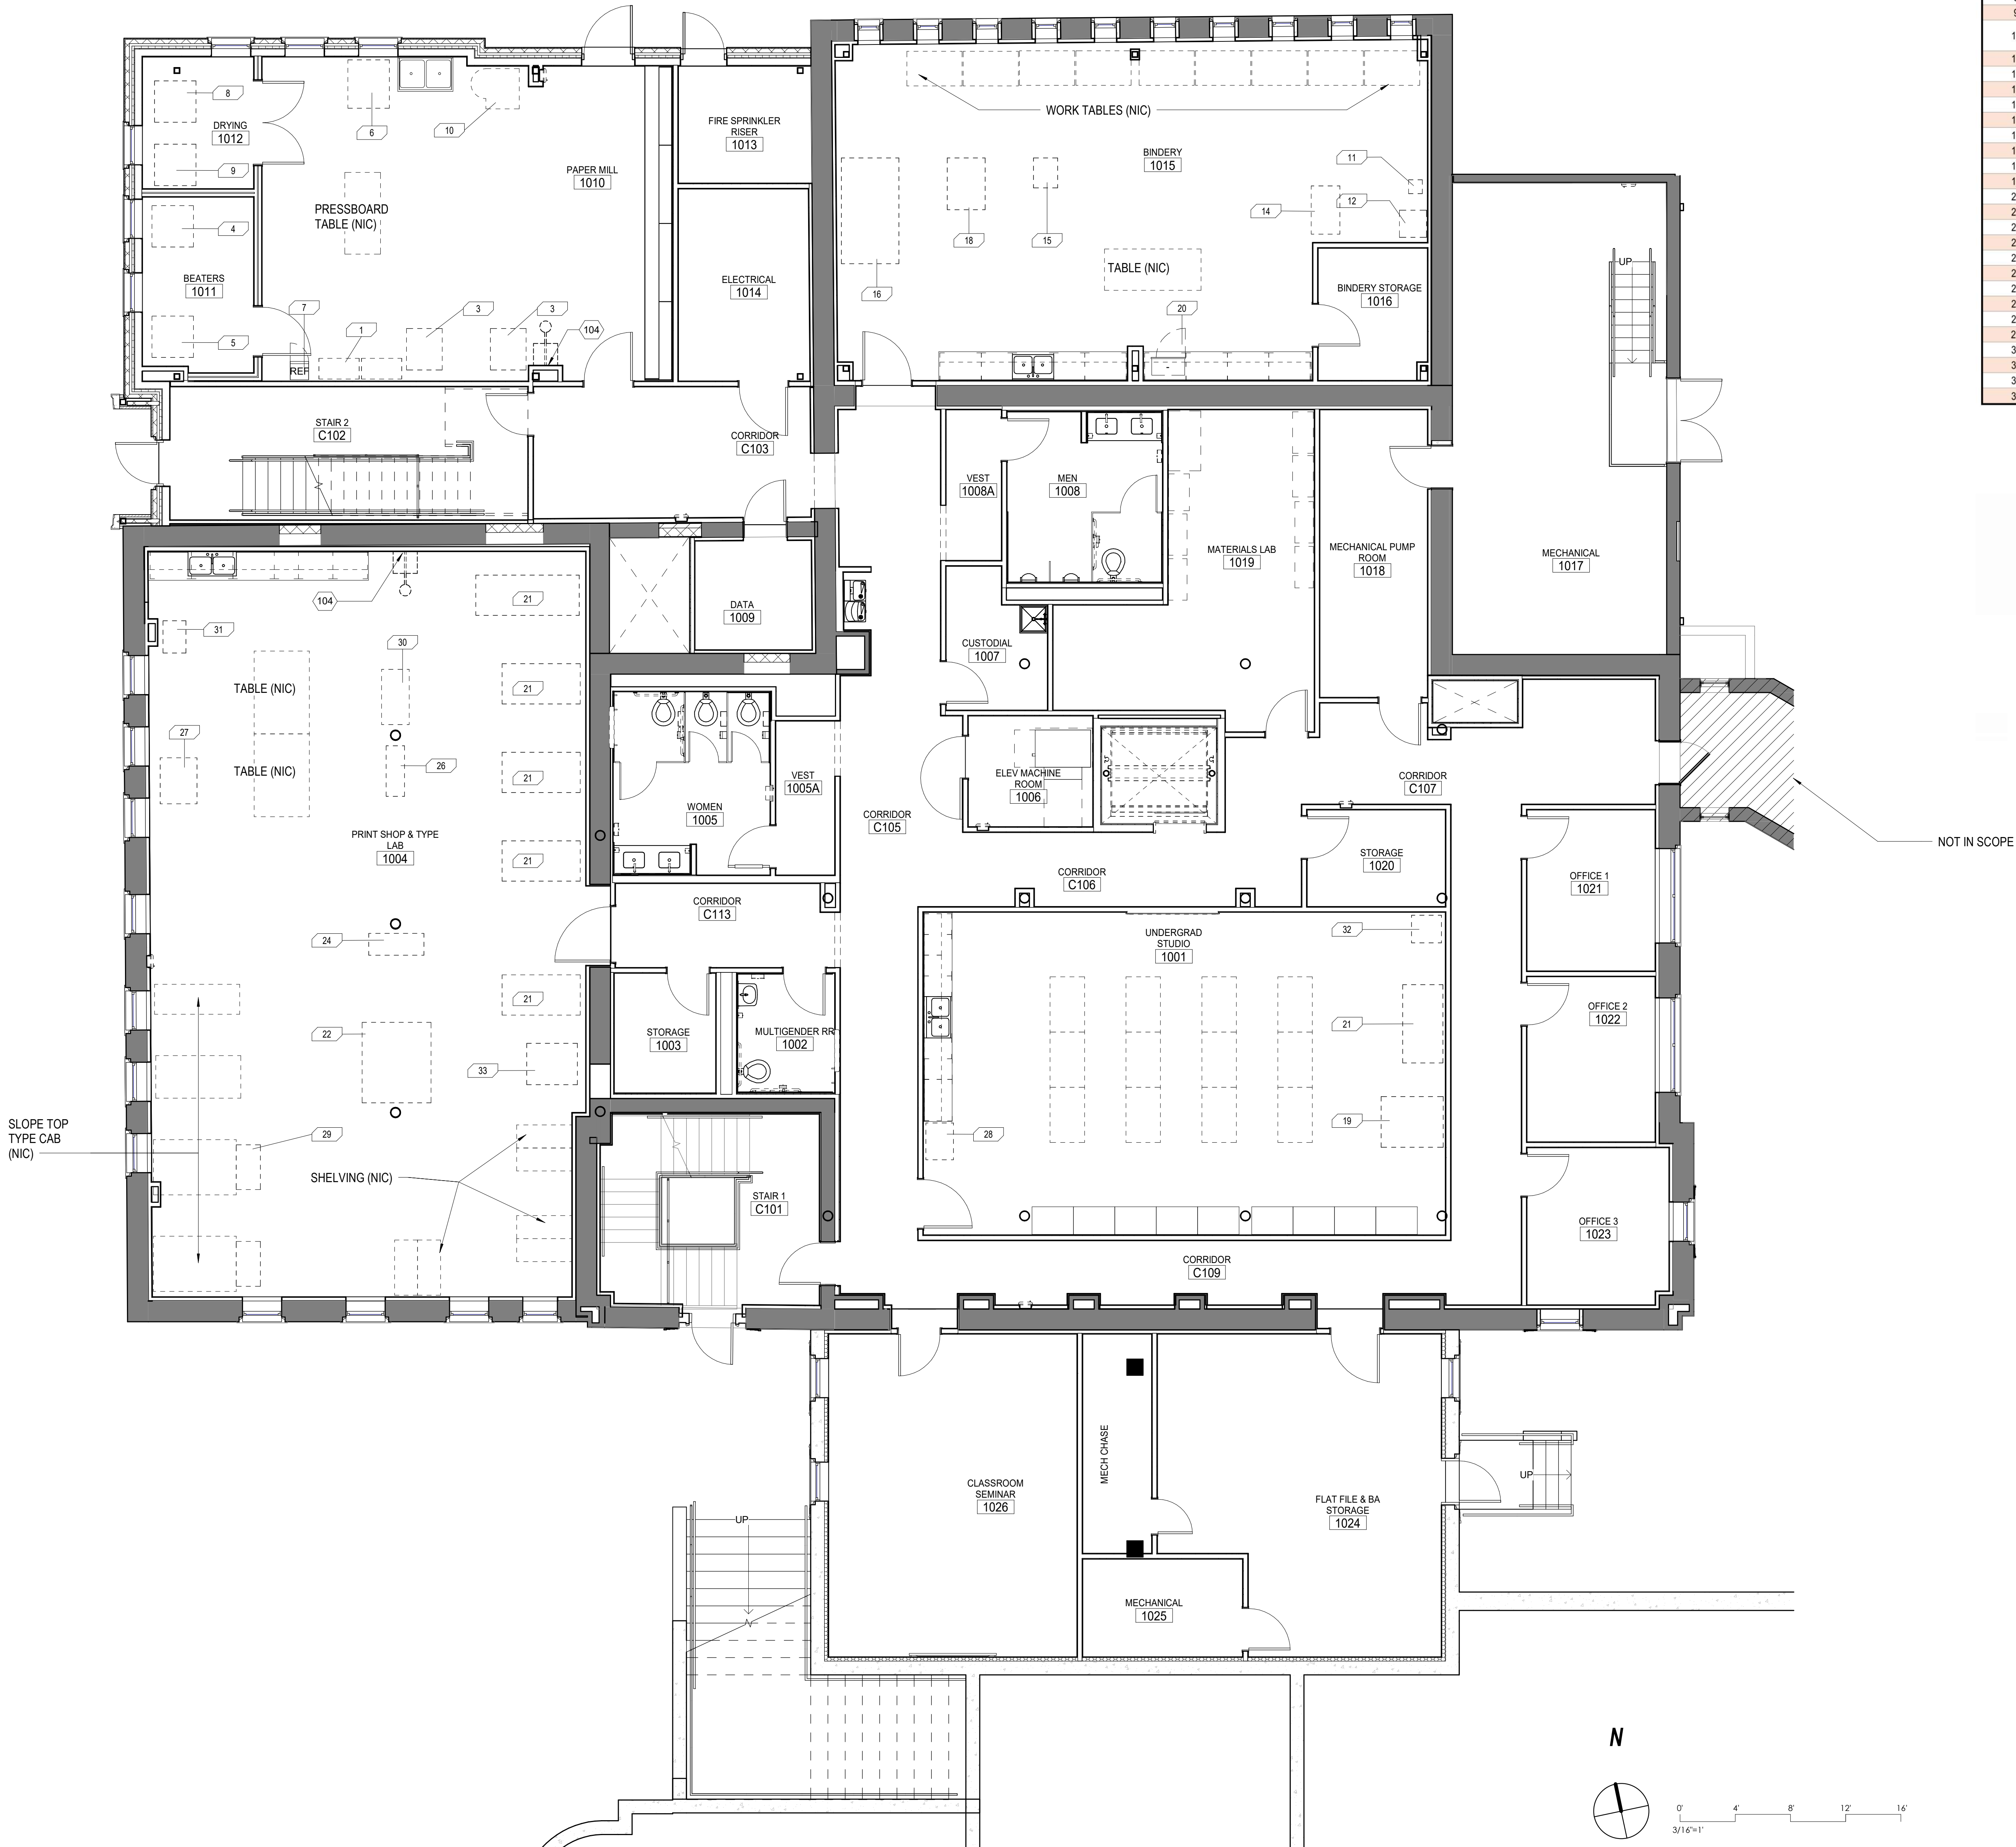

A1 EQUIPMENT PLAN - LEVEL 1
3/16" = 1'-0"

KEYNOTES

104 RECESSED EYEWASH STATION; RE: PLUMBING

EQUIPMENT SCHEDULE - FOR COORDINATION					
NUMBER	NAME	PROVIDER	ELECTRICAL	PLUMBING	EXHAUST
1	FIBER CABINET	OFOI	N	N	N
2	NOT USED				
3	VAT	OFOI	N	Y	N
4	HOLLANDER BEATER	OFOI	Y	Y	N
5	MAGINATA BEATER	OFOI	Y	Y	N
6	HYDRAULIC PRESS	OFOI	N	N	N
7	MINI FRIDGE	OFOI	Y	N	N
8	RESTRAINT DRYING SYSTEM 1	OFOI	Y	N	N
9	RESTRAINT DRYING SYSTEM 2	OFOI	Y	N	N
10	ELECTRIC KETTLE (Green Model No. DEE-20/40/60C/C2T)	OFOI	208V	Y	Y
11	KWIKPRINT HOT STAMPING MACHINE	OFOI	110V	N	N
12	PRAGNANT HOT STAMPING MACHINE	OFOI	110V	N	N
13	LARGE TABLE	OFOI	N	N	N
14	NIPPING PRESS	OFOI	N	N	N
15	JOB BACKER	OFOI	N	N	N
16	BOARD SHEAR	OFOI	N	N	N
17	LARGE NIPPING PRESS	OFOI	N	N	N
18	PLOUGH	OFOI	N	N	N
19	KUTTRIMMER	OFOI	N	N	N
20	MICROWAVE	OFOI	Y	N	N
21	VANDERCOOK PRESS	OFOI	110V	N	Y
22	RELIANCE PRESS	OFOI	N	N	Y
23	NOT USED				
24	ETCHING PRESS	OFOI	N	N	Y
25	NOT USED				
26	TYPE STORAGE	OFOI	N	N	N
27	ROLLING DRYING RACK	OFOI	N	N	N
28	POLYMER PLATE MAKER	OFOI	110V	Y	N
29	COMPOSING STONE & FURNITURE	OFOI	N	N	N
30	INKING SURFACE	OFOI	N	N	N
31	POLYMER PLATE MAKER	OFOI	220V		
32	HAND PRESS	OFOI	N	N	Y
33	PRESS	OFOI	N	N	Y


K|P|S

G R O U P

BAKERS ROW, Suite 100
60 14th Street South
Birmingham, AL 35233
205.251.0125
www.kpsgroup.com

This drawing is an Instrument of Service for this Project and is the sole and exclusive property of the Architect. Any use without the knowledge and written consent of the Architect is prohibited.


The Architect shall not have control or charge of, and shall not be responsible for construction Means and Methods, deviations, techniques, sequences, or procedures, or for safety programs and precautions in connection with the Work, for the acts or omissions of the Contractor, Subcontractors or any other persons performing any of the Work in accordance with the Contract Documents.

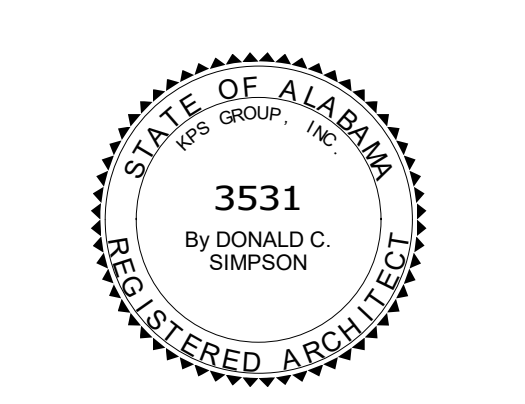

McLURE LIBRARY ADDITION AND RENOVATION

PACKAGE D - ADDITION AND RENOVATION

OWNER
UNIVERSITY OF ALABAMA - COLLEGE OF EDUCATION & COLLEGE OF COMMUNICATIONS AND INFORMATION SCIENCES
BUILDING 2024B3
PROJECT ADDRESS
918 UNIVERSITY BOULEVARD, TUSCALOOSA, ALABAMA 35401



1831

PROJECT STATUS

ISSUED SET: BID SET

ISSUE DATE: 30 JAN 24

REVISIONS

No.	Description	Date
-----	-------------	------

DRAWING TITLE

EQUIPMENT PLAN - LEVEL 1

DRAWN BY:

CHECKED BY:

PROJECT NUMBER

236002-02

DRAWING NO.

ID1.51