



STATEMENT OF WORK (SOW)

Task Order No: FA4861-23-F-0203 (RKMF 23-0064)
Construct Addition and Repair for 328 WPS, BLDG. 47

APPENDIX E

Asbestos & Lead Based Paint Material Survey Report, Bldg 47

Suspect Asbestos and Lead-Containing Materials Survey Nellis Air Force Base Renovation for Building 47 North Las Vegas, Nevada

KAL Architects

2150 River Plaza Drive, Suite 380 | Sacramento, California 95833

January 5, 2024 | Project No. 304931004



Geotechnical | Environmental | Construction Inspection & Testing | Forensic Engineering & Expert Witness

Geophysics | Engineering Geology | Laboratory Testing | Industrial Hygiene | Occupational Safety | Air Quality | GIS

Ninyo & Moore
Geotechnical & Environmental Sciences Consultants

Suspect Asbestos and
Lead-Containing Materials Survey
Nellis Air Force Base,
Renovation for Building 47
North Las Vegas, Nevada

Mr. Kevin Wong, PE

Kal Architects

2150 River Plaza Drive, Suite 380 | Sacramento, California 95833

January 5, 2024 | Project No. 304931004

A handwritten signature in blue ink that reads "Crystal Castellanos".

Crystal Castellanos, GIT
Staff Geologist

CAC/WPL/cas

A handwritten signature in blue ink that reads "William P. Larkin".

William P. Larkin
Principal Scientist

CONTENTS

1	INTRODUCTION	1
2	PURPOSE AND SCOPE OF SERVICES	1
3	SITE BUILDING DESCRIPTIONS	1
4	FIELD LIMITATIONS	2
5	SAMPLE COLLECTION AND ANALYSES	2
5.1	Asbestos Survey	2
5.2	Lead-Containing Materials Survey	3
6	SURVEY RESULTS	3
6.1	Asbestos Results Summary	3
6.2	Lead-Containing Surfaces Summary	3
7	RECOMMENDATIONS	3
7.1	Asbestos	3
7.2	Lead	4
8	LIMITATIONS	4
9	ENVIRONMENTAL PROFESSIONAL STATEMENT	6
10	REFERENCES	7

FIGURES

- 1 – Site Location
- 2 – Site and Vicinity Detail
- 3 – Sample Locations

APPENDICES

- A – Resumes
- B – Lab Analytical Reports and Chain-of-Custody Records

1 INTRODUCTION

Ninyo & Moore has performed suspect asbestos-containing materials (ACMs) and lead-containing surfaces (LCSs) surveys in support of upcoming renovation activities at Building 47 located within Nellis Air Force Base in North Las Vegas, Nevada (Site). This report has been prepared in accordance with generally-accepted environmental science and engineering practices. This report is based on conditions at the Site at the time of the sampling activities and provides documentation of our findings and recommendations.

2 PURPOSE AND SCOPE OF SERVICES

The objective of the survey is to provide recommendations based on the materials encountered at the time of this survey and regarding the potential presence of ACMs and LCSs within the site building, which may require removal prior to the planned renovation activities. For the purposes of this assessment, LCS refers to lead-based paint (LBP), as defined by the United States Department of Housing and Urban Development (HUD).

The scope of services performed by Ninyo & Moore for the study is identified below.

- Performed a visual reconnaissance of the site building to evaluate for the possible presence of ACMs and LCSs.
- Collected bulk samples of suspect asbestos-containing building materials for submittal to an independent laboratory for analysis of asbestos content via United States Environmental Protection Agency (EPA) Test Method 600.
- Collected bulk samples of suspect LBP for submittal to an independent laboratory for analysis of lead content via EPA SW-846 Test Method 7000B: Flame Atomic Absorption Spectrophotometry,
- Prepared this summary report, which presents our data and summarizes field activities.

3 SITE BUILDING DESCRIPTIONS

At the time of the site reconnaissance, the site consists of Building 47, a 6,900-square foot office at Nellis Air Force Base in North Las Vegas, Nevada. Construction of the building includes concrete floors, CMU exterior walls, gypsum sheetrock interior walls and ceilings, 2' x 2' acoustical ceiling tiles, vinyl floor tile and carpet. Access to the building is via exterior entrance on the south side. Consistent colored paints were noted covering interior walls and doors of the building. Vinyl floor tiles were observed in the offices and common areas.

4 FIELD LIMITATIONS

Underground utilities, such as suspect cementitious water lines or suspect insulated/coated gas or electrical lines were not assessed during the survey activities. If additional suspect materials and/or surfaces are encountered during the site building renovations that have not been assessed, they should be assumed to be asbestos-containing and/or lead-containing and handled accordingly, or they should be sampled and analyzed to assess whether they are asbestos-containing and/or lead-containing. Access was limited to common areas and vacant units within the building.

5 SAMPLE COLLECTION AND ANALYSES

On December 18, 2023, the various areas of the site building anticipated to be undergoing renovation were assessed by Crystal Castellanos under the supervision of William Larkin for the presence of ACMs and LCSs. The ACM and LCS assessments followed United States Environmental Protection Agency (EPA) guidelines, or industry standards, within the limitations of the scope of this assessment. Consultant certificates are presented in Appendix A. Survey activities are discussed below.

5.1 Asbestos Survey

Representative samples of suspect ACMs were collected after identification of homogeneous sampling areas (areas in which the materials are consistent in color, texture, construction or application date, and general appearance). Several homogenous areas were observed for material type, location, condition, and friability. Representative samples were collected from the accessible homogenous areas without causing significant or structural damage to building materials. Samples were collected using EPA-recommended sampling procedures.

Building materials suspected to contain asbestos included suspended acoustical ceiling tiles, walls, wall cove and mastic. A total of 15 bulk samples were collected and submitted for analysis.

The suspect ACM samples were analyzed by EMSL Analytical, Inc. (EMSL), which is accredited by the National Voluntary Laboratory Accreditation Program (NVLAP), for the presence and quantification of asbestos fibers using polarized light microscopy with dispersion staining (PLM/ds), in accordance with EPA Method 600/R-93/116. The lower limit of reliable detection for asbestos using the PLM method is approximately 1 percent by volume. Currently, the EPA and the State of Nevada stipulate that materials containing more than 1 percent asbestos constitute an ACM. Materials that are free of asbestos are defined as: “ND” (for “None Detected”) in the laboratory analytical reports and chain-of-custody records (Appendix B).

5.2 Lead-Containing Materials Survey

Suspect LCS samples were submitted to EMSL for analysis of lead content. EMSL is accredited through the National Voluntary Laboratory Accreditation Program (NVLAP). The lead content of the suspect samples is accomplished using flame atomic absorption, in accordance with EPA Method SW 846-7000B. The EPA stipulates that paint containing an amount equal to or in excess of 1 milligram per square centimeter ($\geq 1.0 \text{ mg/cm}^2$), or more than half of one percent (0.5%) by weight (or 5,000 milligrams per kilogram [mg/kg]) of lead, constitute a lead-based paint (LBP). Coatings with any detectable amount of reported lead would be considered lead-containing paint (LCP).

The surfaces of four accessible components were sampled, including exterior and interior walls and submitted for analysis.

6 SURVEY RESULTS

The following sections describe the survey results.

6.1 Asbestos Results Summary

Based on field observations and a review of the reported analytical results, none of the samples collected were reported to have detectable quantities of asbestos. A copy of the laboratory analytical report and chain-of-custody record for suspect ACMs is presented in Appendix B.

6.2 Lead-Containing Surfaces Summary

A total of four surfaces were sampled and tested for lead content. Three of the four samples collected were reported with lead concentrations at less than their associated limits of detection. One of the four samples was reported with a lead concentration of 0.0083% by weight. Occupational Health and Safety Administration (OSHA) regulations apply whenever materials with any detectable amounts of lead are disturbed. A copy of the laboratory analytical report and chain-of-custody records are presented in Appendix B.

7 RECOMMENDATIONS

7.1 Asbestos

Since no ACMs were identified, no further asbestos sampling or monitoring is considered necessary.

- If any suspect ACMs not analyzed and described within this survey are observed to be present during renovation activities, the material should be sampled and analyzed for asbestos content in order to determine the appropriate handling and disposal requirements.
- Alternatively, any building materials not analyzed for this survey and encountered during demolition activities may be presumed to contain asbestos. These materials must then be treated, handled, and disposed of accordingly.

7.2 Lead

One sample of LCP was reported. The following recommendations and precautions are provided:

- The identified LCP reported within the site building should not be disturbed. Any LCP found in a damaged or non-intact condition should be abated and/or stabilized. Prior to renovation or demolition work that would disturb the identified LCP a licensed lead abatement removal contractor should stabilize and/or remove the identified LCP in compliance with the most recent applicable federal, state, and local laws, regulations, standards, and/or codes governing abatement, transport, and disposal of LCP. All lead waste must be properly characterized prior to disposal to determine waste classification, packaging, transportation, and disposal requirements.
- There is a possibility that other suspect hazardous building materials may be discovered during renovation activities. Ninyo & Moore recommends that, should additional suspect materials not sampled or assessed in this report be uncovered during renovation activities, (a) samples of suspect materials should be collected for laboratory analysis and activities that may impact the materials should cease until laboratory analytical results are reviewed or (b) the materials should be assumed to be hazardous and handled as such.

8 LIMITATIONS

Ninyo & Moore's opinions and recommendations regarding environmental conditions, as presented in this report, are based on limited sampling and chemical analysis. Further assessment of potential adverse environmental impacts may be accomplished by a more comprehensive assessment. It is believed that the samples gathered for testing and the resulting observations are a fair representation of the evaluated area(s). However, if additional suspect ACMs or LCSs are encountered during demolition activities, these materials should be sampled by qualified personnel, and analyzed for content prior to further disturbance. These numbers should be confirmed prior to removal or repair activities.

The environmental services described in this report have been conducted in general accordance with current regulatory guidelines and the standard-of-care exercised by environmental consultants performing similar work in the project area. No warranty, expressed or implied, is made regarding the professional opinions presented in this report. Variations in site conditions may exist and conditions not observed or described in this report may be encountered during subsequent activities.

This document is intended to be used only in its entirety. No portion of the document, by itself, is designed to completely represent any aspect of the project described herein. Ninyo & Moore should be contacted if the reader requires any additional information, or has questions regarding content, interpretations presented, or completeness of this document.

The environmental interpretations and opinions contained in this report are based on the results of laboratory tests and field analyses intended to detect the presence and concentration of specific chemical or physical constituents in samples collected from the subject site. The testing and analyses for ACM and LCS/LBP has been conducted by an independent laboratory which is certified by the State of Nevada to conduct such tests.

Our conclusions, recommendations, and opinions are based on an analysis of the observed site conditions. It should be understood that the conditions of a site can change with time as a result of natural processes or the activities of man at the subject site or nearby sites. In addition, changes to the applicable laws, regulations, codes, and standards of practice may occur due to government action or the broadening of knowledge. The findings of this report may, therefore, be invalidated over time, in part or in whole, by changes over which Ninyo & Moore has no control.

9 ENVIRONMENTAL PROFESSIONAL STATEMENT


Pursuant to NAC 459.97285: *I hereby certify that I am responsible for the services described in this document and for the preparation of this document. The services described in this document have been provided in a manner consistent with the current standards of the profession and to the best of my knowledge comply with all applicable federal, state and local statutes, regulations and ordinances.*



Crystal Castellanos
Staff Geologist, Building Inspector # CA-089-05

January 5, 2024

Date

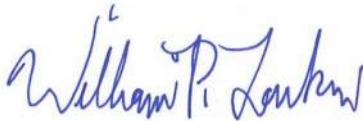

William Larkin,
Principal Environmental Scientist, CAC

January 5, 2024


Date

10 REFERENCES

- Asbestos Hazard Emergency Response Act (AHERA), federal HUD “Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing, 2012
- Asbestos Standard for the Construction Industry, OSHA 3096, 2002
- United States Environmental Protection Agency; The Asbestos Hazard Emergency Response Act (AHERA) Model Accreditation Program (MAP), 2015
- United States Environmental Protection Agency, Asbestos in Buildings: Simplified Sampling Scheme for Friable Surfacing Materials, 2015



FIGURES

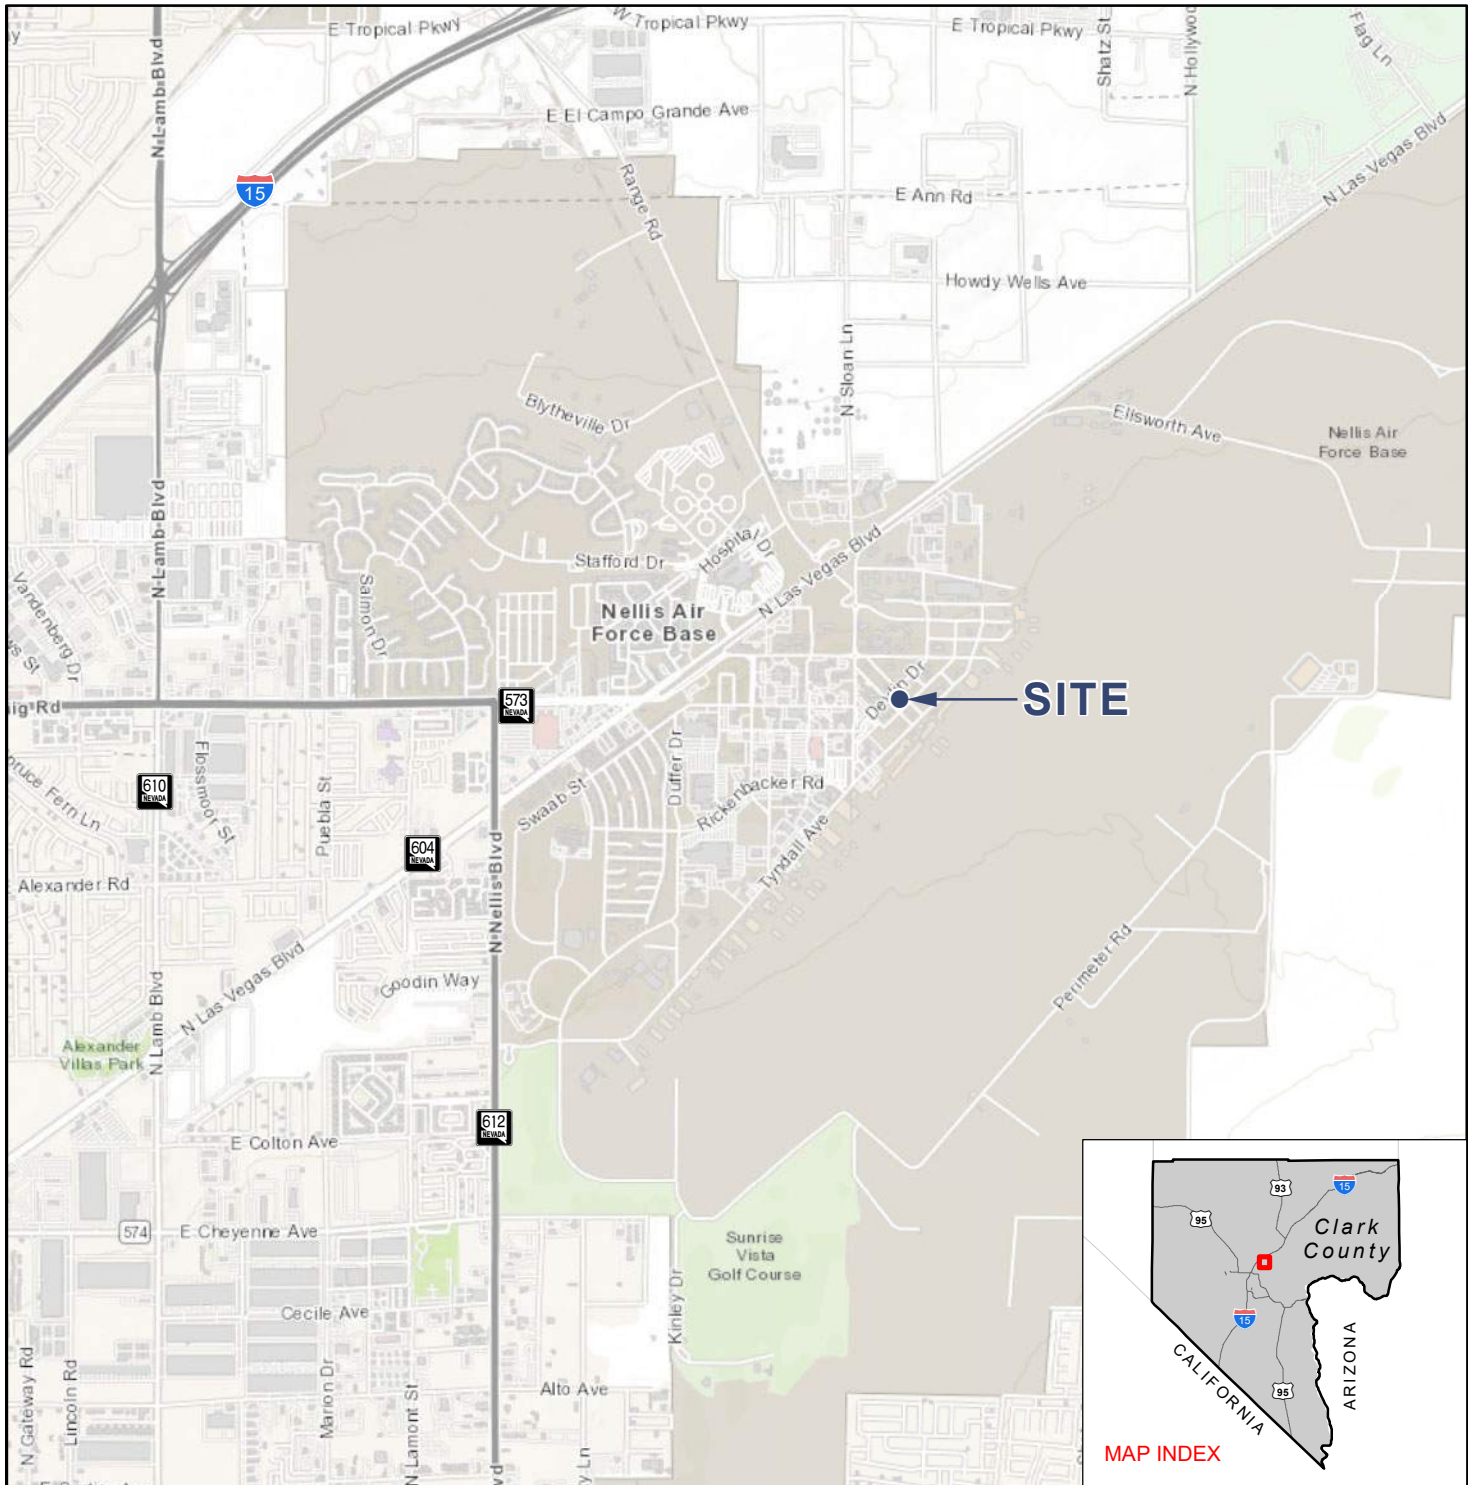

1_304931004_SL.mxd 1/4/2024 JDL

NOTE: DIRECTIONS, DIMENSIONS AND LOCATIONS ARE APPROXIMATE. | SOURCE: ESRI WORLD TOPO, 2024





FIGURE 1

SITE LOCATION

RENOVATION OF NELLIS AFB BUILDING 47 ACM LCP SURVEY
NELLIS AIRFORCE BASE, NORTH LAS VEGAS, NEVADA

304931004 | 1/24

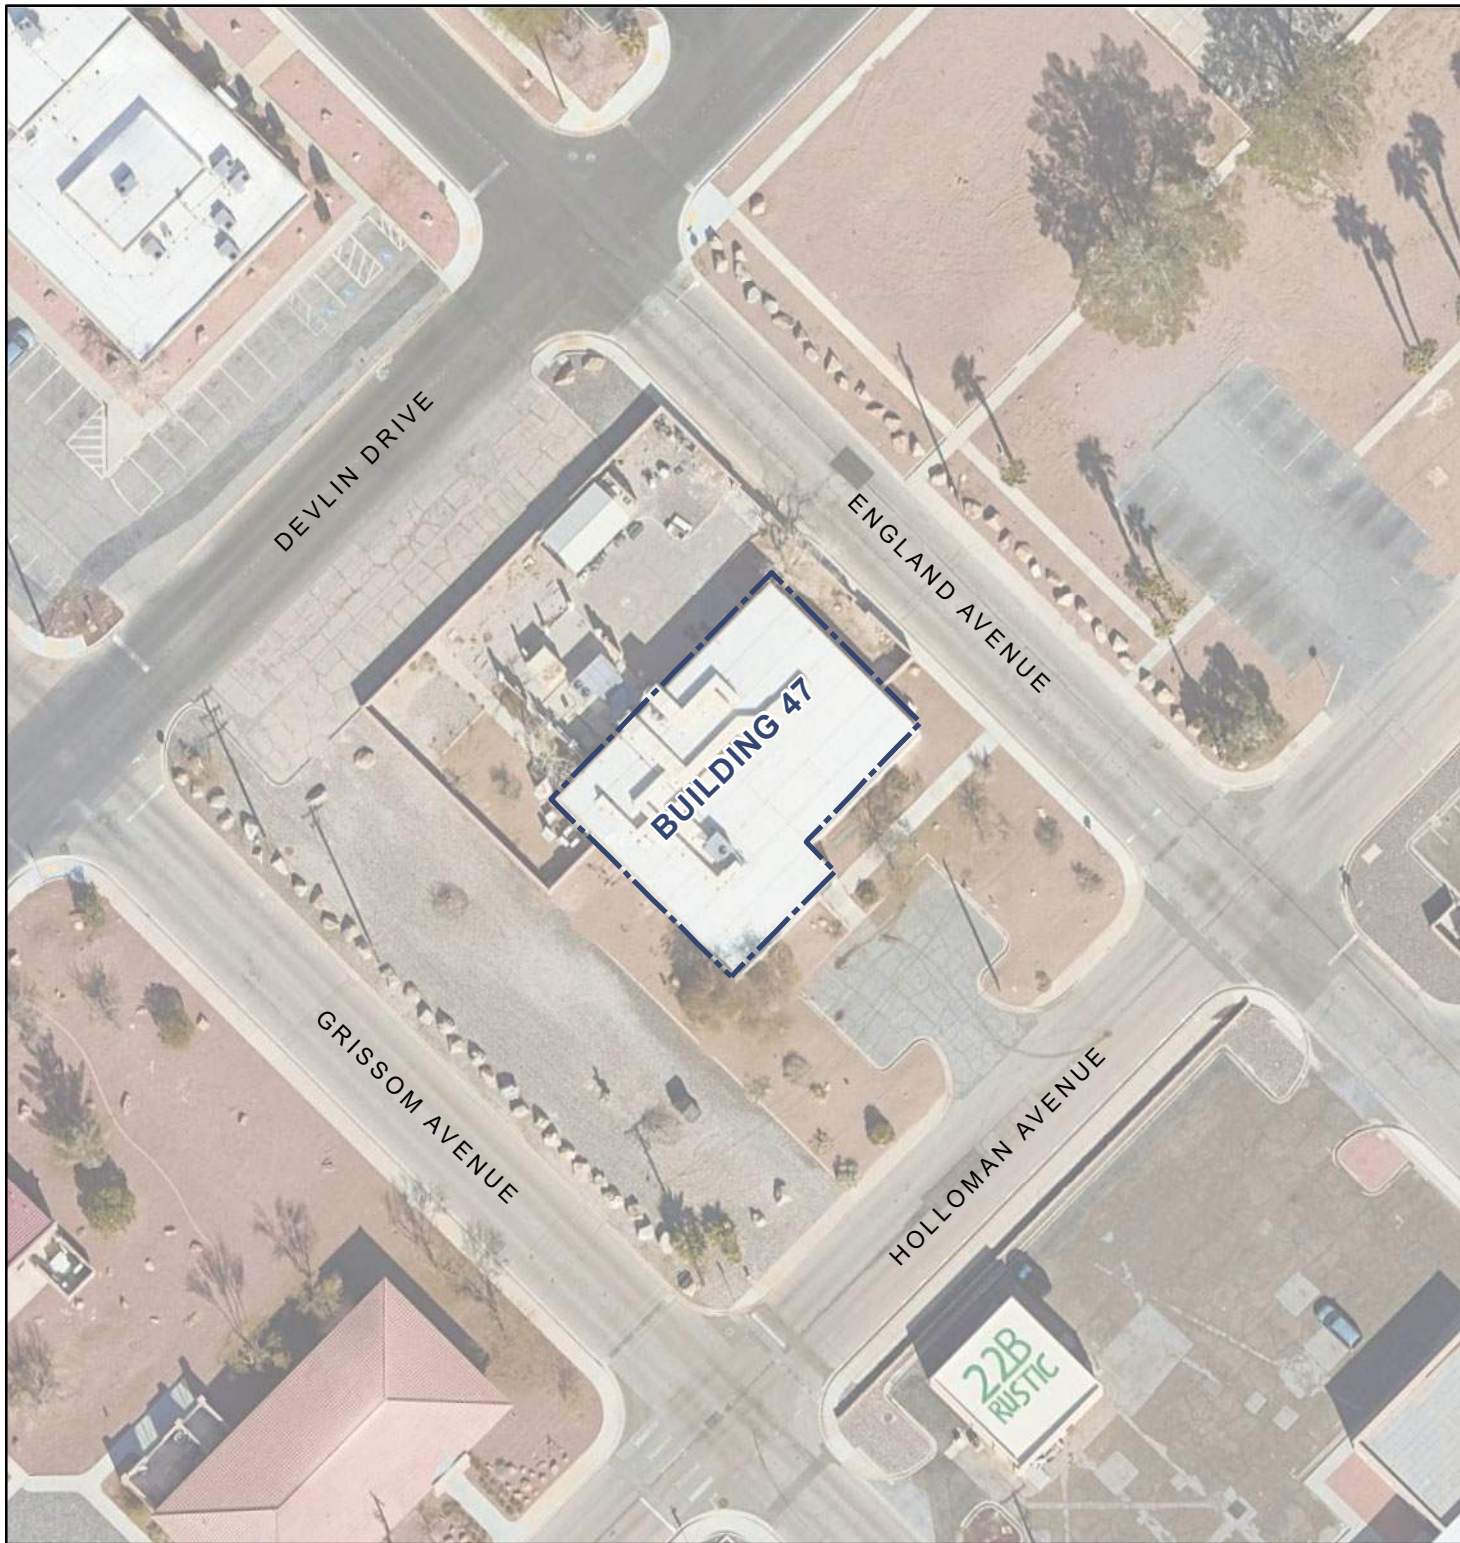

LEGEND _____

--- SITE BOUNDARY

NOTE: DIRECTIONS, DIMENSIONS AND LOCATIONS ARE APPROXIMATE. | SOURCE: GOOGLE EARTH, 2024




FIGURE 2

3_304931004_SMP.mxd 1/4/2024 JDL




FIGURE 3



APPENDIX A

Resumes

WILLIAM P. LARKIN, CAC, DPH LEAD PRINCIPAL ENVIRONMENTAL SCIENTIST

EDUCATION

M.P.A., Golden Gate University, 1994,
San Francisco, California

B.A., Political Science and European
History, 1984, University of California,
Davis

REGISTRATIONS

Certified Asbestos Consultant 99-2688,
California DOSH

ASHERA Accredited Contractor/Supervisor,
Asbestos Inspector, Project Designer and
Management Planner

Certified Lead Inspector/Risk Assessor
and Project Monitor, California DPH 5543

Sampling and Evaluating Airborne
Asbestos Dust Certification, NIOSH 582
OSHA 40-Hour Health & Safety Training
(with annual updates)

EXPERIENCE HIGHLIGHTS

Mineta International Airport, San Jose
San Francisco Redevelopment Agency

The Presidio Trust, San Francisco
Capital Area East End, Sacramento,
California

City of Novato

City of Brentwood

U.S. Mint, San Francisco

Marin Community College District
Measure C On-Call Contract

College of San Mateo

As Principal Environmental Scientist, Mr. Larkin has experience in all aspects of asbestos and lead-based paint surveys, mold/microbiological/moisture mapping and smoke damage assessments, overall hazardous building materials surveys and construction management programs as well as environmental planning programs including transportation and city planning projects. He has participated in multi-family asbestos and lead-based paint surveys in both occupied and unoccupied buildings, aided in asbestos project design and provided project management and construction monitoring in commercial, industrial, residential, and laboratory facilities. Mr. Larkin has conducted numerous environmental due diligence assessments and compliance reviews of retail, industrial, and commercial properties. He has conducted numerous biological/mold assessments for private and public clients. Mr. Larkin has also conducted numerous Hazardous Building Material Surveys (HBMS) and mold/microbial assessments throughout the San Francisco Bay Area and northern California for private and public clients.

REPRESENTATIVE PROJECT EXPERIENCE

Various Mold/Microbial/Moisture Mapping and Smoke Damage Assessments and Air Monitoring: Mr. Larkin has provided mold/microbial and/or smoke damage assessments during the fires in Napa and Sonoma counties for clients in those counties as well as Alameda and Lake counties. Mold microbial assessments included site observation, ambient air and clearance air microbial sampling, moisture measurements/mapping, and/or collection of direct bulk/tape-lift samples. He has also conducted numerous mold/microbial assessments throughout the San Francisco Bay Area and northern California over the last decade.

The Presidio Trust, San Francisco, California: Project Manager for hazardous materials administration/oversight projects at the Presidio of San Francisco; including 7 residences along Wyman Avenue and Building 50 along Moraga Avenue. Mr. Larkin worked closely with the general and abatement contractors and Presidio administration/environmental staff during the implementation of Hazardous Building Materials Surveys (HBMSs) and abatement oversight activities during each of these projects. Ninyo & Moore provided overall hazardous materials administration activities during each of these projects; from initial hazardous materials investigation activities, to abatement specification development, to abatement oversight, and finally to the development of close-out reports/documentation (including hazardous waste removal and documentation). Each project was delayed by weather issues (rain, etc.) that compressed the overall project schedule.

San Francisco Redevelopment Agency (SFRA) Hazardous Materials Abatement Monitoring: Provided hazardous materials abatement monitoring and abatement contractor oversight services to the SFRA at the former Hunter's Point shipyard during exterior lead-based paint stabilization and asbestos abatement activities. Polychlorinated biphenyls (PCBs) spills due to leaking/failed fluorescent light ballasts were discovered in several rooms during this project and successfully remediated.

VA Medical Center, Building 203 Seismic Retrofit, Asbestos Abatement Design Services, San Francisco, California: Project Environmental Scientist providing asbestos abatement design services related to seismic retrofit activities at Building 203 of the VA Medical Center in San Francisco, California. Mr. Larkin reviewed VA master contract specifications and performed bulk suspect building material sampling. His responsibilities included interaction with VA staff and project managers and report/specification writing.

Ninyo & Moore

Experience | Quality | Commitment

REPRESENTATIVE PROJECT EXPERIENCE (continued)

Mold/Microbial Observations and Air Sampling, Larkspur Courts Apartments, Larkspur, California: Mr. Larkin performed mold/microbial investigations during the exterior/interior renovations of 26 apartment buildings at the Larkspur Apartments in Larkspur, California. Duties included air sampling, bulk/tape-lift sampling, observations of affected materials and apartments and development of interim and final clearance reports.

City of Brentwood, Hazardous Building Material Surveys, Brentwood, California: As a Senior Project Environmental Scientist, Mr. Larkin performed and managed Hazardous Building Materials Surveys (HBMSs) at the City of Brentwood Community Development offices, the Community Center, and the City Library in anticipation of planned demolition/renovation activities of these structures. Non-destructive sampling techniques were employed to reduce the amount of damage to the occupied buildings, and to cause the least amount of disruption to the work environment as possible. Mr. Larkin also conducted abatement contractor oversight and air monitoring activities when the abatement of the identified asbestos-containing materials.

Former City Hall Buildings Hazardous Building Materials Surveys, Novato, California: Performed and managed hazardous building materials surveys at four buildings at the site of the former City of Novato City Hall. Hazardous materials abatement specifications/work plans were also developed as part of this project. This project included destructive bulk asbestos and paint chip sampling, quantification of miscellaneous hazardous building materials (potential PCB-containing light ballasts, etc.), development of recommendations within DSA approved guidelines, and heavy client interaction/interface. This project provided the City of Novato with valuable information which was used during the demolition/renovation activities of the project buildings. Ninyo & Moore oversaw the abatement of hazardous materials on this project.

Trinity County Public Works Agency, Bucktail, Salt Flat, Poker Bar, and Treadwell Bridges, Trinity County, California: Project Environmental Scientist for a hazardous materials survey (HBMS) at four Trinity River bridges. Mr. Larkin performed an evaluation of hazardous materials for the existing bridge structures and surrounding vicinity including: an initial site assessment and research; preparation of a sampling protocol for each type or class of material potentially occurring at each site; sample collection and laboratory analysis of samples; and chain-of-custody procedures for the handling of all samples.

Northern California Youth Correctional Center, Stockton, California: Performed a pre-renovation asbestos-containing material (ACM) survey and coordinated an x-ray fluorescence (XRF) lead-based paint survey for an approximately 11,000 square foot health clinic scheduled for renovation/modernization at the Northern California Youth Correctional Center in Stockton, California. This project also included the promulgation of asbestos and lead abatement specifications. All deliverables (survey reports, analytical results, and abatement specifications) were provided on time, within budget, and in standard format per Division of the State Architect (DSA) guidelines.

Marin Community College District Measure C Capital Improvement On-Call Contract: Project Manager for a seven-year on-call contract leading a team of Industrial Hygienists and Environmental Assessors to provide environmental services to develop facilities conditions assessments and HBMSs. Projects included major new construction and modernization projects for all District premises on three campuses. Services include gathering and assessing existing data; determining additional investigation requirements; performing HBMSs and evaluations, including Phase I site assessments and Phase II subsurface investigations; providing CEQA supporting documents and risk management; updating existing hazmat reports; providing recommendations in DSA approved format; and providing abatement contractor oversight and abatement monitoring.

Mineta International Airport, Hazardous Building Materials Surveys, San Jose, California: Performed and managed hazardous building materials surveys services related to the proposed demolitions and renovations at Terminals A and C. He reviewed previous sampling information/analytical results, conducted non-destructive asbestos and paint chip surveys, and miscellaneous hazardous building material quantifications. Of particular importance to this project is the scheduling of activities so as not to compromise airline staff/ticketing/ramp operations and/or airport security operations. Ninyo & Moore personnel have undergone extensive security checks and have conducted night work activities in order to complete the project tasks for the client. Ninyo & Moore oversaw and monitored the abatement of hazardous materials on this project.

College of San Mateo HBMSs, San Mateo California: Project Manager directing hazardous building materials surveys of buildings at three of the College of San Mateo campuses. His main duties included asbestos and paint chip surveys, asbestos abatement specification development, providing recommendations within DSA approved guidelines, heavy client interaction/interface, and management/participation in asbestos abatement monitoring/contractor observation.

mm
STATE OF NEVADA
DEPARTMENT OF BUSINESS AND INDUSTRY
DIVISION OF INDUSTRIAL RELATIONS
Occupational Safety and Health Administration
Asbestos Control Program

Certifies That William Larkin
Ninyo & Moore
is Licensed As Asbestos Abatement Consultant

License No. IJPM-936

Expiration Date 10/05/2023

Signature Of Licensee

William P. Larkin

Crystal A. Castellanos, GIT

Staff Geologist



EDUCATION

B.S., Geology, 2011, California State University, Fullerton

REGISTRATIONS/CERTIFICATIONS

Geologist-in-Training, No. 837 (California)

As a Staff Geologist, Ms. Castellanos provides field services for projects; provides input for technical reports; work with subs onsite (drillers, etc) during field services; and assists Project Managers and Senior Staff personnel with tasks. She has broad site investigation experience from work planning through review of historical documentation, field sampling (soil, groundwater, soil vapor, etc.), and report preparation with extensive environmental experience, completing over 500 Environmental Site Assessments (Phase I ESAs, and Phase II ESAs) throughout her career.

EXPERIENCE

Southern California Edison, McGen Substation, Trona, California: Prepared the workplan for a limited drilling and sampling effort at this site, to establish if onsite or/and offsite migration of the contaminants of concern had occurred or onsite operations had impacted the subject property. Managed a drilling subcontractor onsite and oversaw collection of the required samples. Responsibilities included soil logging of fifty, soil borings from a direct push rig, ordering field supplies, air monitoring, and providing numerous updates to project management daily. The project was safely completed on time and within budget. Southern California Edison determined that no further action was required after receiving the results.

Golden State Water Company, Pomello Well No. 5, La Verne, California: This project involved a municipality who wanted a new water supply well to replace a previous well onsite that no longer produced. Part of the scope of work included assisting on well siting and well design for the new water supply well. The project utilized direct circulation mud rotary drilling, sampling, and geophysical analysis, for well design and construction. Led a team of field staff and subcontractors over a period of three months to complete the investigation. In addition, provided support to develop a plan for how many gallons a minute the well may produce and aquifer test reporting. The new water supply well produces 500 gallons a minute. The assessment concluded that another water supply well would need to be constructed downgradient in order to produce for the local demand. The project was safely completed on time and within budget.

CalRecycle, Carr Fire, Redding, California: This project included the assessment of potential heavy metal and asbestos containing materials impact within the debris remaining from the Carr Wildfire incident that occurred in Shasta County, California. Assessments were conducted within the single-family resident's footprint. Assisted on teams of consultants for asbestos, air monitoring site assessments of hazardous waste and potential impact to soils. Approximately 1,600 structures were damaged, and consulted on more than 330 properties across three cities that were impacted. The project was safely completed ahead of schedule.

Phase I ESAs, Otay Ranch, Chula Vista, California: This project included environmental site assessments of former agricultural land to be converted into residential subdivisions. The ESA's required the review of historical documentation, regulatory records review of unauthorized releases, and conducting site visits for the completion of the investigations. The project was safely completed on time and within budget.

THE ASBESTOS INSTITUTE

Certifies that

Crystal Castellanos

has attended and received instruction in the EPA approved course

AHERA Building Inspector Initial

Approval Code: CA-089-05

on

July 18-20 2023

and successfully completed and passed the competency exam.

Certificate:


4380-16347-072023

Date of Examination:

20-Jul-2023

Date of Expiration:

20-Jul-2024



William T. Cavness
Director



Approved Instructor

THE ASBESTOS INSTITUTE

20033 N. 19th Ave, Building 6, Phoenix, AZ 85027

602-864-6564 – www.theasbestosinstitute.com

The person receiving this certificate has completed the requisite training for asbestos accreditation under TSCA Title II.



APPENDIX B

Lab Analytical Reports and Chain-of-Custody Records



EMSL Analytical, Inc.

12 Sunset Way, Suite 202B Henderson, NV 89014

Tel/Fax: (702) 931-3532 / (702) 931-3533

<http://www.EMSL.com / lasvegaslab@EMSL.com>

EMSL Order: 312303090

Customer ID: NINY63

Customer PO:

Project ID:

Attention: Court Brooks
Ninyo & Moore
6700 Paradise Road
Suite E
Las Vegas, NV 89119

Project: Nellis AFB Building 47

Phone: (702) 433-0330

Fax: (702) 433-0707

Received Date: 12/18/2023 2:30 PM

Analysis Date: 12/19/2023

Collected Date: 12/18/2023

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos % Type
			% Fibrous	% Non-Fibrous	
B47-1-Drywall 312303090-0001	Rm 3 - Drywall with Paint, Blue	White Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-1-Texture 312303090-0001A	Rm 3 - Drywall with Paint, Blue	White Non-Fibrous Homogeneous		30% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-1-Paint 312303090-0001B	Rm 3 - Drywall with Paint, Blue	Blue Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected
B47-3-Cove Base 312303090-0002	Room 6 - Wall Cove with Mastic	Black Non-Fibrous Homogeneous		60% Matrix 40% Non-fibrous (Other)	None Detected
B47-3-Mastic 312303090-0002A	Room 6 - Wall Cove with Mastic	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected
B47-4-Drywall 312303090-0003	Room 8 - Drywall with Paint, Blue	White Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-4-Texture 312303090-0003A	Room 8 - Drywall with Paint, Blue	White Non-Fibrous Homogeneous		30% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-4-Tape 312303090-0003B	Room 8 - Drywall with Paint, Blue	Yellow Fibrous Homogeneous	90% Glass	10% Non-fibrous (Other)	None Detected
B47-4-Paint 312303090-0003C	Room 8 - Drywall with Paint, Blue	Blue Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected
B47-6-Ceramic Tile 312303090-0004	Women's Restroom - Ceramic Tile with Mastic	Red Non-Fibrous Homogeneous		40% Quartz 60% Non-fibrous (Other)	None Detected
B47-6-Grout 312303090-0004A	Women's Restroom - Ceramic Tile with Mastic	White Non-Fibrous Homogeneous		40% Quartz 60% Non-fibrous (Other)	None Detected
B47-6-Mortar 312303090-0004B	Women's Restroom - Ceramic Tile with Mastic	Gray Non-Fibrous Homogeneous		40% Quartz 60% Non-fibrous (Other)	None Detected
B47-6-Mastic 312303090-0004C	Women's Restroom - Ceramic Tile with Mastic	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected
B47-7-Drywall 312303090-0005	Women's Restroom - Drywall with Paint, Tan				Layer Not Present
B47-7-Texture 312303090-0005A	Women's Restroom - Drywall with Paint, Tan	White Non-Fibrous Homogeneous		30% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-7-Paint 312303090-0005B	Women's Restroom - Drywall with Paint, Tan	Tan Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected

Initial report from: 12/20/2023 19:12:42



EMSL Analytical, Inc.

12 Sunset Way, Suite 202B Henderson, NV 89014

Tel/Fax: (702) 931-3532 / (702) 931-3533

<http://www.EMSL.com> / lasvegaslab@EMSL.com

EMSL Order: 312303090

Customer ID: NINY63

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via AHERA Method 40CFR 763 Subpart E Appendix E supplemented with EPA 600/R-93/116 using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
B47-10-Drywall 312303090-0006	Room 11 - Drywall with Paint, Blue	White Fibrous Homogeneous	10% Cellulose	20% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-10-Texture 312303090-0006A	Room 11 - Drywall with Paint, Blue	White Non-Fibrous Homogeneous		30% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-10-Tape 312303090-0006B	Room 11 - Drywall with Paint, Blue	Yellow Fibrous Homogeneous	45% Synthetic 45% Glass	10% Non-fibrous (Other)	None Detected
B47-10-Paint 312303090-0006C	Room 11 - Drywall with Paint, Blue	Tan Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected
B47-12-Cove Base 312303090-0007	Room 11 - Wall Cove with Mastic	Black Non-Fibrous Homogeneous		60% Matrix 40% Non-fibrous (Other)	None Detected
B47-12-Mastic 312303090-0007A	Room 11 - Wall Cove with Mastic	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected
B47-13-Carpet 312303090-0008	Mech. Room - Carpet with Mastic	Blue Fibrous Homogeneous	80% Synthetic	20% Non-fibrous (Other)	None Detected
B47-13-Mastic 312303090-0008A	Mech. Room - Carpet with Mastic	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected
B47-14-Styrofoam 312303090-0009 <i>Drywall not present. Layer appears to be styrofoam.</i>	Exterior Building, West Side - Drywall w/ Paint, Tan	White Non-Fibrous Homogeneous		30% Matrix 70% Non-fibrous (Other)	None Detected
B47-14-Texture 312303090-0009A	Exterior Building, West Side - Drywall w/ Paint, Tan	White Non-Fibrous Homogeneous		30% Ca Carbonate 70% Non-fibrous (Other)	None Detected
B47-14-Tape 312303090-0009B	Exterior Building, West Side - Drywall w/ Paint, Tan	White Fibrous Homogeneous	90% Glass	10% Non-fibrous (Other)	None Detected
B47-14-Paint 312303090-0009C	Exterior Building, West Side - Drywall w/ Paint, Tan	Tan Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected
B47-15-Vinyl 312303090-0010	Exterior Building, Roof - Vinyl Roof Roll	White/Black Non-Fibrous Homogeneous		40% Matrix 60% Non-fibrous (Other)	None Detected
B47-15-Mastic 312303090-0010A	Exterior Building, Roof - Vinyl Roof Roll	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected
B47-15-Backing 312303090-0010B	Exterior Building, Roof - Vinyl Roof Roll	Green Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
B47-16-Ceramic Tile 312303090-0011	Entrance - Ceramic Tile with Mastic	Gray Non-Fibrous Homogeneous		40% Quartz 60% Non-fibrous (Other)	None Detected
B47-16-Grout 312303090-0011A	Entrance - Ceramic Tile with Mastic	White Non-Fibrous Homogeneous		40% Quartz 60% Non-fibrous (Other)	None Detected
B47-16-Mastic 312303090-0011B	Entrance - Ceramic Tile with Mastic	Yellow Non-Fibrous Homogeneous		80% Matrix 20% Non-fibrous (Other)	None Detected

Initial report from: 12/20/2023 19:12:42



EMSL Analytical, Inc.

12 Sunset Way, Suite 202B Henderson, NV 89014

Tel/Fax: (702) 931-3532 / (702) 931-3533

<http://www.EMSL.com> / lasvegaslab@EMSL.com

EMSL Order: 312303090

Customer ID: NINY63

Customer PO:

Project ID:

Analyst(s)

Elijah Mayorga (33)

Shannon Ferguson, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method") but augmented with procedures outlined in the 1993 ("final") version of the method. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Henderson, NV NVLAP Lab Code 600140-0, AZ 0953, NV 050132018-1

Initial report from: 12/20/2023 19:12:42



EMSL Analytical, Inc

464 McCormick Street, San Leandro, CA 94577

Phone/Fax: (510) 895-3675 / (510) 895-3680

<http://www.EMSL.com>

sanleandrolab@emsl.com

EMSL Order: 092327166

CustomerID: NINY63

CustomerPO:

ProjectID:

Attn: **Court Brooks
Ninyo & Moore
6700 Paradise Road
Suite E
Las Vegas, NV 89119**

Phone: (702) 433-0330
Fax: (702) 433-0707
Received: 12/19/2023 09:15 AM
Collected: 12/18/2023

Project: **NELLIS AFB BUILDING 47**

Test Report: Lead in Paint Chips by Flame AAS (SW 846 3050B/7000B)*

Client Sample Description	Lab ID	Collected	Analyzed	Weight	Lead Concentration
B47-2P	092327166-0001	12/18/2023	12/19/2023	0.2516 g	0.0083 % wt
	Site: PAINT CHIP WHITE				
B47-5P	092327166-0002	12/18/2023	12/19/2023	0.2547 g	<0.0080 % wt
	Site: PAINT CHIP BLUE				
B47-9P	092327166-0003	12/18/2023	12/19/2023	0.2526 g	<0.0080 % wt
	Site: PAINT CHIP TAN				
B47-11P	092327166-0004	12/18/2023	12/19/2023	0.2501 g	<0.0080 % wt
	Site: PAINT CHIP BLUE				

Cecilia Yu, Laboratory Manager
or other approved signatory

EMSL maintains liability limited to cost of analysis. Interpretation and use of test results are the responsibility of the client. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. The report reflects the samples as received. Results are generated from the field sampling data (sampling volumes and areas, locations, etc.) provided by the client on the Chain of Custody. Samples are within quality control criteria and met method specifications unless otherwise noted.

* Analysis following Lead in Paint by EMSL SOP/Determination of Environmental Lead by FLAA. Reporting limit is 0.008% wt based on the minimum sample weight per our SOP. "<" (less than) result signifies the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc San Leandro, CA AIHA LAP, LLC-ELLAP Accredited #101748

Initial report from 12/19/2023 14:14:16



EMSL ANALYTICAL, INC.
LABORATORY PRODUCTS TRAINING

Asbestos Bulk Building Materials - Chain of Custody

EMSL Order Number / Lab Use Only

#312303090

EMSL Analytical, Inc.

6325 Harrison Drive
Suite 3

Las Vegas, NV 89120

PHONE: (702) 931-3532

EMAIL: lasvegaslab@emsl.com

Customer Information	Customer ID:			Billing ID:																																														
	Company Name: Ninyo & Moore			Company Name: Ninyo & Moore																																														
	Contact Name: Court Brooks			Billing Contact: Court Brooks																																														
	Street Address: 6700 Paradise Road Suite E			Street Address: 6700 Paradise Road Suite E																																														
	City, State, Zip: Las Vegas NV 89115 Country: US			City, State, Zip: Las Vegas NV Country: US																																														
Phone: 17024284912			Phone: 17024284912																																															
Email(s) for Report: cbrooks@ninyoandmoore.com			Email(s) for Invoice: cbrooks@ninyoandmoore.com																																															
Project Information																																																		
Project Name/No: NEWIS AFB BUILDING 47				Purchase Order:																																														
EMSL LIMS Project ID: (If applicable, EMSL will provide)				US State where samples collected: NV																																														
Sampled By Name: CRYSTAL CASTELLANO				Date Sampled: 12-18-23																																														
Sampled By Signature: <i>C. Castellano</i>				No. of Samples in Shipment: 11																																														
Turn-Around-Time (TAT)																																																		
<input type="checkbox"/> 3 Hour <input type="checkbox"/> 6 Hour <input type="checkbox"/> 24 Hour <input type="checkbox"/> 32 Hour <input type="checkbox"/> 48 Hour <input checked="" type="checkbox"/> 72 Hour <input type="checkbox"/> 96 Hour <input type="checkbox"/> 1 Week <input type="checkbox"/> 2 Week																																																		
Please call ahead for large projects and/or turnaround times 6 Hours or Less. *32 Hour TAT available for select tests only, samples must be submitted by 11:30am.																																																		
Test Selection																																																		
PLM - Bulk (reporting limit)			TEM - Bulk																																															
<input checked="" type="checkbox"/> PLM EPA 600/R-93/116 (<1%) <input type="checkbox"/> PLM EPA NOB (<1%) <input type="checkbox"/> POINT COUNT <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1,000 (<0.1%) <input type="checkbox"/> POINT COUNT w/ GRAVIMETRIC <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1,000 (<0.1%) <input type="checkbox"/> NIOSH 9002 (<1%) <input type="checkbox"/> NYS 198.1 (Friable - NY) <input type="checkbox"/> NYS 198.6 NOB (Non-Friable - NY) <input type="checkbox"/> NYS 198.8 (Vermiculite SM-V)			<input type="checkbox"/> TEM EPA NOB <input type="checkbox"/> NYS NOB 198.4 (Non-Friable - NY) <input type="checkbox"/> TEM EPA 600/R-93/116 w Milling Prep (0.1%) Other Tests (please specify) <input type="checkbox"/> Positive Stop - Clearly Identified Homogeneous Areas (HA)																																															
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th style="width:15%;">Sample Number</th> <th style="width:15%;">HA Number</th> <th style="width:35%;">Sample Location</th> <th style="width:35%;">Material Description</th> </tr> </thead> <tbody> <tr> <td>B47-1</td> <td></td> <td>RM 3</td> <td>drywall with paint, blue</td> </tr> <tr> <td>B47-2</td> <td></td> <td>RM 3</td> <td>paint, blue & white cc</td> </tr> <tr> <td>B47-3</td> <td></td> <td>ROOM 6</td> <td>wall cave with mastic</td> </tr> <tr> <td>B47-4</td> <td></td> <td>ROOM 8</td> <td>drywall with paint, blue</td> </tr> <tr> <td>B47-6</td> <td></td> <td>WOMEN'S RESTROOM</td> <td>ceramic tile with mastic</td> </tr> <tr> <td>B47-7</td> <td></td> <td>WOMEN'S RESTROOM</td> <td>drywall with paint, tan</td> </tr> <tr> <td>B47-10</td> <td></td> <td>ROOM 11</td> <td>drywall with paint, blue</td> </tr> <tr> <td>B47-12</td> <td></td> <td>ROOM 11</td> <td>wall cave with mastic</td> </tr> <tr> <td>B47-13</td> <td></td> <td>MECH. ROOM</td> <td>carpet with mastic</td> </tr> <tr> <td>B47-14</td> <td></td> <td>EXTERIOR BUILDING, WEST SIDE</td> <td>drywall w/ paint, tan</td> </tr> </tbody> </table>							Sample Number	HA Number	Sample Location	Material Description	B47-1		RM 3	drywall with paint, blue	B47-2		RM 3	paint, blue & white cc	B47-3		ROOM 6	wall cave with mastic	B47-4		ROOM 8	drywall with paint, blue	B47-6		WOMEN'S RESTROOM	ceramic tile with mastic	B47-7		WOMEN'S RESTROOM	drywall with paint, tan	B47-10		ROOM 11	drywall with paint, blue	B47-12		ROOM 11	wall cave with mastic	B47-13		MECH. ROOM	carpet with mastic	B47-14		EXTERIOR BUILDING, WEST SIDE	drywall w/ paint, tan
Sample Number	HA Number	Sample Location	Material Description																																															
B47-1		RM 3	drywall with paint, blue																																															
B47-2		RM 3	paint, blue & white cc																																															
B47-3		ROOM 6	wall cave with mastic																																															
B47-4		ROOM 8	drywall with paint, blue																																															
B47-6		WOMEN'S RESTROOM	ceramic tile with mastic																																															
B47-7		WOMEN'S RESTROOM	drywall with paint, tan																																															
B47-10		ROOM 11	drywall with paint, blue																																															
B47-12		ROOM 11	wall cave with mastic																																															
B47-13		MECH. ROOM	carpet with mastic																																															
B47-14		EXTERIOR BUILDING, WEST SIDE	drywall w/ paint, tan																																															
Special Instructions and/or Regulatory Requirements (Sample Specifications, Processing Methods, Limits of Detection, etc.)																																																		
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td colspan="2">Method of Shipment:</td> <td colspan="5">Sample Condition Upon Receipt:</td> </tr> <tr> <td colspan="2">Relinquished by: <i>C. Castellano</i></td> <td colspan="2">Date/Time: <i>12-18-23 2:00</i></td> <td colspan="2">Received by: <i>LNE</i></td> <td colspan="1">Date/Time: <i>12/18/23 14:30</i></td> </tr> <tr> <td colspan="2">Relinquished by:</td> <td colspan="2">Date/Time:</td> <td colspan="2">Received by:</td> <td colspan="1">Date/Time:</td> </tr> </table>							Method of Shipment:		Sample Condition Upon Receipt:					Relinquished by: <i>C. Castellano</i>		Date/Time: <i>12-18-23 2:00</i>		Received by: <i>LNE</i>		Date/Time: <i>12/18/23 14:30</i>	Relinquished by:		Date/Time:		Received by:		Date/Time:																							
Method of Shipment:		Sample Condition Upon Receipt:																																																
Relinquished by: <i>C. Castellano</i>		Date/Time: <i>12-18-23 2:00</i>		Received by: <i>LNE</i>		Date/Time: <i>12/18/23 14:30</i>																																												
Relinquished by:		Date/Time:		Received by:		Date/Time:																																												

Controlled Document - Asbestos Bulk R7 9/14/2021

☐ AGREE TO ELECTRONIC SIGNATURE (By checking, I consent to signing this Chain of Custody document by electronic signature.)

EMSL Analytical, Inc.'s Laboratory Terms and Conditions are Incorporated into this Chain of Custody by reference in their entirety. Submission of samples to EMSL Analytical, Inc. constitutes acceptance and acknowledgment of all terms and conditions by Customer.

EMAIL: lasvegaslab@emsl.com



EMSL ANALYTICAL, INC.
LABORATORY PRODUCTS TRAINING

Chain of Custody

EMSL Order Number (Lab Use Only):

092327166

EMSL ANALYTICAL, INC.
200 ROUTE 130 NORTH
CINNAMINSON, NJ 08077
PHONE: (800) 220-3675
FAX: (856) 786-5974

Company: NINYO & MOORE		EMSL-Bill to: <input checked="" type="checkbox"/> Same <input type="checkbox"/> Different If Bill to Is Different note instructions in Comments**	
Street: 6700 PARADISE ROAD, SUITE E		Third Party Billing requires written authorization from third party	
City: Las Vegas	State/Province: NV	Zip/Postal Code:	Country:
Report To (Name): COURT BROOKS		Fax #:	
Telephone #: 702-428-4912		Email Address: cbrooks@ninyoandmoore.com	
Project Name/Number: NEWIS AFB BUILDING 47			
Please Provide Results: <input type="checkbox"/> Fax <input checked="" type="checkbox"/> Email		Purchase Order:	U.S. State Samples Taken: NV
Turnaround Time (TAT) Options* - Please Check			
<input type="checkbox"/> 3 Hour	<input type="checkbox"/> 6 Hour	<input type="checkbox"/> 24 Hour	<input type="checkbox"/> 48 Hour <input checked="" type="checkbox"/> 72 Hour <input type="checkbox"/> 96 Hour <input type="checkbox"/> 1 Week <input type="checkbox"/> 2 Week
*For RUSH TAT's Please Call Ahead to Confirm Lab Hours and Availability. Not all TAT options are valid for every test. Materials Science and IAQ TATs are in Business Days rather than Hours (i.e. 24 Hour = End of Next Business Day)			
Asbestos			
PCM - Air <input type="checkbox"/> NIOSH 7400 <input type="checkbox"/> w/ 8hr. TWA TEM - Air <input type="checkbox"/> 4-4.5hr TAT (AHERA ONLY) <input type="checkbox"/> AHERA 40 CFR, Part 763 <input type="checkbox"/> NIOSH 7402 <input type="checkbox"/> EPA Level II <input type="checkbox"/> ISO 10312 TEM - Water Fibers >10µm <input type="checkbox"/> Waste <input type="checkbox"/> Drinking All Fiber Sizes <input type="checkbox"/> Waste <input type="checkbox"/> Drinking		PLM - Bulk <input type="checkbox"/> PLM EPA 600/R-93/116 <input type="checkbox"/> PLM EPA NOB (<1%) <input type="checkbox"/> NYS 198.1 (friable-NY) <input type="checkbox"/> NYS 198.6 (non-friable-NY) Point Count <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%) Point Count w/ Gravimetric <input type="checkbox"/> 400 (<0.25%) <input type="checkbox"/> 1000 (<0.1%) TEM - Dust <input type="checkbox"/> Microvac - ASTM D 5755 <input type="checkbox"/> Wipe-ASTM D6480	
Flame Atomic Absorption <input checked="" type="checkbox"/> Chips SW846-7000B or AOAC 974.02 <input type="checkbox"/> Soil SW846-7000B/7420 <input type="checkbox"/> Air NIOSH 7082 <input type="checkbox"/> Wastewater SM3111B or SW846-7000B/7420 <input type="checkbox"/> ASTM Wipe SW846-7000B/7420 <input type="checkbox"/> non ASTM Wipe SW846-7000B/7420 <input type="checkbox"/> TCLP SW846-1311/7420/SM 3111B		ICP <input type="checkbox"/> Air NIOSH 7300 Modified <input type="checkbox"/> non ASTM Wipe SW846-6010B or C <input type="checkbox"/> ASTM Wipe SW846-6010B or C <input type="checkbox"/> Soil SW846-6010 B or C <input type="checkbox"/> Waste Water SW846-6010B or C <input type="checkbox"/> TCLP SW846-6010B or C	
Graphite Furnace Atomic Absorption <input type="checkbox"/> Soil SW846-7421 <input type="checkbox"/> Wastewater EPA 200.9 <input type="checkbox"/> Air NIOSH 7105 <input type="checkbox"/> Drinking Water EPA 200.9		Other: <input type="checkbox"/>	
Microbiology			
Wipe and Bulk Samples <input type="checkbox"/> Mold & Fungi - Direct Examination <input type="checkbox"/> Mold & Fungi Culture (Genus Only) <input type="checkbox"/> Mold & Fungi Culture (Genus & Species) <input type="checkbox"/> Bacterial Count & ID (Up to Three Types) <input type="checkbox"/> Bacterial Count & ID (Up to Five Types) <input type="checkbox"/> MRSA <input type="checkbox"/> <i>Pseudomonas aeruginosa</i> Water Samples <input type="checkbox"/> Total Coliform & E.coli (P/A) <input type="checkbox"/> Fecal Coliform (SM 9222D) <input type="checkbox"/> Sewage Screen <input type="checkbox"/> Heterotrophic Plate Count (SM 9215)		Air Samples <input type="checkbox"/> Mold & Fungi (Spore Trap) <input type="checkbox"/> Mold & Fungi Culture (Genus Only) <input type="checkbox"/> Mold & Fungi (Genus & Species) <input type="checkbox"/> Bacterial Culture & ID (Up to Three Types) <input type="checkbox"/> Bacterial Culture & ID (Up to Five Types) <input type="checkbox"/> Endotoxin Testing Real Time Q-PCR (See Analytical Guide for Code) Code: Legionella <input type="checkbox"/> Level 1 <input type="checkbox"/> Level 2 <input type="checkbox"/> Level 3 <input type="checkbox"/> Level 4 Other: <input type="checkbox"/>	
Materials Science <input type="checkbox"/> Common Particle ID (large particles) <input type="checkbox"/> Full Particle ID (environmental dust) <input type="checkbox"/> Basic Material ID (solids) <input type="checkbox"/> Advanced Material ID <input type="checkbox"/> Physical Testing (Tensile, Compression) <input type="checkbox"/> Combustion-by-products (soot, char, etc.) <input type="checkbox"/> X-Ray Fluorescence (elem. analysis) <input type="checkbox"/> X-Ray Diffraction (Crystalline Part.) <input type="checkbox"/> MMVF's (Fibrous glass, RCF's) <input type="checkbox"/> Particle Size (sieve/microscopy/laser) <input type="checkbox"/> Combustible Dust <input type="checkbox"/> Petrographic Examination Other: <input type="checkbox"/>			
IAQ			
Nuisance Dust NIOSH <input type="checkbox"/> 0500 <input type="checkbox"/> 0600 Airborne Dust <input type="checkbox"/> PM10 <input type="checkbox"/> TSP Silica Analysis: <input type="checkbox"/> All Species Silica Analysis - Single Species <input type="checkbox"/> Alpha Quartz <input type="checkbox"/> Cristobalite <input type="checkbox"/> Tridymite <input type="checkbox"/> HVAC Efficiency <input type="checkbox"/> Carbon Black <input type="checkbox"/> Airborne Oil Mist Radon Testing: Call for Kit and COC Other: <input type="checkbox"/>			
**Comments/Special Instructions:			
Client Sample #'s		Total # of Samples: 4	
Relinquished (Client): CCollins		Date: 12-18-23	
Received (Lab): LNE		Date: 12/18/23	
		Time: 14:30	

Analysis Completed in Accordance with EMSL's Terms and Conditions located in the Analytical Price Guide

Controlled Document One Change R2-1/12/2010

Relinquished: **LNE 12/18/23 FedEx**

Received: **JMP LNE 12/19/23 9:00**

[illegible]

Nunez Escamilla, Liliteth

From: Smartsheet Forms <forms@app.smartsheet.com>
Sent: Monday, December 18, 2023 2:47 PM
To: Nunez Escamilla, Liliteth
Subject: Confirmation - EMSL Internal Transfer Order Tracking_July.23

[EXTERNAL E-MAIL]

Thank you for submitting your entry. A copy is included below for your records.

EMSL Internal Transfer Order Tracking_July.23

Customer

Name &/or ID NINY63
if known

Project Name
/ Number NELLIS AFB BUILDING 47

Test C-Lead FLAA

of Samples 4

Turn Around
Time 72-hour

Received Lab: 31- Las Vegas-NV

Lab

Transferred
to: (Analyzing 09- San Leandro- CA
Lab)

Accreditation
Needed: YES

Lab

Responsible
for Reporting Analyzing Lab
Results

Receive Date 12/18/2023

Due Date 12/22/2023

EMSL Order ID
***(if logged in)**

EMSL Contact

Notification Email SLAdminTeam@emsl.com, LasVegasLab@emsl.com

Reason for Transfer Receiving Lab does not perform Analysis

Ship Date 12/18/2023

Shipped Via FedEx Overnight

Tracking Number 796764073766

Sample Disposal: Routine

Special Instructions / Comments

File Attachments



NINY63 Lead 12.18.23.pdf (718k)

Powered by [Smartsheet Forms](#)

© 2023 Smartsheet Inc. | [Contact](#) | [Privacy Policy](#) | [User Agreement](#) | [Report Abuse/Spam](#)



6700 Paradise Road, Suite E | Las Vegas, Nevada 89119 | p. 702.433.0330

ARIZONA | CALIFORNIA | COLORADO | NEVADA | TEXAS | UTAH

www.ninyoandmoore.com

Ninyo & Moore
Geotechnical & Environmental Sciences Consultants