



**PEACOCK
ARCHITECTS**
2000 RIVEREDGE PARKWAY
SUITE SEVEN HUNDRED
ATLANTA GEORGIA 30328
404-214-5200 PHONE
404-214-5208 FAX

DRUITT BERRY STONE
STRUCTURAL ENGINEER
1000 WILSON AVENUE, SUITE 1000
ATLANTA, GEORGIA 30318
404-525-1100
www.dbs-engineering.com


TRINKA DAVIS VETERANS VILLAGE
CARROLLTON, GA 30111

DATE	REVISION
02/21/11	BUILD FOR BD
03/04/11	ADDED CH 4
03/11/11	ADDED CH 12

PROJECT NO.
1730000
DATE
SEP 12TH 2010
DRAWING TITLE
CLC FOUNDATION PLAN

S2.02

THIS DOCUMENT IS THE PROPERTY OF DRUITT BERRY STONE. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED ON THESE PLANS. IT IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF DRUITT BERRY STONE, INC.

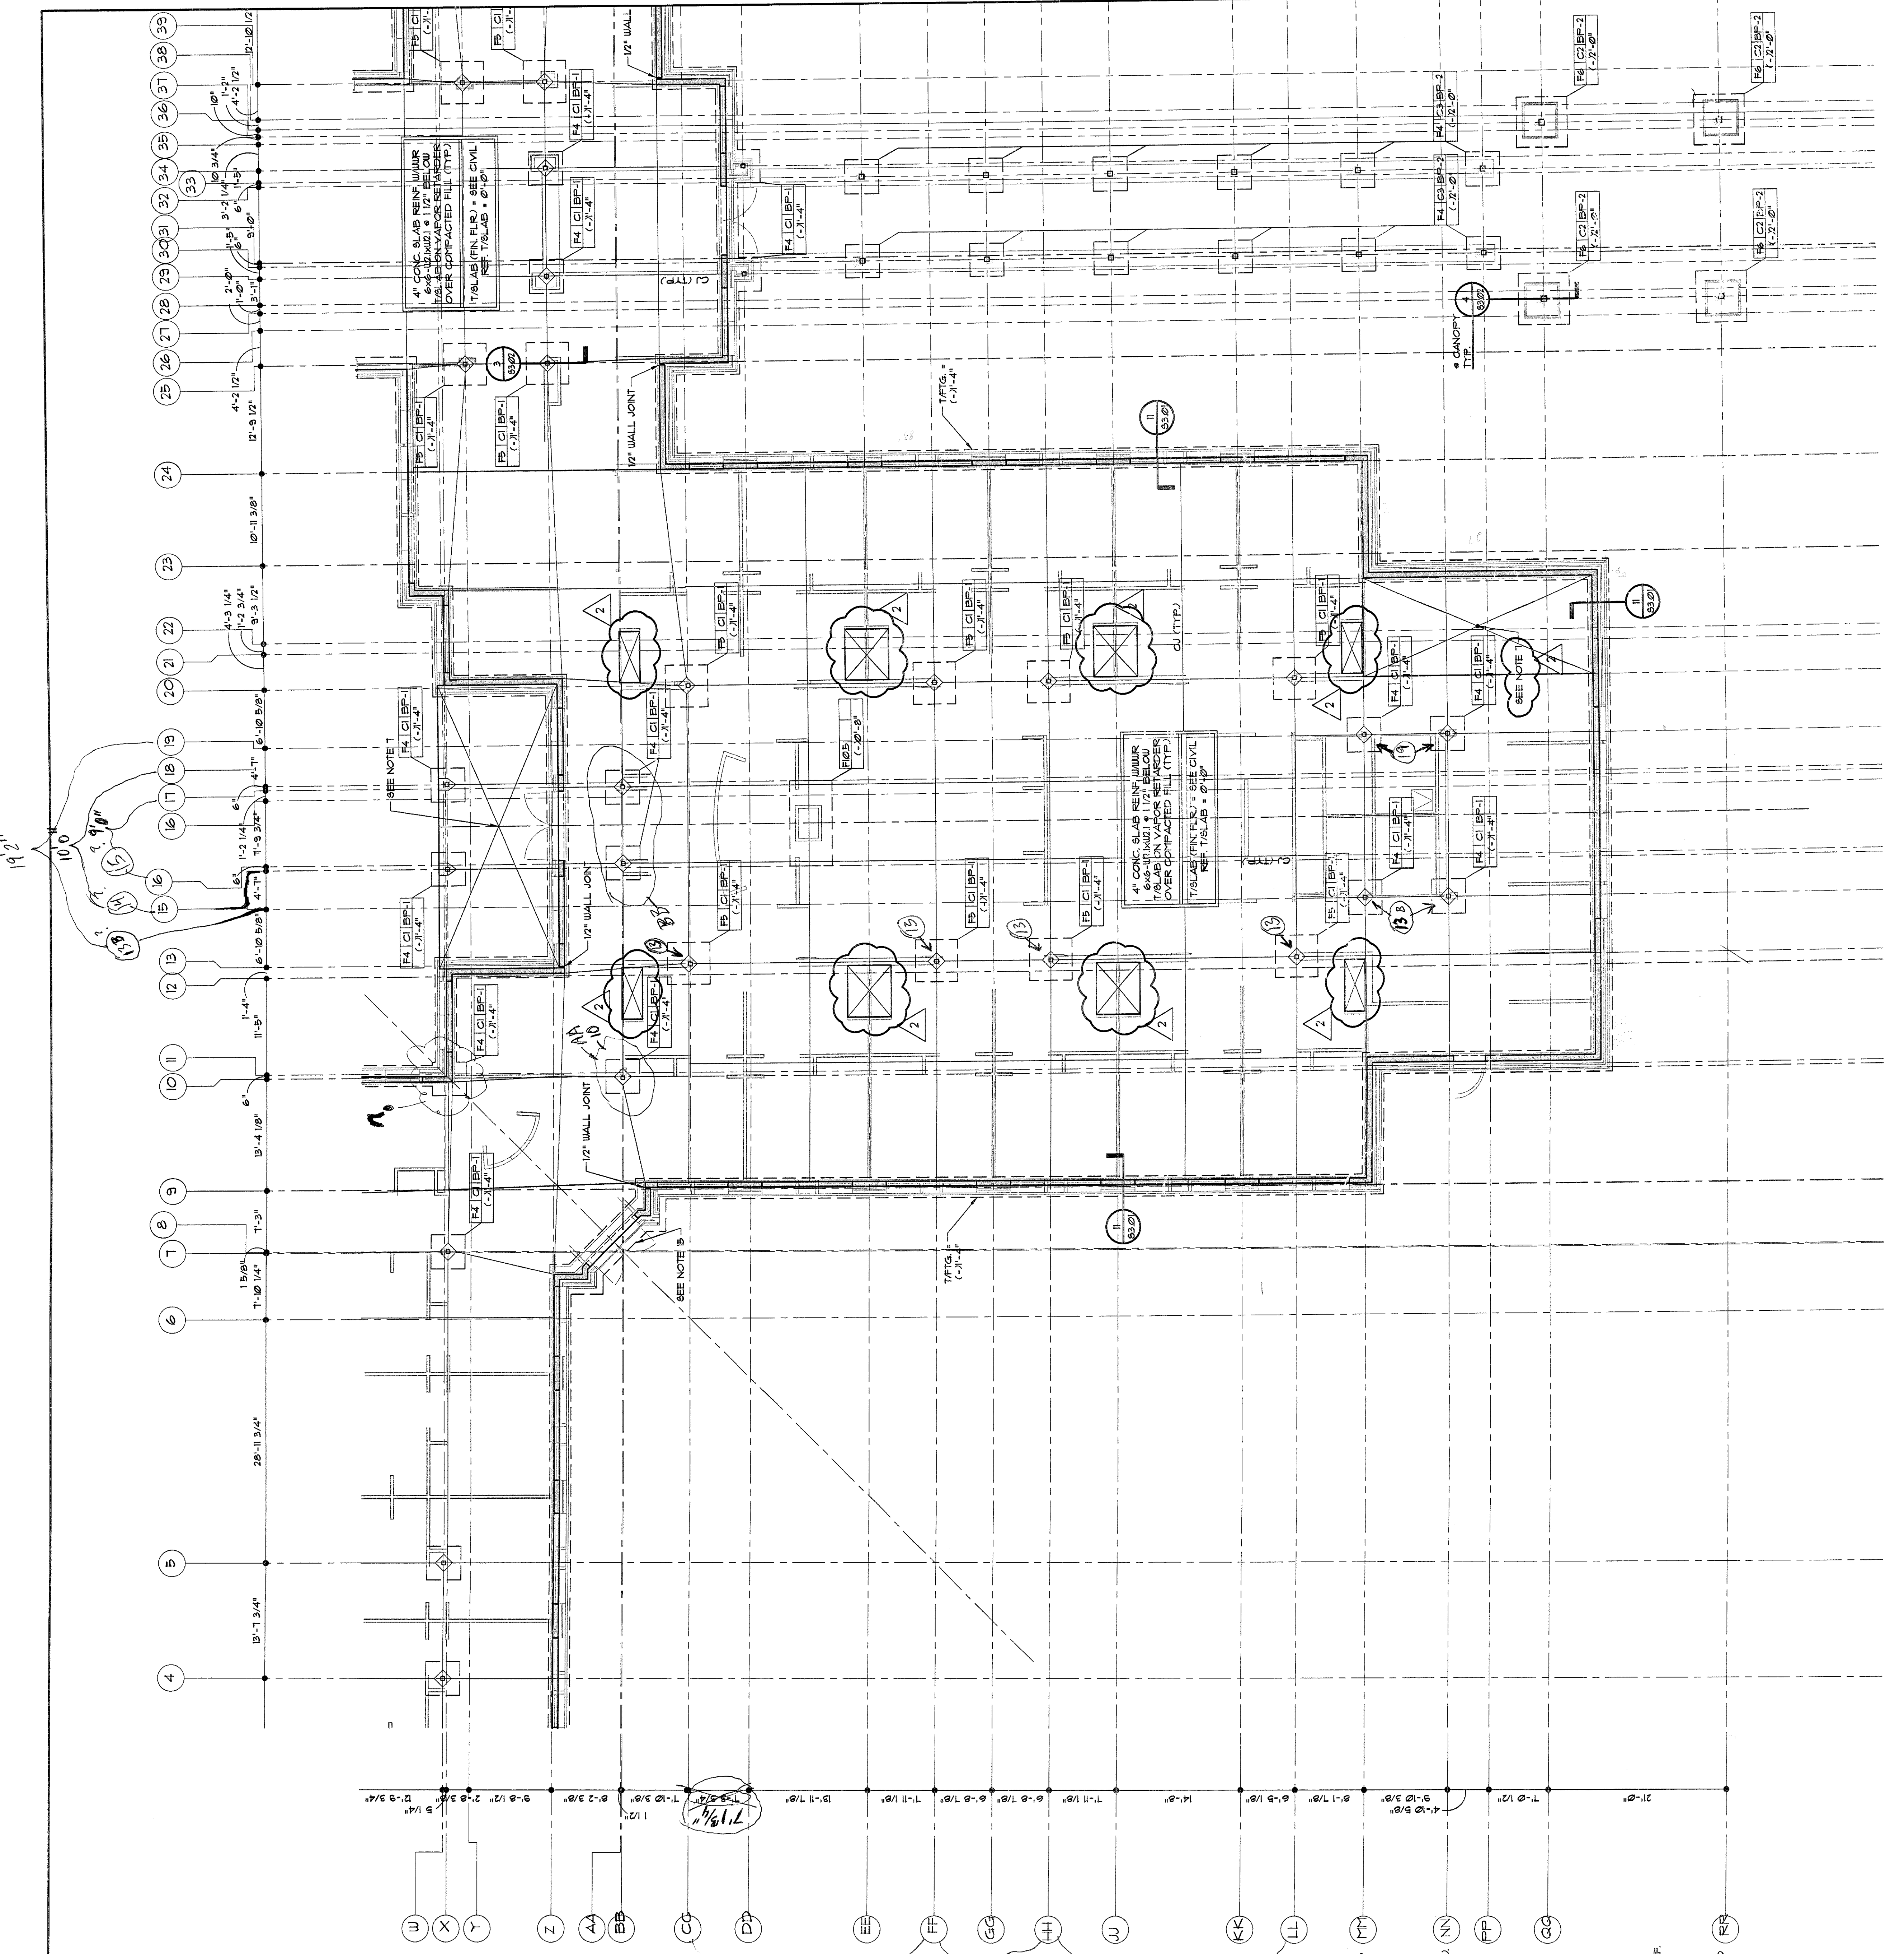

- NOTES:
1. PIPING MUST PASS OVER COLUMN FOOTINGS. SEE DETAILS 103.01, 1203.01 FOR STANDARD DETAILS OF PIPING OVER FOUNDATION. ALL PIPING MUST BE INSTALLED AND INSPECTED BEFORE FOOTINGS ARE PREPARED OR FOOTINGS MUST STEP BELOW PIPE. GC TO COORDINATE DEPTH OF FOOTINGS WITH DEPTH OF PIPING.
 2. [F] [C] [BP] - F: DENOTES FOOTING MARK (SEE FOOTING SCHEDULE ON 5/03.02). [C]: DENOTES CONCRETE WALL. [BP]: DENOTES STEEL BRACKET. (SEE ARCH. DETAIL 103.02). [C-X-X-X]: DENOTES STEEL BRACKET. (SEE ARCH. DETAIL 103.02). [C-X-X-X]: DENOTES STEEL BRACKET. (SEE ARCH. DETAIL 103.02).
 3. SEE DETAIL 103.01 FOR TYPICAL CONCRETE WALL JOINTS.
 4. SEE REBAR/ARCH. DRAWINGS FOR EXACT SIZE & LOCATION OF WALL PENETRATIONS.
 5. SEE PIPING DRAWING FOR LOCATIONS & ELEVATIONS OF ALL UNDERGROUND SANITARY AND VENT PIPING. ALL PIPING MUST BE INSTALLED AND INSPECTED BEFORE FOOTINGS ARE PREPARED OR FOOTINGS MUST STEP BELOW PIPE. GC TO COORDINATE DEPTH OF FOOTINGS WITH DEPTH OF PIPING.
 6. SEE ARCH. FOR ALL BUILDING DIMENSIONS NOT SHOWN.
 7. SEE ARCH. FOR ALL DEPRESSIONED/RAISED AREAS (SEE 4/03.01 FOR DEPRESSIONED SLAB DETAIL).
 8. C/J: DENOTES SLAB JOINT (SEE 3/03.01).
 9. SEE DETAIL 6/03.01 FOR TYPICAL NON-COLUMN CONCRETE WALL CORNER INTERSECTION.
 10. [C-X-X-X] - DENOTES INSULATED CONCRETE FORMS SYSTEM WITH 8" CONCRETE CAVITY WALL REIN. W/ 4" O.C. VERT. AND 4" O.C. HORIZ.
 11. SEE ARCH. FOR EXTENTS AND MINIMUM SLOPE CRITERIA FOR ALL SLOPED SLABS. MAINTAIN 4" MINIMUM SLAB THICKNESS.
 12. PROVIDE (2) #4 #4-20 LG. REBAR # 1/12" BELOW T/S LAB. # ALL REINFORCING CORNERS, DEPRESSIONED SLAB CORNERS, AROUND STEEL COLUMNS, AND # ALL DISCONTINUOUS SAW-CUT CONTROL JOINTS.
 13. INSTALL DEPRESSION SLAB FOR SHOWER CABINS (SEE ARCH. FOR EXTENTS OF DEPRESSIONED SLABS).
 14. [C-X-X-X] - DENOTES 8" CHU WALL REIN. W/ 4" #4 O.C.
 15. EXTEND 1'-0" DEEP CONT. FOOTING TO SUPPORT VENEER (TYP.). REIN. W/ 4" #4 O.C. ELL.
 16. PROVIDE 103.03 1/2" #4 POSTS AT PATENT LIFT FRAMES (SEE ARCH. FOR LIFT FRAME LOCATIONS AND LIFT MANUF. FOR CON. REQUIREMENTS). SEE DETAIL 6/03.01 FOR CON. DETAILS.
 17. -#0- DENOTES STEP IN FOUNDATION (SEE 5/03.01).
 18. INSTALL 103.06 #4 #4-20 LG. # STEEL FRAME TOP (SEE ARCH. FOR REQ.).

CLC FOUNDATION PLAN
SCALE: 1/8" = 1'-0"