



## ADDENDUM NO. 4:

Date: February 13, 2026

Project: Verbena HS Gym  
DCM# 2025629  
WSM# 25-032

Owner: Chilton County Board of Education

Architect: Ward Scott Morris Architecture, Inc.

BID DATE: ~~February 10, 2026~~ **February 17, 2026**

BID TIME: 2:00 PM local time:

BID LOCATION: Chilton County Board of Education, 1705 Lay Dam Road, Clanton, AL

This Addendum forms a part of the Contract Documents and modifies the original Bid Documents as noted below. Acknowledge receipt of this Addendum in the location provided on the Bid Proposal Form.

### **1.1 GENERAL**

A. Incorporate attached PME revisions dated 2/13/26 from Smith, Stegall & Associates.

### **1.2 SPECIFICATIONS**

- A. Section 074113.16 standing Seam Metal Roof Panels: Item 074113.16.2.8 – omit in its entirety. Provide plywood only as indicated on drawings.
- B. Section 123623 Plastic Laminate Clad Countertops: Item 123623.1.3.B.3 – omit in its entirety.
- C. Section 123623 Plastic Laminate Clad Countertops: Item 123623.1.5.A.1 – omit in its entirety
- D. Section 123623 Plastic Laminate Clad Countertops: Item 123623.1.5.B – omit in its entirety
- E. Section 133419 Metal Building Systems: Item 133419.2.3.H.1 - Omit and change to: **Fire/Windstorm Classification: Class 1A-105**.
- F. **Section 133419 Metal Building Systems:** Item 133419.2.2.J Omit this item. Interior wall construction should be plywood and impact resistant gyp. See Detail 1/A331.
- G. : Section 133419 Metal Building Systems: Add Item 133419.2.3.H.2:Hail Resistance MH.
- H. Section 323119 Decorative Metal Fences and Gates: Item 2.1.B.1. add item f. Patriot Aluminum as an approved equal. [www.patriotaluminum.net](http://www.patriotaluminum.net)

### **1.3 DRAWINGS**


- A. Omit civil drawings C201, C301, C501 and C503 and replace with the attached.
- B. Sheet A003" Detail 6/A003 – omit solid surface sills on all gym windows with sill at 22'-0".

### **1.4 ATTACHED TO ADDENDUM**

- A. Plumbing, Mechanical and Electrical sheets F101, P001, P101, P201, M101, E001, E002, E101, E201
- B. Civil Sheets C201, C301, C501, C503.

**END OF ADDENDUM**

# ADDENDUM 004

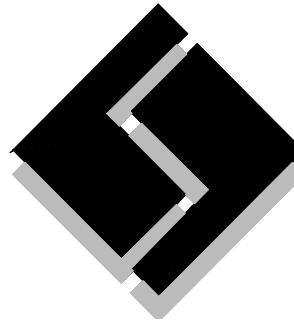

Smith, Stegall & associates p.c.

♦ Consulting Engineers

♦ 2110 Eighth Street, Tuscaloosa, AL 35401

♦ Phone/Fax 205 345 4402

PROJECT: <b>Verbena HS Gym</b>	ENG #2559 ARCH #25-032 DCM #2025629	DATE: <b>February 13, 2026</b>
-----------------------------------	---	-----------------------------------

## Fire Sprinkler:

1. Sheet F101: Delete fire pump. New water service to area provides 75 PSI static on 8" line. No flow test has been performed.
2. Sheet F101: Relocate fire service entrance to Riser 1109.

## Plumbing:

1. Sheet P001: P-17 is recirculating pump for domestic water.
2. Sheet P101: Delete floor drain in former fire pump room.
3. Sheet P201: Delete pressure boosting pump. New water service to area provides 75 PSI.
4. Sheet P201: Relocate water service to Riser 1109

## HVAC:

1. Sheet M101: Delete fire damper at duct entrance to Elec 1104. Room is not required to be rated.

## Electrical:

1. Sheet E001, Gymnasium Riser Diagram: Service to fire pump controller removed
2. Sheet E002:
  - a. Panel 'A' Schedule: Breakers serving 'Pressure Booster' and 'Jockey Pump' removed
  - b. Panel 'B' Schedule: Panel revised to 84 space
3. Sheet E101:
  - a. Gymnasium – Power Wiring Plan:
    - i. Service to fire pump controller removed
    - ii. Storage 1105: CBB 1 relocated to 'Elec 1104'
  - b. Electrical Room 1104:
    - i. Fire pump controller removed
    - ii. Pressure booster removed
    - iii. CBB 1 relocated from 'Storage 1105'
  - c. Riser 1190:
    - i. Panels 'MP' and 'B' shifted / relocated
    - ii. CBB 2, fire alarm NAC extender panel, and fire alarm audio amplifier relocated to 'Elec 1126'
  - d. Electrical Room 1126: CBB 2, fire alarm NAC extender panel, and fire alarm audio amplifier relocated from Riser 1190
  - e. Restroom Building – Power Wiring Plan, Jan 1303: Connection to circulator pump removed
4. Sheet E201, Gymnasium – Lighting Plan:
  - a. Elec 1104: 'S4' luminaire removed
  - b. Storage 1105: 'F4L' luminaire and additional wall switch added

5. Sheet E300:
  - a. Auxiliary Symbols List: See attached sheet for clouded revisions
  - b. Auxiliary Riser Diagram:
    - i. CBB 1 and 2 relocated to 'Elec 1104' and 'Elec 1126' respectively
    - ii. Telecommunications grounding busbar added to CBB 2
6. Sheet E301:
  - a. Exterior: Sprinkler bell and exterior fire alarm speaker strobe relocated to north wall of 'Riser 1109'
  - b. Storage 1105: CBB 1 relocated to 'Elec 1104'
  - c. Elec 1104:
    - i. Fire alarm monitor modules associated with fire pump removed
    - ii. CBB 1 relocated from 'Storage 1105'
  - d. Riser 1109:
    - i. CBB 2, fire alarm NAC extender panel, and fire alarm audio amplifier relocated to 'Elec 1126'
    - ii. Fire alarm connections to fire sprinkler flow and tamper switches added
  - e. Elec 1126: CBB 2, fire alarm NAC extender panel, and fire alarm audio amplifier relocated from Riser 1109

**END OF ADDENDUM**

**Attachment(s):**


1. Sheets (11) F101, P001, P101, P201, M101, E001, E002, E101, E201, E300, E301



02/13/26



02/13/26

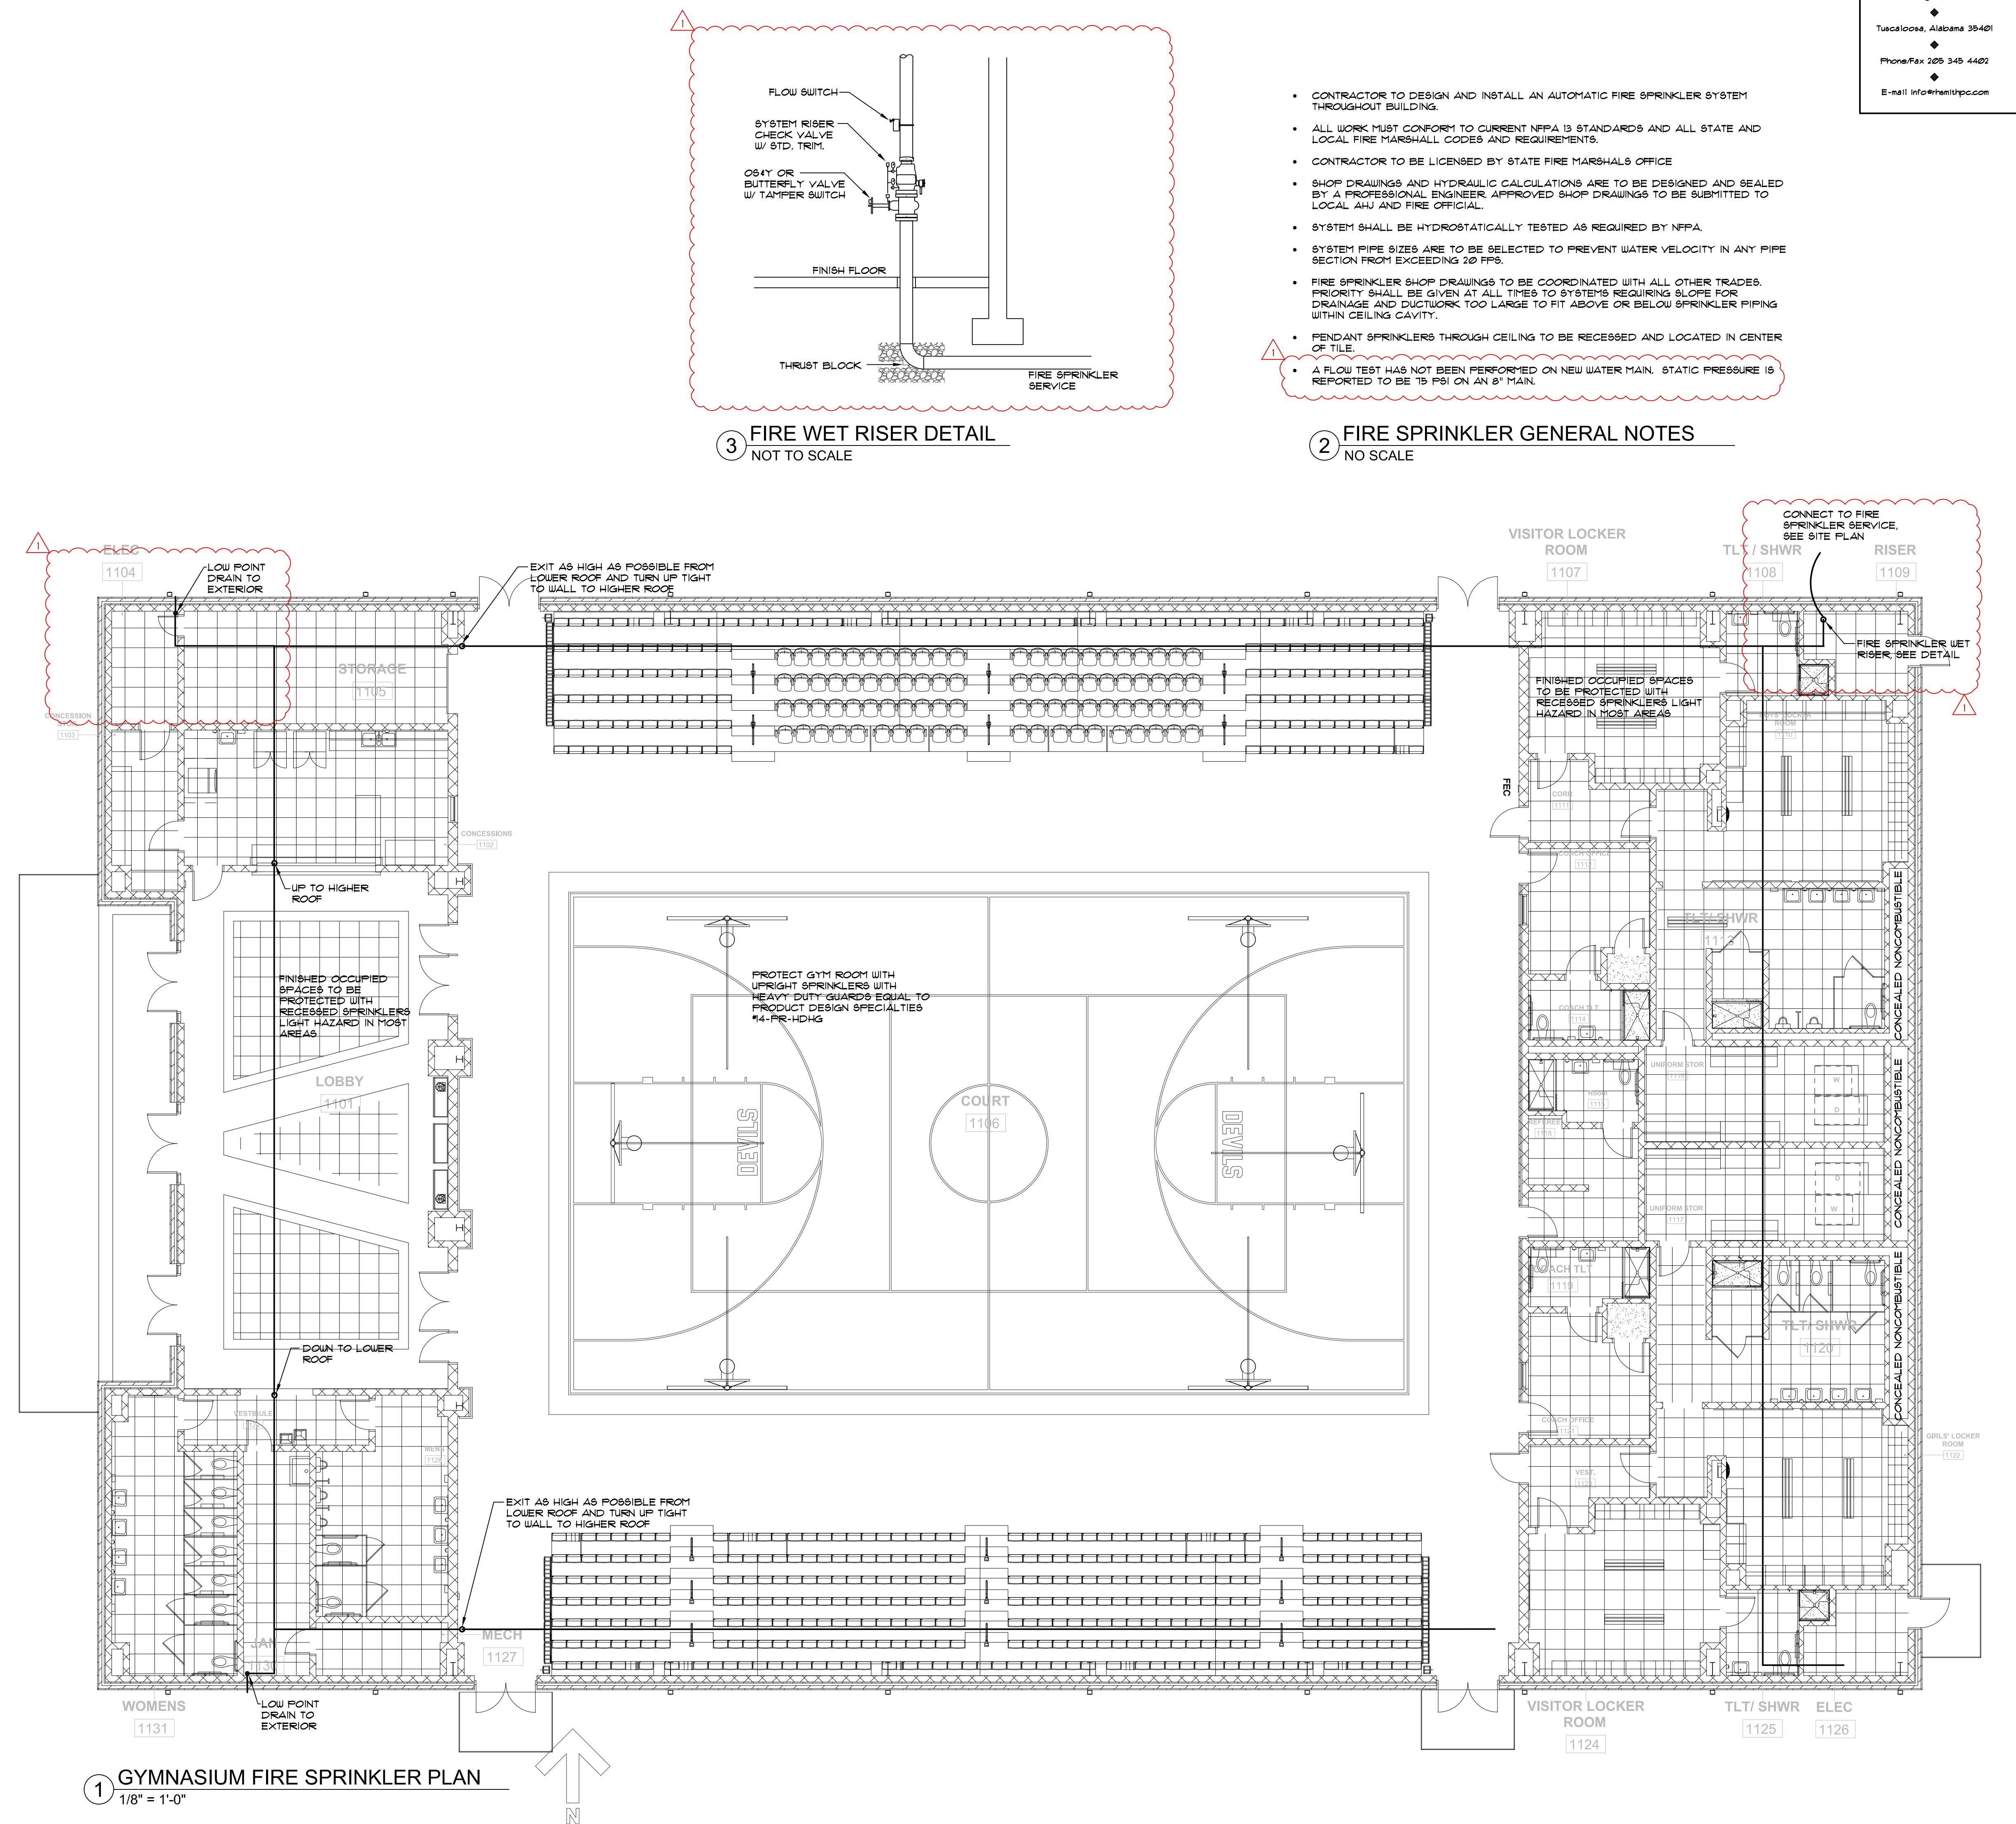


CHILTON CO. VERBENA HS GYM  
CHILTON COUNTY BOARD OF EDUCATION  
202 COUNTY ROAD 510, VERBENA, AL 36091

WARD|SCOTT|MORRIS  
ARCHITECTURE  
2108 Eighth Street  
Tuscaloosa, Alabama 35401  
Phone/Fax 205 345 4482  
E-mail: info@wardscottm.com


02/13/26










5089

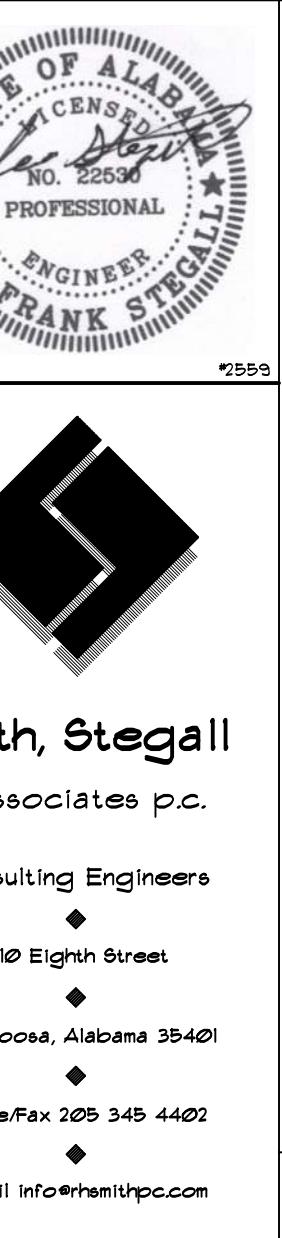

Smith, Stegall  
& associates p.c.  
Consulting Engineers  
2108 Eighth Street  
Tuscaloosa, Alabama 35401  
Phone/Fax 205 345 4482  
E-mail: info@smithpc.com

TUSCALOOSA | HUNTSVILLE  
1606 PAUL W. SPRUITT DRIVE TUSCALOOSA, ALABAMA 35401  
www.wardscottm.com



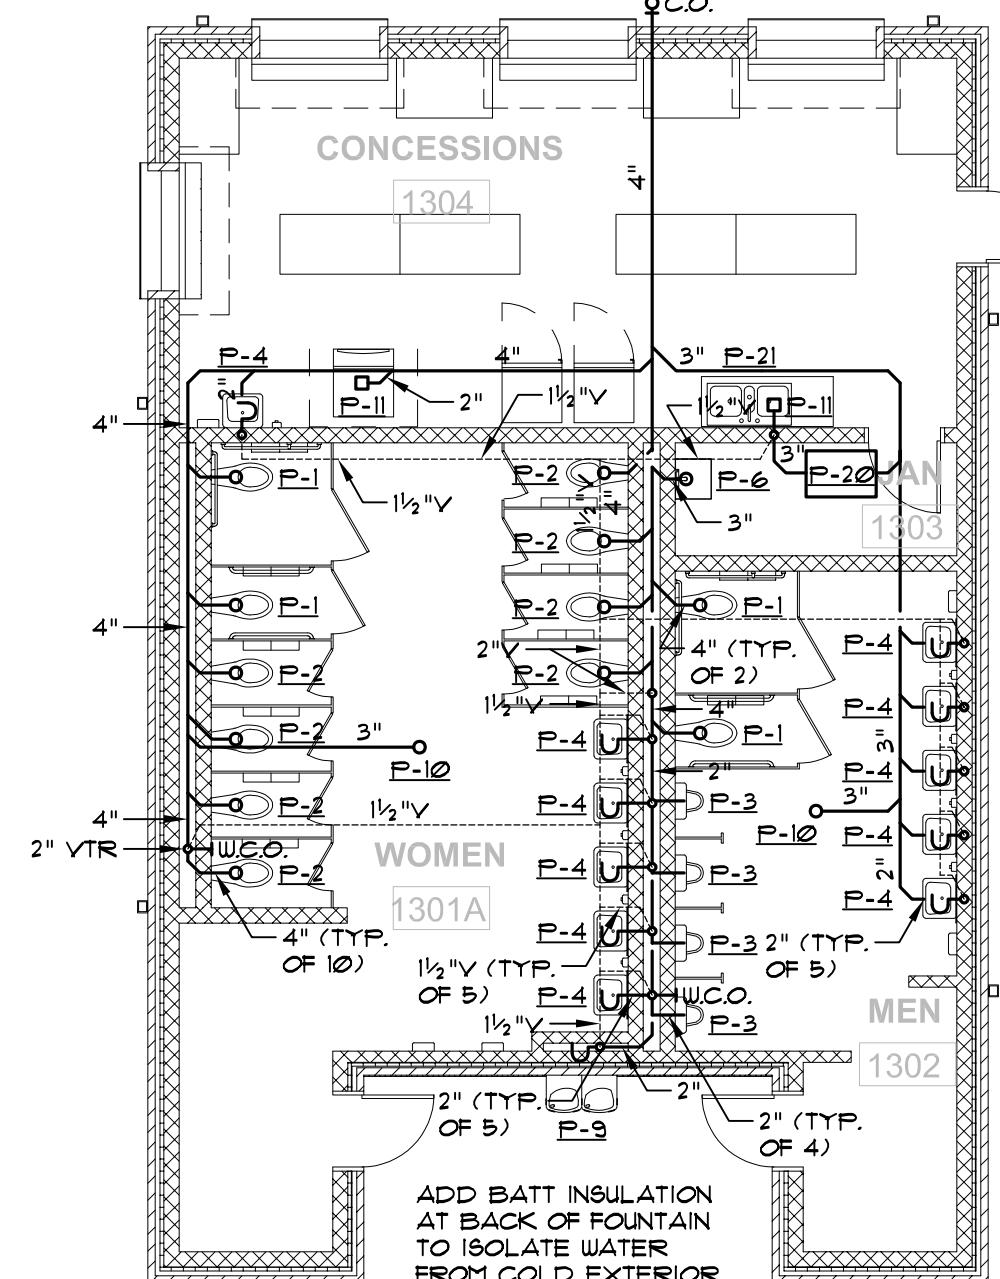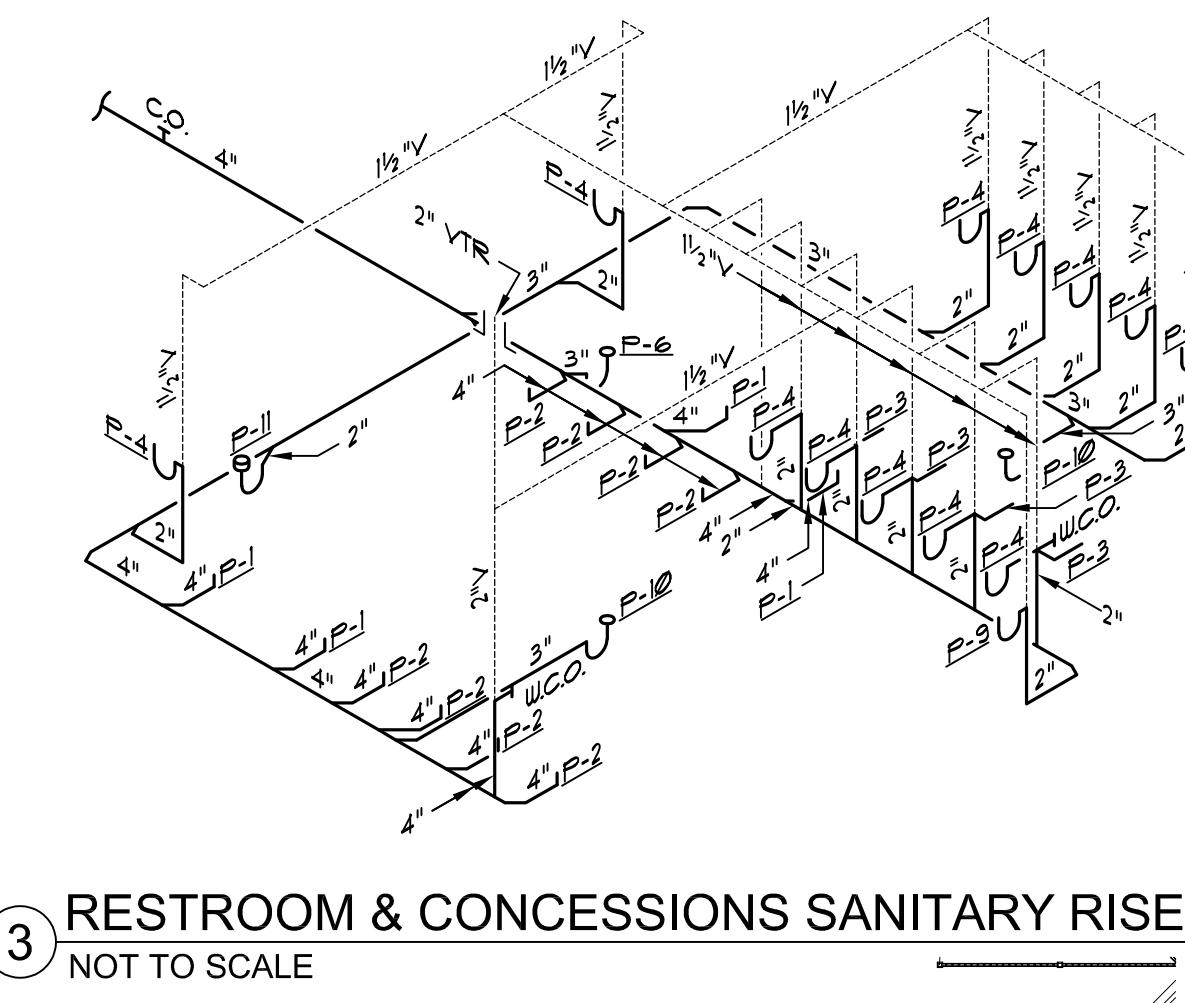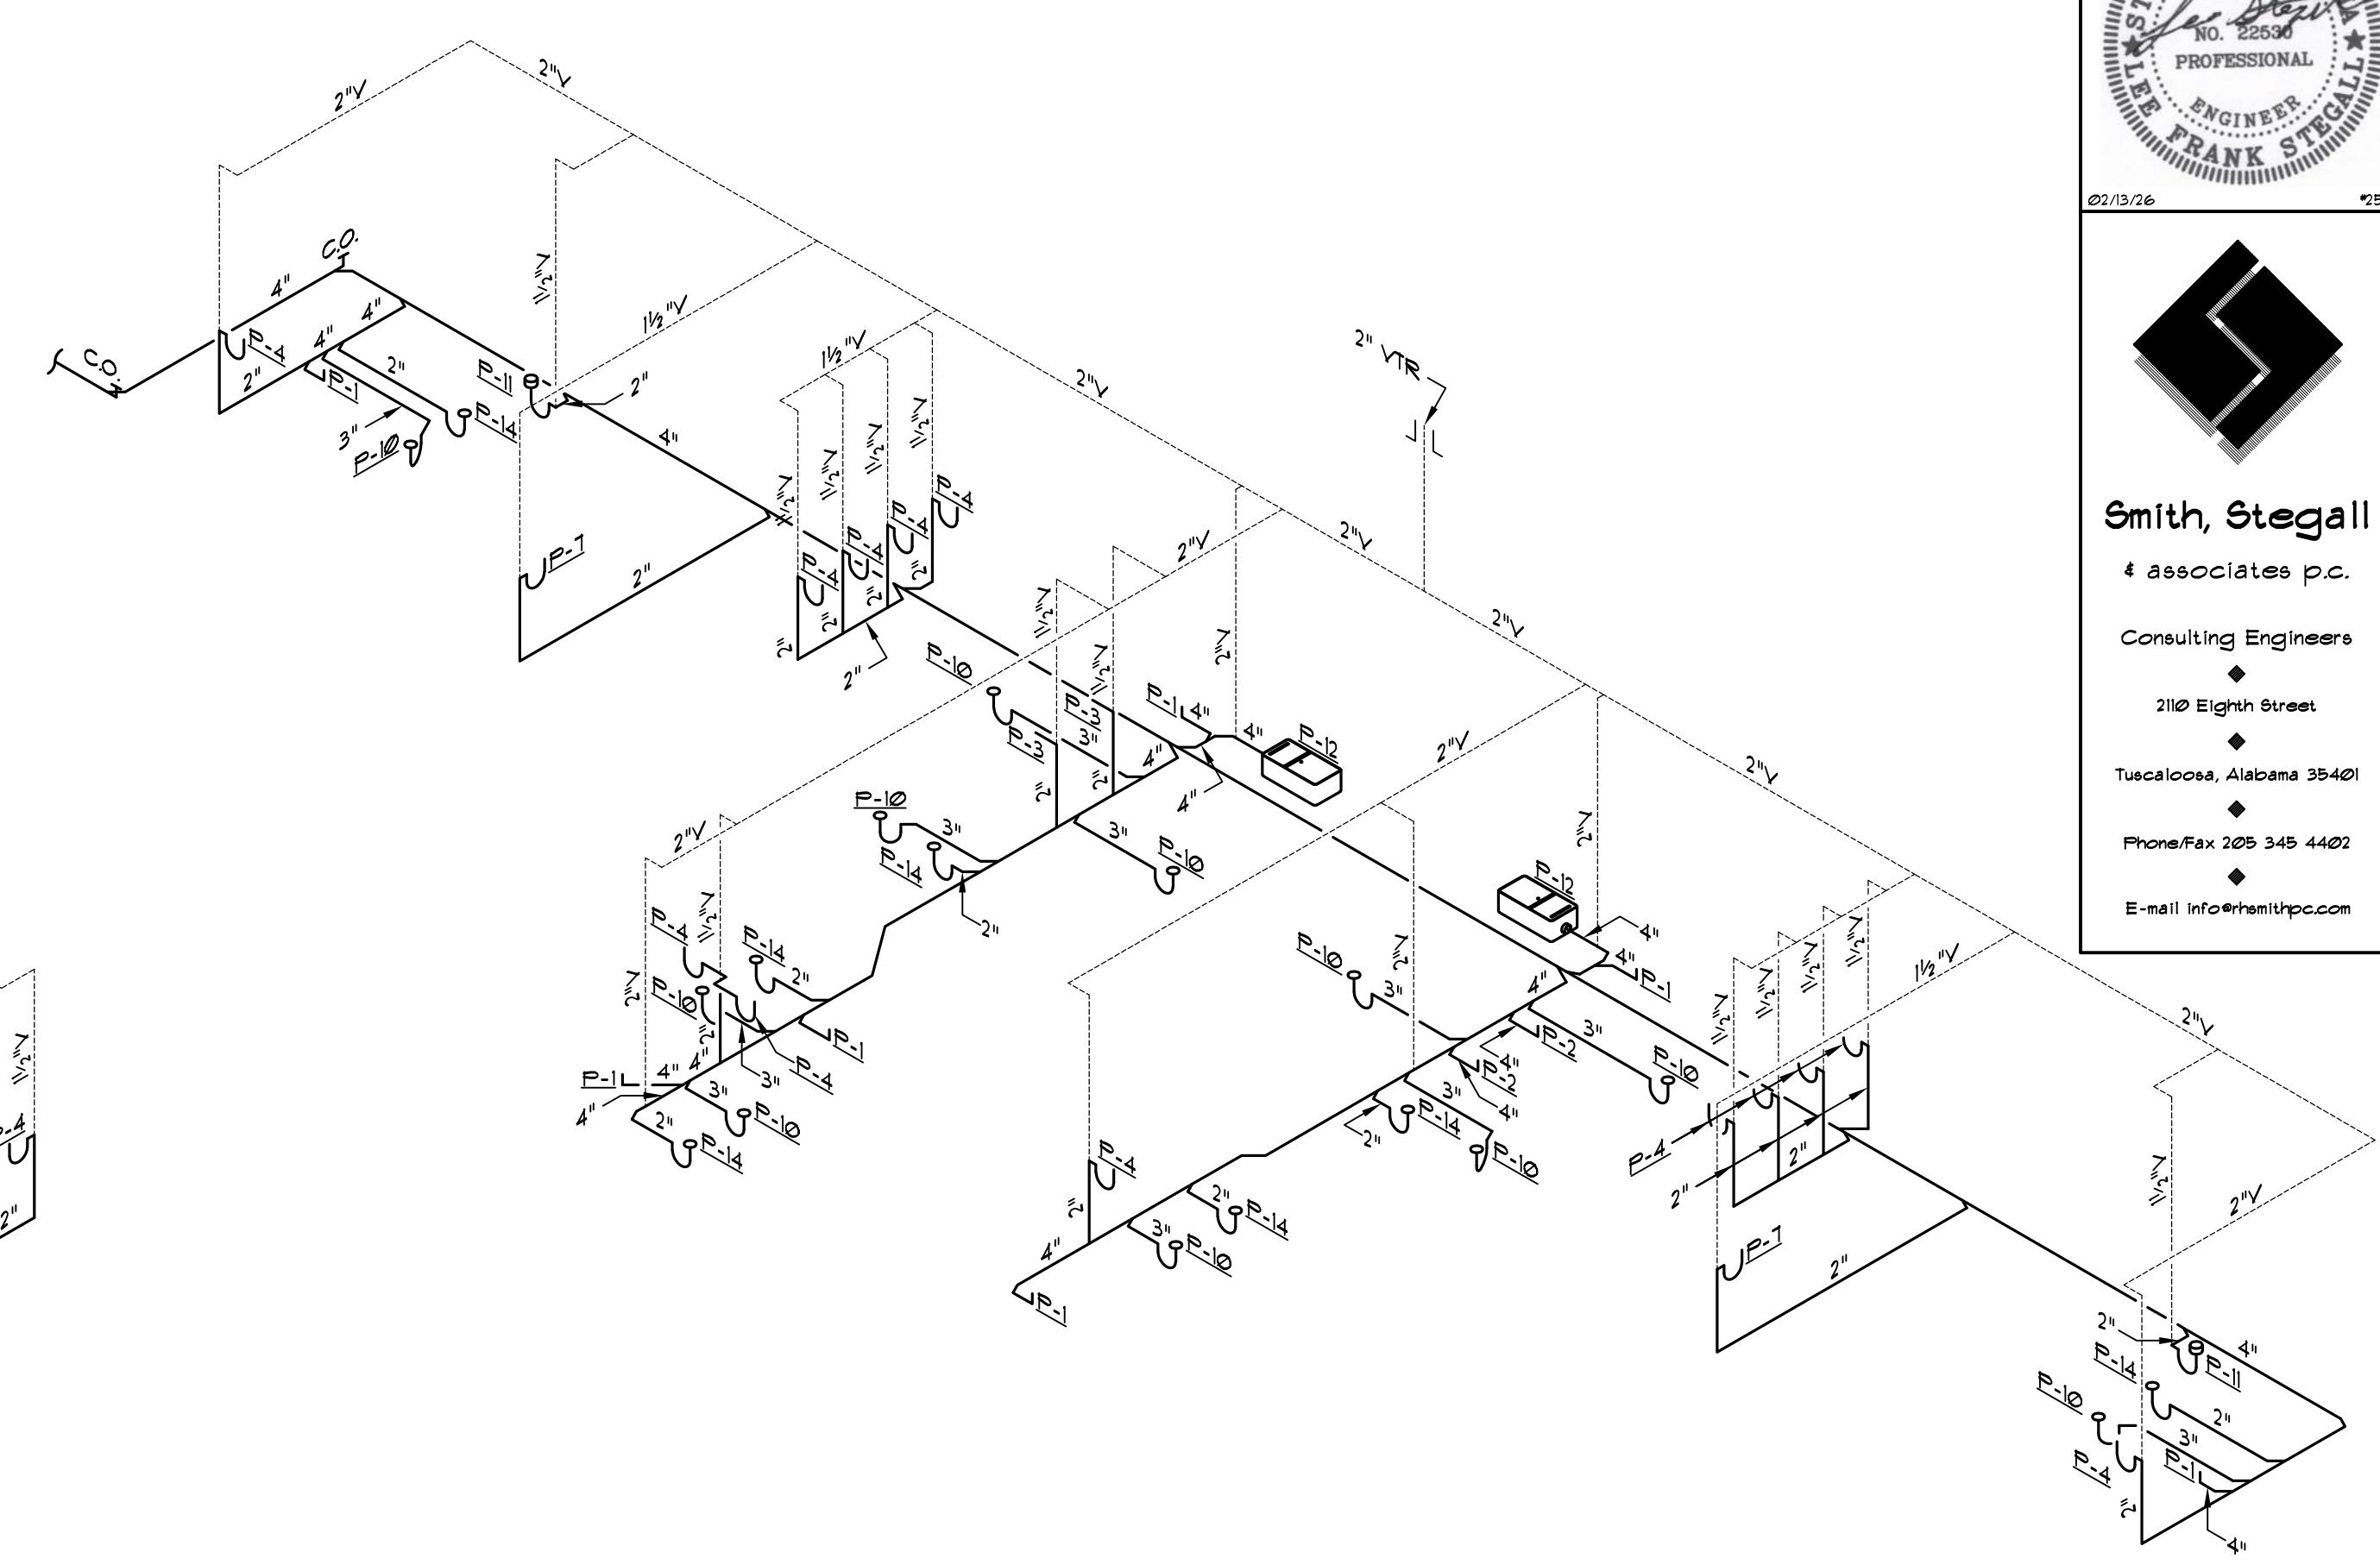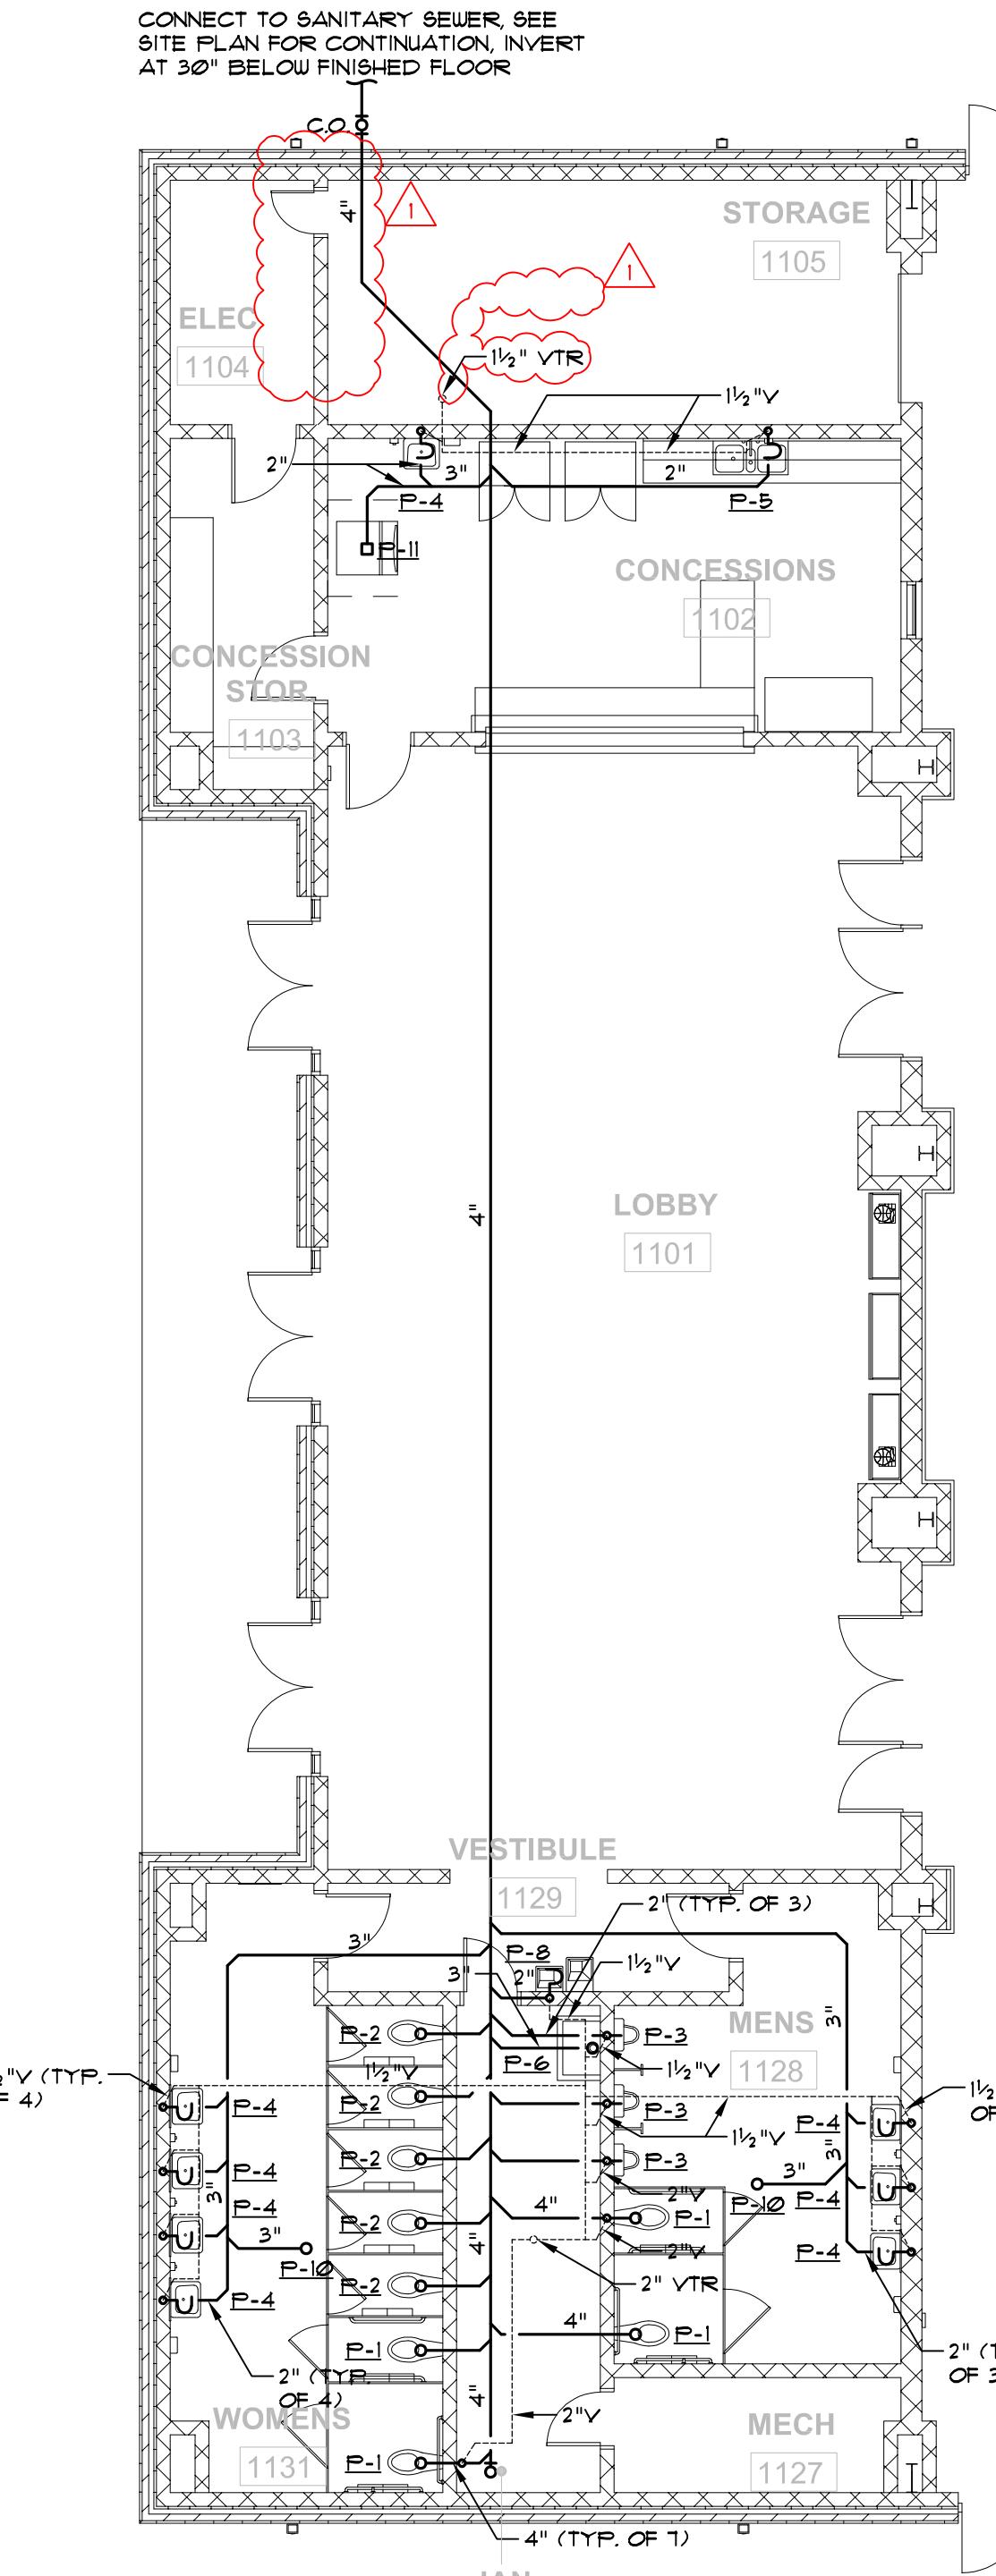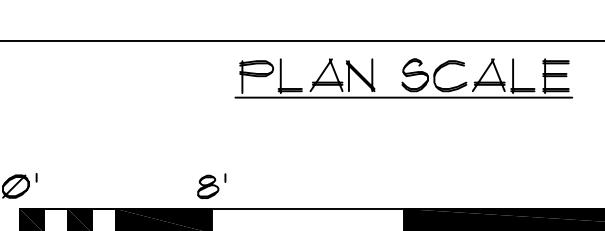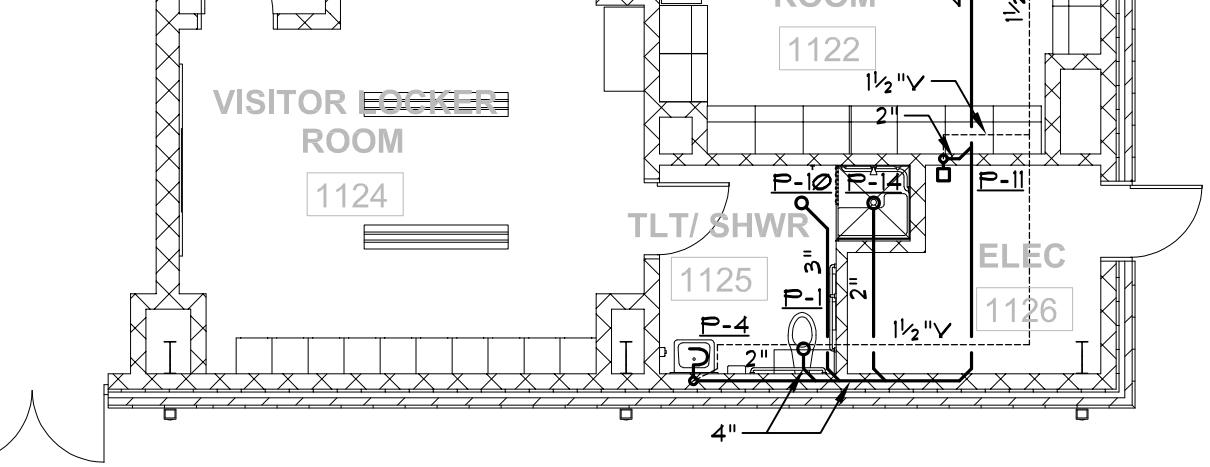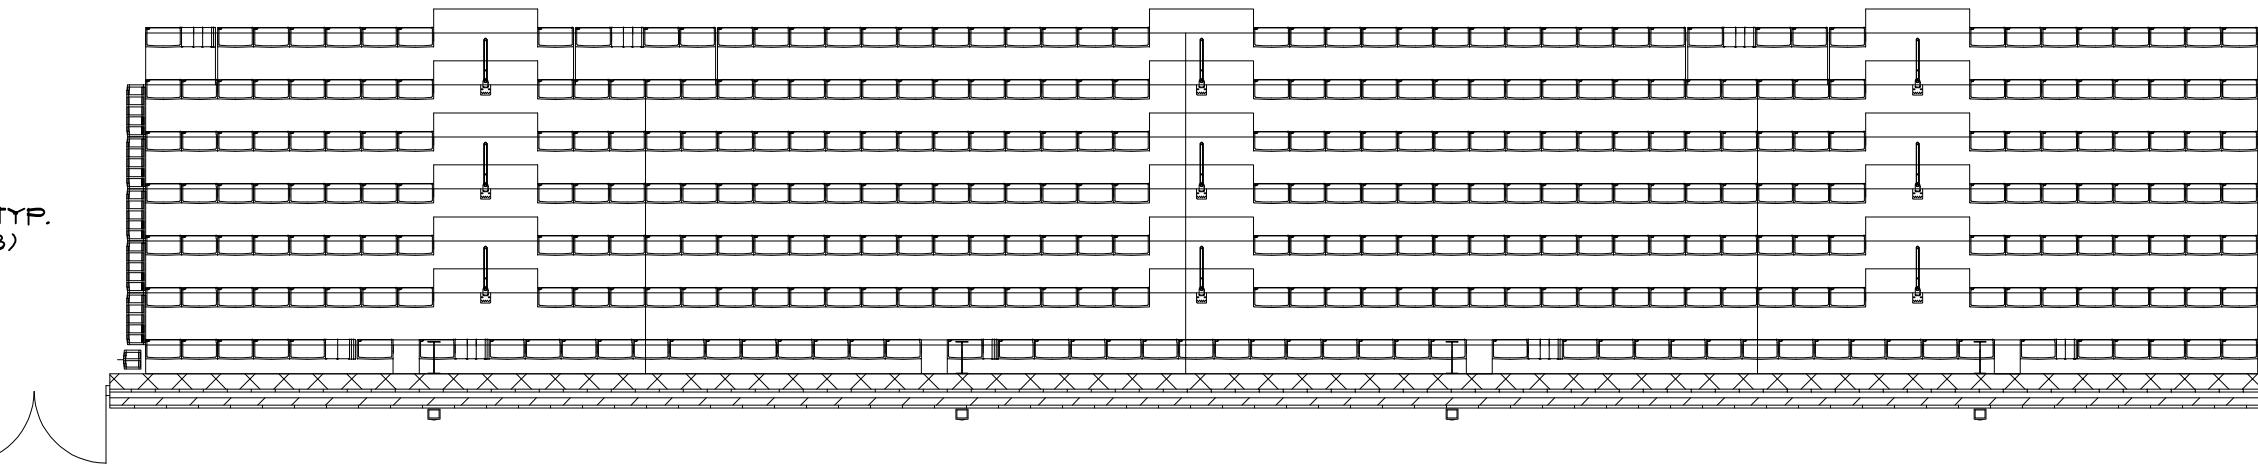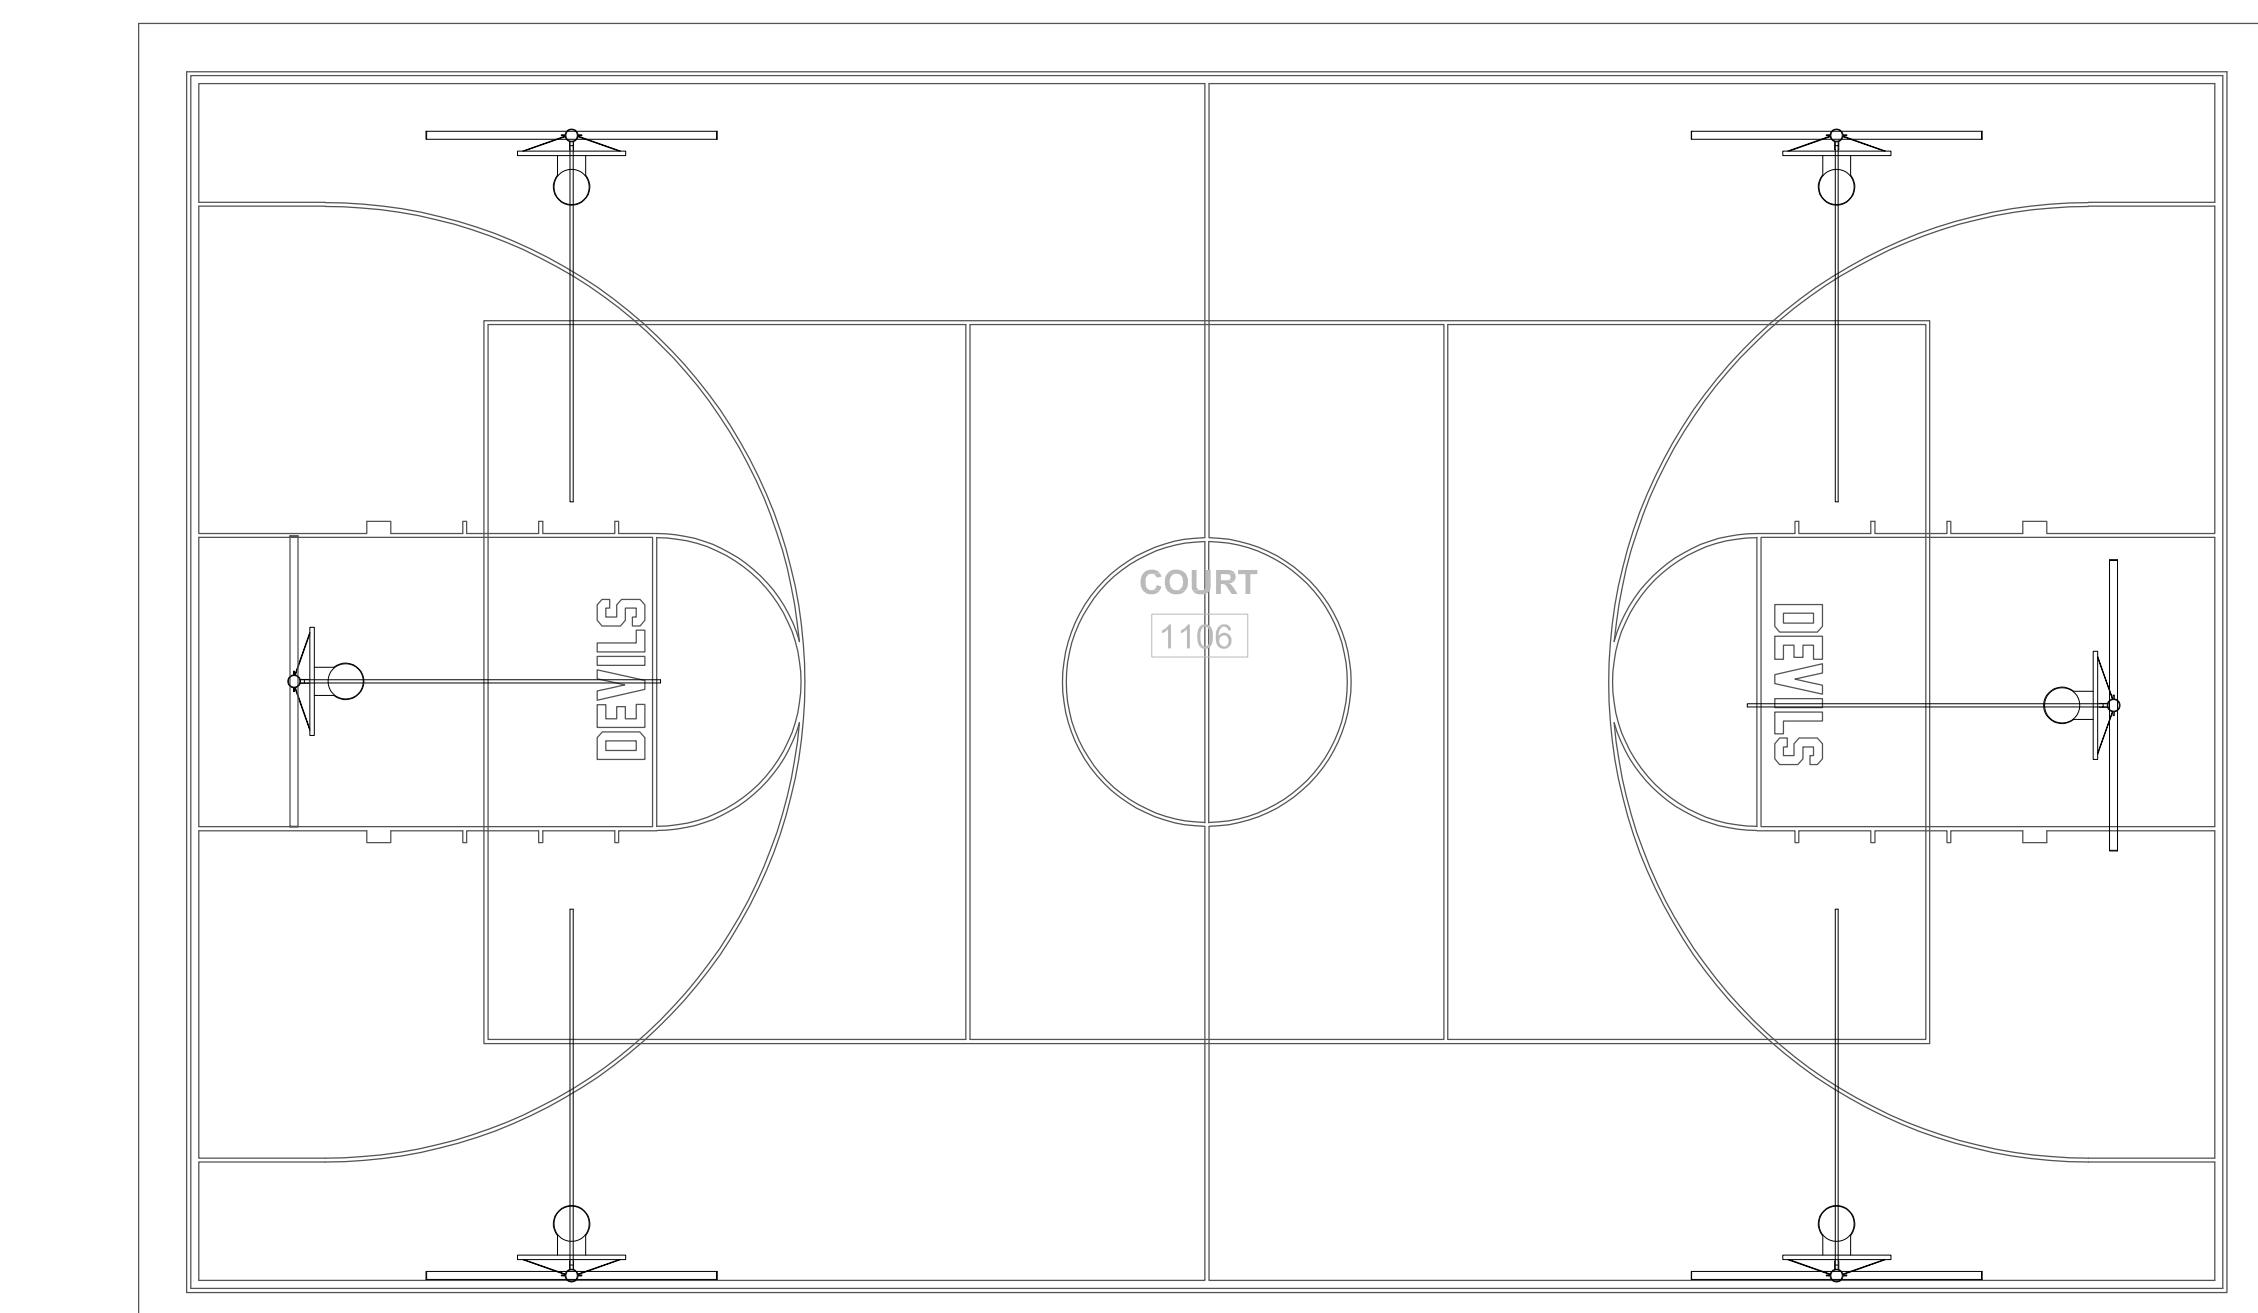② RESTROOM & CONCESSIONS SANITARY PLAN  
1/8" = 1'-0"⑤ WEST GYMNASIUM SANITARY RISER  
NOT TO SCALE① GYMNASIUM SANITARY PLAN  
1/8" = 1'-0"④ EAST GYMNASIUM SANITARY RISER  
NOT TO SCALE


CHILTON CO. VERBENA HS GYM  
CHILTON COUNTY BOARD OF EDUCATION  
202 COUNTY ROAD 510, VERBENA, AL 36091

WARD|SCOTT|MORRIS  
ARCHITECTURE  
2108 EIGHTH STREET  
TUSCALOOSA | HUNTSVILLE  
1606 PAUL W. BERRY DRIVE TUSCALOOSA, ALABAMA 35401  
www.wardscottmoris.com

BID DOCUMENTS  
DATE: 01/08/26  
PROJ NO: 25-032  
REVISIONS  
# DESC DATE  
1 ADD 004 02/13/26

PLAN SCALE  
0' 8' 16' 32'  
4' 1'

P101

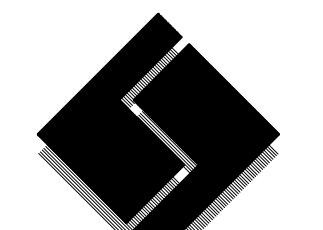

Smith, Stegall

& associates p.c.

Consulting Engineers

2108 Eighth Street

Tuscaloosa, Alabama 35401

Phone/Fax: 205 345 4482



E-mail: info@hpc.com


CHILTON CO. VERBENA HS GYM  
CHILTON COUNTY BOARD OF EDUCATION  
202 COUNTY ROAD 510, VERBENA, AL 36091

P201


BID DOCUMENTS		
DATE: 01/08/26	PROJ NO: 25-0326	
REVISIONS	# DESC DATE	DATE
1 ADD 002 02/05/26	2 ADD 004 02/13/26	


PRESSURE PLAN

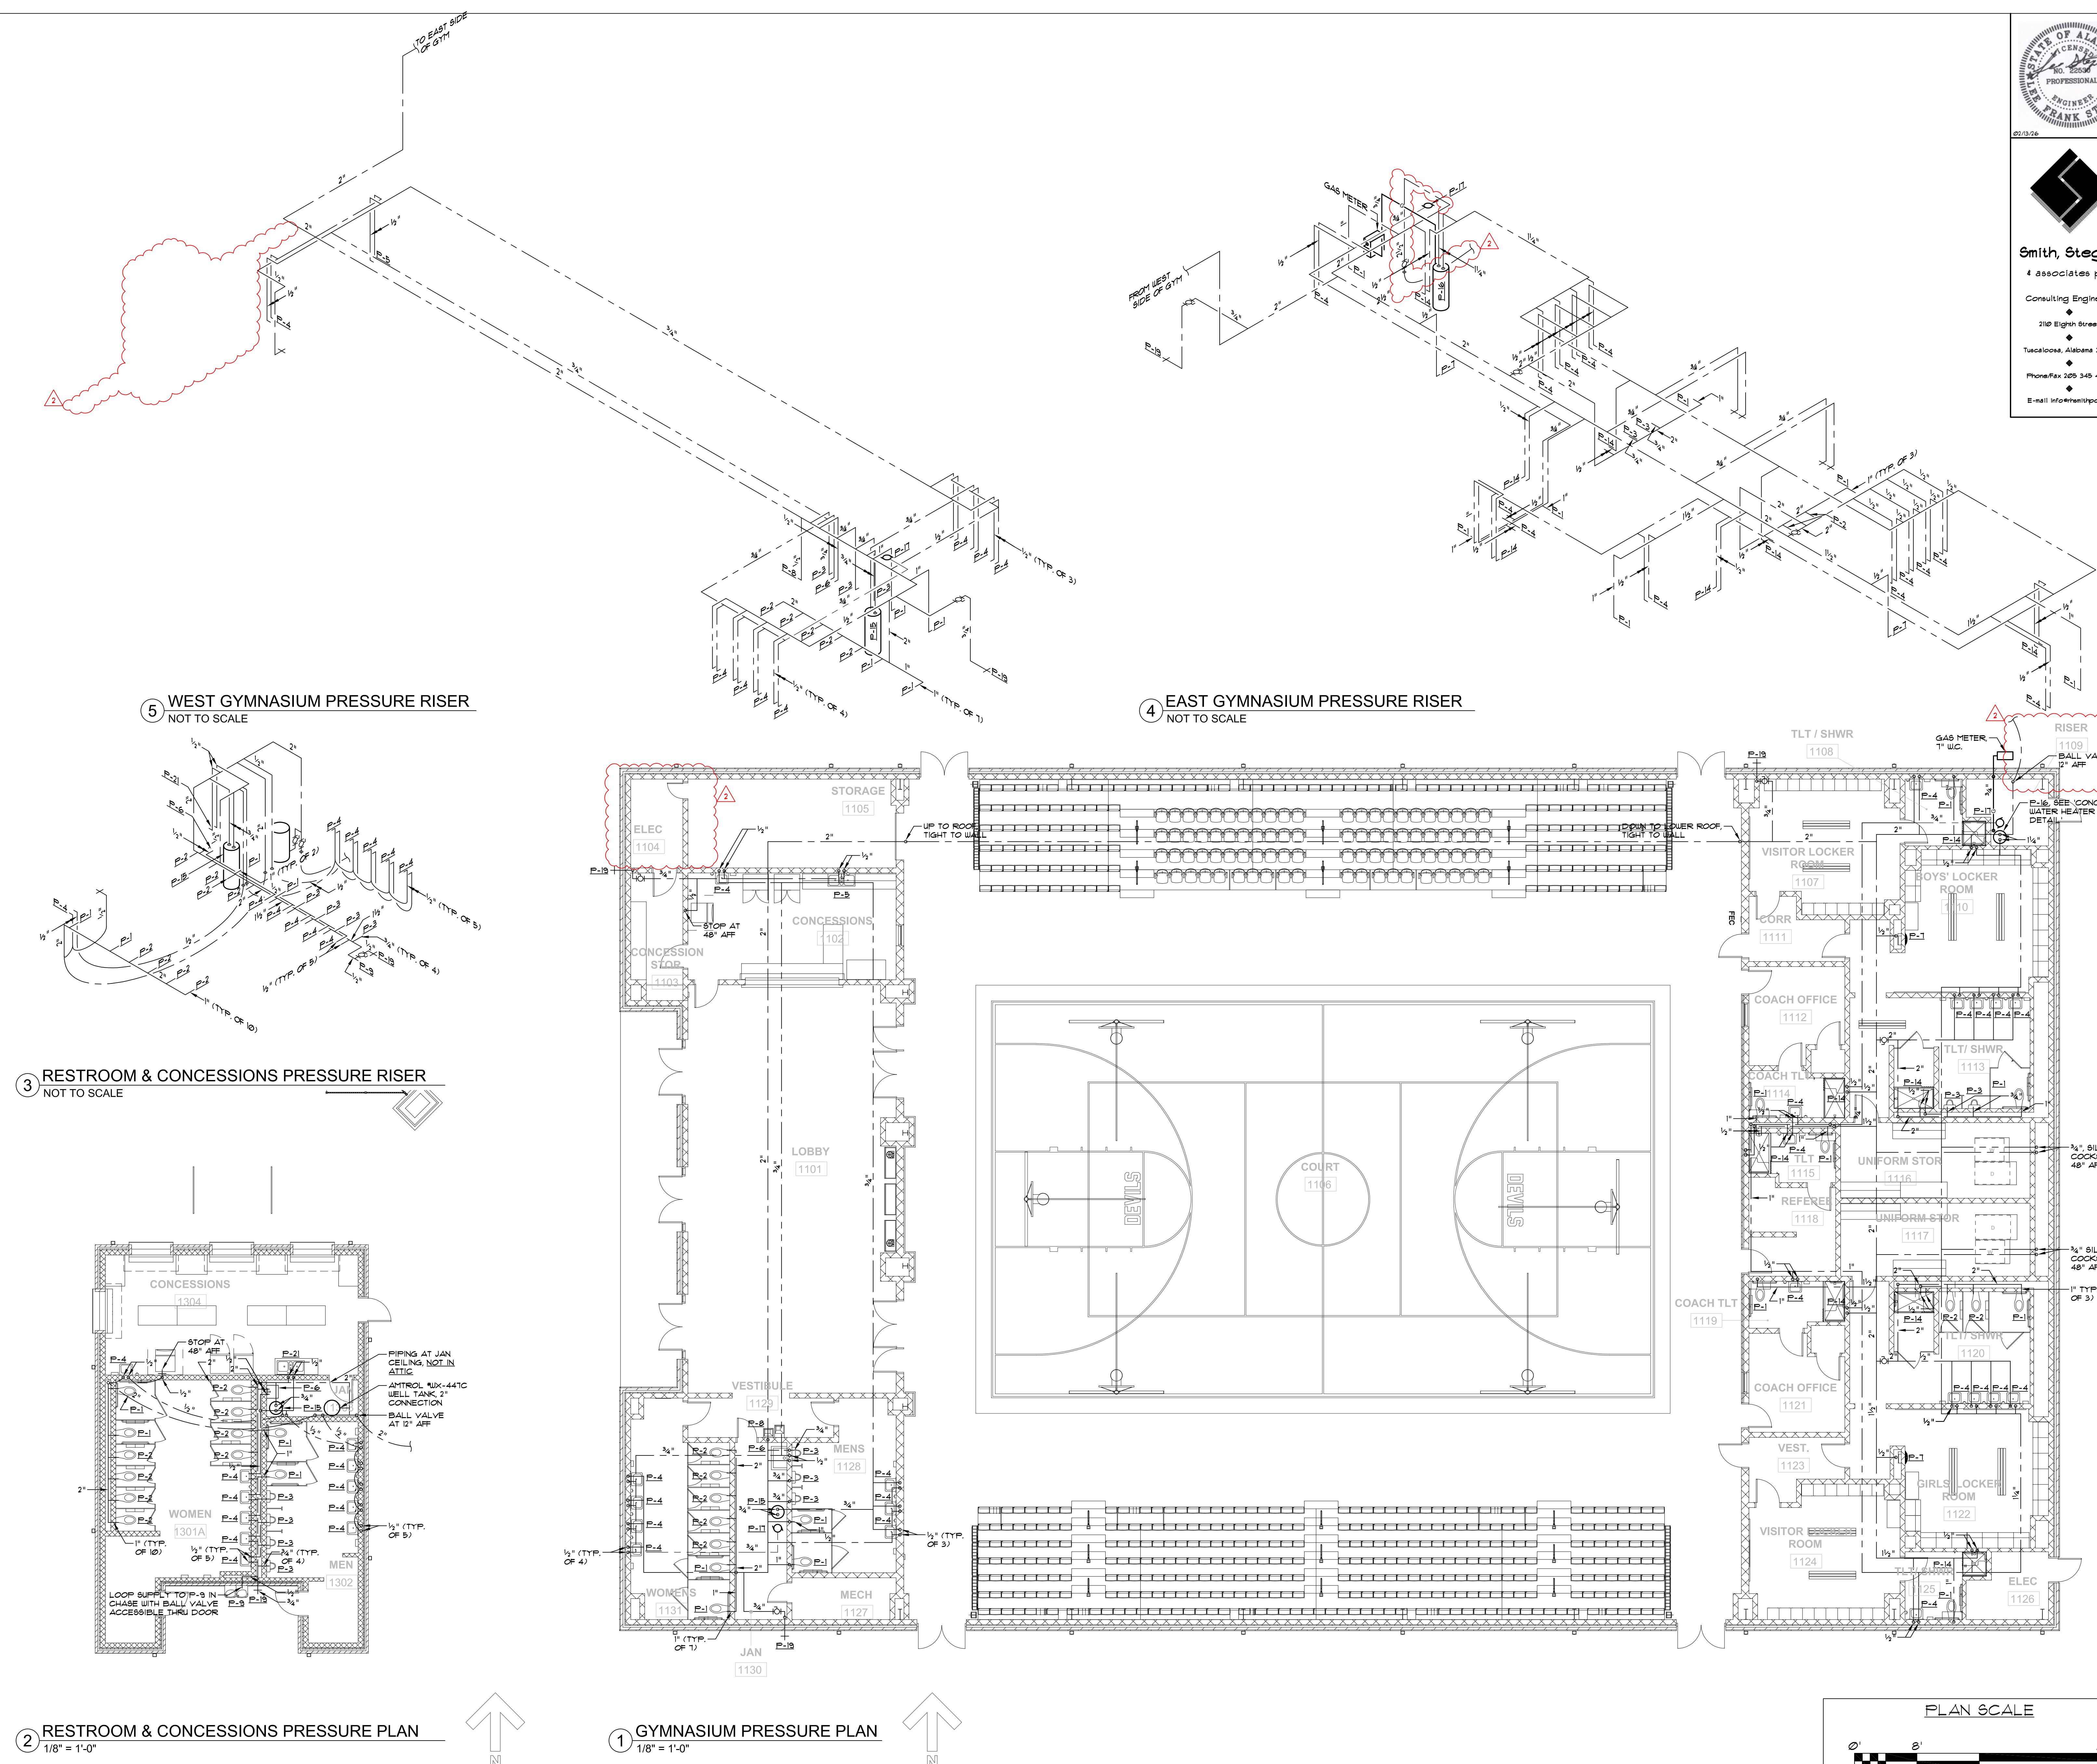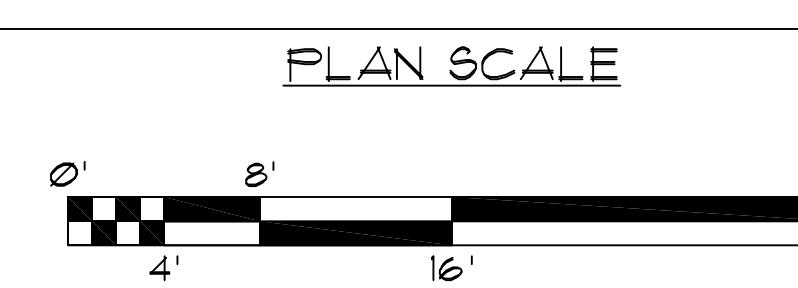

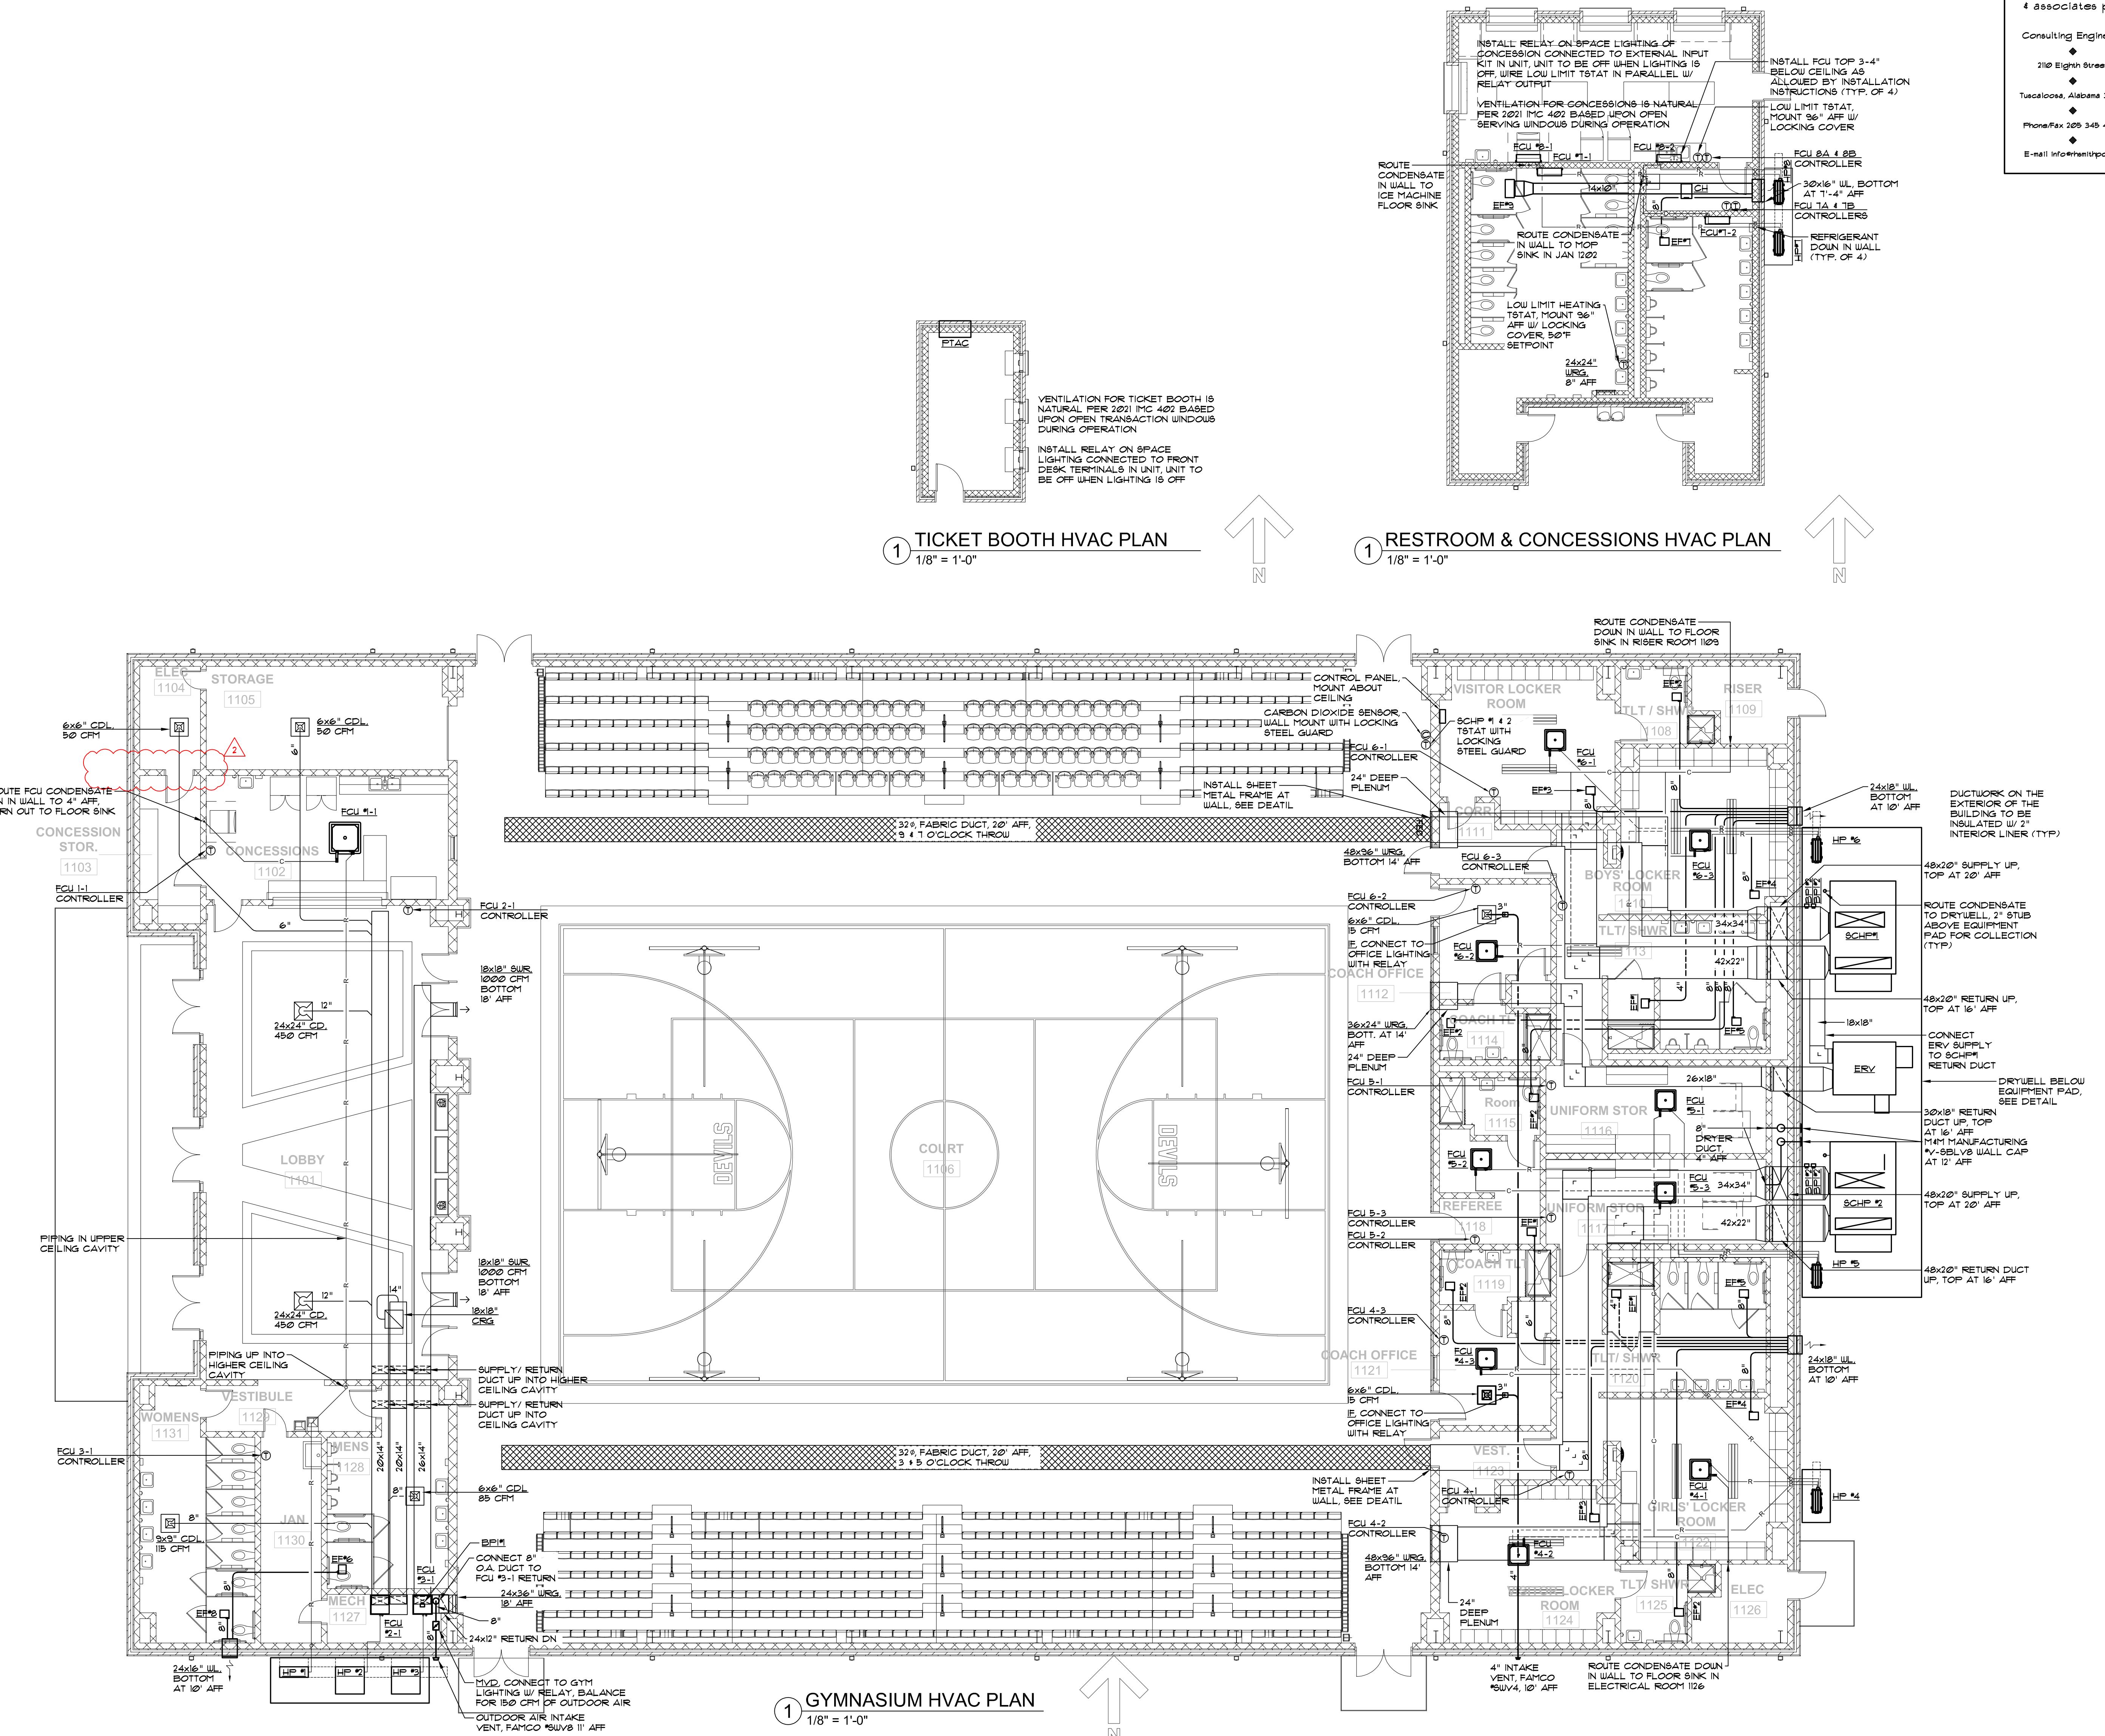


CHILTON CO. VERBENA HS GYM  
CHILTON COUNTY BOARD OF EDUCATION  
202 COUNTY ROAD 510, VERBENA, AL 36091



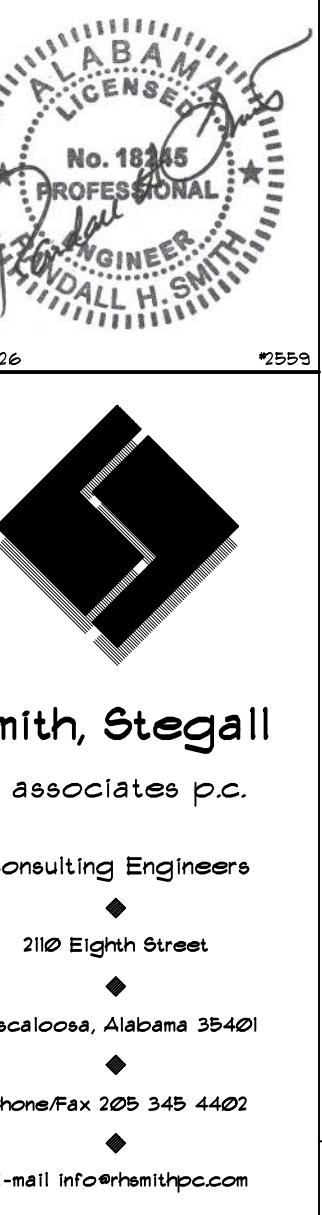

**7** PANEL T SCHEDULE  
NO SCALE

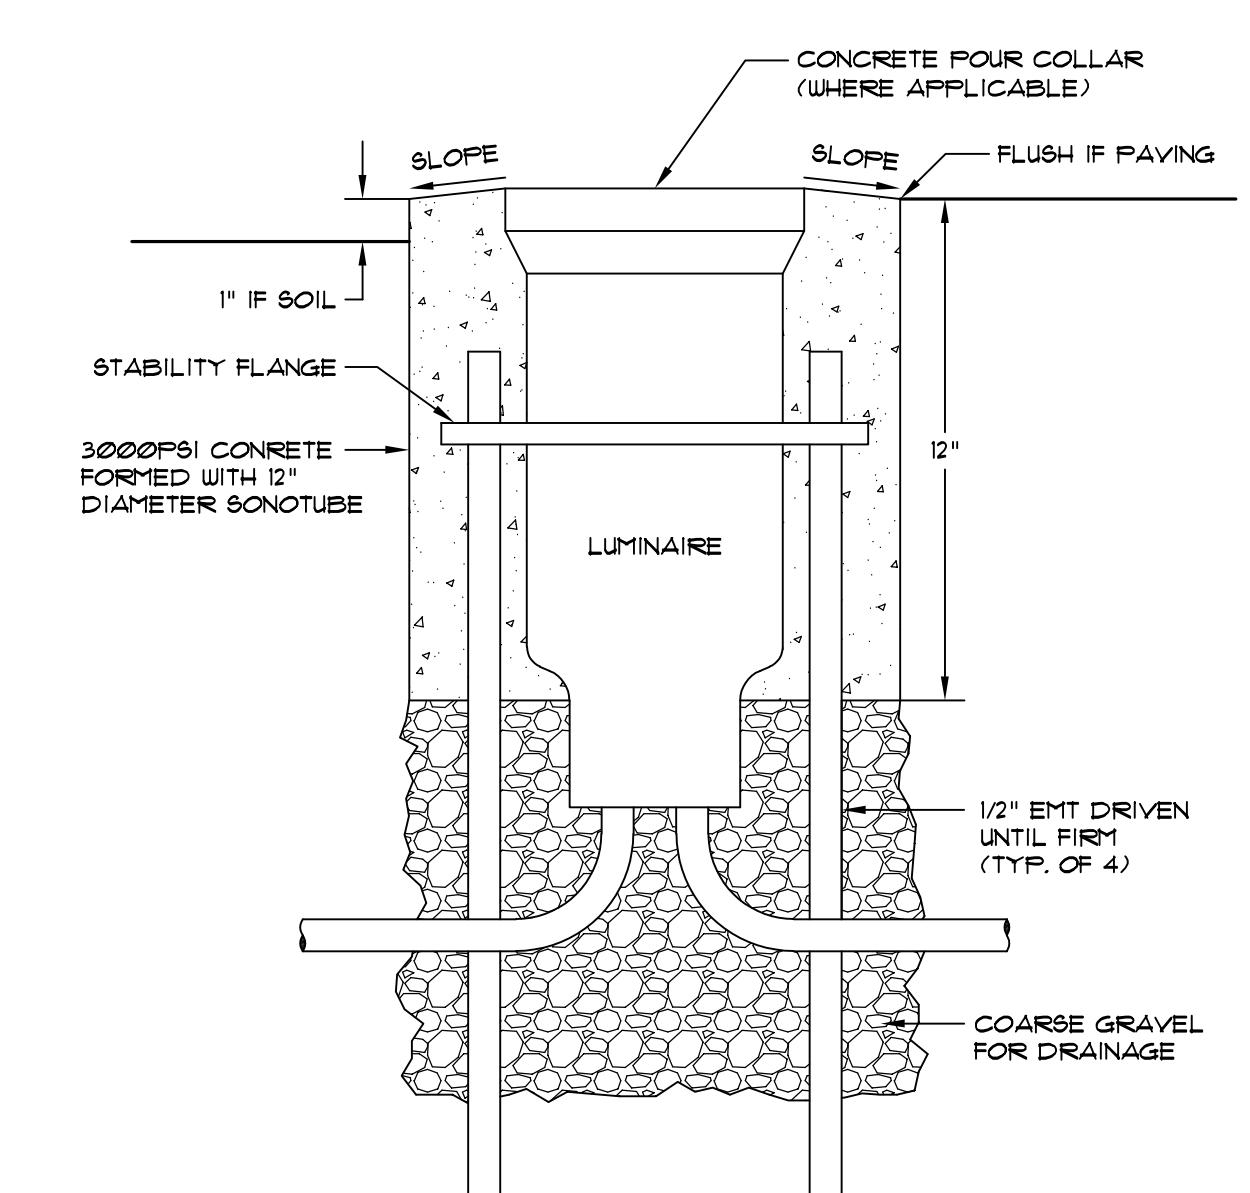


## 6 LUMINAIRE 'Z' MOUNTING DETAIL NOT TO SCALE

DIRECTORY	VA LOAD			CKT NO.	BRKR	BRKR	CKT NO.	VA LOAD			DIRECTORY		
	L1	L2	L3					L1	L2	L3			
LIGHTING	852			1	20/1	20/1	2	1440			RECEPTACLE		
LIGHTING		830		3	20/1	20/1	4		1260		RECEPTACLE		
EXTERIOR LIGHTING / PHOTOCELL		275		5	20/1	20/1 GFI	6			360	GIRL'S BOTTLE FILLER		
GOAL LIFT	500			7	20/1	20/1	8				SPARE		
GOAL LIFT		500		9	20/1	20/1	10		1260		RECEPTACLE		
GOAL LIFT		500		11	20/1	20/1	12			1440	RECEPTACLE		
SCOREBOARD / SHOT CLOCK	360			13	20/1	20/1 GFI	14	360			BOY'S BOTTLE FILLER		
HAND DRYER - VISITOR		950		15	20/1	20/1	16		180		WATER HEATER		
HAND DRYER - GIRLS		950		17	20/1	20/1	18				SPARE		
HAND DRYER - GIRLS	950			19	20/1	20/1	20				SPARE		
HAND DRYER - COACH		950		21	20/1	20/1	22		950		HAND DRYER - BOYS		
HAND DRYER - REFEREE		950		23	20/1	20/1	24			950	HAND DRYER - BOYS		
HAND DRYER - COACH	950			25	20/1	20/1	26	950			HAND DRYER - VISITOR		
DIVIDER CURTAIN		500		27	20/1	20/1	28		540		RECEPTACLE		
POWERTVENT		200		29	20/1	20/1 GFI	30			1,260	GIRLS' LOCKERS		
FIRE ALARM CIRCUIT	360			31	20/1 *	20/1 GFI	32	1620			GIRLS' LOCKERS		
RECEPTACLE - DATA RACK		180		33	20/1	20/1 GFI	34		1,260		GIRLS' VISITOR LOCKERS		
RECEPTACLE - CBB		360		35	20/1	20/1 GFI	36			1,260	GIRLS' VISITOR LOCKERS		
SPARE				37	20/1	20/1 GFI	38	1620			BOYS' LOCKERS		
SPARE				39	20/1	20/1 GFI	40		1,620		BOYS' LOCKERS		
SPARE				41	20/1	20/1 GFI	42			1,800	BOYS' VISITOR LOCKERS		
30/1 PROVISION				43		20/1 GFI	44	1260			BOYS' VISITOR LOCKERS		
30/1 PROVISION				45			46				30/1 PROVISION		
30/1 PROVISION				47			48				30/1 PROVISION		
30/1 PROVISION				49			50				30/1 PROVISION		
30/1 PROVISION				51			52				30/1 PROVISION		
30/1 PROVISION				53			54				30/1 PROVISION		
30/1 PROVISION				55			56				30/1 PROVISION		
30/1 PROVISION				57			58				30/1 PROVISION		
30/1 PROVISION				59			60				30/1 PROVISION		
30/1 PROVISION				61			62				30/1 PROVISION		
30/1 PROVISION				63			64				30/1 PROVISION		
30/1 PROVISION				65			66				30/1 PROVISION		
30/1 PROVISION				67			68				30/1 PROVISION		
30/1 PROVISION				69			70				30/1 PROVISION		
30/1 PROVISION				71			72				30/1 PROVISION		
HP 4	2,200			73	25/2	15/3	74	1,200			BOYS' WASHER		
	2,200			75			76		1,200				
HP 6		2,200		77	25/2	15/3	78			1,200	GIRLS' WASHER		
	2,200			79			80	1,200					
HP 5		1,591		81	20/2	15/3	82		1,200		GIRLS' WASHER		
		1,591		83			84			1,200			
SUBTOTALS	8372	7701	7026				9650	9470	9470		SUBTOTALS		
VOLTAGE: 120/208V, 3 PH, 4W				AMPACITY: 200A		TOTAL VA, LINE 1			18022	Panel ID	B		
MAIN: MLO, TOP						TOTAL VA, LINE 2			17171				
MOUNTING: SURFACE						TOTAL VA, LINE 3			16496	LOC	GYMNASIUM RISER ROOM 1109		
NOTES: PANEL BOARD, 22K AIC, 120 KA INTEGRAL SPD., 2 EQUAL SECTIONS						TOTAL VA			51689				

**5** PANEL B SCHEDULE  
NO SCALE

DIRECTORY	VA LOAD			BRKR	BRKR		VA LOAD			DIRECTORY
	L1	L2	L3				L1	L2	L3	
PANEL A	21,891			250/3	200/3		18,022			PANEL B
		20,422						17,171		
			21,482						16,496	
SCHP 1	20,620			225/3	225/3		20,620			SCHP 2
		20,620						20,620		
			20,620						20,620	
ERV	1,084			25/3	30/3		500			BLEACHERS
		1,084						500		
			1,084						500	
100/3 PROVISION				30/3			500			BLEACHERS
								500		
									500	
100/3 PROVISION										100/3 PROVISION
225/3 PROVISION										225/3 PROVISION
BOY'S DRYER	12,000			150/3	150/3		12,000			GIRLS' DRYER
		12,000						12,000		
			12,000						12,000	
SUBTOTALS	55595	54126	55186				51642	50791	50116	SUBTOTALS
VOLTAGE: 120/208V, 3 PH, 4W				AMPACITY: 1200A	TOTAL VA, LINE 1			107237	Panel ID	MP
MAIN: MAIN BREAKER BOTTOM					TOTAL VA, LINE 2			104917		
MOUNTING: SURFACE					TOTAL VA, LINE 3			105302	LOC	GYMNASIUM RISER ROOM 1109
NOTES: PANEL BOARD, 22K AIC, SE LABEL, 250 KA INTEGRAL SPD.					TOTAL VA			317456		

**2** PANEL MP SCHEDULE  
NO SCALE

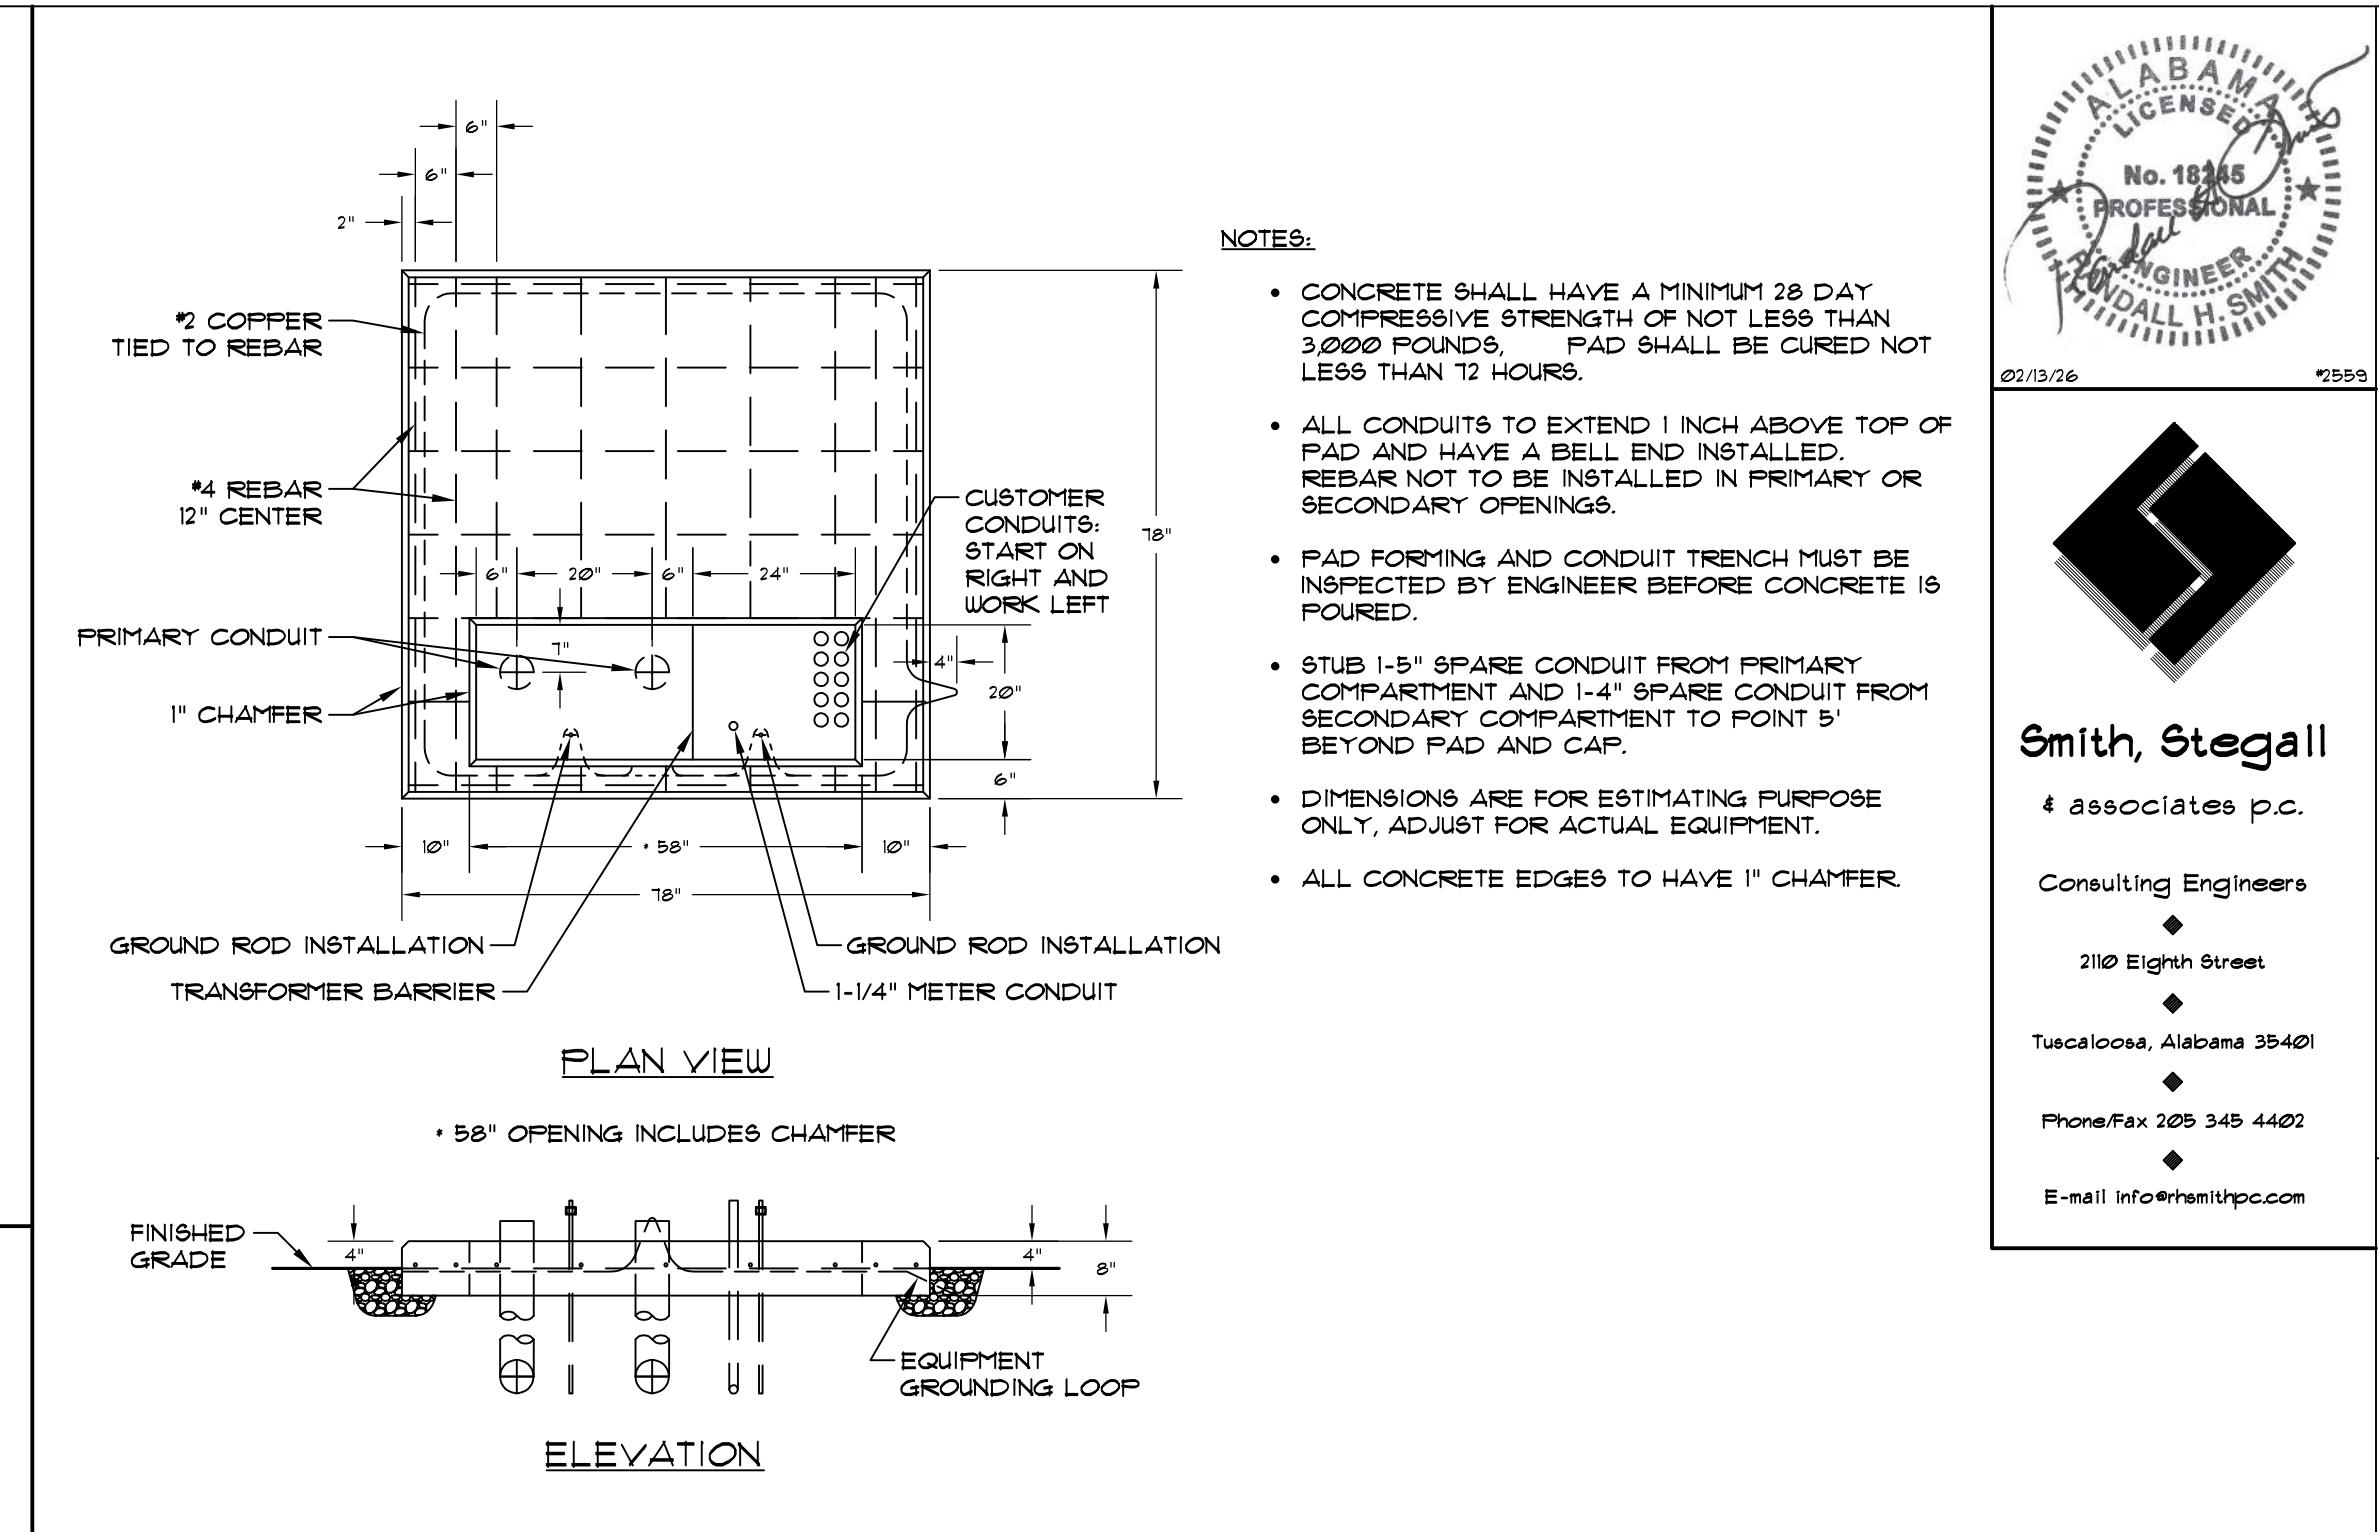

**8 TRANSFORMER PAD DETAIL**  
NOT TO SCALE



DIRECTORY	VA LOAD			CKT NO.	BRKR	BRKR	CKT NO.	VA LOAD			DIRECTORY
	L1	L2	L3					L1	L2	L3	
LCC - GYM LIGHTING ROW 1	1062			1	20/1	20/1	2	500			GOAL LIFT
LCC - GYM LIGHTING ROW 2		1062		3	20/1	20/1	4		500		GOAL LIFT
LCC - GYM LIGHTING ROW 3			1062	5	20/1	20/1	6			500	GOAL LIFT
LCC - GYM LIGHTING ROW 4	1062			7	20/1	20/1	8	1440			RECEPTACLE
LCC - GYM LIGHTING ROW 5		1062		9	20/1	20/1	10		1260		RECEPTACLE
LCC - GYM LIGHTING ROW 6			1062	11	20/1	20/1 GFI	12			360	WATER COOLER
LIGHTING	806			13	20/1	20/1	14	1080			RECEPTACLE
LIGHTING		438		15	20/1	20/1	16		360		RECEPTACLE
LIGHTING			412	17	20/1	20/1 GFI	18			180	RECEPTACLE - REFRIGERATOR
SCOREBOARD / SHOT CLOCK	360			19	20/1	20/1 GFI	20	180			RECEPTACLE - REFRIGERATOR
GYM FLOOR RECEPTACLE		360		21	20/1	20/1 GFI	22		180		RECEPTACLE - ICE MACHINE
GYM FLOOR RECEPTACLE			360	23	20/1	20/1	24			710	INVERTER
RECEPTACLE	360			25	20/1	20/1	26	180			SI - SNAPSHOT INTERFACE
RECEPTACLE		360		27	20/1	20/1	28		180		LCC - LIGHTING CONTROL CAB.
O.H. DOOR			500	29	20/1	20/1	30			180	AC - AUXILIARY CAB.
SPARE				31	20/1	20/1 *	32	360			FIRE ALARM CIRCUIT
SPARE				33	20/1	20/1 *	34		180		BI-DIRECTION AMPLIFIER
SPARE				35	20/1	20/1	36			360	RECEPTACLE - CBB
SPARE				37	20/1	20/1	38	360			RECEPTACLE - CBB
SPARE				39	20/1	20/1	40		360		RECEPTACLE - DATA RACK
SPARE				41	20/1		42				30/1 PROVISION
30/1 PROVISION				43			44				30/1 PROVISION
30/1 PROVISION				45			46				30/1 PROVISION
30/1 PROVISION				47			48				30/1 PROVISION
30/1 PROVISION				49			50				30/1 PROVISION
30/1 PROVISION				51			52				30/1 PROVISION
30/1 PROVISION				53			54				30/1 PROVISION
30/1 PROVISION				55			56				30/1 PROVISION
30/1 PROVISION				57			58				30/1 PROVISION
30/1 PROVISION				59			60				30/1 PROVISION
30/1 PROVISION				61			62				30/1 PROVISION
30/1 PROVISION				63			64				30/1 PROVISION
AREA LIGHTING			446	65	20/2		66				30/1 PROVISION
	446			67			68	4085			
PANEL T		2,230		69	50/2		70		4085		RC - RELAY CABINET
			2,230	71			72			4085	
FCU 3-1	2,500			73	30/2	25/2	74	1690			WATER HEATER
	2,500			75			76		1690		
HP 3		2,920		77	50/2	30/2	78			2500	FCU 2-1
	2,920			79			80	2500			
HP 1		1,405		81	20/2	40/2	82		2210		HP 2
			1,405	83			84			2,210	
SUBTOTALS	9516	9417	10397				12375	11005	11085		SUBTOTALS
VOLTAGE: 120/208V, 3 PH, 4W				AMPACITY: 250A		TOTAL VA, LINE 1			21891	Panel ID	A
MAIN: MLO, BOTTOM						TOTAL VA, LINE 2			20422		
MOUNTING: SURFACE						TOTAL VA, LINE 3			21482	LOC	GYMNASIUM ELECTRICAL 1104
NOTES: PANEL BOARD, 10K AIC, 120 KA INTEGRAL SPD., 2 EQUAL SECTIONS						TOTAL VA			63795		


\* INSTALL RED CIRCUIT BREAKER LOCK, SPACE AGE ETC

## 4 PANEL A SCHEDULE NO SCALE


DIRECTORY	VA LOAD		CKT NO.	BRKR	BRKR	CKT NO.	VA LOAD		DIRECTORY		
	L1	L2					L1	L2			
LIGHTING	570		1	20/1	20/1	2	230		EXTERIOR LIGHTING		
RECEPTACLE - REFRIGERATOR		180	3	20/1 GFI	20/1	4		360	RECEPTACLE		
RECEPTACLE - REFRIGERATOR	180		5	20/1 GFI	20/1	6	360		RECEPTACLE		
RECEPTACLE - ICE MACHINE		180	7	20/1 GFI	20/1	8		360	RECEPTACLE		
RECEPTACLE	180		9	20/1	20/1	10	180		RECEPTACLE		
CEILING HEATER		1,500	11	20/1	20/1	12			SPARE		
SPARE			13	20/1	20/1	14			SPARE		
SPARE			15	20/1	20/1	16			SPARE		
SPARE			17	20/1	20/1	18			SPARE		
WATER HEATER		2,250	19	30/2		20			30/1 PROVISION		
	2,250		21			22			30/1 PROVISION		
HP-8		2,200	23	25/2		24			30/1 PROVISION		
	2,200		25			26			30/1 PROVISION		
HP-7		1,590	27	20/2		28			30/1 PROVISION		
	1,590		29			30			30/1 PROVISION		
SUBTOTALS	6970	7900					770	720	SUBTOTALS		
VOLTAGE:120/240V, 1PH			AMPACITY: 100A		TOTAL VA, LINE 1		7740	Panel ID	C		
MAIN: MAIN BREAKER, BOTTOM					TOTAL VA, LINE 2		8620				
MOUNTING: SURFACE					TOTAL VA		16360	LOC	RESTROOM BUILDING		
NOTES: PANEL BOARD, 10K AIC, SE LABEL, 250 KA INTEGRAL SPD.							16360				

**3** PANEL C SCHEDULE  
NO SCALE

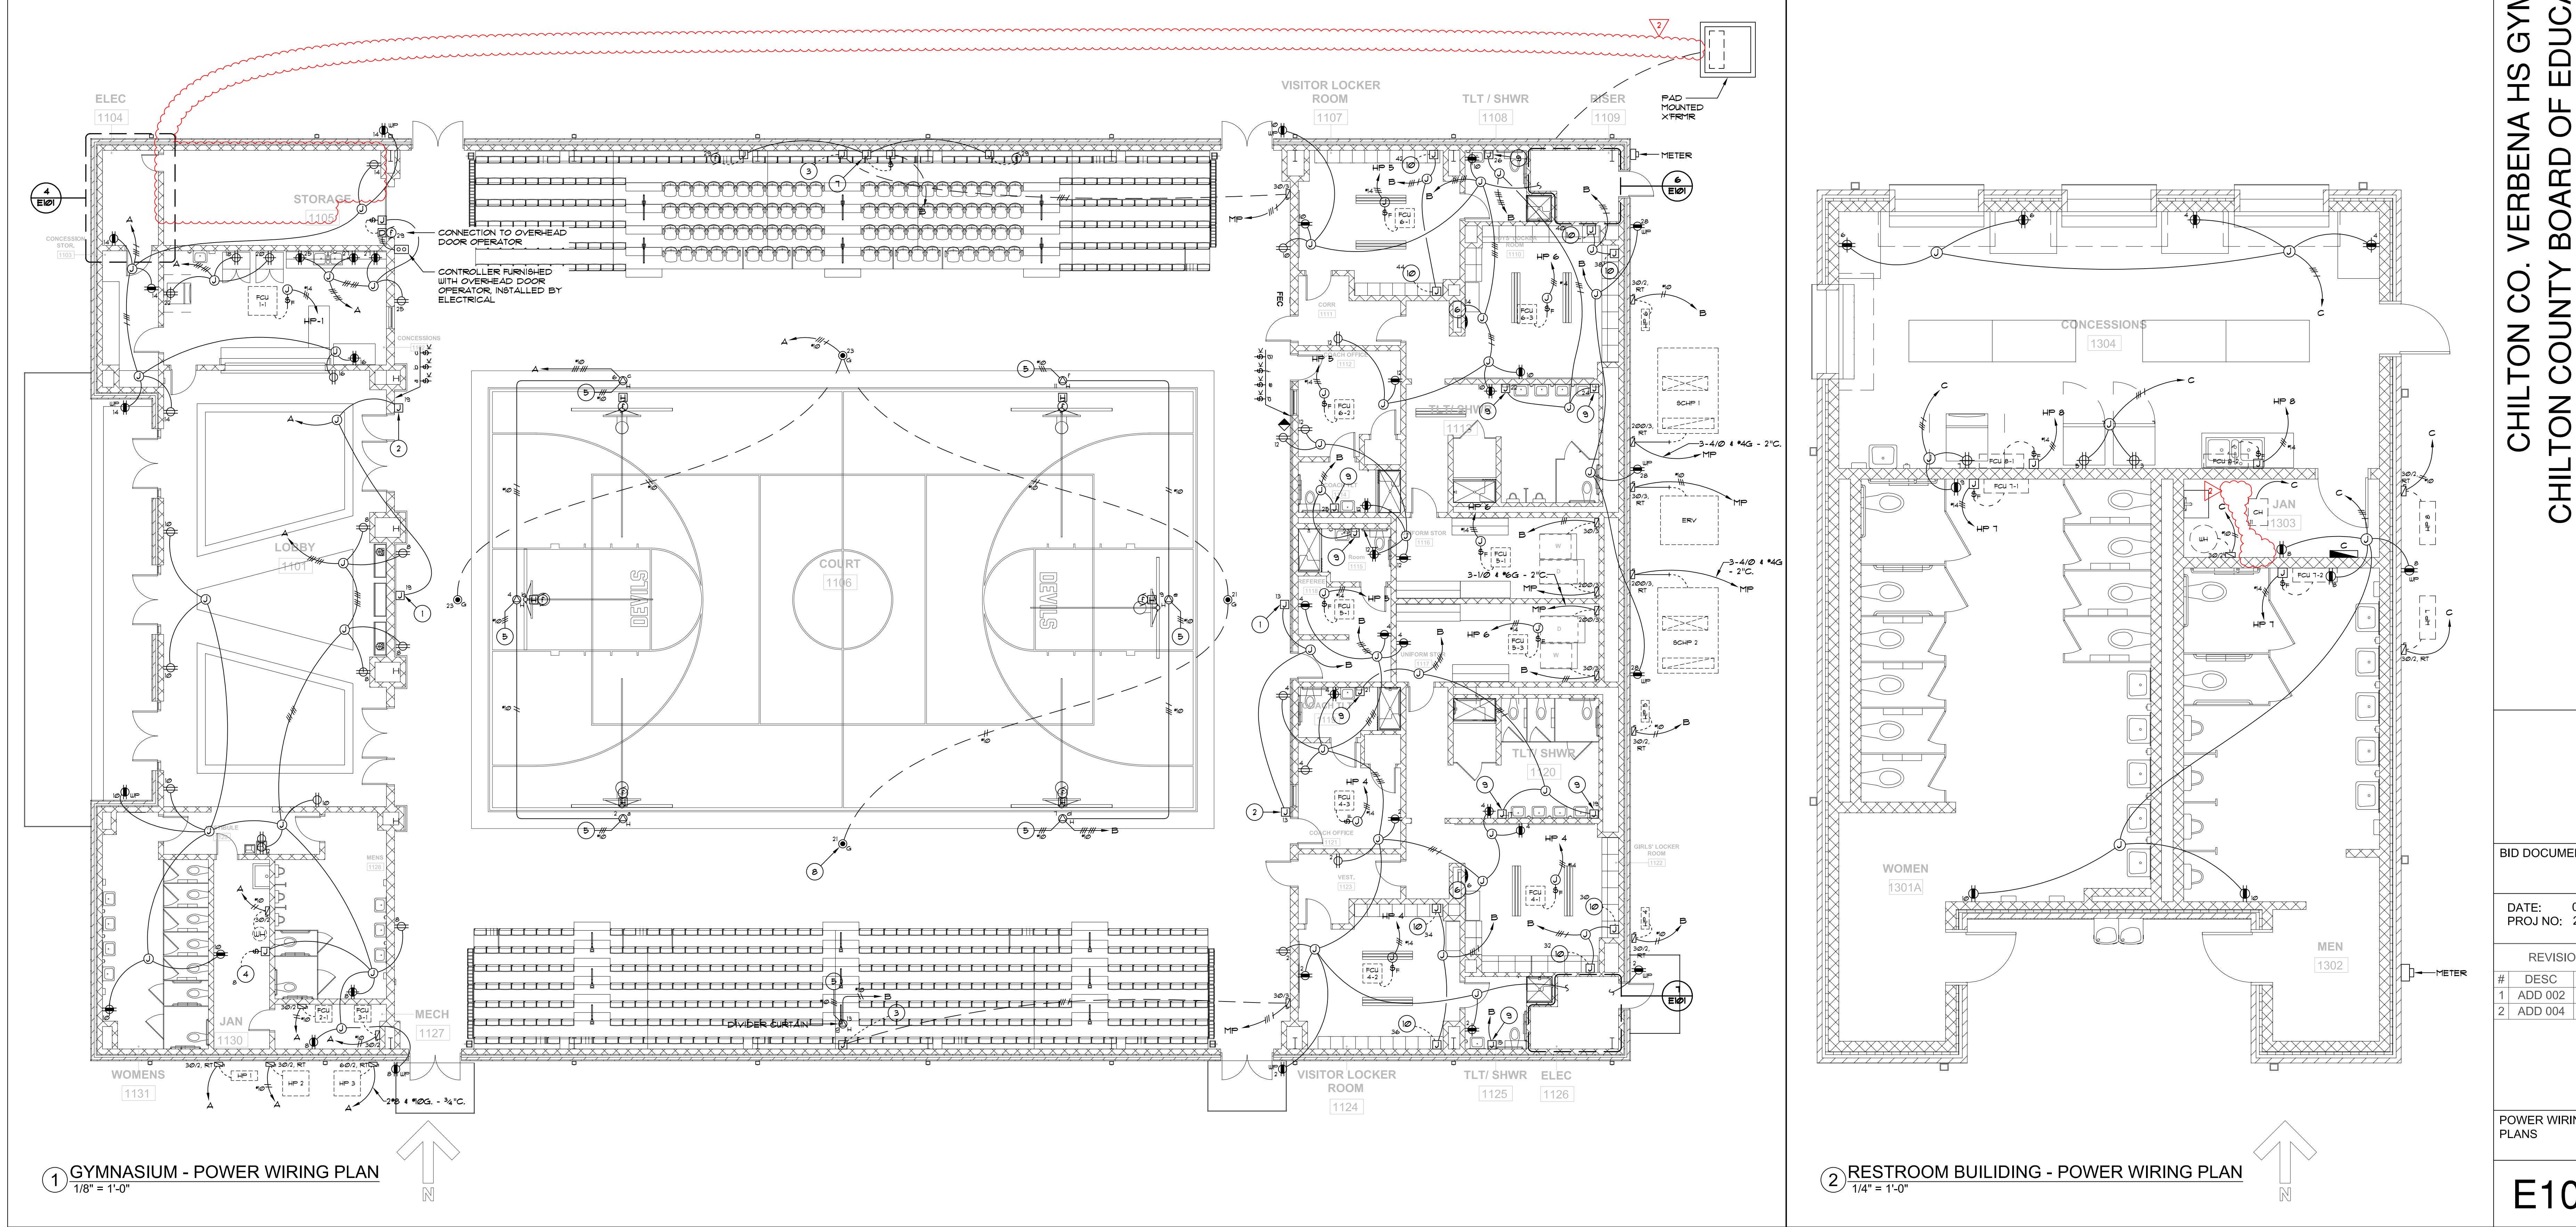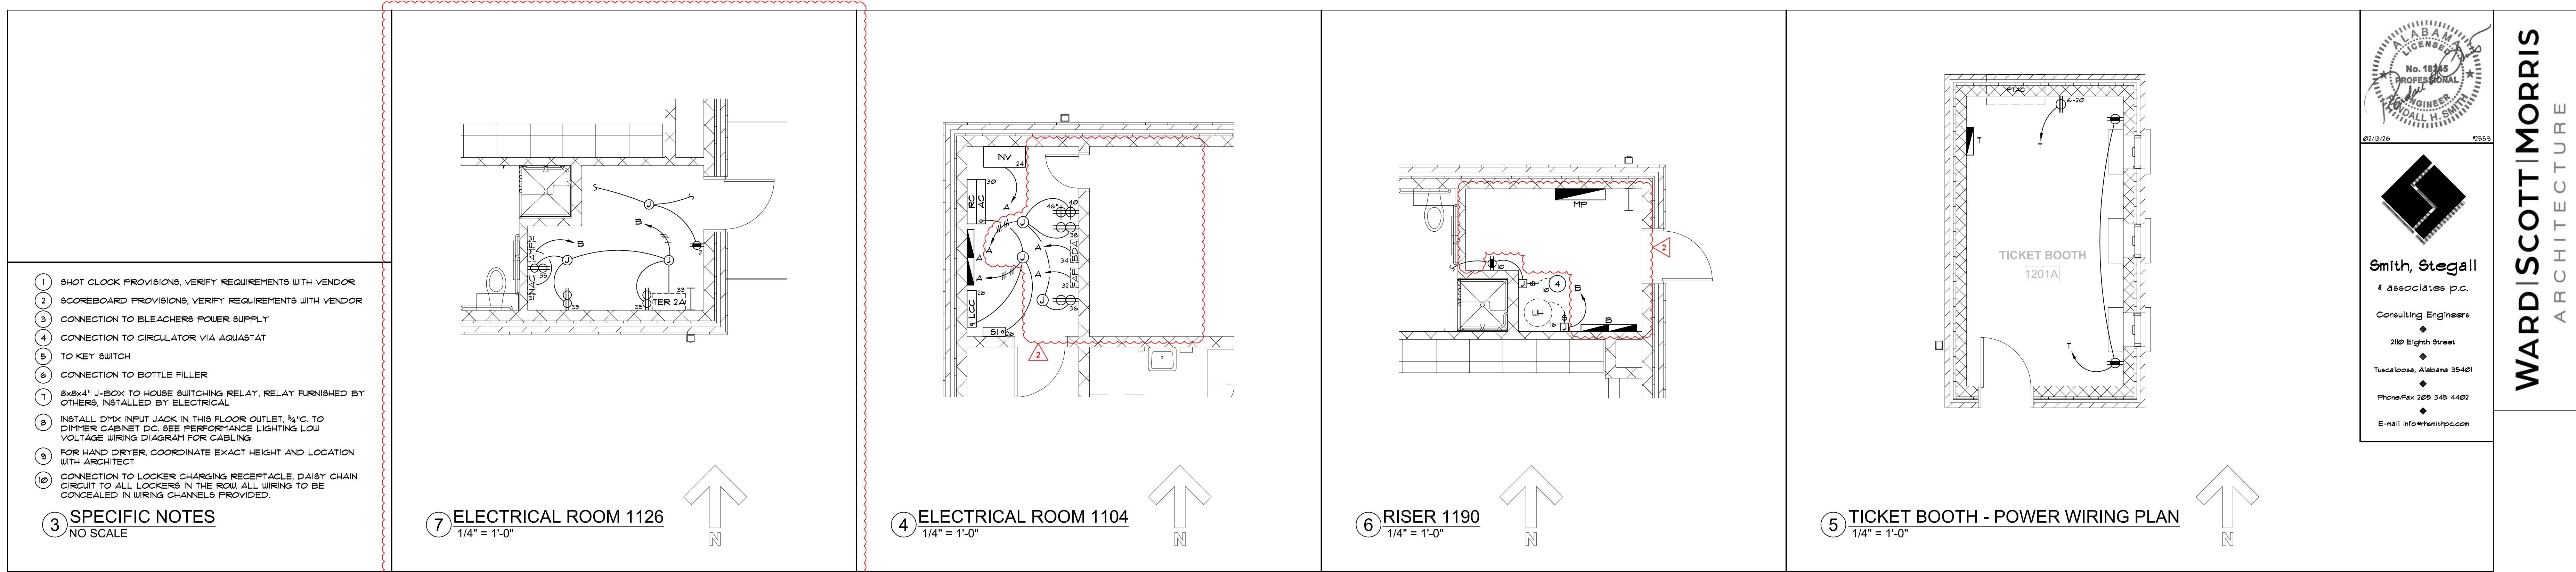

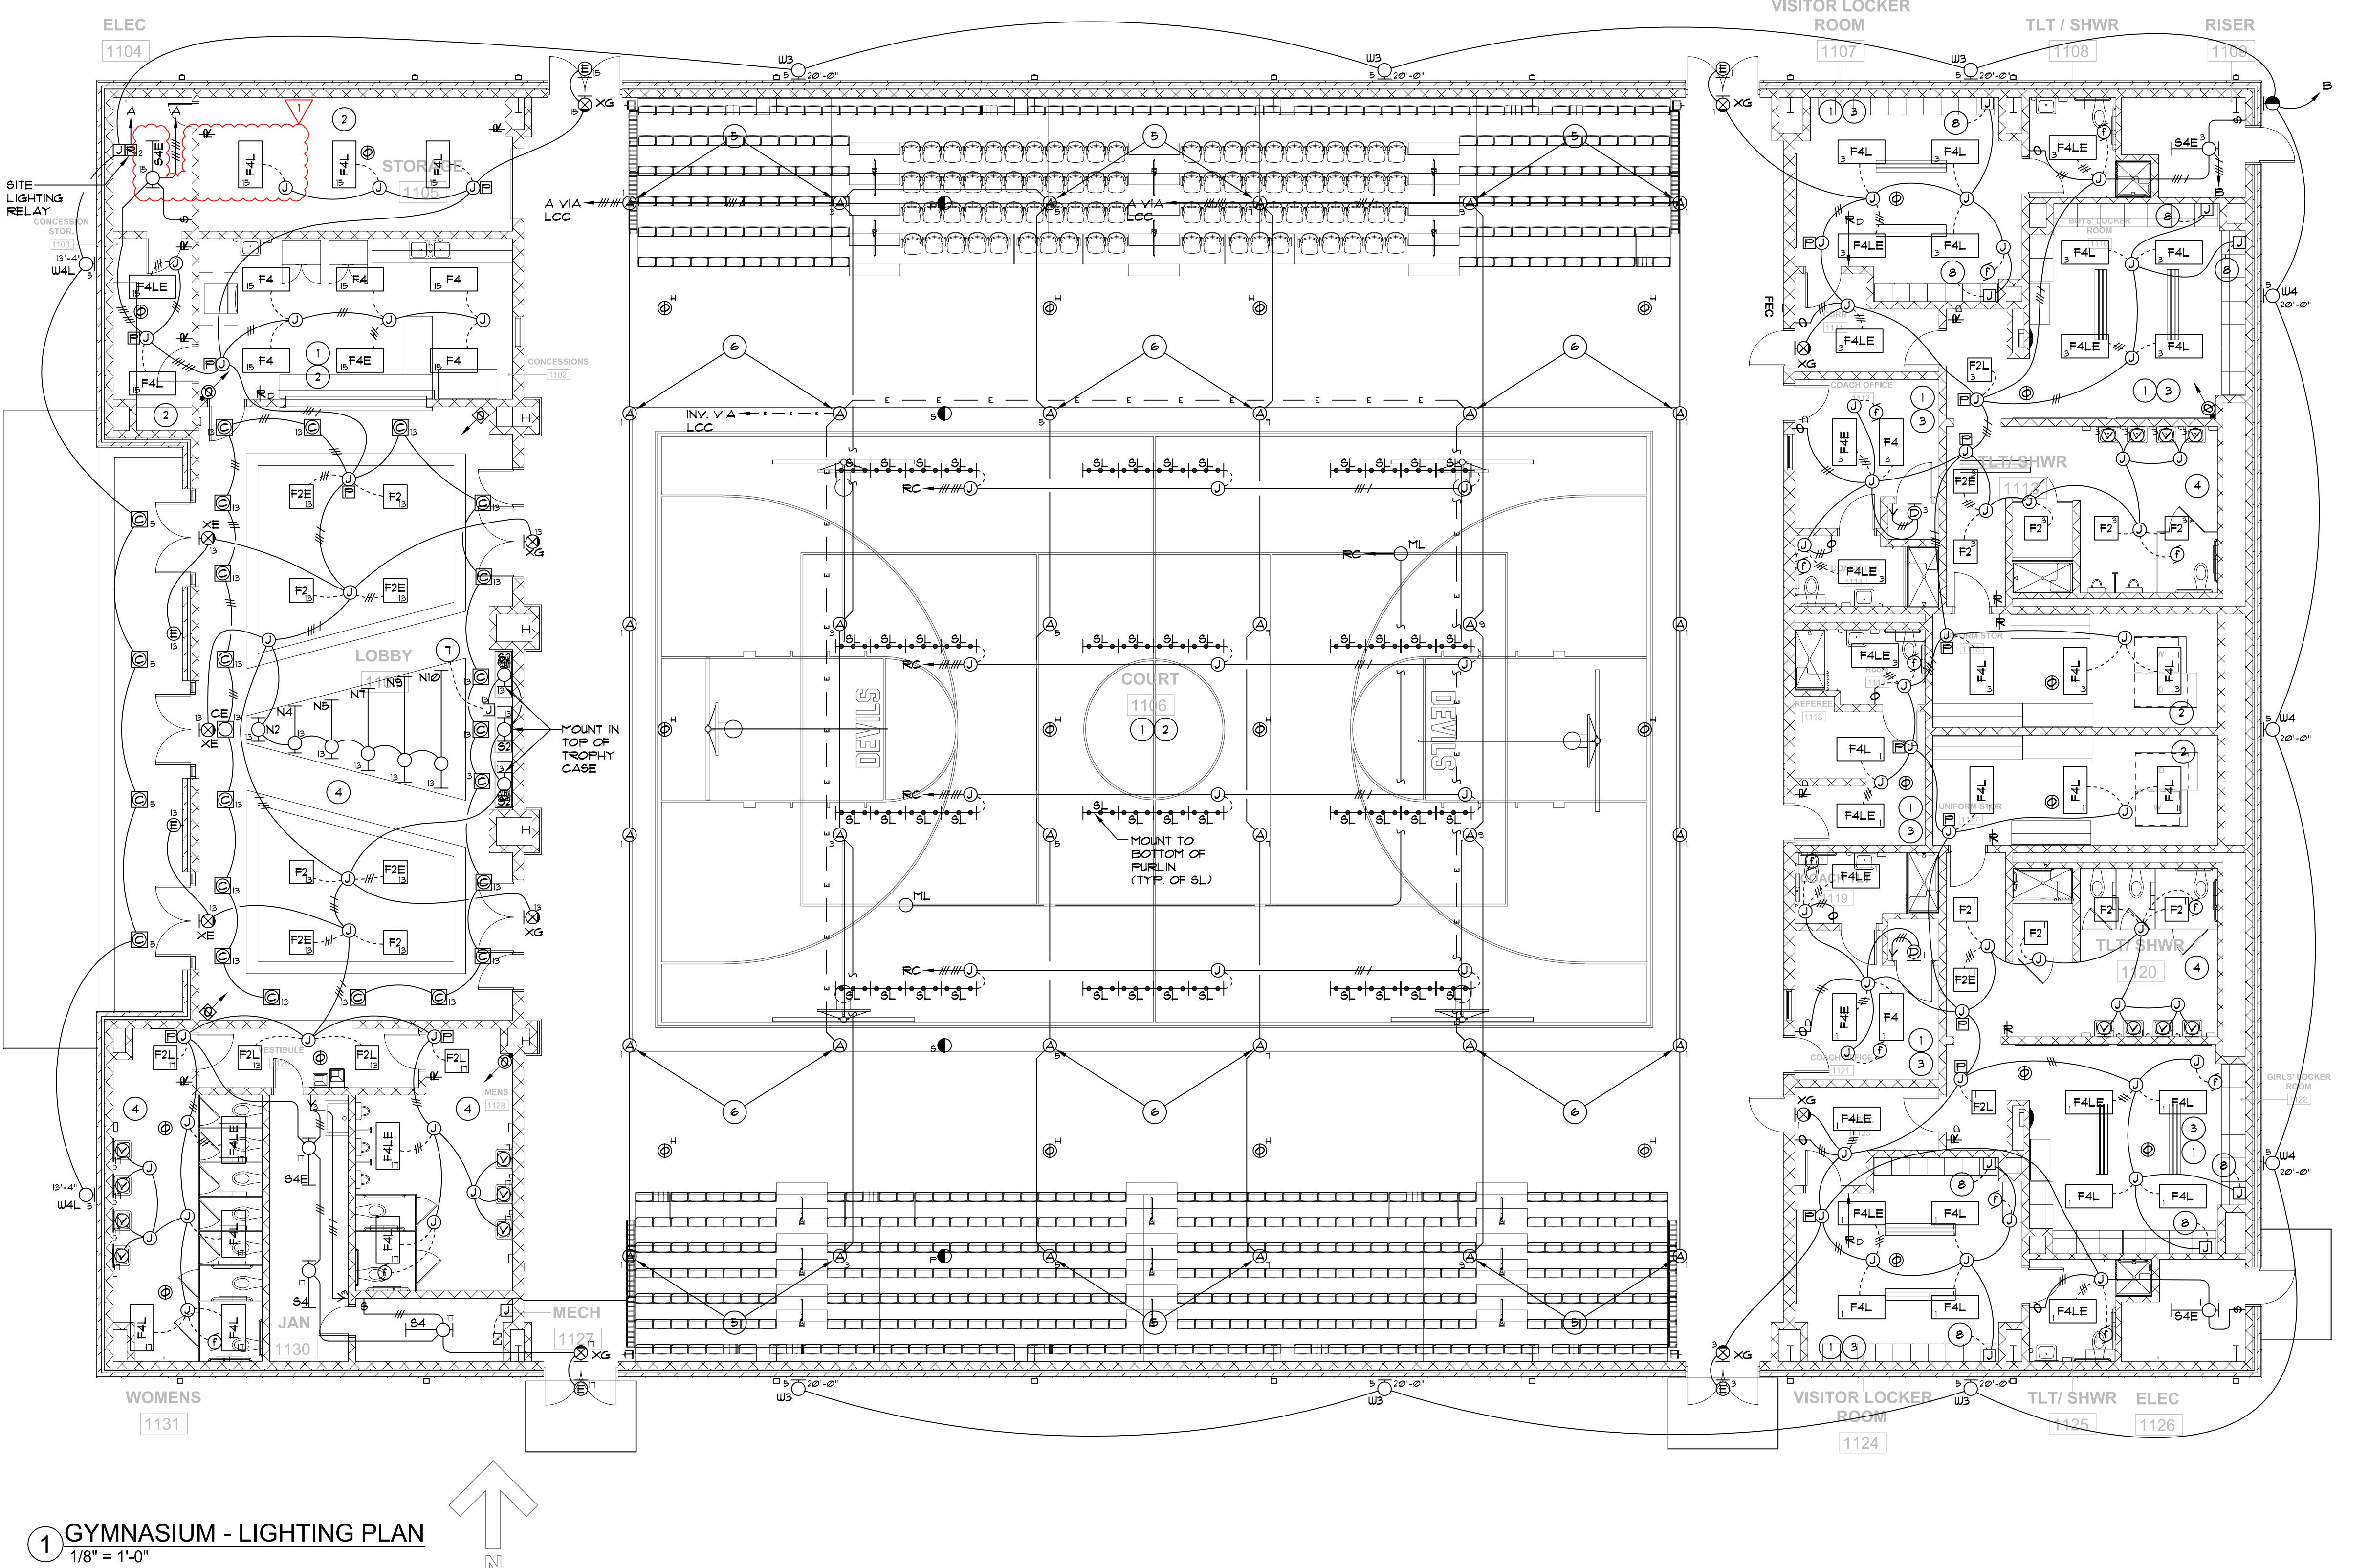

**2 RESTROOM BUILDING - LIGHTING PLAN**  
1/4" = 1'-0"

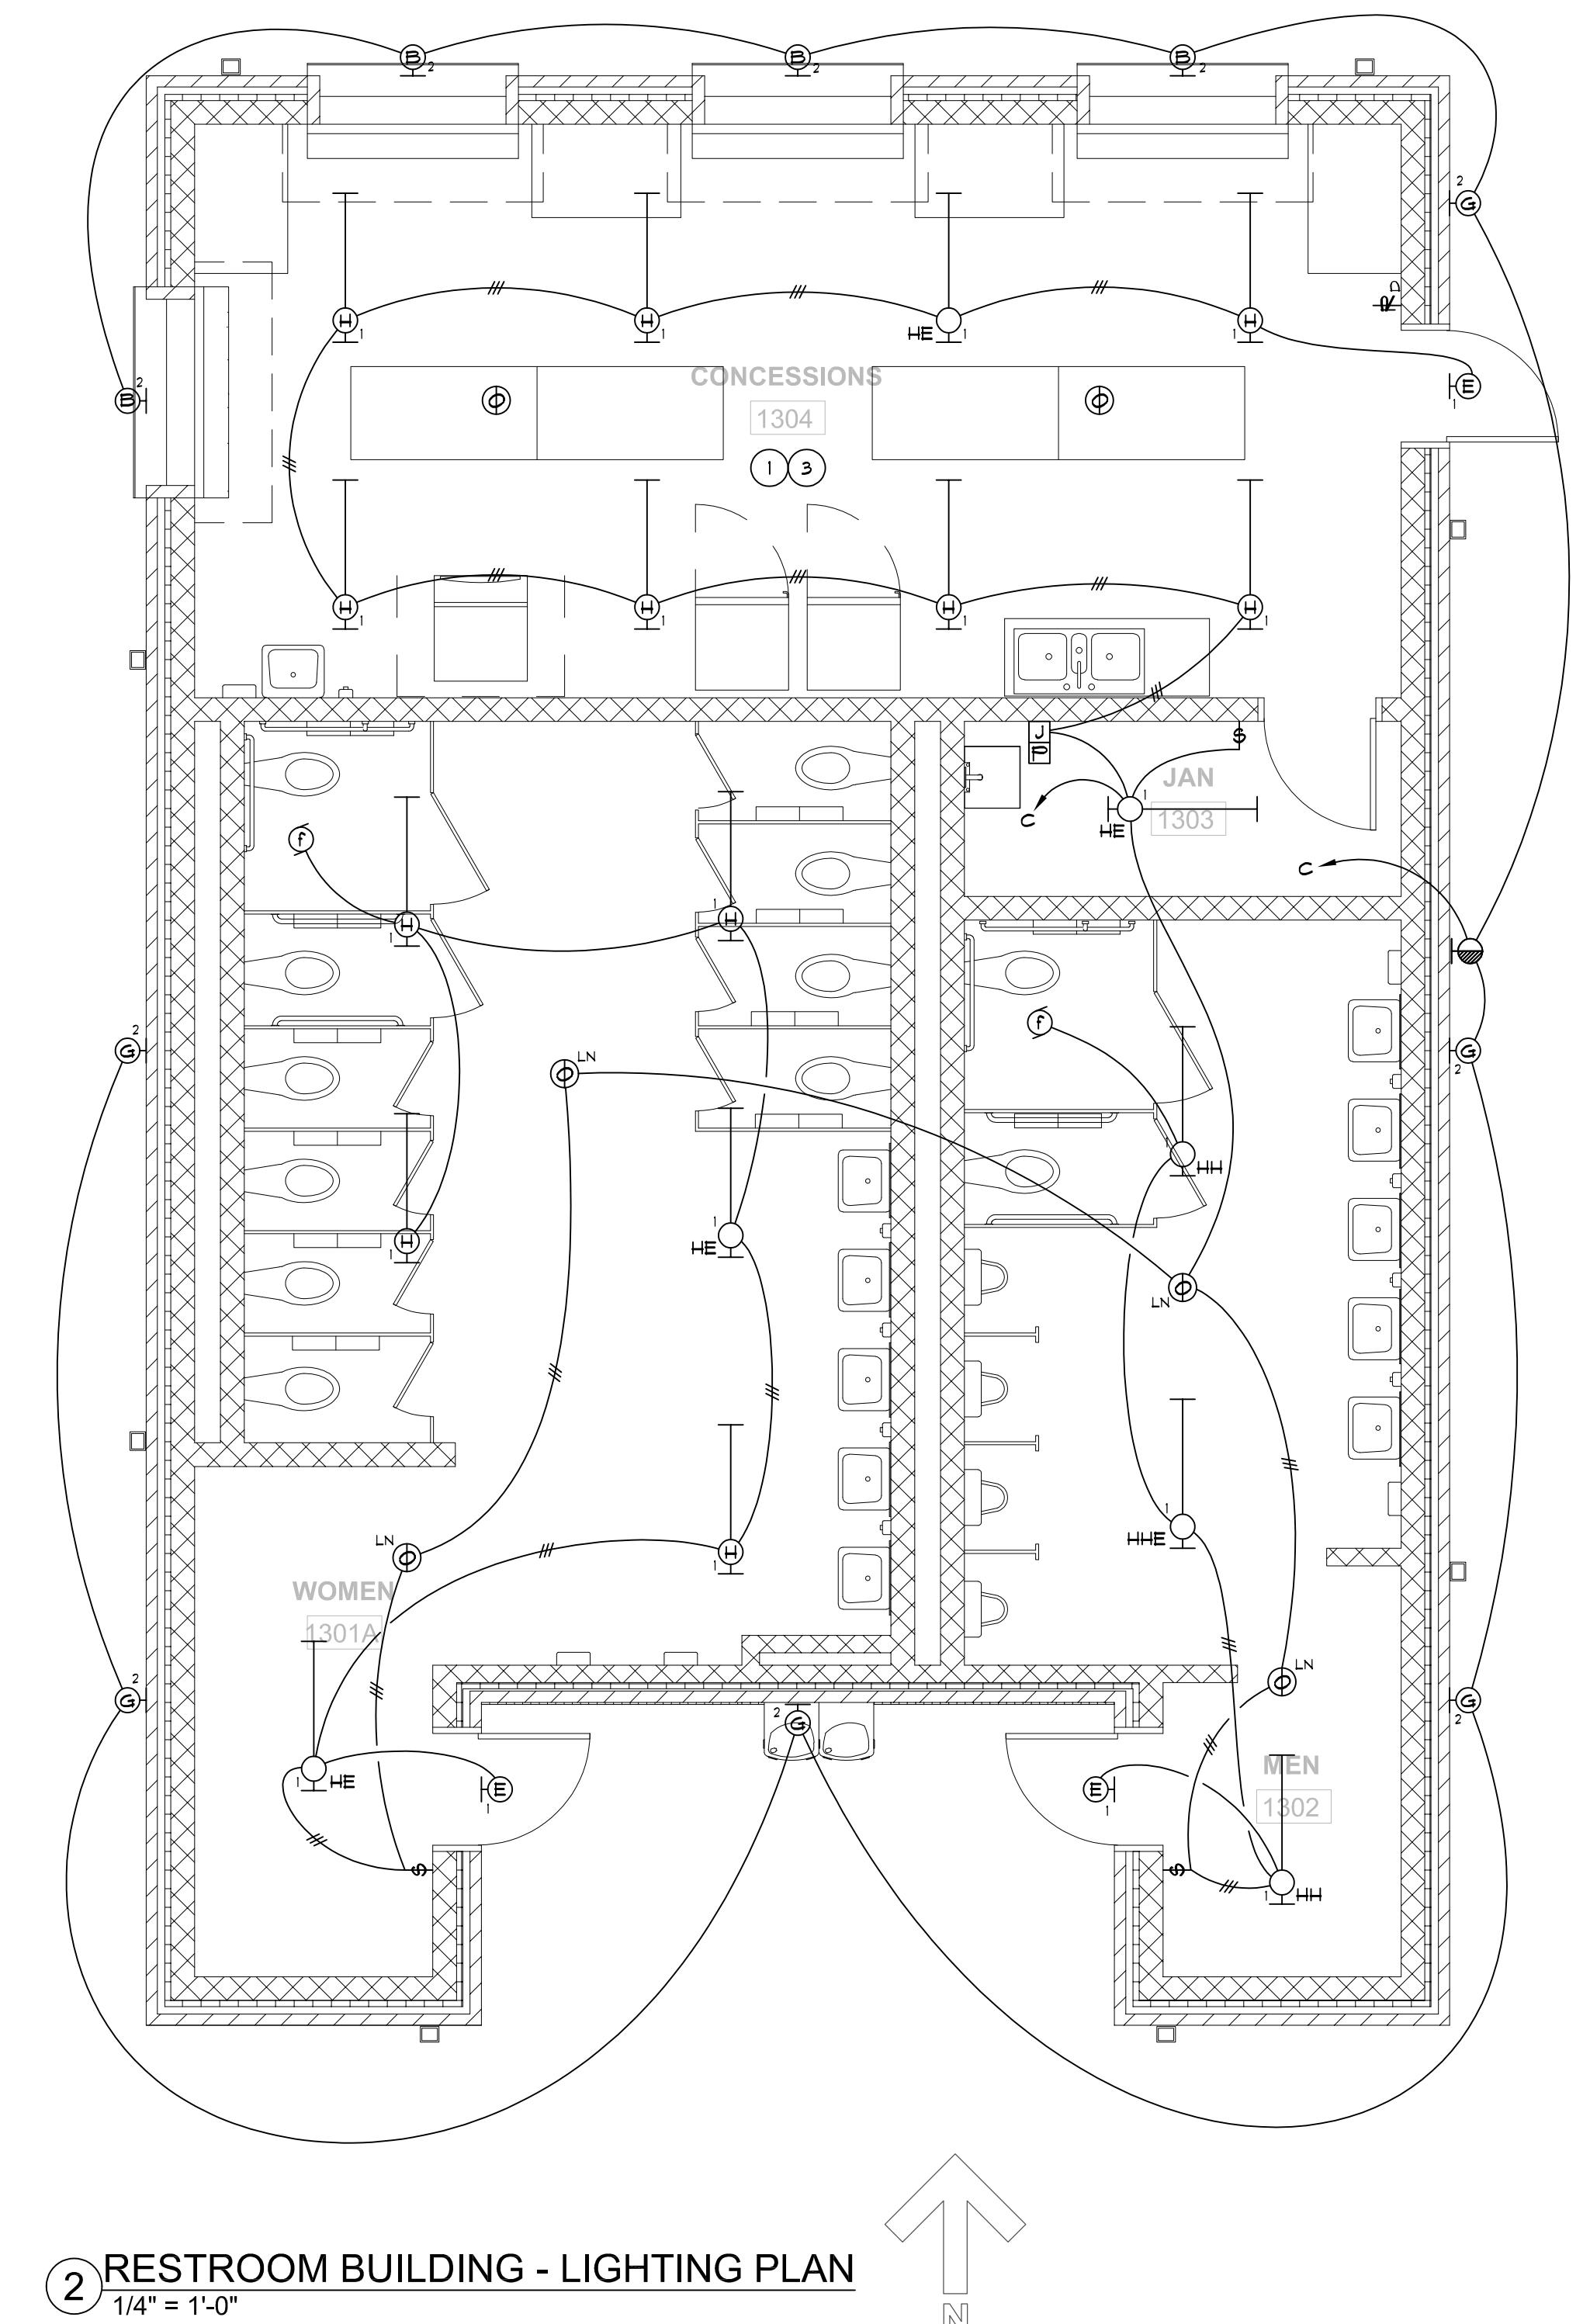

**E201**

**CHILTON COUNTY BOARD OF EDUCATION  
202 COUNTY ROAD 510, VERBENA, AL 36091**

**WARD|SCOTT|MORRIS**  
ARCHITECTURE  
210 Eighth Street  
Tuscaloosa, Alabama 35401  
Phone/Fax 205 345 4402  
E-mail: info@wardscottm.com

ALABAMA  
LICENSED PROFESSIONAL ENGINEER  
No. 12945  
RANDALL H. SMITH  
02/13/26

Smith, Stegall  
& associates p.c.  
Consulting Engineers  
210 Eighth Street  
Tuscaloosa, Alabama 35401  
Phone/Fax 205 345 4402  
E-mail: info@smithpc.com

