
WASTE
WATER
NORTH



EBP 219297

CV 00067580 CCF

EAGLE RESEARCH CORPORATION

CV

ITRON INC 09/22/22 OB

ERG-7000-502
500G REMOTE
W/5' CABLE (VOLUME CORRECTOR)

28 0103449810 500G

100 cubic ft / rev
020535
CCF

ITRON INC 09/22/22 OB

ERG-7000-502
500G REMOTE
W/5' CABLE (VOLUME CORRECTOR)

28 0103449814 500G




2756873
CLOSE
OPE






WASTE
WATER

LOAD CAPACITY
125 LBS / SQ FT

LOCKOUT
TAGOUT
An Open And Shut Case

TAG CENTER

GATOR

TH
6x4

HYUNDAI

FEED FROM PANEL PPM

MCC 4

FED FROM PPM

DIKE AREA POWER

POWER PLASMA CUTTER

RPD

FORKLIFT BATTERY CHARGER

MILLER WELDER

Check Gnd Here

E-01-4484-0039

DISC-RPC

SAFETY SWITCH

E-01-4484-0036

277/480V TEST BENCH

E-01-4484-0037

ON

OFF

TO RECEPTICLES

120/240V TEST BENCH

E-01-4484-0038

TO RECEPT

SWITCHED

UNSWITCHED

LIGHT

Radios Must Be
Turned Off
While
In Charging
Cradle

WESTELL

E-01-4484-0035

XFMR T2

KIM

GREG


Tawni

Danna





SHELTER IN PLACE/FIRE EXTINGUISHER/AED LOCATIONS/EVACUATION ROUTE, O&M BUILDING

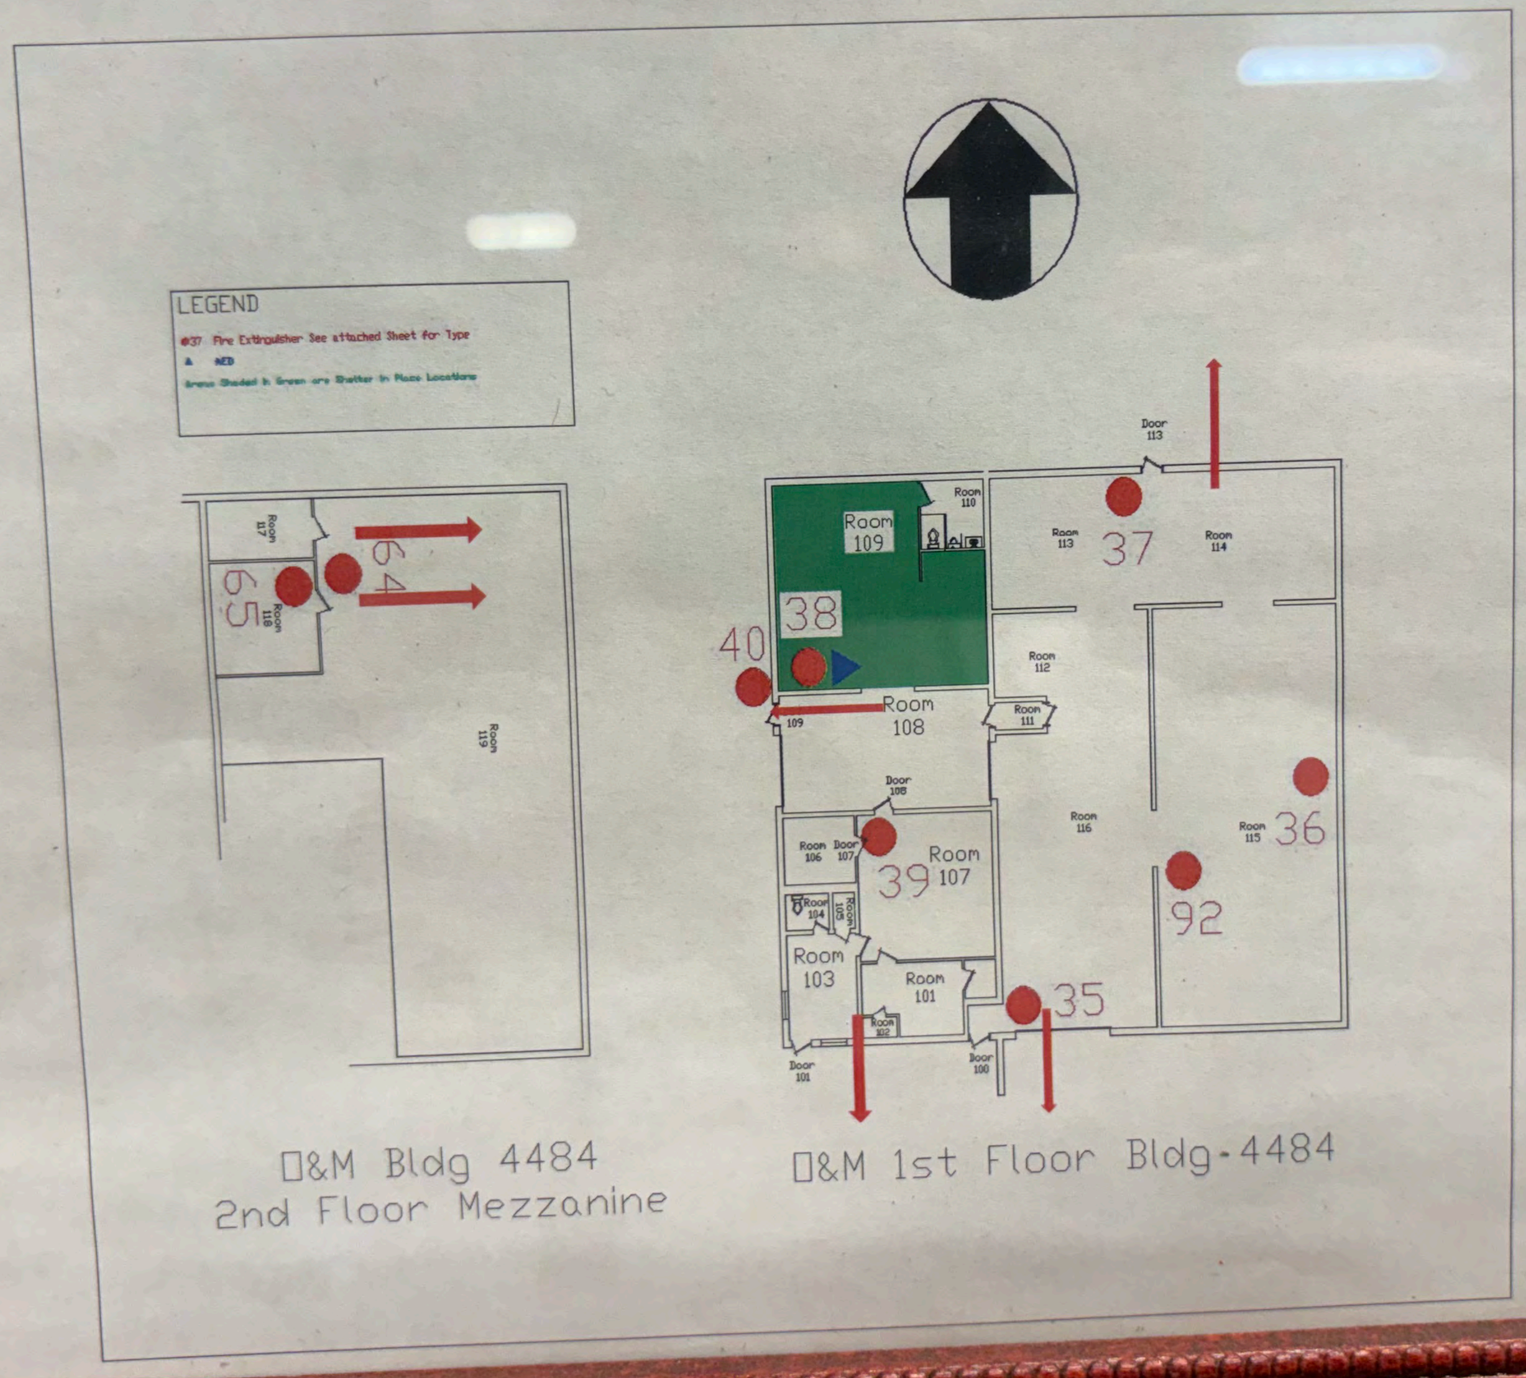


NOTICE
AVISO
NOTICE




152
evapco


evapco


evapco


NOTICE
EMERGENCY
FUEL SHUT OFF
NOTICE
WALLOPS


Northville Sch
UNPLUG AFTER EACH USE


ABB
ZENITH ZTS
E·T·N Transfer Switch


EATON
Transfer Switch
NOTICE
Panel MPA
277/480V
From ATS-1
WARNING
NOTICE
Instruction booklet
located in this section.
DANGER
ATS-1
SERVICE ENTRANCE BREAKER
200A 277/480V
FROM APCO TRANSFORMER
SOURCE 1 BREAKER
ATS-2A
(Panel PPM)
ATS-2B
(Panel PPEQ)


EATON
Transfer Switch
NOTICE
Panel MPA
277/480V
From ATS-1
WARNING
NOTICE
Instruction booklet
located in this section.
ATS-2A
(Panel PPM)
ATS-2B
(Panel FPEC)
ATS-1
2000A 277/480V
Warning: Dual Sources
Source 1 - APCO Transformer
Source 2 - Generator 1
SERVICE ENTRANCE BREAKER
2000A 277/480V
FROM APCO TRANSFORMER
SOURCE 1 BREAKER

ABB

TH ZTS

Panel PPM
277/480V
From ATS-2A

EATON

WARNING
Arc Flash and Shock Risk

NEW PANEL PPM

DL-MPA

CAT

EATON

NOTICE

ATS-2A
1200A 277/480V
Warning: Dual Sources
Source 1 - Panel MPA Breaker 7
Source 2 - Generator 2A

ABB

ZENITH ZTS

DANGER

Panel PPM
277/480V
From ATS-2A

EATON

WARNING
Arc Flash and Shock Risk
Appropriate PPE Required

NEW: PANEL PPM

PP-2

Z-LINE SERIES

GlasFloss


UH-1
STERLING
DAIKIN
DANGER
PELIGRO
Glasfloss
DANGER


FAN MOTOR FROM MCC 4482 0201
NORTH COOLING TOWER FAN DRIVE
MITSUBISHI ELECTRIC
E 01 4482 0298
! WARNING
Arc Flash and Shock Risk
Appropriate PPE Required
FLASH PROTECTION
SHOCK PROTECTION
ON

Panel FPEQ
277/480V
From ATS-2B

EATON

WARNING
Arc Flash and Shock Risk
Appropriate PPE Required
480 VAC Nominal Voltage
110 in Arc Flash Boundary
26.3 cal/cm^2 Available Incident Energy
18 in Working Distance
Required PPE: Consult NFPA 70E Table
Location: FP-EQ
Shawnee, LLC
1120 W Hance Court
Tempe, Arizona
(480) 892-0001

NEW: PANEL FPEQ

ATS-2B
1200A 277/480V
Warning: Dual Sources
Source 1 - Panel MPA Breaker 8
Source 2 - Generator 2B

DANGER
Hazardous Voltage.
Will shock, burn,
or cause death.
Do not touch
until ALL power
is disconnected.

ABB

ZENITH ZTS

NOT AN EXIT

148

NOTICE
EAR PROTECTION MUST BE WORN BEYOND THIS POINT
WHEN CHILLER IS OPERATIONAL
AVISO
DEBE USARSE PROTECCION PARA LOS OIDOS MAS ALLA DE ESTE PUNTO

To Chiller Room

COBRATE EMERGENCY CONTACT NUMBERS

StarWatch Security Systems
CAUTION
UNISYS
StarWatch Security Systems
CAUTION
DAQ
SHERLOCK